"YORKSHIRE-4248"

PAD SIZE: 40'x 112'-8"

GENERAL NOTES:

- NO STRUCTURAL CHANGES FROM THE APPROVED PLANS SHALL BE MADE IN THE FIELD UNLESS, PRIOR TO MAKING CHANGES, A WRITTEN APPROVAL IS OBTAINED FROM THE ENGINEER / ARCHITECT OF RECORD. IF CHANGES ARE MADE WITHOUT WRITTEN APPROVAL, SUCH CHANGES SHALL BE THE LEGAL AND FINANCIAL RESPONSIBILITY OF THE CONTRACTORS INVOLVED, AND SHALL BE THE RESPONSIBILITY OF END PARTIES TO REPLACE OR REPAIR THE CONSTRUCTION AS DIRECTED BY THE ENGINEER.
- CONNECT A/C UNIT TO CONCRETE SLAB w/ (2) USP ACS ANGLE CLIP OR SIMILAR AT FOUR CORNERS USING (1) 3/8" TAPCON, MIN. OF 1" LENGTH INTO CONCRETE AND (2)-#8 METAL SCREWS INTO A/C UNIT FRAME (LOCATION TO BE DETERMINED BY A/C CONTRACTOR) PER CLIP
- ELECTRIC SERVICE GROUND TO BE ECHED TO FOOTING STEEL
- CONTRACTOR TO VERIFY ALL HOSE BIBS LOC. & TYPE
- CONTRACTOR TO ROUGH IN AIR CHASE A/C DRAIN LINES, & CONDUITS AS NEEDED
- CONTRACTOR TO VERIFY ANY PROVISIONS FOR SUNROOM RECEPTORS, SILLS & CURB REQUIREMENTS @ ALL DOORS
- CONTRACTOR TO VERIFY ANY PROVISIONS FOR SUNROOM REINFORCEMENT TO BE EETER BY GENERAL CONTRACTOR
- CONTRACTOR TO CONFIRM ANY SLOPE OF SLAB REQUIREMENT
- BOTTOM OF FOOTING MIN 12" BELOW FINISH GRADE
- ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 2017 (6TH ED.) AND LOCAL CODES AS THEY MAY APPLY

A. FLOOR PLAN:

A.1. **WINDOWS, DOOR AND PANEL CRITERIA:**
- A.1.1. GARAGE DOOR TO BE CERTIFIED W/ MPR, FOR 140 M.P.H.
- A.1.2. ALL DOORS TO BE 6'-0" TALL U.N.O. OR PER BUILDER/CLIENT.
- A.1.3. ALL EXTERIOR DOOR MATERIALS SHALL BE ABLE TO RESIST THE LOADING REQUIREMENTS OF THE FBC SECTION 1609.1 FOR THE 140 MPH WIND LOAD. THE CONTRACTOR IS REQUIRED TO PROVIDE DOCUMENTATION FOR DOORS DEMONSTRATING COMPLIANCE WITH THESE SPECIFICATIONS.
- A.1.4. THE MANUFACTURER'S SPECIFICATIONS AND TEST RESULTS FOR THE REFERENCED WINDOWS, SKID, DOORS AND PANELS IN REGARDS TO COMPLIANCE WITH FLORIDA BUILDING CODE SECTION 1609 FOR A 140 MPH, 3 SECOND GUST, WIND LOAD HAVE BEEN REVIEWED AND ACCEPTED BY THE ENGINEER OF RECORDS FOR USE ON THIS PROJECT WHEN INSTALLED IN ACCORDANCE WITH THESE PLANS AND THE MANUFACTURERS SPECIFICATIONS.

A.2. BAR/REESTAMT DRYWALL OR ALL CEILINGS.

A.3. OPENINGS FROM A PRIVATE GARAGE DIRECTLY INTO A ROOM USED FOR SLEEPING PURPOSES SHALL NOT BE PERMITTED. OTHER OPENINGS BETWEEN THE GARAGE AND RESIDENCE SHALL BE EQUIPPED WITH SOLID WOOD DOORS NOT LESS THAN 1-3/8" THICK, SOLID OR HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1-3/8" THICK, OR 20-MINUTE FIRE-RATED DOORS.

A.4. DUCTS IN THE GARAGE AND DUCTS PENETRATING THE WALLS OR CEILINGS SEPARATING THE DWELLING FROM THE GARAGE SHALL BE CONSTRUCTED OF A MIN. NO. 26 GAGE SHEET STEEL OR OTHER APPROVED MATERIAL AND SHALL HAVE NO OPENINGS INTO GARAGE.

A.5. THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE AND ITS ATTIC BY NOT LESS THAN 1/2 INCH GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH humiliate ROOMS SHALL BE SEPARATED FROM ALL SUCH ROOMS BY NOT LESS THAN 5/8" TYPE X GYPSUM BOARD OR EQUIVALENT. WHERE THE SEPARATION IN A FLOOR-CEILING ASSEMBLY, THE STRUCTURE SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED BY NOT LESS THAN 1/2 INCH GYPSUM BOARD OR EQUIVALENT.

A.6. C.M.U. WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL SWS = SHEAR WALL SEGMENTS

A.7. FRAME WALL SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL SWS = SHEAR WALL SEGMENTS

A.8. COLUMNS SHALL BE CONSTRUCTED OF STANDARD MASONRY UNITS OR PLASTER BLOCK OR MAY BE CAST IN PLACE CONCRETE. MASONRY COLUMN HEIGHT SHALL BE 12 FEET TO TOP OF BOND BEAM. COLUMNS SHALL CONTAIN A MINIMUM OF FOUR VERTICAL BARS, ONE IN EACH CORNER.

A.9. **BATHROOMS:**
- A.9.1. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
- A.9.2. ALL BATHROOM VANITIES SHALL BE 34" HEIGHT, U.N.O.

B. FOUNDATION:

B.1. FLOOR SLAB OF PLANT MIX CONCRETE 2500 P.S.I. 4" THICK WITH FIBER MESH REINFORCEMENT WITH 6 MIL. POLY. VAPOR BARRIER OVER COMPACTED CLEAN FILL OR. FLOOR SLAB OF PLANT MIX CONCRETE 2500 P.S.I. 4" THICK WITH 6x6 10/10 GAUGE REINFORCED MAT. WITH MIN. 6" COVER WITH 6 MIL. POLY. VAPOR BARRIER OVER COMPACTED CLEAN FILL.

B.2. AS AN ALTERNATE, A 6x6 w/1. 10 WELDED WIRE FABRIC EXTENDING A MIN. OF 18" INTO SLAB AND 8" INTO CMW BLOCK OR TOP COURSE.

B.3. SOIL TESTING IS RECOMMENDED

B.4. FOOTINGS SHALL BEAR ON UNDISTURBED SOIL AND PROPERLY COMPACTED FILL. (2000 PSF MIN.). FILL MATERIAL SHALL BE COMPACTED TO 95% DENSITY OF A STANDARD PROCTOR. TO BE VERIFIED BY GENERAL CONTRACTOR / OWNER.

B.5. NO WOOD CHOICE STAKES PERMITTED

B.6. TERMITE TREATMENT TO BE APPLIED BY EITHER TREATED SOIL, BORA-CARE APPLICATION & PER. MANUFACTURER SPECS. CERTIFICATE OF APPLICATION MUST BE MADE AVAILABLE AT TIME OF INSPECTION TO PROVIDE APPLICATION.

B.7. FOOTINGS SHALL BE CONSTRUCTED WITH NO LESS THAN 3# X HEIGHT PLANT BEFORE TO SCHEDULE # 60L.2# FOR FOOTER AND STEEL REINFORCEMENT STEEL. ADDITIONALLY IT IS REQUIRED TO PLACE (1)#5 REBAR AT O.C. HOOKED INTO BOND BEAM AND TIED OFF TO REINFORCEMENT LOCATED IN TOP COURSE / BOND BEAM WHILE ALSO EXTENDING A MIN. OF 18" INTO SLAB.

B.8. A 3/4. OR 1/2 INCH (2" PVC OR A SCALDING DRAIN PARKING UNDER A FOOTING OR THROUGH A FOUNDATION WALL SHALL BE PROVIDED WITH A RELIEVING ARCH, OR THERE SHALL BE BUILT INTO THE MASONRY WALL WITH AN INCH PIPE. BLEEDS (THIS PIPE) SHOULD GREATER THAN THE PIPE PARKING THROUGH.

B.9. THE OUTER BAR OF FOUNDATION STEEL SHALL BE CONTINUOUS ANCHOR COVERS USING CORNER BARS OR BY BENDING THE BAR IN ACCORDANCE WITH 108.5.4. IN BOTH CHARS, THE MINIMUM SHELLAP SHALL BE 30 INCHES.

B.10. STIRRUPS SHALL HAVE AN INNER DIA. OF NOT LESS THAN THE WALL SUPPORTED ABOVE, BUT 30 NO CHAR LESS THAN 6 INCHES THICK, AND SHALL HAVE BARS VERTICAL REINFORCING AS THE WALL ABOVE.

B.11. ALL FOOTING CORNER, BARS SHALL HAVE A STANDARD 90 DEGREE HOOK AND SHALL BE EMBEDDED A MINIMUM OF 6 INCHES INTO ALL FOOTINGS; BOWED, BARS SHALL LAP VERTICAL WALL REINFORCEMENT A MINIMUM OF 30 INCHES.

B.12. MINIMUM CONCRETE COVER OVER REINFORCING BARS SHALL BE:
- B.12.1. 3 INCHES IN FOUNDATIONS WHERE CONCRETE IS CAST AGAINST AND PERMANENTLY IN CONTACT WITH THE EARTH.
- B.12.2. 1-1/2 INCHES FOR No. 5 AND SMALLER BARS, AND 2 INCHES FOR No. 6 AND LARGER BARS WHERE CONCRETE IS FORMED AND WILL BE EXPOSED TO THE WEATHER.
- B.12.3. IN NARROW FOOTINGS WHERE INSUFFICIENT WIDTH IS AVAILABLE TO ACCOMMODATE A STANDARD 90 DEGREE HOOK, PROVIDE THE REQUIRED CONCRETE COVER. THE HOOK SHALL BE ROTATED IN THE HORIZONTAL DIRECTION UNTIL THE REQUIRED CONCRETE COVER IS ACHIEVED.

B.13. CONNECTION OF COLUMNS TO THE FOUNDATION BELOW AND TO THE BOND BEAM AT THE TOP SHALL BE AS FOLLOWS:
- B.13.1. 3x8 INCH COLUMN: TWO NO. 5 STANDARD 90 HOOK INTO THE SUPPORT AT THE BOTTOM AND INTO THE BOND BEAM AT THE TOP.
- B.13.2. 8x16 INCH COLUMN: TWO NO. 5 STANDARD 90 HOOKS (ONE IN EACH CELL) BOTH AT THE BOTTOM AND INTO THE BOND BEAM AT THE TOP.
- B.13.3. 12x12 INCH COLUMN AND 16x16 INCH COLUMN: FOUR NO. 5 STANDARD 90 HOOKS (ONE AT EACH VERTICAL BAR) EXTENDING FROM THE FOUNDATION AND SPLICED WITH THE VERTICAL COLUMN REINFORCEMENT FOR THE BOTTOM THREE NO. 5 STANDARD 90 HOOKS INTO THE BOND BEAM AT TOP, MINIMUM, AND EACH SPLICED AND A VERTICAL COLUMN BAR FOR CORNER COLUMNS, & TWO NO. 5 STANDARD 90 HOOKS INTO THE BOND BEAM AT THE TOP EACH SPLICED TO SEPARATE VERTICAL COLUMN BARS FOR COLUMNS NOT LOCATED IN A CORNER.

C. MASONRY:

C.1. SHALL BE SERVER TYPE S OR S IN ACCORDANCE WITH ASTM C 270

C.2. ALL MORTAR JOINTS FOR HOLLOW UNIT MASONRY SHALL EXTEND THE FULL WIDTH OF FACE SHELLS, MORTAR JOINTS FOR SOLID MASONRY SHALL BE FULL HEAD AND BED JOINTS.

C.3. BED JOINTS SHALL BE 3/8 INCH (+ 1/8 INCH) THICK, HEAD JOINTS SHALL BE 3/8 INCH (+ 3/8 INCH) THICK.

C.4. THE BED JOINT OF THE COURSES PLACED OVER FOOTINGS SHALL BE PERMITTED TO VARY IN THICKNESS FROM A MINIMUM OF 1/4 INCH TO A MAXIMUM OF 3/4 INCH.

D. GROUT:

C.1. SHALL HAVE A MAXIMUM COARSE AGGREGATE SIZE OF 3/8 INCH PLACES AT ANS 9 TO 11 INCH SLUMP AND HAVE A MINIMUM SPECIFIED COMPRESSIVE STRENGTH OF 2000 PSI AT 28 DAYS WHEN TESTED IN ACCORDANCE WITH ASTM C 1019, OR SHALL BE IN ACCORDANCE WITH ASTM C 476.

C.2. LONGITUDINAL WIRES OF JOINT REINFORCEMENT SHALL BE FULLY EMBEDDED IN MORTAR OR GROUT WITH A MINIMUM COVER OF ⅝" INCH WHEN EXPOSED TO EARTH OR WEATHER, AND ⅝" INCH WHEN NOT EXPOSED TO EARTH OR WEATHER.

D. CONCRETE:

D.1. SHALL HAVE A MINIMUM SPECIFIED COMPRESSIVE STRENGTH OF 2500 PSI FOR FOOTINGS (2500 PSI FOR SLABS & TIE BEAMS) AT 28 DAYS PER ACI 318, SECTION 5.3. INSTALLATION OF CONCRETE SHALL BE PER ACI 318, SECTION 5.10.

D.2. FOR CAST-IN-PLACE BOND BEAMS WHERE CONCRETE IS NOT EXPOSED TO WEATHER, THE MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE 1 1/2 INCHES REGARDLESS OF BAR SIZE.

D.3. FOR CAST-IN-PLACE BOND BEAMS WHERE CONCRETE IS EX- POSED TO WEATHER, THE MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE: 1 1/2 INCHES FOR NO. 5 BARS AND SMALLER, 2 INCHES FOR NO. 6 BARS AND LARGER.

E. REINFORCING STEEL:

E.1. SHALL BE MINIMUM GRADE 40 AND IDENTIFIED IN ACCORDANCE WITH ASTM A 615, A 616, A 617, OR A 706.

E.2. REINFORCING STEEL SHALL BE NO. 5 BARS WITH P=60 KSI. EXCEPTION: WHERE TWO NO. 5 BARS ARE REQUIRED WITHIN THE SAME GROUTED MASONRY CELL OR BOND BEAM, ONE NO. 7 BAR MAY BE SUBSTITUTED.

E.3. REINFORCEMENT BARS EMBEDDED IN GROUTED MASONRY CELLS SHALL HAVE A MINIMUM CLEAR DISTANCE OF 1/4 INCH FOR FINE GROUT OR 1/2 INCH FOR COARSE GROUT BETWEEN REINFORCING BARS AND ANY FACE OF THE CELL.

E.4. ANCHOR BOLTS USED IN MASONRY WALLS SHALL HAVE A MASONRY COVER (INCLUDING GROUT) OF NOT LESS THAN 2 INCHES FOR MASONRY UNITS WITH FACE EXPOSED TO EARTH OR WEATHER, 1 1/2 INCH FOR MASONRY UNITS NOT EXPOSED TO EARTH OR WEATHER.

E.5. CLEARANCE FROM THE VERTICAL BAR TO THE MASONRY FACE SHALL BE 1/2 INCH. MINIMUM COVER FOR CAST IN PLACE COLUMNS SHALL BE 1-1/2 INCHES OVER THE COLUMN TIES.

E.6. REINFORCEMENT MAY BE BENT IN THE SHOP OR IN THE FIELD IF:
- E.6.1. ALL REINFORCEMENT IS BENT COLD.
- E.6.2. THE DIAMETER OF THE BEND, MEASURED ON THE INSIDE OF THE BAR, IS NOT LESS THAN 6X BAR DIAMETERS.
- E.6.3. REINFORCEMENT PARTIALLY EMBEDDED IN CONCRETE SHALL NOT BE FIELD BENT. EXCEPTION: WHERE BENDING IS NECESSARY TO ALIGN DOWEL BARS WITH A VERTICAL CELL, BARS PARTIALLY EMBEDDED IN CONCRETE SHALL BE PERMITTED TO BE BENT AT A SLOPE OF NOT MORE THAN 1 INCH OF HORIZONTAL DISPLACEMENT TO 6 INCHES OF VERTICAL BAR LENGTH.

E.7. WHEN TWO BARS ARE REQUIRED IN THE SAME CELL OR BOND BEAM, THEY MAY BE BUNDLED.

E.8. SPLICES SHALL BE LAP SPLICES, AND DICTATED AS BLOCK
- E.8.1. NON-CONTACT LAP SPLICES MAY BE USED PROVIDED REINFORCING BARS ARE NOT SPACED FURTHER APART THAN 8 INCHES FOR NO. 3 BARS AND 7 INCHES FOR NO. 7 BARS.
- E.8.2. SPLICE LENGTHS SHALL BE A MINIMUM OF 28 INCHES FOR NO. 3 BARS AND 35 INCHES FOR NO. 7 BARS (#3 BAR DIAMETERS). SPLICES OF A NO. 3 BAR WITH ONE NO. 7 BAR SHALL BE A MINIMUM OF 35 INCHES, AND TWO NO. 5 BARS WITH ONE NO. 7 BAR SHALL BE A MINIMUM OF 50 INCHES.

F. GALVANIZATION:

F.1. METAL ACCESSORIES FOR USE IN EXTERIOR WALL CONSTRUCTION AND NOT DIRECTLY EXPOSED TO THE WEATHER SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A 153, CLASS B-2. METAL ACCESSORIES FOR USE IN INTERIOR WALL CONSTRUCTION SHALL BE MILL GALVANIZED IN ACCORDANCE WITH ASTM A 653, CLASS 1.

G. METAL ACCESSORIES:

G.1. JOINT REINFORCEMENT, ANCHORS, TIES, AND WIRE FABRIC SHALL CONFORM TO THE FOLLOWING STANDARDS: 1. ASTM A 82 FOR JOINT REINFORCEMENT AND WIRE ANCHORS AND TIES. 2. ASTM A 36 FOR PLATE, HINGED AND BENT BAR ANCHORS. 3. ASTM A 366 FOR SHEET METAL ANCHORS AND TIES.

G.2. UNLESS OTHERWISE STATED, SIZES GIVEN FOR WIRE ARE COMMON WIRE GAUGE. FOR EXAMPLE, #8 = 3 1/2 INCHES LONG X 0.135-INCH DIAMETER. SEE TABLE 6.3A IN THE NATIONAL DESIGN SPECIFICATIONS FOR WOOD CONSTRUCTION.

H. MASONRY:

H.1. LATERAL TIES OF A MINIMUM 1/4 INCH DIAMETER SHALL BE USED TO ENCLOSE VERTICAL COLUMN REINFORCEMENT AS FOLLOWS:
- H.1.1. MAXIMUM VERTICAL SPACING OF LATERAL TIES SHALL NOT EXCEED THE LEAST NOMINAL CROSS SECTIONAL DIMENSION OF THE COLUMN.
- H.1.2. LATERAL TIES MST BE PLACED IN THE MORTAR JOINTS (PROVIDED THEY ARE NO LARGER THAN 1/4 INCH DIAMETER) OR IN THE GROUT.
- H.1.3. THE BOTTOM LATERAL TIES SHALL BE LOCATED VERTICALLY NOT MORE THAN ONE-HALF THE LATERAL TIE SPACING ABOVE THE TOP OF THE FOOTING, SLAB, OR BEAM IN ANY STORY. THE TOP LATERAL TIE SHALL NOT BE MORE THAN ONE-HALF THE LATERAL TIE SPACING BELOW THE LOWEST HORIZONTAL REINFORCEMENT IN THE BEAM ABOVE.
- H.1.4. CONCRETE MASONRY UNITS SHALL BE HOLLOW OR SOLID UNIT MASONRY IN ACCORDANCE WITH ASTM C 90 AND SHALL HAVE A MINIMUM NET AREA COMPRESSIVE STRENGTH OF 1500 PSI. CMU MATERIALS AND CONSTRUCTION SHALL COMPLY WITH "SPECIFICATION FOR MASONRY STRUCTURES" ACI 530, MNCS-X-MRTS-99 AND SPECT 3 & 5.
- H.1.5. MASONRY WALLS SHALL BE RUNNING BOND OR STACK BOND CONSTRUCTION. NINEVEH MASONRY UNITS ARE LAID IN (STACK BOND), 8-GAGE (MINIMUM) HORIZONTAL JOINT REINFORCEMENT, IN ADDITION TO REQUIRED VERTICAL REINFORCEMENT, SHALL BE PLACED IN BED JOINTS AT NOT MORE THAN 16 INCHES ON CENTER.

I. LUMBER:

I.1. ALL LVL BEAM LUMBER SHALL HAVE A MINIMUM FLEXURAL STRENTH, Fb, OF 2,600 PSI AND MODULUS OF ELASTICITY, E, OF 2,000,000 PSI.

J. TRUSS:

J.1. INTERIOR BEARING WALLS BOTTOM CONNECTORS SHALL HAVE THE SAME OR GREATER UPLIFT VALUE AS THE TOP CONNECTOR.

J.2. ALL INTERIOR FRAME BEARING WALLS AND ALL EXTERIOR FRAME WALLS SHALL BE ANCHORED TO THE ANSI TYPE-CMU WALL WITH (2) 1/2"x8" STANDARD HOOK ANCHOR BOLTS EMBEDDED IN GROUTED CELLS. THE FLOOR PLT. PLATE SHALL BE ANCHORED WITH 1/2" x 10" A.B. OR WEDGE ANCHOR (RED HEAD) @ 24" o.c.

J.3. WHEREVER A GIRDER TRUSS BEARS ON A FRAME BEARING WALL, IT SHALL BE SUPPORTED BY A MINIMUM OF AN EQUAL NUMBER OF STUDS OR PLATES IN THE GIRDER.

J.4. REBARS MAY BE DRILLED AND EPOXIED TO MIN. 6" EMBEDMENT.

J.5. FOR MISSING OR MIS-LOCATED TPWPS TO CMU (1) WITH 4x WPJ6-UP TRUSSES CAN BE SUBSTITUTED PROVIDED UPLIFT FOR TRUSS IS LESS THAN 600lbs. LIMIT TWO TRUSSES ADJACENT WITHOUT ENGINEERING INCORPORATIONS.

J.6. ALL INTERIOR BEARING WALLS TO BE 4X SD SYP OR BE SPF UNLESS NOTED OTHERWISE.

J.7. ALL TRUSS CONNECTORS ARE TO BE SIMPSON STRONG-TIE, U.N.O.

J.8. EACH FLOOR TRUSS ATTACHED TO CMU, WITH (1) HETA-16 OR (3) BTS-12 AT FRAME CONNECTION (U.N.O.)

J.9. EACH ROOF TRUSS / RAFTER AT CMU, TO BE ATTACHED WITH (3) HETA-16 (U.N.O.) SEE CONNECTOR SCHEDULE BELOW FOR NAILING REQUIRED.

J.10. EACH ROOF TRUSS / RAFTER AT FRAME CONNECTION TO BE (3) MTS-12 (U.N.O.)

J.11. END/HIPS AND CORNER BRTS MAY BE (1) H2.5 (U.N.O.)

J.12. AT ALL 2 STORY BEARING WALL LOCATIONS AND STORY FRAME WALL STUDS TO BE ATTACHED TO FLOOR TRUSSES BELOW WITH (HETA-20 OR H79-20 CONNECTORS) @ 48" O.C. (U.N.O.)

J.13. ALL P.T. LUMBER TO HAVE SIMPSON Z-MAX CONNECTORS WITH GALVANIZED FASTENERS PER ASTM-F1667.

J.14. TRUSSES SHALL BE DESIGNED AND SEALED BY THE TRUSS MANUFACTURER'S PROFESSIONAL ENGINEER REGISTERED IN THE STATE OF FLORIDA, AND SHALL CONFORM WITH THE TPI DESIGN SPECIFICATIONS FOR METAL PLATE CONNECTED TRUSSES.

J.15. TRUSS MANUFACTURER TO VERIFY ALL TRUSS SPANS, SLOPES, BEARING POINTS, & DIMENSIONS BEFORE FABRICATION. ALSO, TRUSS MANUFACTURER TO PROVIDE SHOP DRAWINGS TO MJS, INC. CUSTOM HOME DESIGNS FOR REVIEW BEFORE FABRICATION.

J.16. ALL ROOF PITCHES ARE TO BE SET AS SHOWN ON PLANS AND ELEVATIONS (OR BY EXISTING CONDITION).

J.17. TOP PLATE HEIGHTS VARY. SEE STUDS LAYOUT, BUILDING SECTIONS, WALL SECTIONS, & ELEVATIONS FOR BEARING HEIGHTS.

J.18. ALL ROOF SHEATHING SHALL BE ENGINEERED WITH THE LONG DIMENSION PERPENDICULAR TO THE FRAMING.

J.19. TRUSS SPACING RANGE TO FOLLOW ALL VALUE END TRUSSES WITH INTERMEDIATE STUD HANGERS @ O.C.

J.20. WOOD MEMBERS THICKER THAN THOSE SPECIFIED MAY BE USED AS LONG AS THE LENGTH OF THE 3/8" TAPCONS IS SUFFICIENT TO OBTAIN A MIN. OF 1-3/8" PENETRATION INTO THE CMU OR TIE BEAM.

J.21. ALL FRAMING LUMBER SHALL BE HEM-FIR, S. PINE, OR S-P-F, GRADE # OR BETTER WITH A MINIMUM Fb OF 1600 PSI. ALL LUMBER USED FOR BRACE SHALL BE HEM-FIR, S. PINE, OR S-P-F, GRADE 2 OR BETTER WITH A MINIMUM Fb OF 1350 PSI.

J.22. OVERHANG WILL VARY. SEE TRUSS LAYOUT, ROOF LAYOUT, & EXTERIOR ELEVATIONS. ALL OVERHANGS GREATER THAN 24" SHALL BE TACKED ON IN THE FIELD.

J.23. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON BEARING WALLS AND AT VOLUME AREAS (U.N.O.).

J.24. ALSO TRUSSES AND YARD FRAMING DO AS ALL GYPSUM WALL BOARD TO BE CONTINUOUS FROM FLOOR TO CEILING.

J.25. TRUSS MANUFACTURER TO ENSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:
- J.25.1. ALL CEILING HUNG SOFFITS AND GABLETS AS SHOWN ON PLANS.
- J.25.2. ATTIC LOCATED HVAC UNITS AS SHOWN ON PLANS.
- J.25.3. LIGHTING & PLUMBING LAYOUTS.

K. ROOF / WALL SHEATHING:

K.1. SHEATHING TO BE 1/2" NOMINAL OR GREATER OSB, OR CDX, TYPE PLYWOOD FOR SHINGLE APPLICATION OR 5/8" NOMINAL OR GREATER OSB, OR CDX, TYPE PLYWOOD FOR TILE APPLICATIONWALLED WITH .0099" RING SHANK OR SCREW SHANK NAILS @ 6" O.C. EXCEPT FIRST 4'-0" OF ENTIRE PERIMETER WHICH SHALL BE 4" O.C. FIELD 4" O.C. EDGE

K.2. TWO LAYERS OF FELT (CR) ONE LAYER OF HOUSE WRAP AND ONE LAYER OF FELT IS REQUIRED BEHIND STUCCO. THE USE OF AN APPROVED 2SP WALL SYSTEM CAN ALSO BE USED IN PLACE OF FELT OR HOUSE WRAP APPLICATION (PER SECTION FBC R703.2)

K.3. ALL ROOF SHEATHING SHALL BE ENGAGERED WITH THE LONG DIMENSION PERPENDICULAR TO THE FRAMING.

K.4. WALL SHEATHING TO BE 7/16" OSB, OR 1/2" CDX, NAILED WITH 8d CORROSION RESISTANT NAILS @ 6" O.C. IN FIELD & 4" O.C. @ EDGE (U.N.O.)
- K.4.A. SHEAR WALL SHEATHING TO BE 7/16" OSB, EXTERIOR GRADE WALLS TO BE 2x6 STUDS PLACED AT 16" O.C. W/ (1)#4 REBAR TOP AND BOTTOM OF EACH FULL LENGTH STUD. (SIMPSON APPROVED SHEAR WALL SYSTEM) ADDITIONALLY WITH (4) @ TOP, ADDITIONALLY WITH (4) @ 16" O.C. ONE REQUIRED FOR EVERY STUD IN EXTERIOR WALLS TO FLOOR TRUSSES IN 2 STORY APPLICATION.
- K.4.A. WHEN STRAPPING TO EXTERIOR MATERIAL WITH (1) 1/2 IN BOLT IN PLATE PLACE SPF OR JH #1 @ 24" O.C. AT TOP & BOTTOM OF EACH PLATE (SIMPSON APPROVED EQUAL) IN A SP-4 @ TOP) PROVIDE 36" O.C.

GENERAL NOTES KEY:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS. CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. WATER HEATER T & P RELIEF VALVE SHALL BE FULL SIZE TO EXTERIOR WATER HEATED AT OR ABOVE FLOOR LEVEL SHALL BE IN A PAN WITH DRAIN TO EXTERIOR. WATER HEATER SHALL HAVE AN APPROVED THERMAL EXPANSION DEVICE.
4. FLOOR SLAB OF PLANT MIX CONCRETE 2500 P.S.I. 4" THICK WITH 6x6 10/10 GUAGE REINFORCING MAT. w/ MIN. 1" COVER. 6 MIL. POLYETHYLENE VAPOR BARRIER OVER COMPACTED CLEAN FILL. WWF SHALL BE PLACED IN MIDDLE TO UPPER THIRD OF SLAB AND SUPPORTED ON APPROVED SLAB BOLSTERS. FIBER MESH REINFORCEMENT MAY BE USED AS AN ALTERNATIVE TO WIRE MESH.
5. PAVERS MAY BE USED ILO CONCRETE SLAB AT PATIO, PORCH, DRIVE AND WALKWAY. DELETE SLAB IN AREAS PAVERS ARE TO BE USED.
6. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
7. IN LEIU OF TREATING THE SOIL, AN ALTERNATIVE TERMITE TREATMENT CAN BE APPLIED TO ALL INTERIOR WOOD SURFACES PER FBC-R 2017 6TH EDITION.
8. BORATE TERMITE TREATMENT TO BE APPLIED ON ALL INTERIOR WOOD SURFACES IAW MANUFACTURERS INSTRUCTIONS AND SPECIFICATIONS, PURSUANT TO CH.482 OF THE FLORIDA BUILDING CODE.
9. ALL STEEL TO BE USED IN FOOTERS & EXTERIOR WALLS TO BE MIN. GRADE 60.
10. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.

DOOR NOTE KEY:

DOOR SIZE CALLOUT:

30 = 2'-0"	30 = 3'-0"
24 = 2'-4"	40 B.F. = 4'-0" BIFOLD
26 = 2'-6"	50 B.F. = 5'-0" BIFOLD
28 = 2'-8"	60 B.F. = 6'-0" BIFOLD

* ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER/CLIENT SPEC'S.

- INDICATES AREA OF TWO STORY BEARING FOOTING.

- INDICATES A CONCRETE FILLED CELL OF 8" CMU. WALL WITH (1) #5 REBAR VERT. CONT. FROM FOUNDATION TO BOND BEAM. PROVIDE A MIN. OF 20" LAP ON ALL STEEL REINFORCING BARS. MIN. REBAR GRADE 60.

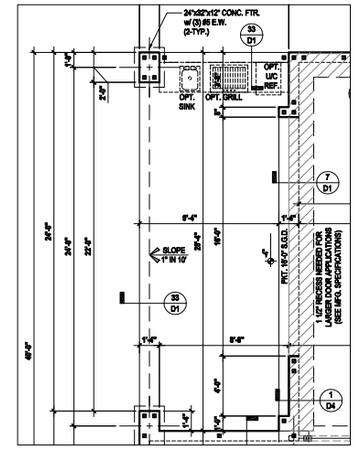

Foundation Plan

(Opt. Pocket SCD.)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

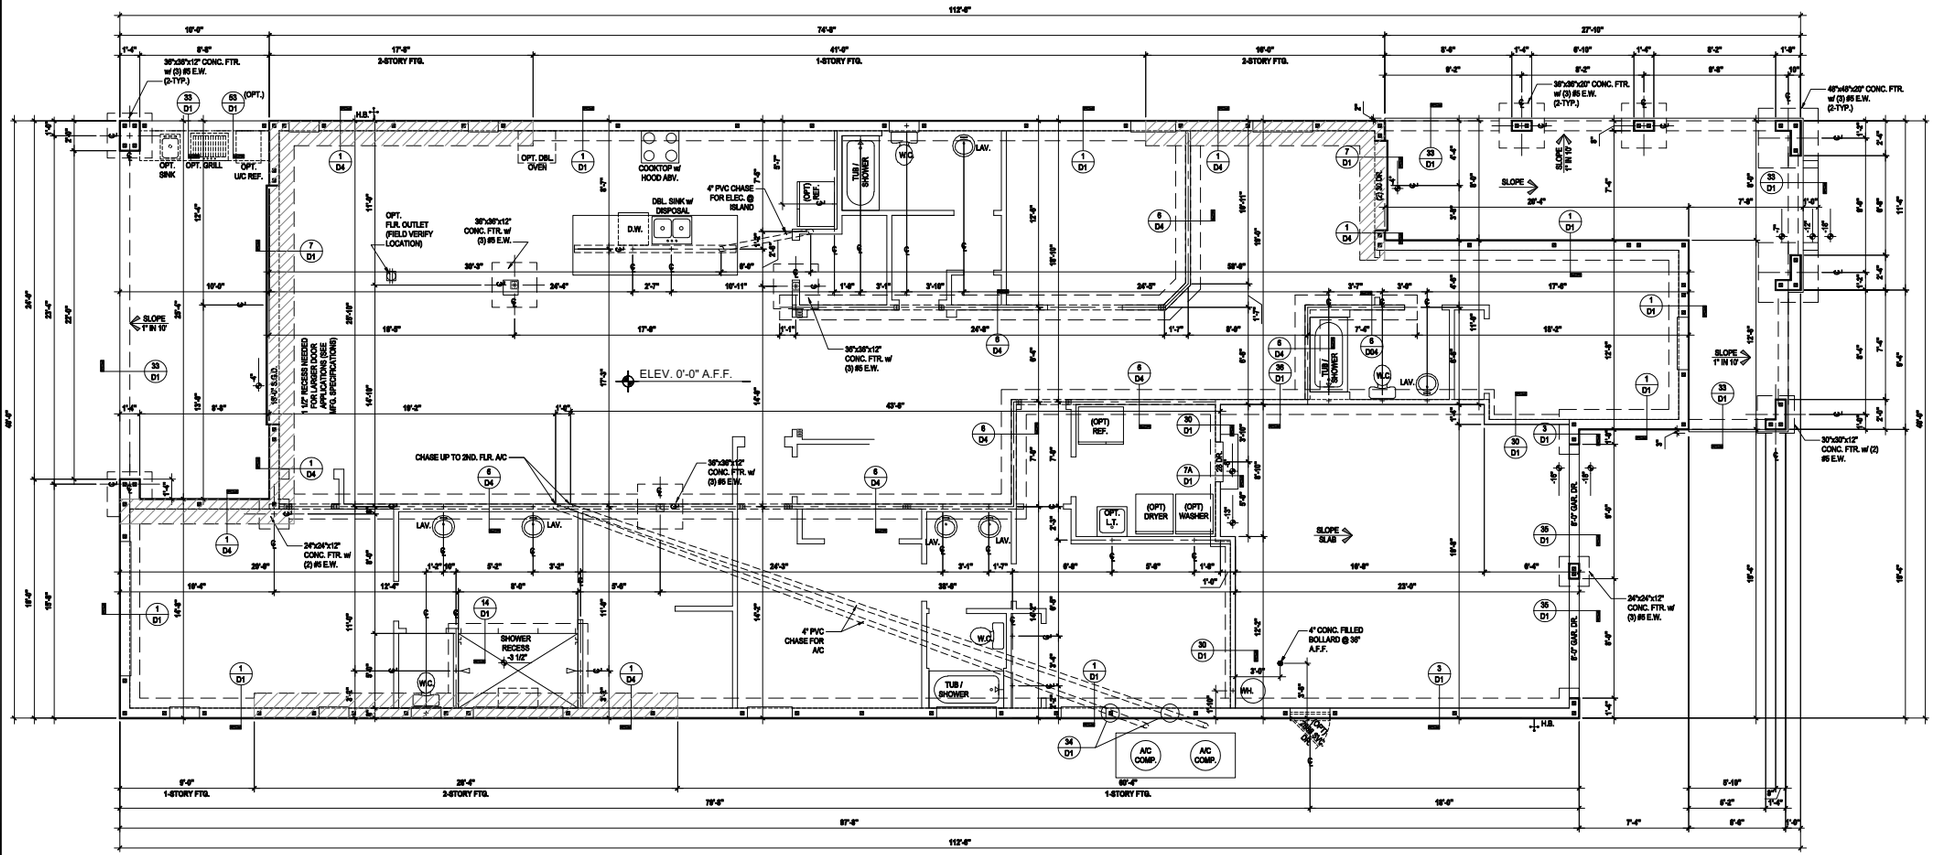

Foundation Plan "A"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\01.A Foundation Plan.dwg May 21, 2019,8:53pm

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, Fl. 32811
Phone: (407) 529-3000

PARK SQUARE HOMES

MJS custom home design
DESIGNERS • PLANNERS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER ESTATES PLANNING & DEVELOPMENT INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierestatesplanning.com
FL CERT. AUTH.: 29113
FL PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

These plans have been electronically signed & sealed by Kent Rodgers, PE using a digital signature. ILO a raised and printed copy of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variance to the dimensions, conditions and specifications appearing on these plans.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FOUNDATION PLAN

01.A

GENERAL NOTES KEY:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS. CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. WATER HEATER T & P RELIEF VALVE SHALL BE FULL SIZE TO EXTERIOR WATER HEATED AT OR ABOVE FLOOR LEVEL SHALL BE IN A PAN WITH DRAIN TO EXTERIOR. WATER HEATER SHALL HAVE AN APPROVED THERMAL EXPANSION DEVICE.
4. FLOOR SLAB OF PLANT MIX CONCRETE 2500 P.S.I. 4" THICK WITH 6x6 10/10 GUAGE REINFORCING MAT. w/ MIN. 1" COVER, 6 MIL. POLYETHYLENE VAPOR BARRIER OVER COMPACTED CLEAN FILL. WWF SHALL BE PLACED IN MIDDLE TO UPPER THIRD OF SLAB AND SUPPORTED ON APPROVED SLAB BOLSTERS. FIBER MESH REINFORCEMENT MAY BE USED AS AN ALTERNATIVE TO WIRE MESH.
5. PAVERS MAY BE USED ILO CONCRETE SLAB AT PATIO, PORCH, DRIVE AND WALKWAY. DELETE SLAB IN AREAS PAVERS ARE TO BE USED.
6. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
7. IN LEIU OF TREATING THE SOIL AN ALTERNATIVE TERMITE TREATMENT CAN BE APPLIED TO ALL INTERIOR WOOD SURFACES PER FBC-R 2017 6TH EDITION.
8. BORATE TERMITE TREATMENT TO BE APPLIED ON ALL INTERIOR WOOD SURFACES IAW MANUFACTURERS INSTRUCTIONS AND SPECIFICATIONS. PURSUANT TO CH.482 OF THE FLORIDA BUILDING CODE.
9. ALL STEEL TO BE USED IN FOOTERS & EXTERIOR WALLS TO BE MIN. GRADE 60.
10. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.

DOOR NOTE KEY:

DOOR SIZE CALLOUT:

20 = 2'-0"	30 = 3'-0"
24 = 2'-4"	40 B.F. = 4'-0" BIFOLD
26 = 2'-6"	50 B.F. = 5'-0" BIFOLD
28 = 2'-8"	60 B.F. = 6'-0" BIFOLD

* ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER/CLIENT SPEC'S.

- INDICATES AREA OF TWO STORY BEARING FOOTING.

- INDICATES A CONCRETE FILLED CELL OF 8" CMU WALL WITH (1) #5 REBAR VERT. CONT. FROM FOUNDATION TO BOND BEAM. PROVIDE A MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS. MIN. REBAR GRADE 60.

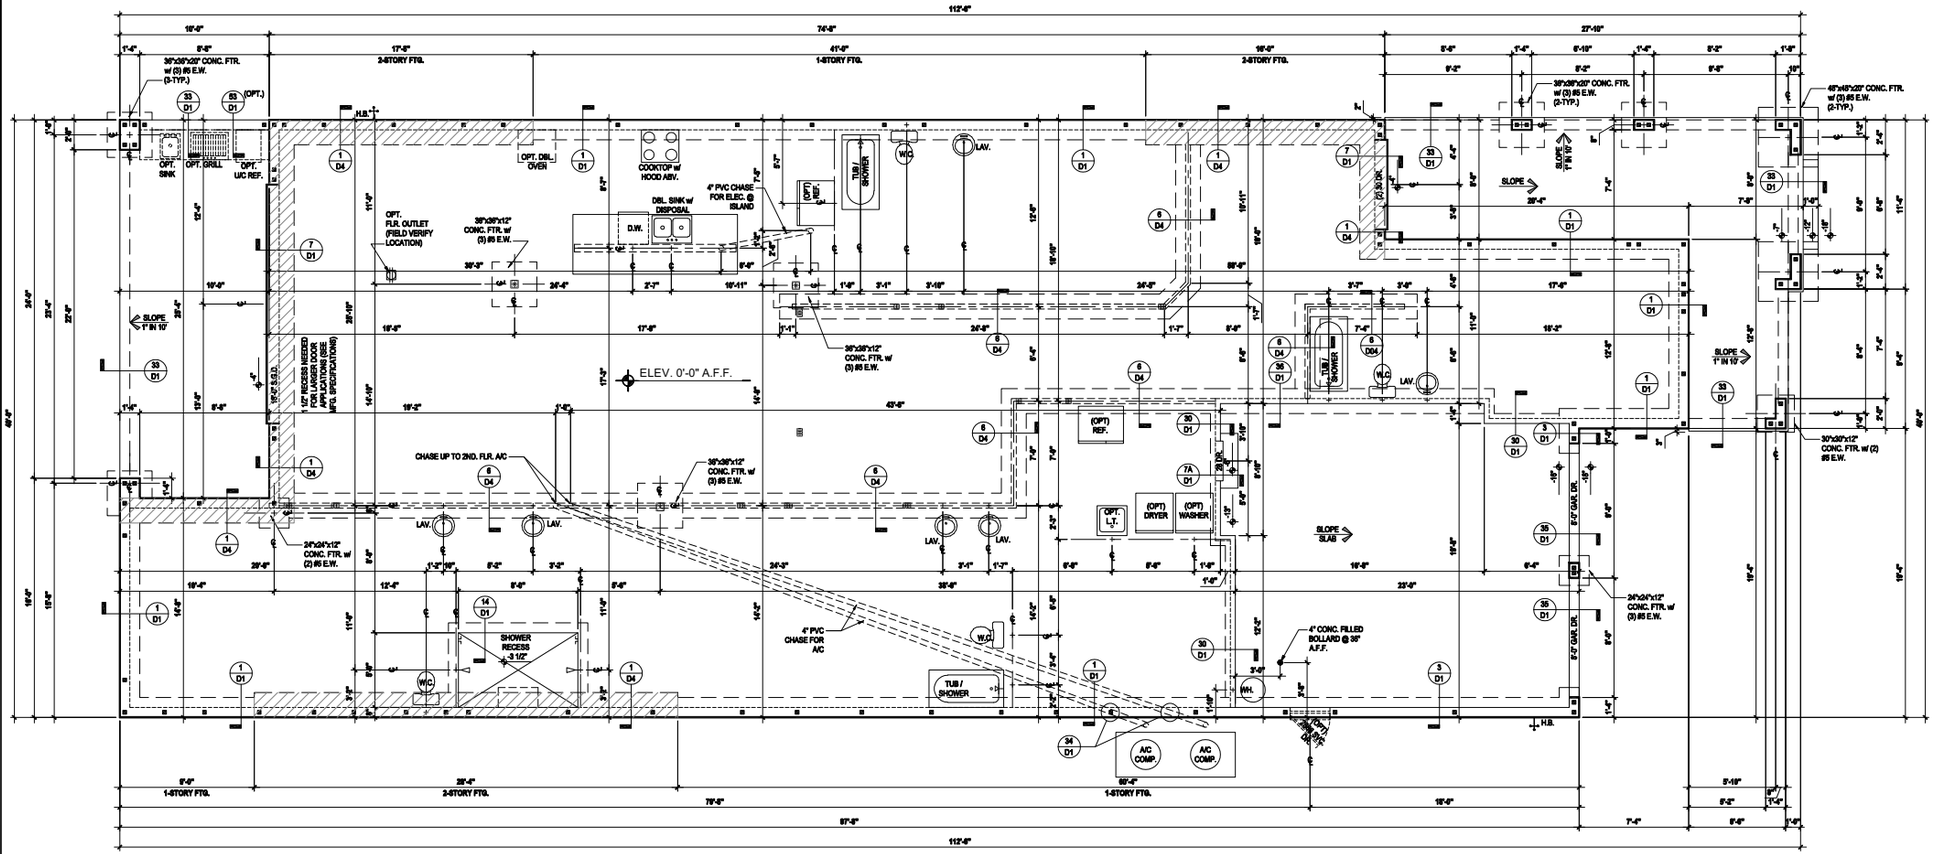

Foundation Plan "A"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

PREMIER ARCHITECTURAL & ENGINEERING INC.

MJS custom home design
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
DESIGNBUILD - PLANNING

Your plans have been electronically signed & sealed by Noel Rodriguez, PE, using a digital signature. ILO a sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

MEETER DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any discrepancies in dimensions, conditions and specifications prior to the start of work.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FOUNDATION PLAN

01.A1

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

May 21, 2018,6:53pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\01.A1 Foundation Plan (Opt. Balcony).dwg

GENERAL NOTES KEY:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS. CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. WATER HEATER T & P RELIEF VALVE SHALL BE FULL SIZE TO EXTERIOR WATER HEATED AT OR ABOVE FLOOR LEVEL SHALL BE IN A PAN WITH DRAIN TO EXTERIOR. WATER HEATER SHALL HAVE AN APPROVED THERMAL EXPANSION DEVICE.
4. FLOOR SLAB OF PLANT MIX CONCRETE 2500 P.S.I. 4" THICK WITH 6x6 10/10 GUAGE REINFORCING MAT. w/ MIN. 1" COVER, 6 MIL. POLYETHYLENE VAPOR BARRIER OVER COMPACTED CLEAN FILL. WWF SHALL BE PLACED IN MIDDLE TO UPPER THIRD OF SLAB AND SUPPORTED ON APPROVED SLAB BOLSTERS. FIBER MESH REINFORCEMENT MAY BE USED AS AN ALTERNATIVE TO WIRE MESH.
5. PAVERS MAY BE USED ILO CONCRETE SLAB AT PATIO, PORCH, DRIVE AND WALKWAY. DELETE SLAB IN AREAS PAVERS ARE TO BE USED.
6. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
7. IN LEIU OF TREATING THE SOIL AN ALTERNATIVE TERMITE TREATMENT CAN BE APPLIED TO ALL INTERIOR WOOD SURFACES PER FBC-R 2017 6TH EDITION.
8. BORATE TERMITE TREATMENT TO BE APPLIED ON ALL INTERIOR WOOD SURFACES IAW MANUFACTURERS INSTRUCTIONS AND SPECIFICATIONS. PURSUANT TO CH.482 OF THE FLORIDA BUILDING CODE.
9. ALL STEEL TO BE USED IN FOOTERS & EXTERIOR WALLS TO BE MIN. GRADE 60.
10. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.

DOOR NOTE KEY:

DOOR SIZE CALLOUT:

20 = 2'-0"	30 = 3'-0"
24 = 2'-4"	40 B.F. = 4'-0" BIFOLD
26 = 2'-6"	50 B.F. = 5'-0" BIFOLD
28 = 2'-8"	60 B.F. = 6'-0" BIFOLD

* ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER/CLIENT SPEC'S.

- INDICATES AREA OF TWO STORY BEARING FOOTING.

- INDICATES A CONCRETE FILLED CELL OF 8" CMU WALL WITH (1) #5 REBAR VERT. CONT. FROM FOUNDATION TO BOND BEAM. PROVIDE A MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS. MIN. REBAR GRADE 60.

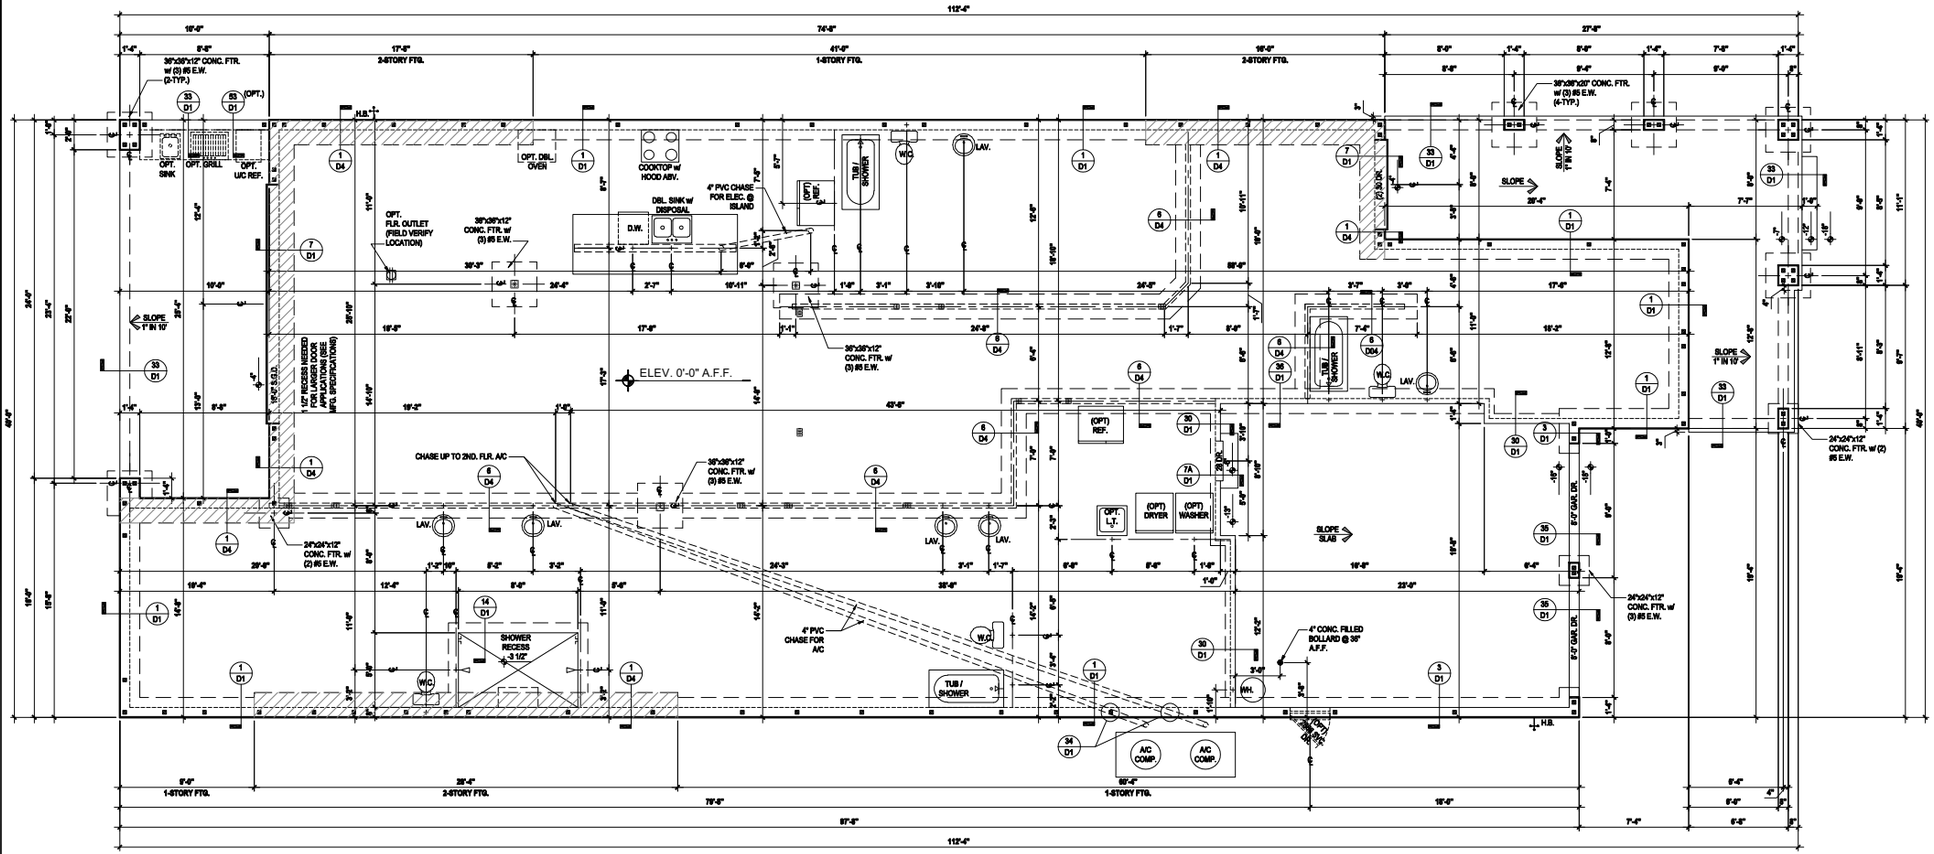

Foundation Plan "B"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,6:53pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\01.B Foundation Plan.dwg

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATION OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

PREMIER ARCHITECTURAL & ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL CERT. AUTH.: 29113
FL PE#: 60239

MJS custom home design
DESIGNSERVE - PLANSERVE
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

Your plans have been electronically signed & sealed by Noel Gallegos, PE using a digital signature. IUD is valid and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

NOTE: DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications shown on these plans.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FOUNDATION PLAN

01.B

GENERAL NOTES KEY:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS. CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. WATER HEATER T & P RELIEF VALVE SHALL BE FULL SIZE TO EXTERIOR WATER HEATED AT OR ABOVE FLOOR LEVEL SHALL BE IN A PAN WITH DRAIN TO EXTERIOR. WATER HEATER SHALL HAVE AN APPROVED THERMAL EXPANSION DEVICE.
4. FLOOR SLAB OF PLANT MIX CONCRETE 2500 P.S.I. 4" THICK WITH 6x6 10/10 GUAGE REINFORCING MAT. w/ MIN. 1" COVER, 6 MIL. POLYETHYLENE VAPOR BARRIER OVER COMPACTED CLEAN FILL. WWF SHALL BE PLACED IN MIDDLE TO UPPER THIRD OF SLAB AND SUPPORTED ON APPROVED SLAB BOLSTERS. FIBER MESH REINFORCEMENT MAY BE USED AS AN ALTERNATIVE TO WIRE MESH.
5. PAVERS MAY BE USED ILO CONCRETE SLAB AT PATIO, PORCH, DRIVE AND WALKWAY. DELETE SLAB IN AREAS PAVERS ARE TO BE USED.
6. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
7. IN LEIU OF TREATING THE SOIL AN ALTERNATIVE TERMITE TREATMENT CAN BE APPLIED TO ALL INTERIOR WOOD SURFACES PER FBC-R 2017 6TH EDITION.
8. BORATE TERMITE TREATMENT TO BE APPLIED ON ALL INTERIOR WOOD SURFACES IAW MANUFACTURERS INSTRUCTIONS AND SPECIFICATIONS. PURSUANT TO CH.482 OF THE FLORIDA BUILDING CODE.
9. ALL STEEL TO BE USED IN FOOTERS & EXTERIOR WALLS TO BE MIN. GRADE 60.
10. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.

DOOR NOTE KEY:

DOOR SIZE CALLOUT:

20 = 2'-0"	30 = 3'-0"
24 = 2'-4"	40 B.F. = 4'-0" BIFOLD
26 = 2'-6"	50 B.F. = 5'-0" BIFOLD
28 = 2'-8"	60 B.F. = 6'-0" BIFOLD

* ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER/CLIENT SPEC'S.

- INDICATES AREA OF TWO STORY BEARING FOOTING.

- INDICATES A CONCRETE FILLED CELL OF 8" CMU WALL WITH (1) #5 REBAR VERT. CONT. FROM FOUNDATION TO BOND BEAM. PROVIDE A MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS. MIN. REBAR GRADE 60.

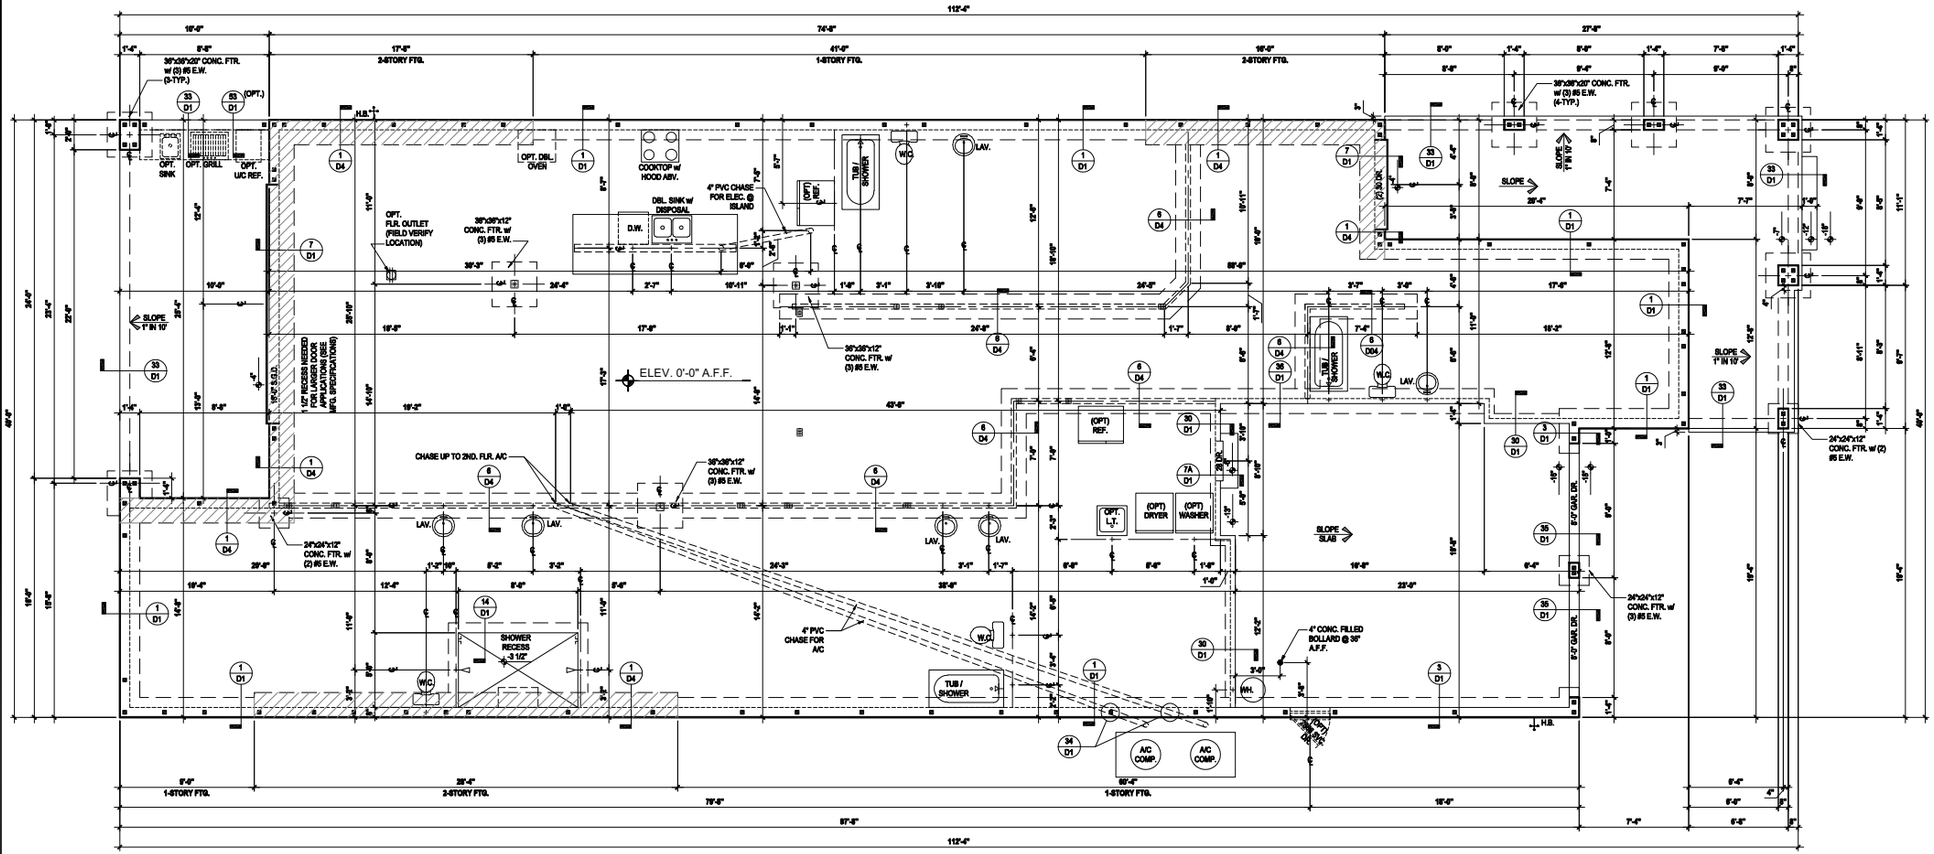

Foundation Plan "B"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

PREMIER ARCHITECTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL CERT. AUTH.: 29113
FL PE#: 60239

MJS custom home design
DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

MEETER DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS.
Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions, conditions and specifications shown on these prints.

40-4248
YORKSHIRE
Street Address
Lot Info
City, State, Zip

Park Square HOMES

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FOUNDATION PLAN
01.B1

This plan has been electronically signed & sealed by Neal Gallagher, PE, using a digital signature. ILO a raised and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

May 21, 2019,6:53pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\01.B1 Foundation Plan (Opt. Balcony).dwg

GENERAL NOTES KEY:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS. CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. WATER HEATER T & P RELIEF VALVE SHALL BE FULL SIZE TO EXTERIOR WATER HEATED AT OR ABOVE FLOOR LEVEL SHALL BE IN A PAN WITH DRAIN TO EXTERIOR. WATER HEATER SHALL HAVE AN APPROVED THERMAL EXPANSION DEVICE.
4. FLOOR SLAB OF PLANT MIX CONCRETE 2500 P.S.I. 4" THICK WITH 6x6 10/10 GUAGE REINFORCING MAT. w/ MIN. 1" COVER, 6 MIL. POLYETHYLENE VAPOR BARRIER OVER COMPACTED CLEAN FILL. WWF SHALL BE PLACED IN MIDDLE TO UPPER THIRD OF SLAB AND SUPPORTED ON APPROVED SLAB BOLSTERS. FIBER MESH REINFORCEMENT MAY BE USED AS AN ALTERNATIVE TO WIRE MESH.
5. PAVERS MAY BE USED ILO CONCRETE SLAB AT PATIO, PORCH, DRIVE AND WALKWAY. DELETE SLAB IN AREAS PAVERS ARE TO BE USED.
6. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
7. IN LEIU OF TREATING THE SOIL AN ALTERNATIVE TERMITE TREATMENT CAN BE APPLIED TO ALL INTERIOR WOOD SURFACES PER FBC-R 2017 6TH EDITION.
8. BORATE TERMITE TREATMENT TO BE APPLIED ON ALL INTERIOR WOOD SURFACES IAW MANUFACTURERS INSTRUCTIONS AND SPECIFICATIONS. PURSUANT TO CH.482 OF THE FLORIDA BUILDING CODE.
9. ALL STEEL TO BE USED IN FOOTERS & EXTERIOR WALLS TO BE MIN. GRADE 60.
10. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.

DOOR NOTE KEY:

DOOR SIZE CALLOUT:

20 = 2'-0"	30 = 3'-0"
24 = 2'-4"	40 B.F. = 4'-0" BIFOLD
26 = 2'-6"	50 B.F. = 5'-0" BIFOLD
28 = 2'-8"	60 B.F. = 6'-0" BIFOLD

* ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER/CLIENT SPEC'S.

- INDICATES AREA OF TWO STORY BEARING FOOTING.

- INDICATES A CONCRETE FILLED CELL OF 8" CMU WALL WITH (1) #5 REBAR VERT. CONT. FROM FOUNDATION TO BOND BEAM. PROVIDE A MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS. MIN. REBAR GRADE 60.

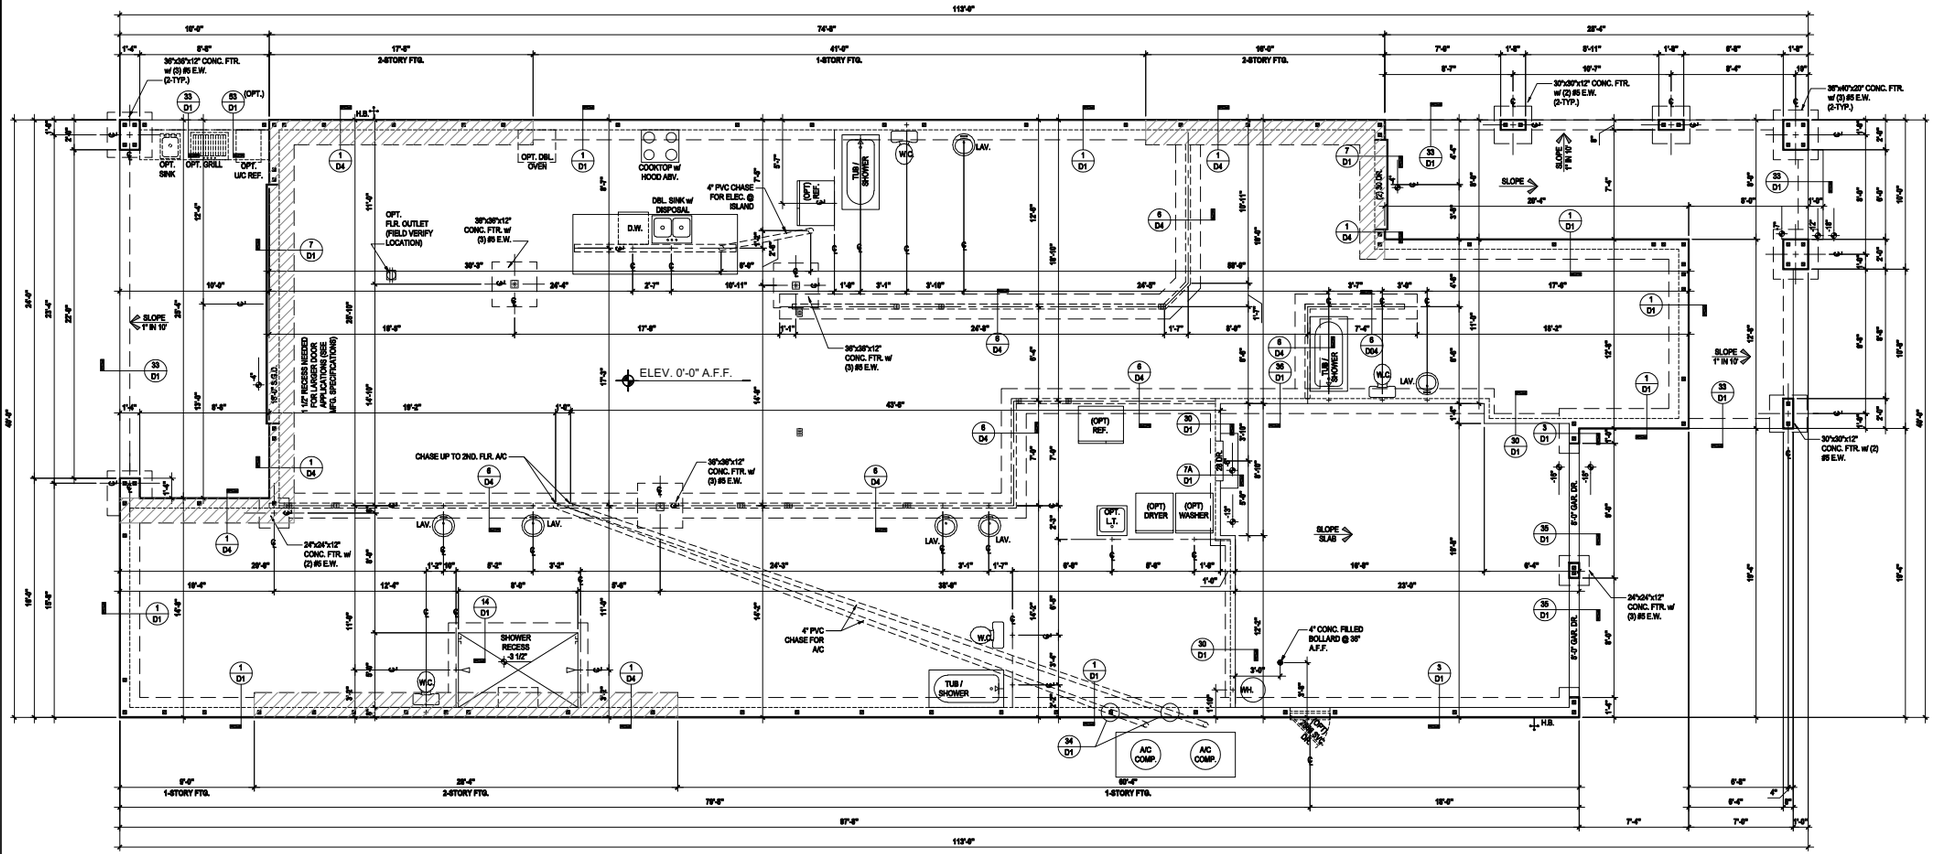

Foundation Plan "C"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

PREMIER ARCHITECTURAL & ENGINEERING INC.

MJS custom home design
DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

Your plans have been electronically signed & sealed by Noel Gonzalez, PE, using a digital signature. ILO a sealed and printed copy of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

MEETED DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions, conditions and specifications shown on these plans.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FOUNDATION PLAN

01.C

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATION OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

May 21, 2019,6:53pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\01.C Foundation Plan.dwg

GENERAL NOTES KEY:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS. CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. WATER HEATER T & P RELIEF VALVE SHALL BE FULL SIZE TO EXTERIOR WATER HEATED AT OR ABOVE FLOOR LEVEL SHALL BE IN A PAN WITH DRAIN TO EXTERIOR. WATER HEATER SHALL HAVE AN APPROVED THERMAL EXPANSION DEVICE.
4. FLOOR SLAB OF PLANT MIX CONCRETE 2500 P.S.I. 4" THICK WITH 6x6 10/10 GUAGE REINFORCING MAT. w/ MIN. 1" COVER, 6 MIL. POLYETHYLENE VAPOR BARRIER OVER COMPACTED CLEAN FILL. WWF SHALL BE PLACED IN MIDDLE TO UPPER THIRD OF SLAB AND SUPPORTED ON APPROVED SLAB BOLSTERS. FIBER MESH REINFORCEMENT MAY BE USED AS AN ALTERNATIVE TO WIRE MESH.
5. PAVERS MAY BE USED ILO CONCRETE SLAB AT PATIO, PORCH, DRIVE AND WALKWAY. DELETE SLAB IN AREAS PAVERS ARE TO BE USED.
6. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
7. IN LEIU OF TREATING THE SOIL AN ALTERNATIVE TERMITE TREATMENT CAN BE APPLIED TO ALL INTERIOR WOOD SURFACES PER FBC-R 2017 6TH EDITION.
8. BORATE TERMITE TREATMENT TO BE APPLIED ON ALL INTERIOR WOOD SURFACES IAW MANUFACTURERS INSTRUCTIONS AND SPECIFICATIONS. PURSUANT TO CH.482 OF THE FLORIDA BUILDING CODE.
9. ALL STEEL TO BE USED IN FOOTERS & EXTERIOR WALLS TO BE MIN. GRADE 60.
10. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.

DOOR NOTE KEY:

DOOR SIZE CALLOUT:

20 = 2'-0"	30 = 3'-0"
24 = 2'-4"	40 B.F. = 4'-0" BIFOLD
26 = 2'-6"	50 B.F. = 5'-0" BIFOLD
28 = 2'-8"	60 B.F. = 6'-0" BIFOLD

* ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER/CLIENT SPEC'S.

- INDICATES AREA OF TWO STORY BEARING FOOTING.

- INDICATES A CONCRETE FILLED CELL OF 8" CMU WALL WITH (1) #5 REBAR VERT. CONT. FROM FOUNDATION TO BOND BEAM. PROVIDE A MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS. MIN. REBAR GRADE 60.

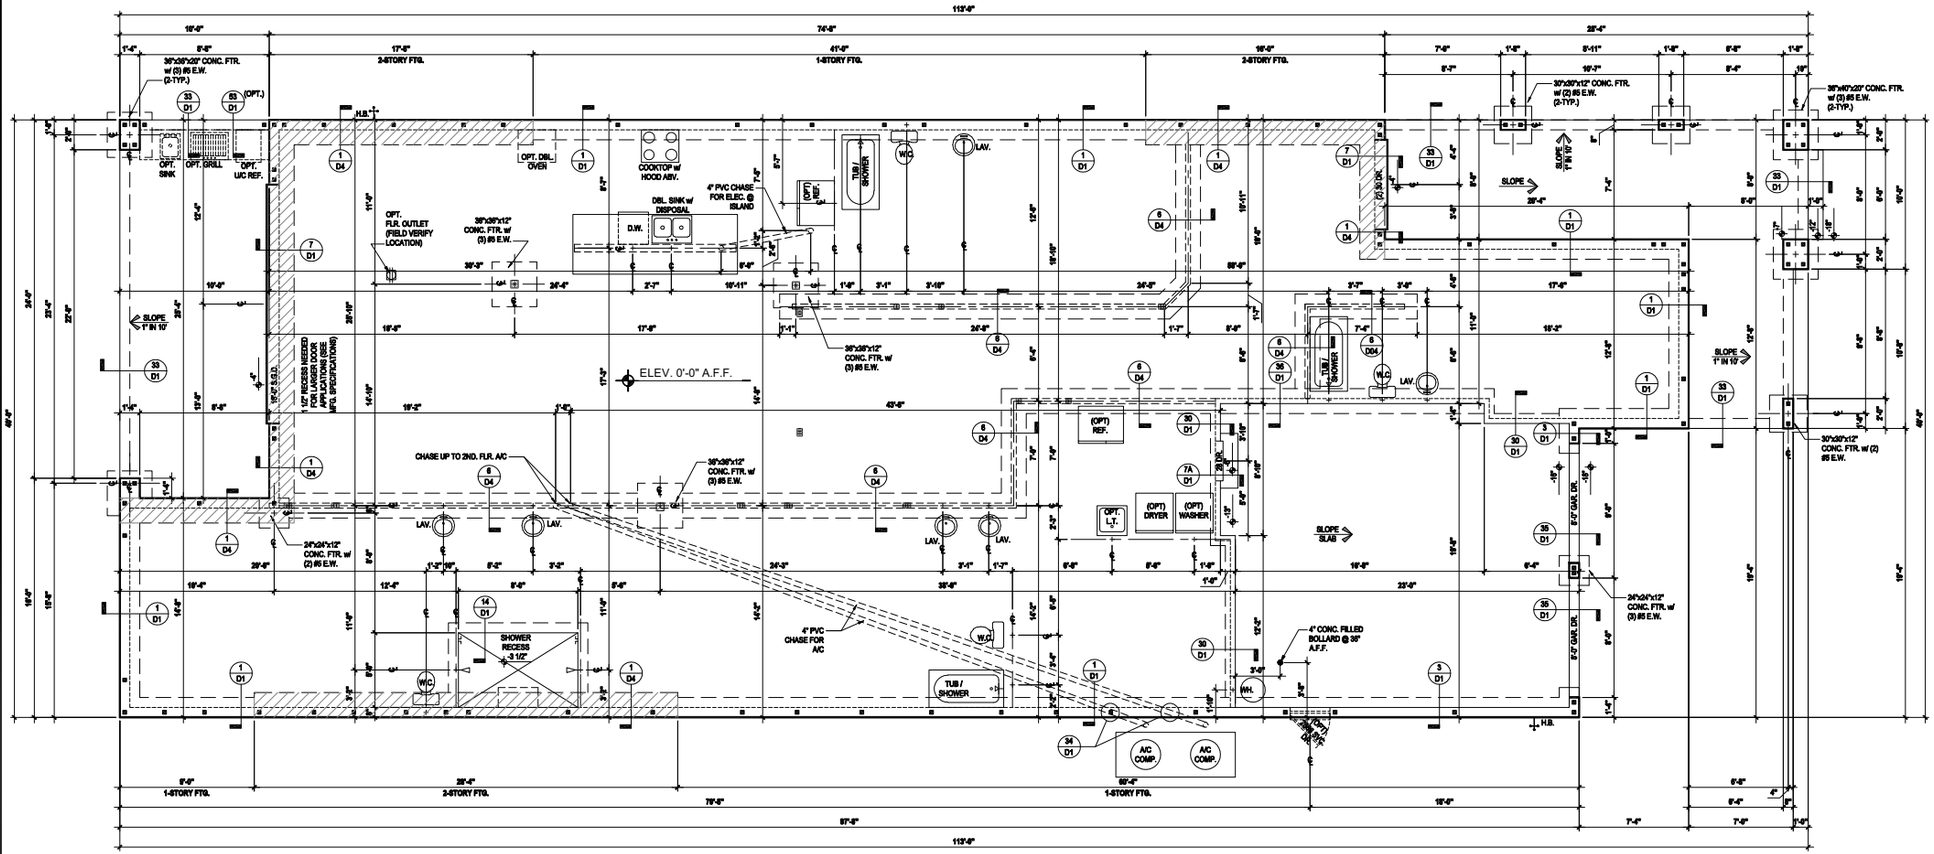

Foundation Plan "C"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2018,6:53pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\01.C1 Foundation Plan (Opt. Balcony).dwg

THESE PLANS, IDEAS AND DESIGN ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OF FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OF FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS custom home design
DESIGNSERVE - PLANSERVE
815 Orlenta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER ARCHITECTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL CERT. AUTH.: 29113
FL PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FOUNDATION PLAN

01.C1

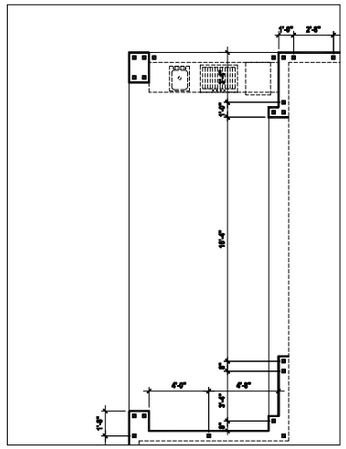

Dowel Plan

(Opt. Pocket SGD.)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

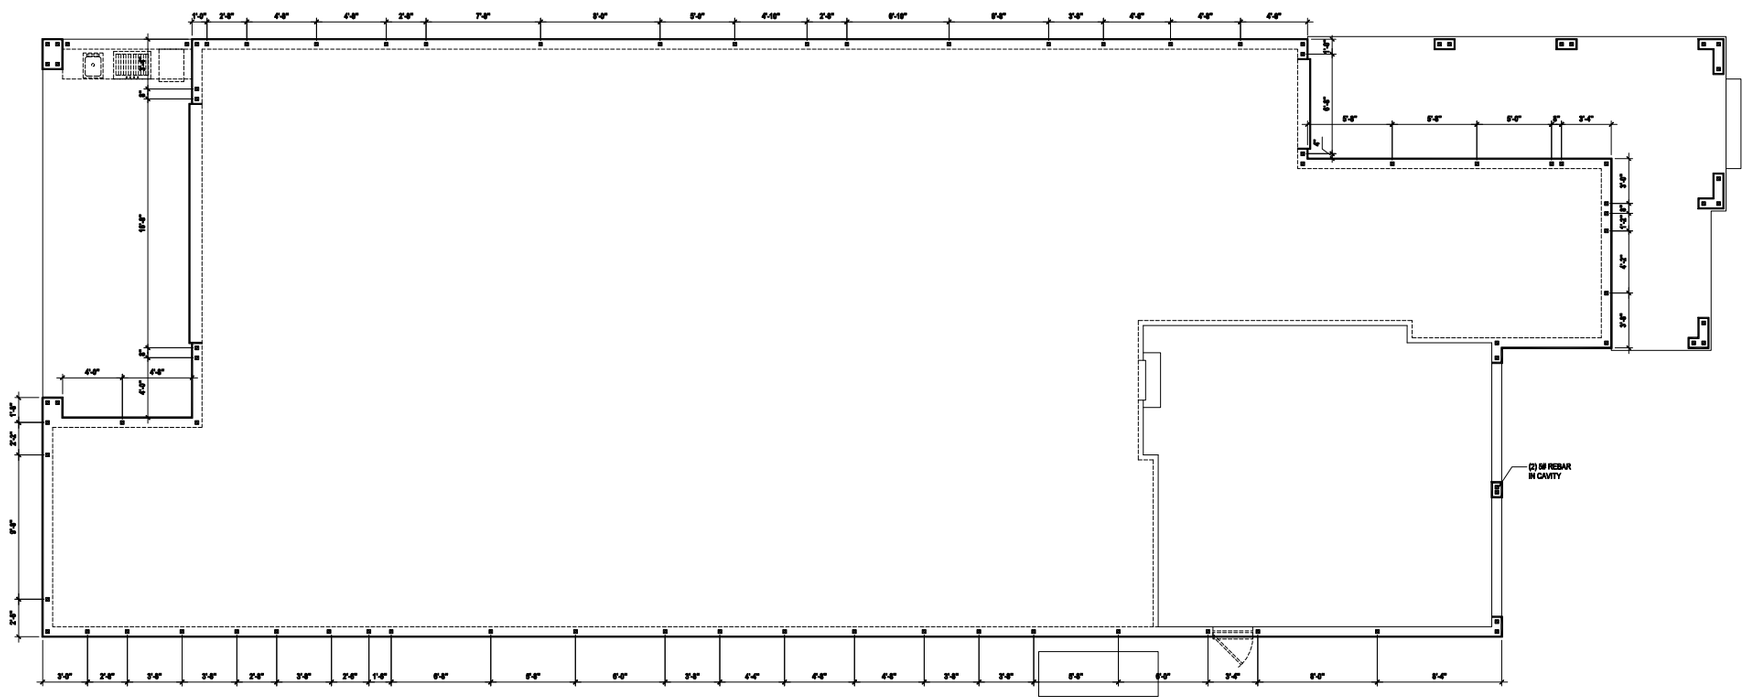

Dowel Plan "A"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,8:53pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\02.A Dowel Plan.dwg

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGNS. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premier-structural.com
FL CERT. AUTH.: 29113
FL PE#: 60239
PREMIER STRUCTURAL ENGINEERING

Note: plans have been electronically signed & sealed by their designer. PE, when it refers to drawings, is in direct and printed copies of the document are not considered legal & binding. Structures must be verified at as-built, certified.

MJS custom home design
CERTIFICATE # CA-C026956
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS.
Contractor shall verify all dimensions, conditions and specifications prior to commencement of any work or fabrication of any component. Notify the designer in writing of any errors in the dimensions, conditions and specifications appearing on these plans.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, Fl. 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

DOWEL PLAN

02.A

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

May 21, 2019,8:55pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\02.B Dowel Plan.dwg

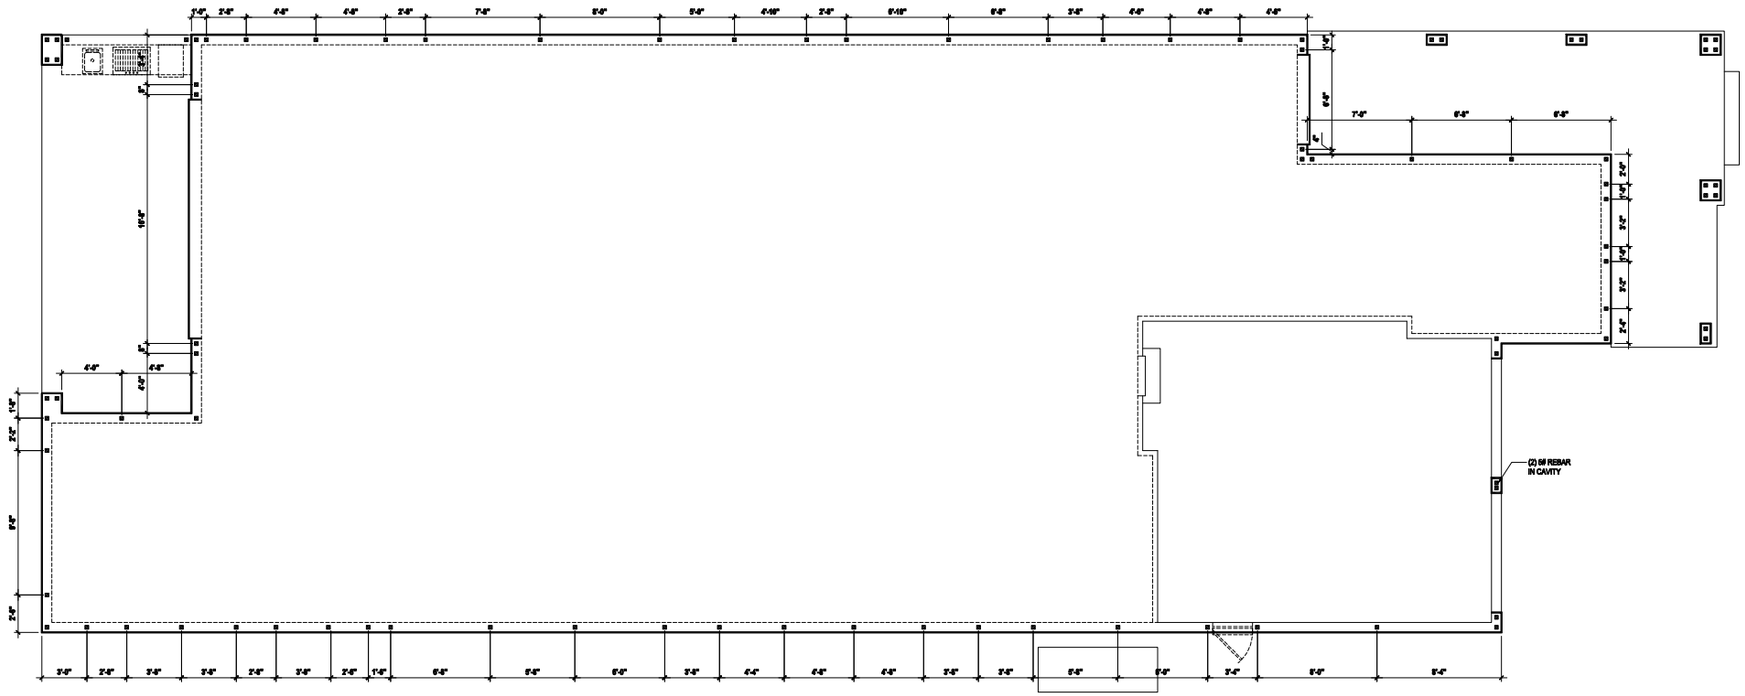

Dowel Plan "B"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS custom home design
DESIGNERS • PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER STRUCTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL CERT. AUTH: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

NOTED DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS.
Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variance from the dimensions, conditions and specifications appearing on these drawings.

When plans have been electronically signed & sealed by Chad Rodriguez, PE, using a digital signature, SCA is sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

DOWEL PLAN

02.B

May 21, 2018,6:53pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\02.C Dowel Plan.dwg
ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

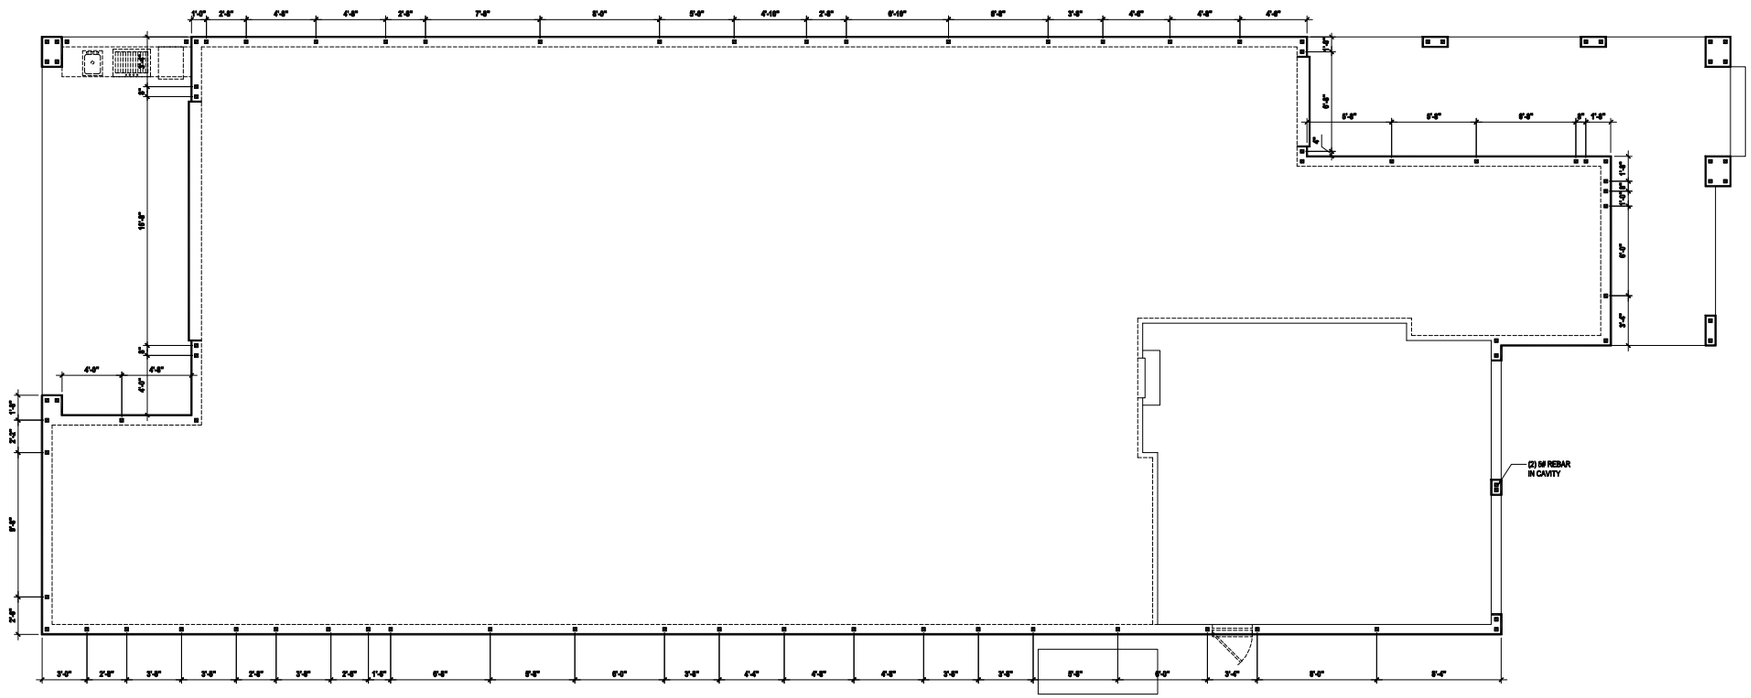

Dowel Plan "B"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS custom home design
DESIGNSGENS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER ARCHITECTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL CERT. AUTH: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

NOTE!!! DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS.
Contractor shall verify and be responsible for dimensions and conditions on the job and MJS, Inc. must be notified of any variations from dimensions and conditions shown on these drawings.

Plans must be verified as per local codes.

When plans have been electronically signed & sealed by Chad Rodgers, PE, using a digital signature, it is a sealed and printed copy of this document and is not considered "Signed & Sealed".

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

DOWEL PLAN

02.C

FLOOR PLAN NOTES:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
4. A/C CONDENSER UNIT TO BE ANCHORED TO SLAB PER CODE M307.2 & M1308.3.
5. PROVIDE RECESS H&C WATER w/ DRAIN @ WASHER SPACE.
6. VENT DRYER THRU EXTERIOR WALL, U.N.O.
7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
8. SAG RESISTANT DRYWALL ON ALL CEILINGS.
9. PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
10. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISH SPEC'S.
11. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
12. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3 5/8" U.N.O.
13. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 7 5/8" U.N.O.
14. ALL INT. FIRST FLOOR CEILINGS AT 9'-0" U.N.O.
   ALL INT. SECOND FLOOR CEILINGS AT 9'-0" U.N.O.
15. C.M.U. & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL SWS = SHEAR WALL SEGMENTS.
16. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED w/ A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER R302.5.1.
17. INSTALL 5/8" TYPE X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP.)
18. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
19. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
20. ALL OPERABLE WINDOWS LOCATED MORE THAN 72" ABV. SURFACE BELOW SHALL HAVE THE LOWEST PORTION OF WINDOW CLEAR OPENING A MIN. OF 24" ABOVE FINISHED FLOOR BEING SERVER PER (FBC-R312.2).
21. ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER / CLIENT
22. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DECKING
23. ALL WINDOW AND DOOR ROUGH OPENINGS VARY PER MANUFACTURER'S SPECIFICATIONS, AND ARE NOT REFLECTED ON THE PLANS. DIMENSIONS PROVIDED ON PLANS ARE USED FOR AN APPROXIMATE LOCATION OF WINDOWS & DOORS, AND DO NOT REFLECT THE ROUGH OPENINGS REQUIRED FOR PROPER INSTALLATION. BUILDER WILL BE REQUIRED TO CROSS-REFERENCE ROUGH OPENINGS AND PLAN DIMENSIONS.

BRG. HT. LEGEND

■ - INDICATES A CONCRETE FILLED CELL WITHIN AN 8" CMU WALL CONTAINING (1) VERT. #5 REBAR CONT., FROM FOUNDATION SLAB TO BOND BEAM. PROVIDE A MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS.

9'-4" BRG. HT. | 12'-0" BRG. HT. | 15'-0" BRG. HT.
10'-0" BRG. HT. | 13'-4" BRG. HT. | 16'-0" BRG. HT.
11'-4" BRG. HT. | 14'-0" BRG. HT. | BRG. PER PLAN

Area Tabulations

Living:		
1st floor:	3,164	sf
2nd floor:	1,084	sf
Total Living:	4,248	sf
entry:	318	sf
covered lanai:	253	sf
garage:	478	sf
Total Area:	5,297	sf

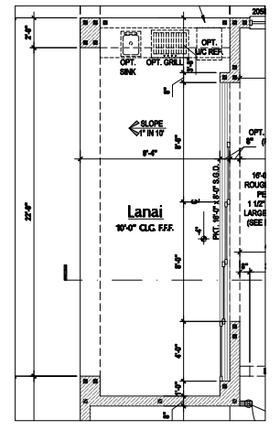

First Floor Plan

(Opt. Pocket SGD.)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

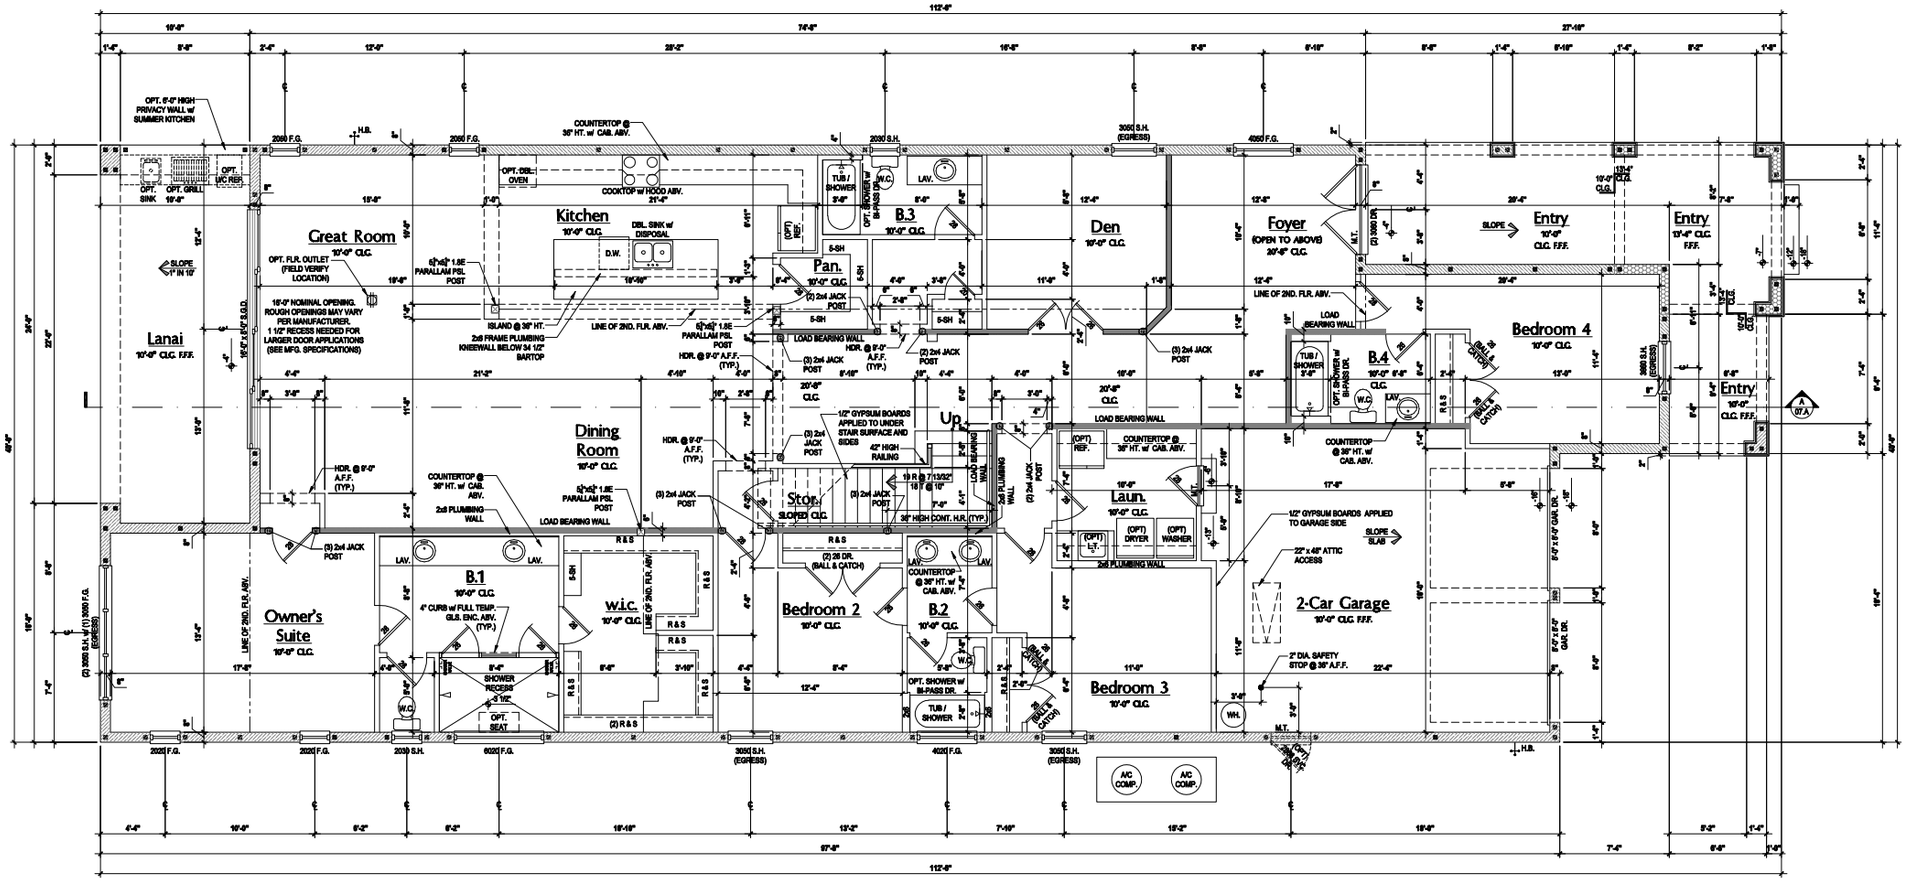

First Floor Plan "A"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
WWW.PREMIERSTRUCTURAL.COM
FL CERT. AUTH.: 29113
FL PE#: 60239

PREMIER STRUCTURAL ENGINEERING INC.

815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
custom home design
DESIGNERS - PLANNERS

MJS

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FIRST FLOOR PLAN

03.A

Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\03.A First Floor Plan.dwg

May 22, 2018, 8:48am

FLOOR PLAN NOTES:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
4. A/C CONDENSER UNIT TO BE ANCHORED TO SLAB PER CODE M307.2 & M1308.3.
5. PROVIDE RECESS H&C WATER w/ DRAIN @ WASHER SPACE.
6. VENT DRYER THRU EXTERIOR WALL, U.N.O.
7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
8. SAG RESISTANT DRYWALL ON ALL CEILINGS.
9. PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
10. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISH SPEC'S.
11. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
12. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3 5/8" U.N.O.
13. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 7 5/8" U.N.O.
14. ALL INT. FIRST FLOOR CEILINGS AT 9'-0" U.N.O.
   ALL INT. SECOND FLOOR CEILINGS AT 9'-0" U.N.O.
15. C.M.U. & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL SWS = SHEAR WALL SEGMENTS.
16. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED w/ A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FRC-R302.5.1.
17. INSTALL 5/8" TYPE X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP.)
18. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
19. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
20. ALL OPERABLE WINDOWS LOCATED MORE THAN 72" ABV. SURFACE BELOW SHALL HAVE THE LOWEST PORTION OF WINDOW CLEAR OPENING A MIN. OF 24" ABOVE FINISHED FLOOR BEING SERVER PER (FBC-R312.2).
21. ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER / CLIENT
22. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DECKING
23. ALL WINDOW AND DOOR ROUGH OPENINGS VARY PER MANUFACTURER'S SPECIFICATIONS, AND ARE NOT REFLECTED ON THE PLANS. DIMENSIONS PROVIDED ON PLANS ARE USED FOR AN APPROXIMATE LOCATION OF WINDOWS & DOORS, AND DO NOT REFLECT THE ROUGH OPENINGS REQUIRED FOR PROPER INSTALLATION. BUILDER WILL BE REQUIRED TO CROSS-REFERENCE ROUGH OPENINGS AND PLAN DIMENSIONS.

BRG. HT. LEGEND

■ - INDICATES A CONCRETE FILLED CELL WITHIN AN 8" CMU WALL CONTAINING (1) VERT. #5 REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM. PROVIDE A MIN. OF 25" LAP OR AN ALL STEEL REINFORCING BARS.

9'-4" BRG. HT. | 12'-0" BRG. HT. | 15'-0" BRG. HT. | 10'-0" BRG. HT. | 13'-4" BRG. HT. | 16'-0" BRG. HT. | 11'-4" BRG. HT. | 14'-0" BRG. HT. | BRG. PER PLAN

Area Tabulations

Living:		
1st floor:	3,164	sf
2nd floor:	1,084	sf
Total Living:	4,248	sf
entry:	318	sf
covered lanai:	253	sf
garage:	478	sf
balcony:	260	sf
Total Area:	5,557	sf

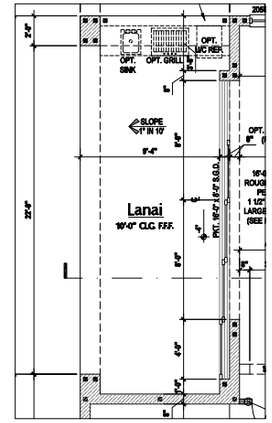

First Floor Plan

(Opt. Pocket SGD)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

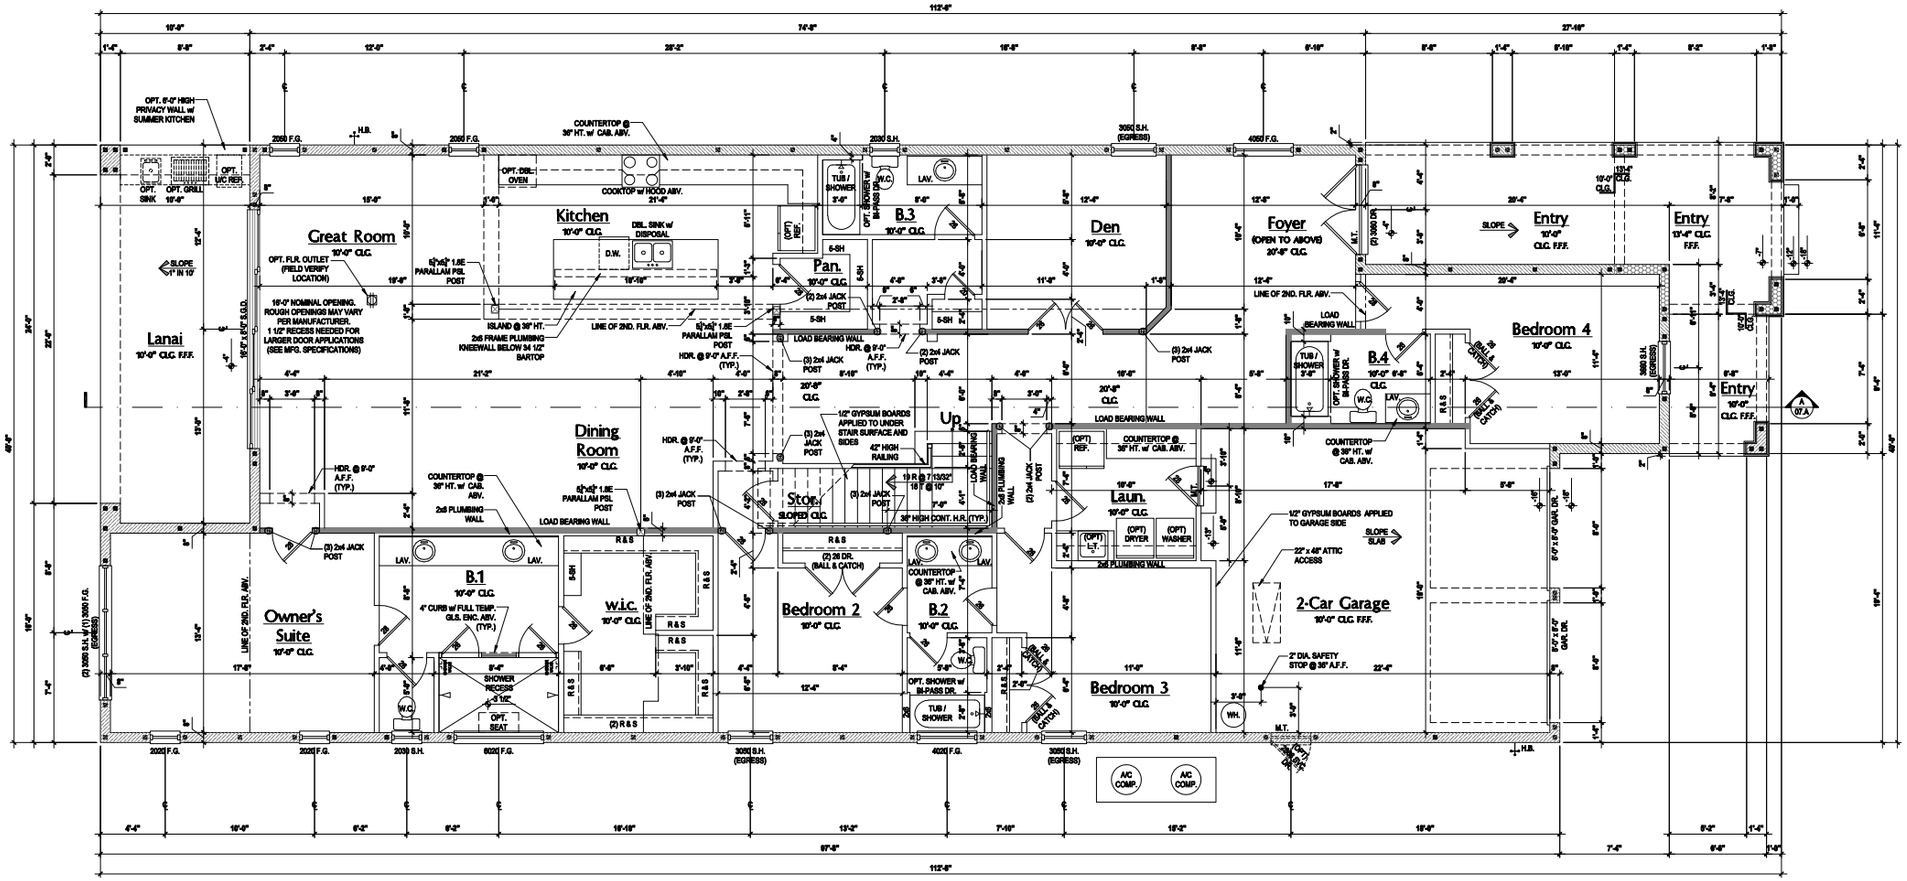

First Floor Plan "A"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

PARK SQUARE HOMES

MJS custom home design
DESIGNERS • PLANNERS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER ARCHITECTURAL & ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL CERT. AUTH.: 29113
FL PE#: 60239

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

These plans have been electronically signed & sealed by Kent Rodriguez, PE using a digital signature. A.D.A. manual and printed copies of this document are not considered Signed & Sealed. Signature and Seal are verified on any electronic copies.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FIRST FLOOR PLAN

03.A1

Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\03.A1 First Floor Plan (Opt. Balcony).dwg

May 22, 2018, 8:48am

FLOOR PLAN NOTES:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
4. A/C CONDENSER UNIT TO BE ANCHORED TO SLAB PER CODE M307.2 & M1309.3.
5. PROVIDE RECESS H&C WATER w/ DRAIN @ WASHER SPACE.
6. VENT DRYER THRU EXTERIOR WALL, U.N.O.
7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
8. SAG RESISTANT DRYWALL ON ALL CEILINGS.
9. PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
10. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISH SPECS.
11. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
12. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3 5/8" U.N.O.
13. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 7 5/8" U.N.O.
14. ALL INT. FIRST FLOOR CEILINGS AT 9'-4" U.N.O.
    ** ALL INT. SECOND FLOOR CEILINGS AT 9'-0" U.N.O.
15. C.M.U. & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL. BWS = SHEAR WALL SEGMENTS.
16. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED w/ A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FBC-R302.5.1.
17. INSTALL SIP TYPE X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP.)
18. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
19. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
20. ALL OPERABLE WINDOWS LOCATED MORE THAN 72" ABV. SURFACE BELOW SHALL HAVE THE LOWEST PORTION OF WINDOW CLEAR OPENING A MIN. OF 24" ABOVE FINISHED FLOOR BEING SERVER PER (FBC-R312.2).
21. ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER / CLIENT
22. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DECKING
23. ALL WINDOW AND DOOR ROUGH OPENINGS VARY PER MANUFACTURER'S SPECIFICATIONS, AND ARE NOT REFLECTED ON THE PLANS. DIMENSIONS PROVIDED ON PLANS ARE USED FOR AN APPROXIMATE LOCATION OF WINDOWS & DOORS, AND DO NOT REFLECT THE ROUGH OPENINGS REQUIRED FOR PROPER INSTALLATION. BUILDER WILL BE REQUIRED TO CROSS-REFERENCE ROUGH OPENINGS AND PLAN DIMENSIONS.

BRG. HT. LEGEND

■ - INDICATES A CONCRETE FILLED CELL WITHIN AN 8" CMU WALL CONTAINING (1) VERT. #5 REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM. PROVIDE A MIN. OF 20" LAP ON ALL STEEL REINFORCING BARS.

9'-4" BRG. HT. | 12'-0" BRG. HT. | 15'-0" BRG. HT.
10'-0" BRG. HT. | 13'-4" BRG. HT. | 16'-0" BRG. HT.
11'-4" BRG. HT. | 14'-0" BRG. HT. | BRG. PER PLAN

Area Tabulations

Living:		
1st floor:	3,164	sf
2nd floor:	1,084	sf
Total Living:	4,248	sf
entry:	323	sf
covered lanai:	253	sf
garage:	478	sf
Total Area:	5,302	sf

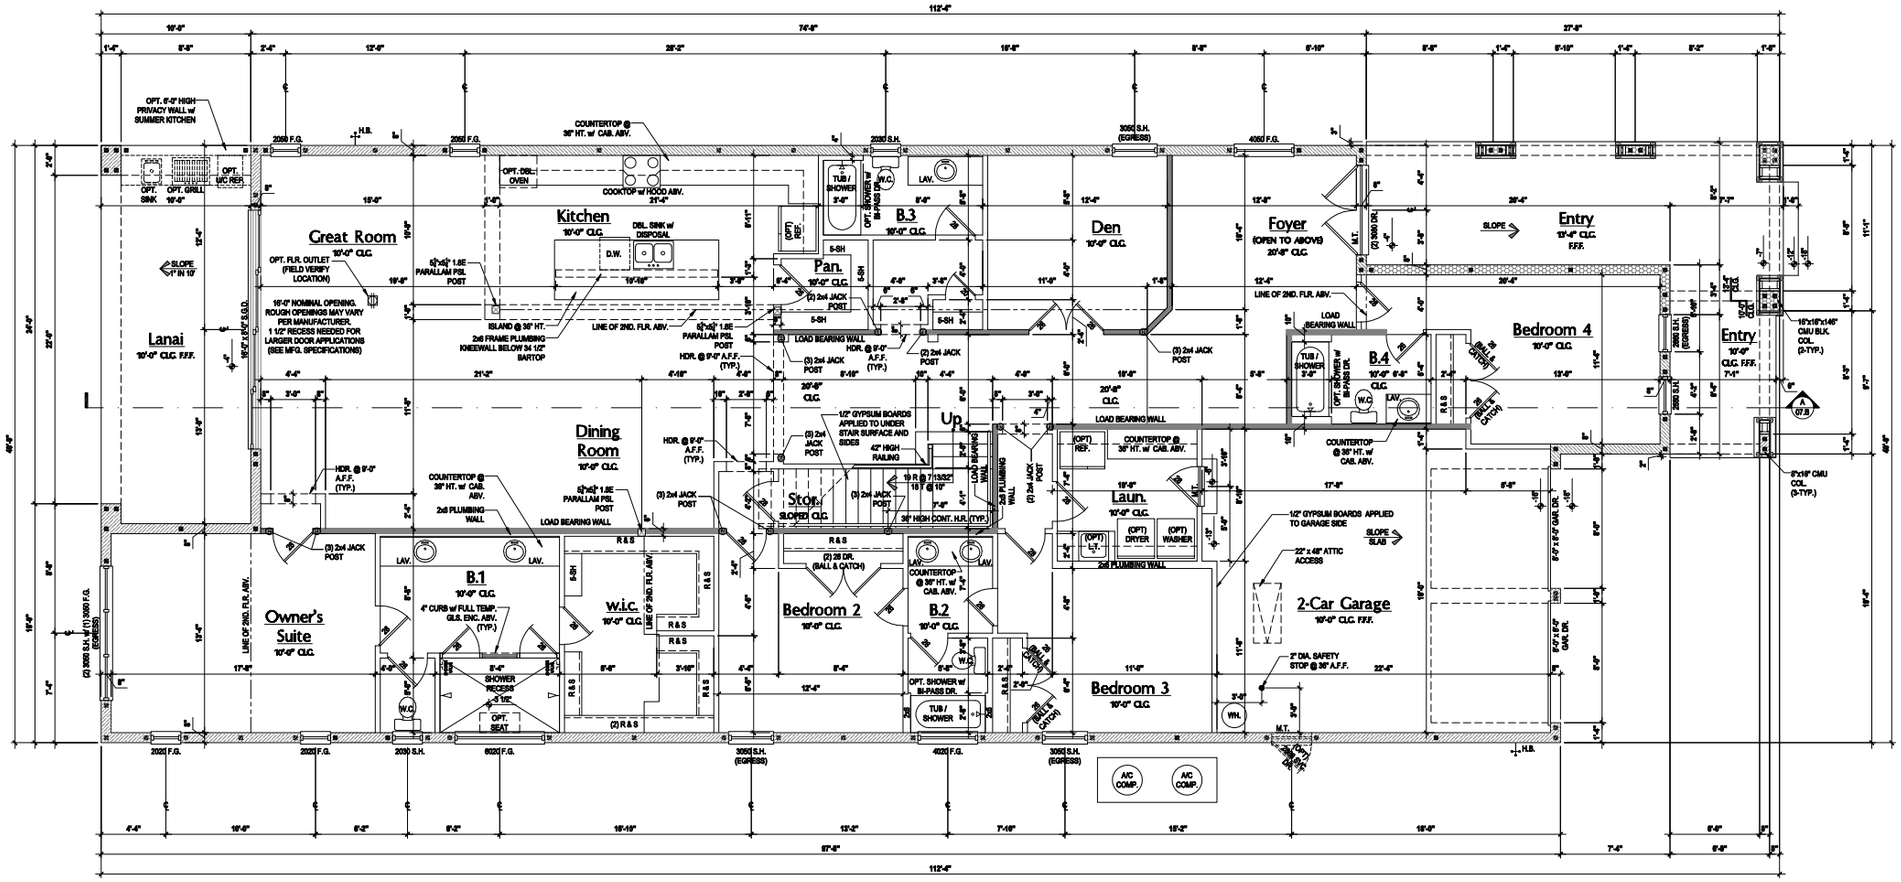

First Floor Plan "B"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATION OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\03.B First Floor Plan.dwg

May 22, 2019,8:49am

© COPYRIGHT 2019 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

PREMIER ARCHITECTURAL & ENGINEERING CONSULTANTS
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL CERT. AUTH.: 29113
FL. PE#: 60239

MJS custom home design DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

INSTEAD DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified in writing of any changes in the dimensions, conditions and specifications appearing on these plans.

Where plans have been electronically signed & sealed by Noel Mackayne, PE, using a digital signature, ID is a valid and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FIRST FLOOR PLAN

03.B

FLOOR PLAN NOTES:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
4. A/C CONDENSER UNIT TO BE ANCHORED TO SLAB PER CODE M307.2 & M1309.3.
5. PROVIDE RECESS H&C WATER w/ DRAIN @ WASHER SPACE.
6. VENT DRYER THRU EXTERIOR WALL, U.N.O.
7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
8. SAG RESISTANT DRYWALL ON ALL CEILINGS.
9. PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
10. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISH SPECS.
11. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
12. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3 5/8" U.N.O.
13. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 7 5/8" U.N.O.
14. ALL INT. FIRST FLOOR CEILINGS AT 9'-4" U.N.O.
    ** ALL INT. SECOND FLOOR CEILINGS AT 9'-0" U.N.O.
15. C.M.U. & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL. BWS = SHEAR WALL SEGMENTS.
16. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED w/ A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FBC-R302.5.1.
17. INSTALL 5/8" TYPE X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP.)
18. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
19. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
20. ALL OPERABLE WINDOWS LOCATED MORE THAN 72" ABV. SURFACE BELOW SHALL HAVE THE LOWEST PORTION OF WINDOW CLEAR OPENING A MIN. OF 24" ABOVE FINISHED FLOOR BEING SERVED PER (FBC-R312.2).
21. ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER / CLIENT
22. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DECKING
23. ALL WINDOW AND DOOR ROUGH OPENINGS VARY PER MANUFACTURER'S SPECIFICATIONS, AND ARE NOT REFLECTED ON THE PLANS. DIMENSIONS PROVIDED ON PLANS ARE USED FOR AN APPROXIMATE LOCATION OF WINDOWS & DOORS, AND DO NOT REFLECT THE ROUGH OPENINGS REQUIRED FOR PROPER INSTALLATION. BUILDER WILL BE REQUIRED TO CROSS-REFERENCE ROUGH OPENINGS AND PLAN DIMENSIONS.

BRG. HT. LEGEND

■ - INDICATES A CONCRETE FILLED CELL WITHIN AN 8" CMU WALL CONTAINING (1) VERT. #5 REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM. PROVIDE A MIN. OF 20" LAP ON ALL STEEL REINFORCING BARS.

9'-4" BRG. HT. | 12'-0" BRG. HT. | 15'-0" BRG. HT.
10'-0" BRG. HT. | 13'-4" BRG. HT. | 16'-0" BRG. HT.
11'-4" BRG. HT. | 14'-0" BRG. HT. | BRG. PER PLAN

Area Tabulations

Living:		
1st floor:	3,164	sf
2nd floor:	1,084	sf
Total Living:	4,248	sf
entry:	323	sf
covered lanai:	253	sf
garage:	478	sf
balcony:	260	sf
Total Area:	5,562	sf

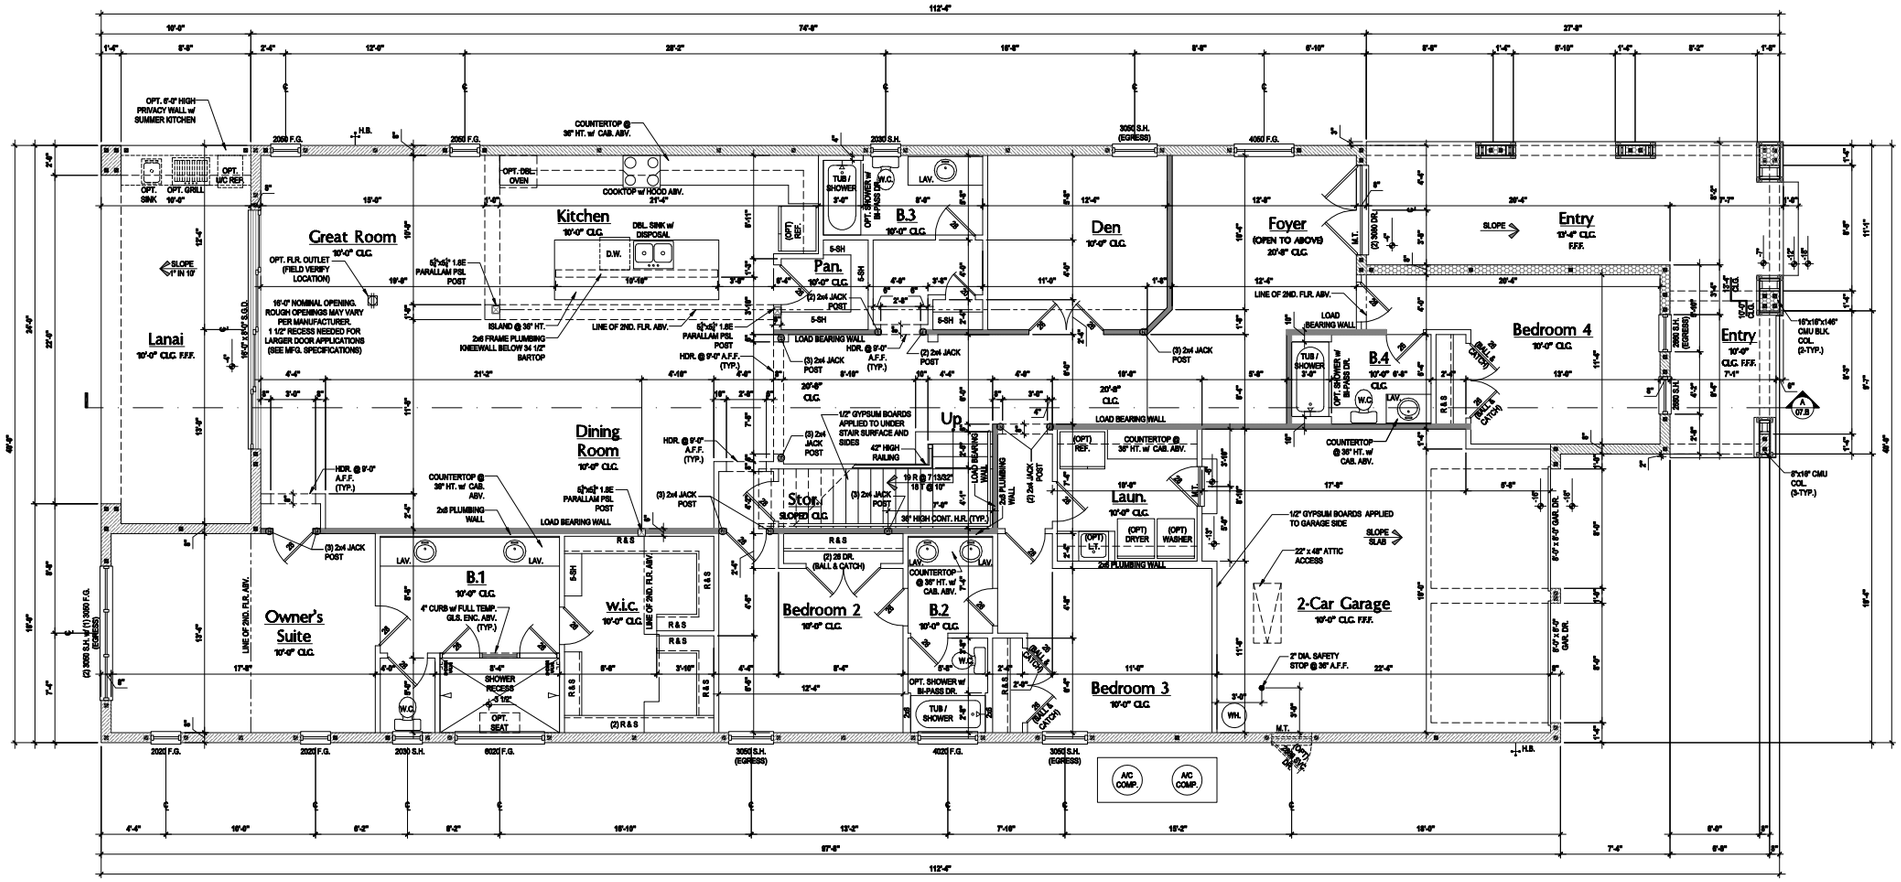

First Floor Plan "B"

(Opt. Balcony)

SCALE 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

PREMIER ARCHITECTURAL & ENGINEERING
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL CERT. AUTH.: 29113
FL. PE#: 60239

MJS custom home design
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
DESIGNERS - PLANNERS www.mjshomedesigns.com

40-4248
YORKSHIRE
Street Address
Lot Info
City, State, Zip

ISSUE DATE 00/00/0000
REVISIONS

PROJECT: 00-0000
SCALE: AS NOTED
DRAWN BY: C.C.
DESIGNED BY: MJS

FIRST FLOOR PLAN
03.B1

Your plans have been electronically signed & sealed by Noel Rodriguez, PE, using a digital signature. DO a sealed and printed copy of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

May 22, 2019,8:49am Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\07 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\03.B1 First Floor Plan (Opt. Balcony).dwg

FLOOR PLAN NOTES:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
4. A/C CONDENSER UNIT TO BE ANCHORED TO SLAB PER CODE M307.2 & M1307.3.
5. PROVIDE RECESS H&C WATER w/ DRAIN @ WASHER SPACE.
6. VENT DRYER THRU EXTERIOR WALL, U.N.O.
7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
8. SAG RESISTANT DRYWALL ON ALL CEILINGS.
9. PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
10. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISH SPECS.
11. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
12. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3 5/8" U.N.O.
13. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 7 5/8" U.N.O.
14. ALL INT. FIRST FLOOR CEILINGS AT 9'-4" U.N.O.
    ALL INT. SECOND FLOOR CEILINGS AT 8'-0" U.N.O.
15. C.M.U. & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL SYS = SHEAR WALL SEGMENTS.
16. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED w/ A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FBC-R302.5.1.
17. INSTALL 5/8" TYPE X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP.)
18. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
19. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
20. ALL OPERABLE WINDOWS LOCATED MORE THAN 72" ABV. SURFACE BELOW SHALL HAVE THE LOWEST PORTION OF WINDOW CLEAR OPENING A MIN. OF 24" ABOVE FINISHED FLOOR BEING SERVICE PER (FBC-R312.2).
21. ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER / CLIENT
22. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DECKING
23. ALL WINDOW AND DOOR ROUGH OPENINGS VARY PER MANUFACTURER'S SPECIFICATIONS, AND ARE NOT REFLECTED ON THE PLANS. DIMENSIONS PROVIDED ON PLANS ARE USED FOR AN APPROXIMATE LOCATION OF WINDOWS & DOORS, AND DO NOT REFLECT THE ROUGH OPENINGS REQUIRED FOR PROPER INSTALLATION. BUILDER WILL BE REQUIRED TO CROSS-REFERENCE ROUGH OPENINGS AND PLAN DIMENSIONS.

BRG. HT. LEGEND

■ - INDICATES A CONCRETE FILLED CELL WITHIN AN 8" CMU WALL CONTAINING (1) VERT. #5 REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM. PROVIDE A MIN. OF 20" LAP ON ALL STEEL REINFORCING BARS.

9'-4" BRG. HT. | 12'-0" BRG. HT. | 15'-0" BRG. HT.
10'-0" BRG. HT. | 13'-4" BRG. HT. | 16'-0" BRG. HT.
11'-4" BRG. HT. | 14'-0" BRG. HT. | BRG. PER PLAN

Area Tabulations

Living:		
1st floor:	3,164	sf
2nd floor:	1,084	sf
Total Living:	4,248	sf
entry:	318	sf
covered lanai:	253	sf
garage:	478	sf
Total Area:	5,297	sf

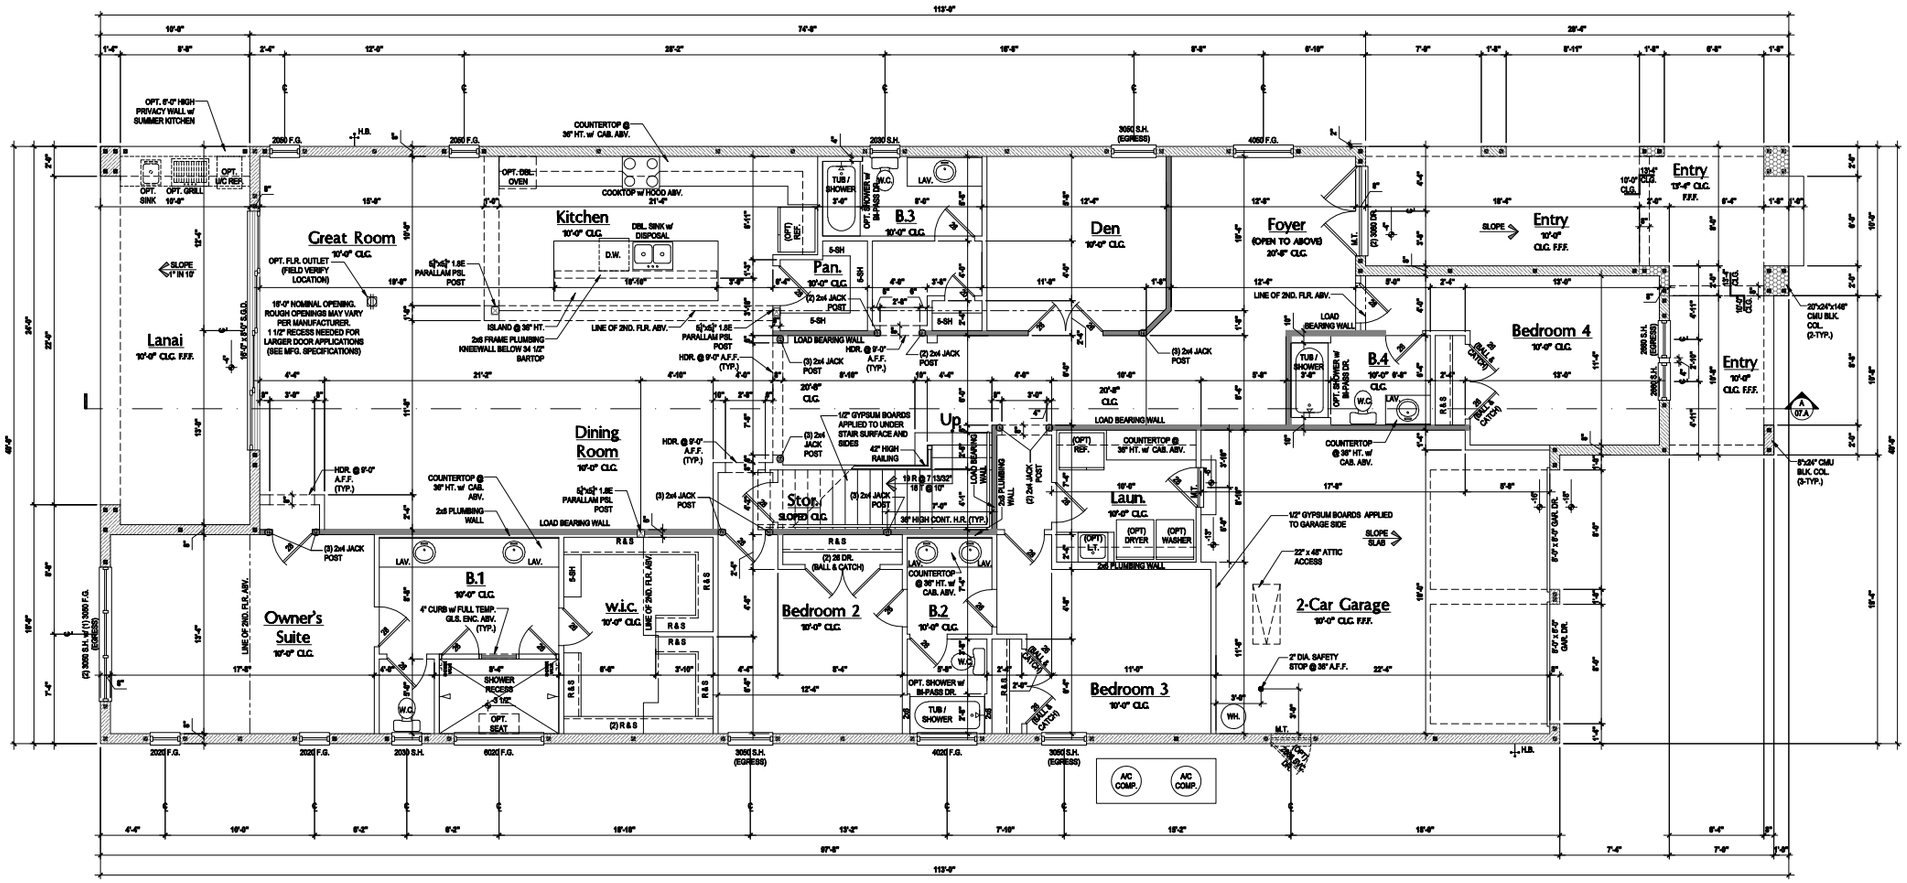

First Floor Plan "C"

(Standard)

SCALE 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATION OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\03.C First Floor Plan.dwg

May 22, 2018,8:46am

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

PREMIER ARCHITECTURAL & ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL CERT. AUTH.: 29113
FL PE#: 60239

MJS custom home design DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

INSTEAD DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

This plan has been electronically signed & sealed by Fred Rodriguez, PE, using a digital signature. SO is sealed and printed copies of this document are not considered signed & sealed. Signature must be verified on any electronic copies.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FIRST FLOOR PLAN

03.C

FLOOR PLAN NOTES:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
4. A/C CONDENSER UNIT TO BE ANCHORED TO SLAB PER CODE M307.2 & M1307.3.
5. PROVIDE RECESS H&C WATER w/ DRAIN @ WASHER SPACE.
6. VENT DRYER THRU EXTERIOR WALL, U.N.O.
7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
8. SAG RESISTANT DRYWALL ON ALL CEILINGS.
9. PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
10. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISH SPECS.
11. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
12. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3 5/8" U.N.O.
13. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 7 5/8" U.N.O.
14. ALL INT. FIRST FLOOR CEILINGS AT 9'-4" U.N.O.
    ALL INT. SECOND FLOOR CEILINGS AT 8'-0" U.N.O.
15. C.M.U. & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL SYS = SHEAR WALL SEGMENTS.
16. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED w/ A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FBC-R302.5.1.
17. INSTALL 5/8" TYPE X GYPSUM ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP.)
18. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
19. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
20. ALL OPERABLE WINDOWS LOCATED MORE THAN 72" ABV. SURFACE BELOW SHALL HAVE THE LOWEST PORTION OF WINDOW CLEAR OPENING A MIN. OF 24" ABOVE FINISHED FLOOR BEING SERVICE PER (FBC-R312.2).
21. ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER / CLIENT
22. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DECKING
23. ALL WINDOW AND DOOR ROUGH OPENINGS VARY PER MANUFACTURER'S SPECIFICATIONS, AND ARE NOT REFLECTED ON THE PLANS. DIMENSIONS PROVIDED ON PLANS ARE USED FOR AN APPROXIMATE LOCATION OF WINDOWS & DOORS, AND DO NOT REFLECT THE ROUGH OPENINGS REQUIRED FOR PROPER INSTALLATION. BUILDER WILL BE REQUIRED TO CROSS-REFERENCE ROUGH OPENINGS AND PLAN DIMENSIONS.

BRG. HT. LEGEND

■ - INDICATES A CONCRETE FILLED CELL WITHIN AN 8" CMU WALL CONTAINING (1) VERT. #5 REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM. PROVIDE A MIN. OF 20" LAP ON ALL STEEL REINFORCING BARS.

9'-4" BRG. HT. | 12'-0" BRG. HT. | 15'-0" BRG. HT.
10'-0" BRG. HT. | 13'-4" BRG. HT. | 16'-0" BRG. HT.
11'-4" BRG. HT. | 14'-0" BRG. HT. | BRG. PER PLAN

Area Tabulations

Living:		
1st floor:	3,164	sf
2nd floor:	1,084	sf
Total Living:	4,248	sf
entry:	318	sf
covered lanai:	253	sf
garage:	478	sf
balcony:	260	sf
Total Area:	5,557	sf

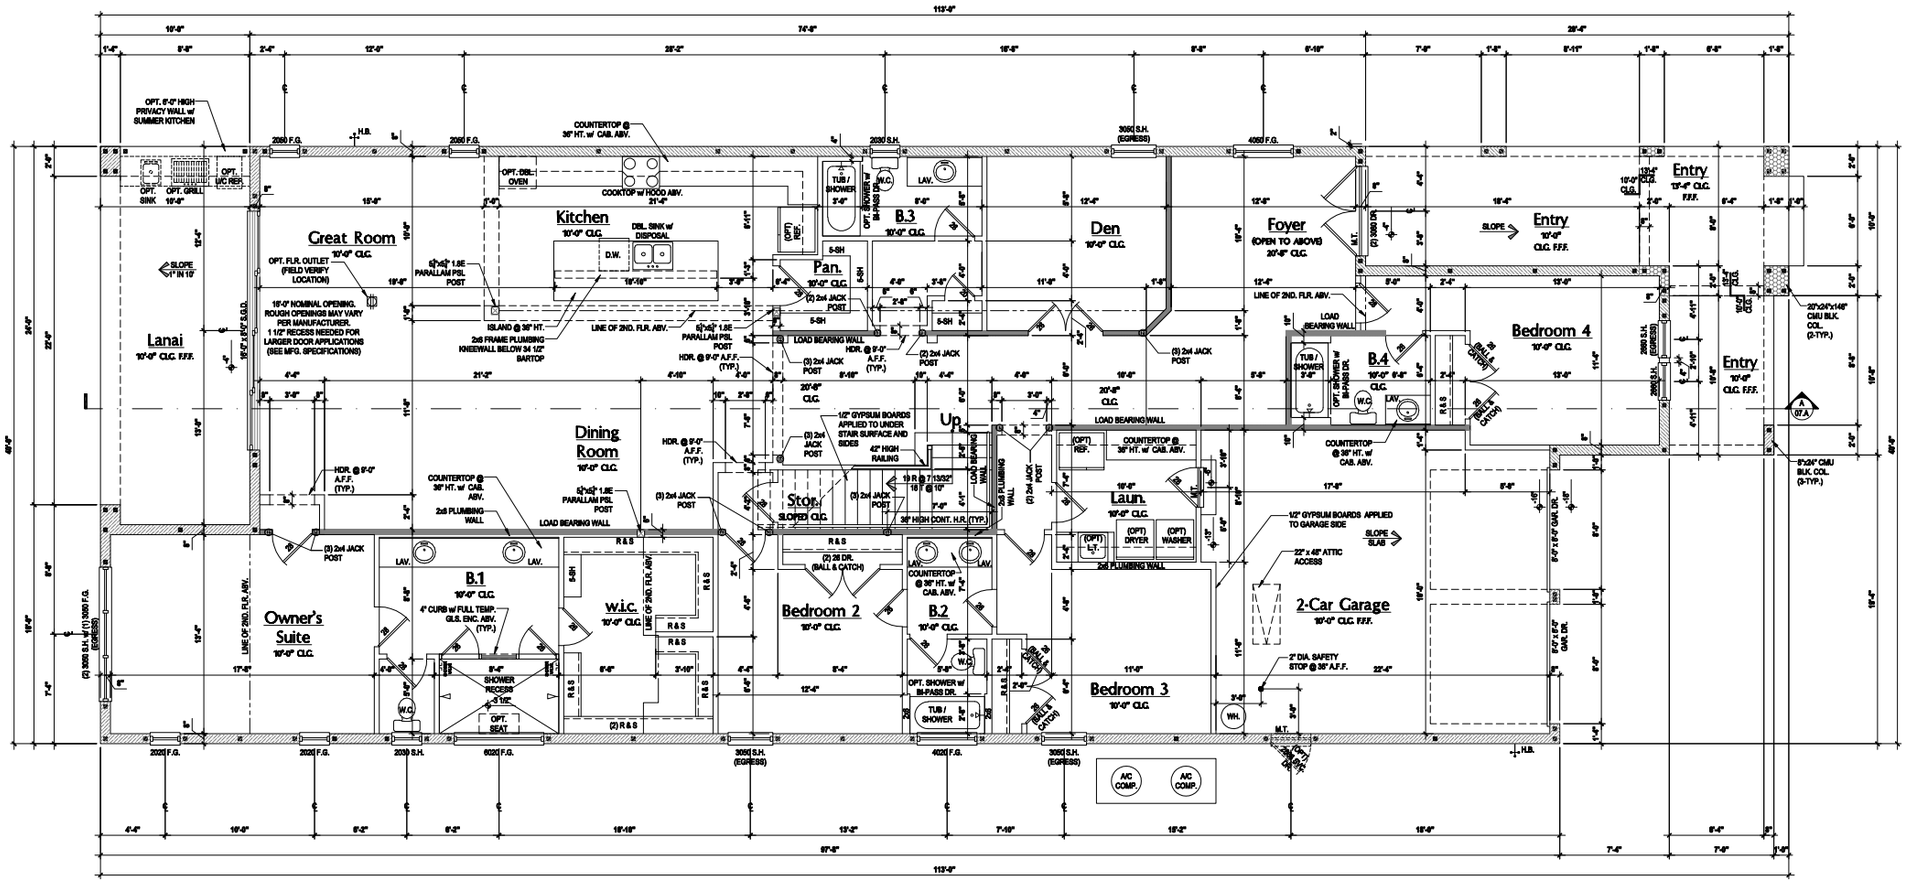

First Floor Plan "C"

(Opt. Balcony)

SCALE 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

PARK SQUARE HOMES

MJS custom home design
DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER ARCHITECTURAL STUDIO
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL CERT. AUTH.: 29113
FL PE#: 60239

40-4248
YORKSHIRE
Street Address
Lot Info
City, State, Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FIRST FLOOR PLAN
03.C1

Plans have been electronically signed & sealed by Brad Rodrigues, PE, using a digital signature. SQ ft stated and printed copies of this document are not considered signed & sealed. Signature and seal to be verified on any electronic copies.

BEFORE DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

May 22, 2018,8:49am Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\03.C1 First Floor Plan (Opt. Balcony) Alt\general\PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATION OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

FLOOR PLAN NOTES:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
4. A/C CONDENSER UNIT TO BE ANCHORED TO SLAB PER CODE M307.2 & M1309.3.
5. PROVIDE RECESS H&C WATER w/ DRAIN @ WASHER SPACE.
6. VENT DRYER THRU EXTERIOR WALL, U.N.O.
7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
8. SAG RESISTANT DRYWALL ON ALL CEILINGS.
9. PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
10. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISH SPECS.
11. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
12. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3 5/8" U.N.O.
13. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 7 5/8" U.N.O.
14. ALL INT. FIRST FLOOR CEILINGS AT 9'-0" U.N.O.
    ALL INT. SECOND FLOOR CEILINGS AT 9'-0" U.N.O.
15. C.M.U. & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL. SWS = SHEAR WALL SEGMENTS.
16. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED w/ A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FBC-R302.5.1.
17. INSTALL 5/8" TYPE X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP.)
18. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
19. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
20. ALL OPERABLE WINDOWS LOCATED MORE THAN 72" ABV. SURFACE BELOW SHALL HAVE THE LOWEST PORTION OF WINDOW CLEAR OPENING A MIN. OF 24" ABOVE FINISHED FLOOR BEING SERVICE PER (FBC-R312.2).
21. ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER / CLIENT
22. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DECKING
23. ALL WINDOW AND DOOR ROUGH OPENINGS VARY PER MANUFACTURER'S SPECIFICATIONS, AND ARE NOT REFLECTED ON THE PLANS. DIMENSIONS PROVIDED ON PLANS ARE USED FOR AN APPROXIMATE LOCATION OF WINDOWS & DOORS, AND DO NOT REFLECT THE ROUGH OPENINGS REQUIRED FOR PROPER INSTALLATION. BUILDER WILL BE REQUIRED TO CROSS-REFERENCE ROUGH OPENINGS AND PLAN DIMENSIONS.

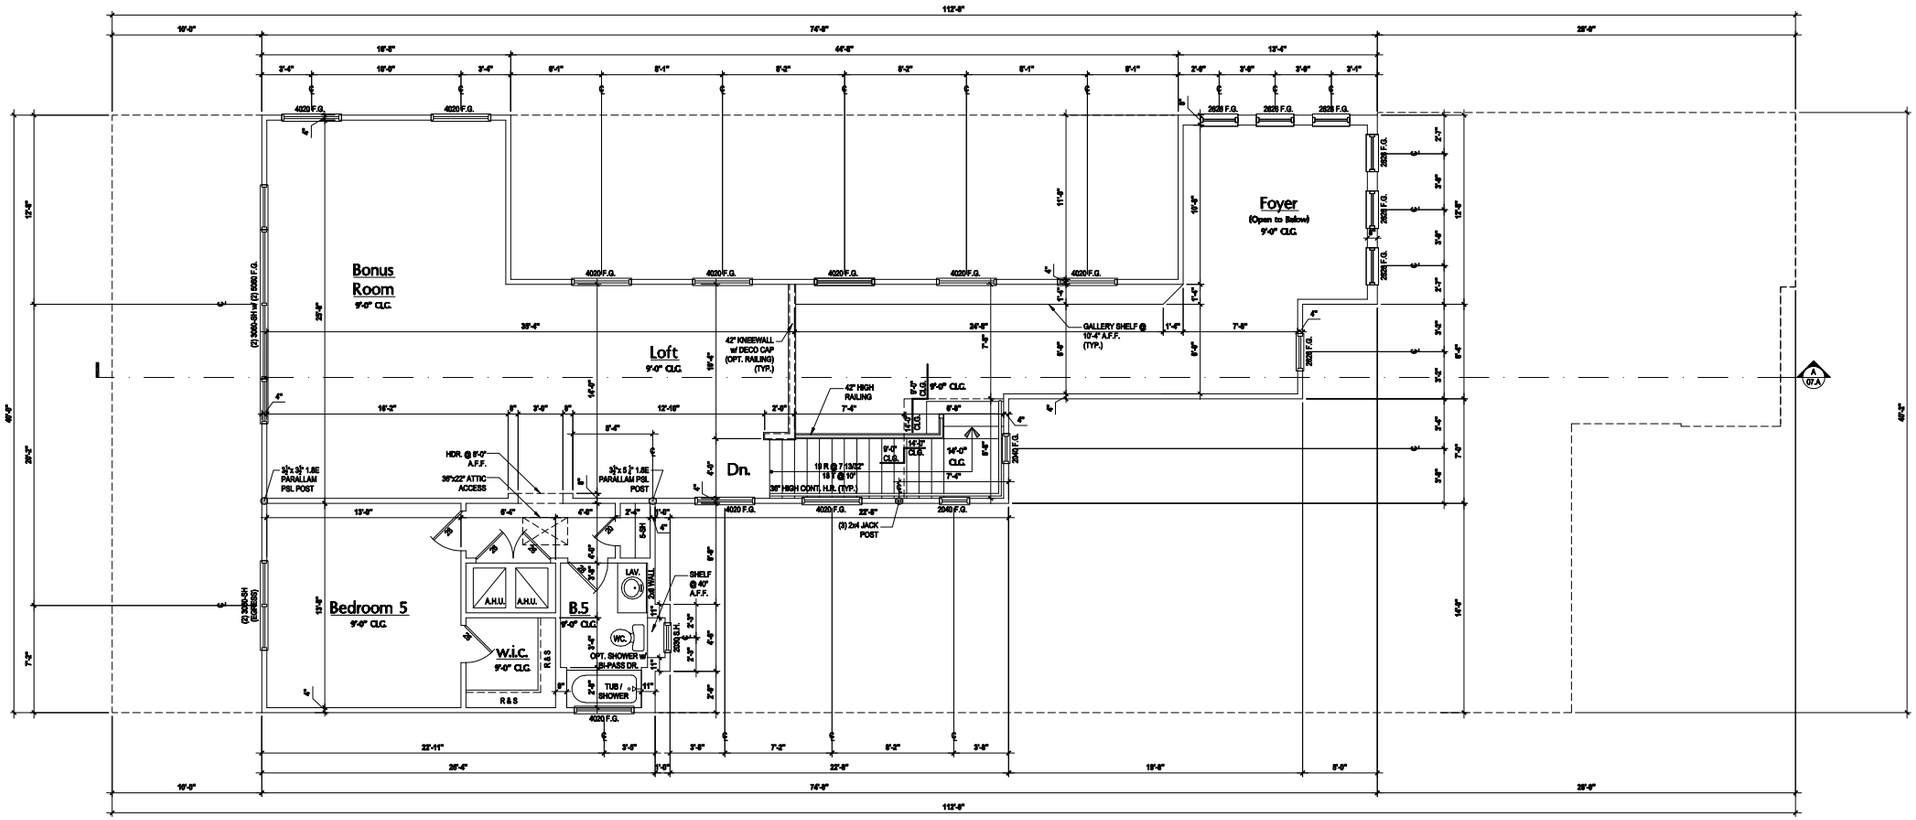

Second Floor Plan "A"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 22, 2018,8:48am Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\A-A Second Floor Plan.dwg

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATION OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS custom home design DESIGNSGROUP - PLANNING
815 Orlenta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER ARCHITECTURAL ENGINEERING LLC
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

MISTAKE DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions on the job and MJS, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

Never plans have been electronically signed & sealed by Chad Kirkpatrick, PE, using a digital signature. DO a raised seal printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

SECOND FLOOR PLAN

04.A

FLOOR PLAN NOTES:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
4. A/C CONDENSER UNIT TO BE ANCHORED TO SLAB PER CODE M307.2 & M1309.3.
5. PROVIDE RECESS H&C WATER w/ DRAIN @ WASHER SPACE.
6. VENT DRYER THRU EXTERIOR WALL, U.N.O.
7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
8. SAG RESISTANT DRYWALL ON ALL CEILINGS.
9. PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
10. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISH SPECS.
11. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
12. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 5 $\frac{1}{2}$" U.N.O.
13. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 7 $\frac{1}{2}$" U.N.O.
14. ALL INT. FIRST FLOOR CEILINGS AT 9'-0" U.N.O.
    ALL INT. SECOND FLOOR CEILINGS AT 9'-0" U.N.O.
15. C.M.U. & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL. SWS = SHEAR WALL SEGMENTS.
16. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED w/ A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FBC-R302.5.1.
17. INSTALL 5/8" TYPE X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP.)
18. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
19. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
20. ALL OPERABLE WINDOWS LOCATED MORE THAN 72" ABV. SURFACE BELOW SHALL HAVE THE LOWEST PORTION OF WINDOW CLEAR OPENING A MIN. OF 24" ABOVE FINISHED FLOOR BEING SERVICE PER (FBC-R312.2).
21. ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER / CLIENT
22. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DECKING
23. ALL WINDOW AND DOOR ROUGH OPENINGS VARY PER MANUFACTURER'S SPECIFICATIONS, AND ARE NOT REFLECTED ON THE PLANS. DIMENSIONS PROVIDED ON PLANS ARE USED FOR AN APPROXIMATE LOCATION OF WINDOWS & DOORS, AND DO NOT REFLECT THE ROUGH OPENINGS REQUIRED FOR PROPER INSTALLATION. BUILDER WILL BE REQUIRED TO CROSS-REFERENCE ROUGH OPENINGS AND PLAN DIMENSIONS.

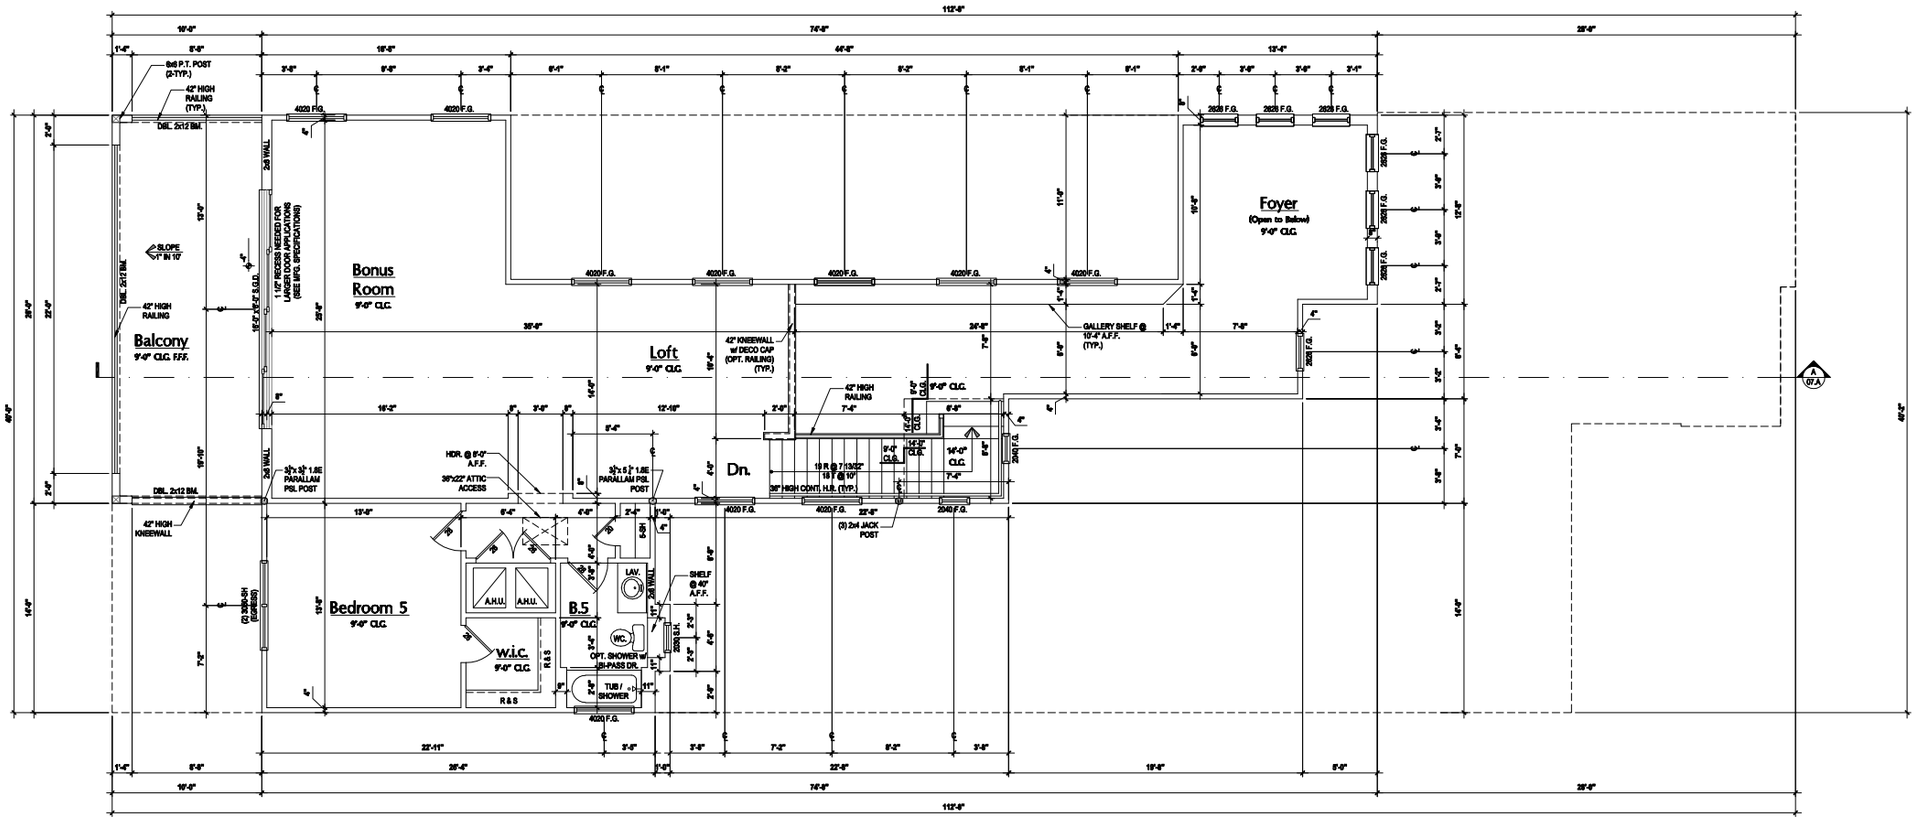

Second Floor Plan "A"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2016 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS
custom home design
DESIGNSERVE - PLANSERVE
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER
STRUCTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

MEETED DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS.
Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions and conditions shown on these drawings.

This plan has been electronically signed & sealed by Neal Hodgson, PE, using a digital signature. DO a sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

SECOND FLOOR PLAN

04.A1

FLOOR PLAN NOTES:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
4. A/C CONDENSER UNIT TO BE ANCHORED TO SLAB PER CODE M307.2 & M1309.3.
5. PROVIDE RECESS H&C WATER w/ DRAIN @ WASHER SPACE.
6. VENT DRYER THRU EXTERIOR WALL, U.N.O.
7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
8. SAG RESISTANT DRYWALL ON ALL CEILINGS.
9. PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
10. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISH SPECS.
11. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
12. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3 $\frac{1}{2}$" U.N.O.
13. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 7 $\frac{5}{8}$" U.N.O.
14. ALL INT. FIRST FLOOR CEILINGS AT 9'-0" U.N.O.
    ALL INT. SECOND FLOOR CEILINGS AT 9'-0" U.N.O.
15. C.M.U. & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL. SWS = SHEAR WALL SEGMENTS.
16. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED w/ A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FBC-R302.5.1.
17. INSTALL 5/8" TYPE X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP.)
18. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
19. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
20. ALL OPERABLE WINDOWS LOCATED MORE THAN 72" ABV. SURFACE BELOW SHALL HAVE THE LOWEST PORTION OF WINDOW CLEAR OPENING A MIN. OF 24" ABOVE FINISHED FLOOR BEING SERVICE PER (FBC-R312.2).
21. ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER / CLIENT
22. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DECKING
23. ALL WINDOW AND DOOR ROUGH OPENINGS VARY PER MANUFACTURER'S SPECIFICATIONS, AND ARE NOT REFLECTED ON THE PLANS. DIMENSIONS PROVIDED ON PLANS ARE USED FOR AN APPROXIMATE LOCATION OF WINDOWS & DOORS, AND DO NOT REFLECT THE ROUGH OPENINGS REQUIRED FOR PROPER INSTALLATION. BUILDER WILL BE REQUIRED TO CROSS-REFERENCE ROUGH OPENINGS AND PLAN DIMENSIONS.

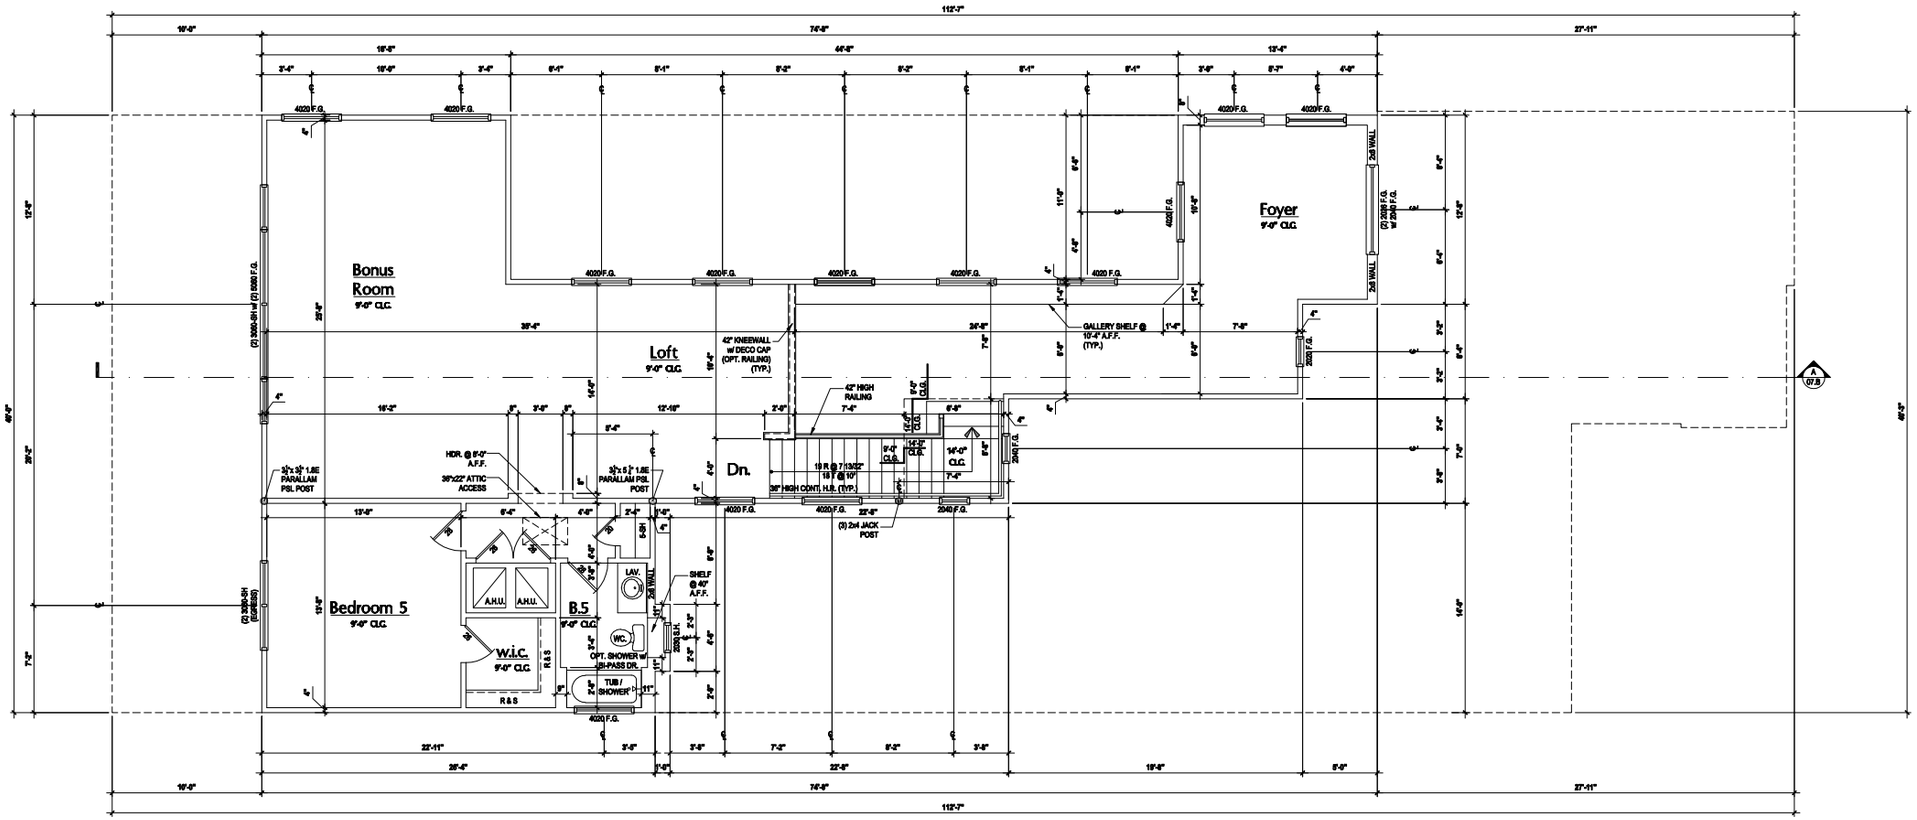

Second Floor Plan "B"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 22, 2018,8:48am Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\04-B Second Floor Plan.dwg

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS DESIGNGROUP
custom home design
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER ARCHITECTURAL ENGINEERING LLC
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

NOTED DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions, conditions and specifications appearing on these plans.

Your plans have been electronically signed & sealed by Noel Rodriguez, PE, using a digital signature. DO a sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

SECOND FLOOR PLAN

04.B

FLOOR PLAN NOTES:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
4. A/C CONDENSER UNIT TO BE ANCHORED TO SLAB PER CODE M307.2 & M1309.3.
5. PROVIDE RECESS H&C WATER w/ DRAIN @ WASHER SPACE.
6. VENT DRYER THRU EXTERIOR WALL, U.N.O.
7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
8. SAG RESISTANT DRYWALL ON ALL CEILINGS.
9. PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
10. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISH SPECS.
11. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
12. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 5 $\frac{1}{2}$" U.N.O.
13. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 7 $\frac{1}{2}$" U.N.O.
14. ALL INT. FIRST FLOOR CEILINGS AT 9'-0" U.N.O.
    ALL INT. SECOND FLOOR CEILINGS AT 9'-0" U.N.O.
15. C.M.U. & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL. SWS = SHEAR WALL SEGMENTS.
16. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED w/ A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FBC-R302.5.1.
17. INSTALL 5/8" TYPE X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP.)
18. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
19. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
20. ALL OPERABLE WINDOWS LOCATED MORE THAN 72" ABV. SURFACE BELOW SHALL HAVE THE LOWEST PORTION OF WINDOW CLEAR OPENING A MIN. OF 24" ABOVE FINISHED FLOOR BEING SERVICE PER (FBC-R312.2).
21. ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER / CLIENT
22. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DECKING
23. ALL WINDOW AND DOOR ROUGH OPENINGS VARY PER MANUFACTURER'S SPECIFICATIONS, AND ARE NOT REFLECTED ON THE PLANS. DIMENSIONS PROVIDED ON PLANS ARE USED FOR AN APPROXIMATE LOCATION OF WINDOWS & DOORS, AND DO NOT REFLECT THE ROUGH OPENINGS REQUIRED FOR PROPER INSTALLATION. BUILDER WILL BE REQUIRED TO CROSS-REFERENCE ROUGH OPENINGS AND PLAN DIMENSIONS.

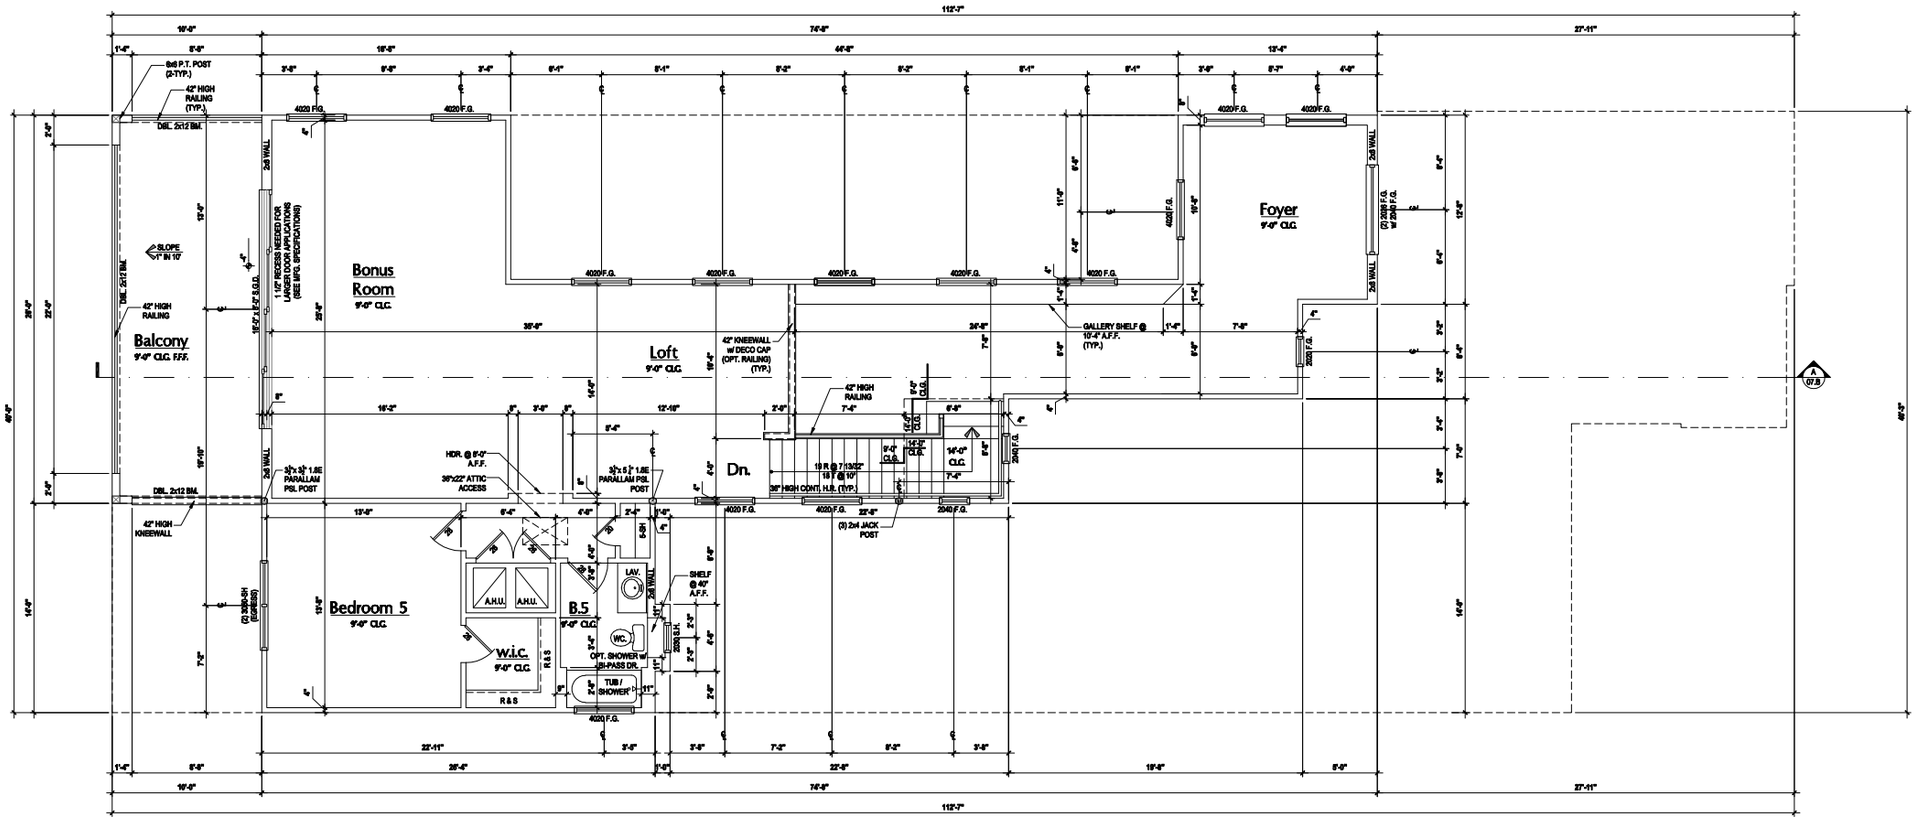

Second Floor Plan "B"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 22, 2018,8:48am Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\04.B1 Second Floor Plan (Opt. Balcony).dwg

THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

PREMIER DESIGN GROUP
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierdesigngroup.com
FL CERT. AUTH.: 29113
FL PE#: 60239

MJS custom home design DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

MEETED DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for all dimensions and conditions on the job and MJS, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

This plan has been electronically signed & sealed by Neal Rodriguez, PE, using a digital signature. DO a sealed and printed copy of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

SECOND FLOOR PLAN

04.B1

FLOOR PLAN NOTES:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
4. A/C CONDENSER UNIT TO BE ANCHORED TO SLAB PER CODE M307.2 & M1303.3.
5. PROVIDE RECESS HSC WATER w/ DRAIN @ WASHER SPACE.
6. VENT DRYER THRU EXTERIOR WALL, U.N.O.
7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
8. SAG RESISTANT DRYWALL ON ALL CEILINGS.
9. PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
10. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISH SPEC'S.
11. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
12. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3 1/2" U.N.O.
13. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 7 5/8" U.N.O.
14. ALL INT. FIRST FLOOR CEILINGS AT 9'-0" U.N.O.
15. ALL INT. SECOND FLOOR CEILINGS AT 9'-0" U.N.O.
16. C.M.U. & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL SYS = SHEAR WALL SEGMENTS.
16. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED w/ A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FSC-R302.5.1.
17. INSTALL 5/8" TYPE X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP.)
18. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
19. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
20. ALL OPERABLE WINDOWS LOCATED MORE THAN 72" ABV. SURFACE BELOW SHALL HAVE THE LOWEST PORTION OF WINDOW CLEAR OPENING A MIN. OF 24" ABOVE FINISHED FLOOR BEING SERVICE PER (FSC-R312.2).
21. ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER / CLIENT
22. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DECKING
23. ALL WINDOW AND DOOR ROUGH OPENINGS VARY PER MANUFACTURER'S SPECIFICATIONS, AND ARE NOT REFLECTED ON THE PLANS. DIMENSIONS PROVIDED ON PLANS ARE USED FOR AN APPROXIMATE LOCATION OF WINDOWS & DOORS, AND DO NOT REFLECT THE ROUGH OPENINGS REQUIRED FOR PROPER INSTALLATION. BUILDER WILL BE REQUIRED TO CROSS-REFERENCE ROUGH OPENINGS AND PLAN DIMENSIONS.

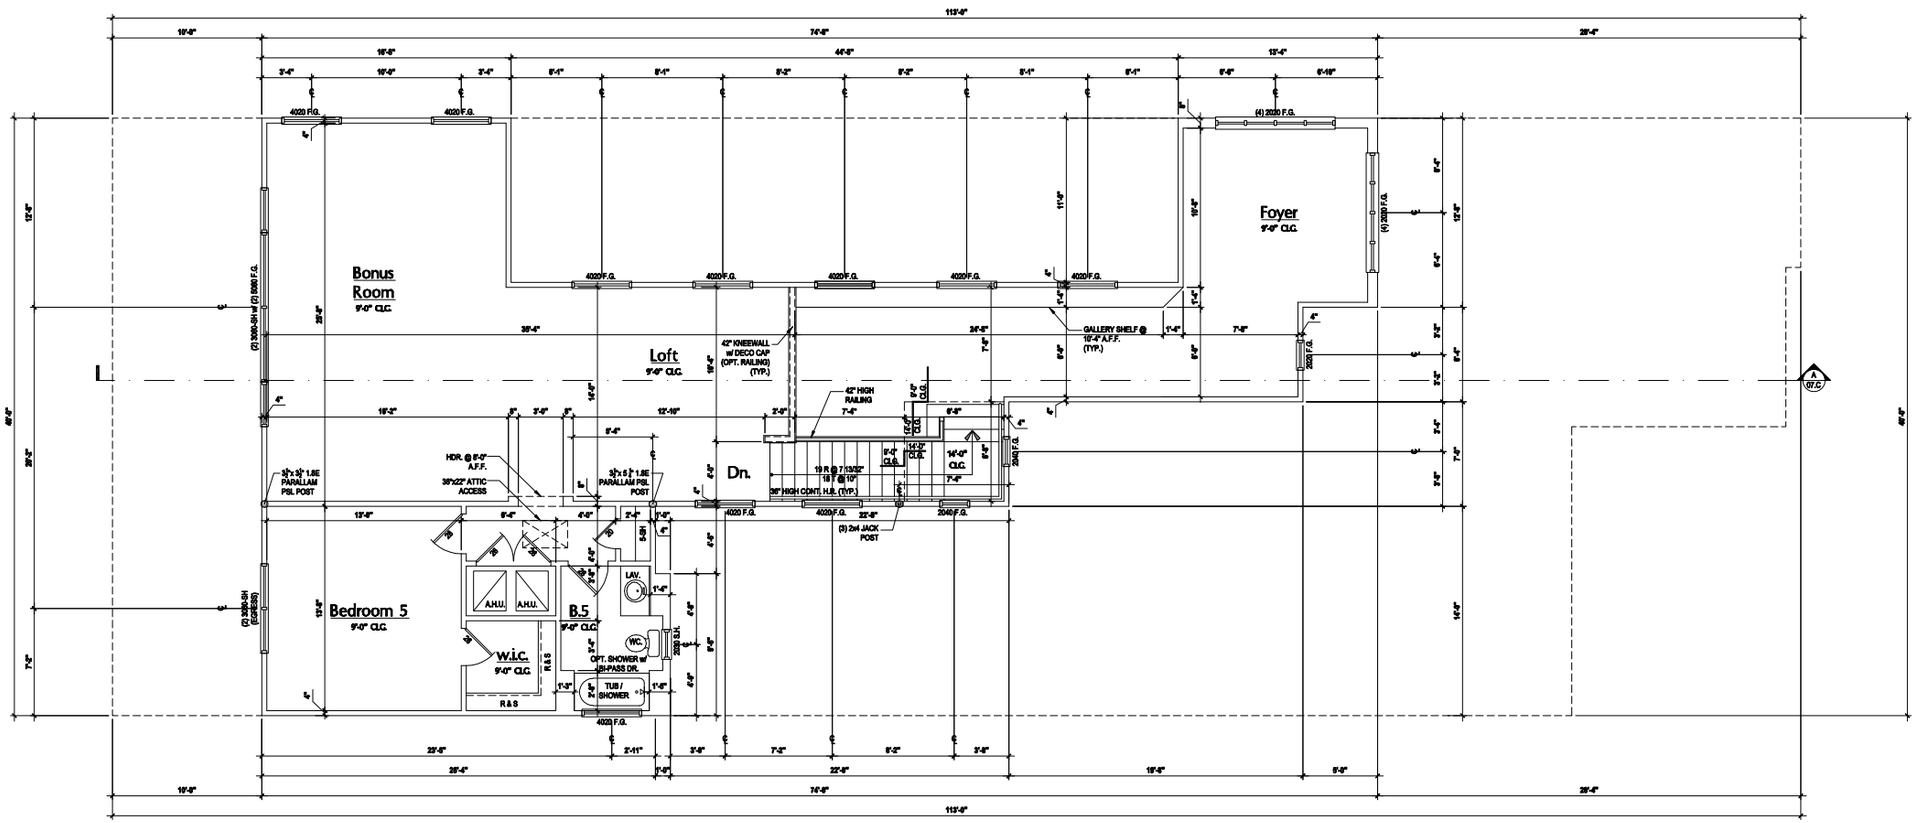

Second Floor Plan "C"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2016 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS DESIGNGROUP
custom home design
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER ARCHITECTURAL ENGINEERING LLC
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

NOTE: DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variance from the dimensions, conditions and specifications shown on these drawings.

These plans have been electronically signed & sealed by Chad Rodriguez, PE, using a digital signature. DO a raised seal printed copies of this document are not considered signed & sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

SECOND FLOOR PLAN

04.C

May 22, 2018,8:48am Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\04-C Second Floor Plan.dwg ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

FLOOR PLAN NOTES:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
4. A/C CONDENSER UNIT TO BE ANCHORED TO SLAB PER CODE M307.2 & M1307.3.
5. PROVIDE RECESS HSC WATER w/ DRAIN @ WASHER SPACE.
6. VENT DRYER THRU EXTERIOR WALL, U.N.O.
7. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
8. SAG RESISTANT DRYWALL ON ALL CEILINGS.
9. PULL ALL DIMENSIONS FROM THE REAR OF PLAN.
10. REFER TO EXTERIOR ELEVATIONS & TYP. DETAIL SHEETS FOR EXTERIOR WALL FINISH SPEC'S.
11. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES.
12. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 5 $\frac{1}{2}$" U.N.O.
13. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 7 $\frac{5}{8}$" U.N.O.
14. ALL INT. FIRST FLOOR CEILINGS AT 9'-0" U.N.O.
    ALL INT. SECOND FLOOR CEILINGS AT 9'-0" U.N.O.
15. C.M.U. & FRAME WALL SYSTEM SEGMENTS WHICH HAVE AN UNINTERRUPTED LENGTH OF 12'-0" OR MORE SHALL BE CONSIDERED SHEAR WALL SYS = SHEAR WALL SEGMENTS.
16. OPENING BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED w/ A 20 MIN. FIRE RATED SOLID WOOD OR HONEYCOMB CORE STEEL DOOR NOT LESS THAN 1 3/8" THICKNESS AS PER FBC-R302.5.1.
17. INSTALL 5/8" TYPE X DRYWALL ON GARAGE CEILING BENEATH HABITABLE ROOMS (TYP.)
18. GARAGE DOOR TO BE CERTIFIED BY MFR. FOR 140 M.P.H.
19. ALL TUB & SHOWER UNITS WILL HAVE ANTI-SCALDING DEVICES INSTALLED.
20. ALL OPERABLE WINDOWS LOCATED MORE THAN 72" ABV. SURFACE BELOW SHALL HAVE THE LOWEST PORTION OF WINDOW CLEAR OPENING A MIN. OF 24" ABOVE FINISHED FLOOR BEING SERVICE PER (FBC-R312.2).
21. ALL INT. DOORS TO BE 6'-8" TALL U.N.O. OR PER BUILDER / CLIENT
22. 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE OF WALL TO UNDERSIDE OF DECKING
23. ALL WINDOW AND DOOR ROUGH OPENINGS VARY PER MANUFACTURER'S SPECIFICATIONS, AND ARE NOT REFLECTED ON THE PLANS. DIMENSIONS PROVIDED ON PLANS ARE USED FOR AN APPROXIMATE LOCATION OF WINDOWS & DOORS, AND DO NOT REFLECT THE ROUGH OPENINGS REQUIRED FOR PROPER INSTALLATION. BUILDER WILL BE REQUIRED TO CROSS-REFERENCE ROUGH OPENINGS AND PLAN DIMENSIONS.

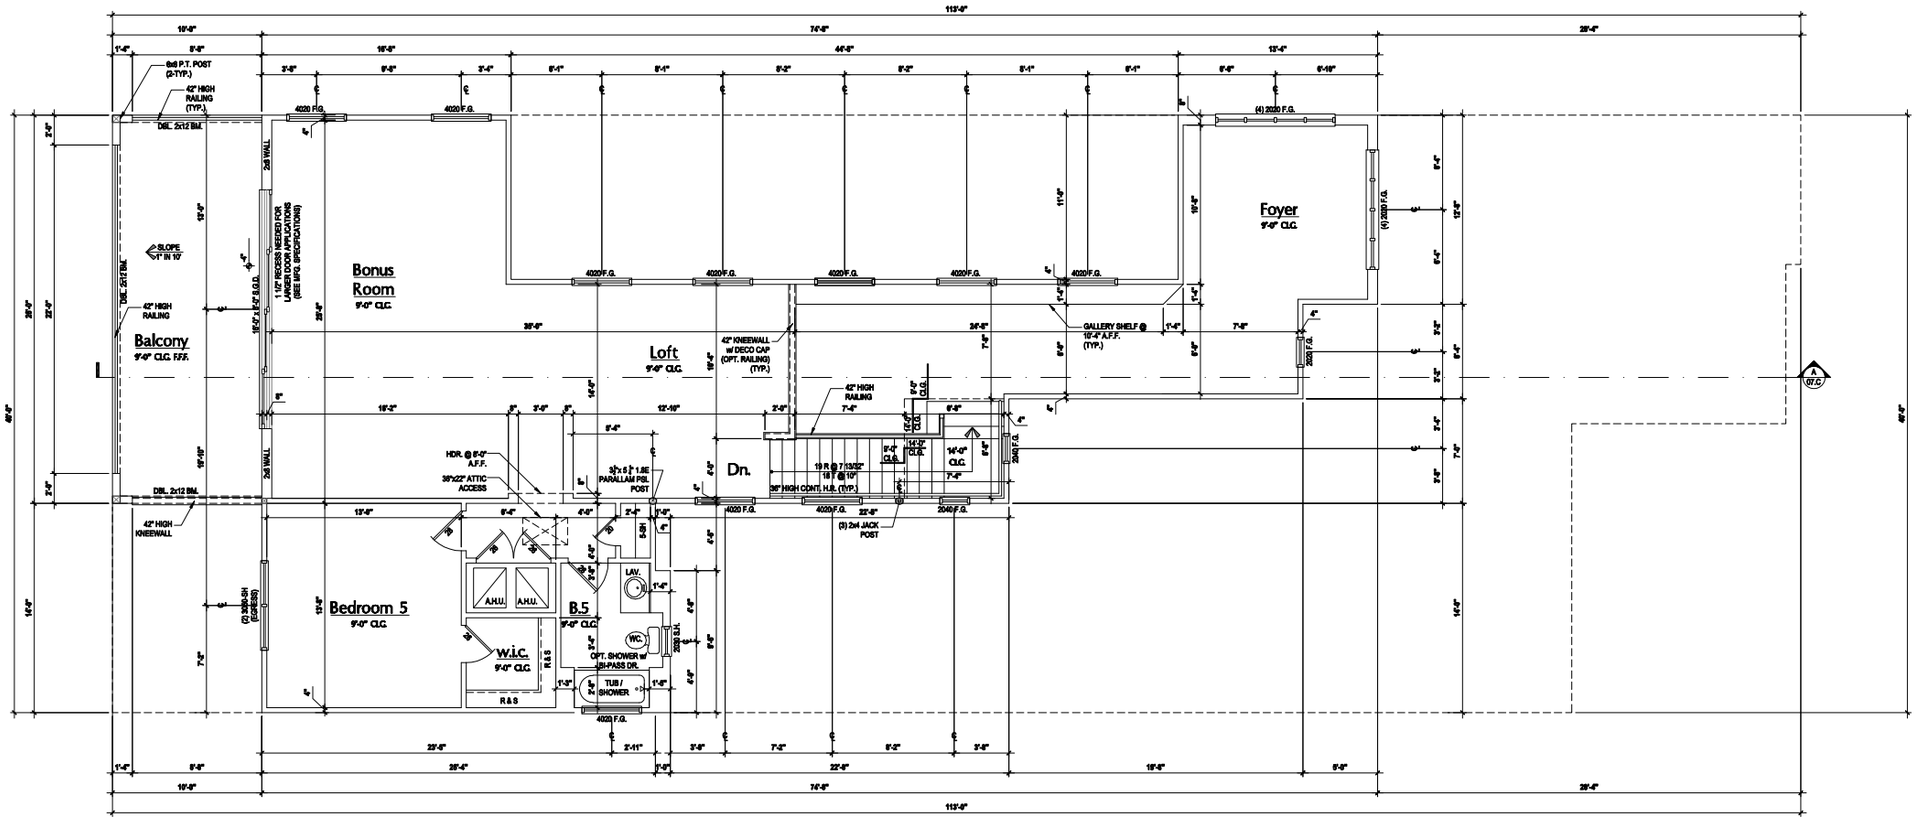

Second Floor Plan "C"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

PARK SQUARE HOMES

MJS
custom home design
DESIGNERS • PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER ARCHITECTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

NOTE!!! DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions and conditions shown on these drawings.

This plan has been electronically signed & sealed by Noel Rodriguez, PE, using a digital signature. ALL copies of this document are not considered signed & sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

SECOND FLOOR PLAN

04.C1



Detail #1

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)



Detail #2

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)

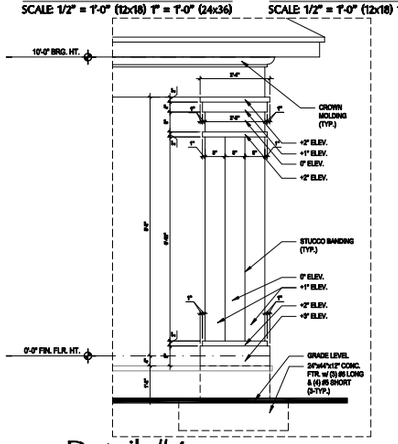

Detail #4

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)

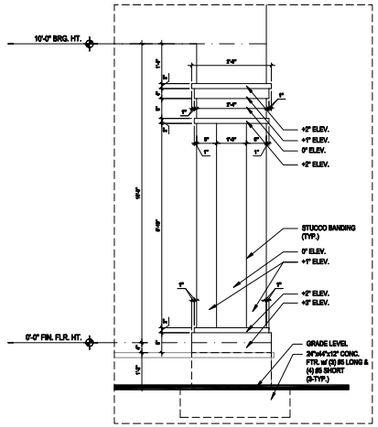

Detail #5

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)



Detail #6

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)

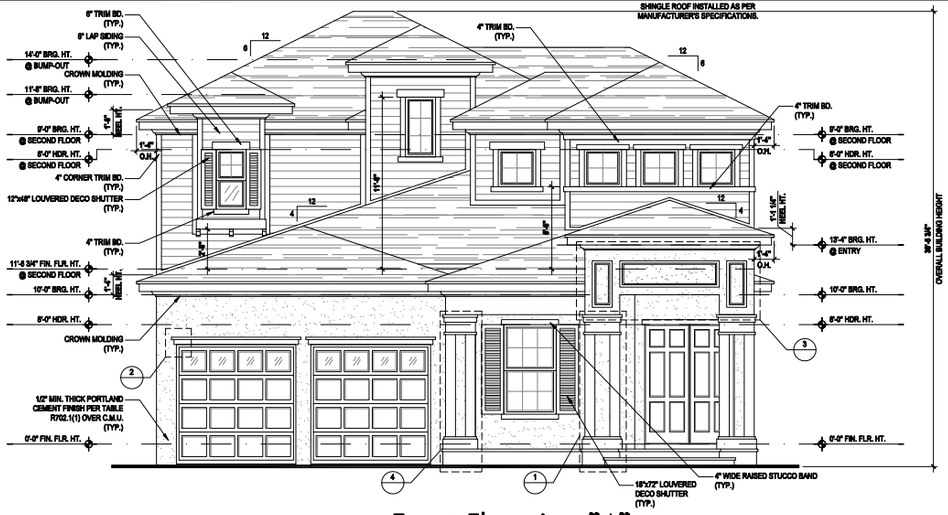

Front Elevation "A"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

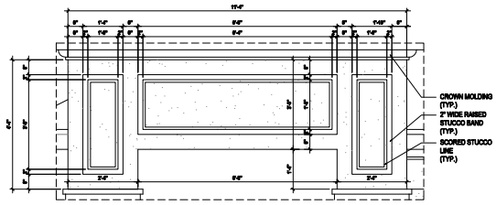

Detail #3

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)

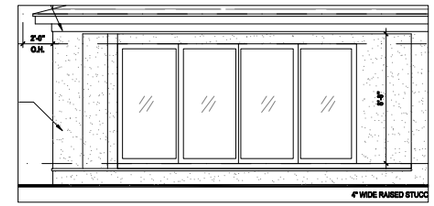

Rear Elevation

(Opt. Pocket SGD.)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

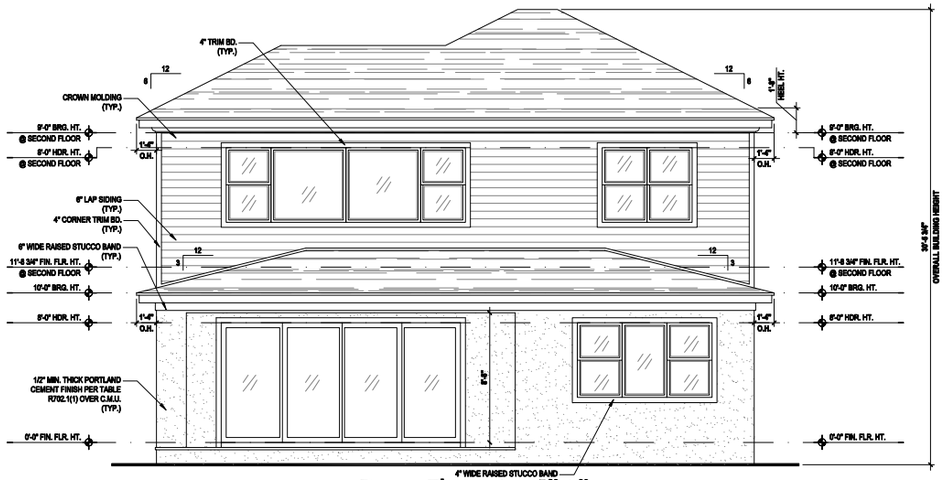

Rear Elevation "A"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

ATTIC VENT CALC'S:

2017 FLORIDA BUILDING CODE (5TH EDITION) SECTION R806
MIN. 40% - MAX 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).
(OFF-RIDGE VENT MAXIMUM OPENING SIZES)

MINIMUM NET VENTILATION AREA SHALL BE $\frac{1}{300}$ OF VENTED SPACE.

TOTAL VENTED SPACE: $\frac{4,842}{300}$ = 16.14 SF. NET FREE REQUIRED

UPPER PORTION VENTILATION TOTAL: 8.498 SF.
TO BE PROVIDED w/ OFF RIDGE VENTS:
10 VENTS @ .853 /PER VENT

TILE: O'HAGIN MODEL "S", SHINGLE: LOMANCO 770-D).

LOWER PORTION VENTILATION TOTAL: 9.694 SF.
TO BE PROVIDED w/ SOFFITS @ EAVE:
80.00 LF. @ 0.121 SF. VENTING/L.F.

UPPER ROOF PERCENTAGE: 40%
LOWER ROOF PERCENTAGE: 60%

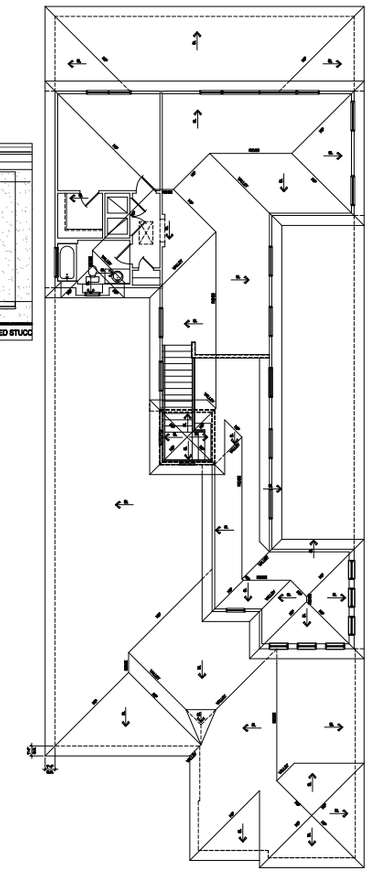

Roof Layout

(Standard)

SCALE: 1/16" = 1'-0" (11x17) 1/8" = 1'-0" (22x34)

May 21, 2019,8:54pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\KS,A Ext.Elevation A, Front & Rear.dwg, DISSEMINATIONS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

PARK SQUARE HOMES

MJS designers - planners
custom home design
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER
ESTATE PROPERTIES & DEVELOPMENT, INC.
2351 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierestatepropertiesinc.com
FL CERT. AUTH.: 29113
FL PER: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELEVATIONS "B"

05.A

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. shall be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

These plans have been electronically signed & sealed by Neil Rodrigues. NR, using a digital signature. NR is sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.



Detail #1

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)



Detail #2

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)

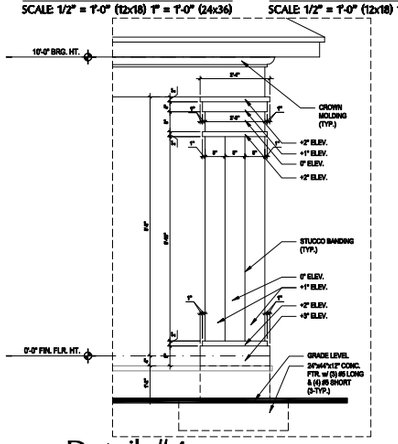

Detail #4

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)

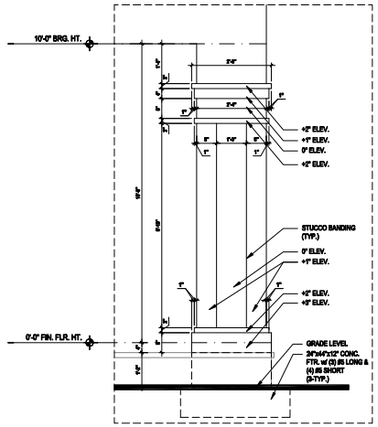

Detail #5

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)

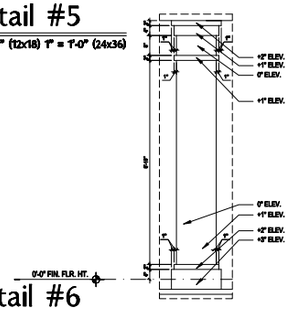

Detail #6

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)

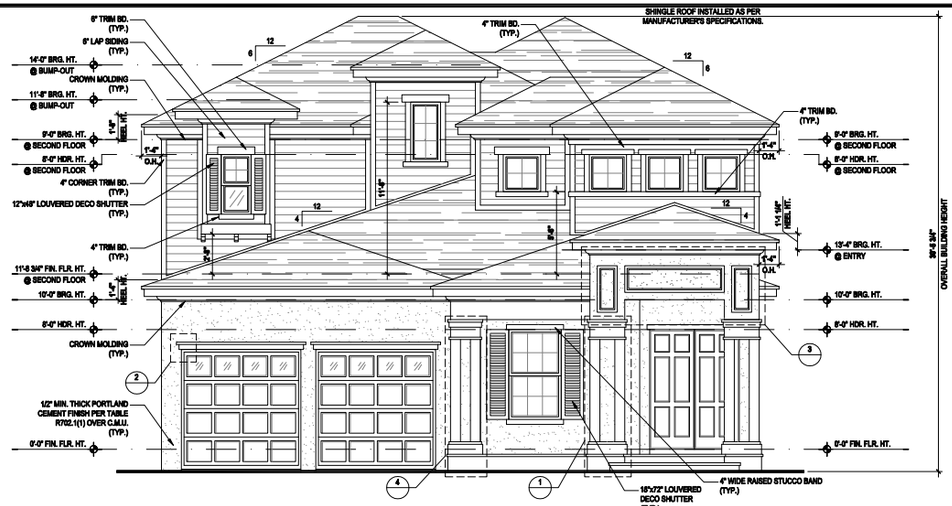

Front Elevation "A"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

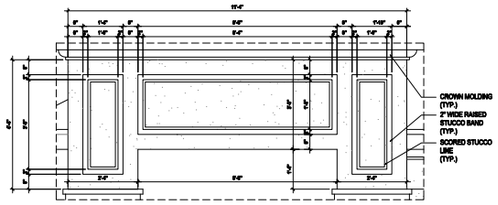

Detail #3

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)

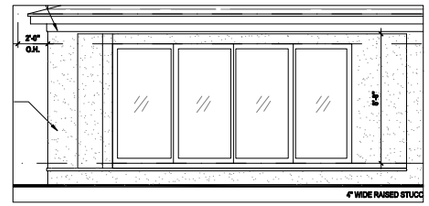

Rear Elevation

(Opt. Pocket SGD.)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

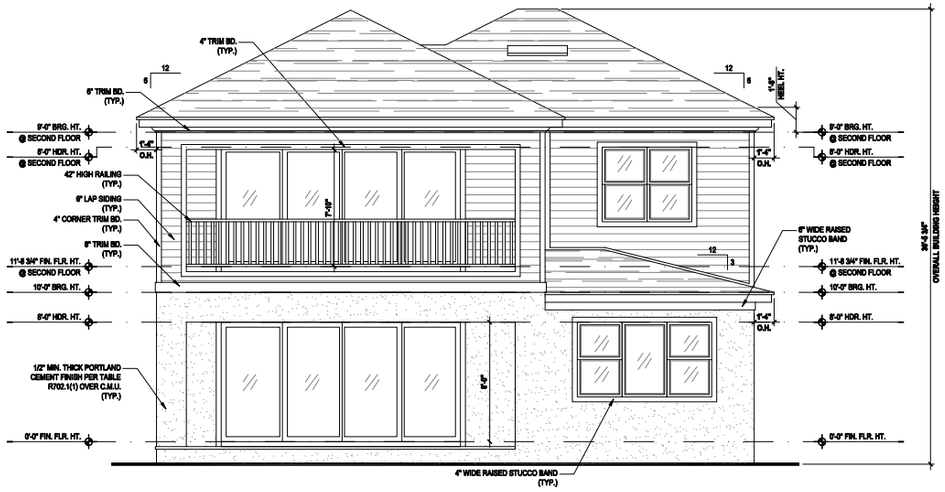

Rear Elevation "A"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

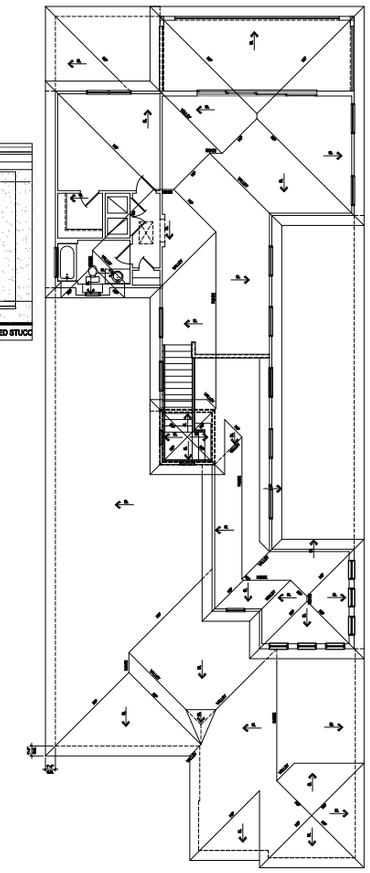

Roof Layout

(Opt. Balcony)

SCALE: 1/16" = 1'-0" (11x17) 1/8" = 1'-0" (22x34)

ATTIC VENT CALC'S:

2017 FLORIDA BUILDING CODE (5TH EDITION) SECTION R806
MIN. 40% - MAX 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).
(OFF-RIDGE VENT MAXIMUM OPENING SIZE50)

MINIMUM NET VENTILATION AREA SHALL BE $\frac{1}{150}$ OF VENTED SPACE.
(UPPER ROOF PERCENTAGE: 40%) (LOWER ROOF PERCENTAGE: 60%)

FIRST FLOOR:
TOTAL VENTED SPACE: 2,198 / 300 = 7.326 SF. NET FREE REQUIRED
UPPER PORTION VENTILATION TOTAL: 2.930 SF.
TOTAL OFF RIDGE VENTS: 4 VENTS @ .093 / PER VENT
LOWER PORTION VENTILATION TOTAL: 4.279 SF.
TOTAL SOFFITS @ EAVE: 69.60 LF. @ 0.121 SF. VENTING / LF.

SECOND FLOOR:
TOTAL VENTED SPACE: 2,705 / 300 = 9.016 SF. NET FREE REQUIRED
UPPER PORTION VENTILATION TOTAL: 5.004 SF.
TOTAL OFF RIDGE VENTS: 5 VENTS @ .093 / PER VENT
LOWER PORTION VENTILATION TOTAL: 6.459 SF.
TOTAL SOFFITS @ EAVE: 69.60 LF. @ 0.121 SF. VENTING / LF.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
WWW.PREMIERPLANS.COM
FL CERT. AUTH.: 29113
PREMIER
ARCHITECTURAL DESIGN & DEVELOPMENT SERVICES, INC.

MJS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
custom home design
DESIGN/BUILD - PLANNERS
FL. PE#: 60239

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS.
Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. shall be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

40-4248
YORKSHIRE
Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, Fl. 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELEVATIONS "B"

05.A1

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

May 21, 2019,8:55pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\05.A1 Ext.Elevation A, Front & Rear (Opt.Balcony).dwg THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

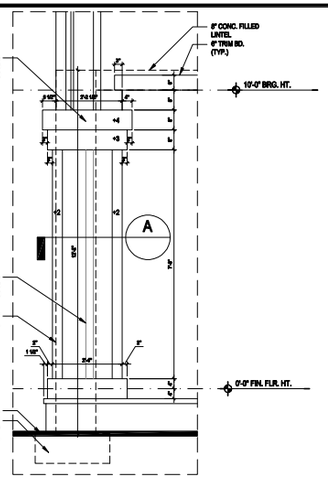

Detail #1

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)



Detail #A

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)



Detail #2

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)

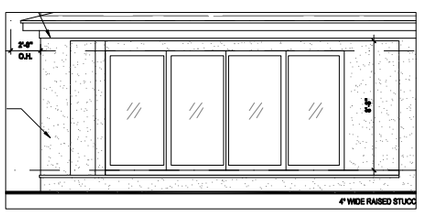

Rear Elevation

(Opt. Pocket SGD.)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

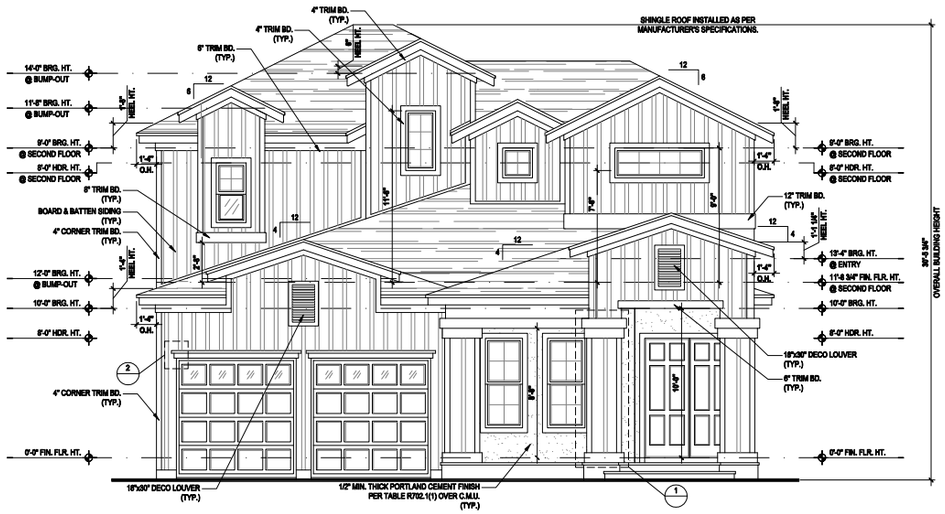

Front Elevation "B"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

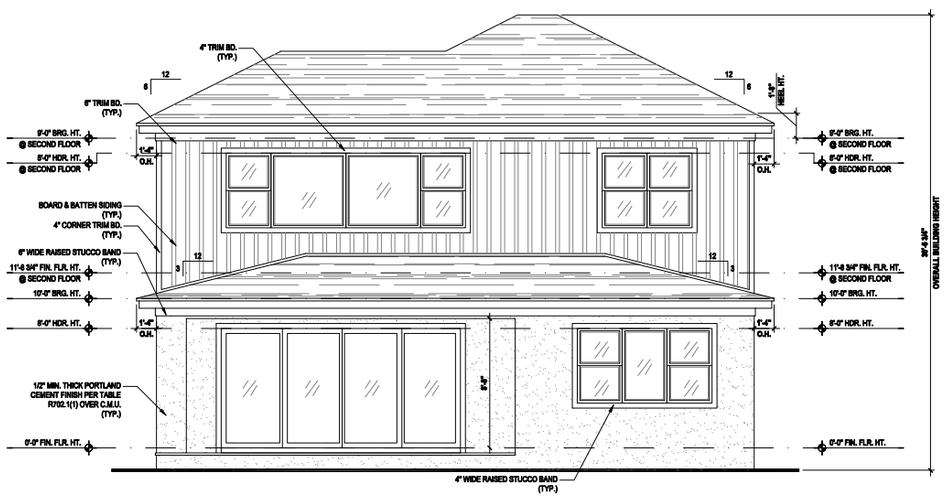

Rear Elevation "B"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

ATTIC VENT CALC'S:

2017 FLORIDA BUILDING CODE (5TH EDITION) SECTION R806
MIN. 40% - MAX 60% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).
(OFF-RIDGE VENT MAXIMUM OPENING SIZES)

MINIMUM NET VENTILATION AREA SHALL BE $\frac{1}{300}$ OF VENTED SPACE.

TOTAL VENTED SPACE: $\frac{4,842}{300}$ = 16.14 SF. NET FREE REQUIRED

UPPER PORTION VENTILATION TOTAL: 6.456 SF.
TO BE PROVIDED w/ OFF RIDGE VENTS:
10 VENTS @ .583 /PER VENT

TILE: O'HAGIN MODEL "S", SHINGLE: LOMANCO 770-D).

LOWER PORTION VENTILATION TOTAL: 9.684 SF.
TO BE PROVIDED w/ SOFFITS @ EAVE:
80.00 LF. @ 0.121 SF. VENTING/L.F.

UPPER ROOF PERCENTAGE: 40%
LOWER ROOF PERCENTAGE: 60%

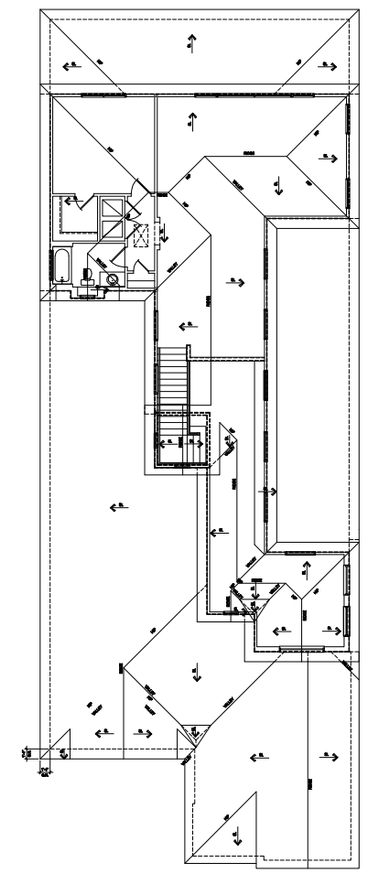

Roof Layout

(Standard)

SCALE: 1/16" = 1'-0" (11x17) 1/8" = 1'-0" (22x34)

May 21, 2019,8:55pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\05.B Ext.Elevation B, Front & Rear.dwg, DESIGN\PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
WWW.PREMIERPROJECTS.COM
FL CERT. AUTH.: 29113
FL PE#: 60239

PREMIER
CITIES • CITY BUILDERS • DEVELOPER SERVICES INC.

MJS
custom home design
DESIGNERS • PLANNERS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS.
Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. shall be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

Plans have been electronically signed & sealed by Kirk Rodrigues, PE using a digital signature. ALL printed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

40-4248
YORKSHIRE
Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELEVATIONS "B"

05.B

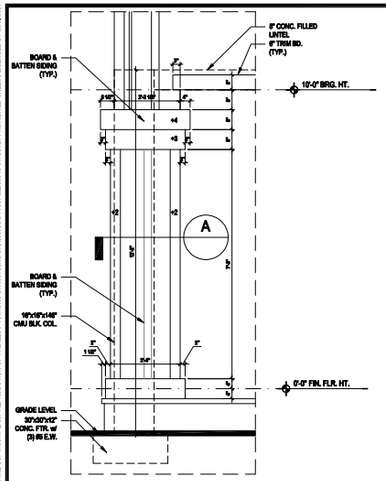

Detail #1

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)



Detail #A

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)



Detail #2

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)

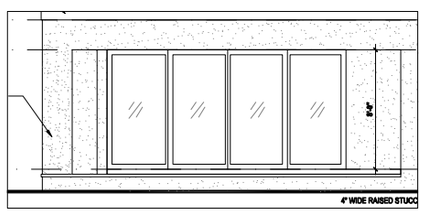

Rear Elevation

(Opt. Pocket SGD.)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

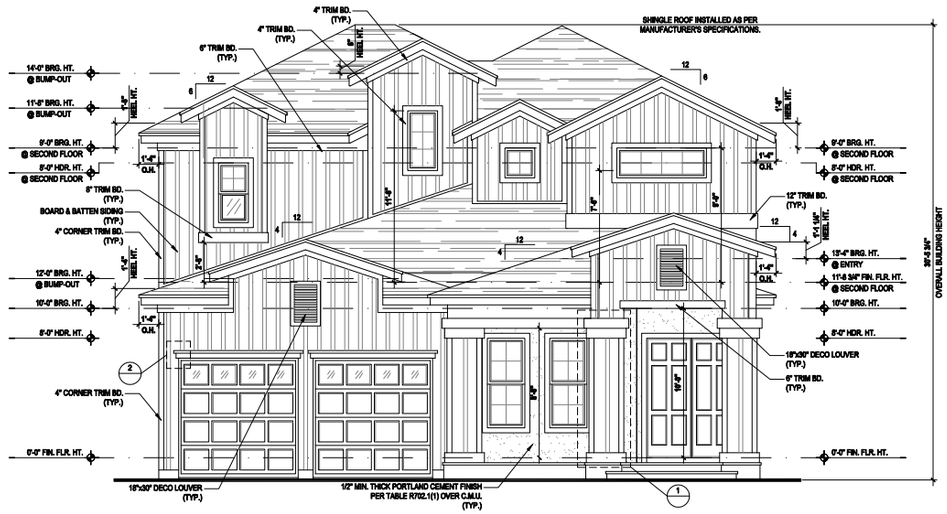

Front Elevation "B"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

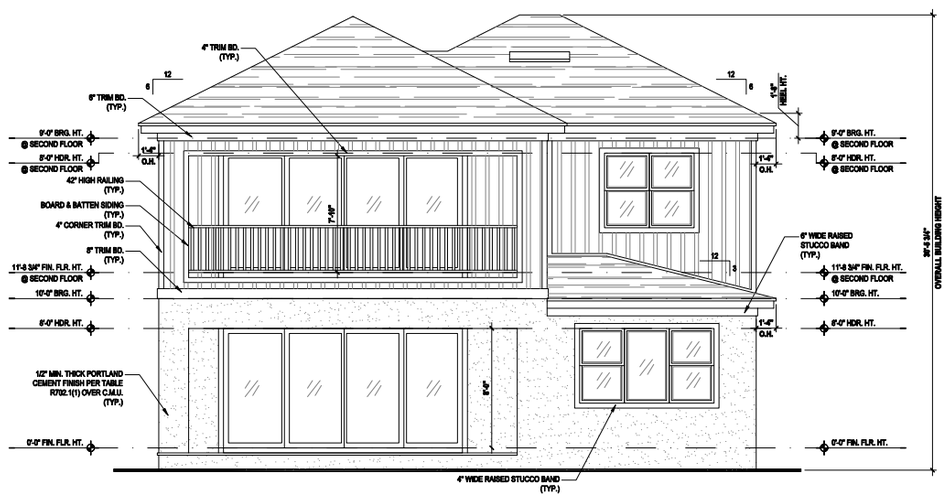

Rear Elevation "B"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

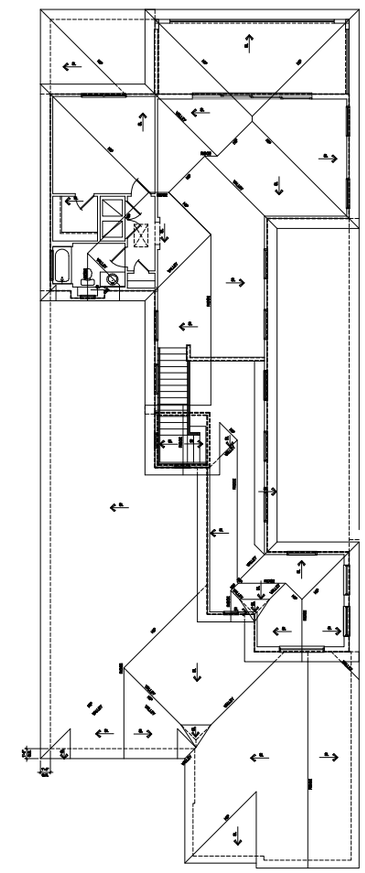

Roof Layout

(Opt. Balcony)

SCALE: 1/16" = 1'-0" (11x17) 1/8" = 1'-0" (22x34)

ATTIC VENT CALC'S:

2017 FLORIDA BUILDING CODE (5TH EDITION) SECTION R806
MIN. 40% - MAX 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).
(OFF-RIDGE VENT MAXIMUM OPENING SIZES)

MINIMUM NET VENTILATION AREA SHALL BE $\frac{1}{150}$ OF VENTED SPACE.
(UPPER ROOF PERCENTAGE: 40%) (LOWER ROOF PERCENTAGE: 60%)

FIRST FLOOR:
TOTAL VENTED SPACE: 2,138 / 300 = 7.126 SF. NET FREE REQUIRED
UPPER PORTION VENTILATION TOTAL: 2.850 SF.
TOTAL OFF RIDGE VENTS: 4 VENTS @ .893 / PER VENT
LOWER PORTION VENTILATION TOTAL: 4.276 SF.
TOTAL SOFFITS @ EAVE: 65.80 LF. @ 0.121 SF. VENTING / LF.

SECOND FLOOR:
TOTAL VENTED SPACE: 2,705 / 300 = 9.016 SF. NET FREE REQUIRED
UPPER PORTION VENTILATION TOTAL: 3.606 SF.
TOTAL OFF RIDGE VENTS: 5 VENTS @ .893 / PER VENT
LOWER PORTION VENTILATION TOTAL: 5.409 SF.
TOTAL SOFFITS @ EAVE: 65.80 LF. @ 0.121 SF. VENTING / LF.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
WWW.PREMIERSTRUCTURES.COM
FL CERT. AUTH.: 29113
PREMIER STRUCTURAL ENGINEERING INC.
FL PE#: 60239

MJS custom home design
DESIGNERS - PLANNERS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELEVATIONS "B"

05.B1

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

This publication are protected under the copyright law. Reproduction of the illustrations or working drawings by any means is strictly prohibited unless licensed by MJS, Inc.

These plans have been electronically signed & sealed by Kent Rodgers, PE using a digital signature. All a manual and printed copy of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. shall be notified of any variance to the dimensions, conditions and specifications appearing on these plans.



Detail #1

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)



Detail #2

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)



Detail #3

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)

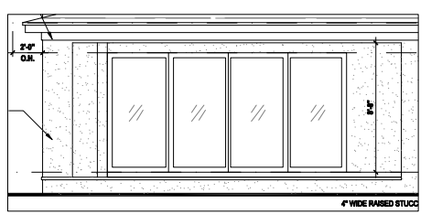

Rear Elevation

(Opt. Pocket SGD.)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

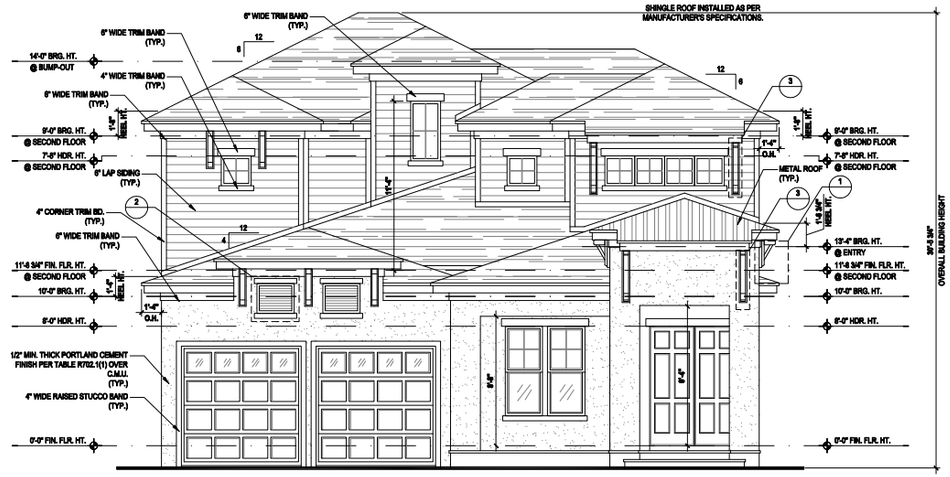

Front Elevation "C"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

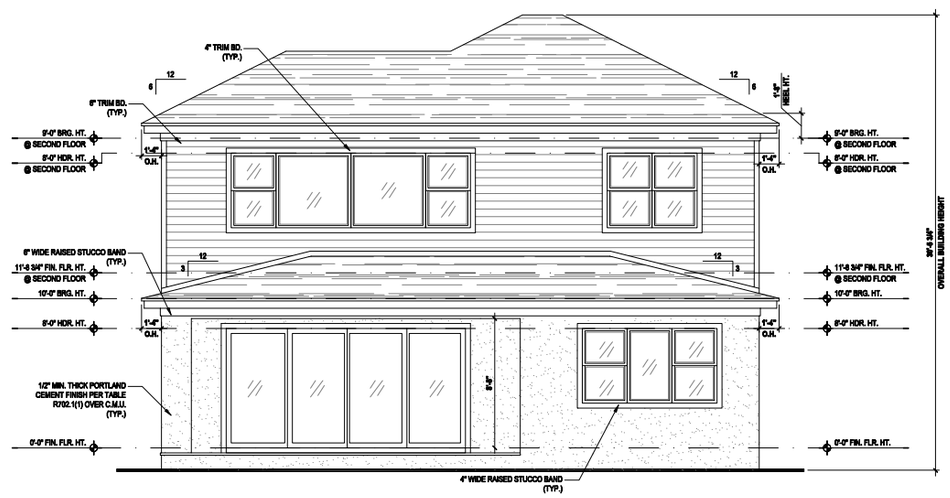

Rear Elevation "C"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

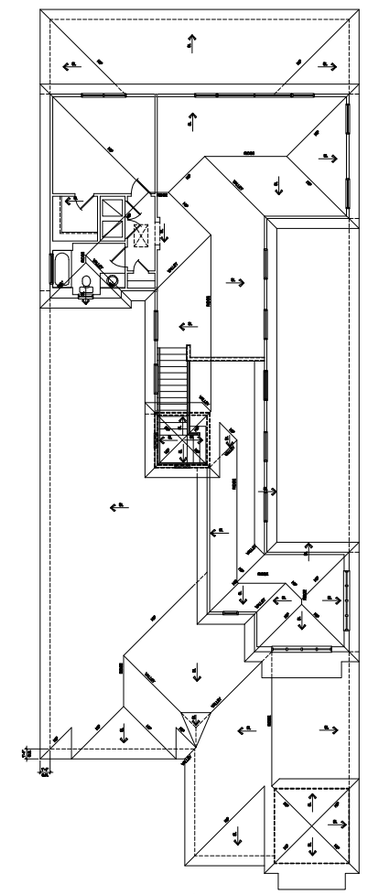

Roof Layout

(Standard)

SCALE: 1/16" = 1'-0" (11x17) 1/8" = 1'-0" (22x34)

ATTIC VENT CALC'S:

2017 FLORIDA BUILDING CODE (5TH EDITION) SECTION R806
MIN. 40% - MAX 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).
(OFF-RIDGE VENT MAXIMUM OPENING SIZES)

MINIMUM NET VENTILATION AREA SHALL BE $\frac{1}{300}$ OF VENTED SPACE.

TOTAL VENTED SPACE: $\frac{4,842}{300}$ = 16.14 SF. NET FREE REQUIRED

UPPER PORTION VENTILATION TOTAL: 8.456 SF.
TO BE PROVIDED w/ OFF RIDGE VENTS:
10 VENTS @ .583 /PER VENT

TILE: O'HAGIN MODEL "S", SHINGLE: LOMANCO 770-D).

LOWER PORTION VENTILATION TOTAL: 9.684 SF.
TO BE PROVIDED w/ SOFFITS @ EAVE:
80.00 LF. @ 0.121 SF. VENTING/L.F.

UPPER ROOF PERCENTAGE: 40%
LOWER ROOF PERCENTAGE: 60%

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
WWW.PREMIERPROJECTS.COM
FL CERT. AUTH.: 29113

PREMIER
ARCHITECTURE & INTERIOR DESIGN SERVICES INC.

MJS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
custom home design
DESIGNERS • PLANNERS
FL PER: 60239

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. shall be notified of any variance to the dimensions, conditions and specifications appearing on these plans.

These plans have been electronically signed & sealed by Kent Rodriguez. KR using a digital signature. ALL printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELEVATIONS "B"

05.C

Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\05.C Ext.Elevation C, Front & Rear.dwg, DESIGNER,AIA® IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY AIA, INC.
May 21, 2019, 8:56pm



Detail #1

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)



Detail #2

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)



Detail #3

SCALE: 1/2" = 1'-0" (12x18) 1" = 1'-0" (24x36)

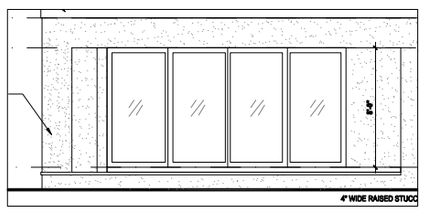

Rear Elevation

(Opt. Pocket SGD.)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

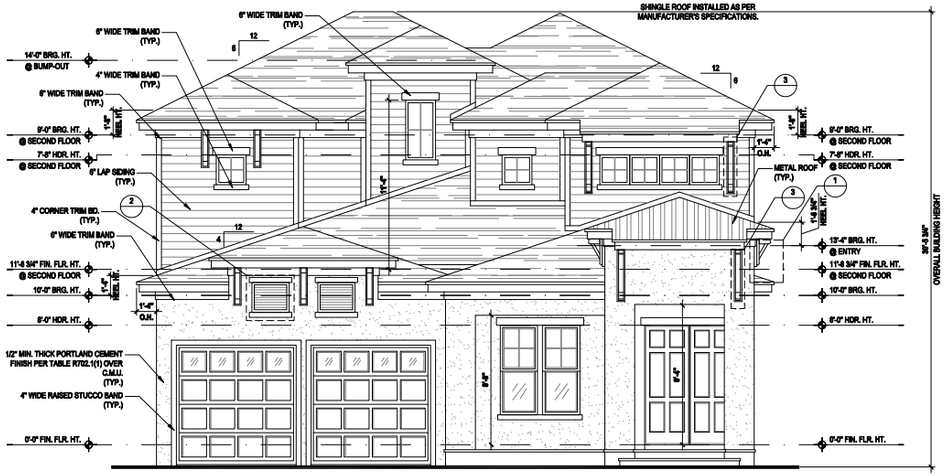

Front Elevation "C"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

Rear Elevation "C"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

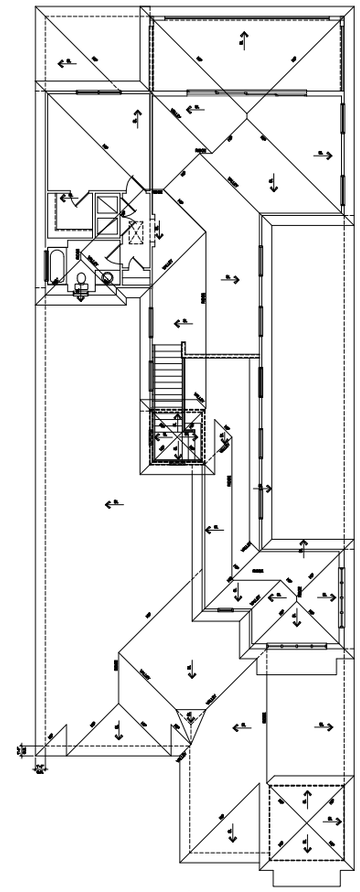

Roof Layout

(Opt. Balcony)

SCALE: 1/16" = 1'-0" (11x17) 1/8" = 1'-0" (22x34)

ATTIC VENT CALC'S:

2017 FLORIDA BUILDING CODE (6TH EDITION) SECTION R806
MIN. 40% - MAX 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).
(OFF-RIDGE VENT MAXIMUM OPENING SIZES)

MINIMUM NET VENTILATION AREA SHALL BE $\frac{1}{150}$ OF VENTED SPACE.
(UPPER ROOF PERCENTAGE: 40%) (LOWER ROOF PERCENTAGE: 60%)

FIRST FLOOR:
TOTAL VENTED SPACE: 2,138 / 300 = 7.128 SF. NET FREE REQUIRED
UPPER PORTION VENTILATION TOTAL: 2.856 SF.
TOTAL OFF RIDGE VENTS: 4 VENTS @ .693 / PER VENT
LOWER PORTION VENTILATION TOTAL: 4.276 SF.
TOTAL SOFFITS @ EAVE: 69.60 LF. @ 0.121 SF. VENTING / LF.

SECOND FLOOR:
TOTAL VENTED SPACE: 2,708 / 300 = 9.016 SF. NET FREE REQUIRED
UPPER PORTION VENTILATION TOTAL: 3.606 SF.
TOTAL OFF RIDGE VENTS: 5 VENTS @ .693 / PER VENT
LOWER PORTION VENTILATION TOTAL: 5.409 SF.
TOTAL SOFFITS @ EAVE: 69.60 LF. @ 0.121 SF. VENTING / LF.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierhomes.total.com
FL CERT. AUTH.: 29113

PREMIER
ESTATE BUILDERS & DEVELOPERS INC.

MJS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
custom home design
DESIGNERS - PLANNERS
www.mjshomedesigns.com

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS.
Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. shall be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

Plans have been electronically signed & sealed by Kent Rodrigues, PE using a digital signature. All copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

40-4248
YORKSHIRE
Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELEVATIONS "B"

05.C1

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

May 21, 2019, 8:56pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\05.C1 Ext.Elevation C, Front & Rear (Opt-Balcony).dwg

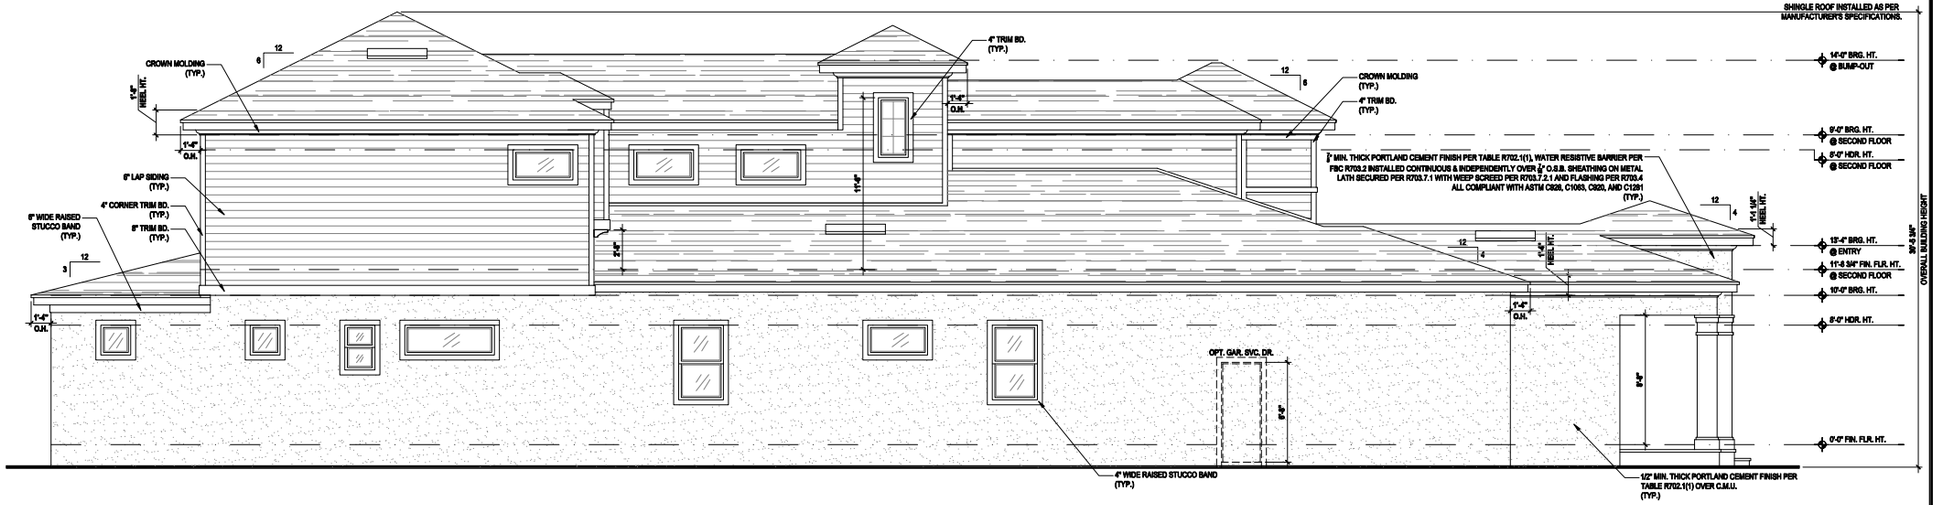

Left Elevation "A"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

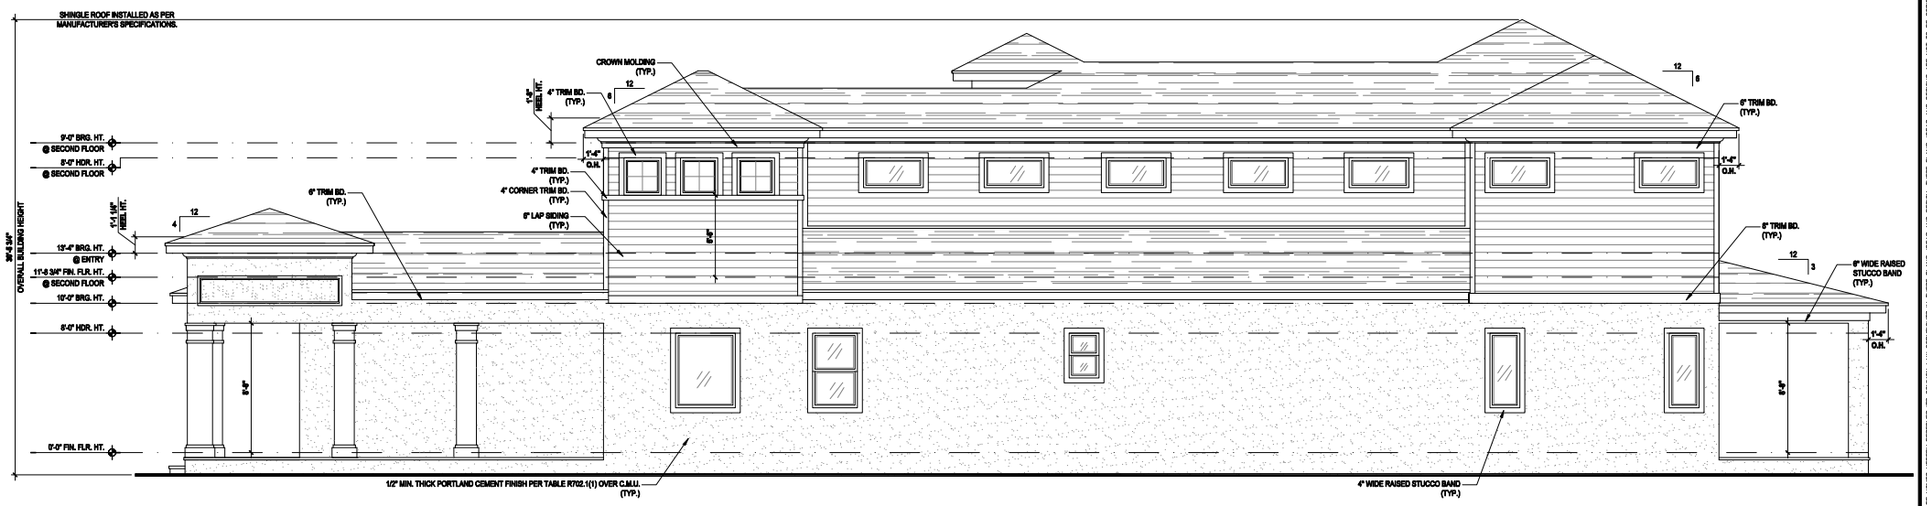

Right Elevation "A"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.parksquarehomes.com
FL CERT. AUTH.: 29113
FL PE#: 60239

PREMIER
ESTATE PROPERTIES & DEVELOPMENTS INC.

MJS DESIGNGROUP
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
custom home design
DESIGNERS • PLANNERS

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions, conditions and specifications appearing on these plans.

These plans have been electronically signed & sealed by Mark Rodriguez. MJS using a digital signature. A.D.A manual and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State. Zip

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, Fl. 32811
Phone: (407) 529-3000

Park Square HOMES

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELEVATIONS "B"

06.A

May 21, 2019,8:56pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\06.A Ext.Elevation A, Left & Right.dwg,LL DESIGNGROUP,AIA IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

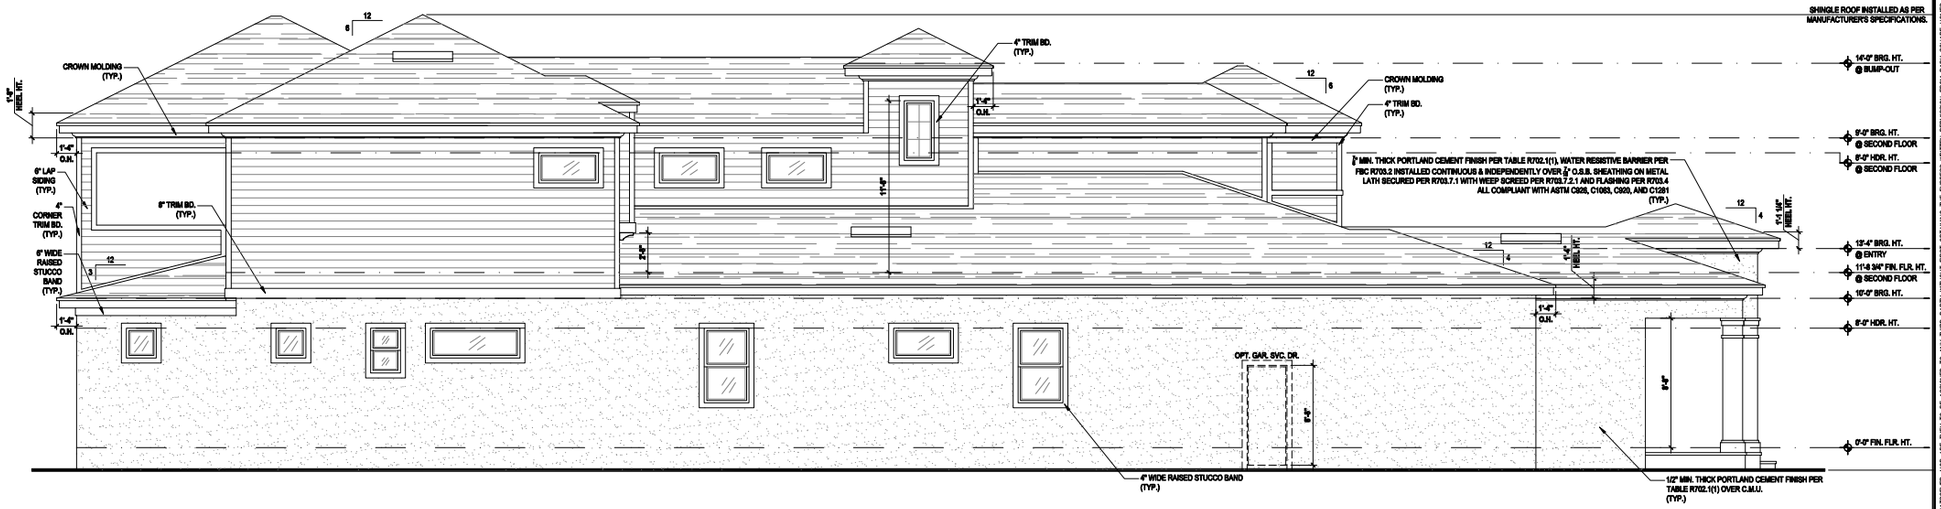

Left Elevation "A"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

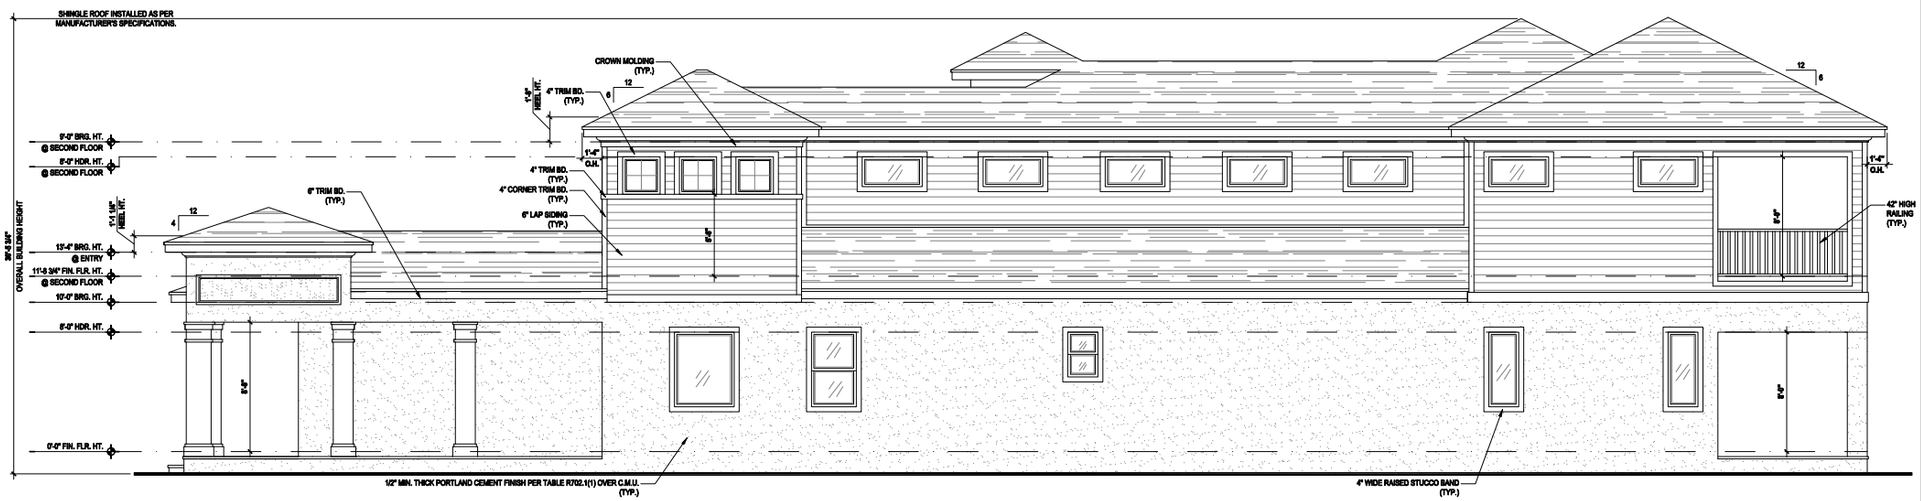

Right Elevation "A"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, Fl. 32811
Phone: (407) 529-3000

MJS DESIGNGROUP - PLANNERS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
custom home design www.mjshomedesigns.com

PREMIER ESTATE PROPERTIES
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierestateproperties.com
FL CERT. AUTH.: 29113
FL PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELEVATIONS "B"

06.A1

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and ALL Inc. must be notified of any variance from the dimensions, conditions and specifications appearing on these plans.

These plans have been electronically signed & sealed by Neil Rodriguez. RA using a digital signature. NO a manual and printed copy of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

May 21, 2019, 8:56pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\06.A1 Ext Elevation A, Left & Right (Opt. Balcony).dwg THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

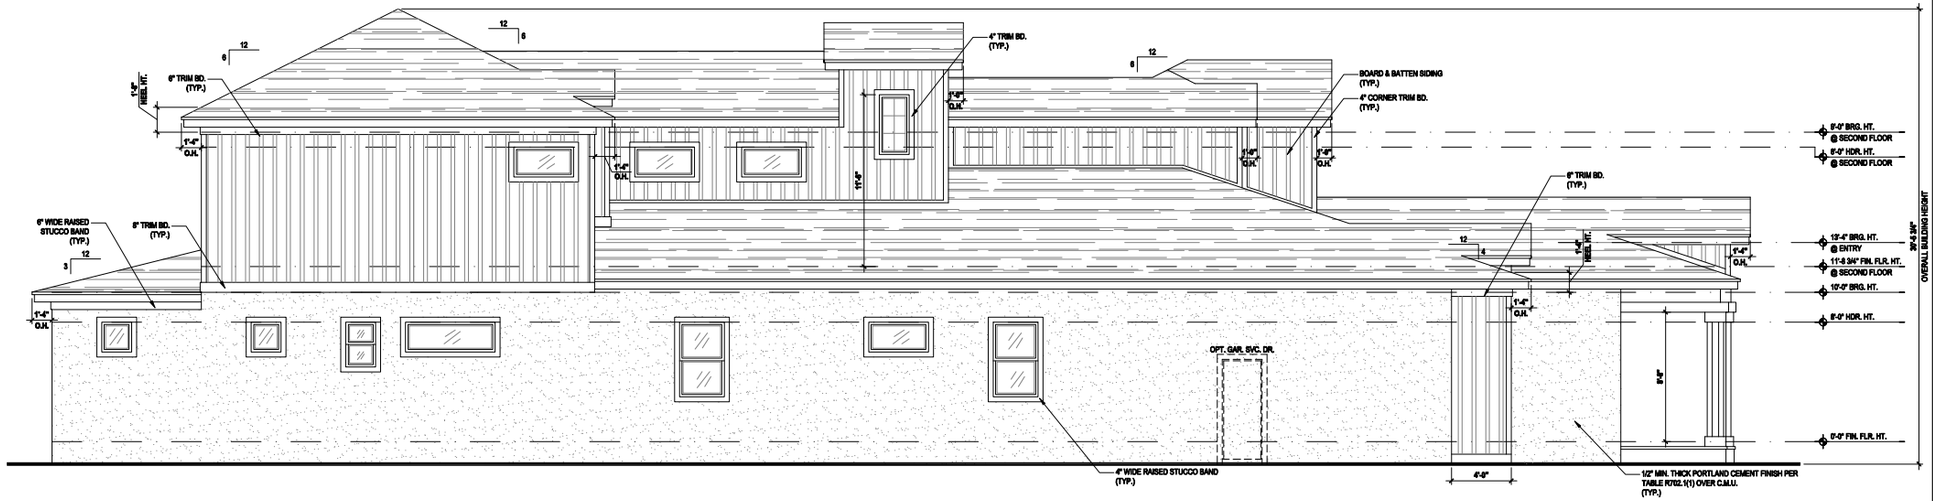

Left Elevation "B"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

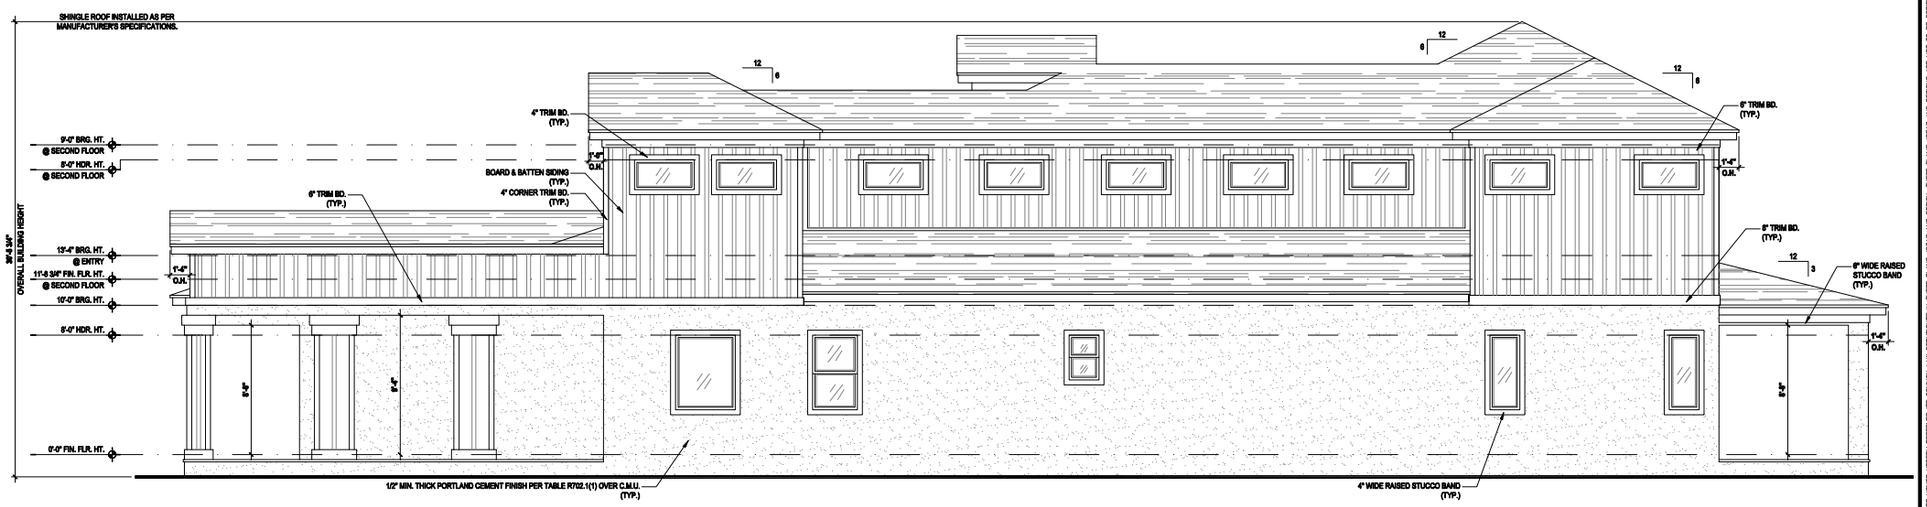

Right Elevation "B"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,8:56pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\KB.B Ext.Elevation R, Left & Right.dwg,LL DESIGNS\PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS DESIGNGROUP, INC.
custom home design
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER DESIGN GROUP, INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierdesigngroup.com
FL CERT. AUTH.: 29113
FL PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for all dimensions and conditions of the job and ALL Inc. shall be notified of any variances or discrepancies before proceeding with any work affected thereby or shown prior to fabrication of any work affected thereby. Drawings are not to be scaled.

Where plans have been electronically signed & sealed by Kirk Rodrigues, PE using a digital signature, LL is a read and printed copy of this document and not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELEVATIONS "B"

06.B

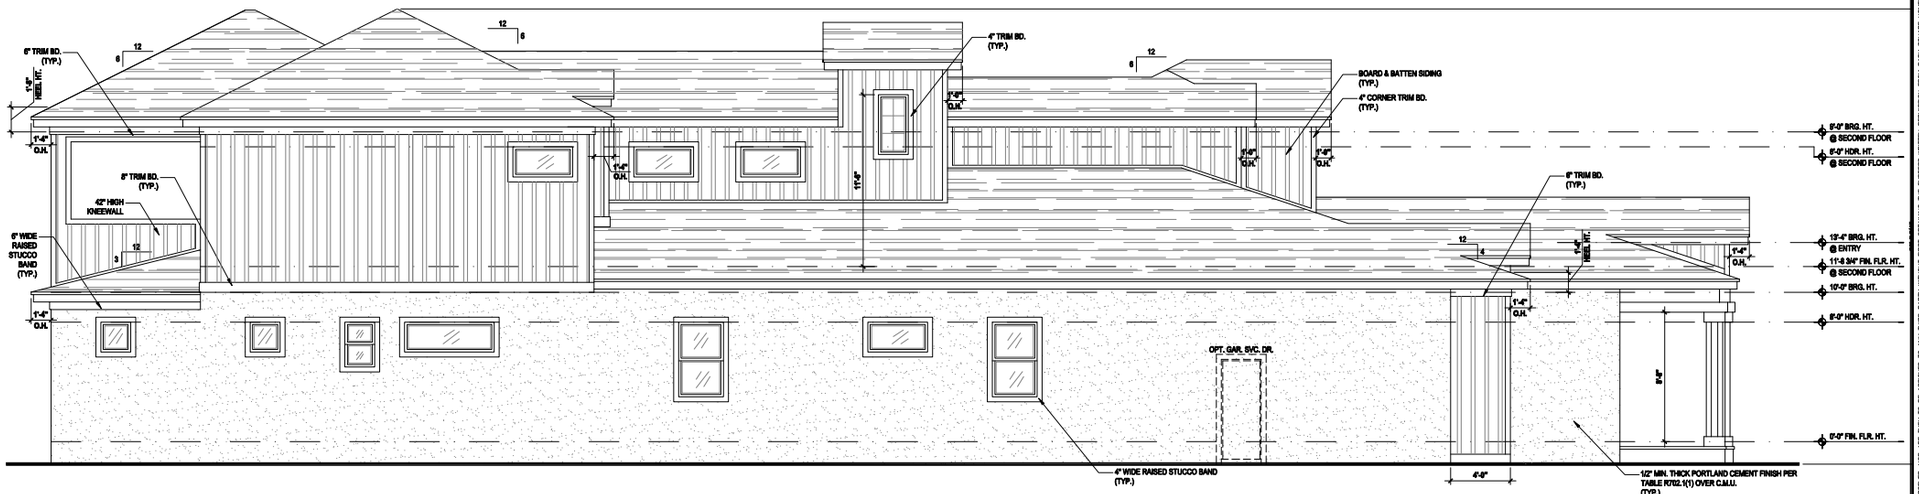

Left Elevation "B"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

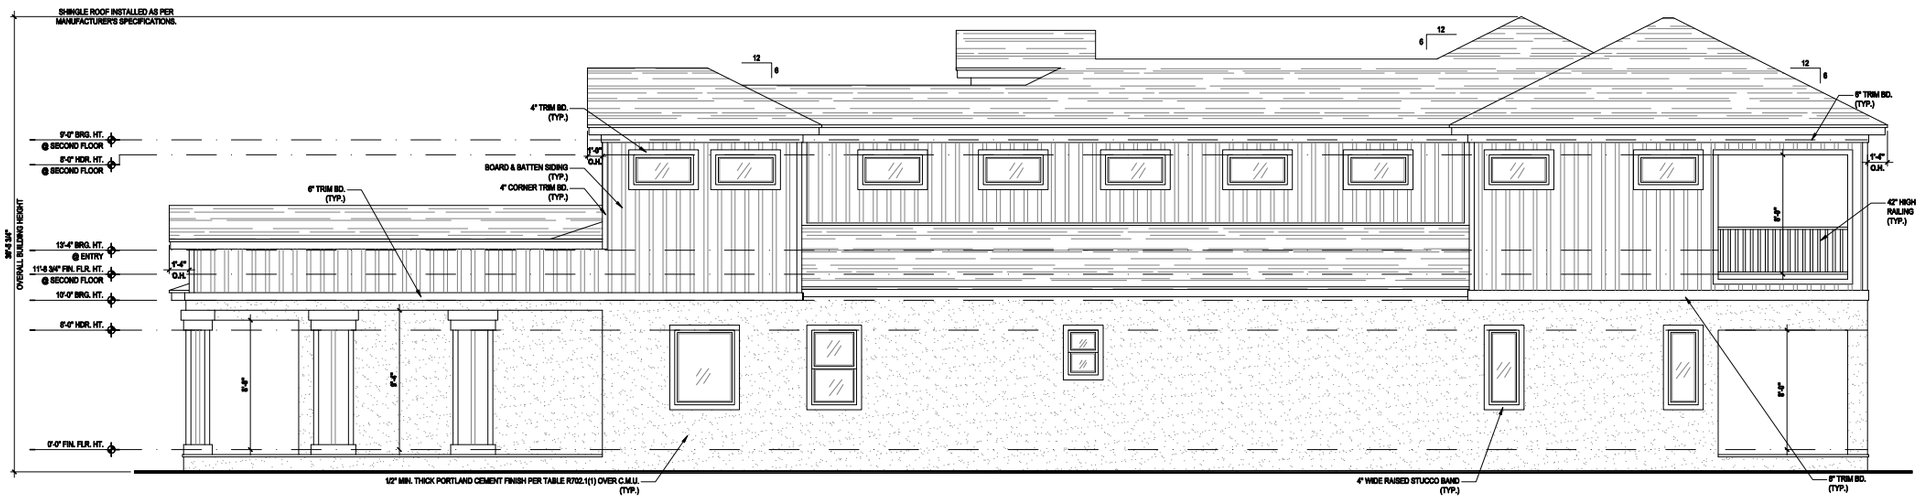

Right Elevation "B"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019, 8:56pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\40.B1 Ext Elevation B, Left & Right (Opt. Balcony).dwg THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
WWW.PREMIERPLANS.COM
FL CERT. AUTH.: 29113
FL PE#: 60239

PREMIER
ESTIMATING & PLANNING SERVICES, INC.

MJS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
custom home design
DESIGNCENTER - PLANNERS
www.mjshomedesigns.com

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions, conditions and specifications appearing on these plans.

These plans have been electronically signed & sealed by Vlad Rodriguez, PE using a digital signature. LO is sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELEVATIONS "B"

06.B1

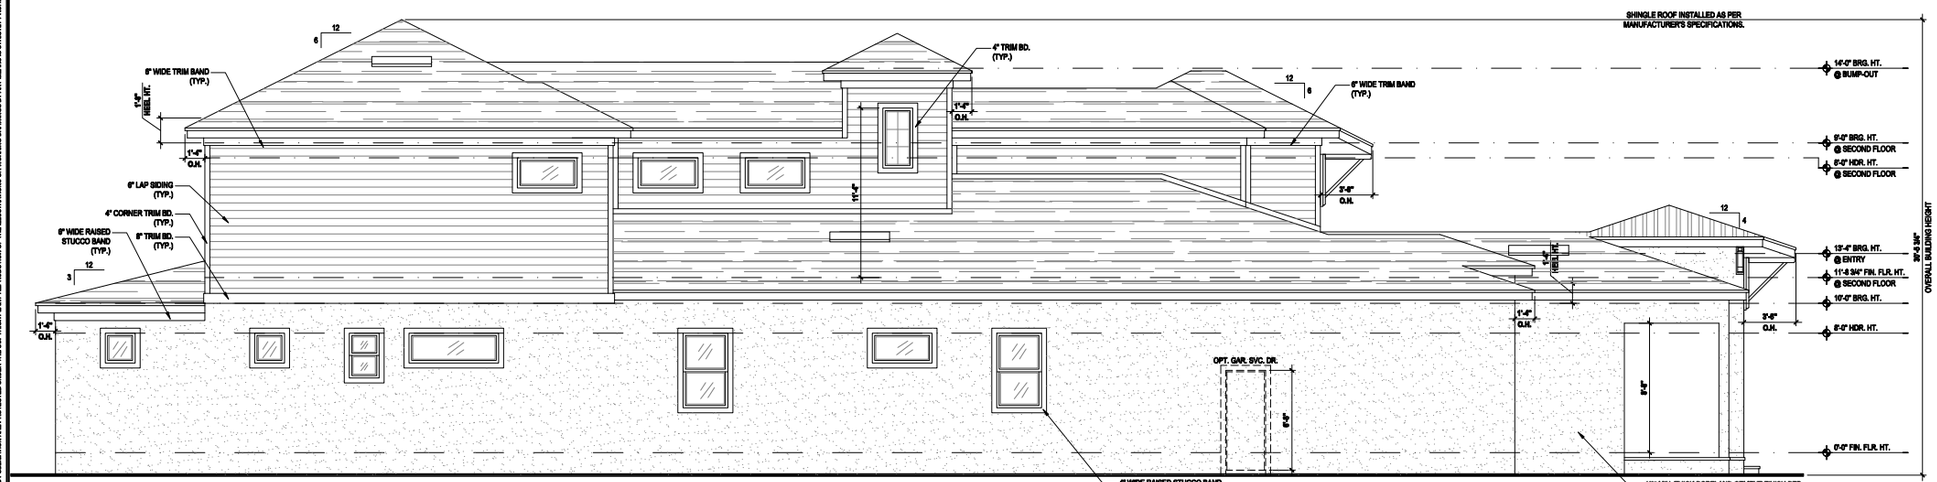

Left Elevation "C"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

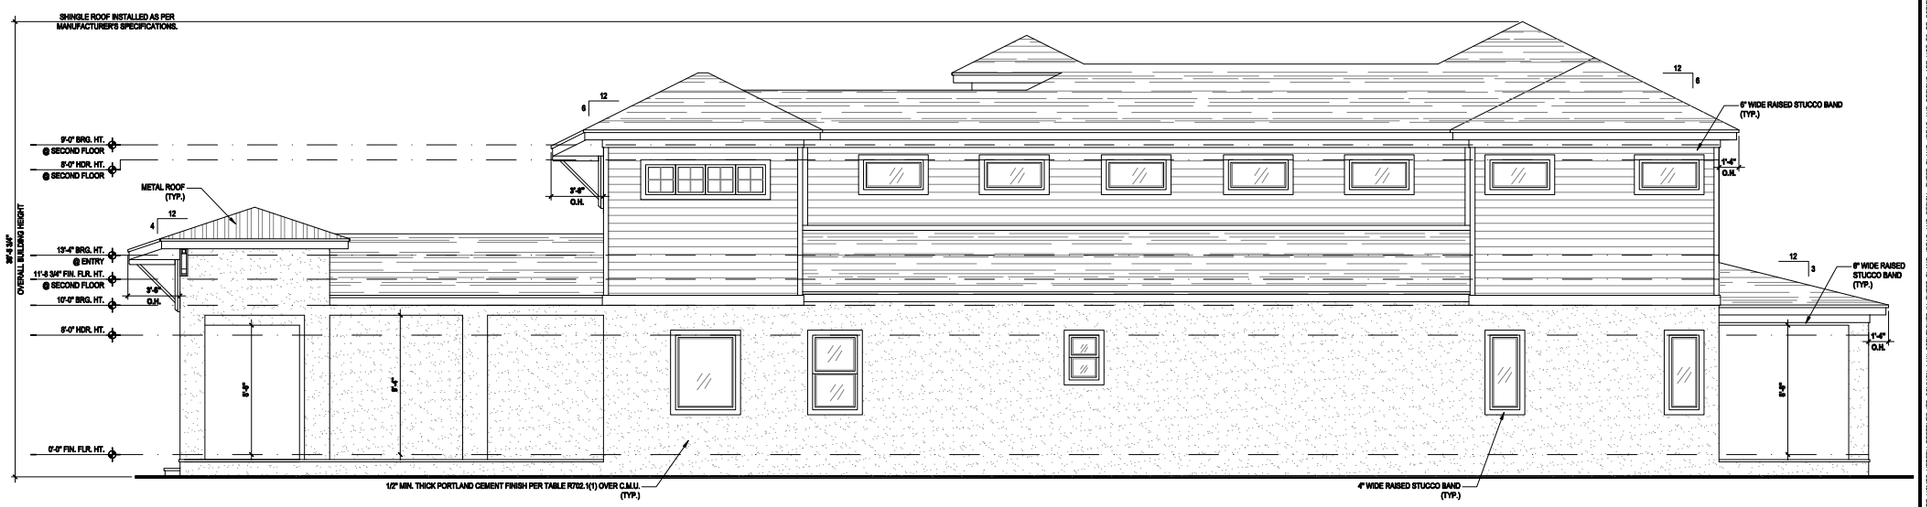

Right Elevation "C"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS DESIGNGROUP
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
custom home design
DESIGNERS • PLANNERS

PREMIER ARCHITECTURAL & ENGINEERING LLC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL CERT. AUTH.: 29113
FL PE#: 60239

May 21, 2019,8:56pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\X0.C Ext.Elevation C, Left & Right.dwg, DESIGNGROUP JMS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELEVATIONS "B"

06.C

These plans have been electronically signed & sealed by Vlad Rodriguez, PE using a digital signature. A.D.a read and printed copy of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variance. We do not assume responsibility for any deviations made from these plans without our knowledge or consent.

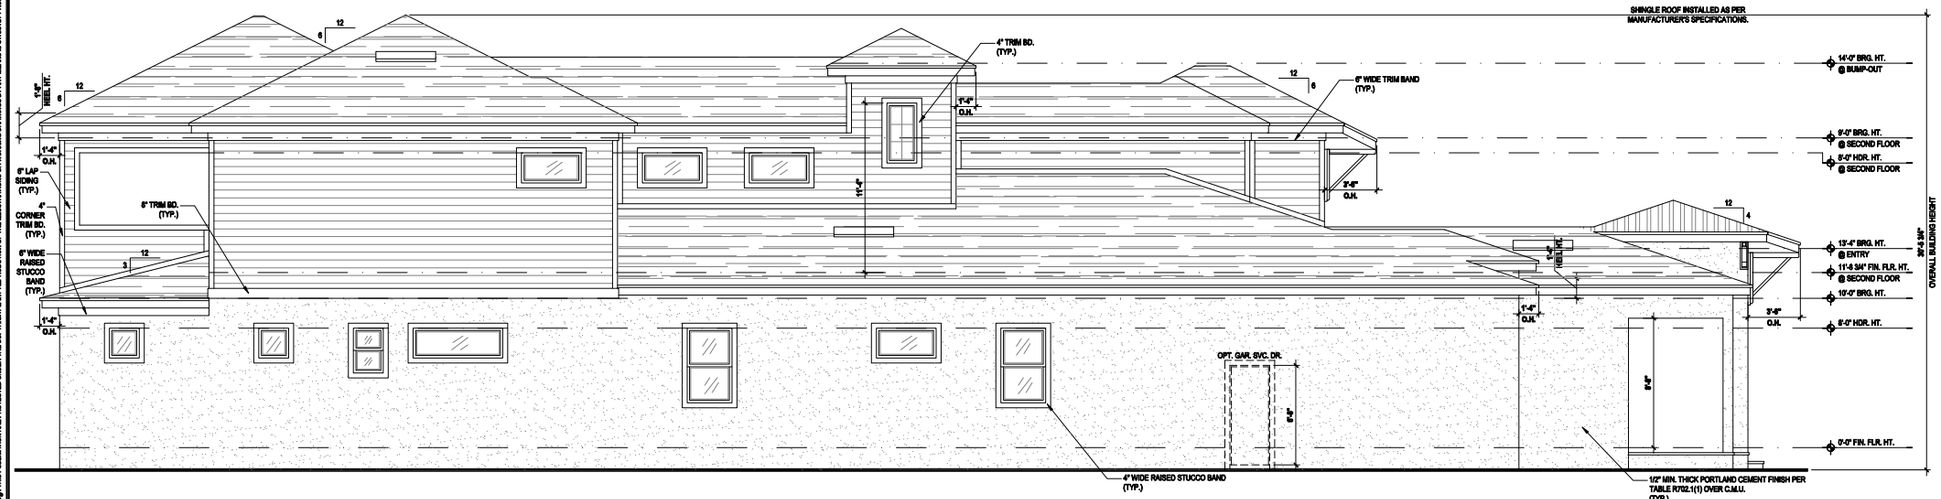

Left Elevation "C"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

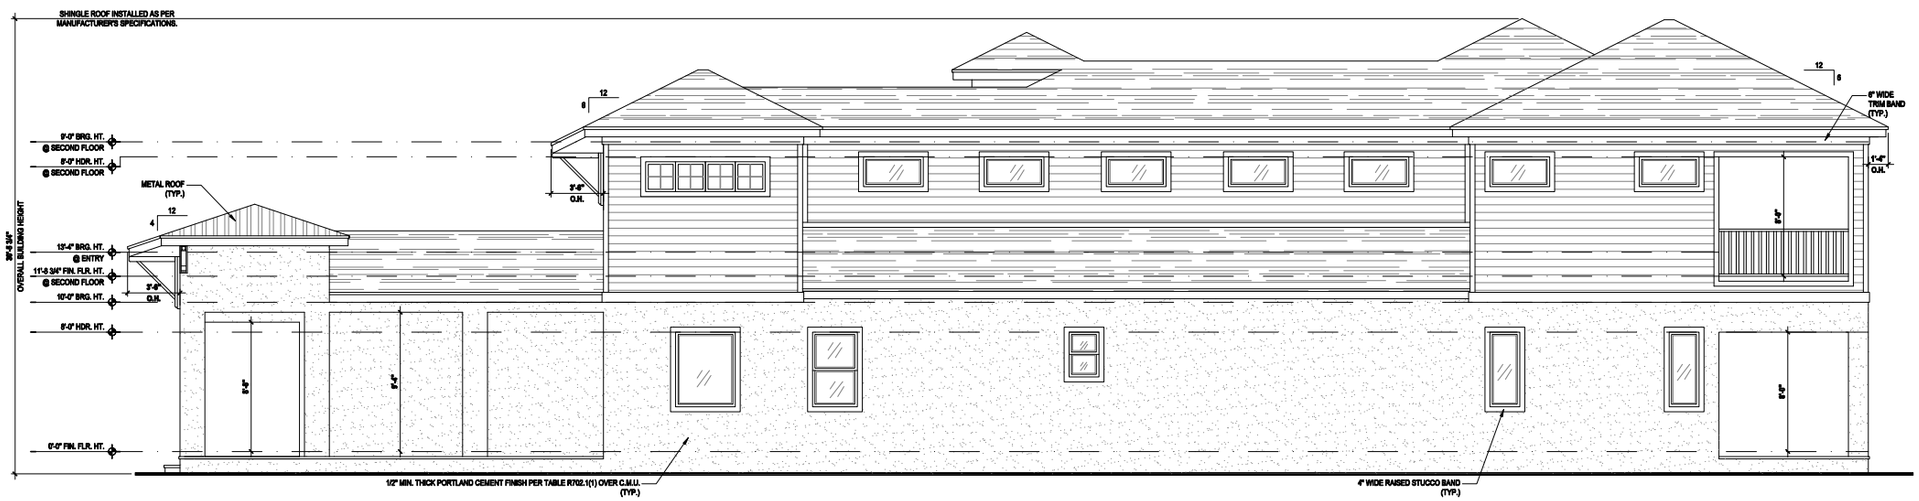

Right Elevation "C"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,8:57pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\KK.C1 Ext.Elevation C, Left & Right (Opt.Balcony).dwg THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, Fl. 32811
Phone: (407) 529-3000

MJS custom home design DESIGNERS • PLANNERS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER PLANNING & DEVELOPMENT
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierplanning@hotmail.com
FL CERT. AUTH.: 29113
FL PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELEVATIONS "B"

06.C1

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. shall be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

These plans have been electronically signed & sealed by Kent Rodrigues, PE using a digital signature. A.O.I.s read and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

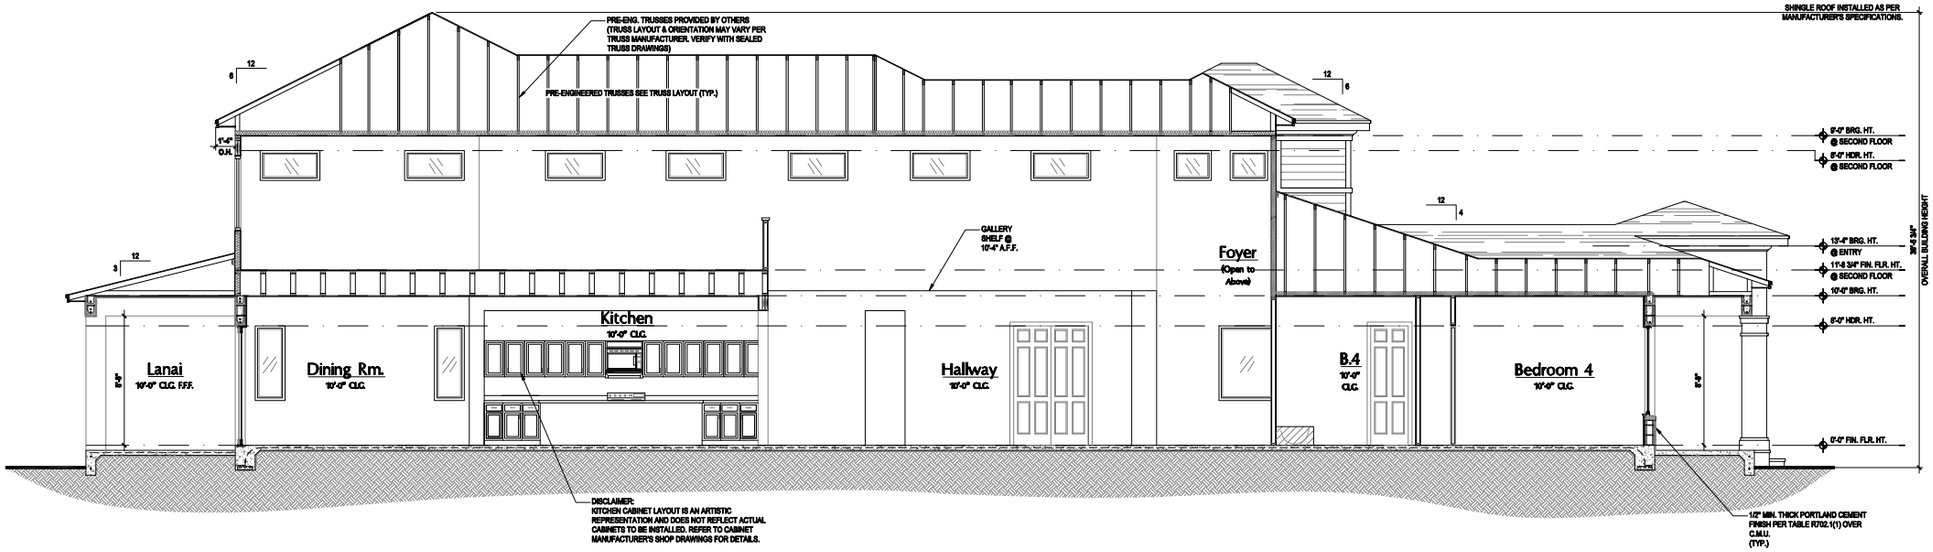

Building Section "A"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

NOTES:

1. STAIRWAY CONSTRUCTION TO CONFORM TO FBCR 2017, 6TH EDITION SECTION R311.7
2. MAX HT. OF RISER TO BE 7 3/4".
3. MIN. WIDTH OF TREAD TO BE 10" (EXCLUSIVE OF NOSING.
4. ALL TREADS LESS THAN 10" IN WIDTH SHALL HAVE APPROX. 1" OF NOSING.
5. 3/16" MAX VARIATION IN RISERS/TREADS ADJACENT TO EACH OTHER.
6. 3/8" MAX VARIATION IN ANY RISE/TREAD.
7. HAND RAIL CIRCULAR CROSS SECTION DIA. TO BE 1 1/4" - 2" OR TO PROVIDE EQUIVALENT GRASPABILITY.
8. UNDER MIN. 6" WIDE @NARROW END.
9. 34'-38" HANDRAIL HT.
10. HEADROOM CLEARANCE MIN 6'-8".

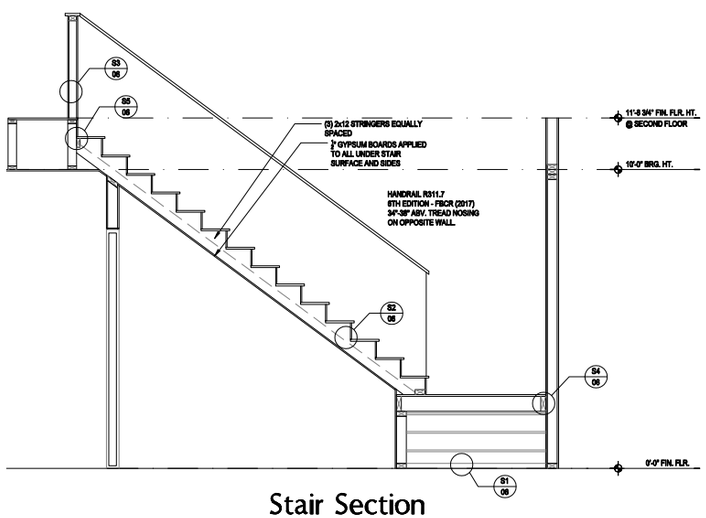

Stair Section

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)



S1 TYP. STAIR CONNECT.

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22"x34")



S2 TREAD & RISER DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34)



S3 HALF WALL DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34)

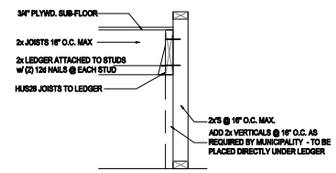

S4 LANDING CONNECT. DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34) PLATFORM FRAMING

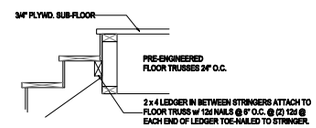

S5 STAIR CONNECT. @ FLR. TRUSS

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34) STRINGER TO FLOOR TRUSS

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

May 21, 2019,8:57pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\07.A Section.dwg

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

PARK SQUARE HOMES

MJS custom home design DESIGNERS - PLANNERS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER ESTATE BUILDERS & DEVELOPERS INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierestatebuilders.com
FL CERT. AUTH.: 29113
FL PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

BUILDING SECTION

07.A

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. shall be notified of any variations from the dimensions, conditions and specifications appearing on these plans. These plans have been electronically signed & sealed by Neil Rodriguez, PE using a digital signature. A printed copy of this document are not considered Signed & Sealed and shall not be verified on any electronic copies.

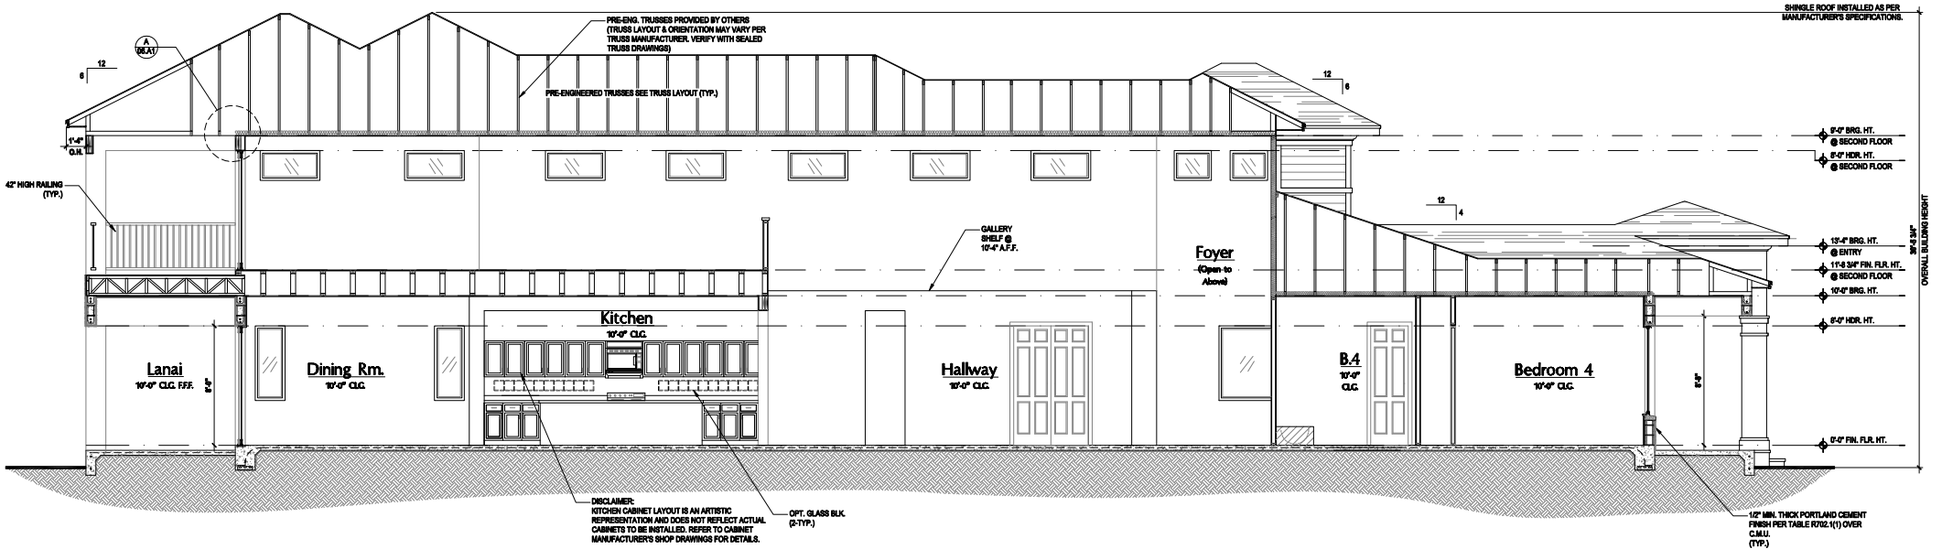

Building Section "A"

(Opt. Second Floor w- Balcony)

SCALE 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

NOTES:

1. STAIRWAY CONSTRUCTION TO CONFORM TO FBCR 2017, 6TH EDITION SECTION R311.7
2. MAX HT. OF RISER TO BE 7 3/4".
3. MIN. WIDTH OF TREAD TO BE 10" (EXCLUSIVE OF NOSING.
4. ALL TREADS LESS THAN 10" IN WIDTH SHALL HAVE APPROX. 1" OF NOSING.
5. 3/16" MAX VARIATION IN RISERS/TREADS ADJACENT TO EACH OTHER.
6. 3/8" MAX VARIATION IN ANY RISE/TREAD.
7. HAND RAIL CIRCULAR CROSS SECTION DIA. TO BE 1 1/4" - 2" OR TO PROVIDE EQUIVALENT GRASPABILITY.
8. UNDER MIN. 6" WIDE @NARROW END.
9. 34'-38" HANDRAIL HT.
10. HEADROOM CLEARANCE MIN 6'-8".

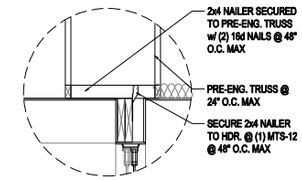

A HDR. CONNECTION

SCALE: 3/4" = 1'-0" (12x18) 1 1/2" = 1'-0" (24x36)

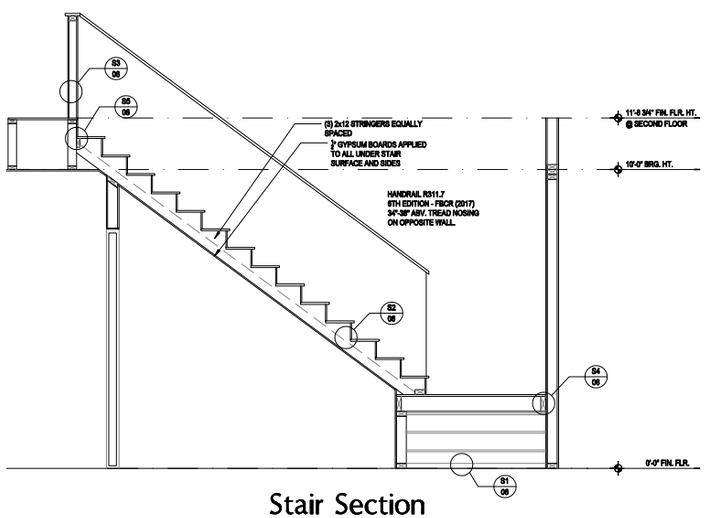

Stair Section

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)



S1 TYP. STAIR CONNECT.

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22"x34")



S2 TREAD & RISER DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34)



S3 HALF WALL DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34)

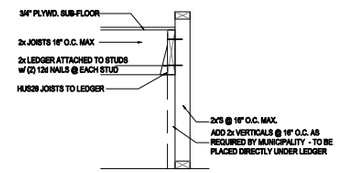

S4 LANDING CONNECT. DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34) PLATFORM FRAMING

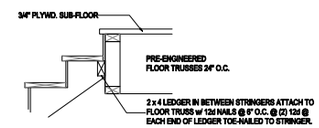

S5 STAIR CONNECT. @ FLR. TRUSS

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34) STRINGER TO FLOOR TRUSS

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
WWW.PREMIERENGINEERINGINC.COM
FL CERT. AUTH.: 29113
FL PE#: 60239

815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
custom home design
DESIGNERS - PLANNERS

40-4248

YORKSHIRE

Street Address
Lot Info
City, State. Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

BUILDING SECTION

07.A1

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

Caitlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\07.A1 Section (Opt. Balcony).dwg May 21, 2019,8:57pm

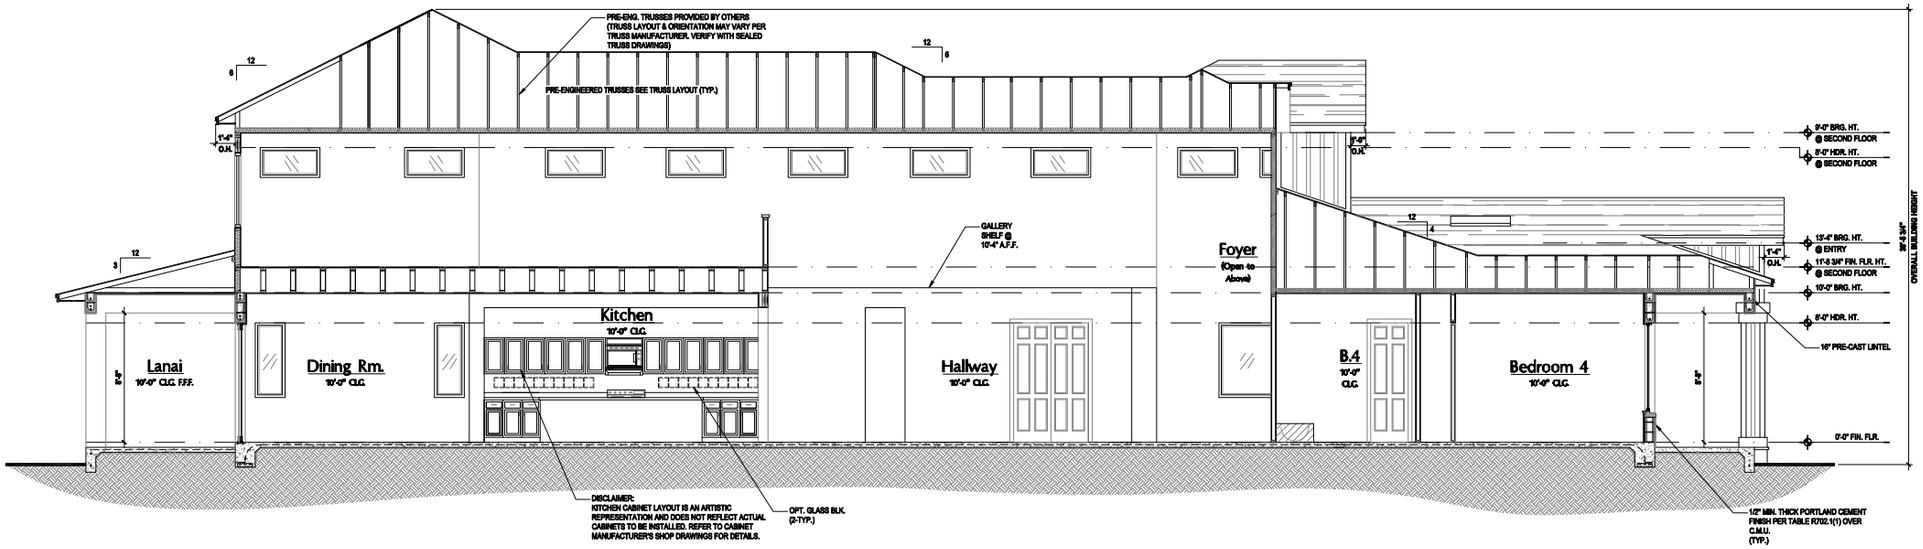

Building Section "B"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

NOTES:

1. STAIRWAY CONSTRUCTION TO CONFORM TO FBCR 2017, 6TH EDITION SECTION R311.7
2. MAX HT. OF RISER TO BE 7 3/4".
3. MIN. WIDTH OF TREAD TO BE 10" (EXCLUSIVE OF NOSING.
4. ALL TREADS LESS THAN 10" IN WIDTH SHALL HAVE APPROX. 1" OF NOSING.
5. 3/16" MAX VARIATION IN RISERS/TREADS ADJACENT TO EACH OTHER.
6. 3/8" MAX VARIATION IN ANY RISE/TREAD.
7. HAND RAIL CIRCULAR CROSS SECTION DIA. TO BE 1 1/4" - 2" OR TO PROVIDE EQUIVALENT GRASPABILITY.
8. UNDER MIN. 6" WIDE @NARROW END.
9. 34'-38" HANDRAIL HT.
10. HEADROOM CLEARANCE MIN 6'-8".

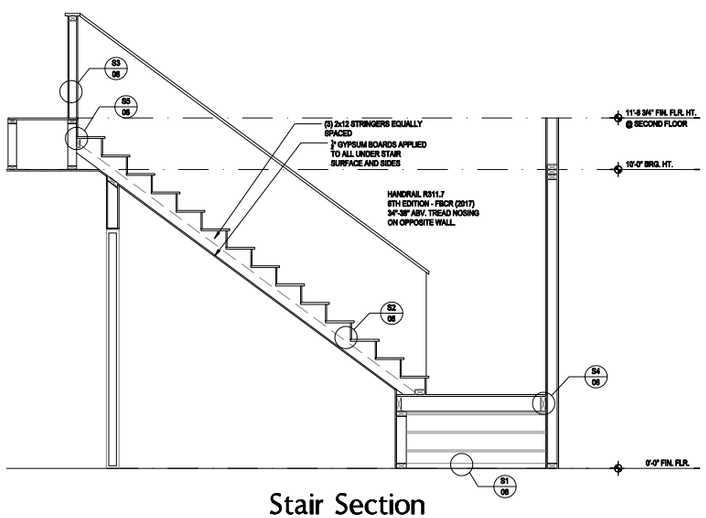

Stair Section

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)



S1 TYP. STAIR CONNECT.

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22"x34")



S2 TREAD & RISER DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34)



S3 HALF WALL DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34)

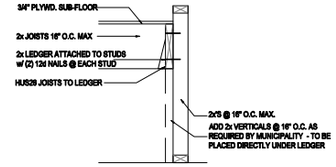

S4 LANDING CONNECT. DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34) PLATFORM FRAMING

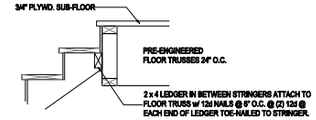

S5 STAIR CONNECT. @ FLR. TRUSS

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34) STRINGER TO FLOOR TRUSS

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATER OR FORM WHATSOEVER, NOR ARE THET TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
WWW.PREMIERPERMITS.COM
FL CERT. AUTH.: 29113
FL PE#: 60239

PREMIER PERMIT EXPEDITERS & ENGINEERING

MJS
custom home design
DESIGNERS - PLANNERS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. shall be notified of any variations from the dimensions, conditions and specifications appearing on these plans.

These plans have been electronically signed & sealed by Vlad Rodriguez, PE using a digital signature. A hard copy or printed copy of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

BUILDING SECTION

07.B

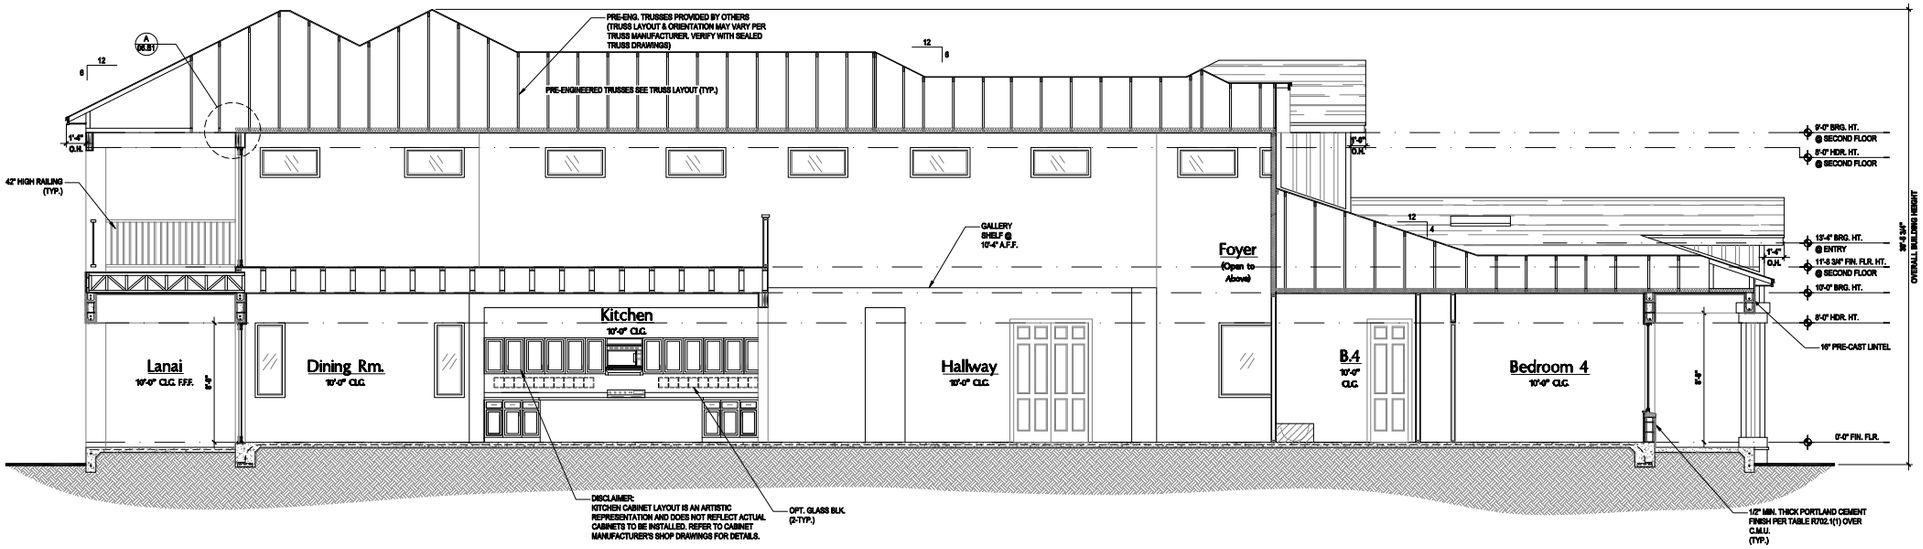

Building Section "B"

(Opt. Second Floor w- Balcony)

SCALE 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

NOTES:

1. STAIRWAY CONSTRUCTION TO CONFORM TO FBCR 2017, 6TH EDITION SECTION R311.7
2. MAX HT. OF RISER TO BE 7 3/4".
3. MIN. WIDTH OF TREAD TO BE 10" (EXCLUSIVE OF NOSING.
4. ALL TREADS LESS THAN 10" IN WIDTH SHALL HAVE APPROX. 1" OF NOSING.
5. 3/16" MAX VARIATION IN RISERS/TREADS ADJACENT TO EACH OTHER.
6. 3/8" MAX VARIATION IN ANY RISE/TREAD.
7. HAND RAIL CIRCULAR CROSS SECTION DIA. TO BE 1 1/4" - 2" OR TO PROVIDE EQUIVALENT GRASPABILITY.
8. UNDER MIN. 6" WIDE @NARROW END.
9. 34'-38" HANDRAIL HT.
10. HEADROOM CLEARANCE MIN 6'-8".

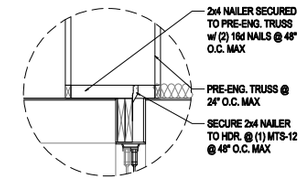

A HDR. CONNECTION

SCALE: 3/4" = 1'-0" (12x18) 1 1/2" = 1'-0" (24x36)

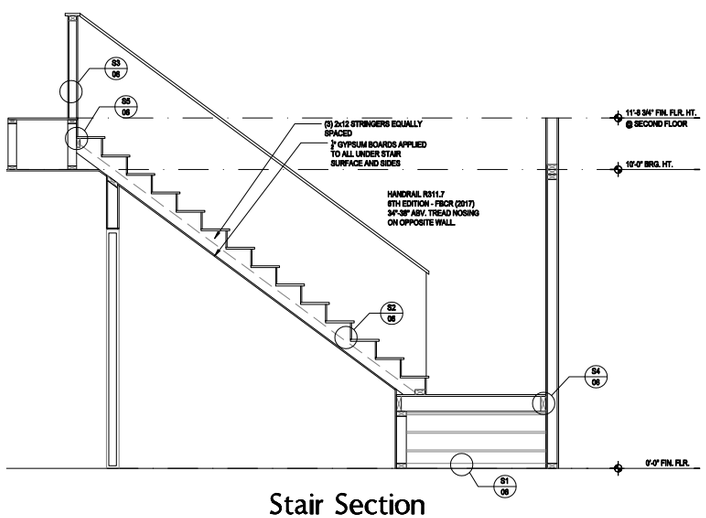

Stair Section

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)



S1 TYP. STAIR CONNECT.

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22"x34")



S2 TREAD & RISER DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34)



S3 HALF WALL DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34)

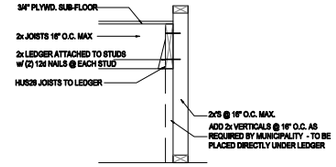

S4 LANDING CONNECT. DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34) PLATFORM FRAMING

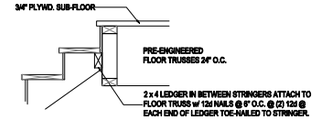

S5 STAIR CONNECT. @ FLR. TRUSS

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34) STRINGER TO FLOOR TRUSS

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
WWW.PREMIERPROJECTS.COM
FL CERT. AUTH.: 29113
FL PE#: 60239

815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

40-4248

YORKSHIRE

Street Address
Lot Info
City, State. Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

BUILDING SECTION

07.B1

Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\07.B1 Section (Opt. Balcony).dwg ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.
May 21, 2019, 8:58pm

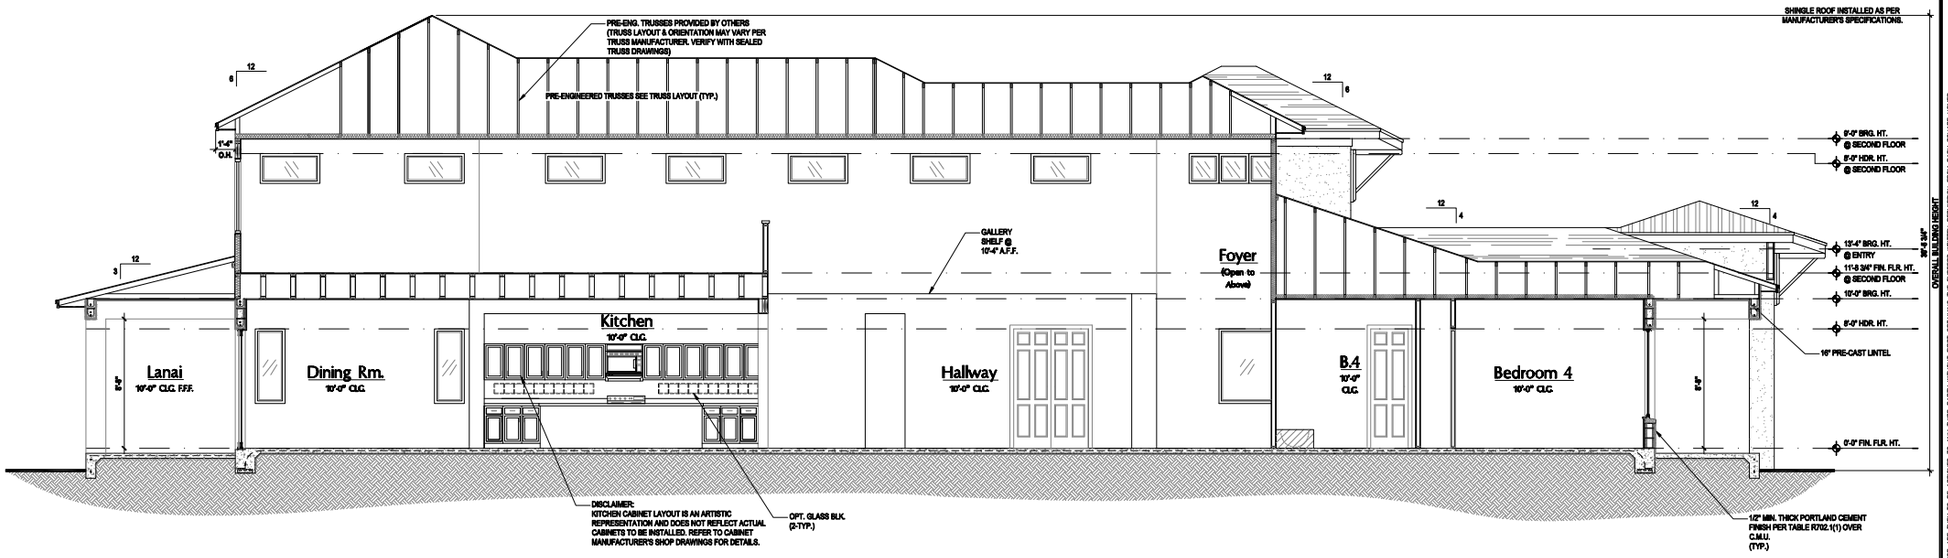

Building Section "C"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

NOTES:

1. STAIRWAY CONSTRUCTION TO CONFORM TO FBCR 2017, 6TH EDITION SECTION R311.7
2. MAX HT. OF RISER TO BE 7 3/4".
3. MIN. WIDTH OF TREAD TO BE 10" (EXCLUSIVE OF NOSING.
4. ALL TREADS LESS THAN 10" IN WIDTH SHALL HAVE APPROX. 1" OF NOSING.
5. 3/16" MAX VARIATION IN RISERS/TREADS ADJACENT TO EACH OTHER.
6. 3/8" MAX VARIATION IN ANY RISE/TREAD.
7. HAND RAIL CIRCULAR CROSS SECTION DIA. TO BE 1 1/4" - 2" OR TO PROVIDE EQUIVALENT GRASPABILITY.
8. UNDER MIN. 6" WIDE @NARROW END.
9. 34'-38" HANDRAIL HT.
10. HEADROOM CLEARANCE MIN 6'-8".

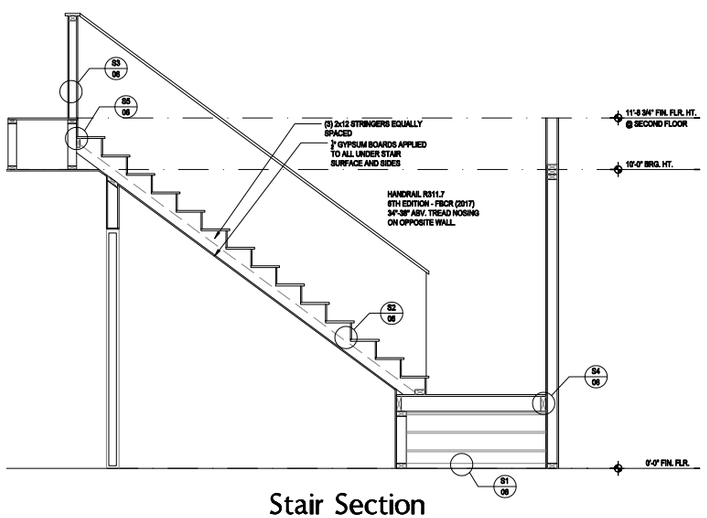

Stair Section

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)



S1 TYP. STAIR CONNECT.

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22"x34")



S2 TREAD & RISER DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34)



S3 HALF WALL DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34)

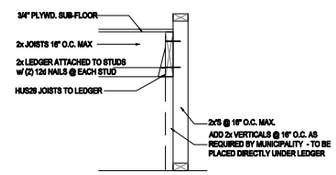

S4 LANDING CONNECT. DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34) PLATFORM FRAMING

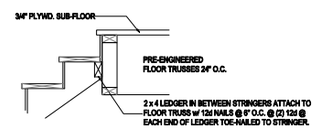

S5 STAIR CONNECT. @ FLR. TRUSS

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34) STRINGER TO FLOOR TRUSS

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATER OR FORM WHATSOEVER, NOR ARE THET TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, Fl. 32811
Phone: (407) 529-3000

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
WWW.PREMIERPROJECTS.COM
FL CERT. AUTH.: 29113

815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
custom home design
DESIGNERS • PLANNERS

40-4248

YORKSHIRE

Street Address
Lot Info
City, State. Zip

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. shall be notified of any variances to the dimensions, conditions and specifications appearing on these plans.

These plans have been electronically signed & sealed by Vlad Rodriguez, PE using a digital signature. A printed copy of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

BUILDING SECTION

07.C

Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\07.C Section.dwg
May 21, 2019, 8:58pm

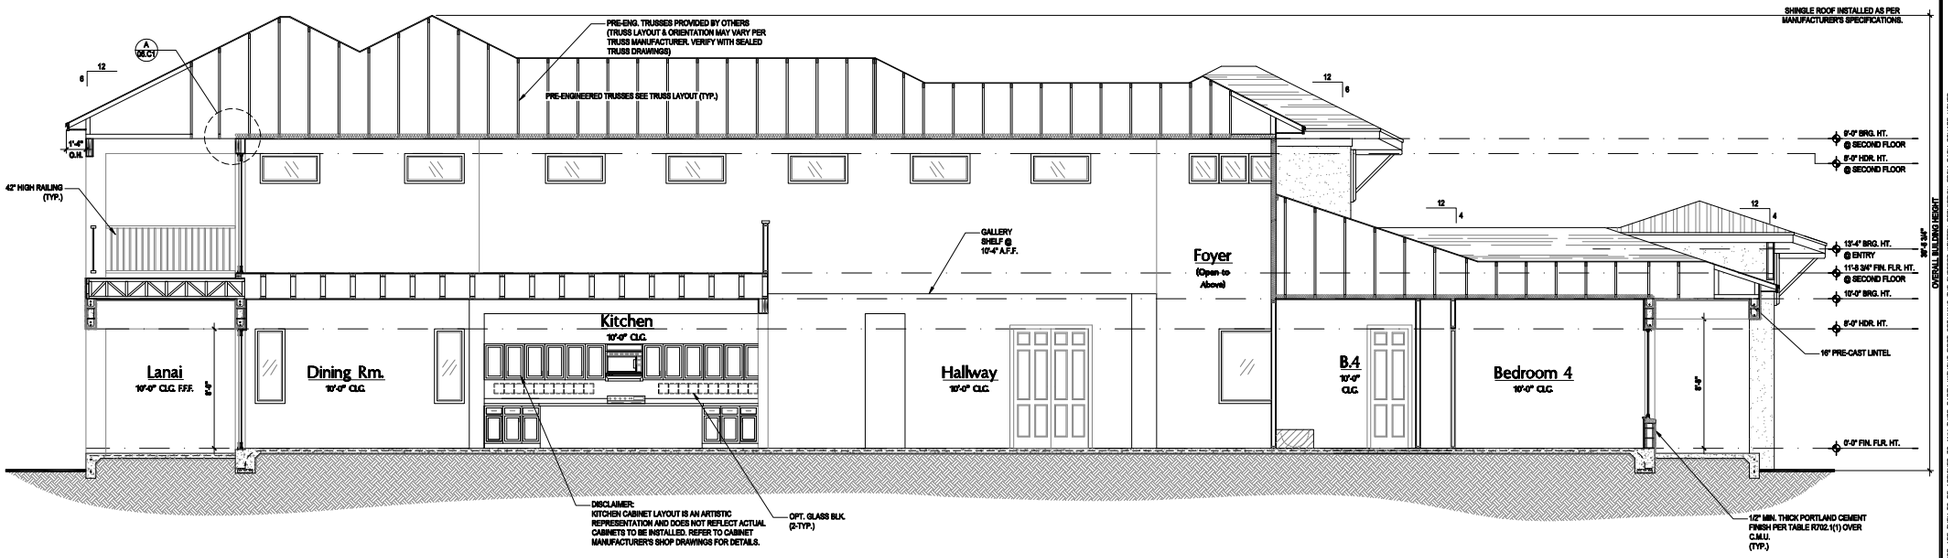

Building Section "C"

(Opt. Second Floor w- Balcony)

SCALE 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

NOTES:

1. STAIRWAY CONSTRUCTION TO CONFORM TO FBCR 2017, 6TH EDITION SECTION R311.7
2. MAX HT. OF RISER TO BE 7 3/4".
3. MIN. WIDTH OF TREAD TO BE 10" (EXCLUSIVE OF NOSING.
4. ALL TREADS LESS THAN 10" IN WIDTH SHALL HAVE APPROX. 1" OF NOSING.
5. 3/16" MAX VARIATION IN RISERS/TREADS ADJACENT TO EACH OTHER.
6. 3/8" MAX VARIATION IN ANY RISE/TREAD.
7. HAND RAIL CIRCULAR CROSS SECTION DIA. TO BE 1 1/4" - 2" OR TO PROVIDE EQUIVALENT GRASPABILITY.
8. UNDER MIN. 6" WIDE @NARROW END.
9. 34'-38" HANDRAIL HT.
10. HEADROOM CLEARANCE MIN 6'-8".

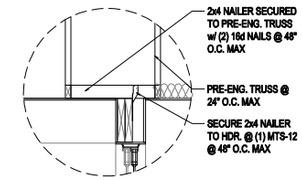

A HDR. CONNECTION

SCALE: 3/4" = 1'-0" (12x18) 1 1/2" = 1'-0" (24x36)

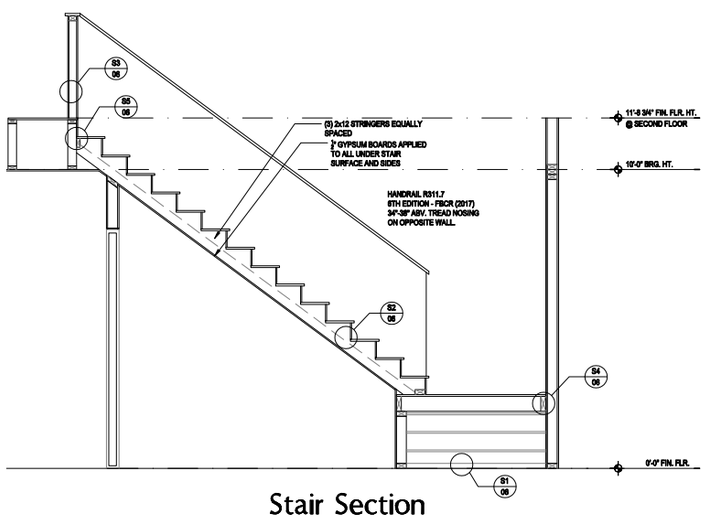

Stair Section

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)



S1 TYP. STAIR CONNECT.

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22"x34")



S2 TREAD & RISER DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34)



S3 HALF WALL DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34)

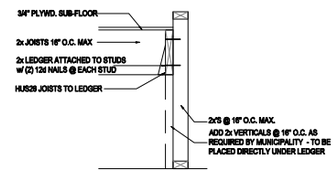

S4 LANDING CONNECT. DETAIL

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34) PLATFORM FRAMING

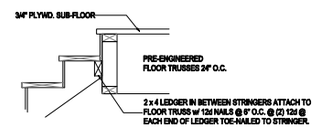

S5 STAIR CONNECT. @ FLR. TRUSS

SCALE: 3/4" = 1'-0" (11x17) 1 1/2" = 1'-0" (22x34) STRINGER TO FLOOR TRUSS

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
WWW.PREMIERPROTOTYPE.COM
FL CERT. AUTH.: 29113
FL PE#: 60239

815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

40-4248

YORKSHIRE

Street Address
Lot Info
City, State. Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

BUILDING SECTION

07.C1

Plans have been electronically signed & sealed by Kirk Rodrigues, PE using a digital signature. A printed copy of this document is not considered Signed & Sealed. Signature must be verified on any electronic copies.

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\07.C1 Section (Opt. Balcony).dwg May 21, 2019, 8:58pm

GENERAL NOTES KEY:

1. BUILDER TO VERIFY EXACT LOCATION OF FLOOR OUTLETS IN FIELD.
2. ALL OUTLETS ARE TO BE AFCI PROTECTED.
3. ALL 15A AND 20A 120V BRANCH CIRCUITS WILL BE AFCI PROTECTED.
4. ALL 15A AND 20A 120V BRANCH CIRCUITS LOCATED IN THE GARAGE AND LAUNDRY WILL BE GFCI PROTECTED.
5. ALL GARAGE BAYS WILL HAVE DEDICATED GFCI OUTLET.
6. ALL OUTLETS LOCATED IN THE KITCHEN AND BATHROOMS ARE TO BE GFCI PROTECTED.
7. DW. AND GARBAGE DISPOSAL ARE TO BE GFCI PROTECTED.
8. EXCEPTIONS TO THE GFCI STIPULATION WILL BE ALLOWED ONLY IF ALLOWED PER CURRENT NFPA / NEC.
9. OUTLETS LOCATED IN THE LAUNDRY ARE TO BE GFCI AND AFCI PROTECTED.
10. OUTLETS LOCATED WITHIN 6'-0" OF A WET AREA ARE TO BE GFCI PROTECTED.
11. ALL OUTLETS OVER COUNTERTOPS TO BE 42" A.F.F. (U.N.O.).
12. ALL SMOKE/CARBON MONOXIDE DETECTORS ARE TO BE HARD WIRED, INTERCONNECTED AND AFCI PROTECTED.
13. 8'-0" HEIGHT VANITY LIGHTS IN MASTER BATHROOM AND 7'-0" IN ALL OTHER BATHROOMS.
14. IN AREAS SPECIFIED IN SECTION E3901.1, 125-VOLT, 15- AND 20-AMPERE RECEPTACLES SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES.

NOTES:

- THIS DIAGRAMMATIC PLAN IS INTENDED TO SHOW LIGHTING AND CONVENIENCE OUTLETS ONLY. IT IS THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO VERIFY THE REQUIREMENT AND LOCATIONS OF ALL ELECTRICAL EQUIPMENT, (INCLUDING KITCHEN EQUIPMENT) AND PROVIDE AND INSTALL COMPLETE ELECTRICAL SERVICE AS REQUIRED PER NFPA, NEC, FBC CODES AND ALL REIGNING MUNICIPALITY CODES, STANDARDS AND ORDINANCES.
- LOCATION OF FIXTURES AND / OR OUTLETS ARE SUGGESTED LOCATIONS AND MEET MOST LOCAL CODE REQUIREMENTS. ADDITIONS OR ADJUSTMENTS MAY BE MADE BETWEEN THE OWNER AND BUILDER IN THE FIELD.
- ALL ELECTRICAL WORK AND APPLIANCES ARE IN FULL COMPLIANCE WITH N.F.P.A., N.E.C., F.B.C. 6TH EDITION (2017) RESIDENTIAL, AND ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
- VARIOUS SYMBOLS ON ELECTRICAL LEGEND MAY OR MAY NOT BE USED ON THIS PLAN.

ELECTRICAL KEY:

	CEILING MOUNTED LIGHT		FLOOR RECEPTACLE		CHIME		FLUSH MOUNT FLUORESCENT LIGHT
PC	PULL CHAIN LIGHT		PRE-WIRE FOR CLG. FAN		DOOR BELL / GARAGE DOOR SWITCH		FAN / LIGHT COMBINATION
	RECESSED LIGHT	GFI	GROUND FAULT INTERRUPT		DISCONNECT SWITCH		GARBAGE DISPOSAL MOTOR
	WALL MOUNTED LIGHT		WALL SWITCH		ELECTRICAL METER		SPEAKER
	WALL WASH RECESSED		3-WAY SWITCH	S.D.	SMOKE DETECTOR		JUNCTION BOX
	DUPLEX RECEPTACLE		DIMMER SWITCH	C.M.S.D.	CARBON MONOXIDE / SMOKE DETECTOR	L.V.	LOW VOLTAGE
	220 V RECEPTACLE		TELEPHONE JACK		CEILING FAN	V.P.	VAPOR PROOF
	1/2 HOT, 1/2 SWITCHED		CABLE JACK		WALL SCONCE	A.F.	ARC FAULT PROTECTION
WP	WATER PROOF RECEPTACLE		PRE-WIRE GARAGE DOOR OPENER		CHANDELIER		
			FLUORESCENT LIGHT		SPOT LIGHT		
			ELECTRICAL PANEL				

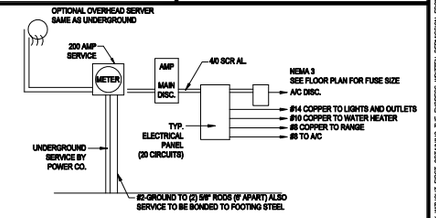

NOTE:
ALL ELECTRICAL WORK AND MATERIAL PROVIDED SHALL COMPLY WITH THE FLORIDA BUILDING CODE. (2017) THE ABOVE ELECTRICAL LAYOUT IS FOR BID PURPOSE ONLY.

200 AMP ELECTRICAL RISER

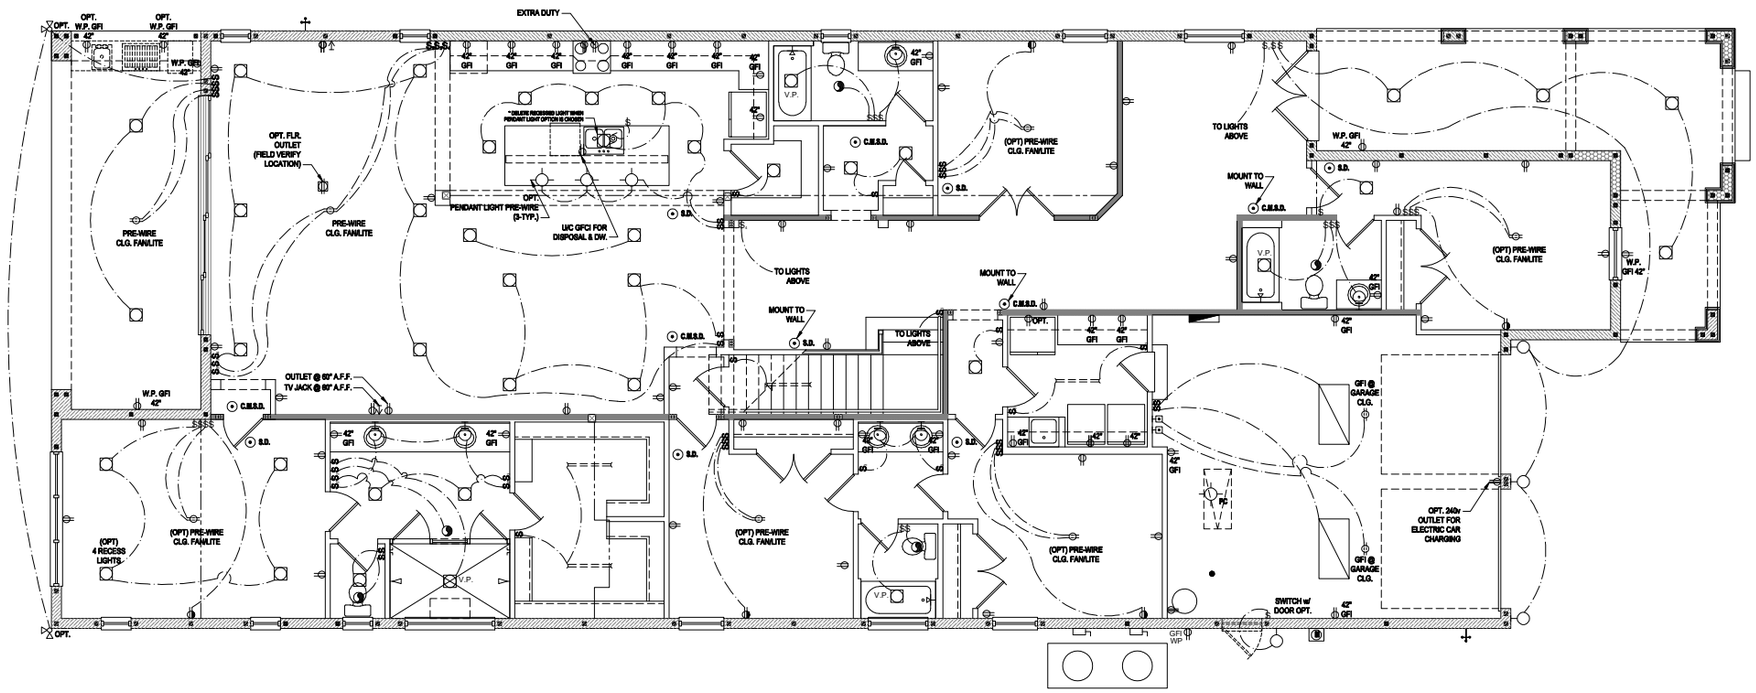

First Floor Electrical Plan "A"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\08.A First Floor Electrical Plan.dwg ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

May 21, 2019,6:55pm

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierarchitectural.com
CERT. AUTH.: 29113
FL. PE# 60239

PREMIER ARCHITECTURAL ENGINEERING INC.

MJS 815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
custom home design
DESIGNERS - PLANNERS www.mjshomedesigns.com

NOTE!! DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor and/or owner are responsible for dimensions and conditions of the job and M.J.S., Inc. must be notified of any of any changes to the dimensions, conditions and specifications appearing on these plans.

When plans have been electronically signed & sealed by Chad Rodgers, PE, using a digital signature, SO is sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

A division of Park Square Enterprises Inc.,
5200 Vineland Rd, Suite #200
Orlando, Fl. 32811
Phone: (407) 529-3000

Park Square HOMES

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELECTRICAL PLAN

08.A

GENERAL NOTES KEY:

1. BUILDER TO VERIFY EXACT LOCATION OF FLOOR OUTLETS IN FIELD.
2. ALL OUTLETS ARE TO BE AFCI PROTECTED.
3. ALL 15A AND 20A 120V BRANCH CIRCUITS WILL BE AFCI PROTECTED.
4. ALL 15A AND 20A 120V BRANCH CIRCUITS LOCATED IN THE GARAGE AND LAUNDRY WILL BE GFCI PROTECTED.
5. ALL GARAGE BAYS WILL HAVE DEDICATED GFCI OUTLET.
6. ALL OUTLETS LOCATED IN THE KITCHEN AND BATHROOMS ARE TO BE GFCI PROTECTED.
7. DW. AND GARBAGE DISPOSAL ARE TO BE GFCI PROTECTED.
8. EXCEPTIONS TO THE GFCI STIPULATION WILL BE ALLOWED ONLY IF ALLOWED PER CURRENT NFPA / NEC.
9. OUTLETS LOCATED IN THE LAUNDRY ARE TO BE GFCI AND AFCI PROTECTED.
10. OUTLETS LOCATED WITHIN 6'-0" OF A WET AREA ARE TO BE GFCI PROTECTED.
11. ALL OUTLETS OVER COUNTERTOPS TO BE 42" A.F.F. (U.N.O.).
12. ALL SMOKE/CARBON MONOXIDE DETECTORS ARE TO BE HARD WIRED, INTERCONNECTED AND AFCI PROTECTED.
13. 8'-0" HEIGHT VANITY LIGHTS IN MASTER BATHROOM AND 7'-0" IN ALL OTHER BATHROOMS.
14. IN AREAS SPECIFIED IN SECTION E3901.1, 125-VOLT, 15- AND 20-AMPERE RECEPTACLES SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES.

NOTES:

- THIS DIAGRAMMATIC PLAN IS INTENDED TO SHOW LIGHTING AND CONVENIENCE OUTLETS ONLY. IT IS THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO VERIFY THE REQUIREMENT AND LOCATIONS OF ALL ELECTRICAL EQUIPMENT, (INCLUDING KITCHEN EQUIPMENT) AND PROVIDE AND INSTALL COMPLETE ELECTRICAL SERVICE AS REQUIRED PER NFPA, NEC, FBC CODES AND ALL REIGNING MUNICIPALITY CODES, STANDARDS AND ORDINANCES.
- LOCATION OF FIXTURES AND / OR OUTLETS ARE SUGGESTED LOCATIONS AND MEET MOST LOCAL CODE REQUIREMENTS. ADDITIONS OR ADJUSTMENTS MAY BE MADE BETWEEN THE OWNER AND BUILDER IN THE FIELD.
- ALL ELECTRICAL WORK AND APPLIANCES ARE IN FULL COMPLIANCE WITH N.F.P.A., N.E.C., F.B.C. 6TH EDITION (2017) RESIDENTIAL, AND ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
- VARIOUS SYMBOLS ON ELECTRICAL LEGEND MAY OR MAY NOT BE USED ON THIS PLAN.

ELECTRICAL KEY:

	CEILING MOUNTED LIGHT		FLOOR RECEPTACLE		CHIME		FLUSH MOUNT FLUORESCENT LIGHT
	PULL CHAIN LIGHT		PRE-WIRE FOR CLG. FAN		DOOR BELL / GARAGE DOOR SWITCH		FAN / LIGHT COMBINATION
PC		GFI	GROUND FAULT INTERRUPT		DISCONNECT SWITCH		GARBAGE DISPOSAL MOTOR
	RECESSED LIGHT	$	WALL SWITCH		ELECTRICAL METER		SPEAKER
	WALL MOUNTED LIGHT	$3	3-WAY SWITCH	S.D.	SMOKE DETECTOR	J	JUNCTION BOX
	WALL WASH RECESSED	$D	DIMMER SWITCH	C.M.S.D.	CARBON MONOXIDE / SMOKE DETECTOR	L.V.	LOW VOLTAGE
	DUPLEX RECEPTACLE		TELEPHONE JACK		CEILING FAN	V.P.	VAPOR PROOF
	220 V RECEPTACLE		CABLE JACK		WALL SCONCE	A.F.	ARC FAULT PROTECTION
	1/2 HOT, 1/2 SWITCHED		PRE-WIRE GARAGE DOOR OPENER		CHANDELIER		
WP	WATER PROOF RECEPTACLE		FLUORESCENT LIGHT		SPOT LIGHT		
			ELECTRICAL PANEL				

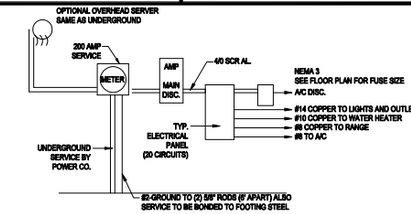

NOTE:
ALL ELECTRICAL WORK AND MATERIAL PROVIDED SHALL COMPLY WITH THE FLORIDA BUILDING CODE. (2017) THE ABOVE ELECTRICAL LAYOUT IS FOR BID PURPOSE ONLY.

200 AMP ELECTRICAL RISER

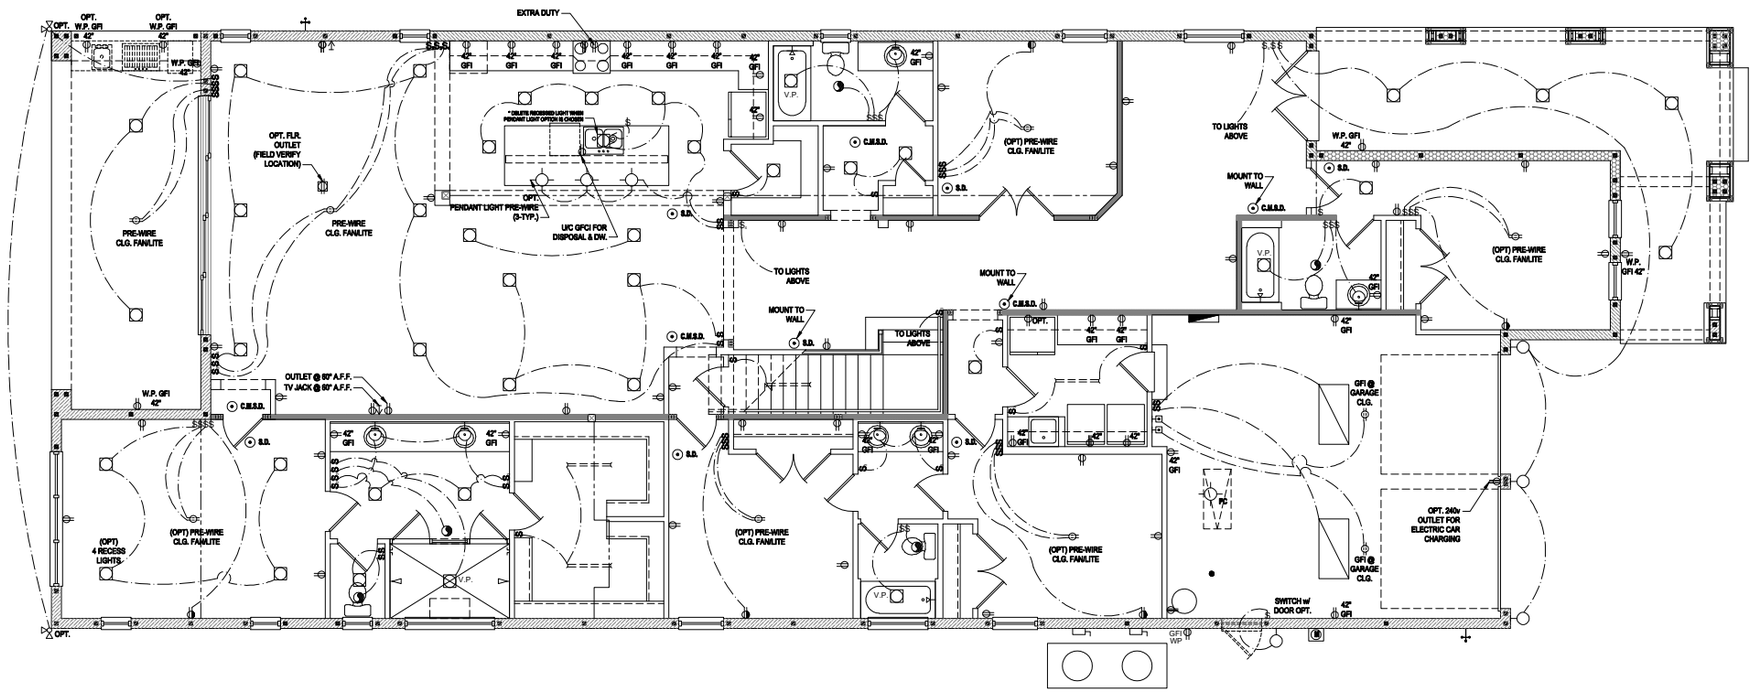

First Floor Electrical Plan "B"

(Opt. Second Floor)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

MJS 815 Orienta Ave, Suite# 1040 Altamonte Springs, FL. 32701 Ph: (407) 629-6711 Fax: (407) 629-6776 custom home design DESIGNSHOME - PLANNERS www.mjshomedesigns.com

235 Maitland Avenue S. Suite 108-A Maitland, FL. 32751 Ph: (407) 227-7416 www.premierarchitectural.com FL. CERT. AUTH.: 29113 FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

A division of Park Square Enterprises Inc., 5200 Vineland Rd. Suite #200 Orlando, FL 32811 Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELECTRICAL PLAN

08.B

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

May 21, 2019,6:56pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\03.B First Floor Electrical Plan.dwg

GENERAL NOTES KEY:

1. BUILDER TO VERIFY EXACT LOCATION OF FLOOR OUTLETS IN FIELD.
2. ALL OUTLETS ARE TO BE AFCI PROTECTED.
3. ALL 15A AND 20A 120V BRANCH CIRCUITS WILL BE AFCI PROTECTED.
4. ALL 15A AND 20A 120V BRANCH CIRCUITS LOCATED IN THE GARAGE AND LAUNDRY WILL BE GFCI PROTECTED.
5. ALL GARAGE BAYS WILL HAVE DEDICATED GFCI OUTLET.
6. ALL OUTLETS LOCATED IN THE KITCHEN AND BATHROOMS ARE TO BE GFCI PROTECTED.
7. DW. AND GARBAGE DISPOSAL ARE TO BE GFCI PROTECTED.
8. EXCEPTIONS TO THE GFCI STIPULATION WILL BE ALLOWED ONLY IF ALLOWED PER CURRENT NFPA / NEC.
9. OUTLETS LOCATED IN THE LAUNDRY ARE TO BE GFCI AND AFCI PROTECTED.
10. OUTLETS LOCATED WITHIN 6'-0" OF A WET AREA ARE TO BE GFCI PROTECTED.
11. ALL OUTLETS OVER COUNTERTOPS TO BE 42" A.F.F. (U.N.O.).
12. ALL SMOKE/CARBON MONOXIDE DETECTORS ARE TO BE HARD WIRED, INTERCONNECTED AND AFCI PROTECTED.
13. 8'-0" HEIGHT VANITY LIGHTS IN MASTER BATHROOM AND 7'-0" IN ALL OTHER BATHROOMS.
14. IN AREAS SPECIFIED IN SECTION E3901.1, 125-VOLT, 15- AND 20-AMPERE RECEPTACLES SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES.

NOTES:

- THIS DIAGRAMMATIC PLAN IS INTENDED TO SHOW LIGHTING AND CONVENIENCE OUTLETS ONLY. IT IS THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO VERIFY THE REQUIREMENT AND LOCATIONS OF ALL ELECTRICAL EQUIPMENT, (INCLUDING KITCHEN EQUIPMENT) AND PROVIDE AND INSTALL COMPLETE ELECTRICAL SERVICE AS REQUIRED PER NFPA, NEC, FBC CODES AND ALL REIGNING MUNICIPALITY CODES, STANDARDS AND ORDINANCES.
- LOCATION OF FIXTURES AND / OR OUTLETS ARE SUGGESTED LOCATIONS AND MEET MOST LOCAL CODE REQUIREMENTS. ADDITIONS OR ADJUSTMENTS MAY BE MADE BETWEEN THE OWNER AND BUILDER IN THE FIELD.
- ALL ELECTRICAL WORK AND APPLIANCES ARE IN FULL COMPLIANCE WITH N.F.P.A., N.E.C., F.B.C. 6TH EDITION (2017) RESIDENTIAL, AND ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
- VARIOUS SYMBOLS ON ELECTRICAL LEGEND MAY OR MAY NOT BE USED ON THIS PLAN.

ELECTRICAL KEY:

	CEILING MOUNTED LIGHT		FLOOR RECEPTACLE		CHIME		FLUSH MOUNT FLUORESCENT LIGHT
PC	PULL CHAIN LIGHT		PRE-WIRE FOR CLG. FAN		DOOR BELL / GARAGE DOOR SWITCH		FAN / LIGHT COMBINATION
	RECESSED LIGHT	GFI	GROUND FAULT INTERRUPT		DISCONNECT SWITCH		GARBAGE DISPOSAL MOTOR
	WALL MOUNTED LIGHT	S	WALL SWITCH		ELECTRICAL METER		SPEAKER
	WALL WASH RECESSED	$3	3-WAY SWITCH	S.D.	SMOKE DETECTOR		JUNCTION BOX
	DUPLEX RECEPTACLE	$D	DIMMER SWITCH	C.M.S.D.	CARBON MONOXIDE / SMOKE DETECTOR	L.V.	LOW VOLTAGE
	220 V RECEPTACLE		TELEPHONE JACK		CEILING FAN	V.P.	VAPOR PROOF
	1/2 HOT, 1/2 SWITCHED		CABLE JACK		WALL SCONCE	A.F.	ARC FAULT PROTECTION
WP	WATER PROOF RECEPTACLE		PRE-WIRE GARAGE DOOR OPENER		CHANDELIER		
			FLUORESCENT LIGHT		SPOT LIGHT		
			ELECTRICAL PANEL				

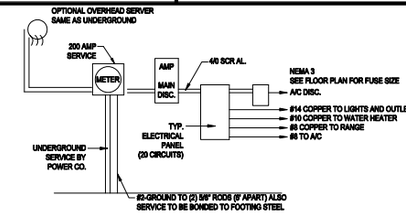

NOTE:
ALL ELECTRICAL WORK AND MATERIAL PROVIDED SHALL COMPLY WITH THE FLORIDA BUILDING CODE. (2017) THE ABOVE ELECTRICAL LAYOUT IS FOR BID PURPOSE ONLY.

200 AMP ELECTRICAL RISER

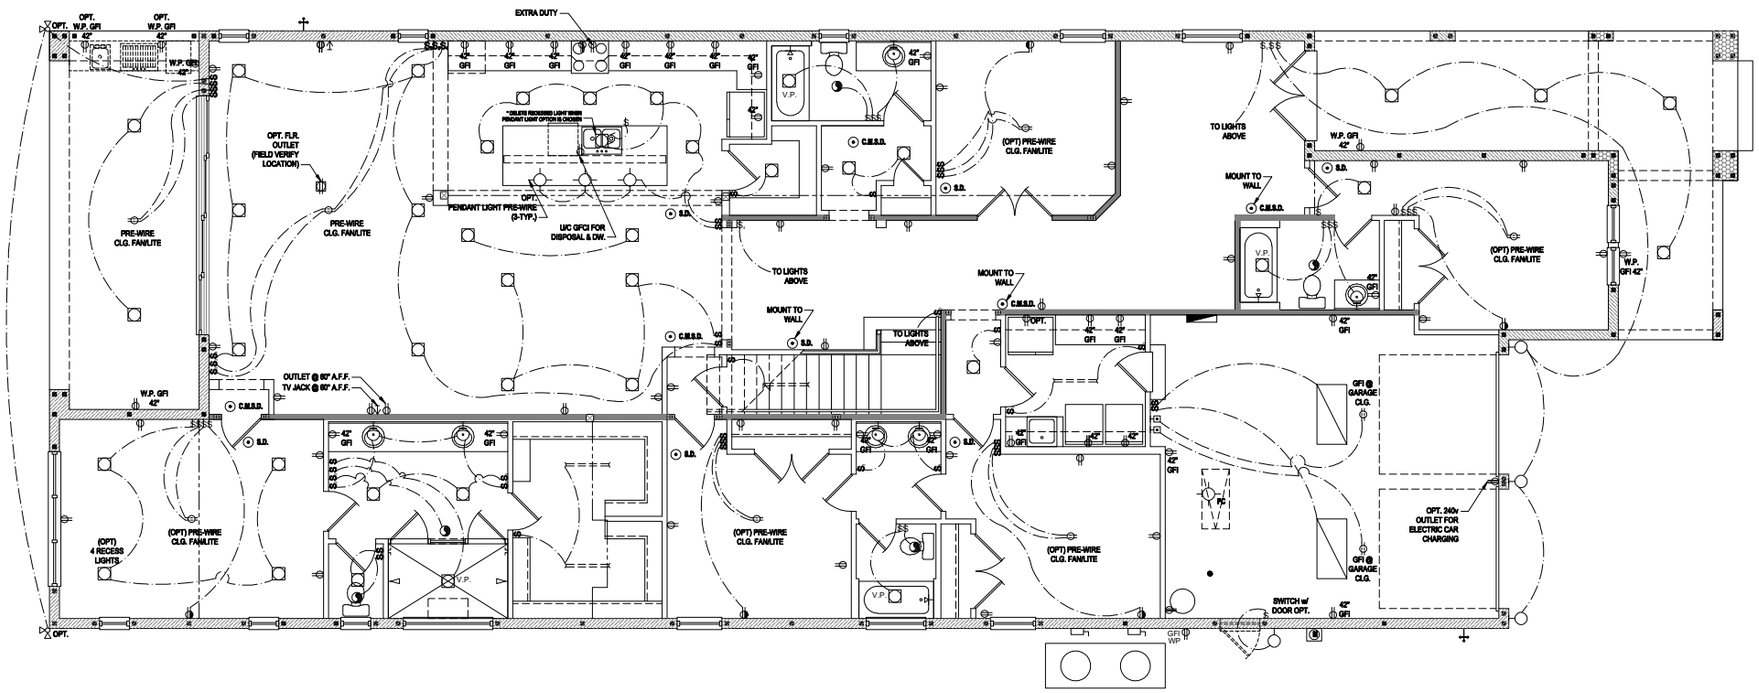

First Floor Electrical Plan "C"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,6:59pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\08.C First Floor Electrical Plan.dwg ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATION OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY M.J.S. INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

MJS 815 Orienta Ave, Suite# 1040 Altamonte Springs, FL. 32701 Ph: (407) 629-6711 Fax: (407) 629-6776
custom home design DESIGNERS - PLANNERS www.mjshomedesigns.com

PREMIER STRUCTURAL ENGINEERING INC. 235 Maitland Avenue S. Suite 108-A Maitland, FL. 32751 Ph: (407) 227-7416 www.premierstructural.com FL. CERT. AUTH: 29113 FL. PE#: 60239

NOTE: DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and M.J.S., Inc. must be notified of any variations from the dimensions and conditions shown on these drawings.

Plans may have been electronically signed & sealed by their licensure, PE, using a digital signature. DO NOT USE a raised seal printed copy of this document are not considered signed & sealed. Signature must be verified on any electronic copies.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELECTRICAL PLAN:
08.C

GENERAL NOTES KEY:

1. BUILDER TO VERIFY EXACT LOCATION OF FLOOR OUTLETS IN FIELD.
2. ALL OUTLETS ARE TO BE AFCI PROTECTED.
3. ALL 15A AND 20A 120V BRANCH CIRCUITS WILL BE AFCI PROTECTED.
4. ALL 15A AND 20A 120V BRANCH CIRCUITS LOCATED IN THE GARAGE AND LAUNDRY WILL BE GFCI PROTECTED.
5. ALL GARAGE BAYS WILL HAVE DEDICATED GFCI OUTLET.
6. ALL OUTLETS LOCATED IN THE KITCHEN AND BATHROOMS ARE TO BE GFCI PROTECTED.
7. DW. AND GARBAGE DISPOSAL ARE TO BE GFCI PROTECTED.
8. EXCEPTIONS TO THE GFCI STIPULATION WILL BE ALLOWED ONLY IF ALLOWED PER CURRENT NFPA / NEC.
9. OUTLETS LOCATED IN THE LAUNDRY ARE TO BE GFCI AND AFCI PROTECTED.
10. OUTLETS LOCATED WITHIN 6'-0" OF A WET AREA ARE TO BE GFCI PROTECTED.
11. ALL OUTLETS OVER COUNTERTOPS TO BE 42" A.F.F. (U.N.O.).
12. ALL SMOKE/CARBON MONOXIDE DETECTORS ARE TO BE HARD WIRED, INTERCONNECTED AND AFCI PROTECTED.
13. 8'-0" HEIGHT VANITY LIGHTS IN MASTER BATHROOM AND 7'-0" IN ALL OTHER BATHROOMS.
14. IN AREAS SPECIFIED IN SECTION E3901.1, 125-VOLT, 15- AND 20-AMPERE RECEPTACLES SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES.

NOTES:

- THIS DIAGRAMMATIC PLAN IS INTENDED TO SHOW LIGHTING AND CONVENIENCE OUTLETS ONLY. IT IS THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO VERIFY THE REQUIREMENT AND LOCATIONS OF ALL ELECTRICAL EQUIPMENT, (INCLUDING KITCHEN EQUIPMENT) AND PROVIDE AND INSTALL COMPLETE ELECTRICAL SERVICE AS REQUIRED PER NFPA, NEC, FBC CODES AND ALL REIGNING MUNICIPALITY CODES, STANDARDS AND ORDINANCES.
- LOCATION OF FIXTURES AND / OR OUTLETS ARE SUGGESTED LOCATIONS AND MEET MOST LOCAL CODE REQUIREMENTS. ADDITIONS OR ADJUSTMENTS MAY BE MADE BETWEEN THE OWNER AND BUILDER IN THE FIELD.
- ALL ELECTRICAL WORK AND APPLIANCES ARE IN FULL COMPLIANCE WITH N.F.P.A., N.E.C., F.B.C. 6TH EDITION (2017) RESIDENTIAL, AND ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
- VARIOUS SYMBOLS ON ELECTRICAL LEGEND MAY OR MAY NOT BE USED ON THIS PLAN.

ELECTRICAL KEY:

	CEILING MOUNTED LIGHT		FLOOR RECEPTACLE		CHIME		FLUSH MOUNT FLUORESCENT LIGHT
	PULL CHAIN LIGHT		PRE-WIRE FOR CLG. FAN		DOOR BELL / GARAGE DOOR SWITCH		FAN / LIGHT COMBINATION
	RECESSED LIGHT		GROUND FAULT INTERRUPT		DISCONNECT SWITCH		GARBAGE DISPOSAL MOTOR
	WALL MOUNTED LIGHT		WALL SWITCH		ELECTRICAL METER		SPEAKER
	WALL WASH RECESSED		3-WAY SWITCH		SMOKE DETECTOR		JUNCTION BOX
	DUPLEX RECEPTACLE		DIMMER SWITCH		CARBON MONOXIDE / SMOKE DETECTOR		LOW VOLTAGE
	220 V RECEPTACLE		TELEPHONE JACK		CEILING FAN		VAPOR PROOF
	1/2 HOT, 1/2 SWITCHED		CABLE JACK		WALL SCONCE		ARC FAULT PROTECTION
	WATER PROOF RECEPTACLE		PRE-WIRE GARAGE DOOR OPENER		CHANDELIER		
			FLUORESCENT LIGHT		SPOT LIGHT		
			ELECTRICAL PANEL				

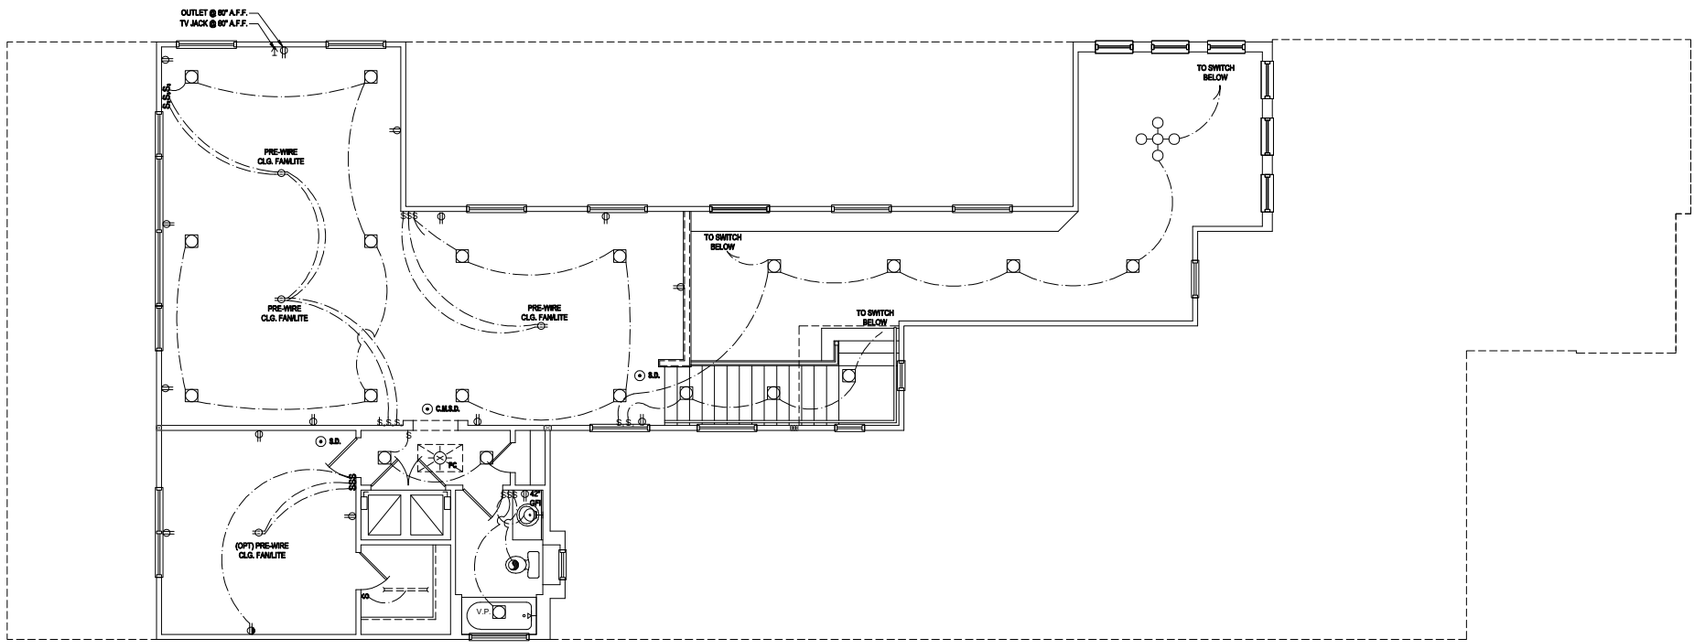

Second Floor Electrical Plan "A"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,6:59pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\09.A Second Floor Electrical Plan.dwg

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

THE PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS custom home design DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER ARCHITECTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

NOTE:TO DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS.
Contractor shall verify and be responsible for dimensions and conditions of the job and M.J.S., Inc. must be notified of any variations from the dimensions and conditions shown on this drawing before ordering or proceeding with any work affected by such variations.

When plans have been electronically signed & sealed by Chad Rodgers, PE, using a digital signature, it is a valid and printed copy of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELECTRICAL PLAN:
09.A

GENERAL NOTES KEY:

1. BUILDER TO VERIFY EXACT LOCATION OF FLOOR OUTLETS IN FIELD.
2. ALL OUTLETS ARE TO BE AFCI PROTECTED.
3. ALL 15A AND 20A 120V BRANCH CIRCUITS WILL BE AFCI PROTECTED.
4. ALL 15A AND 20A 120V BRANCH CIRCUITS LOCATED IN THE GARAGE AND LAUNDRY WILL BE GFCI PROTECTED.
5. ALL GARAGE BAYS WILL HAVE DEDICATED GFCI OUTLET.
6. ALL OUTLETS LOCATED IN THE KITCHEN AND BATHROOMS ARE TO BE GFCI PROTECTED.
7. DW. AND GARBAGE DISPOSAL ARE TO BE GFCI PROTECTED.
8. EXCEPTIONS TO THE GFCI STIPULATION WILL BE ALLOWED ONLY IF ALLOWED PER CURRENT NFPA / NEC.
9. OUTLETS LOCATED IN THE LAUNDRY ARE TO BE GFCI AND AFCI PROTECTED.
10. OUTLETS LOCATED WITHIN 6'-0" OF A WET AREA ARE TO BE GFCI PROTECTED.
11. ALL OUTLETS OVER COUNTERTOPS TO BE 42" A.F.F. (U.N.O.).
12. ALL SMOKE/CARBON MONOXIDE DETECTORS ARE TO BE HARD WIRED, INTERCONNECTED AND AFCI PROTECTED.
13. 8'-0" HEIGHT VANITY LIGHTS IN MASTER BATHROOM AND 7'-0" IN ALL OTHER BATHROOMS.
14. IN AREAS SPECIFIED IN SECTION E3901.1, 125-VOLT, 15- AND 20-AMPERE RECEPTACLES SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES.

NOTES:

- THIS DIAGRAMMATIC PLAN IS INTENDED TO SHOW LIGHTING AND CONVENIENCE OUTLETS ONLY. IT IS THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO VERIFY THE REQUIREMENT AND LOCATIONS OF ALL ELECTRICAL EQUIPMENT, (INCLUDING KITCHEN EQUIPMENT) AND PROVIDE AND INSTALL COMPLETE ELECTRICAL SERVICE AS REQUIRED PER NFPA, NEC, FBC CODES AND ALL REIGNING MUNICIPALITY CODES, STANDARDS AND ORDINANCES.
- LOCATION OF FIXTURES AND / OR OUTLETS ARE SUGGESTED LOCATIONS AND MEET MOST LOCAL CODE REQUIREMENTS. ADDITIONS OR ADJUSTMENTS MAY BE MADE BETWEEN THE OWNER AND BUILDER IN THE FIELD.
- ALL ELECTRICAL WORK AND APPLIANCES ARE IN FULL COMPLIANCE WITH N.F.P.A., N.E.C., F.B.C. 6TH EDITION (2017) RESIDENTIAL, AND ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
- VARIOUS SYMBOLS ON ELECTRICAL LEGEND MAY OR MAY NOT BE USED ON THIS PLAN.

ELECTRICAL KEY:

	CEILING MOUNTED LIGHT		FLOOR RECEPTACLE		CHIME		FLUSH MOUNT FLUORESCENT LIGHT
	PULL CHAIN LIGHT		PRE-WIRE FOR CLG. FAN		DOOR BELL / GARAGE DOOR SWITCH		FAN / LIGHT COMBINATION
PC		GFI	GROUND FAULT INTERRUPT		DISCONNECT SWITCH		GARBAGE DISPOSAL MOTOR
	RECESSED LIGHT		WALL SWITCH		ELECTRICAL METER		SPEAKER
	WALL MOUNTED LIGHT	3	3-WAY SWITCH	S.D.	SMOKE DETECTOR		JUNCTION BOX
	WALL WASH RECESSED	D	DIMMER SWITCH	C.M.S.D.	CARBON MONOXIDE / SMOKE DETECTOR	L.V.	LOW VOLTAGE
	DUPLEX RECEPTACLE		TELEPHONE JACK		CEILING FAN	V.P.	VAPOR PROOF
	220 V RECEPTACLE		CABLE JACK			A.F.	ARC FAULT PROTECTION
	1/2 HOT, 1/2 SWITCHED		PRE-WIRE GARAGE DOOR OPENER		WALL SCONCE		
WP	WATER PROOF RECEPTACLE		FLUORESCENT LIGHT		CHANDELIER		
			ELECTRICAL PANEL		SPOT LIGHT		

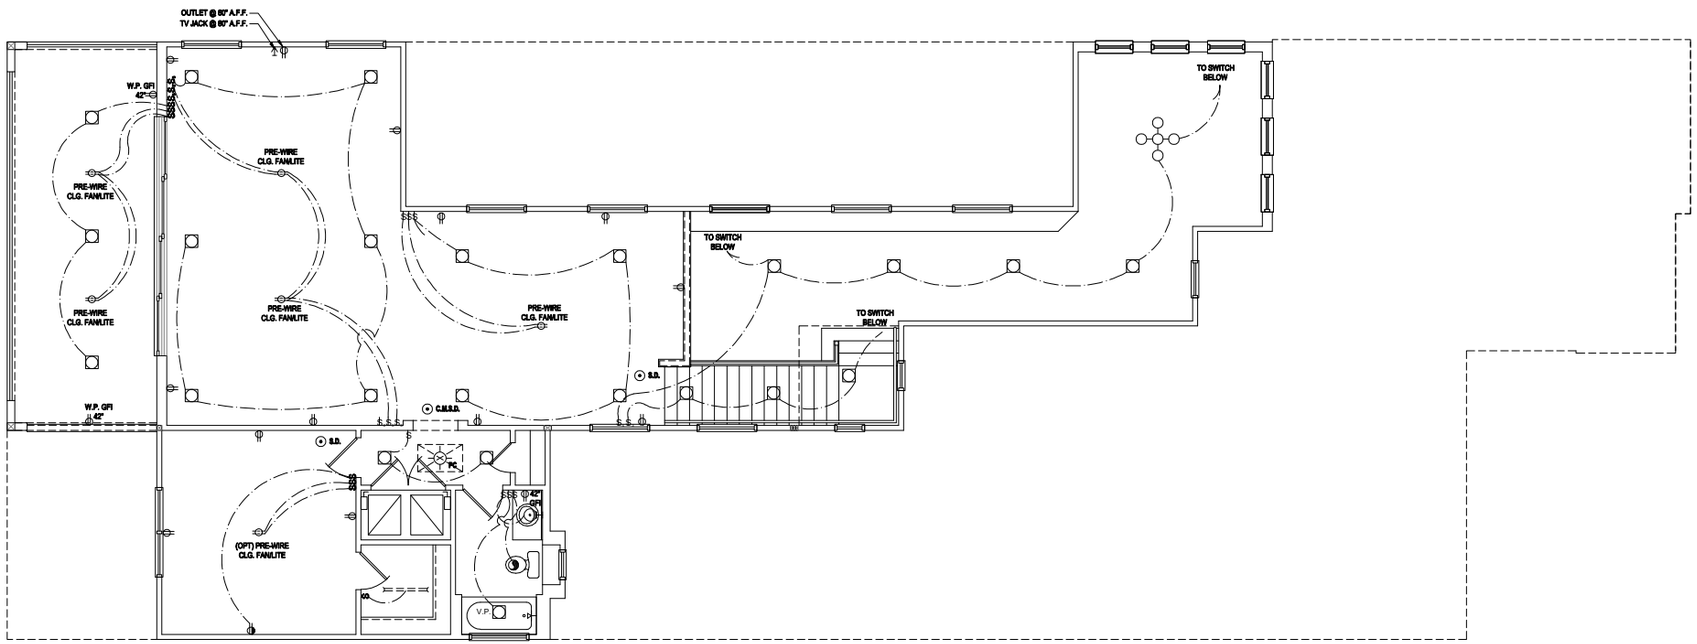

Second Floor Electrical Plan "A"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS DESIGN GROUP
custom home design
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER STRUCTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

NOTE!!! DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and ALL plans must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

Your plans have been electronically signed & sealed by Noel Rodriguez, PE. Little is digital signature. DO is sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELECTRICAL PLAN

09.A1

May 21, 2019,6:59pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\09.A1 Second Floor Electrical Plan (Opt. Balcony).dwg

GENERAL NOTES KEY:

1. BUILDER TO VERIFY EXACT LOCATION OF FLOOR OUTLETS IN FIELD.
2. ALL OUTLETS ARE TO BE AFCI PROTECTED.
3. ALL 15A AND 20A 120V BRANCH CIRCUITS WILL BE AFCI PROTECTED.
4. ALL 15A AND 20A 120V BRANCH CIRCUITS LOCATED IN THE GARAGE AND LAUNDRY WILL BE GFCI PROTECTED.
5. ALL GARAGE BAYS WILL HAVE DEDICATED GFCI OUTLET.
6. ALL OUTLETS LOCATED IN THE KITCHEN AND BATHROOMS ARE TO BE GFCI PROTECTED.
7. DW. AND GARBAGE DISPOSAL ARE TO BE GFCI PROTECTED.
8. EXCEPTIONS TO THE GFCI STIPULATION WILL BE ALLOWED ONLY IF ALLOWED PER CURRENT NFPA / NEC.
9. OUTLETS LOCATED IN THE LAUNDRY ARE TO BE GFCI AND AFCI PROTECTED.
10. OUTLETS LOCATED WITHIN 6'-0" OF A WET AREA ARE TO BE GFCI PROTECTED.
11. ALL OUTLETS OVER COUNTERTOPS TO BE 42" A.F.F. (U.N.O.).
12. ALL SMOKE/CARBON MONOXIDE DETECTORS ARE TO BE HARD WIRED, INTERCONNECTED AND AFCI PROTECTED.
13. 8'-0" HEIGHT VANITY LIGHTS IN MASTER BATHROOM AND 7'-0" IN ALL OTHER BATHROOMS.
14. IN AREAS SPECIFIED IN SECTION E3901.1, 125-VOLT, 15- AND 20-AMPERE RECEPTACLES SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES.

NOTES:

- THIS DIAGRAMMATIC PLAN IS INTENDED TO SHOW LIGHTING AND CONVENIENCE OUTLETS ONLY. IT IS THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO VERIFY THE REQUIREMENT AND LOCATIONS OF ALL ELECTRICAL EQUIPMENT, (INCLUDING KITCHEN EQUIPMENT) AND PROVIDE AND INSTALL COMPLETE ELECTRICAL SERVICE AS REQUIRED PER NFPA, NEC, FBC CODES AND ALL REIGNING MUNICIPALITY CODES, STANDARDS AND ORDINANCES.
- LOCATION OF FIXTURES AND / OR OUTLETS ARE SUGGESTED LOCATIONS AND MEET MOST LOCAL CODE REQUIREMENTS. ADDITIONS OR ADJUSTMENTS MAY BE MADE BETWEEN THE OWNER AND BUILDER IN THE FIELD.
- ALL ELECTRICAL WORK AND APPLIANCES ARE IN FULL COMPLIANCE WITH N.F.P.A., N.E.C., F.B.C. 6TH EDITION (2017) RESIDENTIAL, AND ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
- VARIOUS SYMBOLS ON ELECTRICAL LEGEND MAY OR MAY NOT BE USED ON THIS PLAN.

ELECTRICAL KEY:

	CEILING MOUNTED LIGHT		FLOOR RECEPTACLE		CHIME		FLUSH MOUNT FLUORESCENT LIGHT
	PULL CHAIN LIGHT	PC	PRE-WIRE FOR CLG. FAN		DOOR BELL / GARAGE DOOR SWITCH		FAN / LIGHT COMBINATION
		GFI	GROUND FAULT INTERRUPT		DISCONNECT SWITCH		GARBAGE DISPOSAL MOTOR
	RECESSED LIGHT		WALL SWITCH		ELECTRICAL METER		SPEAKER
	WALL MOUNTED LIGHT		3-WAY SWITCH	S.D.	SMOKE DETECTOR		JUNCTION BOX
	WALL WASH RECESSED		DIMMER SWITCH	C.M.S.D.	CARBON MONOXIDE / SMOKE DETECTOR	L.V.	LOW VOLTAGE
	DUPLEX RECEPTACLE		TELEPHONE JACK		CEILING FAN	V.P.	VAPOR PROOF
	220 V RECEPTACLE		CABLE JACK			A.F.	ARC FAULT PROTECTION
	1/2 HOT, 1/2 SWITCHED		PRE-WIRE GARAGE DOOR OPENER		WALL SCONCE		
			FLUORESCENT LIGHT		CHANDELIER		
	WATER PROOF RECEPTACLE		ELECTRICAL PANEL		SPOT LIGHT		

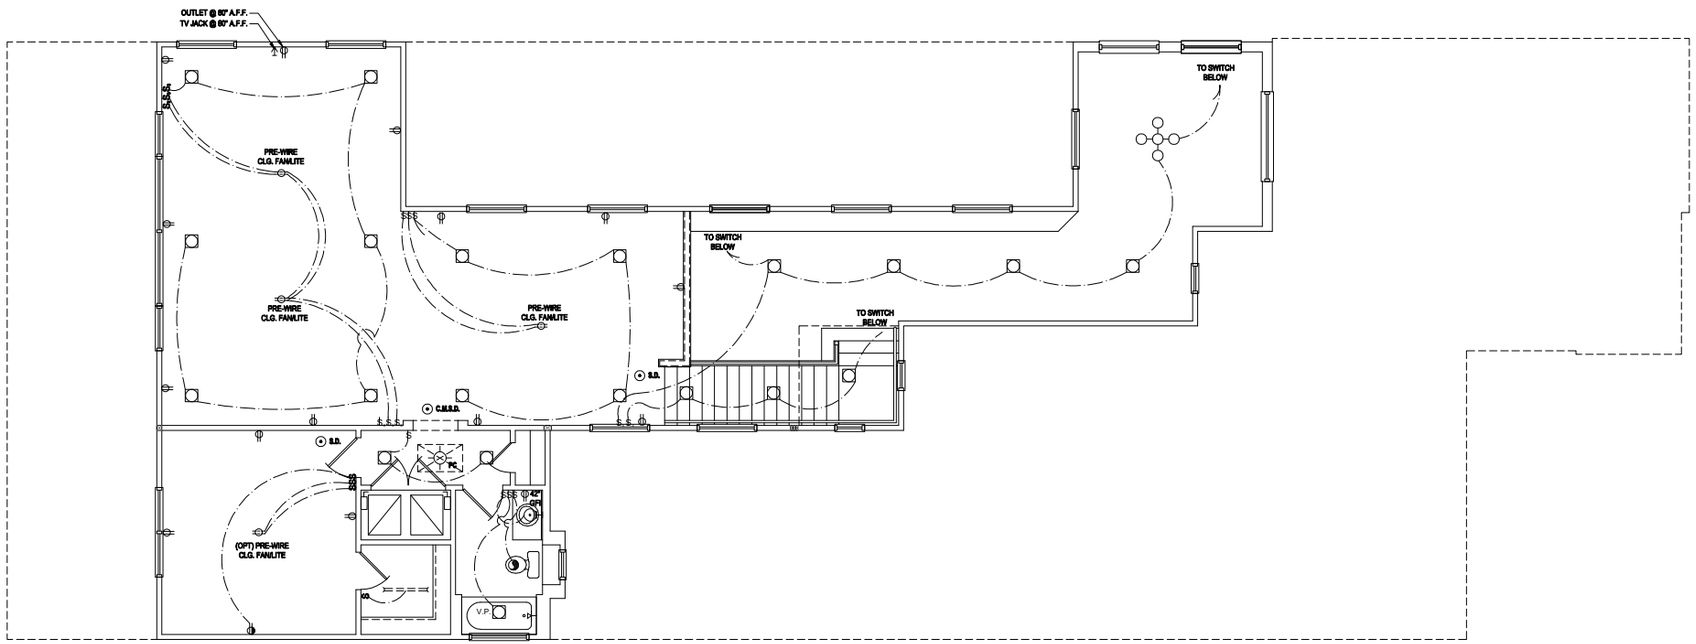

Second Floor Electrical Plan "B"

(Opt. Second Floor)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS custom home design
DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER STRUCTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

MEETER DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS.
Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions and conditions shown on these drawings.

Your plans have been electronically signed & sealed by Noel Rodriguez, PE. Little is digital signature. DO is sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELECTRICAL PLAN

09.B

May 21, 2019,6:59pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\09.B Second Floor Electrical Plan.dwg

GENERAL NOTES KEY:

1. BUILDER TO VERIFY EXACT LOCATION OF FLOOR OUTLETS IN FIELD.
2. ALL OUTLETS ARE TO BE AFCI PROTECTED.
3. ALL 15A AND 20A 120V BRANCH CIRCUITS WILL BE AFCI PROTECTED.
4. ALL 15A AND 20A 120V BRANCH CIRCUITS LOCATED IN THE GARAGE AND LAUNDRY WILL BE GFCI PROTECTED.
5. ALL GARAGE BAYS WILL HAVE DEDICATED GFCI OUTLET.
6. ALL OUTLETS LOCATED IN THE KITCHEN AND BATHROOMS ARE TO BE GFCI PROTECTED.
7. DW. AND GARBAGE DISPOSAL ARE TO BE GFCI PROTECTED.
8. EXCEPTIONS TO THE GFCI STIPULATION WILL BE ALLOWED ONLY IF ALLOWED PER CURRENT NFPA / NEC.
9. OUTLETS LOCATED IN THE LAUNDRY ARE TO BE GFCI AND AFCI PROTECTED.
10. OUTLETS LOCATED WITHIN 6'-0" OF A WET AREA ARE TO BE GFCI PROTECTED.
11. ALL OUTLETS OVER COUNTERTOPS TO BE 42" A.F.F. (U.N.O.).
12. ALL SMOKE/CARBON MONOXIDE DETECTORS ARE TO BE HARD WIRED, INTERCONNECTED AND AFCI PROTECTED.
13. 8'-0" HEIGHT VANITY LIGHTS IN MASTER BATHROOM AND 7'-0" IN ALL OTHER BATHROOMS.
14. IN AREAS SPECIFIED IN SECTION E3901.1, 125-VOLT, 15- AND 20-AMPERE RECEPTACLES SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES.

NOTES:

- THIS DIAGRAMMATIC PLAN IS INTENDED TO SHOW LIGHTING AND CONVENIENCE OUTLETS ONLY. IT IS THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO VERIFY THE REQUIREMENT AND LOCATIONS OF ALL ELECTRICAL EQUIPMENT, (INCLUDING KITCHEN EQUIPMENT) AND PROVIDE AND INSTALL COMPLETE ELECTRICAL SERVICE AS REQUIRED PER NFPA, NEC, FBC CODES AND ALL REIGNING MUNICIPALITY CODES, STANDARDS AND ORDINANCES.
- LOCATION OF FIXTURES AND / OR OUTLETS ARE SUGGESTED LOCATIONS AND MEET MOST LOCAL CODE REQUIREMENTS. ADDITIONS OR ADJUSTMENTS MAY BE MADE BETWEEN THE OWNER AND BUILDER IN THE FIELD.
- ALL ELECTRICAL WORK AND APPLIANCES ARE IN FULL COMPLIANCE WITH N.F.P.A., N.E.C., F.B.C. 6TH EDITION (2017) RESIDENTIAL, AND ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
- VARIOUS SYMBOLS ON ELECTRICAL LEGEND MAY OR MAY NOT BE USED ON THIS PLAN.

ELECTRICAL KEY:

	CEILING MOUNTED LIGHT		FLOOR RECEPTACLE		CHIME		FLUSH MOUNT FLUORESCENT LIGHT
PC	PULL CHAIN LIGHT		PRE-WIRE FOR CLG. FAN		DOOR BELL / GARAGE DOOR SWITCH		FAN / LIGHT COMBINATION
		GFI	GROUND FAULT INTERRUPT		DISCONNECT SWITCH		GARBAGE DISPOSAL MOTOR
	RECESSED LIGHT	$	WALL SWITCH		ELECTRICAL METER		SPEAKER
	WALL MOUNTED LIGHT	$3	3-WAY SWITCH	S.D.	SMOKE DETECTOR		JUNCTION BOX
	WALL WASH RECESSED	$D	DIMMER SWITCH	C.M.S.D.	CARBON MONOXIDE / SMOKE DETECTOR	L.V.	LOW VOLTAGE
	DUPLEX RECEPTACLE		TELEPHONE JACK		CEILING FAN	V.P.	VAPOR PROOF
	220 V RECEPTACLE		CABLE JACK			A.F.	ARC FAULT PROTECTION
	1/2 HOT, 1/2 SWITCHED		PRE-WIRE GARAGE DOOR OPENER		WALL SCONCE		
WP	WATER PROOF RECEPTACLE		FLUORESCENT LIGHT		CHANDELIER		
			ELECTRICAL PANEL		SPOT LIGHT		

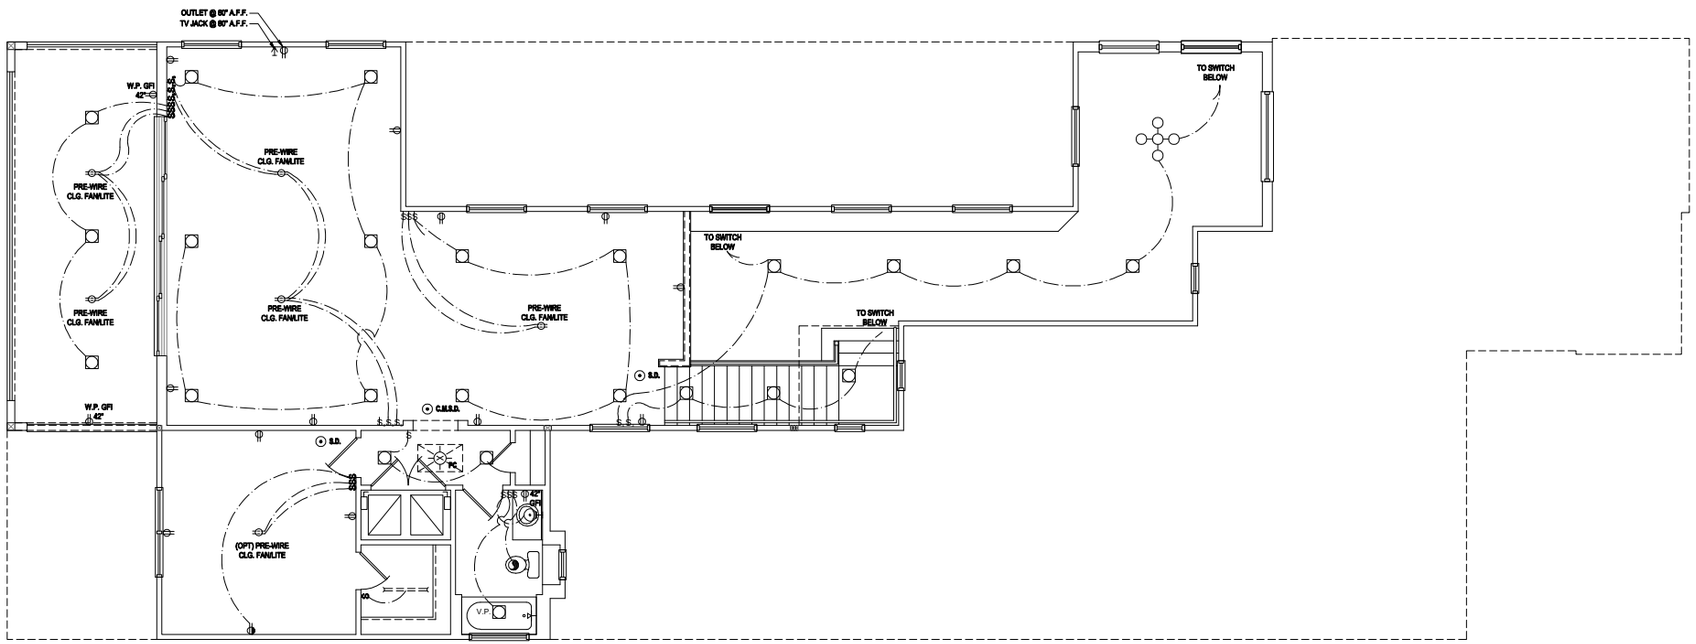

Second Floor Electrical Plan "B"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS DESIGN GROUP
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
custom home design
DESIGN-BUILD - PLANNING

PREMIER STRUCTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

NOTE: DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions and conditions shown on these drawings.

Your plans have been electronically signed & sealed by Noel Rodriguez, PE. Little is digital signature. DO a sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELECTRICAL PLAN

09.B1

May 21, 2019,6:59pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\09.B1 Second Floor Electrical Plan (Opt. Balcony).dwg THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

GENERAL NOTES KEY:

1. BUILDER TO VERIFY EXACT LOCATION OF FLOOR OUTLETS IN FIELD.
2. ALL OUTLETS ARE TO BE AFCI PROTECTED.
3. ALL 15A AND 20A 120V BRANCH CIRCUITS WILL BE AFCI PROTECTED.
4. ALL 15A AND 20A 120V BRANCH CIRCUITS LOCATED IN THE GARAGE AND LAUNDRY WILL BE GFCI PROTECTED.
5. ALL GARAGE BAYS WILL HAVE DEDICATED GFCI OUTLET.
6. ALL OUTLETS LOCATED IN THE KITCHEN AND BATHROOMS ARE TO BE GFCI PROTECTED.
7. DW. AND GARBAGE DISPOSAL ARE TO BE GFCI PROTECTED.
8. EXCEPTIONS TO THE GFCI STIPULATION WILL BE ALLOWED ONLY IF ALLOWED PER CURRENT NFPA / NEC.
9. OUTLETS LOCATED IN THE LAUNDRY ARE TO BE GFCI AND AFCI PROTECTED.
10. OUTLETS LOCATED WITHIN 6'-0" OF A WET AREA ARE TO BE GFCI PROTECTED.
11. ALL OUTLETS OVER COUNTERTOPS TO BE 42" A.F.F. (U.N.O.).
12. ALL SMOKE/CARBON MONOXIDE DETECTORS ARE TO BE HARD WIRED, INTERCONNECTED AND AFCI PROTECTED.
13. 8'-0" HEIGHT VANITY LIGHTS IN MASTER BATHROOM AND 7'-0" IN ALL OTHER BATHROOMS.
14. IN AREAS SPECIFIED IN SECTION E3901.1, 125-VOLT, 15- AND 20-AMPERE RECEPTACLES SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES.

NOTES:

- THIS DIAGRAMMATIC PLAN IS INTENDED TO SHOW LIGHTING AND CONVENIENCE OUTLETS ONLY. IT IS THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO VERIFY THE REQUIREMENT AND LOCATIONS OF ALL ELECTRICAL EQUIPMENT, (INCLUDING KITCHEN EQUIPMENT) AND PROVIDE AND INSTALL COMPLETE ELECTRICAL SERVICE AS REQUIRED PER NFPA, NEC, FBC CODES AND ALL REIGNING MUNICIPALITY CODES, STANDARDS AND ORDINANCES.
- LOCATION OF FIXTURES AND / OR OUTLETS ARE SUGGESTED LOCATIONS AND MEET MOST LOCAL CODE REQUIREMENTS. ADDITIONS OR ADJUSTMENTS MAY BE MADE BETWEEN THE OWNER AND BUILDER IN THE FIELD.
- ALL ELECTRICAL WORK AND APPLIANCES ARE IN FULL COMPLIANCE WITH N.F.P.A., N.E.C., F.B.C. 6TH EDITION (2017) RESIDENTIAL, AND ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
- VARIOUS SYMBOLS ON ELECTRICAL LEGEND MAY OR MAY NOT BE USED ON THIS PLAN.

ELECTRICAL KEY:

	CEILING MOUNTED LIGHT		FLOOR RECEPTACLE		CHIME		FLUSH MOUNT FLUORESCENT LIGHT
			PRE-WIRE FOR CLG. FAN		DOOR BELL / GARAGE DOOR SWITCH		FAN / LIGHT COMBINATION
PC	PULL CHAIN LIGHT	GFI	GROUND FAULT INTERRUPT		DISCONNECT SWITCH		GARBAGE DISPOSAL MOTOR
			WALL SWITCH		ELECTRICAL METER		SPEAKER
	RECESSED LIGHT	3	3-WAY SWITCH	S.D.	SMOKE DETECTOR		JUNCTION BOX
	WALL MOUNTED LIGHT	D	DIMMER SWITCH	C.M.S.D.	CARBON MONOXIDE / SMOKE DETECTOR	L.V.	LOW VOLTAGE
	WALL WASH RECESSED		TELEPHONE JACK		CEILING FAN	V.P.	VAPOR PROOF
	DUPLEX RECEPTACLE		CABLE JACK			A.F.	ARC FAULT PROTECTION
	220 V RECEPTACLE		PRE-WIRE GARAGE DOOR OPENER		WALL SCONCE		
	1/2 HOT, 1/2 SWITCHED		FLUORESCENT LIGHT		CHANDELIER		
WP	WATER PROOF RECEPTACLE		ELECTRICAL PANEL		SPOT LIGHT		

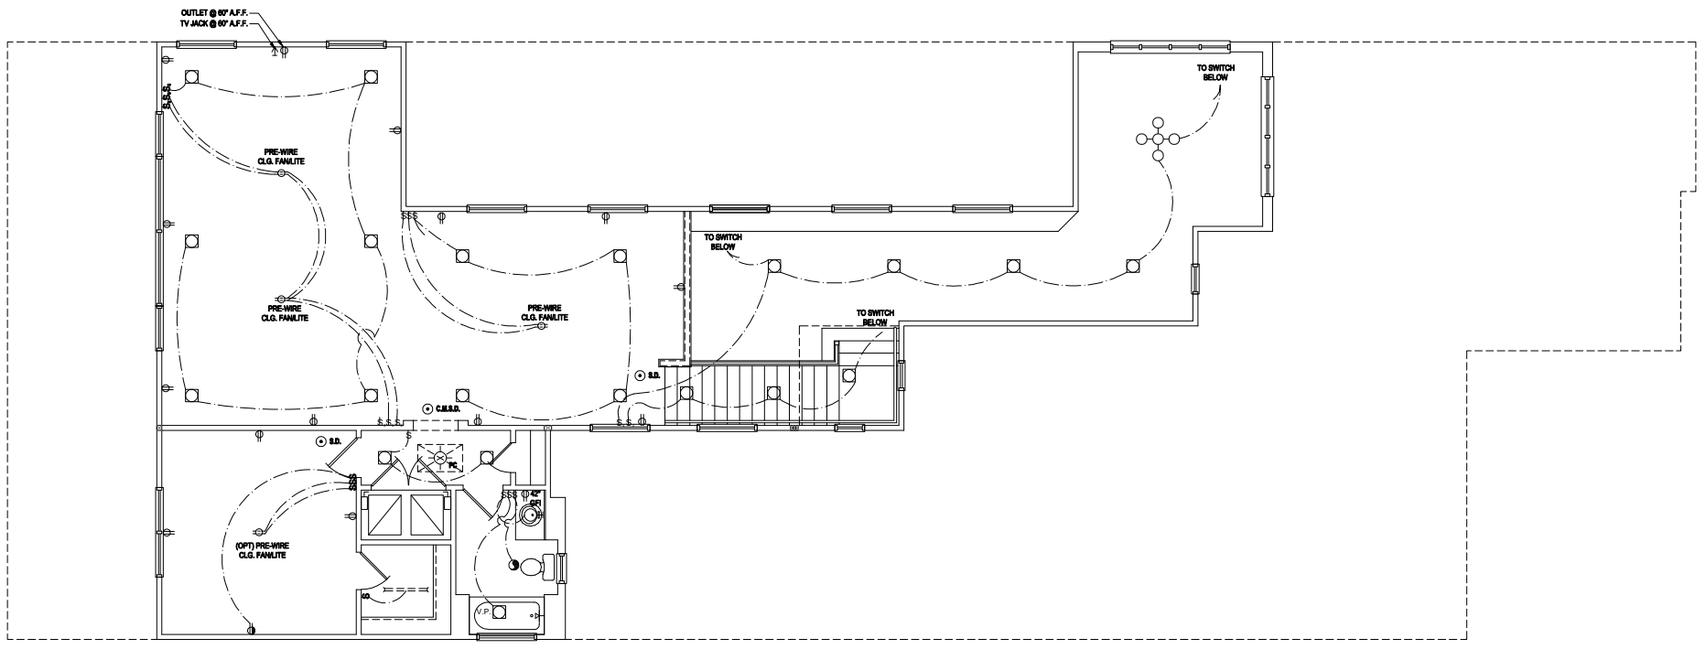

Second Floor Electrical Plan "C"

(Standard)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

PARK SQUARE HOMES

MJS custom home design
DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER STRUCTURAL ENGINEERING
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

NOTE!!! DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and M.J.S., Inc. must be notified of any variations from dimensions and conditions shown on these drawings before proceeding with any construction.

Your plans have been electronically signed & sealed by Noel Rodriguez, PE, using a digital signature. DO a sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELECTRICAL PLAN:
09.C

May 21, 2018,6:59pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\09.C Second Floor Electrical Plan.dwg

GENERAL NOTES KEY:

1. BUILDER TO VERIFY EXACT LOCATION OF FLOOR OUTLETS IN FIELD.
2. ALL OUTLETS ARE TO BE AFCI PROTECTED.
3. ALL 15A AND 20A 120V BRANCH CIRCUITS WILL BE AFCI PROTECTED.
4. ALL 15A AND 20A 120V BRANCH CIRCUITS LOCATED IN THE GARAGE AND LAUNDRY WILL BE GFCI PROTECTED.
5. ALL GARAGE BAYS WILL HAVE DEDICATED GFCI OUTLET.
6. ALL OUTLETS LOCATED IN THE KITCHEN AND BATHROOMS ARE TO BE GFCI PROTECTED.
7. DW. AND GARBAGE DISPOSAL ARE TO BE GFCI PROTECTED.
8. EXCEPTIONS TO THE GFCI STIPULATION WILL BE ALLOWED ONLY IF ALLOWED PER CURRENT NFPA / NEC.
9. OUTLETS LOCATED IN THE LAUNDRY ARE TO BE GFCI AND AFCI PROTECTED.
10. OUTLETS LOCATED WITHIN 6'-0" OF A WET AREA ARE TO BE GFCI PROTECTED.
11. ALL OUTLETS OVER COUNTERTOPS TO BE 42" A.F.F. (U.N.O.).
12. ALL SMOKE/CARBON MONOXIDE DETECTORS ARE TO BE HARD WIRED, INTERCONNECTED AND AFCI PROTECTED.
13. 8'-0" HEIGHT VANITY LIGHTS IN MASTER BATHROOM AND 7'-0" IN ALL OTHER BATHROOMS.
14. IN AREAS SPECIFIED IN SECTION E3901.1, 125-VOLT, 15- AND 20-AMPERE RECEPTACLES SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES.

NOTES:

- THIS DIAGRAMMATIC PLAN IS INTENDED TO SHOW LIGHTING AND CONVENIENCE OUTLETS ONLY. IT IS THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO VERIFY THE REQUIREMENT AND LOCATIONS OF ALL ELECTRICAL EQUIPMENT, (INCLUDING KITCHEN EQUIPMENT) AND PROVIDE AND INSTALL COMPLETE ELECTRICAL SERVICE AS REQUIRED PER NFPA, NEC, FBC CODES AND ALL REIGNING MUNICIPALITY CODES, STANDARDS AND ORDINANCES.
- LOCATION OF FIXTURES AND / OR OUTLETS ARE SUGGESTED LOCATIONS AND MEET MOST LOCAL CODE REQUIREMENTS. ADDITIONS OR ADJUSTMENTS MAY BE MADE BETWEEN THE OWNER AND BUILDER IN THE FIELD.
- ALL ELECTRICAL WORK AND APPLIANCES ARE IN FULL COMPLIANCE WITH N.F.P.A., N.E.C., F.B.C. 6TH EDITION (2017) RESIDENTIAL, AND ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
- VARIOUS SYMBOLS ON ELECTRICAL LEGEND MAY OR MAY NOT BE USED ON THIS PLAN.

ELECTRICAL KEY:

	CEILING MOUNTED LIGHT		FLOOR RECEPTACLE		CHIME		FLUSH MOUNT FLUORESCENT LIGHT
PC	PULL CHAIN LIGHT		PRE-WIRE FOR CLG. FAN		DOOR BELL / GARAGE DOOR SWITCH		FAN / LIGHT COMBINATION
	RECESSED LIGHT	GFI	GROUND FAULT INTERRUPT		DISCONNECT SWITCH		GARBAGE DISPOSAL MOTOR
	WALL MOUNTED LIGHT	$	WALL SWITCH		ELECTRICAL METER		SPEAKER
	WALL WASH RECESSED	$3	3-WAY SWITCH	S.D.	SMOKE DETECTOR	J	JUNCTION BOX
	DUPLEX RECEPTACLE	$D	DIMMER SWITCH	C.M.S.D.	CARBON MONOXIDE / SMOKE DETECTOR	L.V.	LOW VOLTAGE
	220 V RECEPTACLE		TELEPHONE JACK		CEILING FAN	V.P.	VAPOR PROOF
	1/2 HOT, 1/2 SWITCHED		CABLE JACK		WALL SCONCE	A.F.	ARC FAULT PROTECTION
WP	WATER PROOF RECEPTACLE		PRE-WIRE GARAGE DOOR OPENER		CHANDELIER		
			FLUORESCENT LIGHT		SPOT LIGHT		
			ELECTRICAL PANEL				

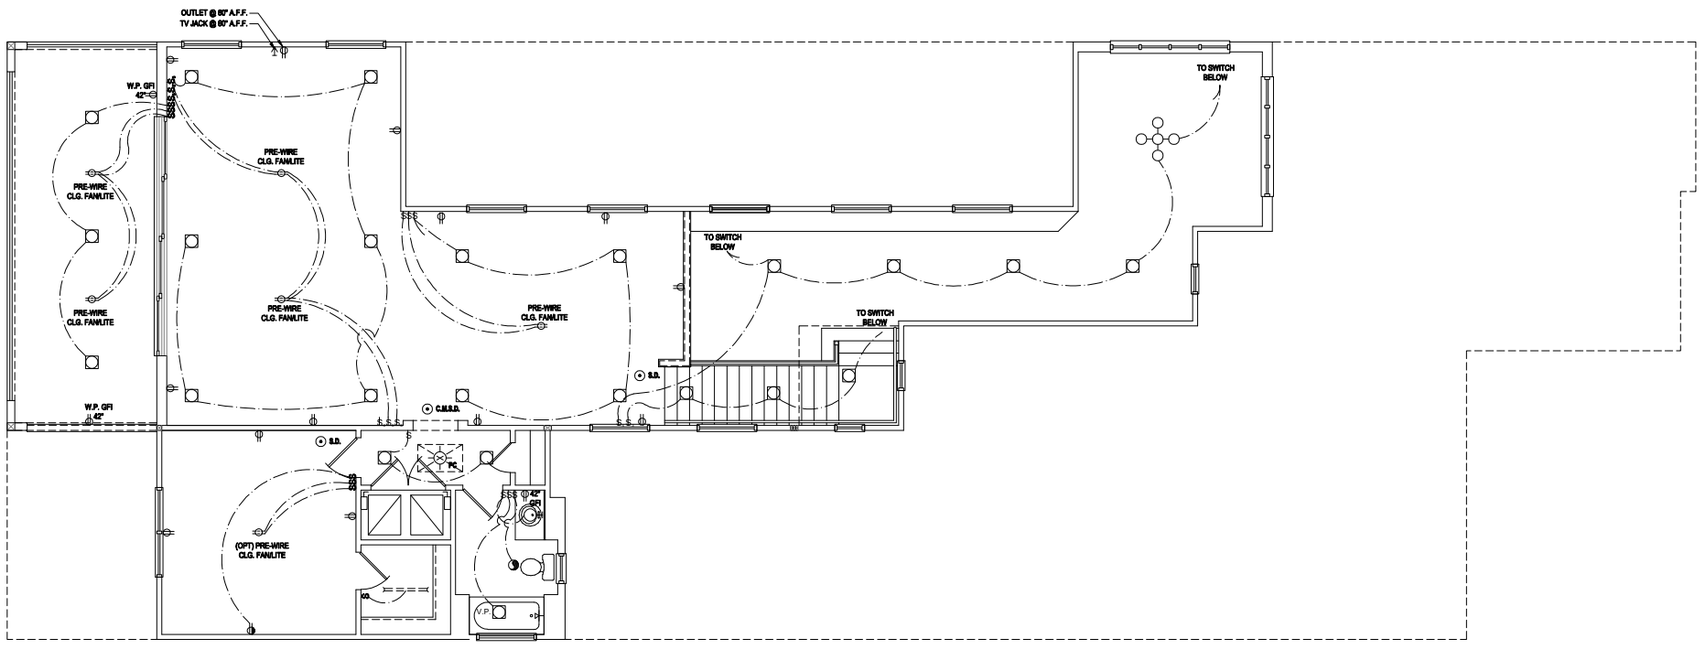

Second Floor Electrical Plan "C"

(Opt. Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

custom home design
DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

MJS

NOTE: DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions and conditions shown on these drawings. Signature must be verified on all electronic codes.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premier-structural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

PREMIER STRUCTURAL ENGINEERING INC.

Your plans have been electronically signed & sealed by Noel Rodriguez, PE, using a digital signature. ILO a raised seal printed copy of this document are not considered Signed & Sealed.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

ELECTRICAL PLAN

09.C1

May 21, 2019,6:59pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\09.C1 Second Floor Electrical Plan (Opt. Balcony).dwg THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

SAFE GRAVITY LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	8U8	8F8-08 / 8F8-18	8F12-08 / 8F12-18	8F16-08 / 8F16-18	8F20-08 / 8F20-18	8F24-08 / 8F24-18	8F28-08 / 8F28-18	8F32-08 / 8F32-18
			SAFE LOAD - POUNDS PER LINEAR FOOT						
3'-6" (42") PRECAST	2231		3069	3719	5163	6607	8054	9502	10951
			3069	4605	6113	7547	8974	10394	11809
4'-0" (48") PRECAST	1966		2561	2751	3820	4890	5961	7034	8107
			2693	4605	6113	7547	8974	10394	11809
4'-6" (54") PRECAST	1599		1969	2110	2931	3753	4576	5400	6224
			2189	4375	6113	7547 (#)	8972	10294	11809
5'-4" (64") PRECAST	1217		1349	1438	1999	2560	3123	3686	4249
			1463	3090	5365	7547 (#)	7342 (#)	8733 (#)	10127 (#)
5'-10" (70") PRECAST	1062		1105	1173	1631	2090	2549	3009	3470
			1451	2822	4360	7168 (#)	6536 (#)	7181 (#)	8328 (#)
6'-6" (78") PRECAST	908		1238	2177	3480	3031	3707	4383	5061
			1238	2177	3480	5381	6360	7339 (#)	8325 (#)
7'-6" (90") PRECAST	743		1011	1729	2632	2205	2698	3191	3685
			1011	1729	2661	3898	5681	6467 (#)	6472 (#)
9'-4" (112") PRECAST	554		899	1160	1425	2564	3486	2818	3302
			752	1245	1843	2564	3486	4705 (#)	6390 (#)
10'-6" (126") PRECAST	475		535	890	1247	2083	2777	2163	2536
			643	1052	1533	2083	2781	3643 (#)	4754 (#)
11'-4" (136") PRECAST	362		582	945	1366	1846	2423	3127	4006
			582	945	1366	1846	2423	3127	4006
12'-0" (144") PRECAST	337		540	873	1254	1684	2193	2805	3552
			540	873	1254	1684	2193	2805	3552
13'-4" (160") PRECAST	296		471	765	1075	1428	1838	2316	2883
			471	765	1075	1428	1838	2316	2883
14'-0" (168") PRECAST	279		424	706	1002	1326	1697	2127	2630
			442	706	1002	1326	1697	2127	2630
14'-8" (176") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			458	783	1370	1902	2245	2517	2712
15'-4" (184") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			412	710	1250	1733	2058	2320	2513
17'-4" (208") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			300	548	950	1326	1609	1849	2047
19'-4" (232") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			235	428	750	1037	1282	1515	1714
21'-4" (256") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			180	340	598	840	1114	1338	1468
22'-0" (264") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			165	315	550	784	1047	1285	1399
24'-0" (288") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			129	250	450	654	884	1092	1222

(#) THE NUMBERS IN PARENTHESIS ARE PERCENT REDUCTIONS FOR GRADE 40 FIELD ADDED REBAR.

NOTE:
ALL LINTELS OVER 9'-0" IN LENGTH NEED TO BE SHORED DURING GROUTING. CONTRACTOR SHALL FOLLOW PRECAST MANUFACTURER'S RECOMMENDATIONS REGARDING THE SHORING OF GROUTED LINTELS

SAFE UPLIFT LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	8F8-11 / 8F8-27	8F12-11 / 8F12-27	8F16-11 / 8F16-27	8F20-11 / 8F20-27	8F24-11 / 8F24-27	8F28-11 / 8F28-27	8F32-11 / 8F32-27
		SAFE LOAD - POUNDS PER LINEAR FOOT						
3'-6" (42") PRECAST		1569	2655	3524	4394	5263	6132	7001
4'-0" (48") PRECAST		1569	2655	3524	4394	5263	6132	7001
		1363	2305	3060	3815	4570	5325	6079
4'-6" (54") PRECAST		1363	2305	3060	3815	4570	5325	6079
		1207	2040	2707	3375	4043	4711	5379
5'-4" (64") PRECAST		1207	2040	2707	3375	4043	4711	5379
		1016	1715 (#)	2276 (#)	2838	3399	3961	4522
5'-10" (70") PRECAST		1016	1715	2276	2838	3399	3961	4522
		909	1567 (#)	2080 (#)	2593 (#)	3107 (#)	3620 (#)	4133 (#)
6'-6" (78") PRECAST		929	1567	2080	2593	3107	3620	4133
		835 (#)	1407 (#)	1868 (#)	2329 (#)	2790 (#)	3251 (#)	3712 (#)
7'-6" (90") PRECAST		836	1407	1868	2329	2790	3251	3712
		727 (#)	1065 (#)	1424 (#)	2025 (#)	2426 (#)	2827 (#)	3228 (#)
9'-4" (112") PRECAST		727	1224	1624	2025	2426	2827	3228
		591	708 (#)	1136 (#)	1474 (#)	1815 (#)	2157 (#)	2500 (#)
10'-6" (126") PRECAST		591	708	1136	1474	1815	2157	2500
		530	575 (#)	916 (#)	1188 (#)	1461 (#)	1736 (#)	2011 (#)
11'-4" (136") PRECAST		530	695	1180 (#)	1472 (#)	1763 (#)	2055	2346
		474	504 (#)	800 (#)	1037 (#)	1274 (#)	1513 (#)	1753 (#)
12'-0" (144") PRECAST		494	607	1042 (#)	1372 (#)	1643 (#)	1915 (#)	2187 (#)
		470 (#)	458 (#)	724 (#)	938 (#)	1153 (#)	1369 (#)	1585 (#)
13'-4" (160") PRECAST		470	550	940 (#)	1302 (#)	1560 (#)	1818 (#)	2075 (#)
		418 (#)	386 (#)	607 (#)	785 (#)	964 (#)	1143 (#)	1323 (#)
14'-0" (168") PRECAST		428	460	780 (#)	1159 (#)	1418 (#)	1653 (#)	1887 (#)
		384 (#)	358 (#)	560 (#)	724 (#)	889 (#)	1054 (#)	1220 (#)
14'-8" (176") PRESTRESSED		410	425	717 (#)	1063 (#)	1308 (#)	1582 (#)	1807 (#)
		239	334 (#)	520 (#)	672 (#)	825 (#)	978 (#)	1131 (#)
15'-4" (184") PRESTRESSED		246	395	663 (#)	980 (#)	1303 (#)	1518 (#)	1734 (#)
		224	313 (#)	486 (#)	627 (#)	769 (#)	911 (#)	1054 (#)
17'-4" (208") PRESTRESSED		230	368	616 (#)	908 (#)	1240 (#)	1460 (#)	1668 (#)
		187	283 (#)	405 (#)	521 (#)	638 (#)	756 (#)	873 (#)
19'-4" (232") PRESTRESSED		192	306	506 (#)	740 (#)	1005 (#)	1271 (#)	1473 (#)
		162	229 (#)	348 (#)	447 (#)	547 (#)	647 (#)	747 (#)
21'-4" (256") PRESTRESSED		166	263	429 (#)	623 (#)	841 (#)	1059 (#)	1227 (#)
		142	204 (#)	307 (#)	393 (#)	480 (#)	568 (#)	655 (#)
22'-0" (264") PRESTRESSED		142	232	373 (#)	537 (#)	721 (#)	905 (#)	1048 (#)
		137	197 (#)	295 (#)	378 (#)	462 (#)	546 (#)	630 (#)
24'-0" (288") PRESTRESSED		137	223	358 (#)	513 (#)	688 (#)	863 (#)	999 (#)
		124	179 (#)	267 (#)	342 (#)	416 (#)	492 (#)	567 (#)
		124	202	319 (#)	455 (#)	606 (#)	757 (#)	876 (#)

SAFE GRAVITY LOADS FOR 8" PRECAST w/ 2" RECESS DOOR U-LINTELS

LENGTH	TYPE	8RU6	8RF6-08 / 8RF6-18	8RF10-08 / 8RF10-18	8RF14-08 / 8RF14-18	8RF18-08 / 8RF18-18	8RF22-08 / 8RF22-18	8RF26-08 / 8RF26-18	8RF30-08 / 8RF30-18
			SAFE LOAD - POUNDS PER LINEAR FOOT						
4'-4" (52") PRECAST		1635	1749	3305	3280	4348	5421	6493	7567
			1891	3699	5204	6639	8060	9479	10893
4'-6" (54") PRECAST		1494	1596	3063	2992	3968	4946	5924	6904
			1756	3699	5204	6639	8060	9479	10893
5'-8" (68") PRECAST		866	920	1770	1716	2277	2839	3402	3966
			1147	2481	4567	6389	8060 (#)	7917 (#)	9311 (#)
5'-10" (70") PRECAST		810	859	1653	1600	2124	2649	3174	3700
			1113	2342	4242	6639 (#)	8060 (#)	7402 (#)	8708 (#)
6'-8" (80") PRECAST		797	901	1825	3120	5048	7767	9448	7360
			901	1825	3120	5048	7915	9479	10893 (#)
7'-6" (90") PRECAST		669	755	1490	2459	3776	5743	7239	5623
			755	1490	2459	3776	5743	8060 (#)	10893 (#)
9'-8" (116") PRECAST		411	466	999	1568	2253	3129	4081	3148
			526	999	1568	2253	3129	4150	5891 (#)
			395	468 (#)	884 (#)	1222 (#)	1540 (#)	1859 (#)	2180 (#)
			395	560	1072	1386	1701	2016	2331

SAFE UPLIFT LOADS FOR 8" PRECAST w/ 2" RECESS DOOR U-LINTELS

LENGTH	TYPE	8RF6-11 / 8RF6-27	8RF10-11 / 8RF10-27	8RF14-11 / 8RF14-27	8RF18-11 / 8RF18-27	8RF22-11 / 8RF22-27	8RF26-11 / 8RF26-27	8RF30-11 / 8RF30-27
		SAFE LOAD - POUNDS PER LINEAR FOOT						
4'-4" (52") PRECAST		905	1668	2362	3056	3751	4445	5140
		905	1668	2362	3056	3751	4445	5140
4'-6" (54") PRECAST		867	1604	2272	2939	3607	4275	4943
		867	1604	2272	2939	3607	4275	4943
5'-8" (68") PRECAST		675	1269 (#)	1797	2326 (#)	2854 (#)	3382	3911
		675	1269	1797	2326	2854	3382	3911
5'-10" (70") PRECAST		655	1207 (#)	1746 (#)	2259 (#)	2773 (#)	3286 (#)	2799 (#)
		655	1233	1746	2259	2773	3286	2799
6'-8" (80") PRECAST		570	929 (#)	1530 (#)	1980 (#)	2429 (#)	2879 (#)	3329 (#)
		570	1080	1530	1980	2429	2879	3329
7'-6" (90") PRECAST		506	742 (#)	1364 (#)	1765 (#)	2166 (#)	2567 (#)	2968 (#)
		506	898	1364	1765	2166	2567	2968
9'-8" (116") PRECAST		395	468 (#)	884 (#)	1222 (#)	1540 (#)	1859 (#)	2180 (#)
		395	560	1072	1386	1701	2016	2331

LINTEL SCHEDULE

LINTEL NO.	LENGTH	TYPE	COMMENTS
L-1	9'-4"	8F40-1B/1T	
L-2	4'-6"	8F24-1B/1T	
L-3	5'-4"	8F24-0B/1T	
L-4	7'-6"	8F24-1B/1T	
L-5	3'-6"	8F24-0B/1T	
L-6	10'-6"	8F24-1B/1T	
L-7	17'-4"	8F24-1B/1T	
L-8	24'-0"	8F16-1B/1T	MODIFY AS REQ'D
L-9	10'-6"	8F16-1B/1T	MODIFY AS REQ'D
L-10	7'-6"	8RF22-1B/1T	
L-11	5'-4"	8F24-0B/1T	MODIFY AS REQ'D
L-12	10'-6"	8F16-1B/1T	MODIFY AS REQ'D
L-13	9'-4"	8F16-1B/1T	MODIFY AS REQ'D
L-14	9'-4"	8F56-1B/1T	MODIFY AS REQ'D
L-15	9'-4"	8F40-1B/1T	MODIFY AS REQ'D
L-16	6'-6"	8F16-1B/1T	MODIFY AS REQ'D
L-17	6'-6"	8F40-1B/1T	MODIFY AS REQ'D
L-18	4'-0"	8F48-0B/1T	OPT. SRVC. DOOR

GENERAL NOTES

1. Provide full mortar bed and head joints.
2. Shore filled lintels as required.
3. Installation of lintel must comply with the architectural and/or structural documents.
4. U-Lintels are manufactured with 5 1/2" long notches at the ends to accomodate vertical cell reinforcing and grouting.
5. Reference the CAST-CRETE Load Deflection Graph brochure for lintel deflection information.
6. Bottom field added rebar to be located at the bottom of the lintel cavity.
7. 7/32" diameter wire stirrups are welded to the bottom steel for mechanical anchorage.
8. Cast-in-place concrete may be provided in composite lintel in lieu of concrete masonry units.
9. Safe load rating based on rational design analysis per ACI 318 and ACI 530
10. The exterior surface of lintels installed in exterior concrete masonry walls shall have a coating of stucco applied in accordance with ASTM C-926 or other approved coating.
11. Lintels loaded simultaneously with vertical (gravity or uplift) and horizontal (lateral) loads should be checked for the combined loading with the following equation:

$$\frac{\text{Applied vertical load}}{\text{Safe vertical load}} + \frac{\text{Applied horizontal load}}{\text{Safe horizontal load}} \leq 1.0$$

12. Additional lateral load capacity can be obtained by the designer by providing additional reinforced concrete masonry above the lintel. See detail at right.

SAFE LOAD TABLE NOTES

1. All values based on minimum 4 inch nominal bearing. Exception: Safe loads for unfilled lintels must be reduced by 20% if bearing length is less than 6 1/2 inches.
2. N.R. = Not Rated
3. Safe loads are superimposed allowable loads.
4. Safe loads based on grade 40 or grade 60 field rebar.
5. One #7 rebar may be substituted for two #5 rebars in 8" lintels only
6. The designer may evaluate concentrated loads from the safe load tables by calculating the maximum resisting moment and shear at d-away from face of support. For composite lintel heights not shown, use safe load from next lower height shown.
8. For lintels lengths not shown, use safe load from next longest length shown
9. All safe loads in units of pounds per linear foot
10. All safe loads based on simply supported span.
11. The number in the the parenthesis indicates the percent reduction for grade 40 field added rebar. Example 7'-6" lintel type 8F32-1B safe gravity load = 6472.

MATERIALS

1. f'c 8" precast lintel = 4000 psi
2. f'c prestressed lintel = 6000 psi
3. Grout per ASTM C476 f'g = 3000 psi w/ maximum 3/8 inch aggregate & 8 to 11 inch slump
4. Concrete Masonry Units (CMU) per ASTM C90 w/minimum net area compressive strength = 1900 psi
5. Rebar per ASTM A615 grade 60
6. Prestressing strand per ASTM A416 grade 270 low relaxation3
7. Mortar per ASTM C270 type M or S



TYPE DESIGNATION





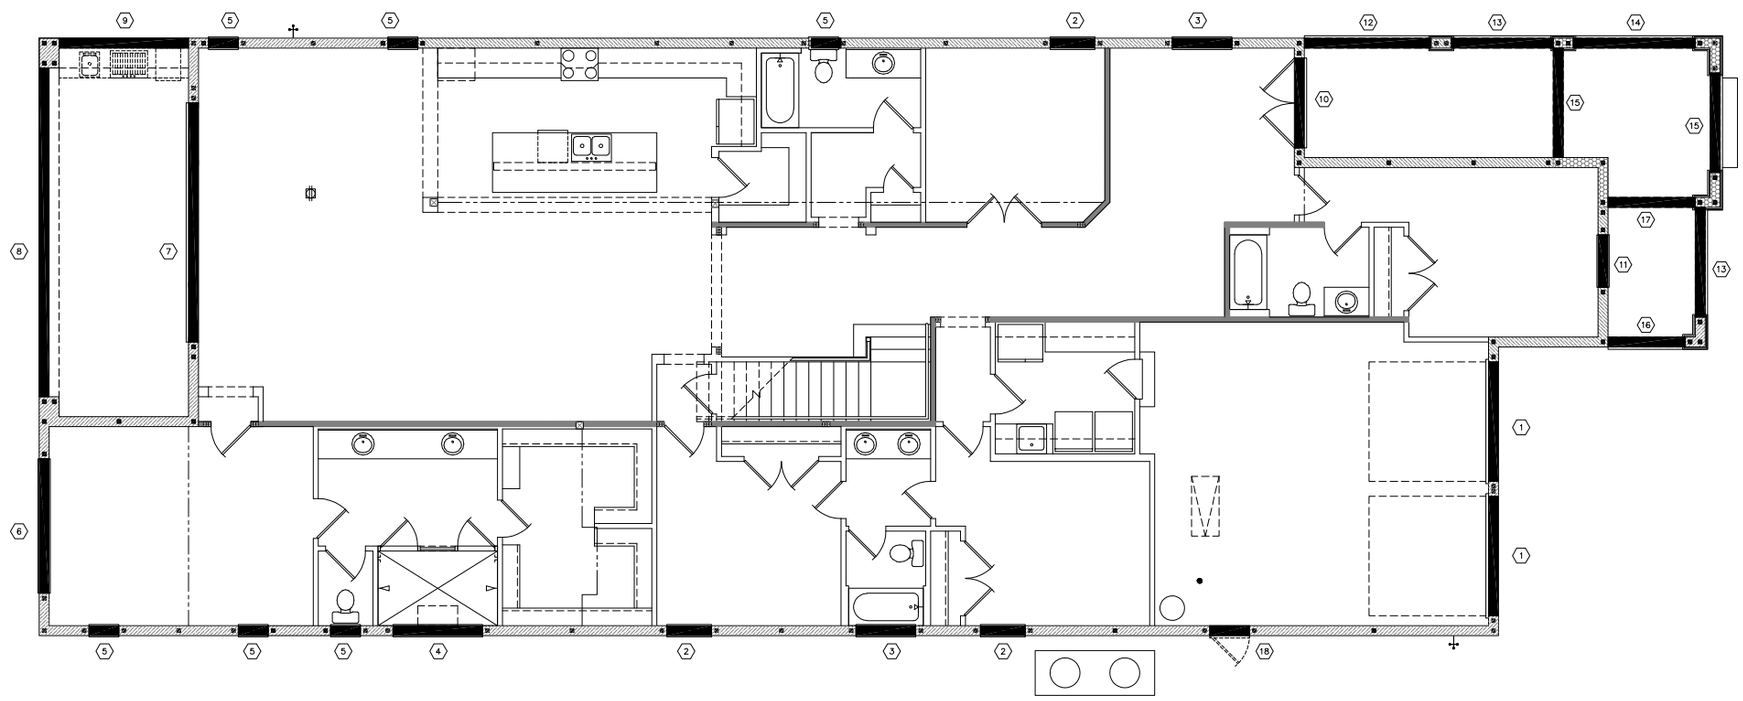

Lintel Plan "A"

(Standard)

SCALE 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

MJS custom home design
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
DESIGNERS • PLANNERS

40-4248
YORKSHIRE
Street Address
Lot Info
City, State, Zip

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, Fl. 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

LINTEL PLAN
10.A

235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
E-mail: ccastro@premierrural.com
FL CERT. AUTH.: 29113
FL PE#: 60239

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions on the job and MJS, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

These plans have been electronically signed & sealed by Noel Rodriguez, PE using a digital signature. Do not accept printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

© COPYRIGHT 2016 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

ALL DESIGNS PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

May 21, 2019 8:59pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\10.A Lintel Plan.dwg

SAFE GRAVITY LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	8U8	8F8-0B / 8F8-1B	8F12-0B / 8F12-1B	8F16-0B / 8F16-1B	8F20-0B / 8F20-1B	8F24-0B / 8F24-1B	8F28-0B / 8F28-1B	8F32-0B / 8F32-1B
			SAFE LOAD - POUNDS PER LINEAR FOOT						
3'-6" (42") PRECAST	2231		3069	3719	5163	6607	8054	9502	10951
			3069	4605	6113	7547	8974	10394	11809
4'-0" (48") PRECAST	1966		2561	2751	3820	4890	5961	7034	8107
			2693	4605	6113	7547	8974	10394	11809
4'-6" (54") PRECAST	1599		1969	2110	2931	3753	4576	5400	6224
			2189	4375	6113	7547 (#)	8972	10294	11809
5'-4" (64") PRECAST	1217		1349	1438	1999	2560	3123	3686	4249
			1463	3090	5365	7547 (#)	7342 (#)	8733 (#)	10127 (#)
5'-10" (70") PRECAST	1062		1105	1173	1631	2090	2549	3009	3470
			1451	2822	4360	7168 (#)	6536 (#)	7181 (#)	8328 (#)
6'-6" (78") PRECAST	908		1238	2177	3480	3931	3707	4363	5061
			1238	2177	3480	5381	6360	7039 (#)	8625 (#)
7'-6" (90") PRECAST	743		1011	1729	2632	2205	2898	3191	3695
			1011	1729	2661	3898	5681	8467 (#)	6472 (#)
9'-4" (112") PRECAST	554		899	1160	1425	2564	3486	2818	3302
			752	1245	1843	2564	3486	4705 (#)	6390 (#)
10'-6" (126") PRECAST	475		535	890	1247	2063	2777	2163	2536
			643	1052	1533	2063	2781	3643 (#)	4754 (#)
11'-4" (136") PRECAST	362		582	945	1366	1846	2423	3127	4006
			582	945	1366	1846	2423	3127	4006
12'-0" (144") PRECAST	337		540	873	1254	1684	2193	2805	3552
			540	873	1254	1684	2193	2805	3552
13'-4" (160") PRECAST	296		471	765	1075	1428	1838	2316	2883
			471	765	1075	1428	1838	2316	2883
14'-0" (168") PRECAST	279		424	706	1002	1326	1697	2127	2630
			442	706	1002	1326	1697	2127	2630
14'-8" (176") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			458	783	1370	1902	2245	2517	2712
15'-4" (184") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			412	710	1250	1733	2058	2320	2513
17'-4" (208") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			300	548	950	1326	1609	1849	2047
19'-4" (232") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			235	428	750	1037	1282	1515	1714
21'-4" (256") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			180	340	598	840	1114	1338	1468
22'-0" (264") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			165	315	550	784	1047	1285	1399
24'-0" (288") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			129	250	450	654	884	1092	1222

(#) THE NUMBERS IN PARENTHESIS ARE PERCENT REDUCTIONS FOR GRADE 40 FIELD ADDED REBAR.

NOTE:
ALL LINTELS OVER 9'-0" IN LENGTH NEED TO BE SHORED DURING GROUTING. CONTRACTOR SHALL FOLLOW PRECAST MANUFACTURER'S RECOMMENDATIONS REGARDING THE SHORING OF GROUTED LINTELS

SAFE UPLIFT LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	8F8-11 / 8F8-2T	8F12-11 / 8F12-2T	8F16-11 / 8F16-2T	8F20-11 / 8F20-2T	8F24-11 / 8F24-2T	8F28-11 / 8F28-2T	8F32-11 / 8F32-2T
		SAFE LOAD - POUNDS PER LINEAR FOOT						
3'-6" (42") PRECAST		1569	2655	3524	4394	5263	6132	7001
		1569	2655	3524	4394	5263	6132	7001
4'-0" (48") PRECAST		1363	2305	3060	3815	4570	5325	6079
		1363	2305	3060	3815	4570	5325	6079
4'-6" (54") PRECAST		1207	2040	2707	3375	4043	4711	5379
		1207	2040	2707	3375	4043	4711	5379
5'-4" (64") PRECAST		1016	1715 (#)	2276 (#)	2838	3399	3961	4522
		1016	1715	2276	2838	3399	3961	4522
5'-10" (70") PRECAST		909	1567 (#)	2080 (#)	2593 (#)	3107 (#)	3620 (#)	4133 (#)
		929	1567	2080	2593	3107	3620	4133
6'-6" (78") PRECAST		835 (#)	1407 (#)	1868 (#)	2329 (#)	2790 (#)	3251 (#)	3712 (#)
		836	1407	1868	2329	2790	3251	3712
7'-6" (90") PRECAST		727 (#)	1065 (#)	1424 (#)	2025 (#)	2426 (#)	2827 (#)	3228 (#)
		727	1224	1624	2025	2426	2827	3228
9'-4" (112") PRECAST		591	708 (#)	1136 (#)	1474 (#)	1815 (#)	2157 (#)	2500 (#)
		591	862	1318	1643	1969	2294	2619
10'-6" (126") PRECAST		530	575 (#)	916 (#)	1188 (#)	1461 (#)	1736 (#)	2011 (#)
		530	695	1180 (#)	1472 (#)	1763 (#)	2055	2346
11'-4" (136") PRECAST		474	504 (#)	800 (#)	1037 (#)	1274 (#)	1513 (#)	1753 (#)
		494	607	1042 (#)	1372 (#)	1643 (#)	1915 (#)	2187 (#)
12'-0" (144") PRECAST		470 (#)	458 (#)	724 (#)	938 (#)	1153 (#)	1369 (#)	1585 (#)
		470	550	940 (#)	1302 (#)	1560 (#)	1818 (#)	2075 (#)
13'-4" (160") PRECAST		418 (#)	386 (#)	607 (#)	785 (#)	964 (#)	1143 (#)	1323 (#)
		428	460	780 (#)	1159 (#)	1418 (#)	1653 (#)	1887 (#)
14'-0" (168") PRECAST		384 (#)	358 (#)	560 (#)	724 (#)	889 (#)	1054 (#)	1220 (#)
		410	425	717 (#)	1063 (#)	1358 (#)	1582 (#)	1807 (#)
14'-8" (176") PRESTRESSED		239	334 (#)	520 (#)	672 (#)	825 (#)	978 (#)	1131 (#)
		246	395	663 (#)	980 (#)	1303 (#)	1518 (#)	1734 (#)
15'-4" (184") PRESTRESSED		224	313 (#)	486 (#)	627 (#)	769 (#)	911 (#)	1054 (#)
		230	368	616 (#)	908 (#)	1240 (#)	1460 (#)	1668 (#)
17'-4" (208") PRESTRESSED		187	263 (#)	405 (#)	521 (#)	638 (#)	756 (#)	873 (#)
		192	306	506 (#)	740 (#)	1005 (#)	1271 (#)	1473 (#)
19'-4" (232") PRESTRESSED		162	229 (#)	348 (#)	447 (#)	547 (#)	647 (#)	747 (#)
		166	263	429 (#)	623 (#)	841 (#)	1059 (#)	1227 (#)
21'-4" (256") PRESTRESSED		142	204 (#)	307 (#)	393 (#)	480 (#)	566 (#)	655 (#)
		142	232	373 (#)	537 (#)	721 (#)	905 (#)	1048 (#)
22'-0" (264") PRESTRESSED		137	197 (#)	295 (#)	378 (#)	462 (#)	546 (#)	630 (#)
		137	223	358 (#)	513 (#)	688 (#)	863 (#)	999 (#)
24'-0" (288") PRESTRESSED		124	179 (#)	267 (#)	342 (#)	416 (#)	492 (#)	567 (#)
		124	202	319 (#)	455 (#)	606 (#)	757 (#)	876 (#)

SAFE GRAVITY LOADS FOR 8" PRECAST w/ 2" RECESS DOOR U-LINTELS

LENGTH	TYPE	8RUE	8RF6-0B / 8RF6-1B	8RF10-0B / 8RF10-1B	8RF14-0B / 8RF14-1B	8RF18-0B / 8RF18-1B	8RF22-0B / 8RF22-1B	8RF26-0B / 8RF26-1B	8RF30-0B / 8RF30-1B
			SAFE LOAD - POUNDS PER LINEAR FOOT						
4'-4" (52") PRECAST		1635	1749	3305	3280	4348	5421	6493	7567
			1891	3699	5204	6639	8060	9479	10893
4'-6" (54") PRECAST		1494	1596	3063	2992	3968	4946	5924	6904
			1756	3699	5204	6639	8060	9479	10893
5'-8" (68") PRECAST		866	920	1770	1716	2277	2839	3402	3966
			1147	2481	4567	6389	8060 (#)	7917 (#)	9311 (#)
5'-10" (70") PRECAST		810	859	1653	1600	2124	2649	3174	3700
			1113	2342	4242	6639 (#)	8060 (#)	7402 (#)	8708 (#)
6'-8" (80") PRECAST		797	901	1825	3120	5048	7767	9448	7360
			901	1825	3120	5048	7915	9479	10893 (#)
7'-6" (90") PRECAST		669	755	1490	2459	3776	5743	7239	5623
			755	1490	2459	3776	5743	8996 (#)	10893 (#)
9'-8" (116") PRECAST		411	466	999	1568	2253	3129	4081	3148
			526	999	1568	2253	3129	4150	5891 (#)

(#) THE NUMBERS IN PARENTHESIS ARE PERCENT REDUCTIONS FOR GRADE 40 FIELD ADDED REBAR.

SAFE UPLIFT LOADS FOR 8" PRECAST w/ 2" RECESS DOOR U-LINTELS

LENGTH	TYPE	8RF6-11 / 8RF6-2T	8RF10-11 / 8RF10-2T	8RF14-11 / 8RF14-2T	8RF18-11 / 8RF18-2T	8RF22-11 / 8RF22-2T	8RF26-11 / 8RF26-2T	8RF30-11 / 8RF30-2T
		SAFE LOAD - POUNDS PER LINEAR FOOT						
4'-4" (52") PRECAST		905	1668	2362	3056	3751	4445	5140
		905	1668	2362	3056	3751	4445	5140
4'-6" (54") PRECAST		867	1604	2272	2939	3607	4275	4943
		867	1604	2272	2939	3607	4275	4943
5'-8" (68") PRECAST		675	1269 (#)	1797	2326 (#)	2854 (#)	3382	3911
		675	1269	1797	2326	2854	3382	3911
5'-10" (70") PRECAST		655	1207 (#)	1746 (#)	2259 (#)	2773 (#)	3286 (#)	2799 (#)
		655	1233	1746	2259	2773	3286	2799
6'-8" (80") PRECAST		570	929 (#)	1530 (#)	1980 (#)	2429 (#)	2879 (#)	3329 (#)
		570	1080	1530	1980	2429	2879	3329
7'-6" (90") PRECAST		506	742 (#)	1364 (#)	1765 (#)	2166 (#)	2567 (#)	2968 (#)
		506	898	1364	1765	2166	2567	2968
9'-8" (116") PRECAST		395	468 (#)	884 (#)	1222 (#)	1540 (#)	1859 (#)	2180 (#)
		395	560	1072	1386	1701	2016	2331

LINTEL SCHEDULE

LINTEL NO.	LENGTH	TYPE	COMMENTS
L-1	9'-4"	8F40-1B/1T	
L-2	4'-6"	8F24-1B/1T	
L-3	5'-4"	8F24-0B/1T	
L-4	7'-6"	8F24-1B/1T	
L-5	3'-6"	8F24-0B/1T	
L-6	10'-6"	8F24-1B/1T	
L-7	17'-4"	8F24-1B/1T	
L-8	24'-0"	8F16-1B/1T	MODIFY AS REQ'D
L-9	10'-6"	8F16-1B/1T	MODIFY AS REQ'D
L-10	7'-6"	8RF22-1B/1T	
L-11	5'-4"	8F24-0B/1T	MODIFY AS REQ'D
L-12	10'-6"	8F16-1B/1T	MODIFY AS REQ'D
L-13	9'-4"	8F16-1B/1T	MODIFY AS REQ'D
L-14	9'-4"	8F56-1B/1T	MODIFY AS REQ'D
L-15	9'-4"	8F40-1B/1T	MODIFY AS REQ'D
L-16	6'-6"	8F16-1B/1T	MODIFY AS REQ'D
L-17	6'-6"	8F40-1B/1T	MODIFY AS REQ'D
L-18	4'-0"	8F48-0B/1T	OPT. SRVC. DOOR

GENERAL NOTES

1. Provide full mortar bed and head joints.
2. Shore filled lintels as required.
3. Installation of lintel must comply with the architectural and/or structural documents.
4. U-Lintels are manufactured with 5 1/2" long notches at the ends to accomodate vertical cell reinforcing and grouting.
5. Reference the CAST-CRETE Load Deflection Graph brochure for lintel deflection information.
6. Bottom field added rebar to be located at the bottom of the lintel cavity.
7. 7/32" diameter wire stirrups are welded to the bottom steel for mechanical anchorage.
8. Cast-in-place concrete may be provided in composite lintel in lieu of concrete masonry units.
9. Safe load rating based on rational design analysis per ACI 318 and ACI 530
10. The exterior surface of lintels installed in exterior concrete masonry walls shall have a coating of stucco applied in accordance with ASTM C-926 or other approved coating.
11. Lintels loaded simultaneously with vertical (gravity or uplift) and horizontal (lateral) loads should be checked for the combined loading with the following equation:

$$\frac{\text{Applied vertical load}}{\text{Safe vertical load}} + \frac{\text{Applied horizontal load}}{\text{Safe horizontal load}} \leq 1.0$$

12. Additional lateral load capacity can be obtained by the designer by providing additional reinforced concrete masonry above the lintel. See detail at right.

SAFE LOAD TABLE NOTES

1. All values based on minimum 4 inch nominal bearing. Exception: Safe loads for unfilled lintels must be reduced by 20% if bearing length is less than 6 1/2 inches.
2. N.R. = Not Rated
3. Safe loads are superimposed allowable loads.
4. Safe loads based on grade 40 or grade 60 field rebar.
5. One #7 rebar may be substituted for two #5 rebars in 8" lintels only
6. The designer may evaluate concentrated loads from the safe load tables by calculating the maximum resisting moment and shear at d-away from face of support. For composite lintel heights not shown, use safe load from next lower height shown.
8. For lintels lengths not shown, use safe load from next longest length shown
9. All safe loads in units of pounds per linear foot
10. All safe loads based on simply supported span.
11. The number in the the parenthesis indicates the percent reduction for grade 40 field added rebar. Example 7'-6" lintel type 8F32-1B safe gravity load = 6472.

MATERIALS

1. f'c 8" precast lintel = 4000 psi
2. f'c prestressed lintel = 6000 psi
3. Grout per ASTM C476 f'g = 3000 psi w/ maximum 3/8 inch aggregate & 8 to 11 inch slump
4. Concrete Masonry Units (CMU) per ASTM C90 w/minimum net area compressive strength = 1900 psi
5. Rebar per ASTM A615 grade 60
6. Prestressing strand per ASTM A416 grade 270 low relaxation3
7. Mortar per ASTM C270 type M or S



TYPE DESIGNATION

8F16-1B/1T

- F = FILLED WITH GROUT / U = UNFILLED
- QUANTITY OF #5 REBAR AT BOTTOM OF LINTEL CAVITY
- NOMINAL HEIGHT
- QUANTITY OF #5 REBAR AT TOP
- NOMINAL WIDTH



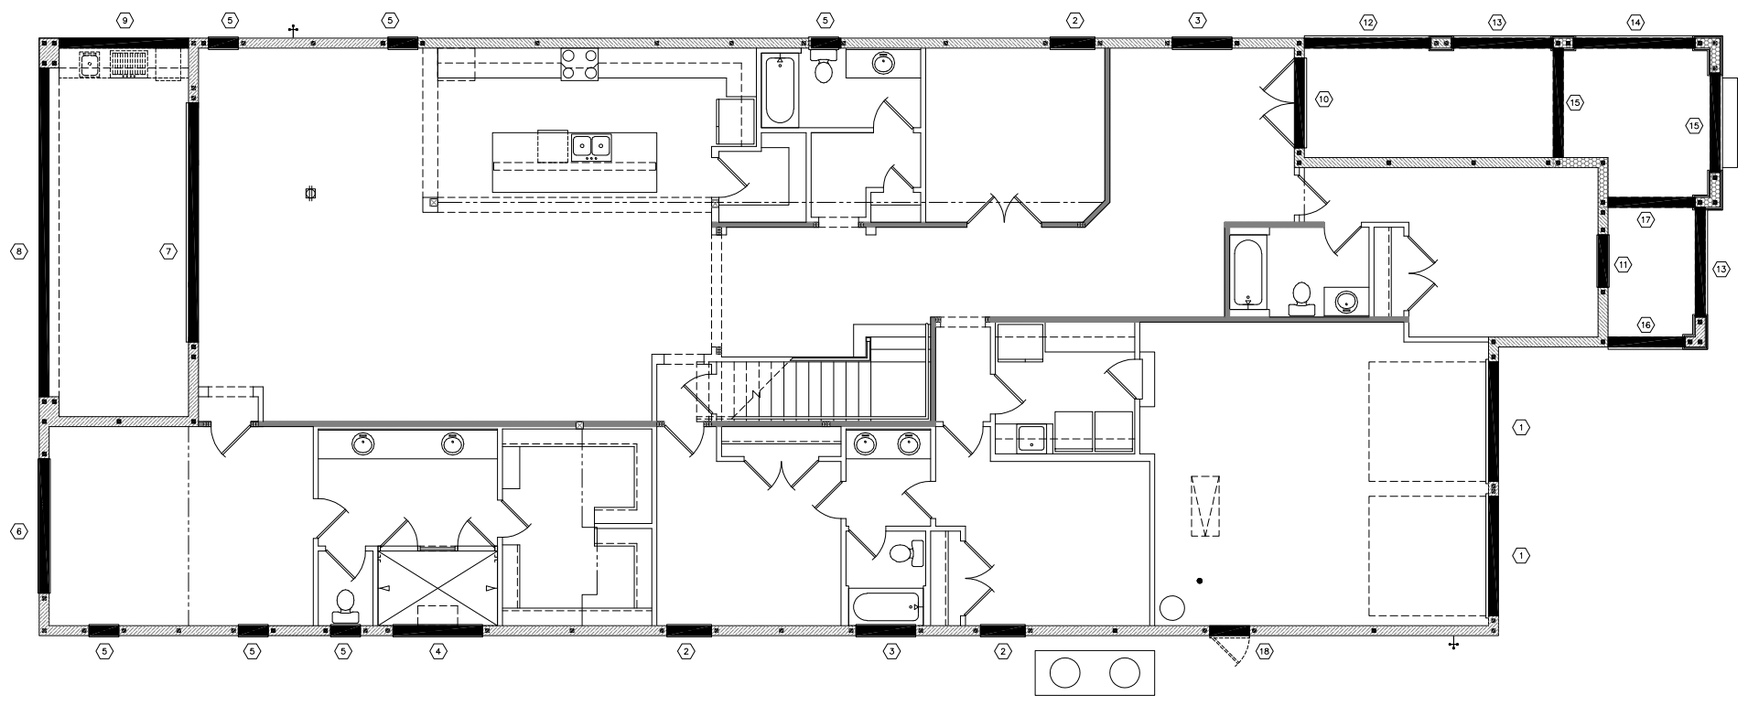

Lintel Plan "A"

(Opt. Balcony)

SCALE 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

MJS custom home design DESIGNERS • PLANNERS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

40-4248
YORKSHIRE
Street Address
Lot Info
City, State, Zip

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, Fl. 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

LINTEL PLAN
10.A1

235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierengineering.com
FL CERT. AUTH.: 29113

© COPYRIGHT 2016 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions on the job and MJs, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

"Where plans have been electronically signed & sealed by Raul Rodriguez, III, using a digital signature, it is sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies."

Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\10.A1 Lintel Plan (Opt. Balcony).dwg ALL DESIGNS PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.
May 21, 2019,6:59pm

SAFE GRAVITY LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	8U8	8F8-0B / 8F8-1B	8F12-0B / 8F12-1B	8F16-0B / 8F16-1B	8F20-0B / 8F20-1B	8F24-0B / 8F24-1B	8F28-0B / 8F28-1B	8F32-0B / 8F32-1B
			SAFE LOAD - POUNDS PER LINEAR FOOT						
3'-6" (42") PRECAST	2231		3069	3719	5163	6607	8054	9502	10951
			3069	4605	6113	7547	8974	10394	11809
4'-0" (48") PRECAST	1966		2561	2751	3820	4890	5961	7034	8107
			2693	4605	6113	7547	8974	10394	11809
4'-6" (54") PRECAST	1599		1969	2110	2931	3753	4576	5400	6224
			2189	4375	6113	7547 (#)	8972	10294	11809
5'-4" (64") PRECAST	1217		1349	1438	1999	2560	3123	3686	4249
			1463	3090	5365	7547 (#)	7342 (#)	8733 (#)	10127 (#)
5'-10" (70") PRECAST	1062		1105	1173	1631	2090	2549	3009	3470
			1451	2822	4360	7168 (#)	6536 (#)	7181 (#)	8328 (#)
6'-6" (78") PRECAST	908		1238	2177	3480	3031	3707	4383	5061
			1238	2177	3480	5381	6360	7339 (#)	8825 (#)
7'-6" (90") PRECAST	743		1011	1729	2632	2205	2698	3191	3685
			1011	1729	2661	3898	5681	8467 (#)	6472 (#)
9'-4" (112") PRECAST	554		899	1160	1425	2564	3486	2818	3302
			752	1245	1843	2564	3486	4705 (#)	6390 (#)
10'-6" (126") PRECAST	475		535	890	1247	2083	2777	2163	2536
			643	1052	1533	2083	2781	3643 (#)	4754 (#)
11'-4" (136") PRECAST	362		582	945	1366	1846	2423	3127	4006
			582	945	1366	1846	2423	3127	4006
12'-0" (144") PRECAST	337		540	873	1254	1684	2193	2805	3552
			540	873	1254	1684	2193	2805	3552
13'-4" (160") PRECAST	296		471	765	1075	1428	1838	2316	2883
			471	765	1075	1428	1838	2316	2883
14'-0" (168") PRECAST	279		424	706	1002	1326	1697	2127	2630
			442	706	1002	1326	1697	2127	2630
14'-8" (176") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			458	783	1370	1902	2245	2517	2712
15'-4" (184") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			412	710	1250	1733	2058	2320	2513
17'-4" (208") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			300	548	950	1326	1609	1849	2047
19'-4" (232") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			235	426	750	1037	1282	1515	1714
21'-4" (256") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			180	340	598	845	1114	1338	1468
22'-0" (264") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			165	315	550	784	1047	1285	1399
24'-0" (288") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			129	250	450	654	884	1092	1222

(#) THE NUMBERS IN PARENTHESIS ARE PERCENT REDUCTIONS FOR GRADE 40 FIELD ADDED REBAR.

NOTE:
ALL LINTELS OVER 9'-0" IN LENGTH NEED TO BE SHORED DURING GROUTING. CONTRACTOR SHALL FOLLOW PRECAST MANUFACTURER'S RECOMMENDATIONS REGARDING THE SHORING OF GROUTED LINTELS

SAFE UPLIFT LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	8F8-1T / 8F8-2T	8F12-1T / 8F12-2T	8F16-1T / 8F16-2T	8F20-1T / 8F20-2T	8F24-1T / 8F24-2T	8F28-1T / 8F28-2T	8F32-1T / 8F32-2T
		SAFE LOAD - POUNDS PER LINEAR FOOT						
3'-6" (42") PRECAST		1569	2655	3524	4394	5263	6132	7001
4'-0" (48") PRECAST		1569	2655	3524	4394	5263	6132	7001
		1363	2305	3060	3815	4570	5325	6079
4'-6" (54") PRECAST		1363	2305	3060	3815	4570	5325	6079
		1207	2040	2707	3375	4043	4711	5379
5'-4" (64") PRECAST		1207	2040	2707	3375	4043	4711	5379
		1016	1715 (#)	2276 (#)	2838	3399	3961	4522
5'-10" (70") PRECAST		1016	1715	2276	2838	3399	3961	4522
		909	1567 (#)	2080 (#)	2593 (#)	3107 (#)	3620 (#)	4133 (#)
6'-6" (78") PRECAST		929	1567	2080	2593	3107	3620	4133
		835 (#)	1407 (#)	1868 (#)	2329 (#)	2790 (#)	3251 (#)	3712 (#)
7'-6" (90") PRECAST		836	1407	1868	2329	2790	3251	3712
		727 (#)	1065 (#)	1424 (#)	2025 (#)	2426 (#)	2827 (#)	3228 (#)
9'-4" (112") PRECAST		727	1224	1624	2025	2426	2827	3228
		591	708 (#)	1136 (#)	1474 (#)	1815 (#)	2157 (#)	2500 (#)
10'-6" (126") PRECAST		591	708	1136	1474	1815	2157	2500
		530	575 (#)	916 (#)	1188 (#)	1461 (#)	1736 (#)	2011 (#)
11'-4" (136") PRECAST		530	695	1180 (#)	1472 (#)	1763 (#)	2055	2346
		474	504 (#)	800 (#)	1037 (#)	1274 (#)	1513 (#)	1753 (#)
12'-0" (144") PRECAST		494	607	1042 (#)	1372 (#)	1643 (#)	1915 (#)	2187 (#)
		470 (#)	458 (#)	724 (#)	938 (#)	1153 (#)	1369 (#)	1585 (#)
13'-4" (160") PRECAST		470	550	940 (#)	1302 (#)	1560 (#)	1818 (#)	2075 (#)
		418 (#)	386 (#)	607 (#)	785 (#)	964 (#)	1143 (#)	1323 (#)
14'-0" (168") PRECAST		428	460	780 (#)	1159 (#)	1418 (#)	1653 (#)	1887 (#)
		384 (#)	358 (#)	560 (#)	724 (#)	889 (#)	1054 (#)	1220 (#)
14'-8" (176") PRESTRESSED		410	425	717 (#)	1063 (#)	1308 (#)	1582 (#)	1807 (#)
		239	334 (#)	520 (#)	672 (#)	825 (#)	978 (#)	1131 (#)
15'-4" (184") PRESTRESSED		246	395	663 (#)	980 (#)	1303 (#)	1518 (#)	1734 (#)
		224	313 (#)	486 (#)	627 (#)	769 (#)	911 (#)	1054 (#)
17'-4" (208") PRESTRESSED		230	368	616 (#)	908 (#)	1240 (#)	1460 (#)	1668 (#)
		187	283 (#)	405 (#)	521 (#)	638 (#)	756 (#)	873 (#)
19'-4" (232") PRESTRESSED		192	306	506 (#)	740 (#)	1005 (#)	1271 (#)	1473 (#)
		182	229 (#)	348 (#)	447 (#)	547 (#)	647 (#)	747 (#)
21'-4" (256") PRESTRESSED		166	263	429 (#)	623 (#)	841 (#)	1059 (#)	1227 (#)
		142	204 (#)	307 (#)	393 (#)	480 (#)	568 (#)	655 (#)
22'-0" (264") PRESTRESSED		142	232	373 (#)	537 (#)	721 (#)	905 (#)	1048 (#)
		137	197 (#)	295 (#)	378 (#)	462 (#)	546 (#)	630 (#)
24'-0" (288") PRESTRESSED		137	223	358 (#)	513 (#)	688 (#)	863 (#)	999 (#)
		124	179 (#)	267 (#)	342 (#)	416 (#)	492 (#)	567 (#)
		124	202	319 (#)	455 (#)	606 (#)	757 (#)	876 (#)

SAFE GRAVITY LOADS FOR 8" PRECAST w/ 2" RECESS DOOR U-LINTELS

LENGTH	TYPE	8RU6	8RF6-0B / 8RF6-1B	8RF10-0B / 8RF10-1B	8RF14-0B / 8RF14-1B	8RF18-0B / 8RF18-1B	8RF22-0B / 8RF22-1B	8RF26-0B / 8RF26-1B	8RF30-0B / 8RF30-1B
			SAFE LOAD - POUNDS PER LINEAR FOOT						
4'-4" (52") PRECAST		1635	1749	3305	3280	4348	5421	6493	7567
			1891	3699	5204	6639	8060	9479	10893
4'-6" (54") PRECAST		1494	1596	3063	2992	3968	4946	5924	6904
			1756	3699	5204	6639	8060	9479	10893
5'-8" (68") PRECAST		866	920	1770	1716	2277	2839	3402	3966
			1147	2481	4567	6389	8060 (#)	7917 (#)	9311 (#)
5'-10" (70") PRECAST		810	859	1653	1600	2124	2649	3174	3700
			1113	2342	4242	6639 (#)	8060 (#)	7402 (#)	8708 (#)
6'-8" (80") PRECAST		797	901	1825	3120	5048	7767	9448	7360
			755	1490	2459	3776	5743	7239	5623
7'-6" (90") PRECAST		669	795	1490	2459	3776	5743	8996 (#)	10893 (#)
			466	999	1568	2253	3129	4081	3148
9'-8" (116") PRECAST		411	526	999	1568	2253	3129	4150	5891 (#)

(#) THE NUMBERS IN PARENTHESIS ARE PERCENT REDUCTIONS FOR GRADE 40 FIELD ADDED REBAR.

SAFE UPLIFT LOADS FOR 8" PRECAST w/ 2" RECESS DOOR U-LINTELS

LENGTH	TYPE	8RF6-1T / 8RF6-2T	8RF10-1T / 8RF10-2T	8RF14-1T / 8RF14-2T	8RF18-1T / 8RF18-2T	8RF22-1T / 8RF22-2T	8RF26-1T / 8RF26-2T	8RF30-1T / 8RF30-2T
		SAFE LOAD - POUNDS PER LINEAR FOOT						
4'-4" (52") PRECAST		905	1668	2362	3056	3751	4445	5140
		905	1668	2362	3056	3751	4445	5140
4'-6" (54") PRECAST		867	1604	2272	2939	3607	4275	4943
		867	1604	2272	2939	3607	4275	4943
5'-8" (68") PRECAST		675	1269 (#)	1797	2326 (#)	2854 (#)	3382	3911
		675	1269	1797	2326	2854	3382	3911
5'-10" (70") PRECAST		655	1207 (#)	1746 (#)	2259 (#)	2773 (#)	3286 (#)	2799 (#)
		655	1233	1746	2259	2773	3286	2799
6'-8" (80") PRECAST		570	929 (#)	1530 (#)	1980 (#)	2429 (#)	2879 (#)	3329 (#)
		570	1080	1530	1980	2429	2879	3329
7'-6" (90") PRECAST		506	742 (#)	1364 (#)	1765 (#)	2166 (#)	2567 (#)	2968 (#)
		506	898	1364	1765	2166	2567	2968
9'-8" (116") PRECAST		395	468 (#)	884 (#)	1222 (#)	1540 (#)	1859 (#)	2180 (#)
		395	560	1072	1386	1701	2016	2331

LINTEL SCHEDULE

LINTEL NO.	LENGTH	TYPE	COMMENTS
L-1	9'-4"	8F40-1B/1T	
L-2	4'-6"	8F24-1B/1T	
L-3	5'-4"	8F24-0B/1T	
L-4	7'-6"	8F24-1B/1T	
L-5	3'-6"	8F24-0B/1T	
L-6	10'-6"	8F24-1B/1T	
L-7	17'-4"	8F24-1B/1T	
L-8	24'-0"	8F16-1B/1T	MODIFY AS REQ'D
L-9	10'-6"	8F16-1B/1T	MODIFY AS REQ'D
L-10	7'-6"	8RF22-1B/1T	
L-11	4'-0"	8F24-0B/1T	MODIFY AS REQ'D
L-12	9'-4"	8F48-1B/1T	
L-13	10'-6"	8F40-1B/1T	MODIFY AS REQ'D
L-14	9'-4"	8F16-1B/1T	MODIFY AS REQ'D
L-15	7'-6"	8F16-1B/1T	MODIFY AS REQ'D
L-16	7'-6"	8F56-1B/1T	MODIFY AS REQ'D
L-17	4'-0"	8F48-0B/1T	OPT. SRVC. DOOR

GENERAL NOTES

1. Provide full mortar bed and head joints.
2. Shore filled lintels as required.
3. Installation of lintel must comply with the architectural and/or structural documents.
4. U-Lintels are manufactured with 5 1/2" long notches at the ends to accomodate vertical cell reinforcing and grouting.
5. Reference the CAST-CRETE Load Deflection Graph brochure for lintel deflection information.
6. Bottom field added rebar to be located at the bottom of the lintel cavity.
7. 7/32" diameter wire stirrups are welded to the bottom steel for mechanical anchorage.
8. Cast-in-place concrete may be provided in composite lintel in lieu of concrete masonry units.
9. Safe load rating based on rational design analysis per ACI 318 and ACI 530
10. The exterior surface of lintels installed in exterior concrete masonry walls shall have a coating of stucco applied in accordance with ASTM C-926 or other approved coating.
11. Lintels loaded simultaneously with vertical (gravity or uplift) and horizontal (lateral) loads should be checked for the combined loading with the following equation:

$$\frac{\text{Applied vertical load}}{\text{Safe vertical load}} + \frac{\text{Applied horizontal load}}{\text{Safe horizontal load}} \leq 1.0$$

12. Additional lateral load capacity can be obtained by the designer by providing additional reinforced concrete masonry above the lintel. See detail at right.

SAFE LOAD TABLE NOTES

1. All values based on minimum 4 inch nominal bearing. Exception: Safe loads for unfilled lintels must be reduced by 20% if bearing length is less than 6 1/2 inches.
2. N.R. = Not Rated
3. Safe loads are superimposed allowable loads.
4. Safe loads based on grade 40 or grade 60 field rebar.
5. One #7 rebar may be substituted for two #5 rebars in 8" lintels only
6. The designer may evaluate concentrated loads from the safe load tables by calculating the maximum resisting moment and shear at d-away from face of support. For composite lintel heights not shown, use safe load from next lower height shown.
7. For lintels lengths not shown, use safe load from next longest length shown
8. All safe loads in units of pounds per linear foot
9. All safe loads based on simply supported span.
10. The number in the the parenthesis indicates the percent reduction for grade 40 field added rebar. Example 7'-6" lintel type 8F32-1B safe gravity load = 6472.

MATERIALS

1. f'c 8" precast lintel = 4000 psi
2. f'c prestressed lintel = 6000 psi
3. Grout per ASTM C476 f'g = 3000 psi w/ maximum 3/8 inch aggregate & 8 to 11 inch slump
4. Concrete Masonry Units (CMU) per ASTM C90 w/minimum net area compressive strength = 1900 psi
5. Rebar per ASTM A615 grade 60
6. Prestressing strand per ASTM A416 grade 270 low relaxation3
7. Mortar per ASTM C270 type M or S



TYPE DESIGNATION

8F16-1B/1T

- F = FILLED WITH GROUT / U = UNFILLED
- QUANTITY OF #5 REBAR AT BOTTOM OF LINTEL CAVITY
- NOMINAL HEIGHT
- NOMINAL WIDTH
- QUANTITY OF #5 REBAR AT TOP



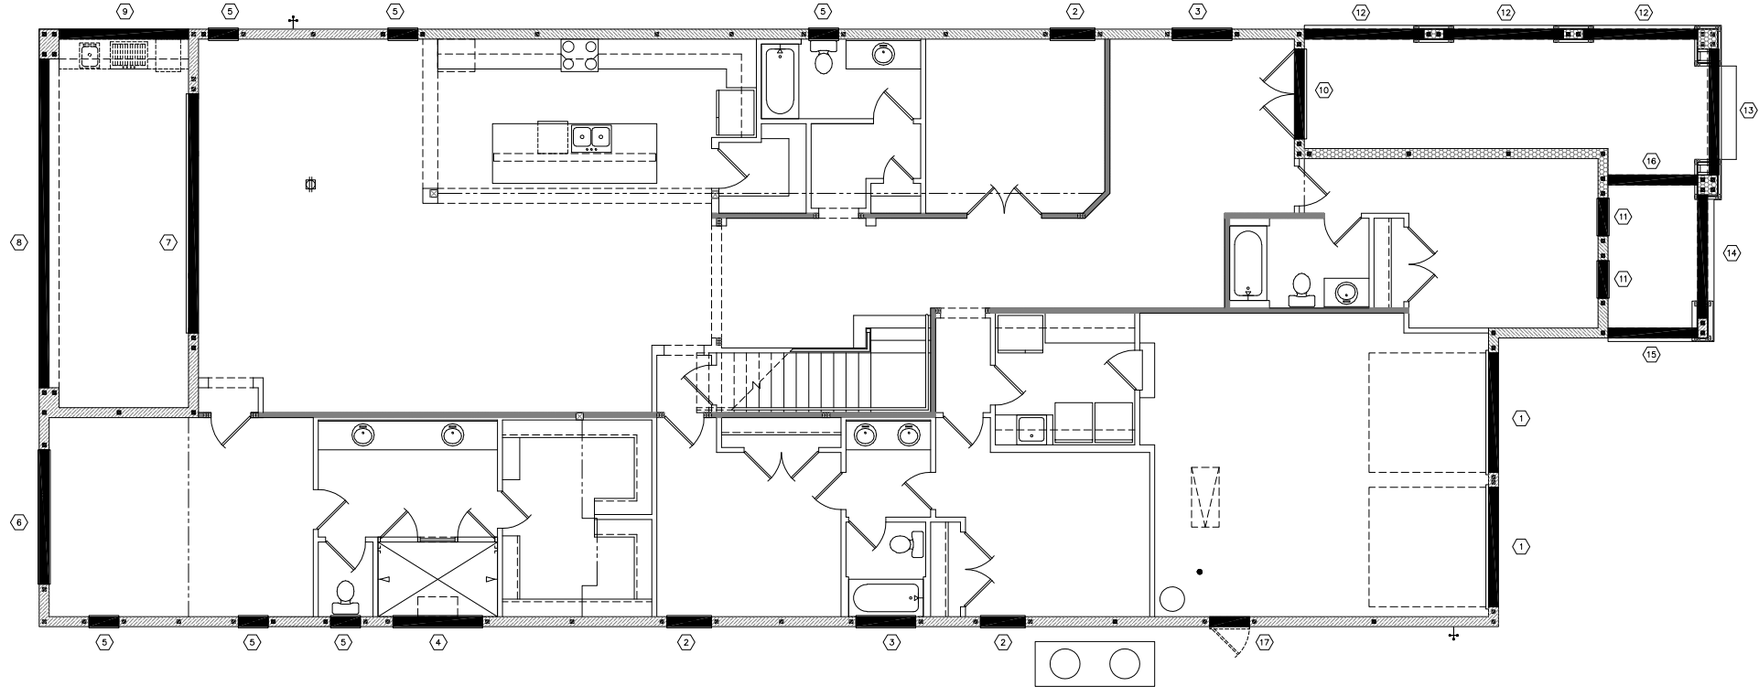

Lintel Plan "B"

(Standard)

SCALE 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
WEB: www.premierrural.com
FL CERT. AUTH.: 29113

PREMIER
ESTATE HOMES, LAND DEVELOPMENT & REAL ESTATE

MJS
custom home design
DESIGNERS • PLANNERS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions on the job and MJs, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

40-4248
YORKSHIRE
Street Address
Lot Info
City, State, Zip

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, Fl. 32811
Phone: (407) 529-3000

Park Square HOMES

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

LINTEL PLAN
10.B

© COPYRIGHT 2016 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

ALL DESIGNS PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW, REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

May 21, 2019,6:59pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\10.B Lintel Plan.dwg

SAFE GRAVITY LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	8U8	8F8-0B / 8F8-1B	8F12-0B / 8F12-1B	8F16-0B / 8F16-1B	8F20-0B / 8F20-1B	8F24-0B / 8F24-1B	8F28-0B / 8F28-1B	8F32-0B / 8F32-1B
			SAFE LOAD - POUNDS PER LINEAR FOOT						
3'-6" (42") PRECAST	2231		3069	3719	5163	6607	8054	9502	10951
			3069	4605	6113	7547	8974	10394	11809
4'-0" (48") PRECAST	1966		2561	2751	3820	4890	5961	7034	8107
			2693	4605	6113	7547	8974	10394	11809
4'-6" (54") PRECAST	1599		1969	2110	2931	3753	4576	5400	6224
			2189	4375	6113	7547 (#)	8972	10294	11809
5'-4" (64") PRECAST	1217		1349	1438	1999	2560	3123	3686	4249
			1463	3090	5365	7547 (#)	7342 (#)	8733 (#)	10127 (#)
5'-10" (70") PRECAST	1062		1105	1173	1631	2090	2549	3009	3470
			1451	2822	4360	7168 (#)	6536 (#)	7181 (#)	8328 (#)
6'-6" (78") PRECAST	908		1238	2177	3480	3031	3707	4383	5061
			1238	2177	3480	5381	6360	7339 (#)	8825 (#)
7'-6" (90") PRECAST	743		1011	1729	2632	2205	2698	3191	3685
			1011	1729	2661	3898	5681	8467 (#)	6472 (#)
9'-4" (112") PRECAST	554		899	1160	1425	2564	3486	2818	3302
			752	1245	1843	2564	3486	4705 (#)	6390 (#)
10'-6" (126") PRECAST	475		535	890	1247	2083	2777	2163	2536
			643	1052	1533	2083	2781	3643 (#)	4754 (#)
11'-4" (136") PRECAST	362		582	945	1366	1846	2423	3127	4006
			582	945	1366	1846	2423	3127	4006
12'-0" (144") PRECAST	337		540	873	1254	1684	2193	2805	3592
			540	873	1254	1684	2193	2805	3592
13'-4" (160") PRECAST	296		471	765	1075	1428	1838	2316	2883
			471	765	1075	1428	1838	2316	2883
14'-0" (168") PRECAST	279		424	706	1002	1326	1697	2127	2630
			442	706	1002	1326	1697	2127	2630
14'-8" (176") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			458	783	1370	1902	2245	2517	2712
15'-4" (184") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			412	710	1250	1733	2058	2320	2513
17'-4" (208") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			300	548	950	1326	1609	1849	2047
19'-4" (232") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			235	426	750	1037	1282	1515	1714
21'-4" (256") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			180	340	598	845	1114	1338	1468
22'-0" (264") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			165	315	550	784	1047	1285	1399
24'-0" (288") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			129	250	450	654	884	1092	1222

(#) THE NUMBERS IN PARENTHESIS ARE PERCENT REDUCTIONS FOR GRADE 40 FIELD ADDED REBAR.

NOTE:
ALL LINTELS OVER 9'-0" IN LENGTH NEED TO BE SHORED DURING GROUTING. CONTRACTOR SHALL FOLLOW PRECAST MANUFACTURER'S RECOMMENDATIONS REGARDING THE SHORING OF GROUTED LINTELS

SAFE UPLIFT LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	8F8-11 / 8F8-2T	8F12-11 / 8F12-2T	8F16-11 / 8F16-2T	8F20-11 / 8F20-2T	8F24-11 / 8F24-2T	8F28-11 / 8F28-2T	8F32-11 / 8F32-2T
		SAFE LOAD - POUNDS PER LINEAR FOOT						
3'-6" (42") PRECAST		1569	2655	3524	4394	5263	6132	7001
		1569	2655	3524	4394	5263	6132	7001
4'-0" (48") PRECAST		1363	2305	3060	3815	4570	5325	6079
		1363	2305	3060	3815	4570	5325	6079
4'-6" (54") PRECAST		1207	2040	2707	3375	4043	4711	5379
		1207	2040	2707	3375	4043	4711	5379
5'-4" (64") PRECAST		1016	1715 (#)	2276 (#)	2838	3399	3961	4522
		1016	1715	2276	2838	3399	3961	4522
5'-10" (70") PRECAST		909	1567 (#)	2080 (#)	2593 (#)	3107 (#)	3620 (#)	4133 (#)
		929	1567	2080	2593	3107	3620	4133
6'-6" (78") PRECAST		835 (#)	1407 (#)	1866 (#)	2329 (#)	2790 (#)	3251 (#)	3712 (#)
		836	1407	1868	2329	2790	3251	3712
7'-6" (90") PRECAST		727 (#)	1065 (#)	1424 (#)	2025 (#)	2426 (#)	2827 (#)	3228 (#)
		727	1224	1624	2025	2426	2827	3228
9'-4" (112") PRECAST		591	708 (#)	1136 (#)	1474 (#)	1815 (#)	2157 (#)	2500 (#)
		591	862	1318	1643	1969	2294	2619
10'-6" (126") PRECAST		530	575 (#)	916 (#)	1188 (#)	1461 (#)	1736 (#)	2011 (#)
		530	695	1180 (#)	1472 (#)	1763 (#)	2055	2346
11'-4" (136") PRECAST		474	504 (#)	800 (#)	1037 (#)	1274 (#)	1513 (#)	1753 (#)
		494	607	1042 (#)	1372 (#)	1643 (#)	1915 (#)	2187 (#)
12'-0" (144") PRECAST		470 (#)	458 (#)	724 (#)	938 (#)	1153 (#)	1369 (#)	1585 (#)
		470	550	940 (#)	1302 (#)	1560 (#)	1818 (#)	2075 (#)
13'-4" (160") PRECAST		418 (#)	386 (#)	607 (#)	785 (#)	964 (#)	1143 (#)	1323 (#)
		428	460	780 (#)	1159 (#)	1418 (#)	1653 (#)	1887 (#)
14'-0" (168") PRECAST		384 (#)	358 (#)	560 (#)	724 (#)	889 (#)	1054 (#)	1220 (#)
		410	425	717 (#)	1063 (#)	1358 (#)	1582 (#)	1807 (#)
14'-8" (176") PRESTRESSED		239	334 (#)	520 (#)	672 (#)	825 (#)	978 (#)	1131 (#)
		246	395	663 (#)	980 (#)	1303 (#)	1518 (#)	1734 (#)
15'-4" (184") PRESTRESSED		224	313 (#)	486 (#)	627 (#)	769 (#)	911 (#)	1054 (#)
		230	368	616 (#)	908 (#)	1240 (#)	1460 (#)	1668 (#)
17'-4" (208") PRESTRESSED		187	263 (#)	405 (#)	521 (#)	638 (#)	756 (#)	873 (#)
		192	306	506 (#)	740 (#)	1005 (#)	1271 (#)	1473 (#)
19'-4" (232") PRESTRESSED		162	229 (#)	348 (#)	447 (#)	547 (#)	647 (#)	747 (#)
		166	263	429 (#)	623 (#)	841 (#)	1059 (#)	1227 (#)
21'-4" (256") PRESTRESSED		142	204 (#)	307 (#)	393 (#)	480 (#)	568 (#)	655 (#)
		142	232	373 (#)	537 (#)	721 (#)	905 (#)	1048 (#)
22'-0" (264") PRESTRESSED		137	197 (#)	295 (#)	378 (#)	462 (#)	546 (#)	630 (#)
		137	223	358 (#)	513 (#)	688 (#)	863 (#)	999 (#)
24'-0" (288") PRESTRESSED		124	179 (#)	267 (#)	342 (#)	416 (#)	492 (#)	567 (#)
		124	202	319 (#)	455 (#)	606 (#)	757 (#)	876 (#)

SAFE GRAVITY LOADS FOR 8" PRECAST w/ 2" RECESS DOOR U-LINTELS

LENGTH	TYPE	8RU6	8RF6-0B / 8RF6-1B	8RF10-0B / 8RF10-1B	8RF14-0B / 8RF14-1B	8RF18-0B / 8RF18-1B	8RF22-0B / 8RF22-1B	8RF26-0B / 8RF26-1B	8RF30-0B / 8RF30-1B
			SAFE LOAD - POUNDS PER LINEAR FOOT						
4'-4" (52") PRECAST		1635	1749	3305	3280	4348	5421	6493	7567
			1891	3699	5204	6639	8060	9479	10893
4'-6" (54") PRECAST		1494	1596	3063	2992	3968	4946	5924	6904
			1756	3699	5204	6639	8060	9479	10893
5'-8" (68") PRECAST		866	920	1770	1716	2277	2839	3402	3966
			1147	2481	4567	6389	8060 (#)	7917 (#)	9311 (#)
5'-10" (70") PRECAST		810	859	1653	1600	2124	2649	3174	3700
			1113	2342	4242	6639 (#)	8060 (#)	7402 (#)	8708 (#)
6'-8" (80") PRECAST		797	901	1825	3120	5048	7767	9448	7360
			755	1490	2459	3776	5743	7239	5623
7'-6" (90") PRECAST		669	795	1490	2459	3776	5743	8996 (#)	10893 (#)
			466	999	1568	2253	3129	4081	3148
9'-8" (116") PRECAST		411	526	999	1568	2253	3129	4150	5891 (#)
			395	560	1072	1386	1701	2016	2331

(#) THE NUMBERS IN PARENTHESIS ARE PERCENT REDUCTIONS FOR GRADE 40 FIELD ADDED REBAR.

SAFE UPLIFT LOADS FOR 8" PRECAST w/ 2" RECESS DOOR U-LINTELS

LENGTH	TYPE	8RF6-11 / 8RF6-2T	8RF10-11 / 8RF10-2T	8RF14-11 / 8RF14-2T	8RF18-11 / 8RF18-2T	8RF22-11 / 8RF22-2T	8RF26-11 / 8RF26-2T	8RF30-11 / 8RF30-2T
		SAFE LOAD - POUNDS PER LINEAR FOOT						
4'-4" (52") PRECAST		905	1668	2362	3056	3751	4445	5140
		905	1668	2362	3056	3751	4445	5140
4'-6" (54") PRECAST		867	1604	2272	2939	3607	4275	4943
		867	1604	2272	2939	3607	4275	4943
5'-8" (68") PRECAST		675	1269 (#)	1797	2326 (#)	2854 (#)	3382	3911
		675	1269	1797	2326	2854	3382	3911
5'-10" (70") PRECAST		655	1207 (#)	1746 (#)	2259 (#)	2773 (#)	3286 (#)	2799 (#)
		655	1233	1746	2259	2773	3286	2799
6'-8" (80") PRECAST		570	929 (#)	1530 (#)	1980 (#)	2429 (#)	2879 (#)	3329 (#)
		570	1080	1530	1980	2429	2879	3329
7'-6" (90") PRECAST		506	742 (#)	1364 (#)	1765 (#)	2166 (#)	2567 (#)	2968 (#)
		506	898	1364	1765	2166	2567	2968
9'-8" (116") PRECAST		395	468 (#)	884 (#)	1222 (#)	1540 (#)	1859 (#)	2180 (#)
		395	560	1072	1386	1701	2016	2331

GENERAL NOTES

1. Provide full mortar bed and head joints.
2. Shore filled lintels as required.
3. Installation of lintel must comply with the architectural and/or structural documents.
4. U-Lintels are manufactured with 5 1/2" long notches at the ends to accomodate vertical cell reinforcing and grouting.
5. Reference the CAST-CRETE Load Deflection Graph brochure for lintel deflection information.
6. Bottom field added rebar to be located at the bottom of the lintel cavity.
7. 7/32" diameter wire stirrups are welded to the bottom steel for mechanical anchorage.
8. Cast-in-place concrete may be provided in composite lintel in lieu of concrete masonry units.
9. Safe load rating based on rational design analysis per ACI 318 and ACI 530
10. The exterior surface of lintels installed in exterior concrete masonry walls shall have a coating of stucco applied in accordance with ASTM C-926 or other approved coating.
11. Lintels loaded simultaneously with vertical (gravity or uplift) and horizontal (lateral) loads should be checked for the combined loading with the following equation:

$$\frac{\text{Applied vertical load}}{\text{Safe vertical load}} + \frac{\text{Applied horizontal load}}{\text{Safe horizontal load}} \leq 1.0$$

12. Additional lateral load capacity can be obtained by the designer by providing additional reinforced concrete masonry above the lintel. See detail at right.

SAFE LOAD TABLE NOTES

1. All values based on minimum 4 inch nominal bearing. Exception: Safe loads for unfilled lintels must be reduced by 20% if bearing length is less than 6 1/2 inches.
2. N.R. = Not Rated
3. Safe loads are superimposed allowable loads.
4. Safe loads based on grade 40 or grade 60 field rebar.
5. One #7 rebar may be substituted for two #5 rebars in 8" lintels only
6. The designer may evaluate concentrated loads from the safe load tables by calculating the maximum resisting moment and shear at d=away from face of support.
7. For composite lintel heights not shown, use safe load from next lower height shown.
8. For lintels lengths not shown, use safe load from next longest length shown
9. All safe loads in units of pounds per linear foot
10. All safe loads based on simply supported span.
11. The number in the the parenthesis indicates the percent reduction for grade 40 field added rebar. Example 7'-6" lintel type 8F32-1B safe gravity load = 6472.

MATERIALS

1. f'c 8" precast lintel = 4000 psi
2. f'c prestressed lintel = 6000 psi
3. Grout per ASTM C476 f'g = 3000 psi w/ maximum 3/8 inch aggregate & 8 to 11 inch slump
4. Concrete Masonry Units (CMU) per ASTM C90 w/minimum net area compressive strength = 1900 psi
5. Rebar per ASTM A615 grade 60
6. Prestressing strand per ASTM A416 grade 270 low relaxation3
7. Mortar per ASTM C270 type M or S



TYPE DESIGNATION

8F16-1B/1T

- F = FILLED WITH GROUT / U = UNFILLED
- QUANTITY OF #5 REBAR AT BOTTOM OF LINTEL CAVITY
- NOMINAL HEIGHT
- NOMINAL WIDTH
- QUANTITY OF #5 REBAR AT TOP



LINTEL SCHEDULE

LINTEL NO.	LENGTH	TYPE	COMMENTS
L-1	9'-4"	8F40-1B/1T	
L-2	4'-6"	8F24-1B/1T	
L-3	5'-4"	8F24-0B/1T	
L-4	7'-6"	8F24-1B/1T	
L-5	3'-6"	8F24-0B/1T	
L-6	10'-6"	8F24-1B/1T	
L-7	17'-4"	8F24-2B/1T	
L-8	24'-0"	8F16-2B/1T	MODIFY AS REQ'D
L-9	10'-6"	8F16-2B/1T	MODIFY AS REQ'D
L-10	7'-6"	8RF22-1B/1T	
L-11	4'-0"	8F24-0B/1T	MODIFY AS REQ'D
L-12	9'-4"	8F48-1B/1T	
L-13	10'-6"	8F40-1B/1T	MODIFY AS REQ'D
L-14	9'-4"	8F16-1B/1T	MODIFY AS REQ'D
L-15	7'-6"	8F16-1B/1T	MODIFY AS REQ'D
L-16	7'-6"	8F56-1B/1T	MODIFY AS REQ'D
L-17	4'-0"	8F48-0B/1T	OPT. SRVC. DOOR

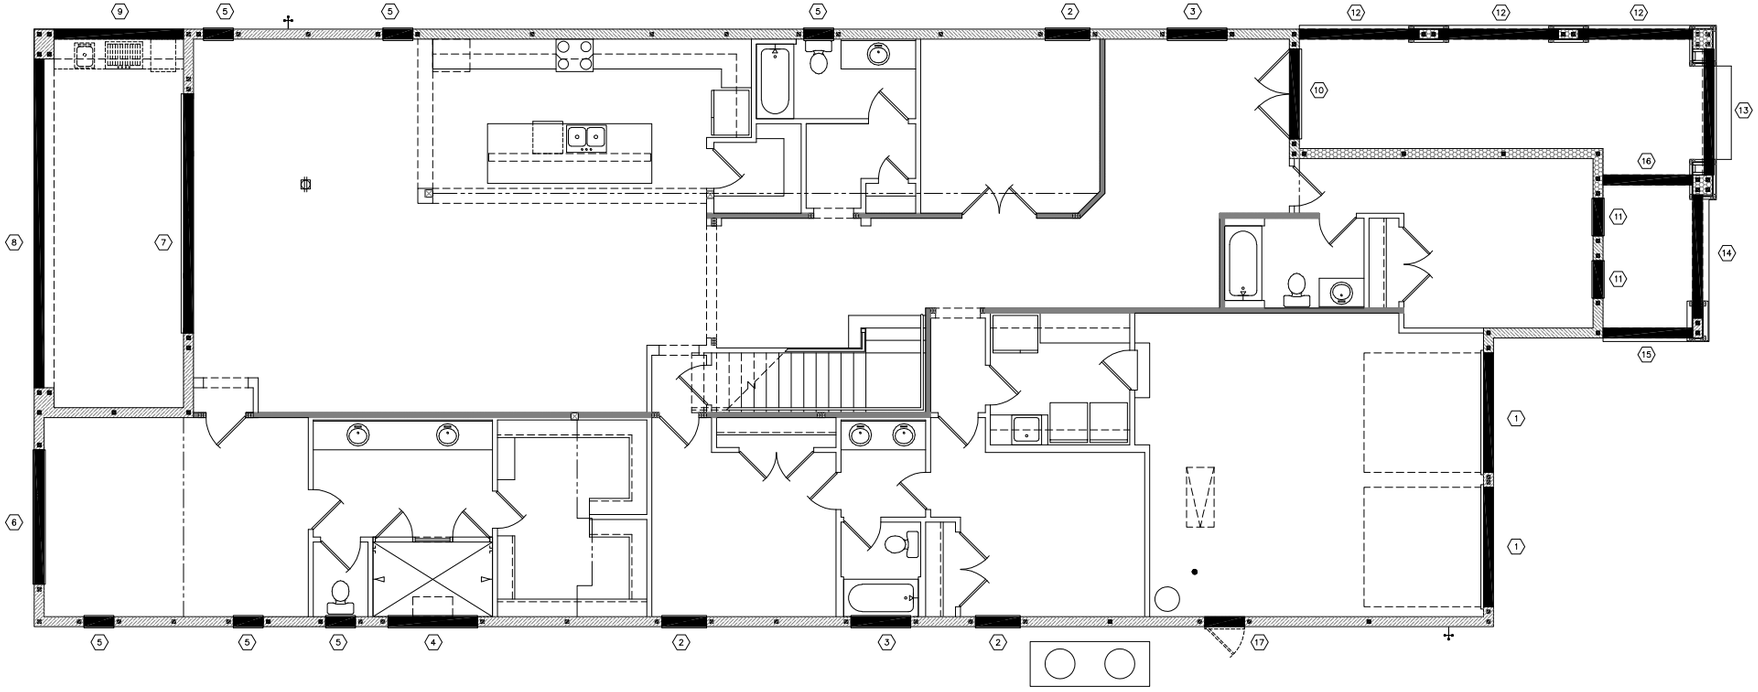

Lintel Plan "B"

(Opt. Balcony)

SCALE 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,6:59pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\10.B1 Lintel Plan (Opt. Balcony).dwg ALL DESIGNS PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

© COPYRIGHT 2016 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

Park Square HOMES

MJS custom home design DESIGNERS • PLANNERS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER ESTATE PROPERTIES, INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierestateproperties.com
FL CERT. AUTH.: 29113
FL PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

LINTEL PLAN

10.B1

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions on the job and MJS, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

Seals are to be verified on any electronic copies.

Signature must be verified on any electronic copies.

SAFE GRAVITY LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	8U8	8F8-08 / 8F8-18	8F12-08 / 8F12-18	8F16-08 / 8F16-18	8F20-08 / 8F20-18	8F24-08 / 8F24-18	8F28-08 / 8F28-18	8F32-08 / 8F32-18
			SAFE LOAD - POUNDS PER LINEAR FOOT						
3'-6" (42") PRECAST	2231		3069	3719	5163	6607	8054	9502	10951
			3069	4605	6113	7547	8974	10394	11809
4'-0" (48") PRECAST	1966		2561	2751	3820	4890	5961	7034	8107
			2693	4605	6113	7547	8974	10394	11809
4'-6" (54") PRECAST	1599		1969	2110	2931	3753	4576	5400	6224
			2189	4375	6113	7547 (#)	8972	10294	11809
5'-4" (64") PRECAST	1217		1349	1438	1999	2560	3123	3686	4249
			1463	3090	5365	7547 (#)	7342 (#)	8733 (#)	10127 (#)
5'-10" (70") PRECAST	1062		1105	1173	1631	2090	2549	3009	3470
			1451	2822	4360	7168 (#)	6536 (#)	7181 (#)	8328 (#)
6'-6" (78") PRECAST	908		1238	2177	3480	3931	3707	4383	5061
			1238	2177	3480	5381	6360	7039 (#)	8625 (#)
7'-6" (90") PRECAST	743		1011	1729	2632	2205	2898	3191	3685
			1011	1729	2661	3898	5681	8467 (#)	6472 (#)
9'-4" (112") PRECAST	554		899	1160	1425	2564	3486	2818	3302
			752	1245	1843	2564	3486	4705 (#)	6390 (#)
10'-6" (126") PRECAST	475		535	890	1247	2083	2777	2163	2536
			643	1052	1533	2083	2781	3643 (#)	4754 (#)
11'-4" (136") PRECAST	362		582	945	1366	1846	2423	3127	4006
			582	945	1366	1846	2423	3127	4006
12'-0" (144") PRECAST	337		540	873	1254	1684	2193	2805	3592
			540	873	1254	1684	2193	2805	3592
13'-4" (160") PRECAST	296		471	765	1075	1428	1838	2316	2883
			471	765	1075	1428	1838	2316	2883
14'-0" (168") PRECAST	279		424	706	1002	1326	1697	2127	2630
			442	706	1002	1326	1697	2127	2630
14'-8" (176") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			458	783	1370	1902	2245	2517	2712
15'-4" (184") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			412	710	1250	1733	2058	2320	2513
17'-4" (208") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			300	548	950	1326	1609	1849	2047
19'-4" (232") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			235	426	750	1037	1282	1515	1714
21'-4" (256") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			180	340	598	845	1114	1338	1468
22'-0" (264") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			165	315	550	784	1047	1285	1399
24'-0" (288") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			129	250	450	654	884	1092	1222

(#) THE NUMBERS IN PARENTHESIS ARE PERCENT REDUCTIONS FOR GRADE 40 FIELD ADDED REBAR.

NOTE:
ALL LINTELS OVER 9'-0" IN LENGTH NEED TO BE SHORED DURING GROUTING. CONTRACTOR SHALL FOLLOW PRECAST MANUFACTURER'S RECOMMENDATIONS REGARDING THE SHORING OF GROUTED LINTELS

SAFE UPLIFT LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	8F8-11 / 8F8-21	8F12-11 / 8F12-21	8F16-11 / 8F16-21	8F20-11 / 8F20-21	8F24-11 / 8F24-21	8F28-11 / 8F28-21	8F32-11 / 8F32-21
		SAFE LOAD - POUNDS PER LINEAR FOOT						
3'-6" (42") PRECAST		1569	2655	3524	4394	5263	6132	7001
		1569	2655	3524	4394	5263	6132	7001
4'-0" (48") PRECAST		1363	2305	3060	3815	4570	5325	6079
		1363	2305	3060	3815	4570	5325	6079
4'-6" (54") PRECAST		1207	2040	2707	3375	4043	4711	5379
		1207	2040	2707	3375	4043	4711	5379
5'-4" (64") PRECAST		1016	1715 (#)	2276 (#)	2838	3399	3961	4522
		1016	1715	2276	2838	3399	3961	4522
5'-10" (70") PRECAST		909	1567 (#)	2080 (#)	2593 (#)	3107 (#)	3620 (#)	4133 (#)
		929	1567	2080	2593	3107	3620	4133
6'-6" (78") PRECAST		835 (#)	1407 (#)	1868 (#)	2329 (#)	2790 (#)	3251 (#)	3712 (#)
		836	1407	1868	2329	2790	3251	3712
7'-6" (90") PRECAST		727 (#)	1065 (#)	1424 (#)	2025 (#)	2426 (#)	2827 (#)	3228 (#)
		727	1224	1624	2025	2426	2827	3228
9'-4" (112") PRECAST		591	708 (#)	1136 (#)	1474 (#)	1815 (#)	2157 (#)	2500 (#)
		591	862	1318	1643	1969	2294	2619
10'-6" (126") PRECAST		530	575 (#)	916 (#)	1188 (#)	1461 (#)	1736 (#)	2011 (#)
		530	695	1180 (#)	1472 (#)	1763 (#)	2055	2346
11'-4" (136") PRECAST		474	504 (#)	800 (#)	1037 (#)	1274 (#)	1513 (#)	1753 (#)
		494	607	1042 (#)	1372 (#)	1643 (#)	1915 (#)	2187 (#)
12'-0" (144") PRECAST		470 (#)	458 (#)	724 (#)	938 (#)	1153 (#)	1369 (#)	1585 (#)
		470	550	940 (#)	1302 (#)	1560 (#)	1818 (#)	2075 (#)
13'-4" (160") PRECAST		418 (#)	386 (#)	607 (#)	785 (#)	964 (#)	1143 (#)	1323 (#)
		428	460	780 (#)	1159 (#)	1418 (#)	1653 (#)	1887 (#)
14'-0" (168") PRECAST		384 (#)	358 (#)	560 (#)	724 (#)	889 (#)	1054 (#)	1220 (#)
		410	425	717 (#)	1063 (#)	1358 (#)	1582 (#)	1807 (#)
14'-8" (176") PRESTRESSED		239	334 (#)	520 (#)	672 (#)	825 (#)	978 (#)	1131 (#)
		246	395	663 (#)	980 (#)	1303 (#)	1518 (#)	1734 (#)
15'-4" (184") PRESTRESSED		224	313 (#)	486 (#)	627 (#)	769 (#)	911 (#)	1054 (#)
		230	368	616 (#)	908 (#)	1240 (#)	1460 (#)	1668 (#)
17'-4" (208") PRESTRESSED		187	263 (#)	405 (#)	521 (#)	638 (#)	756 (#)	873 (#)
		192	306	506 (#)	740 (#)	1005 (#)	1271 (#)	1473 (#)
19'-4" (232") PRESTRESSED		162	229 (#)	348 (#)	447 (#)	547 (#)	647 (#)	747 (#)
		166	263	429 (#)	623 (#)	841 (#)	1059 (#)	1227 (#)
21'-4" (256") PRESTRESSED		142	204 (#)	307 (#)	393 (#)	480 (#)	566 (#)	655 (#)
		142	232	373 (#)	537 (#)	721 (#)	905 (#)	1048 (#)
22'-0" (264") PRESTRESSED		137	197 (#)	295 (#)	378 (#)	462 (#)	546 (#)	630 (#)
		137	223	358 (#)	513 (#)	688 (#)	863 (#)	999 (#)
24'-0" (288") PRESTRESSED		124	179 (#)	267 (#)	342 (#)	416 (#)	492 (#)	567 (#)
		124	202	319 (#)	455 (#)	606 (#)	757 (#)	876 (#)

SAFE GRAVITY LOADS FOR 8" PRECAST w/ 2" RECESS DOOR U-LINTELS

LENGTH	TYPE	8RU6	8RF6-08 / 8RF6-18	8RF10-08 / 8RF10-18	8RF14-08 / 8RF14-18	8RF18-08 / 8RF18-18	8RF22-08 / 8RF22-18	8RF26-08 / 8RF26-18	8RF30-08 / 8RF30-18
			SAFE LOAD - POUNDS PER LINEAR FOOT						
4'-4" (52") PRECAST		1635	1749	3305	3280	4348	5421	6493	7567
			1891	3699	5204	6639	8060	9479	10893
4'-6" (54") PRECAST		1494	1596	3063	2992	3968	4946	5924	6904
			1756	3699	5204	6639	8060	9479	10893
5'-8" (68") PRECAST		866	920	1770	1716	2277	2839	3402	3966
			1147	2481	4567	6389	8060 (#)	7917 (#)	9311 (#)
5'-10" (70") PRECAST		810	859	1653	1600	2124	2649	3174	3700
			1113	2342	4242	6639 (#)	8060 (#)	7402 (#)	8708 (#)
6'-8" (80") PRECAST		797	901	1825	3120	5048	7767	9448	7360
			901	1825	3120	5048	7915	9479	10893 (#)
7'-6" (90") PRECAST		669	755	1490	2459	3776	5743	7239	5623
			755	1490	2459	3776	5743	8060 (#)	10893 (#)
9'-8" (116") PRECAST		411	466	999	1568	2253	3129	4081	3148
			526	999	1568	2253	3129	4150	5891 (#)

(#) THE NUMBERS IN PARENTHESIS ARE PERCENT REDUCTIONS FOR GRADE 40 FIELD ADDED REBAR.

SAFE UPLIFT LOADS FOR 8" PRECAST w/ 2" RECESS DOOR U-LINTELS

LENGTH	TYPE	8RF6-11 / 8RF6-21	8RF10-11 / 8RF10-21	8RF14-11 / 8RF14-21	8RF18-11 / 8RF18-21	8RF22-11 / 8RF22-21	8RF26-11 / 8RF26-21	8RF30-11 / 8RF30-21
		SAFE LOAD - POUNDS PER LINEAR FOOT						
4'-4" (52") PRECAST		905	1668	2362	3056	3751	4445	5140
		905	1668	2362	3056	3751	4445	5140
4'-6" (54") PRECAST		867	1604	2272	2939	3607	4275	4943
		867	1604	2272	2939	3607	4275	4943
5'-8" (68") PRECAST		675	1269 (#)	1797	2326 (#)	2854 (#)	3382	3911
		675	1269	1797	2326	2854	3382	3911
5'-10" (70") PRECAST		655	1207 (#)	1746 (#)	2259 (#)	2773 (#)	3286 (#)	2799 (#)
		655	1233	1746	2259	2773	3286	2799
6'-8" (80") PRECAST		570	929 (#)	1530 (#)	1980 (#)	2429 (#)	2879 (#)	3329 (#)
		570	1080	1530	1980	2429	2879	3329
7'-6" (90") PRECAST		506	742 (#)	1364 (#)	1765 (#)	2166 (#)	2567 (#)	2968 (#)
		506	898	1364	1765	2166	2567	2968
9'-8" (116") PRECAST		395	468 (#)	884 (#)	1222 (#)	1540 (#)	1859 (#)	2180 (#)
		395	560	1072	1386	1701	2016	2331

LINTEL SCHEDULE

LINTEL NO.	LENGTH	TYPE	COMMENTS
L-1	9'-4"	8F40-1B/1T	
L-2	4'-6"	8F24-1B/1T	
L-3	5'-4"	8F24-0B/1T	
L-4	7'-6"	8F24-1B/1T	
L-5	3'-6"	8F24-0B/1T	
L-6	10'-6"	8F24-1B/1T	
L-7	17'-4"	8F24-1B/1T	
L-8	24'-0"	8F24-1B/1T	MODIFY AS REQ'D
L-9	10'-6"	8F24-1B/1T	MODIFY AS REQ'D
L-10	7'-6"	8RF22-1B/1T	
L-11	4'-0"	8F24-0B/1T	MODIFY AS REQ'D
L-12	9'-4"	8F8-1B/1T	MODIFY AS REQ'D
L-13	10'-6"	8F8-1B/1T	MODIFY AS REQ'D
L-13A	9'-4"	8F48-1B/1T	MODIFY AS REQ'D
L-14	7'-6"	8F48-1B/1T	MODIFY AS REQ'D
L-15	10'-6"	8F16-1B/1T	MODIFY AS REQ'D
L-16	7'-6"	8F16-1B/1T	
L-17	4'-0"	8F48-0B/1T	OPT. SRVC. DOOR

GENERAL NOTES

1. Provide full mortar bed and head joints.
2. Shore filled lintels as required.
3. Installation of lintel must comply with the architectural and/or structural documents.
4. U-Lintels are manufactured with 5 1/2" long notches at the ends to accomodate vertical cell reinforcing and grouting.
5. Reference the CAST-CRETE Load Deflection Graph brochure for lintel deflection information.
6. Bottom field added rebar to be located at the bottom of the lintel cavity.
7. 7/32" diameter wire stirrups are welded to the bottom steel for mechanical anchorage.
8. Cast-in-place concrete may be provided in composite lintel in lieu of concrete masonry units.
9. Safe load rating based on rational design analysis per ACI 318 and ACI 530
10. The exterior surface of lintels installed in exterior concrete masonry walls shall have a coating of stucco applied in accordance with ASTM C-926 or other approved coating.
11. Lintels loaded simultaneously with vertical (gravity or uplift) and horizontal (lateral) loads should be checked for the combined loading with the following equation:

$$\frac{\text{Applied vertical load}}{\text{Safe vertical load}} + \frac{\text{Applied horizontal load}}{\text{Safe horizontal load}} \leq 1.0$$

12. Additional lateral load capacity can be obtained by the designer by providing additional reinforced concrete masonry above the lintel. See detail at right.

SAFE LOAD TABLE NOTES

1. All values based on minimum 4 inch nominal bearing. Exception: Safe loads for unfilled lintels must be reduced by 20% if bearing length is less than 6 1/2 inches.
2. N.R. = Not Rated
3. Safe loads are superimposed allowable loads.
4. Safe loads based on grade 40 or grade 60 field rebar.
5. One #7 rebar may be substituted for two #5 rebars in 8" lintels only
6. The designer may evaluate concentrated loads from the safe load tables by calculating the maximum resisting moment and shear at d-away from face of support. For composite lintel heights not shown, use safe load from next lower height shown.
8. For lintels lengths not shown, use safe load from next longest length shown
9. All safe loads in units of pounds per linear foot
10. All safe loads based on simply supported span.
11. The number in the the parenthesis indicates the percent reduction for grade 40 field added rebar. Example 7'-6" lintel type 8F32-1B safe gravity load = 6472.

MATERIALS

1. f'c 8" precast lintel = 4000 psi
2. f'c prestressed lintel = 6000 psi
3. Grout per ASTM C476 f'g = 3000 psi w/ maximum 3/8 inch aggregate & 8 to 11 inch slump
4. Concrete Masonry Units (CMU) per ASTM C90 w/minimum net area compressive strength = 1900 psi
5. Rebar per ASTM A615 grade 60
6. Prestressing strand per ASTM A416 grade 270 low relaxation3
7. Mortar per ASTM C270 type M or S



TYPE DESIGNATION

8F16-1B/1T

- F = FILLED WITH GROUT / U = UNFILLED
- QUANTITY OF #5 REBAR AT BOTTOM OF LINTEL CAVITY
- NOMINAL HEIGHT
- NOMINAL WIDTH
- QUANTITY OF #5 REBAR AT TOP



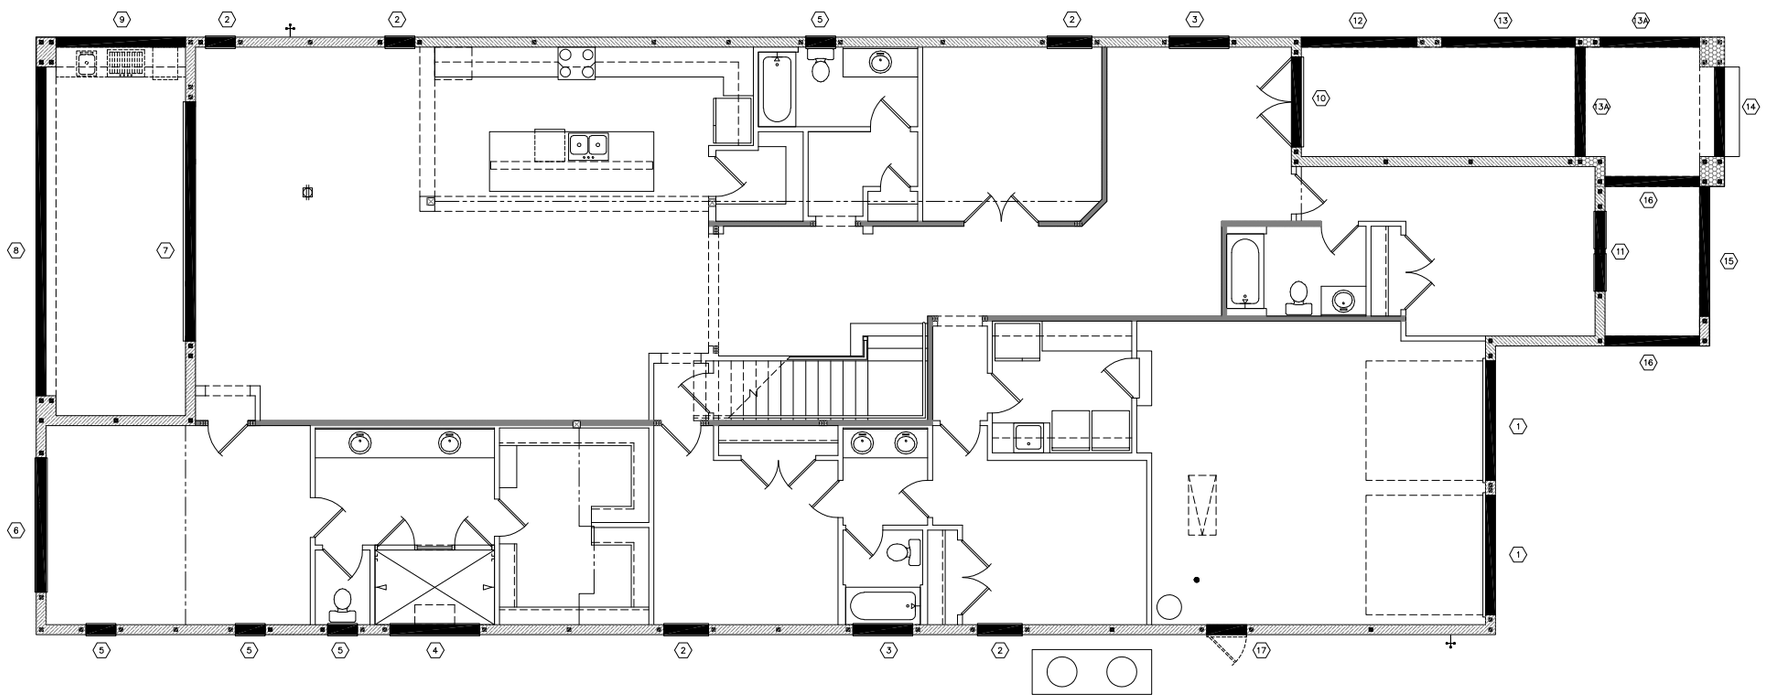

Lintel Plan "C"

(Standard)

SCALE 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
FL CERT. AUTH.: 29113

PREMIER
ESTATE HOMES & PROFESSIONAL SERVICES, INC.

MJS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
custom home design
www.mjshomedesigns.com
DESIGN BUILD • PLANNING
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

LINTEL PLAN

10.C

© COPYRIGHT 2016 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions on the job and MJS, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

This plan has been electronically signed & sealed by Raul Rodriguez, PE using a digital signature. Do not accept paper copies of this document as it is considered Signed & Sealed. Signature must be verified on any electronic copies.

Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\10.C Lintel Plan.dwg

May 21, 2019,6:59pm

ALL DESIGNS PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

SAFE GRAVITY LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	8U8	8F8-0B 8F8-1B	8F12-0B 8F12-1B	8F16-0B 8F16-1B	8F20-0B 8F20-1B	8F24-0B 8F24-1B	8F28-0B 8F28-1B	8F30-0B 8F30-1B
			SAFE LOAD - POUNDS PER LINEAR FOOT						
3'-6" (42") PRECAST	2231		3069	3719	5163	6607	8054	9503	10951
			3069	4605	6113	7547	8974	10394	11809
4'-0" (48") PRECAST	1966		2561	2751	3820	4890	5961	7034	8107
			2693	4605	6113	7547	8974	10394	11809
4'-6" (54") PRECAST	1599		1969	2110	2931	3753	4576	5400	6224
			2189	4375	6113	7547 (#)	8972	10294	11809
5'-4" (64") PRECAST	1217		1349	1438	1999	2560	3123	3686	4249
			1463	3090	5365	7547 (#)	7342 (#)	8733 (#)	10127 (#)
5'-10" (70") PRECAST	1062		1105	1173	1631	2090	2549	3009	3470
			1451	2822	4360	7168 (#)	6036 (#)	7181 (#)	8328 (#)
6'-6" (78") PRECAST	908		1238	2177	3480	3031	3707	4383	5061
			1238	2177	3480	5381	6360	7339 (#)	8325 (#)
7'-6" (90") PRECAST	743		1011	1729	2632	2200	2698	3191	3685
			1011	1729	2661	3898	5681	8467 (#)	6472 (#)
9'-4" (112") PRECAST	554		899	1160	1425	2564	3486	2818	3302
			752	1245	1843	2564	3486	4705 (#)	6390 (#)
10'-6" (126") PRECAST	475		535	890	1247	2083	2777	3163	3536
			643	1052	1533	2083	2781	3643 (#)	4754 (#)
11'-4" (136") PRECAST	362		582	945	1366	1846	2423	3127	4006
			582	945	1366	1846	2423	3127	4006
12'-0" (144") PRECAST	337		540	873	1254	1684	2183	2805	3592
			540	873	1254	1684	2183	2805	3592
13'-4" (160") PRECAST	296		471	765	1075	1428	1838	2316	2883
			471	765	1075	1428	1838	2316	2883
14'-0" (168") PRECAST	279		424	706	1002	1326	1697	2127	2630
			442	706	1002	1326	1697	2127	2630
14'-8" (176") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			408	783	1370	1902	2245	2517	2712
15'-4" (184") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			412	710	1250	1733	2058	2320	2513
17'-4" (208") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			300	548	950	1326	1609	1849	2047
19'-4" (232") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			235	428	750	1037	1282	1515	1716
21'-4" (256") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			180	340	588	845	1114	1338	1468
22'-0" (264") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			165	315	550	784	1047	1285	1369
24'-0" (288") PRESTRESSED	N.R.		NR	NR	NR	NR	NR	NR	NR
			129	250	450	654	884	1092	1222

(#) THE NUMBERS IN PARENTHESIS ARE PERCENT REDUCTIONS FOR GRADE 40 FIELD ADDED REBAR.

NOTE:
ALL LINTELS OVER 9'-0" IN LENGTH NEED TO BE SHORED DURING GROUTING. CONTRACTOR SHALL FOLLOW PRECAST MANUFACTURER'S RECOMMENDATIONS REGARDING THE SHORING OF GROUTED LINTELS

SAFE UPLIFT LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	8F8-11 8F8-2T	8F12-11 8F12-2T	8F16-11 8F16-2T	8F20-11 8F20-2T	8F24-11 8F24-2T	8F28-11 8F28-2T	8F32-11 8F32-2T
		SAFE LOAD - POUNDS PER LINEAR FOOT						
3'-6" (42") PRECAST		1569	2655	3524	4394	5263	6132	7001
		1569	2655	3524	4394	5263	6132	7001
4'-0" (48") PRECAST		1363	2305	3060	3815	4570	5325	6079
		1363	2305	3060	3815	4570	5325	6079
4'-6" (54") PRESTRESSED		1207	2040	2707	3375	4043	4711	5379
		1207	2040	2707	3375	4043	4711	5379
5'-4" (64") PRECAST		1016	1715 (#)	2276 (#)	2838	3399	3961	4522
		1016	1715	2276	2838	3399	3961	4522
5'-10" (70") PRECAST		909	1567 (#)	2080 (#)	2593 (#)	3107 (#)	3620 (#)	4133 (#)
		929	1567	2080	2593	3107	3620	4133
6'-6" (78") PRECAST		835 (#)	1407 (#)	1866 (#)	2329 (#)	2790 (#)	3251 (#)	3712 (#)
		835	1407	1866	2329	2790	3251	3712
7'-6" (90") PRECAST		727 (#)	1065 (#)	1424 (#)	2025 (#)	2426 (#)	2827 (#)	3228 (#)
		727	1224	1624	2025	2426	2827	3228
9'-4" (112") PRECAST		591	708 (#)	1136 (#)	1474 (#)	1815 (#)	2157 (#)	2500 (#)
		591	862	1318	1643	1969	2294	2619
10'-6" (126") PRECAST		530	575 (#)	918 (#)	1188 (#)	1461 (#)	1736 (#)	2011 (#)
		530	695	1180 (#)	1472 (#)	1763 (#)	2055	2346
11'-4" (136") PRECAST		474	504 (#)	800 (#)	1037 (#)	1274 (#)	1513 (#)	1753 (#)
		494	607	1042 (#)	1372 (#)	1643 (#)	1915 (#)	2187 (#)
12'-0" (144") PRECAST		470 (#)	458 (#)	724 (#)	938 (#)	1153 (#)	1369 (#)	1585 (#)
		470	550	940 (#)	1302 (#)	1560 (#)	1818 (#)	2075 (#)
13'-4" (160") PRECAST		418 (#)	386 (#)	607 (#)	785 (#)	964 (#)	1143 (#)	1323 (#)
		428	460	780 (#)	1159 (#)	1418 (#)	1653 (#)	1887 (#)
14'-0" (168") PRECAST		384 (#)	358 (#)	560 (#)	724 (#)	889 (#)	1054 (#)	1220 (#)
		410	425	717 (#)	1063 (#)	1358 (#)	1582 (#)	1807 (#)
14'-8" (176") PRESTRESSED		239	334 (#)	520 (#)	672 (#)	825 (#)	978 (#)	1131 (#)
		246	395	663 (#)	980 (#)	1303 (#)	1518 (#)	1734 (#)
15'-4" (184") PRESTRESSED		224	313 (#)	486 (#)	627 (#)	769 (#)	911 (#)	1054 (#)
		230	368	616 (#)	908 (#)	1240 (#)	1460 (#)	1668 (#)
17'-4" (208") PRESTRESSED		187	263 (#)	405 (#)	521 (#)	638 (#)	756 (#)	873 (#)
		192	306	506 (#)	740 (#)	1005 (#)	1271 (#)	1473 (#)
19'-4" (232") PRESTRESSED		162	229 (#)	348 (#)	447 (#)	547 (#)	647 (#)	747 (#)
		166	263	429 (#)	623 (#)	841 (#)	1059 (#)	1227 (#)
21'-4" (256") PRESTRESSED		142	204 (#)	307 (#)	393 (#)	480 (#)	568 (#)	655 (#)
		142	232	373 (#)	537 (#)	721 (#)	905 (#)	1048 (#)
22'-0" (264") PRESTRESSED		137	197 (#)	295 (#)	378 (#)	462 (#)	546 (#)	630 (#)
		137	223	358 (#)	513 (#)	688 (#)	863 (#)	999 (#)
24'-0" (288") PRESTRESSED		124	179 (#)	267 (#)	342 (#)	416 (#)	492 (#)	567 (#)
		124	202	319 (#)	455 (#)	606 (#)	757 (#)	876 (#)

SAFE GRAVITY LOADS FOR 8" PRECAST w/ 2" RECESS DOOR U-LINTELS

LENGTH	TYPE	8RU6	8RF6-0B 8RF6-1B	8RF10-0B 8RF10-1B	8RF14-0B 8RF14-1B	8RF18-0B 8RF18-1B	8RF22-0B 8RF22-1B	8RF26-0B 8RF26-1B	8RF30-0B 8RF30-1B
			SAFE LOAD - POUNDS PER LINEAR FOOT						
4'-4" (52") PRECAST		1635	1749	3305	3280	4348	5421	6493	7567
			1891	3699	5206	6639	8060	9479	10893
4'-6" (54") PRECAST		1494	1596	3063	2992	3968	4946	5924	6904
			1756	3699	5206	6639	8060	9479	10893
5'-8" (68") PRECAST		866	920	1770	1716	2277	2839	3402	3966
			1147	2481	4567	6389	8060 (#)	7917 (#)	9311 (#)
5'-10" (70") PRECAST		810	859	1653	1600	2124	2649	3174	3700
			1113	2342	4242	6639 (#)	8060 (#)	7402 (#)	8708 (#)
6'-8" (80") PRECAST		797	901	1825	3120	5048	7767	9448	7302
			901	1825	3120	5048	7915	9479	10893 (#)
7'-6" (90") PRECAST		669	795	1490	2459	3776	5743	7239	5623
			795	1490	2459	3776	5743	8898 (#)	10893 (#)
9'-8" (116") PRECAST		411	466	999	1568	2253	3129	4081	3148
			526	999	1568	2253	3129	4150	5891 (#)

(#) THE NUMBERS IN PARENTHESIS ARE PERCENT REDUCTIONS FOR GRADE 40 FIELD ADDED REBAR.

SAFE UPLIFT LOADS FOR 8" PRECAST w/ 2" RECESS DOOR U-LINTELS

LENGTH	TYPE	8RF6-11 8RF6-2T	8RF10-11 8RF10-2T	8RF14-11 8RF14-2T	8RF18-11 8RF18-2T	8RF22-11 8RF22-2T	8RF26-11 8RF26-2T	8RF30-11 8RF30-2T
		SAFE LOAD - POUNDS PER LINEAR FOOT						
4'-4" (52") PRECAST		905	1668	2362	3056	3751	4445	5140
		905	1668	2362	3056	3751	4445	5140
4'-6" (54") PRECAST		867	1604	2272	2939	3607	4275	4943
		867	1604	2272	2939	3607	4275	4943
5'-8" (68") PRECAST		675	1269 (#)	1797	2326 (#)	2854 (#)	3382	3911
		675	1269	1797	2326	2854	3382	3911
5'-10" (70") PRECAST		655	1207 (#)	1746 (#)	2259 (#)	2773 (#)	3286 (#)	2799 (#)
		655	1233	1746	2259	2773	3286	2799
6'-8" (80") PRECAST		570	929 (#)	1530 (#)	1980 (#)	2429 (#)	2879 (#)	3329 (#)
		570	1080	1530	1980	2429	2879	3329
7'-6" (90") PRECAST		506	742 (#)	1364 (#)	1765 (#)	2166 (#)	2567 (#)	2968 (#)
		506	898	1364	1765	2166	2567	2968
9'-8" (116") PRECAST		395	468 (#)	884 (#)	1222 (#)	1540 (#)	1859 (#)	2180 (#)
		395	560	1072	1386	1701	2016	2331

LINTEL SCHEDULE

LINTEL NO.	LENGTH	TYPE	COMMENTS
L-1	9'-4"	8F40-1B/1T	
L-2	4'-6"	8F24-1B/1T	
L-3	5'-4"	8F24-0B/1T	
L-4	7'-6"	8F24-1B/1T	
L-5	3'-6"	8F24-0B/1T	
L-6	10'-6"	8F24-1B/1T	
L-7	17'-4"	8F24-2B/1T	
L-8	24'-0"	8F24-2B/1T	MODIFY AS REQ'D
L-9	10'-6"	8F24-2B/1T	MODIFY AS REQ'D
L-10	7'-6"	8RF22-1B/1T	
L-11	4'-0"	8F24-0B/1T	MODIFY AS REQ'D
L-12	9'-4"	8F8-1B/1T	MODIFY AS REQ'D
L-13	10'-6"	8F8-1B/1T	MODIFY AS REQ'D
L-13A	9'-4"	8F48-1B/1T	MODIFY AS REQ'D
L-14	7'-6"	8F48-1B/1T	MODIFY AS REQ'D
L-15	10'-6"	8F16-1B/1T	MODIFY AS REQ'D
L-16	7'-6"	8F16-1B/1T	
L-17	4'-0"	8F48-0B/1T	OPT. SRVC. DOOR

GENERAL NOTES

1. Provide full mortar bed and head joints.
2. Shore filled lintels as required.
3. Installation of lintel must comply with the architectural and/or structural documents.
4. U-Lintels are manufactured with 5 1/2" long notches at the ends to accomodate vertical cell reinforcing and grouting.
5. Reference the CAST-CRETE Load Deflection Graph brochure for lintel deflection information.
6. Bottom field added rebar to be located at the bottom of the lintel cavity.
7. 7/32" diameter wire stirrups are welded to the bottom steel for mechanical anchorage.
8. Cast-in-place concrete may be provided in composite lintel in lieu of concrete masonry units.
9. Safe load rating based on rational design analysis per ACI 318 and ACI 530
10. The exterior surface of lintels installed in exterior concrete masonry walls shall have a coating of stucco applied in accordance with ASTM C-926 or other approved coating.
11. Lintels loaded simultaneously with vertical (gravity or uplift) and horizontal (lateral) loads should be checked for the combined loading with the following equation:

$$\frac{\text{Applied vertical load}}{\text{Safe vertical load}} + \frac{\text{Applied horizontal load}}{\text{Safe horizontal load}} \leq 1.0$$

12. Additional lateral load capacity can be obtained by the designer by providing additional reinforced concrete masonry above the lintel. See detail at right.

SAFE LOAD TABLE NOTES

1. All values based on minimum 4 inch nominal bearing. Exception: Safe loads for unfilled lintels must be reduced by 20% if bearing length is less than 6 1/2 inches.
2. N.R. = Not Rated
3. Safe loads are superimposed allowable loads.
4. Safe loads based on grade 40 or grade 60 field rebar.
5. One #7 rebar may be substituted for two #5 rebars in 8" lintels only
6. The designer may evaluate concentrated loads from the safe load tables by calculating the maximum resisting moment and shear at d=away from face of support.
7. For composite lintel heights not shown, use safe load from next lower height shown.
8. For lintels lengths not shown, use safe load from next longest length shown
9. All safe loads in units of pounds per linear foot
10. All safe loads based on simply supported span.
11. The number in the the parenthesis indicates the percent reduction for grade 40 field added rebar. Example 7"-6" lintel type 8F32-1B safe gravity load = 6472.

MATERIALS

1. f'c 8" precast lintel = 4000 psi
2. f'c prestressed lintel = 6000 psi
3. Grout per ASTM C476 f'g = 3000 psi w/ maximum 3/8 inch aggregate & 8 to 11 inch slump
4. Concrete Masonry Units (CMU) per ASTM C90 w/minimum net area compressive strength = 1900 psi
5. Rebar per ASTM A615 grade 60
6. Prestressing strand per ASTM A416 grade 270 low relaxation3
7. Mortar per ASTM C270 type M or S



TYPE DESIGNATION

8F16-1B/1T

- F = FILLED WITH GROUT / U = UNFILLED
- QUANTITY OF #5 REBAR AT BOTTOM OF LINTEL CAVITY
- NOMINAL HEIGHT
- NOMINAL WIDTH
- QUANTITY OF #5 REBAR AT TOP



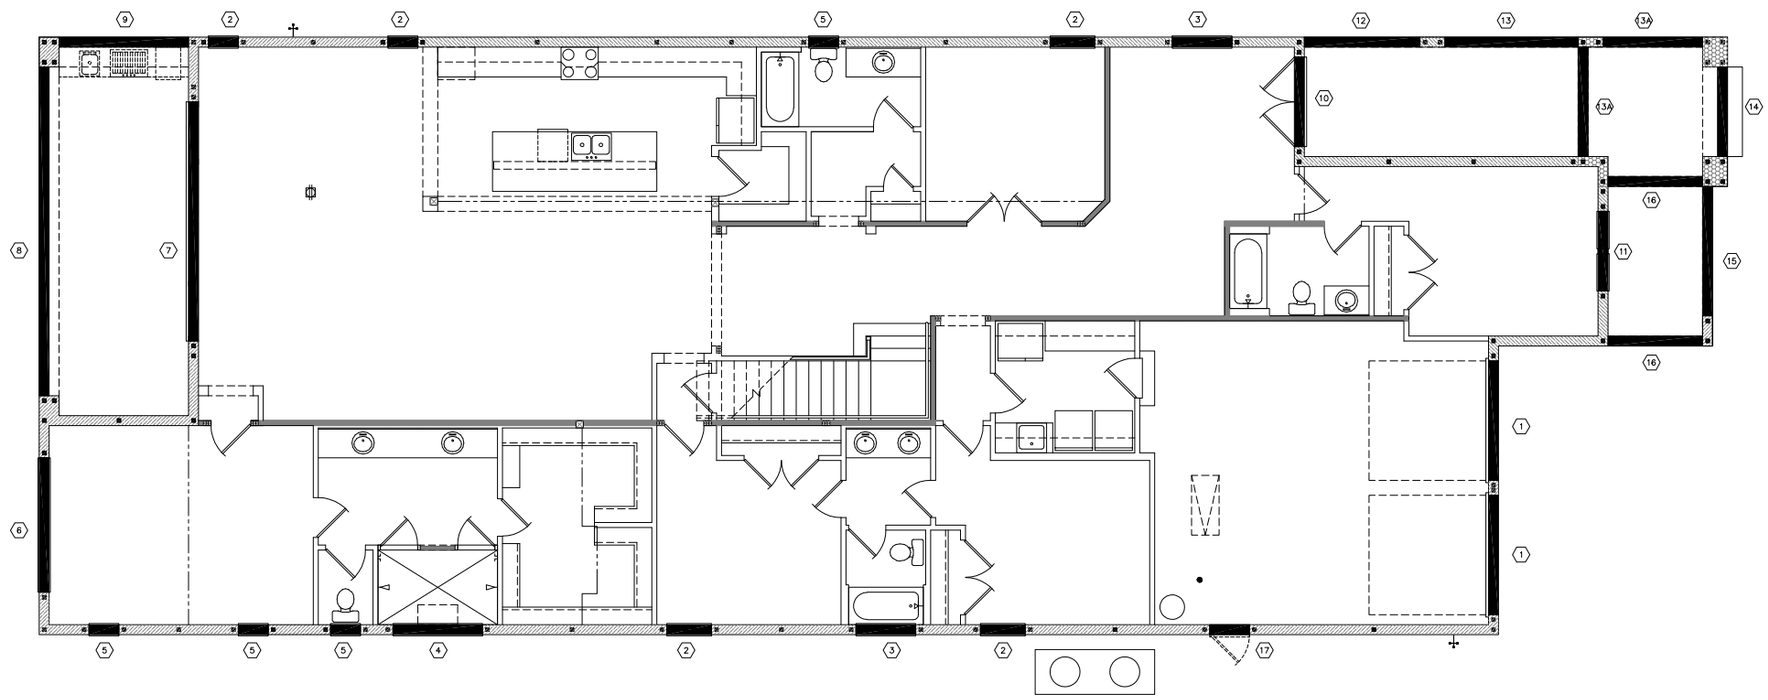

Lintel Plan "C"

(Opt. Balcony)

SCALE 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

MJS custom home design DESIGNERS • PLANNERS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

40-4248
YORKSHIRE
Street Address
Lot Info
City, State, Zip

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, Fl. 32811
Phone: (407) 529-3000

235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierengineering.net
FL CERT. AUTH.: 29113
FL PE#: 60239

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

LINTEL PLAN
10.C1

© COPYRIGHT 2016 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions on the job and MJS, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

This plan has been electronically signed & sealed by Raul Rodriguez, III, using a digital signature. Printed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

May 21, 2019,6:59pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\10.C1 Lintel Plan (Opt. Balcony).dwg ALL DESIGNS PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW, REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

POST NOTES:

SPECIAL POSTS:

(A) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP AND SP4 AT BOTTOM

(B) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP & (2) SP-4 AT BOTTOM OF EACH STUD W/ (14) 10d NAILS CAP=1000#

(C) 3½"x 3½" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(D) 3½"x 5¼" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(E) 5¼"x 5¼"1.8E PARALLAM PSL COLUMN SECURED w/ SIMPSON HTT-5 AT BOTTOM AND (3) HTS-20 AT TOP.

SPECIAL HEADERS:

(H-1) (2) 1¾" x 12" L.V.L HEADER SUPPORTED ON EA. SIDE BY (3) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) MSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

(H-2) (2) 2"x12" BEAM WITH 1/2" PLYWOOD FLITCH SUPPORTED ON EACH SIDE WITH (2) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) LSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

CONNECTOR NOTES:

1. EACH FLOOR TRUSS ATTACHED TO CMU WITH (1) HETA-16 AND (1) MTS-12 AT FRAME CONNECTION (U.N.O.)
2. EACH ROOF TRUSS / RAFTER AT CMU. TO BE ATTACHED WITH (1) HETA-16 (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
3. EACH ROOF TRUSS / RAFTER AT FRAME CONNECTION TO BE (1) MTS-12 AT ALL COMMON TRUSSES & (1) H2.5 AT ALL HIP JACKS (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
4. END JACKS AND CORNER SETS MAY BE (1) H-2.5 (U.N.O.)
5. ROOF SHEATHING TO BE 1/2" NOMINAL OR GREATER OSB. OR CDX. TYPE PLYWOOD NAILED WITH .099x2" RING SHANK NAILS @ 6" O.C. EXCEPT FIRST 4'-0" OF ENTIRE PERIMETER WHICH SHALL BE 6" O.C. FIELD 4" O.C. EDGE.

   WALL SHEATHING TO BE 7/16" OSB. OR 1/2" CDX. NAILED WITH 8d CORROSION RESISTANT NAILS @ 6" O.C. IN FIELD & 4" O.C. @ EDGE (U.N.O.). SEE SHEATHING DETAIL.
6. FLOOR SHEATHING TO BE 3/4" PLYWOOD OR OSB (U.N.O), WITH LONG DIMENSION PERPENDICULAR TO SUPPORT (FLOOR TRUSSES), NAILS: NAILS USED IN ALL FLOORING APPLICATIONS SHALL BE 8d, RING OR SPIRAL SHANK, HAND OR GUN DRIVEN NAILS. GUN DRIVEN NAILS SHALL HAVE HEAD SIZE EQUIVALENT TO HAND DRIVEN NAILS, SPACING SHALL BE 6" ON EDGES AND 12" IN FIELD.

GENERAL NOTES:

1. TRUSS LAYOUT IS AN ARTISTIC REPRESENTATION AND MAY VARY FROM FINAL LAYOUT SUBMITTED BY TRUSS MANUFACTURER. ALL TRUSS LAYOUTS AND PROFILES SHALL BE DESIGNED AND CERTIFIED BY TRUSS MANUFACTURER'S REGISTERED ENGINEER.
2. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.
3. TRUSS MANUFACTURER TO VERIFY ALL TRUSS SPANS, SLOPES, BEARING POINTS, & DIMENSIONS BEFORE FABRICATION. TRUSS MANUFACTURER SHALL COORDINATE LOCATIONS FOR MECHANICAL AND PLUMBING CHASES TO AVOID CONFLICT. ALSO, TRUSS MANUFACTURER TO PROVIDE SHOP DRAWINGS FOR APPROVAL BEFORE FABRICATION.
4. ALL ROOF PITCHES ARE TO BE SET AS INDICATED ON PLANS AND ELEVATIONS.
5. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS, & ELEVATIONS FOR BEARING HEIGHTS.
6. TRUSS SPACING SHALL BE 24" O.C. (U.N.O.) CONVENTIONAL FRAMING SHALL BE 16" O.C.
7. TRUSS MANUFACTURER TO PROVIDE ALL GABLE END TRUSSES WITH INTERMEDIATE STUD MEMBERS @ 16" O.C.
8. ROOF DECKING AS SPECIFIED.
9. ALL ROOF OVERHANGS TO BE 12" UNLESS NOTED OTHERWISE.
10. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON BEARING WALLS AND AT VOLUME AREAS (U.N.O.).
11. ALIGN TRUSSES AND HAND FRAMING SO AS ALL GYPSUM WALL BOARD TO BE CONTINUOUS FROM FLOOR TO CEILING.
12. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:

    12.1. ALL CEILING HUNG SOFFITS AND SOFFITS w/ CABINETS AS SHOWN ON PLANS.
    12.2. ATTIC LOCATED HVAC. UNITS AS SHOWN ON PLANS.
13. PROVIDE AND INSTALL FLASHING & ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE, IN ACCORDANCE WITH FBC-R 2017, 6TH EDITION.
14. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCSI 1.
15. REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
16. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBC-R 2017, 6TH EDITION

BRG. HT. LEGEND

■ - INDICATES A CONCRETE FILLED CELL WITHIN AN 8" CMU WALL CONTAINING (1) VERT. #5 REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM. PROVIDE A MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS.

9'-4" BRG. HT. | 12'-0" BRG. HT. | 15'-0" BRG. HT.
10'-0" BRG. HT. | 13'-4" BRG. HT. | 16'-0" BRG. HT.
11'-4" BRG. HT. | 14'-0" BRG. HT. | BRG. PER PLAN

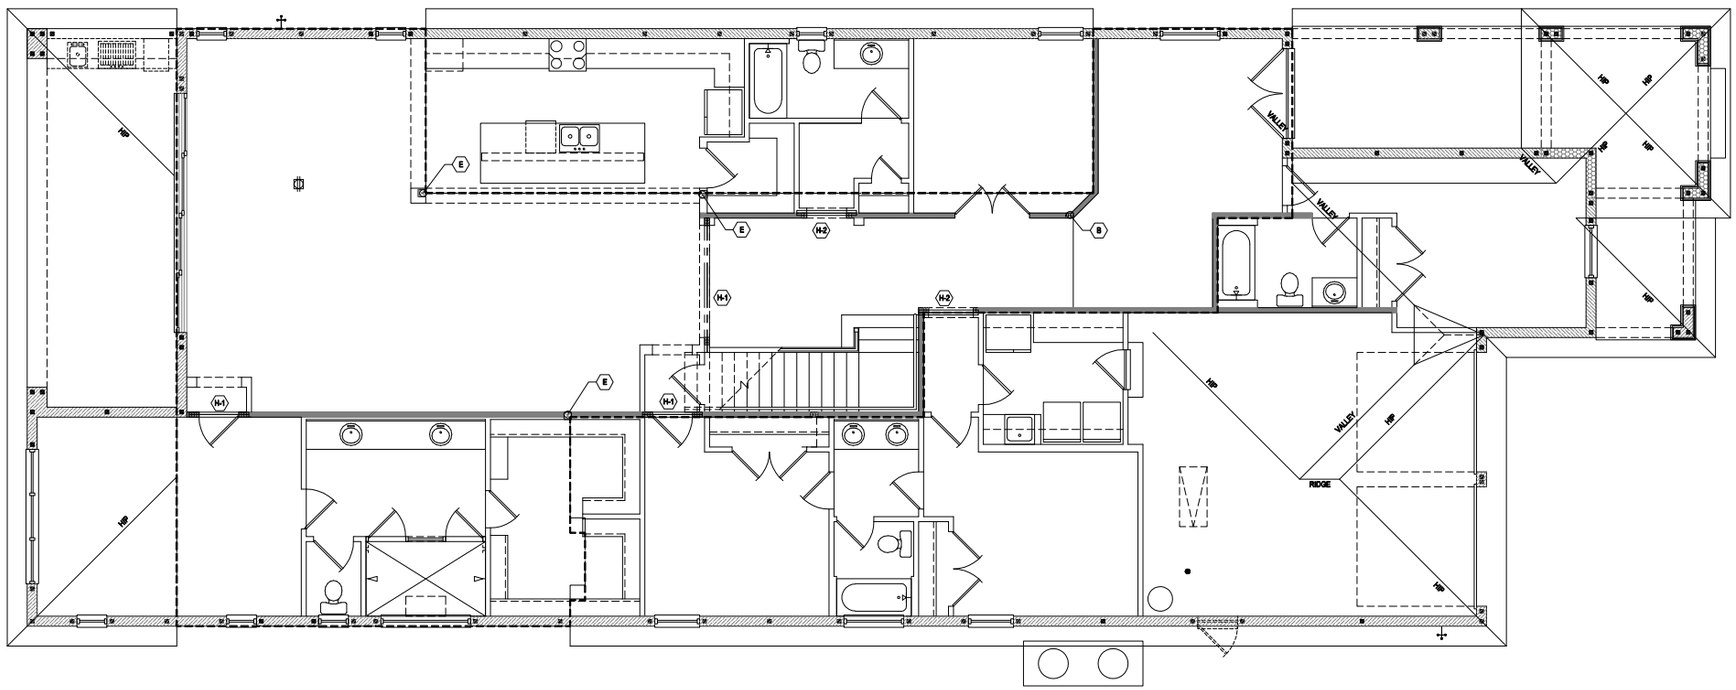

First Floor Truss Plan "A"

(Opt. Second Floor)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,6:59pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\11.A First Floor Truss plan.dwg ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATION OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, Fl. 32811
Phone: (407) 529-3000

MJS custom home design
DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER STRUCTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

MEETER DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS.
Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions and conditions shown on these drawings before proceeding with any work.

Your plans have been electronically signed & sealed by Noel Rodriguez, PE, using a digital signature. DO a sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FIRST FLOOR TRUSS

11.A

POST NOTES:

SPECIAL POSTS:

(A) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP AND SPH AT BOTTOM

(B) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP & (2) SP-4 AT BOTTOM OF EACH STUD W/ (14) 10d NAILS CAP=1000#

(C) 3½"x 3½" LBE PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(D) 3½"x 5¼" LBE PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(E) 5¼"x 5¼"LBE PARALLAM PSL COLUMN SECURED w/ SIMPSON HTT-5 AT BOTTOM AND (3) HTS-20 AT TOP.

SPECIAL HEADERS:

(H-1) (2) 1¾" x 12" L.V.L HEADER SUPPORTED ON EA. SIDE BY (3) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) MSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

(H-2) (2) 2"x12" BEAM WITH 1/2" PLYWOOD FLITCH SUPPORTED ON EACH SIDE WITH (2) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) LSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

CONNECTOR NOTES:

1. EACH FLOOR TRUSS ATTACHED TO CMU WITH (1) HETA-16 AND (1) MTS-12 AT FRAME CONNECTION (U.N.O.)
2. EACH ROOF TRUSS / RAFTER AT CMU. TO BE ATTACHED WITH (1) HETA-16 (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
3. EACH ROOF TRUSS / RAFTER AT FRAME CONNECTION TO BE (1) MTS-12 AT ALL COMMON TRUSSES & (1) H2.5 AT ALL HIP JACKS (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
4. END JACKS AND CORNER SETS MAY BE (1) H-2.5 (U.N.O.)
5. ROOF SHEATHING TO BE 1/2" NOMINAL OR GREATER OSB. OR CDX. TYPE PLYWOOD NAILED WITH .099x2" RING SHANK NAILS @ 6" O.C. EXCEPT FIRST 4'-0" OF ENTIRE PERIMETER WHICH SHALL BE 6" O.C. FIELD 4" O.C. EDGE.

   WALL SHEATHING TO BE 7/16" OSB. OR 1/2" CDX. NAILED WITH 8d CORROSION RESISTANT NAILS @ 6" O.C. IN FIELD & 4" O.C. @ EDGE (U.N.O.). SEE SHEATHING DETAIL.
6. FLOOR SHEATHING TO BE 3/4" PLYWOOD OR OSB (U.N.O), WITH LONG DIMENSION PERPENDICULAR TO SUPPORT (FLOOR TRUSSES). NAILS: NAILS USED IN ALL FLOORING APPLICATIONS SHALL BE 8d, RING OR SPIRAL SHANK, HAND OR GUN DRIVEN NAILS. GUN DRIVEN NAILS SHALL HAVE HEAD SIZE EQUIVALENT TO HAND DRIVEN NAILS, SPACING SHALL BE 6" ON EDGES AND 12" IN FIELD.

GENERAL NOTES:

1. TRUSS LAYOUT IS AN ARTISTIC REPRESENTATION AND MAY VARY FROM FINAL LAYOUT SUBMITTED BY TRUSS MANUFACTURER. ALL TRUSS LAYOUTS AND PROFILES SHALL BE DESIGNED AND CERTIFIED BY TRUSS MANUFACTURER'S REGISTERED ENGINEER.
2. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.
3. TRUSS MANUFACTURER TO VERIFY ALL TRUSS SPANS, SLOPES, BEARING POINTS, & DIMENSIONS BEFORE FABRICATION. TRUSS MANUFACTURER SHALL COORDINATE LOCATIONS FOR MECHANICAL AND PLUMBING CHASES TO AVOID CONFLICT. ALSO, TRUSS MANUFACTURER TO PROVIDE SHOP DRAWINGS FOR APPROVAL BEFORE FABRICATION.
4. ALL ROOF PITCHES ARE TO BE SET AS INDICATED ON PLANS AND ELEVATIONS.
5. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS, & ELEVATIONS FOR BEARING HEIGHTS.
6. TRUSS SPACING SHALL BE 24" O.C. (U.N.O.) CONVENTIONAL FRAMING SHALL BE 16" O.C.
7. TRUSS MANUFACTURER TO PROVIDE ALL GABLE END TRUSSES WITH INTERMEDIATE STUD MEMBERS @ 16" O.C.
8. ROOF DECKING AS SPECIFIED.
9. ALL ROOF OVERHANGS TO BE 12" UNLESS NOTED OTHERWISE.
10. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON BEARING WALLS AND AT VOLUME AREAS (U.N.O.).
11. ALIGN TRUSSES AND HAND FRAMING SO AS ALL GYPSUM WALL BOARD TO BE CONTINUOUS FROM FLOOR TO CEILING.
12. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:

    12.1. ALL CEILING HUNG SOFFITS AND SOFFITS w/ CABINETS AS SHOWN ON PLANS.

    12.2. ATTIC LOCATED HVAC. UNITS AS SHOWN ON PLANS.
13. PROVIDE AND INSTALL FLASHING & ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE, IN ACCORDANCE WITH FBC-R 2017, 6TH EDITION.
14. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCSI 1.
15. REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
16. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBC-R 2017, 6TH EDITION

BRG. HT. LEGEND

■ - INDICATES A CONCRETE FILLED CELL WITHIN AN 8" CMU WALL CONTAINING (1) VERT. #5 REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM. PROVIDE A MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS.

9'-4" BRG. HT. | 12'-0" BRG. HT. | 15'-0" BRG. HT.
10'-0" BRG. HT. | 13'-4" BRG. HT. | 16'-0" BRG. HT.
11'-4" BRG. HT. | 14'-0" BRG. HT. | BRG. PER PLAN

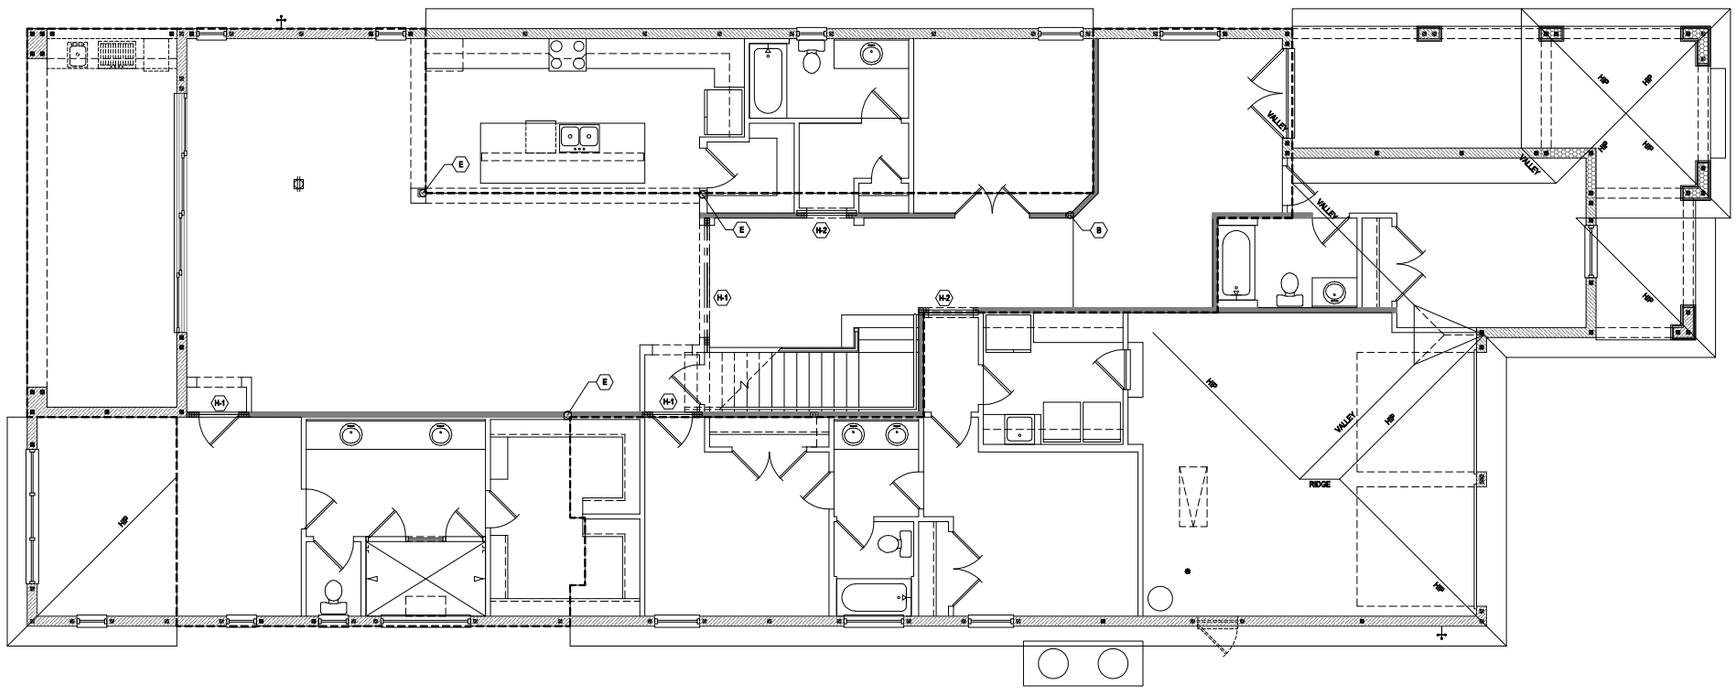

First Floor Truss Plan "A"

(Opt. Second Floor w- Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,6:59pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\0A0 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\11.A1 First Floor Truss plan (Opt. Balcony).dwg

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS custom home design
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
DESIGNERS - PLANNERS

235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premier-structural.com
FL CERT. AUTH.: 29113
FL PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

NOTE: DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions and conditions shown on these drawings prior to commencement of any work.

Your plans have been electronically signed & sealed by Noel Rodriguez, PE, using a digital signature. DO a sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FIRST FLOOR TRUSS

11.A1

POST NOTES:

SPECIAL POSTS:

(A) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP AND SP4 AT BOTTOM

(B) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP & (2) SP-4 AT BOTTOM OF EACH STUD W/ (14) 10d NAILS CAP=1000#

(C) 3½"x 3½" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(D) 3½"x 5¼" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(E) 5¼"x 5¼"1.8E PARALLAM PSL COLUMN SECURED w/ SIMPSON HTT-5 AT BOTTOM AND (3) HTS-20 AT TOP.

SPECIAL HEADERS:

(H-1) (2) 1¾" x 12" L.V.L HEADER SUPPORTED ON EA. SIDE BY (3) 2x JACK STUDS WITH (3) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) MSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

(H-2) (2) 2"x12" BEAM WITH 1/2" PLYWOOD FLITCH SUPPORTED ON EACH SIDE WITH (2) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) LSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

CONNECTOR NOTES:

1. EACH FLOOR TRUSS ATTACHED TO CMU WITH (1) HETA-16 AND (1) MTS-12 AT FRAME CONNECTION (U.N.O.)
2. EACH ROOF TRUSS / RAFTER AT CMU. TO BE ATTACHED WITH (1) HETA-16 (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
3. EACH ROOF TRUSS / RAFTER AT FRAME CONNECTION TO BE (1) MTS-12 AT ALL COMMON TRUSSES & (1) H2.5 AT ALL HIP JACKS (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
4. END JACKS AND CORNER SETS MAY BE (1) H-2.5 (U.N.O.)
5. ROOF SHEATHING TO BE 1/2" NOMINAL OR GREATER OSB. OR CDX. TYPE PLYWOOD NAILED WITH .099x2" RING SHANK NAILS @ 6" O.C. EXCEPT FIRST 4'-0" OF ENTIRE PERIMETER WHICH SHALL BE 6" O.C. FIELD 4" O.C. EDGE.

   WALL SHEATHING TO BE 7/16" OSB. OR 1/2" CDX. NAILED WITH 8d CORROSION RESISTANT NAILS @ 6" O.C. IN FIELD & 4" O.C. @ EDGE (U.N.O.). SEE SHEATHING DETAIL.
6. FLOOR SHEATHING TO BE ¾" PLYWOOD OR OSB (U.N.O), WITH LONG DIMENSION PERPENDICULAR TO SUPPORT (FLOOR TRUSSES), NAILS: NAILS USED IN ALL FLOORING APPLICATIONS SHALL BE 8d, RING OR SPIRAL SHANK, HAND OR GUN DRIVEN NAILS. GUN DRIVEN NAILS SHALL HAVE HEAD SIZE EQUIVALENT TO HAND DRIVEN NAILS, SPACING SHALL BE 6" ON EDGES AND 12" IN FIELD.

GENERAL NOTES:

1. TRUSS LAYOUT IS AN ARTISTIC REPRESENTATION AND MAY VARY FROM FINAL LAYOUT SUBMITTED BY TRUSS MANUFACTURER. ALL TRUSS LAYOUTS AND PROFILES SHALL BE DESIGNED AND CERTIFIED BY TRUSS MANUFACTURER'S REGISTERED ENGINEER.
2. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.
3. TRUSS MANUFACTURER TO VERIFY ALL TRUSS SPANS, SLOPES, BEARING POINTS, & DIMENSIONS BEFORE FABRICATION. TRUSS MANUFACTURER SHALL COORDINATE LOCATIONS FOR MECHANICAL AND PLUMBING CHASES TO AVOID CONFLICT. ALSO, TRUSS MANUFACTURER TO PROVIDE SHOP DRAWINGS FOR APPROVAL BEFORE FABRICATION.
4. ALL ROOF PITCHES ARE TO BE SET AS INDICATED ON PLANS AND ELEVATIONS.
5. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS, & ELEVATIONS FOR BEARING HEIGHTS.
6. TRUSS SPACING SHALL BE 24" O.C. (U.N.O.) CONVENTIONAL FRAMING SHALL BE 16" O.C.
7. TRUSS MANUFACTURER TO PROVIDE ALL GABLE END TRUSSES WITH INTERMEDIATE STUD MEMBERS @ 16" O.C.
8. ROOF DECKING AS SPECIFIED.
9. ALL ROOF OVERHANGS TO BE 12" UNLESS NOTED OTHERWISE.
10. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON BEARING WALLS AND AT VOLUME AREAS (U.N.O.).
11. ALIGN TRUSSES AND HAND FRAMING SO AS ALL GYPSUM WALL BOARD TO BE CONTINUOUS FROM FLOOR TO CEILING.
12. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:

    12.1. ALL CEILING HUNG SOFFITS AND SOFFITS w/ CABINETS AS SHOWN ON PLANS.
    12.2. ATTIC LOCATED HVAC. UNITS AS SHOWN ON PLANS.
13. PROVIDE AND INSTALL FLASHING & ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE, IN ACCORDANCE WITH FBC-R 2017, 6TH EDITION.
14. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCSI 1.
15. REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
16. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBC-R 2017, 6TH EDITION

BRG. HT. LEGEND

■ - INDICATES A CONCRETE FILLED CELL WITHIN AN 8" CMU WALL CONTAINING (1) VERT. #5 REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM. PROVIDE A MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS.

9'-4" BRG. HT. | 12'-0" BRG. HT. | 15'-0" BRG. HT.
10'-0" BRG. HT. | 13'-4" BRG. HT. | 16'-0" BRG. HT.
11'-4" BRG. HT. | 14'-0" BRG. HT. | BRG. PER PLAN

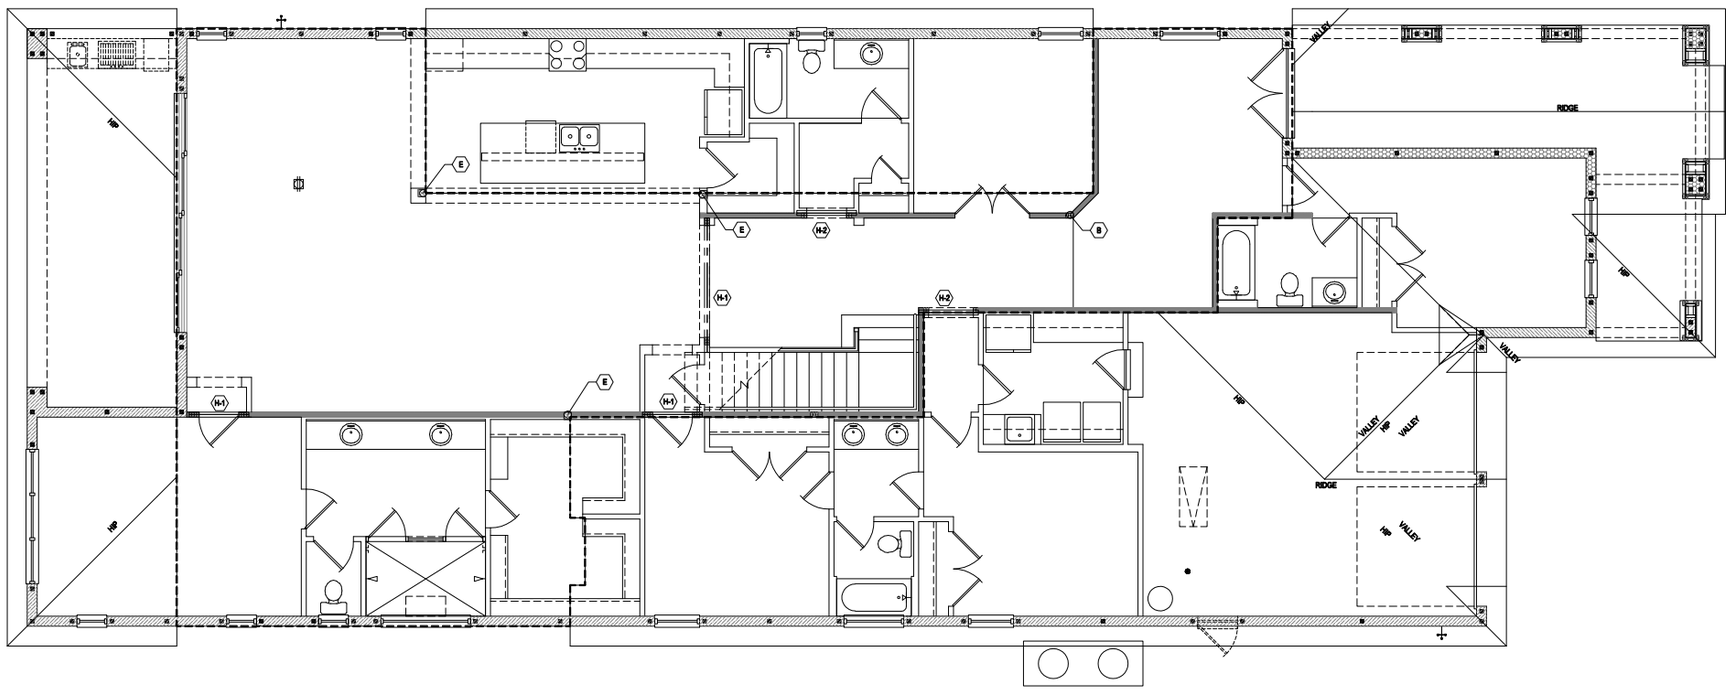

First Floor Truss Plan "B"

(Opt. Second Floor)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATION OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

PREMIER STRUCTURAL ENGINEERING INC.

MJS 815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
custom home design
DESIGNERS - PLANNERS

MEETS DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions/conditions shown on these drawings and specifications before proceeding to do work affected by such variations.

Note: plans have been electronically signed & sealed by Noel Mathews, PE, using a digital signature. SO a raised seal printed copy of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FIRST FLOOR TRUSS

11.B

POST NOTES:

SPECIAL POSTS:

(A) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP AND SP4 AT BOTTOM

(B) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP & (2) SP-4 AT BOTTOM OF EACH STUD W/ (14) 10d NAILS CAP=1000#

(C) 3½"x 3½" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(D) 3½"x 5¼" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(E) 5¼"x 5¼"1.8E PARALLAM PSL COLUMN SECURED w/ SIMPSON HTT-5 AT BOTTOM AND (3) HTS-20 AT TOP.

SPECIAL HEADERS:

(H-1) (2) 1¾" x 12" L.V.L HEADER SUPPORTED ON EA. SIDE BY (3) 2x JACK STUDS WITH (3) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) MSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

(H-2) (2) 2"x12" BEAM WITH 1/2" PLYWOOD FLITCH SUPPORTED ON EACH SIDE WITH (2) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) LSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

CONNECTOR NOTES:

1. EACH FLOOR TRUSS ATTACHED TO CMU WITH (1) HETA-16 AND (1) MTS-12 AT FRAME CONNECTION (U.N.O.)
2. EACH ROOF TRUSS / RAFTER AT CMU. TO BE ATTACHED WITH (1) HETA-16 (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
3. EACH ROOF TRUSS / RAFTER AT FRAME CONNECTION TO BE (1) MTS-12 AT ALL COMMON TRUSSES & (1) H2.5 AT ALL HIP JACKS (U.N.O.). SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
4. END JACKS AND CORNER SETS MAY BE (1) H-2.5 (U.N.O.)
5. ROOF SHEATHING TO BE 1/2" NOMINAL OR GREATER OSB. OR CDX. TYPE PLYWOOD NAILED WITH .099x2" RING SHANK NAILS @ 6" O.C. EXCEPT FIRST 4'-0" OF ENTIRE PERIMETER WHICH SHALL BE 6" O.C. FIELD 4" O.C. EDGE.

   WALL SHEATHING TO BE 7/16" OSB. OR 1/2" CDX. NAILED WITH 8d CORROSION RESISTANT NAILS @ 6" O.C. IN FIELD & 4" O.C. @ EDGE (U.N.O.). SEE SHEATHING DETAIL.
6. FLOOR SHEATHING TO BE 3/4" PLYWOOD OR OSB (U.N.O), WITH LONG DIMENSION PERPENDICULAR TO SUPPORT (FLOOR TRUSSES). NAILS: NAILS USED IN ALL FLOORING APPLICATIONS SHALL BE 8d, RING OR SPIRAL SHANK, HAND OR GUN DRIVEN NAILS. GUN DRIVEN NAILS SHALL HAVE HEAD SIZE EQUIVALENT TO HAND DRIVEN NAILS, SPACING SHALL BE 6" ON EDGES AND 12" IN FIELD.

GENERAL NOTES:

1. TRUSS LAYOUT IS AN ARTISTIC REPRESENTATION AND MAY VARY FROM FINAL LAYOUT SUBMITTED BY TRUSS MANUFACTURER. ALL TRUSS LAYOUTS AND PROFILES SHALL BE DESIGNED AND CERTIFIED BY TRUSS MANUFACTURER'S REGISTERED ENGINEER.
2. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.
3. TRUSS MANUFACTURER TO VERIFY ALL TRUSS SPANS, SLOPES, BEARING POINTS, & DIMENSIONS BEFORE FABRICATION. TRUSS MANUFACTURER SHALL COORDINATE LOCATIONS FOR MECHANICAL AND PLUMBING CHASES TO AVOID CONFLICT. ALSO, TRUSS MANUFACTURER TO PROVIDE SHOP DRAWINGS FOR APPROVAL BEFORE FABRICATION.
4. ALL ROOF PITCHES ARE TO BE SET AS INDICATED ON PLANS AND ELEVATIONS.
5. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS, & ELEVATIONS FOR BEARING HEIGHTS.
6. TRUSS SPACING SHALL BE 24" O.C. (U.N.O.) CONVENTIONAL FRAMING SHALL BE 16" O.C.
7. TRUSS MANUFACTURER TO PROVIDE ALL GABLE END TRUSSES WITH INTERMEDIATE STUD MEMBERS @ 16" O.C.
8. ROOF DECKING AS SPECIFIED.
9. ALL ROOF OVERHANGS TO BE 12" UNLESS NOTED OTHERWISE.
10. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON BEARING WALLS AND AT VOLUME AREAS (U.N.O.).
11. ALIGN TRUSSES AND HAND FRAMING SO AS ALL GYPSUM WALL BOARD TO BE CONTINUOUS FROM FLOOR TO CEILING.
12. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:

    12.1. ALL CEILING HUNG SOFFITS AND SOFFITS w/ CABINETS AS SHOWN ON PLANS.
    12.2. ATTIC LOCATED HVAC. UNITS AS SHOWN ON PLANS.
13. PROVIDE AND INSTALL FLASHING & ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE, IN ACCORDANCE WITH FBC-R 2017, 6TH EDITION.
14. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCSI 1.
15. REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
16. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBC-R 2017, 6TH EDITION

BRG. HT. LEGEND

■ - INDICATES A CONCRETE FILLED CELL WITHIN AN 8" CMU WALL CONTAINING (1) VERT. #5 REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM. PROVIDE A MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS.

9'-4" BRG. HT. | 12'-0" BRG. HT. | 15'-0" BRG. HT.
10'-0" BRG. HT. | 13'-4" BRG. HT. | 16'-0" BRG. HT.
11'-4" BRG. HT. | 14'-0" BRG. HT. | BRG. PER PLAN

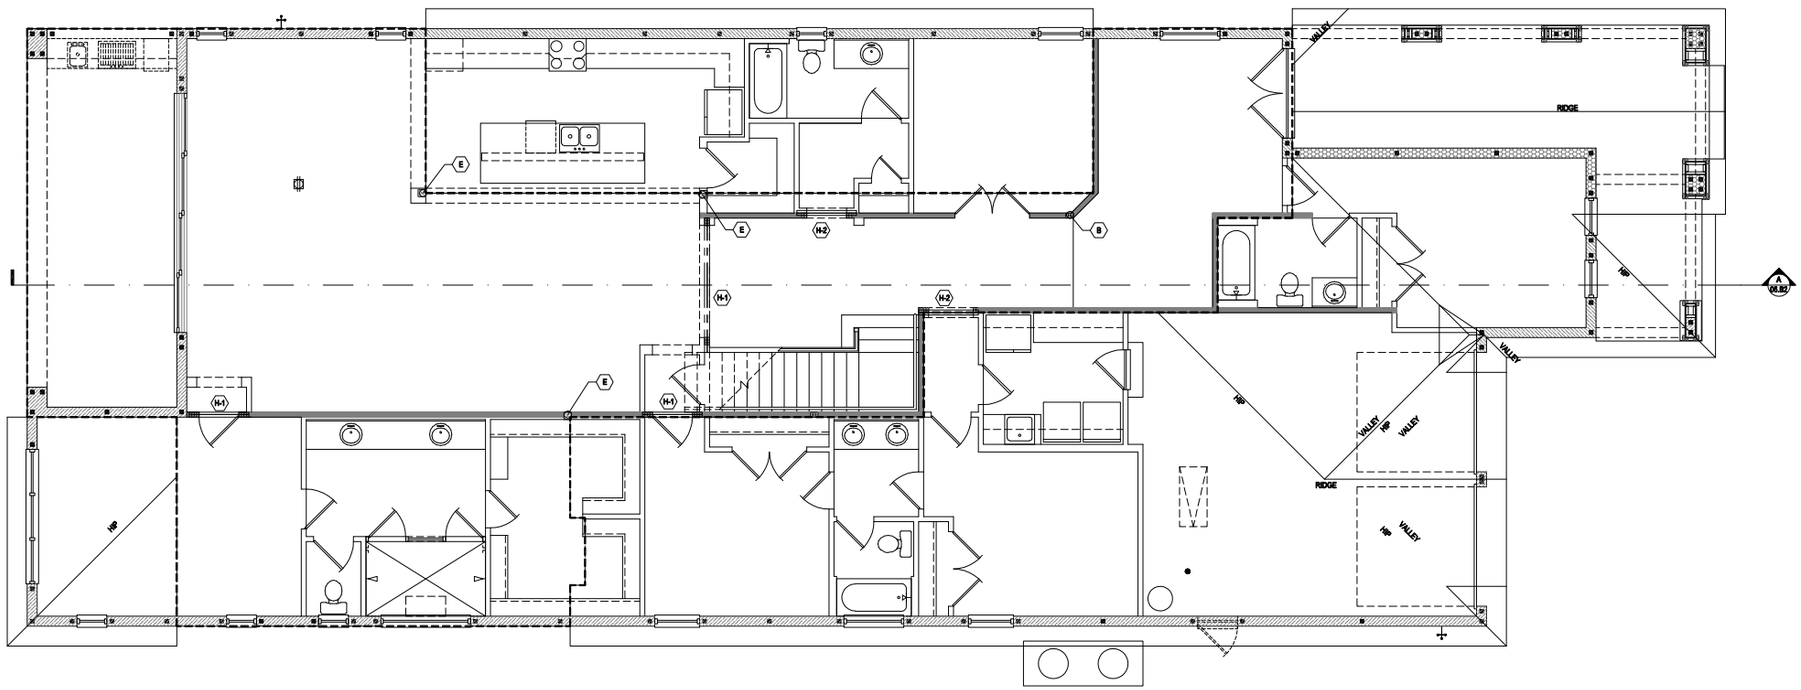

First Floor Truss Plan "B"

(Opt. Second Floor w- Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,6:59pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\04 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\11.B1 First Floor Truss plan (Opt. Balcony).dwg PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATION OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS custom home design
DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER STRUCTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

METER DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions and conditions shown on these drawings before proceeding with the work.

Your plans have been electronically signed & sealed by Noel Mulligan, PE, using a digital signature. DO a sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FIRST FLOOR TRUSS

11.B1

POST NOTES:

SPECIAL POSTS:

(A) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP AND SP4 AT BOTTOM

(B) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP & (2) SP-4 AT BOTTOM OF EACH STUD W/ (14) 10d NAILS CAP=1000#

(C) 3½"x 5¼" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(D) 3½"x 5¼" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(E) 5¼"x 5¼"1.8E PARALLAM PSL COLUMN SECURED w/ SIMPSON HTT-5 AT BOTTOM AND (3) HTS-20 AT TOP.

SPECIAL HEADERS:

(H-1) (2) 1¾" x 12" L.V.L HEADER SUPPORTED ON EA. SIDE BY (3) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) MSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

(H-2) (2) 2"x12" BEAM WITH 1/2" PLYWOOD FLITCH SUPPORTED ON EACH SIDE WITH (2) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) LSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

CONNECTOR NOTES:

1. EACH FLOOR TRUSS ATTACHED TO CMU WITH (1) HETA-16 AND (1) MTS-12 AT FRAME CONNECTION (U.N.O.)
2. EACH ROOF TRUSS / RAFTER AT CMU. TO BE ATTACHED WITH (1) HETA-16 (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
3. EACH ROOF TRUSS / RAFTER AT FRAME CONNECTION TO BE (1) MTS-12 AT ALL COMMON TRUSSES & (1) H2.5 AT ALL HIP JACKS (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
4. END JACKS AND CORNER SETS MAY BE (1) H-2.5 (U.N.O.)
5. ROOF SHEATHING TO BE 1/2" NOMINAL OR GREATER OSB. OR CDX. TYPE PLYWOOD NAILED WITH .099x2" RING SHANK NAILS @ 6" O.C. EXCEPT FIRST 4'-0" OF ENTIRE PERIMETER WHICH SHALL BE 6" O.C. FIELD 4" O.C. EDGE.

   WALL SHEATHING TO BE 7/16" OSB. OR 1/2" CDX. NAILED WITH 8d CORROSION RESISTANT NAILS @ 6" O.C. IN FIELD & 4" O.C. @ EDGE (U.N.O.). SEE SHEATHING DETAIL.
6. FLOOR SHEATHING TO BE ¾" PLYWOOD OR OSB (U.N.O), WITH LONG DIMENSION PERPENDICULAR TO SUPPORT (FLOOR TRUSSES), NAILS: NAILS USED IN ALL FLOORING APPLICATIONS SHALL BE 8d, RING OR SPIRAL SHANK, HAND OR GUN DRIVEN NAILS. GUN DRIVEN NAILS SHALL HAVE HEAD SIZE EQUIVALENT TO HAND DRIVEN NAILS, SPACING SHALL BE 6" ON EDGES AND 12" IN FIELD.

GENERAL NOTES:

1. TRUSS LAYOUT IS AN ARTISTIC REPRESENTATION AND MAY VARY FROM FINAL LAYOUT SUBMITTED BY TRUSS MANUFACTURER. ALL TRUSS LAYOUTS AND PROFILES SHALL BE DESIGNED AND CERTIFIED BY TRUSS MANUFACTURER'S REGISTERED ENGINEER.
2. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.
3. TRUSS MANUFACTURER TO VERIFY ALL TRUSS SPANS, SLOPES, BEARING POINTS, & DIMENSIONS BEFORE FABRICATION. TRUSS MANUFACTURER SHALL COORDINATE LOCATIONS FOR MECHANICAL AND PLUMBING CHASES TO AVOID CONFLICT. ALSO, TRUSS MANUFACTURER TO PROVIDE SHOP DRAWINGS FOR APPROVAL BEFORE FABRICATION.
4. ALL ROOF PITCHES ARE TO BE SET AS INDICATED ON PLANS AND ELEVATIONS.
5. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS, & ELEVATIONS FOR BEARING HEIGHTS.
6. TRUSS SPACING SHALL BE 24" O.C. (U.N.O.) CONVENTIONAL FRAMING SHALL BE 16" O.C.
7. TRUSS MANUFACTURER TO PROVIDE ALL GABLE END TRUSSES WITH INTERMEDIATE STUD MEMBERS @ 16" O.C.
8. ROOF DECKING AS SPECIFIED.
9. ALL ROOF OVERHANGS TO BE 12" UNLESS NOTED OTHERWISE.
10. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON BEARING WALLS AND AT VOLUME AREAS (U.N.O.).
11. ALIGN TRUSSES AND HAND FRAMING SO AS ALL GYPSUM WALL BOARD TO BE CONTINUOUS FROM FLOOR TO CEILING.
12. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:

    12.1. ALL CEILING HUNG SOFFITS AND SOFFITS w/ CABINETS AS SHOWN ON PLANS.

    12.2. ATTIC LOCATED HVAC. UNITS AS SHOWN ON PLANS.
13. PROVIDE AND INSTALL FLASHING & ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE, IN ACCORDANCE WITH FBC-R 2017, 6TH EDITION.
14. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCSI 1.
15. REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
16. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBC-R 2017, 6TH EDITION

BRG. HT. LEGEND

■ - INDICATES A CONCRETE FILLED CELL WITHIN AN 8" CMU WALL CONTAINING (1) VERT. #5 REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM. PROVIDE A MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS.

9'-4" BRG. HT. | 12'-0" BRG. HT. | 15'-0" BRG. HT.
10'-0" BRG. HT. | 13'-4" BRG. HT. | 16'-0" BRG. HT.
11'-4" BRG. HT. | 14'-0" BRG. HT. | BRG. PER PLAN

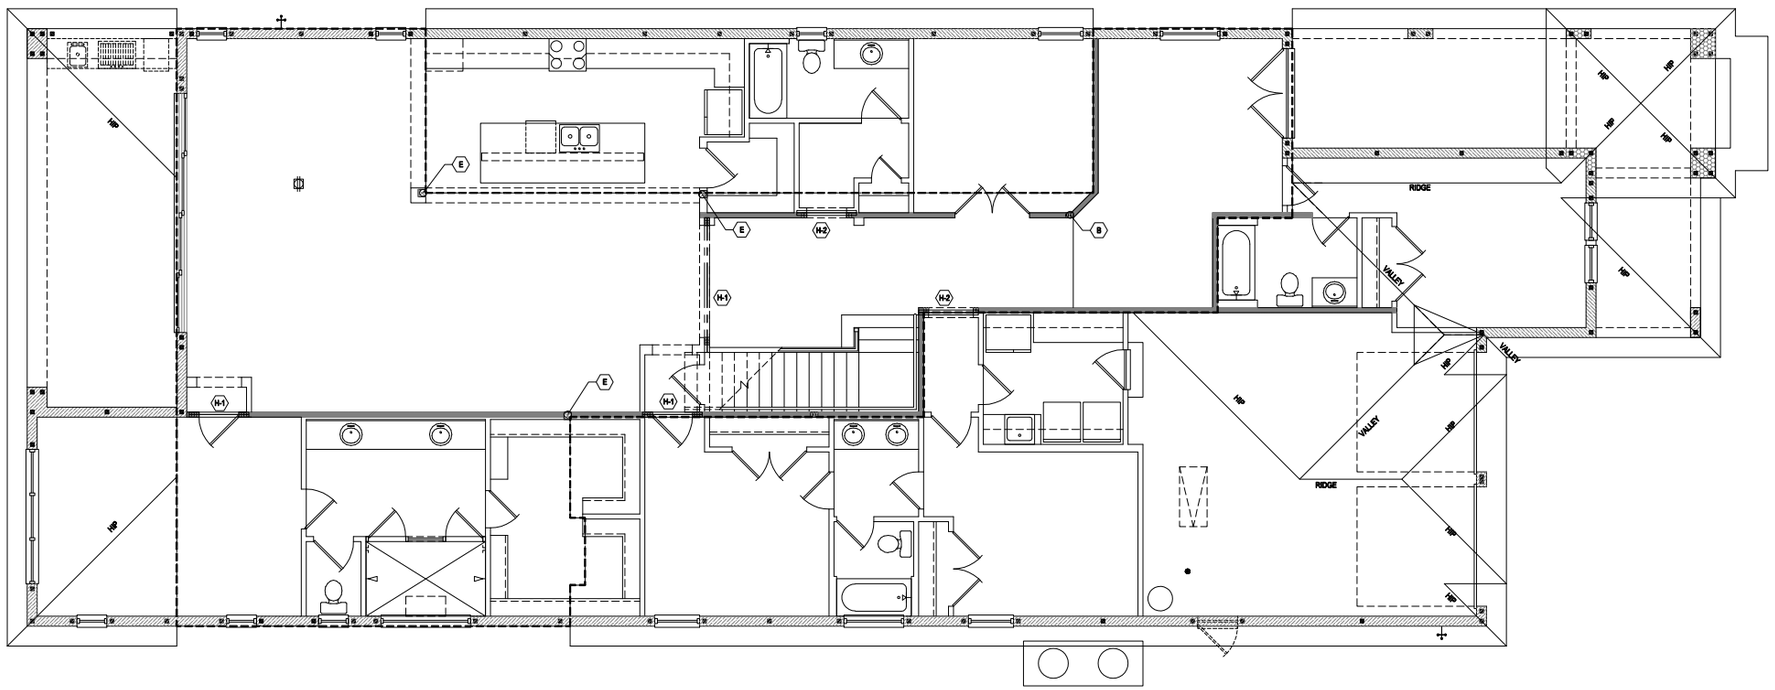

First Floor Truss Plan "C"

(Opt. Second Floor)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,7:00pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\11.C First Floor Truss plan.dwg ALL DESIGNS PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATION OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS custom home design
DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER STRUCTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

MEETER DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions and conditions shown on these drawings before proceeding with any work affected thereby.

Your plans have been electronically signed & sealed by Noel Gallegos, PE, using a digital signature. DO a raised seal printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FIRST FLOOR TRUSS

11.C

POST NOTES:

SPECIAL POSTS:

(A) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP AND SP4 AT BOTTOM

(B) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP & (2) SP-4 AT BOTTOM OF EACH STUD W/ (14) 10d NAILS CAP=1000#

(C) $3\frac{1}{2}$"x $3\frac{1}{2}$" LBE PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(D) $3\frac{1}{2}$"x $5\frac{1}{2}$" LBE PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(E) $5\frac{1}{2}$"x $5\frac{1}{2}$"LBE PARALLAM PSL COLUMN SECURED w/ SIMPSON HTT-5 AT BOTTOM AND (3) HTS-20 AT TOP.

SPECIAL HEADERS:

(H-1) (2) $1\frac{3}{4}$" x 12" L.V.L HEADER SUPPORTED ON EA. SIDE BY (3) 2x JACK STUDS WITH (3) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) MSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

(H-2) (2) 2"x12" BEAM WITH 1/2" PLYWOOD FLITCH SUPPORTED ON EACH SIDE WITH (2) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) LSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

CONNECTOR NOTES:

1. EACH FLOOR TRUSS ATTACHED TO CMU WITH (1) HETA-16 AND (1) MTS-12 AT FRAME CONNECTION (U.N.O.)
2. EACH ROOF TRUSS / RAFTER AT CMU. TO BE ATTACHED WITH (1) HETA-16 (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
3. EACH ROOF TRUSS / RAFTER AT FRAME CONNECTION TO BE (1) MTS-12 AT ALL COMMON TRUSSES & (1) H2.5 AT ALL HIP JACKS (U.N.O.). SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
4. END JACKS AND CORNER SETS MAY BE (1) H-2.5 (U.N.O.)
5. ROOF SHEATHING TO BE 1/2" NOMINAL OR GREATER OSB. OR CDX. TYPE PLYWOOD NAILED WITH .099x2" RING SHANK NAILS @ 6" O.C. EXCEPT FIRST 4'-0" OF ENTIRE PERIMETER WHICH SHALL BE 6" O.C. FIELD 4" O.C. EDGE.

   WALL SHEATHING TO BE 7/16" OSB. OR 1/2" CDX. NAILED WITH 8d CORROSION RESISTANT NAILS @ 6" O.C. IN FIELD & 4" O.C. @ EDGE (U.N.O.). SEE SHEATHING DETAIL.
6. FLOOR SHEATHING TO BE $\frac{3}{4}$" PLYWOOD OR OSB (U.N.O), WITH LONG DIMENSION PERPENDICULAR TO SUPPORT (FLOOR TRUSSES). NAILS: NAILS USED IN ALL FLOORING APPLICATIONS SHALL BE 8d, RING OR SPIRAL SHANK, HAND OR GUN DRIVEN NAILS. GUN DRIVEN NAILS SHALL HAVE HEAD SIZE EQUIVALENT TO HAND DRIVEN NAILS, SPACING SHALL BE 6" ON EDGES AND 12" IN FIELD.

GENERAL NOTES:

1. TRUSS LAYOUT IS AN ARTISTIC REPRESENTATION AND MAY VARY FROM FINAL LAYOUT SUBMITTED BY TRUSS MANUFACTURER. ALL TRUSS LAYOUTS AND PROFILES SHALL BE DESIGNED AND CERTIFIED BY TRUSS MANUFACTURER'S REGISTERED ENGINEER.
2. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.
3. TRUSS MANUFACTURER TO VERIFY ALL TRUSS SPANS, SLOPES, BEARING POINTS, & DIMENSIONS BEFORE FABRICATION. TRUSS MANUFACTURER SHALL COORDINATE LOCATIONS FOR MECHANICAL AND PLUMBING CHASES TO AVOID CONFLICT. ALSO, TRUSS MANUFACTURER TO PROVIDE SHOP DRAWINGS FOR APPROVAL BEFORE FABRICATION.
4. ALL ROOF PITCHES ARE TO BE SET AS INDICATED ON PLANS AND ELEVATIONS.
5. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS, & ELEVATIONS FOR BEARING HEIGHTS.
6. TRUSS SPACING SHALL BE 24" O.C. (U.N.O.) CONVENTIONAL FRAMING SHALL BE 16" O.C.
7. TRUSS MANUFACTURER TO PROVIDE ALL GABLE END TRUSSES WITH INTERMEDIATE STUD MEMBERS @ 16" O.C.
8. ROOF DECKING AS SPECIFIED.
9. ALL ROOF OVERHANGS TO BE 12" UNLESS NOTED OTHERWISE.
10. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON BEARING WALLS AND AT VOLUME AREAS (U.N.O.).
11. ALIGN TRUSSES AND HAND FRAMING SO AS ALL GYPSUM WALL BOARD TO BE CONTINUOUS FROM FLOOR TO CEILING.
12. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:

    12.1. ALL CEILING HUNG SOFFITS AND SOFFITS w/ CABINETS AS SHOWN ON PLANS.
    12.2. ATTIC LOCATED HVAC. UNITS AS SHOWN ON PLANS.
13. PROVIDE AND INSTALL FLASHING & ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE, IN ACCORDANCE WITH FBC-R 2017, 6TH EDITION.
14. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCSI 1.
15. REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
16. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBC-R 2017, 6TH EDITION

BRG. HT. LEGEND

■ - INDICATES A CONCRETE FILLED CELL WITHIN AN 8" CMU WALL CONTAINING (1) VERT. #5 REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM. PROVIDE A MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS.

9'-4" BRG. HT. | 12'-0" BRG. HT. | 15'-0" BRG. HT.
10'-0" BRG. HT. | 13'-4" BRG. HT. | 16'-0" BRG. HT.
11'-4" BRG. HT. | 14'-0" BRG. HT. | BRG. PER PLAN

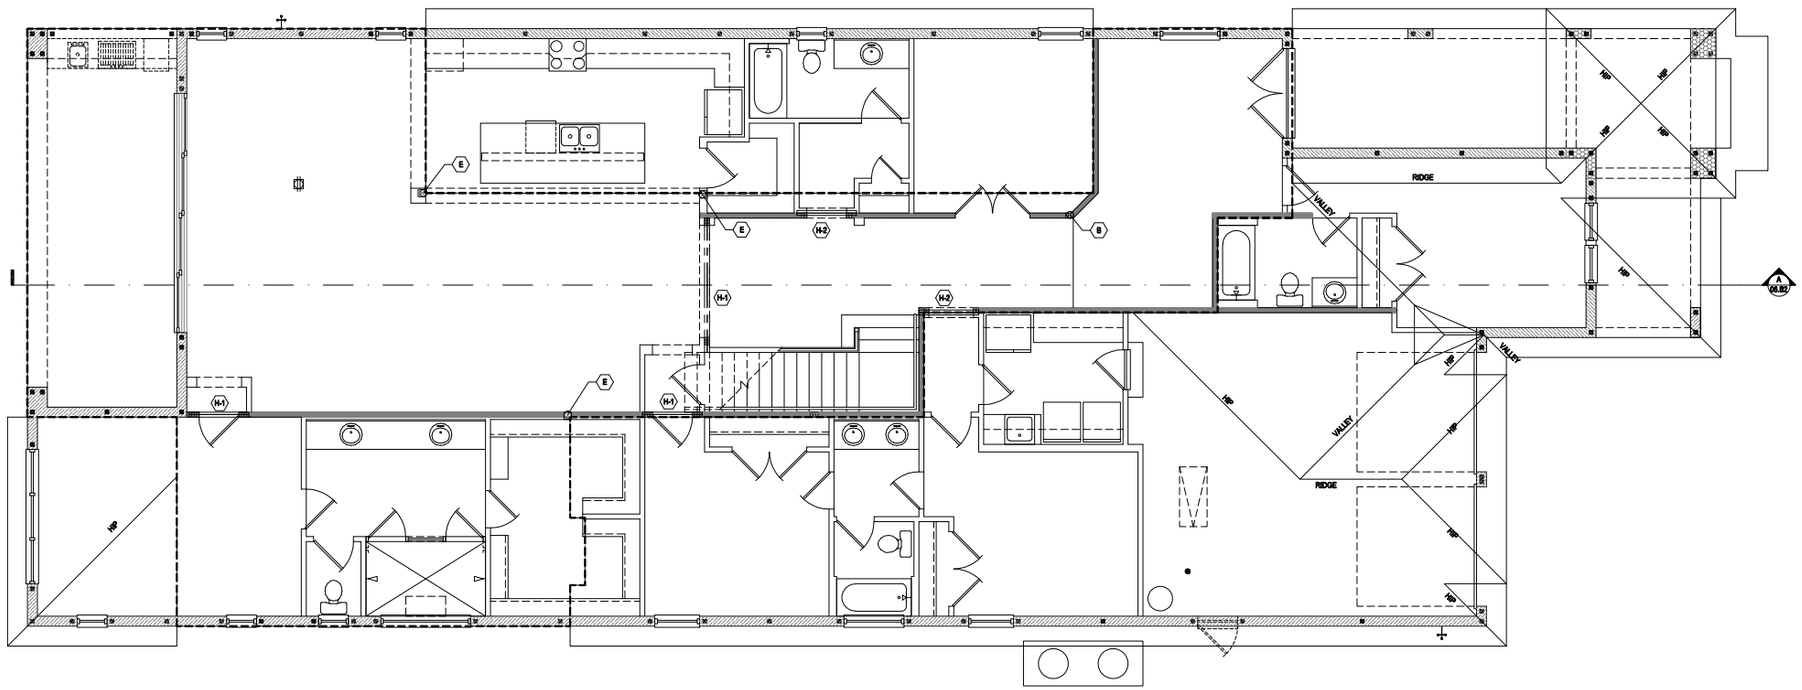

First Floor Truss Plan "C"

(Opt. Second Floor w- Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,7:00pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\11.C1 First Floor Truss plan (Opt. Balcony).dwg

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OF FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS custom home design
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
DESIGNERS - PLANNERS

PREMIER STRUCTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL CERT. AUTH.: 29113
FL PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

NOTES: DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions, conditions and specifications shown on these plans.

These plans have been electronically signed & sealed by Noel Mackenzie, PE, using a digital signature. In a sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

FIRST FLOOR TRUSS

11.C1

POST NOTES:

SPECIAL POSTS:

(A) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP AND SP4 AT BOTTOM

(B) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP & (2) SP-4 AT BOTTOM OF EACH STUD W/ (14) 10d NAILS CAP=10000#

(C) $3\frac{1}{2}$"x $3\frac{1}{2}$" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(D) $3\frac{1}{2}$"x $5\frac{1}{2}$" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(E) $5\frac{1}{2}$"x $5\frac{1}{2}$"1.8E PARALLAM PSL COLUMN SECURED w/ SIMPSON HTT-5 AT BOTTOM AND (3) HTS-20 AT TOP.

SPECIAL HEADERS:

(H-1) (2) $1\frac{7}{8}$" x 12" L.V.L HEADER SUPPORTED ON EA. SIDE BY (3) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) MSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

(H-2) (2) 2"x12" BEAM WITH 1/2" PLYWOOD FLITCH SUPPORTED ON EACH SIDE WITH (2) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) LSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

CONNECTOR NOTES:

1. EACH FLOOR TRUSS ATTACHED TO CMU WITH (1) HETA-16 AND (1) MTS-12 AT FRAME CONNECTION (U.N.O.)
2. EACH ROOF TRUSS / RAFTER AT CMU. TO BE ATTACHED WITH (1) HETA-16 (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
3. EACH ROOF TRUSS / RAFTER AT FRAME CONNECTION TO BE (1) MTS-12 AT ALL COMMON TRUSSES & (1) H2.5 AT ALL HIP JACKS (U.N.O.). SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
4. END JACKS AND CORNER SETS MAY BE (1) H-2.5 (U.N.O.)
5. ROOF SHEATHING TO BE 1/2" NOMINAL OR GREATER OSB. OR CDX. TYPE PLYWOOD NAILED WITH .099x2" RING SHANK NAILS @ 6" O.C. EXCEPT FIRST 4'-0" OF ENTIRE PERIMETER WHICH SHALL BE 6" O.C. FIELD 4" O.C. EDGE.

   WALL SHEATHING TO BE 7/16" OSB. OR 1/2" CDX. NAILED WITH 8d CORROSION RESISTANT NAILS @ 6" O.C. IN FIELD & 4" O.C. @ EDGE (U.N.O.). SEE SHEATHING DETAIL.
6. FLOOR SHEATHING TO BE $\frac{3}{4}$" PLYWOOD OR OSB (U.N.O), WITH LONG DIMENSION PERPENDICULAR TO SUPPORT (FLOOR TRUSSES). NAILS: NAILS USED IN ALL FLOORING APPLICATIONS SHALL BE 8d, RING OR SPIRAL SHANK, HAND OR GUN DRIVEN NAILS. GUN DRIVEN NAILS SHALL HAVE HEAD SIZE EQUIVALENT TO HAND DRIVEN NAILS, SPACING SHALL BE 6" ON EDGES AND 12" IN FIELD.

GENERAL NOTES:

1. TRUSS LAYOUT IS AN ARTISTIC REPRESENTATION AND MAY VARY FROM FINAL LAYOUT SUBMITTED BY TRUSS MANUFACTURER. ALL TRUSS LAYOUTS AND PROFILES SHALL BE DESIGNED AND CERTIFIED BY TRUSS MANUFACTURER'S REGISTERED ENGINEER.
2. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.
3. TRUSS MANUFACTURER TO VERIFY ALL TRUSS SPANS, SLOPES, BEARING POINTS, & DIMENSIONS BEFORE FABRICATION. TRUSS MANUFACTURER SHALL COORDINATE LOCATIONS FOR MECHANICAL AND PLUMBING CHASES TO AVOID CONFLICT. ALSO, TRUSS MANUFACTURER TO PROVIDE SHOP DRAWINGS FOR APPROVAL BEFORE FABRICATION.
4. ALL ROOF PITCHES ARE TO BE SET AS INDICATED ON PLANS AND ELEVATIONS.
5. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS, & ELEVATIONS FOR BEARING HEIGHTS.
6. TRUSS SPACING SHALL BE 24" O.C. (U.N.O.) CONVENTIONAL FRAMING SHALL BE 16" O.C.
7. TRUSS MANUFACTURER TO PROVIDE ALL GABLE END TRUSSES WITH INTERMEDIATE STUD MEMBERS @ 16" O.C.
8. ROOF DECKING AS SPECIFIED.
9. ALL ROOF OVERHANGS TO BE 12" UNLESS NOTED OTHERWISE.
10. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON BEARING WALLS AND AT VOLUME AREAS (U.N.O.).
11. ALIGN TRUSSES AND HAND FRAMING SO AS ALL GYPSUM WALL BOARD TO BE CONTINUOUS FROM FLOOR TO CEILING.
12. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:

    12.1. ALL CEILING HUNG SOFFITS AND SOFFITS w/ CABINETS AS SHOWN ON PLANS.
    12.2. ATTIC LOCATED HVAC. UNITS AS SHOWN ON PLANS.
13. PROVIDE AND INSTALL FLASHING & ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE, IN ACCORDANCE WITH FBC-R 2017, 6TH EDITION.
14. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCSI 1.
15. REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
16. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBC-R 2017, 6TH EDITION

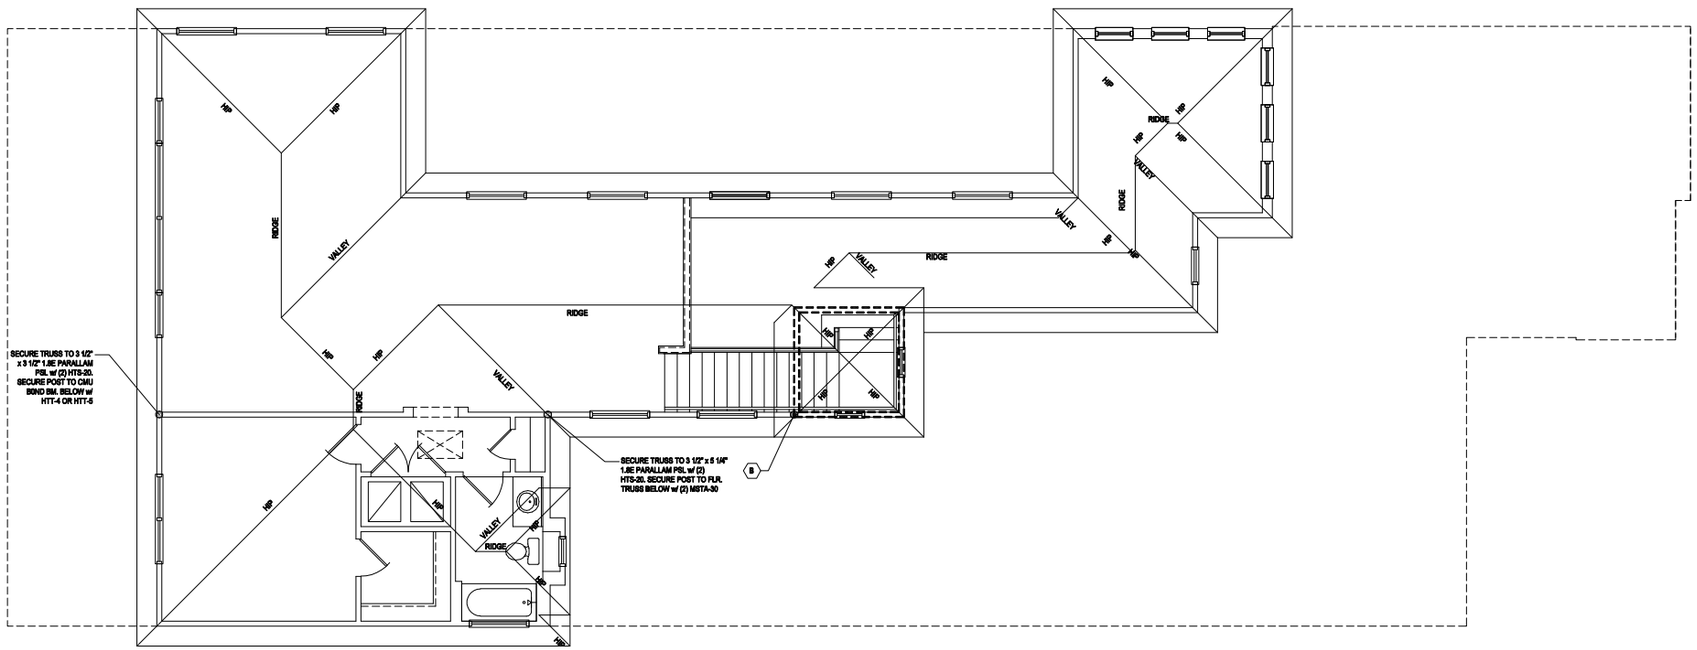

Second Floor Truss Plan "A"

(Opt. Second Floor)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,7:00pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\07 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\12.A Second Floor Truss plan.dwg ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS custom home designs
DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER ARCHITECTURAL ENGINEERING
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL CERT. AUTH.: 29113
FL PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

NOTES: DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variances from dimensions and conditions on the job prior to construction. Plans not to be scaled. Signature must be verified on any electronic copies.

Your plans have been electronically signed & sealed by Noel Rodriguez, PE, using a digital signature. DO is sealed and printed copies of this document are not considered Signed & Sealed.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

SECOND FLOOR TRUSS

12.A

POST NOTES:

SPECIAL POSTS:

(A) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP AND SP4 AT BOTTOM

(B) (6) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP & (2) SP-4 AT BOTTOM OF EACH STUD W/ (14) 10d NAILS CAP=10000#

(C) $3\frac{1}{2}$"x $3\frac{1}{2}$" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(D) $3\frac{1}{2}$"x $5\frac{1}{2}$" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(E) $5\frac{1}{2}$"x $5\frac{1}{2}$"1.8E PARALLAM PSL COLUMN SECURED w/ SIMPSON HTT-5 AT BOTTOM AND (3) HTS-20 AT TOP.

SPECIAL HEADERS:

(H-1) (2) $1\frac{3}{4}$" x 12" L.V.L HEADER SUPPORTED ON EA. SIDE BY (3) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) MSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

(H-2) (2) 2"x12" BEAM WITH 1/2" PLYWOOD FLITCH SUPPORTED ON EACH SIDE WITH (2) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) LSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

CONNECTOR NOTES:

1. EACH FLOOR TRUSS ATTACHED TO CMU WITH (1) HETA-16 AND (1) MTS-12 AT FRAME CONNECTION (U.N.O.)
2. EACH ROOF TRUSS / RAFTER AT CMU. TO BE ATTACHED WITH (1) HETA-16 (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
3. EACH ROOF TRUSS / RAFTER AT FRAME CONNECTION TO BE (1) MTS-12 AT ALL COMMON TRUSSES & (1) H2.5 AT ALL HIP JACKS (U.N.O.). SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
4. ENDJACKS AND CORNER SETS MAY BE (1) H-2.5 (U.N.O.)
5. ROOF SHEATHING TO BE 1/2" NOMINAL OR GREATER OSB. OR CDX. TYPE PLYWOOD NAILED WITH .099x2" RING SHANK NAILS @ 6" O.C. EXCEPT FIRST 4'-0" OF ENTIRE PERIMETER WHICH SHALL BE 6" O.C. FIELD 4" O.C. EDGE.

   WALL SHEATHING TO BE 7/16" OSB. OR 1/2" CDX. NAILED WITH 8d CORROSION RESISTANT NAILS @ 6" O.C. IN FIELD & 4" O.C. @ EDGE (U.N.O.). SEE SHEATHING DETAIL.
6. FLOOR SHEATHING TO BE $\frac{3}{4}$" PLYWOOD OR OSB (U.N.O), WITH LONG DIMENSION PERPENDICULAR TO SUPPORT (FLOOR TRUSSES), NAILS: NAILS USED IN ALL FLOORING APPLICATIONS SHALL BE 8d, RING OR SPIRAL SHANK, HAND OR GUN DRIVEN NAILS. GUN DRIVEN NAILS SHALL HAVE HEAD SIZE EQUIVALENT TO HAND DRIVEN NAILS, SPACING SHALL BE 6" ON EDGES AND 12" IN FIELD.

GENERAL NOTES:

1. TRUSS LAYOUT IS AN ARTISTIC REPRESENTATION AND MAY VARY FROM FINAL LAYOUT SUBMITTED BY TRUSS MANUFACTURER. ALL TRUSS LAYOUTS AND PROFILES SHALL BE DESIGNED AND CERTIFIED BY TRUSS MANUFACTURER'S REGISTERED ENGINEER.
2. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.
3. TRUSS MANUFACTURER TO VERIFY ALL TRUSS SPANS, SLOPES, BEARING POINTS, & DIMENSIONS BEFORE FABRICATION. TRUSS MANUFACTURER SHALL COORDINATE LOCATIONS FOR MECHANICAL AND PLUMBING CHASES TO AVOID CONFLICT. ALSO, TRUSS MANUFACTURER TO PROVIDE SHOP DRAWINGS FOR APPROVAL BEFORE FABRICATION.
4. ALL ROOF PITCHES ARE TO BE SET AS INDICATED ON PLANS AND ELEVATIONS.
5. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS, & ELEVATIONS FOR BEARING HEIGHTS.
6. TRUSS SPACING SHALL BE 24" O.C. (U.N.O.) CONVENTIONAL FRAMING SHALL BE 16" O.C.
7. TRUSS MANUFACTURER TO PROVIDE ALL GABLE END TRUSSES WITH INTERMEDIATE STUD MEMBERS @ 16" O.C.
8. ROOF DECKING AS SPECIFIED.
9. ALL ROOF OVERHANGS TO BE 12" UNLESS NOTED OTHERWISE.
10. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON BEARING WALLS AND AT VOLUME AREAS (U.N.O.).
11. ALIGN TRUSSES AND HAND FRAMING SO AS ALL GYPSUM WALL BOARD TO BE CONTINUOUS FROM FLOOR TO CEILING.
12. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:

    12.1. ALL CEILING HUNG SOFFITS AND SOFFITS w/ CABINETS AS SHOWN ON PLANS.
    12.2. ATTIC LOCATED HVAC. UNITS AS SHOWN ON PLANS.
13. PROVIDE AND INSTALL FLASHING & ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE, IN ACCORDANCE WITH FBC-R 2017, 6TH EDITION.
14. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCSI 1.
15. REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
16. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBC-R 2017, 6TH EDITION

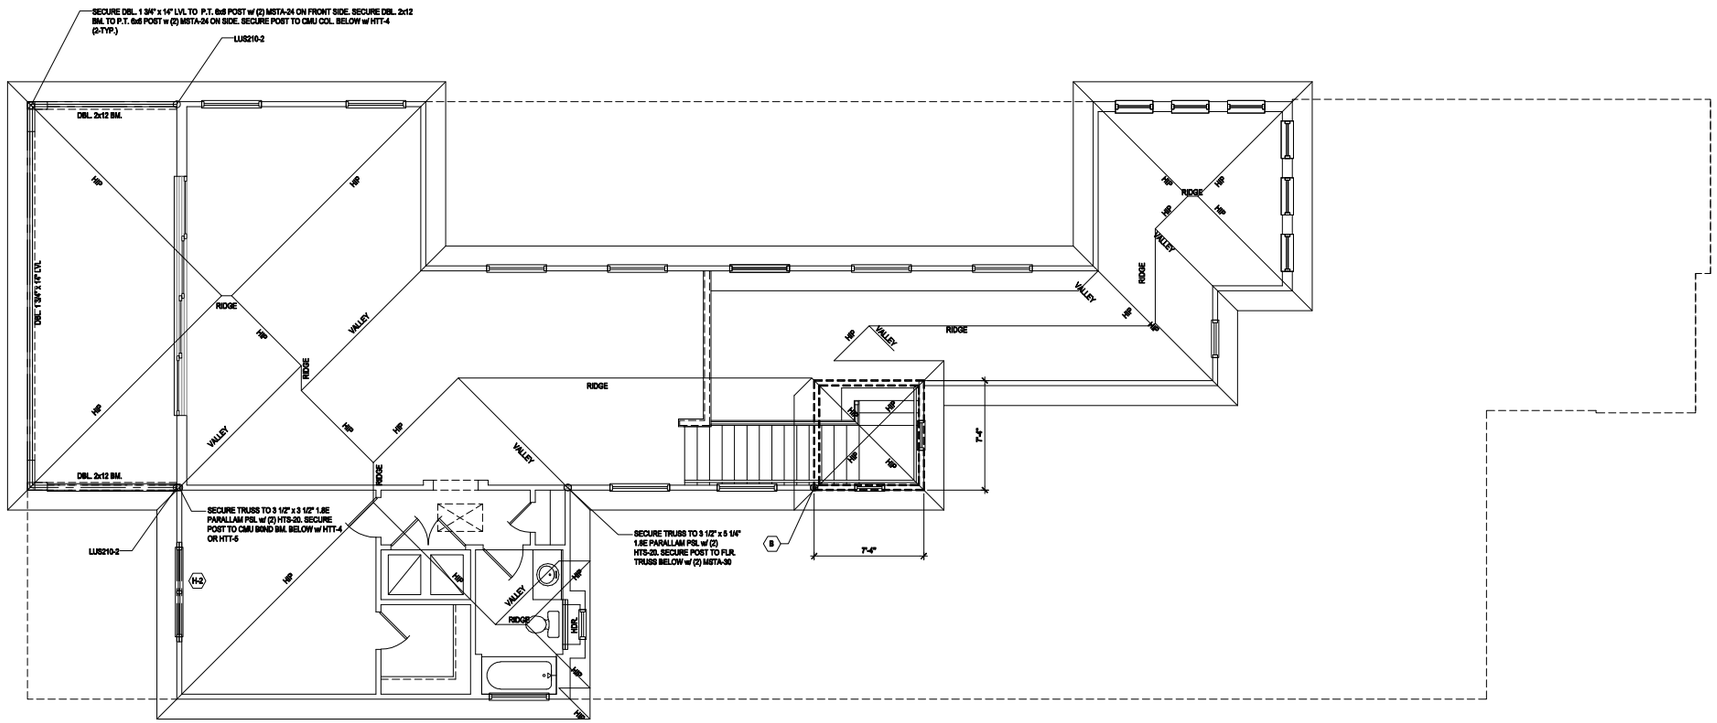

Second Floor Truss Plan "A"

(Opt. Second Floor w- Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,7:00pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\07 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\12.A1 Second Floor Truss plan (Opt. Balcony).dwg

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS custom home design DESIGNERS • PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER STRUCTURAL ENGINEERING
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL CERT. AUTH.: 29113
FL PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

METER DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variance from the dimensions conditions and specifications shown on these drawings.

Your plans have been electronically signed & sealed by Noel Rodriguez, PE, using a digital signature. DO a raised seal printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

SECOND FLOOR TRUSS

12.A1

POST NOTES:

SPECIAL POSTS:

(A) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP AND SP4 AT BOTTOM

(B) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP & (2) SP-4 AT BOTTOM OF EACH STUD W/ (14) 10d NAILS CAP=1000#

(C) $3\frac{1}{2}$"x $3\frac{1}{2}$" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(D) $3\frac{1}{2}$"x $5\frac{1}{2}$" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(E) $5\frac{1}{2}$"x $5\frac{1}{2}$"1.8E PARALLAM PSL COLUMN SECURED w/ SIMPSON HTT-5 AT BOTTOM AND (3) HTS-20 AT TOP.

SPECIAL HEADERS:

(H-1) (2) $1\frac{3}{4}$" x 12" L.V.L HEADER SUPPORTED ON EA. SIDE BY (3) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) MSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

(H-2) (2) 2"x12" BEAM WITH 1/2" PLYWOOD FLITCH SUPPORTED ON EACH SIDE WITH (2) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) LSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

CONNECTOR NOTES:

1. EACH FLOOR TRUSS ATTACHED TO CMU WITH (1) HETA-16 AND (1) MTS-12 AT FRAME CONNECTION (U.N.O.)
2. EACH ROOF TRUSS / RAFTER AT CMU. TO BE ATTACHED WITH (1) HETA-16 (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
3. EACH ROOF TRUSS / RAFTER AT FRAME CONNECTION TO BE (1) MTS-12 AT ALL COMMON TRUSSES & (1) H2.5 AT ALL HIP JACKS (U.N.O.). SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
4. END JACKS AND CORNER SETS MAY BE (1) H-2.5 (U.N.O.)
5. ROOF SHEATHING TO BE 1/2" NOMINAL OR GREATER OSB. OR CDX. TYPE PLYWOOD NAILED WITH .099x2" RING SHANK NAILS @ 6" O.C. EXCEPT FIRST 4'-0" OF ENTIRE PERIMETER WHICH SHALL BE 6" O.C. FIELD 4" O.C. EDGE.

   WALL SHEATHING TO BE 7/16" OSB. OR 1/2" CDX. NAILED WITH 8d CORROSION RESISTANT NAILS @ 6" O.C. IN FIELD & 4" O.C. @ EDGE (U.N.O.). SEE SHEATHING DETAIL.
6. FLOOR SHEATHING TO BE $\frac{3}{4}$" PLYWOOD OR OSB (U.N.O), WITH LONG DIMENSION PERPENDICULAR TO SUPPORT (FLOOR TRUSSES), NAILS: NAILS USED IN ALL FLOORING APPLICATIONS SHALL BE 8d, RING OR SPIRAL SHANK, HAND OR GUN DRIVEN NAILS. GUN DRIVEN NAILS SHALL HAVE HEAD SIZE EQUIVALENT TO HAND DRIVEN NAILS, SPACING SHALL BE 6" ON EDGES AND 12" IN FIELD.

GENERAL NOTES:

1. TRUSS LAYOUT IS AN ARTISTIC REPRESENTATION AND MAY VARY FROM FINAL LAYOUT SUBMITTED BY TRUSS MANUFACTURER. ALL TRUSS LAYOUTS AND PROFILES SHALL BE DESIGNED AND CERTIFIED BY TRUSS MANUFACTURER'S REGISTERED ENGINEER.
2. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.
3. TRUSS MANUFACTURER TO VERIFY ALL TRUSS SPANS, SLOPES, BEARING POINTS, & DIMENSIONS BEFORE FABRICATION. TRUSS MANUFACTURER SHALL COORDINATE LOCATIONS FOR MECHANICAL AND PLUMBING CHASES TO AVOID CONFLICT. ALSO, TRUSS MANUFACTURER TO PROVIDE SHOP DRAWINGS FOR APPROVAL BEFORE FABRICATION.
4. ALL ROOF PITCHES ARE TO BE SET AS INDICATED ON PLANS AND ELEVATIONS.
5. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS, & ELEVATIONS FOR BEARING HEIGHTS.
6. TRUSS SPACING SHALL BE 24" O.C. (U.N.O.) CONVENTIONAL FRAMING SHALL BE 16" O.C.
7. TRUSS MANUFACTURER TO PROVIDE ALL GABLE END TRUSSES WITH INTERMEDIATE STUD MEMBERS @ 16" O.C.
8. ROOF DECKING AS SPECIFIED.
9. ALL ROOF OVERHANGS TO BE 12" UNLESS NOTED OTHERWISE.
10. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON BEARING WALLS AND AT VOLUME AREAS (U.N.O.).
11. ALIGN TRUSSES AND HAND FRAMING SO AS ALL GYPSUM WALL BOARD TO BE CONTINUOUS FROM FLOOR TO CEILING.
12. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:

    12.1. ALL CEILING HUNG SOFFITS AND SOFFITS w/ CABINETS AS SHOWN ON PLANS.
    12.2. ATTIC LOCATED HVAC. UNITS AS SHOWN ON PLANS.
13. PROVIDE AND INSTALL FLASHING & ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE, IN ACCORDANCE WITH FBC-R 2017, 6TH EDITION.
14. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCSI 1.
15. REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
16. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBC-R 2017, 6TH EDITION

BRG. HT. LEGEND

■ - INDICATES A CONCRETE FILLED CELL WITHIN AN 8" CMU WALL CONTAINING (1) VERT. #5 REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM. PROVIDE A MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS.

9'-4" BRG. HT. | 12'-0" BRG. HT. | 15'-0" BRG. HT.
10'-0" BRG. HT. | 13'-4" BRG. HT. | 16'-0" BRG. HT.
11'-4" BRG. HT. | 14'-0" BRG. HT. | BRG. PER PLAN

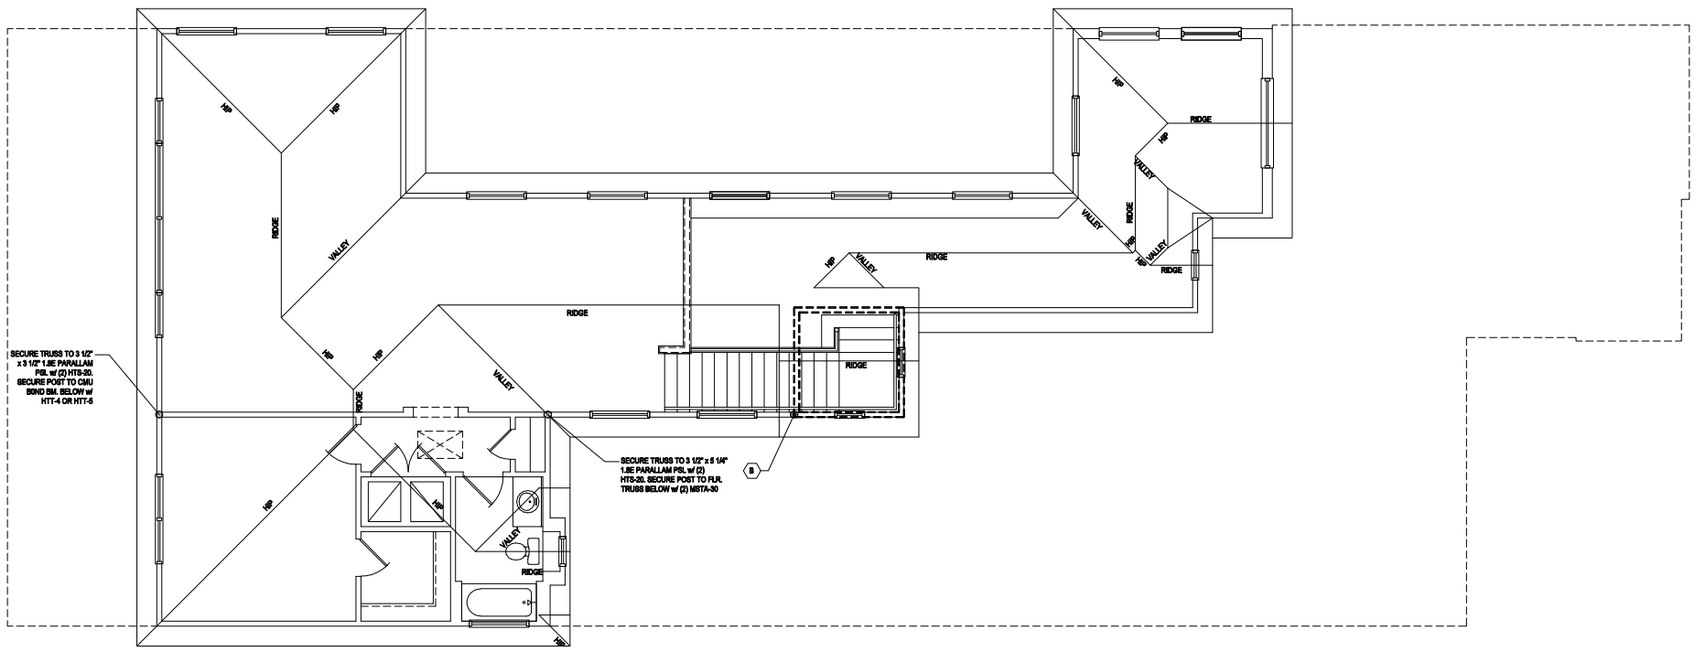

Second Floor Truss Plan "B"

(Opt. Second Floor)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,7:00pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\12.B Second Floor Truss plan.dwg ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATION OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OF FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS custom home design DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER STRUCTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

NOTES: DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

Note: plans have been electronically signed & sealed by Noel Rodriguez, PE, using a digital signature. SO is sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

SECOND FLOOR TRUSS

12.B

POST NOTES:

SPECIAL POSTS:

(A) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP AND SP4 AT BOTTOM

(B) (6) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP & (2) SP-4 AT BOTTOM OF EACH STUD W/ (14) 10d NAILS CAP=10000#

(C) $3\frac{1}{2}$"x $3\frac{1}{2}$" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(D) $3\frac{1}{2}$"x $5\frac{1}{2}$" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(E) $5\frac{1}{2}$"x $5\frac{1}{2}$"1.8E PARALLAM PSL COLUMN SECURED w/ SIMPSON HTT-5 AT BOTTOM AND (3) HTS-20 AT TOP.

SPECIAL HEADERS:

(H-1) (2) $1\frac{3}{4}$" x 12" L.V.L HEADER SUPPORTED ON EA. SIDE BY (3) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) MSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

(H-2) (2) 2"x12" BEAM WITH 1/2" PLYWOOD FLITCH SUPPORTED ON EACH SIDE WITH (2) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) LSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

CONNECTOR NOTES:

1. EACH FLOOR TRUSS ATTACHED TO CMU WITH (1) HETA-16 AND (1) MTS-12 AT FRAME CONNECTION (U.N.O.)
2. EACH ROOF TRUSS / RAFTER AT CMU. TO BE ATTACHED WITH (1) HETA-16 (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
3. EACH ROOF TRUSS / RAFTER AT FRAME CONNECTION TO BE (1) MTS-12 AT ALL COMMON TRUSSES & (1) H2.5 AT ALL HIP JACKS (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
4. END JACKS AND CORNER SETS MAY BE (1) H-2.5 (U.N.O.)
5. ROOF SHEATHING TO BE 1/2" NOMINAL OR GREATER OSB. OR CDX. TYPE PLYWOOD NAILED WITH .099x2" RING SHANK NAILS @ 6" O.C. EXCEPT FIRST 4'-0" OF ENTIRE PERIMETER WHICH SHALL BE 6" O.C. FIELD 4" O.C. EDGE.

   WALL SHEATHING TO BE 7/16" OSB. OR 1/2" CDX. NAILED WITH 8d CORROSION RESISTANT NAILS @ 6" O.C. IN FIELD & 4" O.C. @ EDGE (U.N.O.). SEE SHEATHING DETAIL.
6. FLOOR SHEATHING TO BE $\frac{3}{4}$" PLYWOOD OR OSB (U.N.O), WITH LONG DIMENSION PERPENDICULAR TO SUPPORT (FLOOR TRUSSES). NAILS: NAILS USED IN ALL FLOORING APPLICATIONS SHALL BE 8d, RING OR SPIRAL SHANK, HAND OR GUN DRIVEN NAILS. GUN DRIVEN NAILS SHALL HAVE HEAD SIZE EQUIVALENT TO HAND DRIVEN NAILS, SPACING SHALL BE 6" ON EDGES AND 12" IN FIELD.

GENERAL NOTES:

1. TRUSS LAYOUT IS AN ARTISTIC REPRESENTATION AND MAY VARY FROM FINAL LAYOUT SUBMITTED BY TRUSS MANUFACTURER. ALL TRUSS LAYOUTS AND PROFILES SHALL BE DESIGNED AND CERTIFIED BY TRUSS MANUFACTURER'S REGISTERED ENGINEER.
2. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.
3. TRUSS MANUFACTURER TO VERIFY ALL TRUSS SPANS, SLOPES, BEARING POINTS, & DIMENSIONS BEFORE FABRICATION. TRUSS MANUFACTURER SHALL COORDINATE LOCATIONS FOR MECHANICAL AND PLUMBING CHASES TO AVOID CONFLICT. ALSO, TRUSS MANUFACTURER TO PROVIDE SHOP DRAWINGS FOR APPROVAL BEFORE FABRICATION.
4. ALL ROOF PITCHES ARE TO BE SET AS INDICATED ON PLANS AND ELEVATIONS.
5. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS, & ELEVATIONS FOR BEARING HEIGHTS.
6. TRUSS SPACING SHALL BE 24" O.C. (U.N.O.) CONVENTIONAL FRAMING SHALL BE 16" O.C.
7. TRUSS MANUFACTURER TO PROVIDE ALL GABLE END TRUSSES WITH INTERMEDIATE STUD MEMBERS @ 16" O.C.
8. ROOF DECKING AS SPECIFIED.
9. ALL ROOF OVERHANGS TO BE 12" UNLESS NOTED OTHERWISE.
10. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON BEARING WALLS AND AT VOLUME AREAS (U.N.O.).
11. ALIGN TRUSSES AND HAND FRAMING SO AS ALL GYPSUM WALL BOARD TO BE CONTINUOUS FROM FLOOR TO CEILING.
12. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:

    12.1. ALL CEILING HUNG SOFFITS AND SOFFITS w/ CABINETS AS SHOWN ON PLANS.
    12.2. ATTIC LOCATED HVAC. UNITS AS SHOWN ON PLANS.
13. PROVIDE AND INSTALL FLASHING & ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE, IN ACCORDANCE WITH FBC-R 2017, 6TH EDITION.
14. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCSI 1.
15. REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
16. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBC-R 2017, 6TH EDITION

BRG. HT. LEGEND

■ - INDICATES A CONCRETE FILLED CELL WITHIN AN 8" CMU WALL CONTAINING (1) VERT. #5 REBAR CONT. FROM FOUNDATION SLAB TO BOND BEAM. PROVIDE A MIN. OF 25" LAP ON ALL STEEL REINFORCING BARS.

9'-4" BRG. HT. | 12'-0" BRG. HT. | 15'-0" BRG. HT.
10'-0" BRG. HT. | 13'-4" BRG. HT. | 16'-0" BRG. HT.
11'-4" BRG. HT. | 14'-0" BRG. HT. | BRG. PER PLAN

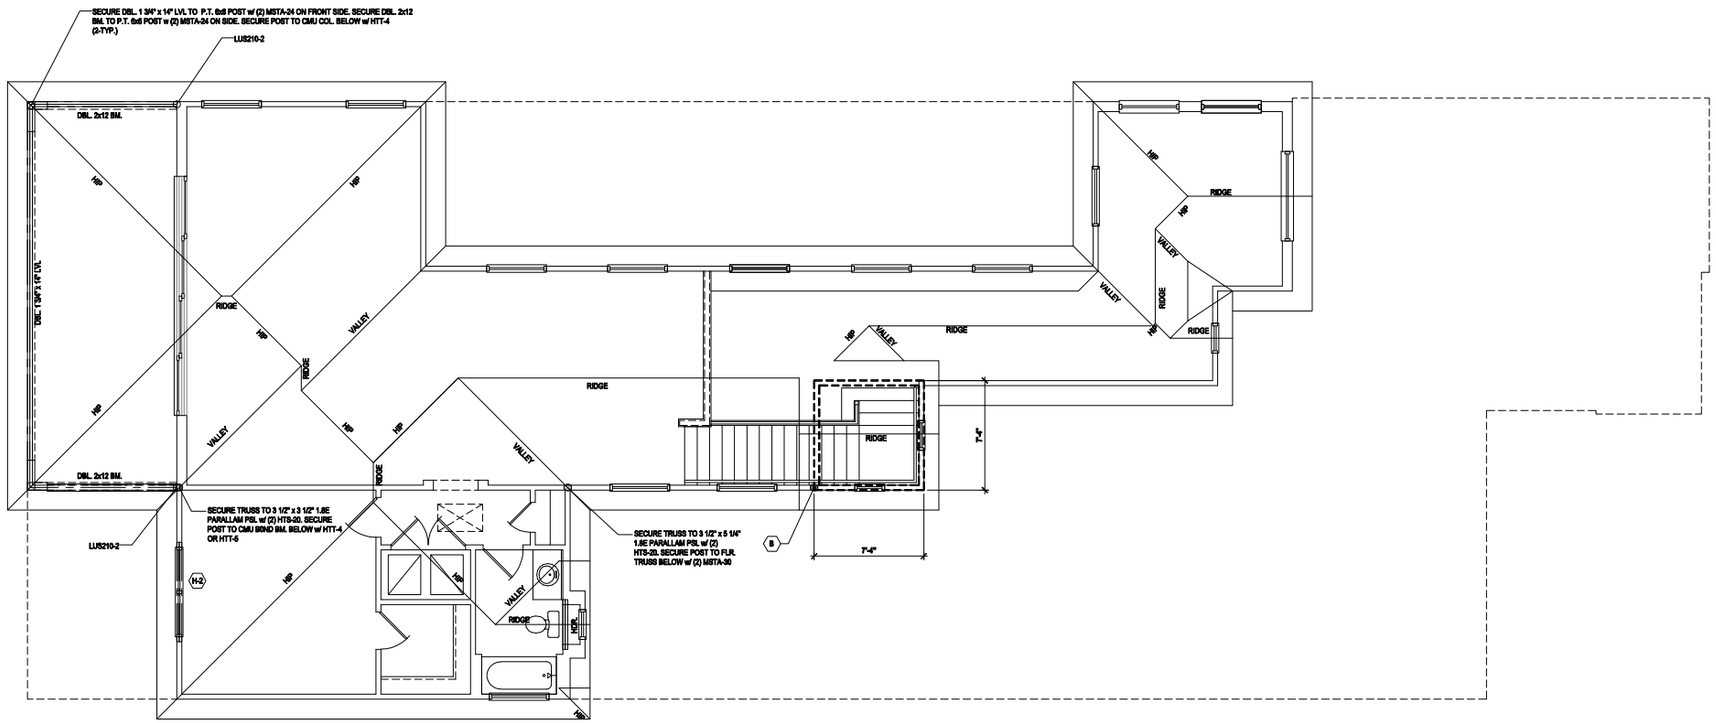

Second Floor Truss Plan "B"

(Opt. Second Floor w- Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,7:00pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\NV Models (Horizon West)\MODELS\The Yorkshire (40-4248)\12.B1 Second Floor Truss plan (Opt. Balcony).dwg

These plans have been electronically signed & sealed by Noel Rodriguez, PE, using a digital signature. A hard copy or printed copy of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OF FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

PREMIER STRUCTURAL ENGINEERING INC.

MJS 815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
custom home design
DESIGNERS - PLANNERS

NOTE: DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions and conditions shown on these drawings.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

SECOND FLOOR TRUSS

12.B1

POST NOTES:

SPECIAL POSTS:

(A) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP AND SP4 AT BOTTOM

(B) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP & (2) SP-4 AT BOTTOM OF EACH STUD W/ (14) 10d NAILS CAP=10000#

(C) $3\frac{1}{2}$"x $3\frac{1}{2}$" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(D) $3\frac{1}{2}$"x $5\frac{1}{2}$" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(E) $5\frac{1}{2}$"x $5\frac{1}{2}$"1.8E PARALLAM PSL COLUMN SECURED w/ SIMPSON HTT-5 AT BOTTOM AND (3) HTS-20 AT TOP.

SPECIAL HEADERS:

(H-1) (2) $1\frac{3}{4}$" x 12" L.V.L HEADER SUPPORTED ON EA. SIDE BY (3) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) MSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

(H-2) (2) 2"x12" BEAM WITH 1/2" PLYWOOD FLITCH SUPPORTED ON EACH SIDE WITH (2) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) LSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

CONNECTOR NOTES:

1. EACH FLOOR TRUSS ATTACHED TO CMU WITH (1) HETA-16 AND (1) MTS-12 AT FRAME CONNECTION (U.N.O.)
2. EACH ROOF TRUSS / RAFTER AT CMU. TO BE ATTACHED WITH (1) HETA-16 (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
3. EACH ROOF TRUSS / RAFTER AT FRAME CONNECTION TO BE (1) MTS-12 AT ALL COMMON TRUSSES & (1) H2.5 AT ALL HIP JACKS (U.N.O.). SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
4. ENDJACKS AND CORNER SETS MAY BE (1) H-2.5 (U.N.O.)
5. ROOF SHEATHING TO BE 1/2" NOMINAL OR GREATER OSB. OR CDX. TYPE PLYWOOD NAILED WITH .099x2" RING SHANK NAILS @ 6" O.C. EXCEPT FIRST 4'-0" OF ENTIRE PERIMETER WHICH SHALL BE 6" O.C. FIELD 4" O.C. EDGE.

   WALL SHEATHING TO BE 7/16" OSB. OR 1/2" CDX, NAILED WITH 8d CORROSION RESISTANT NAILS @ 6" O.C. IN FIELD & 4" O.C. @ EDGE (U.N.O.). SEE SHEATHING DETAIL.
6. FLOOR SHEATHING TO BE $\frac{3}{4}$" PLYWOOD OR OSB (U.N.O), WITH LONG DIMENSION PERPENDICULAR TO SUPPORT (FLOOR TRUSSES). NAILS: NAILS USED IN ALL FLOORING APPLICATIONS SHALL BE 8d, RING OR SPIRAL SHANK, HAND OR GUN DRIVEN NAILS. GUN DRIVEN NAILS SHALL HAVE HEAD SIZE EQUIVALENT TO HAND DRIVEN NAILS, SPACING SHALL BE 6" ON EDGES AND 12" IN FIELD.

GENERAL NOTES:

1. TRUSS LAYOUT IS AN ARTISTIC REPRESENTATION AND MAY VARY FROM FINAL LAYOUT SUBMITTED BY TRUSS MANUFACTURER. ALL TRUSS LAYOUTS AND PROFILES SHALL BE DESIGNED AND CERTIFIED BY TRUSS MANUFACTURER'S REGISTERED ENGINEER.
2. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.
3. TRUSS MANUFACTURER TO VERIFY ALL TRUSS SPANS, SLOPES, BEARING POINTS, & DIMENSIONS BEFORE FABRICATION. TRUSS MANUFACTURER SHALL COORDINATE LOCATIONS FOR MECHANICAL AND PLUMBING CHASES TO AVOID CONFLICT. ALSO, TRUSS MANUFACTURER TO PROVIDE SHOP DRAWINGS FOR APPROVAL BEFORE FABRICATION.
4. ALL ROOF PITCHES ARE TO BE SET AS INDICATED ON PLANS AND ELEVATIONS.
5. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS, & ELEVATIONS FOR BEARING HEIGHTS.
6. TRUSS SPACING SHALL BE 24" O.C. (U.N.O.) CONVENTIONAL FRAMING SHALL BE 16" O.C.
7. TRUSS MANUFACTURER TO PROVIDE ALL GABLE END TRUSSES WITH INTERMEDIATE STUD MEMBERS @ 16" O.C.
8. ROOF DECKING AS SPECIFIED.
9. ALL ROOF OVERHANGS TO BE 12" UNLESS NOTED OTHERWISE.
10. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON BEARING WALLS AND AT VOLUME AREAS (U.N.O.).
11. ALIGN TRUSSES AND HAND FRAMING SO AS ALL GYPSUM WALL BOARD TO BE CONTINUOUS FROM FLOOR TO CEILING.
12. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:

    12.1. ALL CEILING HUNG SOFFITS AND SOFFITS w/ CABINETS AS SHOWN ON PLANS.
    12.2. ATTIC LOCATED HVAC. UNITS AS SHOWN ON PLANS.
13. PROVIDE AND INSTALL FLASHING & ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE, IN ACCORDANCE WITH FBC-R 2017, 6TH EDITION.
14. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCSI 1.
15. REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
16. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBC-R 2017, 6TH EDITION

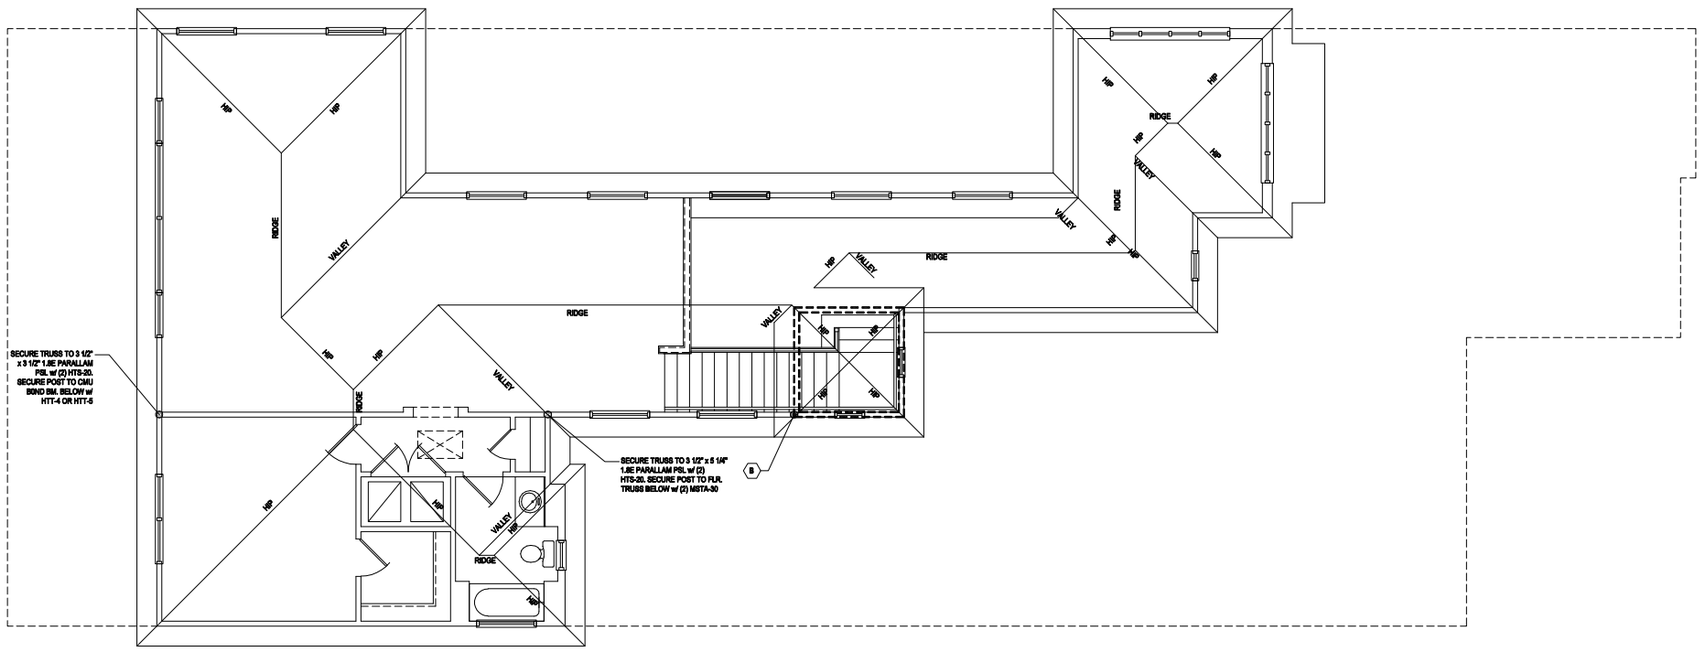

Second Floor Truss Plan "C"

(Opt. Second Floor)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,7:00pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\07 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\12.C Second Floor Truss plan.dwg ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENCED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OF FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

MJS custom home design DESIGNERS - PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER STRUCTURAL ENGINEERING INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierstructural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

Your plans have been electronically signed & sealed by Noel Rodriguez, PE, using a digital signature. SO is sealed and printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

NOTES: DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variations from the dimensions and conditions shown on these drawings.

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

SECOND FLOOR TRUSS

12.C

POST NOTES:

SPECIAL POSTS:

(A) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP AND SP4 AT BOTTOM

(B) (2) 2x JACK POST WITH (2) MTS-12 OR (2) MSTA-20 AT TOP & (2) SP-4 AT BOTTOM OF EACH STUD W/ (14) 10d NAILS CAP=1000#

(C) $3\frac{1}{2}$"x $3\frac{1}{2}$" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(D) $3\frac{1}{2}$"x $5\frac{1}{2}$" 1.8E PARALLAM PSL JACK POST WITH (2) HTS-16 ON TOP AND (1) HTT-4 AT BOTTOM.

(E) $5\frac{1}{2}$"x $5\frac{1}{2}$"1.8E PARALLAM PSL COLUMN SECURED w/ SIMPSON HTT-5 AT BOTTOM AND (3) HTS-20 AT TOP.

SPECIAL HEADERS:

(H-1) (2) $1\frac{3}{4}$" x 12" L.V.L HEADER SUPPORTED ON EA. SIDE BY (3) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) MSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

(H-2) (2) 2"x12" BEAM WITH 1/2" PLYWOOD FLITCH SUPPORTED ON EACH SIDE WITH (2) 2x JACK STUDS WITH (2) 2x FULL LENGTH STUDS ADJACENT. USE SP-1 @ BOTTOM OF EACH STUD & (2) LSTA-24 FROM STUD TO HEADER AT TOP ON EACH SIDE.

CONNECTOR NOTES:

1. EACH FLOOR TRUSS ATTACHED TO CMU WITH (1) HETA-16 AND (1) MTS-12 AT FRAME CONNECTION (U.N.O.)
2. EACH ROOF TRUSS / RAFTER AT CMU. TO BE ATTACHED WITH (1) HETA-16 (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
3. EACH ROOF TRUSS / RAFTER AT FRAME CONNECTION TO BE (1) MTS-12 AT ALL COMMON TRUSSES & (1) H2.5 AT ALL HIP JACKS (U.N.O.) SEE CONNECTOR SCHEDULE FOR NAILING REQUIRED.
4. END JACKS AND CORNER SETS MAY BE (1) H-2.5 (U.N.O.)
5. ROOF SHEATHING TO BE 1/2" NOMINAL OR GREATER OSB. OR CDX. TYPE PLYWOOD NAILED WITH .099x2" RING SHANK NAILS @ 6" O.C. EXCEPT FIRST 4'-0" OF ENTIRE PERIMETER WHICH SHALL BE 6" O.C. FIELD 4" O.C. EDGE.

   WALL SHEATHING TO BE 7/16" OSB. OR 1/2" CDX. NAILED WITH 8d CORROSION RESISTANT NAILS @ 6" O.C. IN FIELD & 4" O.C. @ EDGE (U.N.O.). SEE SHEATHING DETAIL.
6. FLOOR SHEATHING TO BE $\frac{3}{4}$" PLYWOOD OR OSB (U.N.O), WITH LONG DIMENSION PERPENDICULAR TO SUPPORT (FLOOR TRUSSES). NAILS: NAILS USED IN ALL FLOORING APPLICATIONS SHALL BE 8d, RING OR SPIRAL SHANK, HAND OR GUN DRIVEN NAILS. GUN DRIVEN NAILS SHALL HAVE HEAD SIZE EQUIVALENT TO HAND DRIVEN NAILS, SPACING SHALL BE 6" ON EDGES AND 12" IN FIELD.

GENERAL NOTES:

1. TRUSS LAYOUT IS AN ARTISTIC REPRESENTATION AND MAY VARY FROM FINAL LAYOUT SUBMITTED BY TRUSS MANUFACTURER. ALL TRUSS LAYOUTS AND PROFILES SHALL BE DESIGNED AND CERTIFIED BY TRUSS MANUFACTURER'S REGISTERED ENGINEER.
2. IF TRUSS LAYOUT / ENGINEERING IS CHANGED OR ALTERED FROM ITS ORIGINAL MASTER FILE, THE E.O.R AND DESIGNER MUST BE NOTIFIED IMMEDIATELY AND WILL NOT BE HELD LIABLE.
3. TRUSS MANUFACTURER TO VERIFY ALL TRUSS SPANS, SLOPES, BEARING POINTS, & DIMENSIONS BEFORE FABRICATION. TRUSS MANUFACTURER SHALL COORDINATE LOCATIONS FOR MECHANICAL AND PLUMBING CHASES TO AVOID CONFLICT. ALSO, TRUSS MANUFACTURER TO PROVIDE SHOP DRAWINGS FOR APPROVAL BEFORE FABRICATION.
4. ALL ROOF PITCHES ARE TO BE SET AS INDICATED ON PLANS AND ELEVATIONS.
5. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS, & ELEVATIONS FOR BEARING HEIGHTS.
6. TRUSS SPACING SHALL BE 24" O.C. (U.N.O.) CONVENTIONAL FRAMING SHALL BE 16" O.C.
7. TRUSS MANUFACTURER TO PROVIDE ALL GABLE END TRUSSES WITH INTERMEDIATE STUD MEMBERS @ 16" O.C.
8. ROOF DECKING AS SPECIFIED.
9. ALL ROOF OVERHANGS TO BE 12" UNLESS NOTED OTHERWISE.
10. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON BEARING WALLS AND AT VOLUME AREAS (U.N.O.).
11. ALIGN TRUSSES AND HAND FRAMING SO AS ALL GYPSUM WALL BOARD TO BE CONTINUOUS FROM FLOOR TO CEILING.
12. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:

    12.1. ALL CEILING HUNG SOFFITS AND SOFFITS w/ CABINETS AS SHOWN ON PLANS.
    12.2. ATTIC LOCATED HVAC. UNITS AS SHOWN ON PLANS.
13. PROVIDE AND INSTALL FLASHING & ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE, IN ACCORDANCE WITH FBC-R 2017, 9TH EDITION.
14. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCSI 1.
15. REFER TO TRUSS MANUFACTURERS DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
16. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBC-R 2017, 6TH EDITION

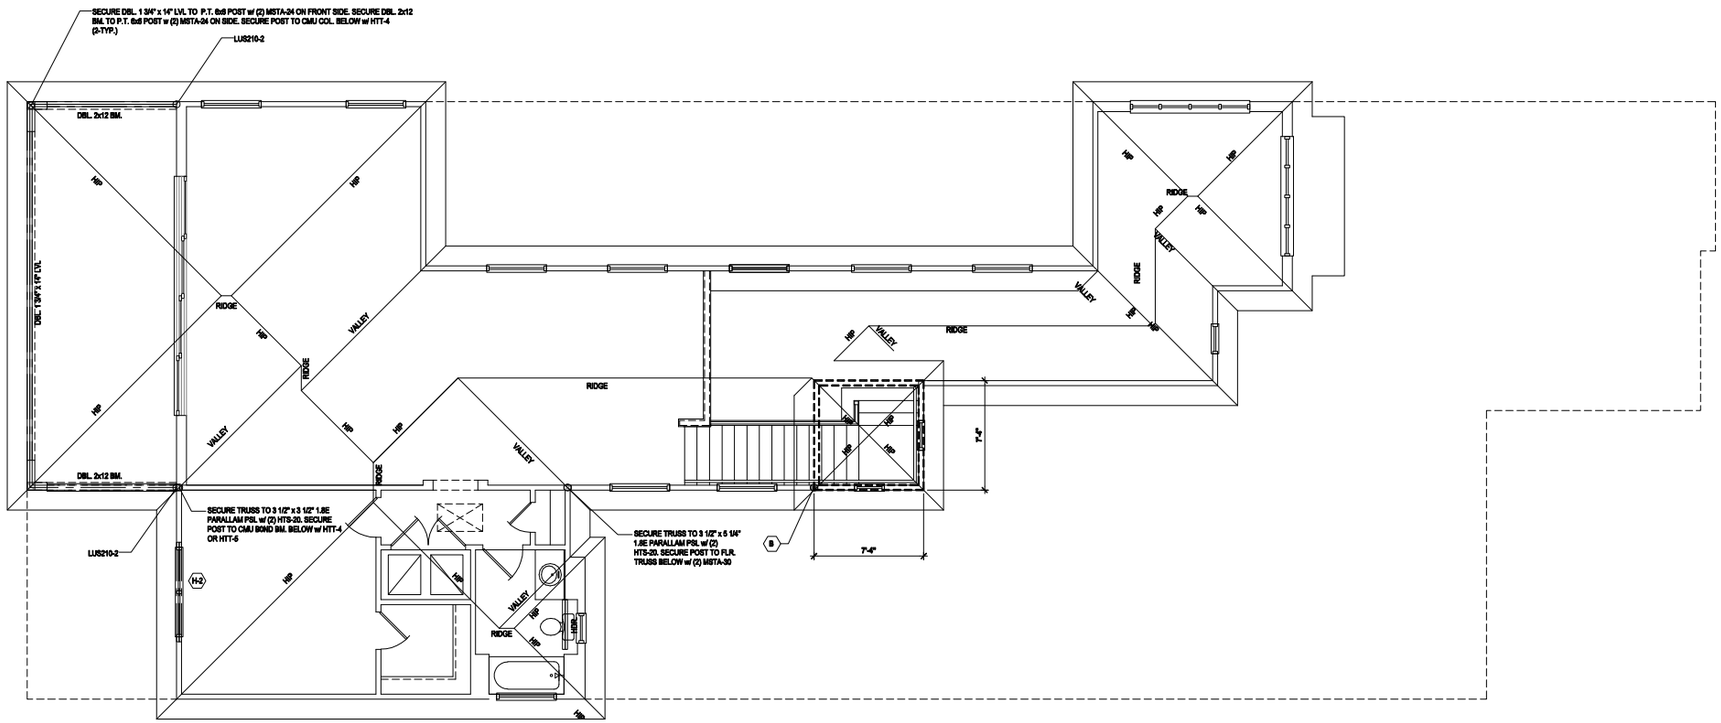

Second Floor Truss Plan "C"

(Opt. Second Floor w- Balcony)

SCALE: 1/8" = 1'-0" (12x18) 1/4" = 1'-0" (24x36)

May 21, 2019,7:00pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\12.C1 Second Floor Truss plan (Opt. Balcony).dwg

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd, Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

PARK SQUARE HOMES

MJS custom home design
DESIGNERS • PLANNERS
815 Orienta Ave, Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER ARCHITECTURAL ENGINEERING LLC
235 Maitland Avenue S.
Suite 108-A
Maitland, FL. 32751
Ph: (407) 227-7416
www.premierarchitectural.com
FL. CERT. AUTH.: 29113
FL. PE#: 60239

40-4248

YORKSHIRE

Street Address
Lot Info
City, State, Zip

NOTE:DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

Note: plans have been electronically signed & sealed by Neal Rodriguez, PE, using a digital signature. NO a raised seal or printed copies of this document are not considered Signed & Sealed. Signature must be verified on any electronic copies.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

SECOND FLOOR TRUSS

12.C1

NOTE:
CONNECTORS NOTED ON THESE DETAILS ARE SIMPSON STRONG-TIE UNLESS NOTED OTHERWISE

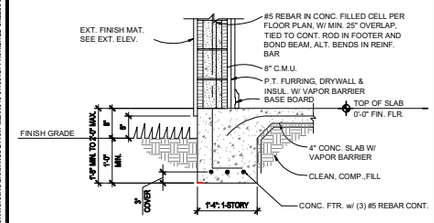

1 ONE- STORY EXTERIOR WALL SCALE: 3/4" = 1'-0"

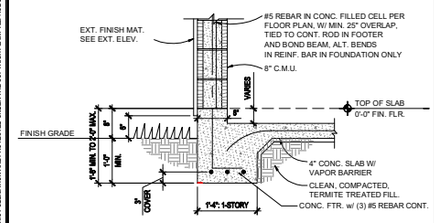

3 GARAGE CURB SCALE: 3/4" = 1'-0"

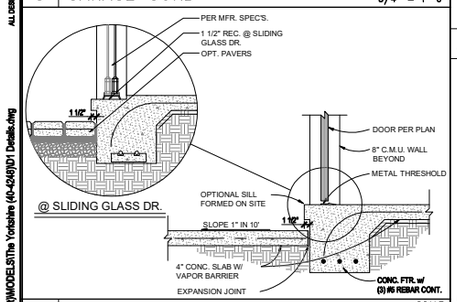

7 EXTERIOR DOOR SILL SCALE: 3/4" = 1'-0"

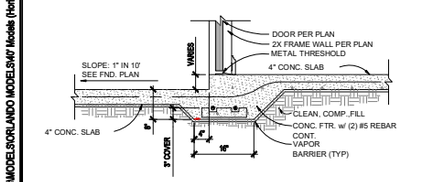

7A INT. GARAGE DOOR SILL SCALE: 3/4" = 1'-0"

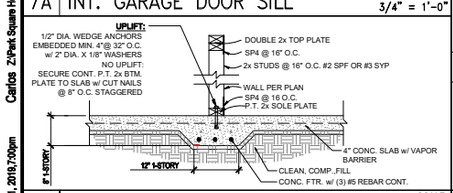

8 1-STORY INT. BRG. WALL SCALE: 3/4" = 1'-0"



14 SUNKEN SHOWER SCALE: 1 1/2" = 1'-0"

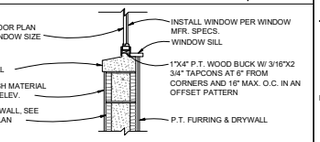

17 WINDOW SILL AT BLOCK SCALE: 3/4" = 1'-0"

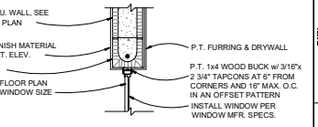

18 WINDOW HEAD AT BLOCK SCALE: 3/4" = 1'-0"



30 GAR. CURB, NON-BEARING SCALE: 3/4" = 1'-0"

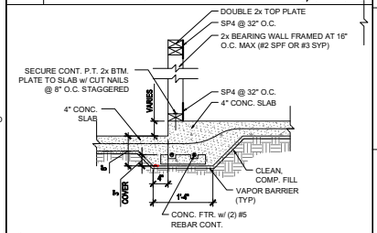

(w/o UPLIFT)

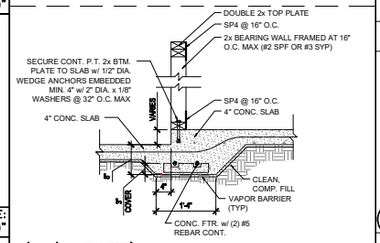

(w/ UPLIFT)

31 1-STORY GAR. CURB SCALE: 3/4" = 1'-0"



32 8" THICKENED EDGE

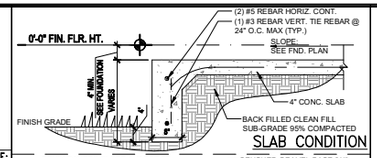

SLAB CONDITION

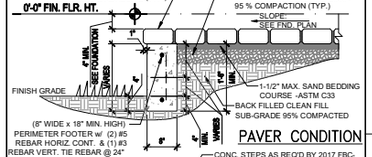

PAVER CONDITION

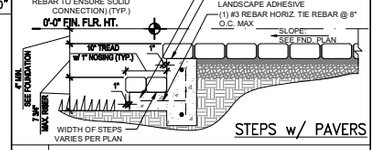

STEPS w/ PAVERS

33 8"EXT. THICKENED EDGE

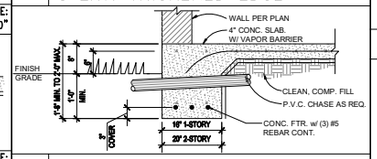

34 UTILITY CHASE

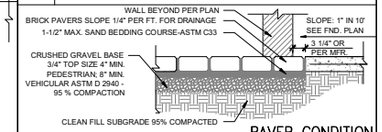

PAVER CONDITION

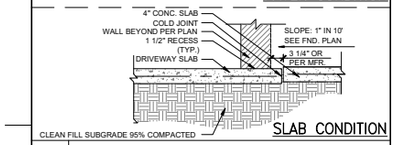

SLAB CONDITION

35 GARAGE DOOR FTG.

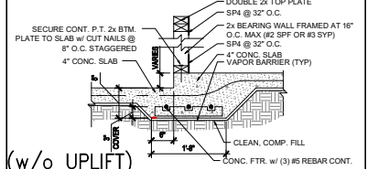

(w/o UPLIFT)

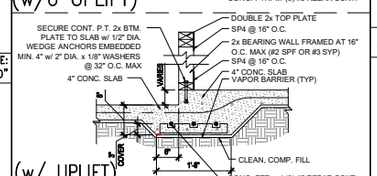

(w/ UPLIFT)

36 2-STORY GAR. CURB

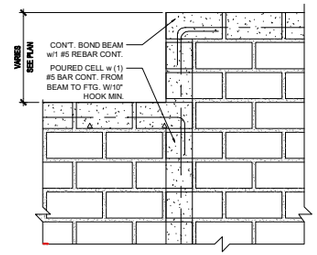

41 STEP DOWN TIE BEAM

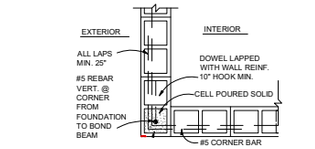

42 CORNER/VERTICAL WALL REINF.

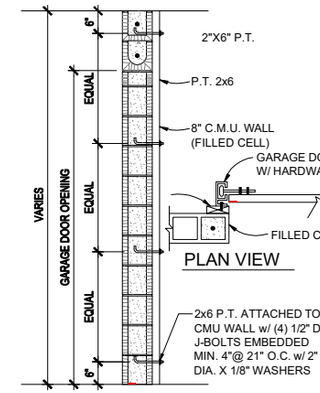

- DETAIL TO SATISFY 140 MPH WIND LOAD
- MASONRY FRAME SHALL BE MIN 8X16 ASTM C-90
- GROUT FILLED CELL w/ ASTM (1) #5 REBAR (GRADE 60) @ EA. SIDE OF GARAGE DOOR OPENING U.N.O.
- MAX. DISTANCE TO CORNER OF C.B.S. WALL REINF. 48"
- REINF. TO BE CONT. FROM FTG. TO TIE BEAM w/ ALL "ACI" DETAILS & DEVELOPMENT LENGTHS ADHERED TO
- GARAGE DOOR MANUFACTURER TO PROVIDE ATTACHMENT TO "BUCK". THE GARAGE DOOR ASSEMBLY SHALL BE DESIGNED FOR POSITIVE AND NEGATIVE WIND PRESSURES OF 25 PSF IN ACCORDANCE WITH SECTION R301 OF THE FLORIDA RESIDENTIAL CODE CERTIFICATION SHALL BE SUBMITTED FROM THE GARAGE DOOR MANUFACTURER TO THE BUILDING DEPARTMENT FOR THE FOLLOWING ITEMS:

A. THE DESIGN OF THE DOOR COMPLIES WITH THE CRITERIA SPECIFIED IN SECTION R613 OF THE 2017 FLORIDA BUILDING CODE RESIDENTIAL, 6TH EDITION
B. DOOR SIZE, TYPE AND GLAZING
C. TRACK SIZE AND FASTENER DETAILS
D. TRACK BRACKET QUANTITY, SPACING AND FASTENER DETAILS
E. REINFORCING MEMBER QUANTITY, LOCATION, SIZE, TYPE AND FASTENER DETAILS. (IF REQUIRED)

44 GARAGE DOOR BUCK

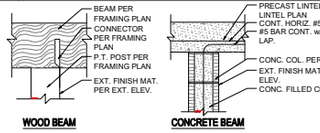

55 POST/BEAM CONNECTION

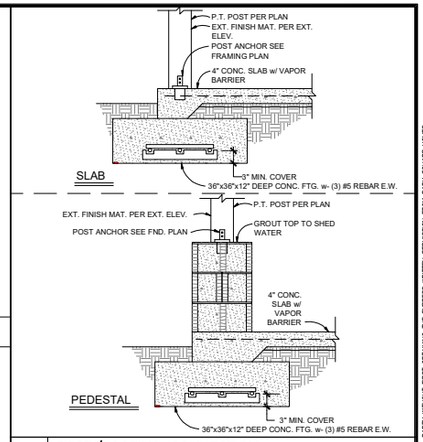

56 POST/FOOTING CONNECTION

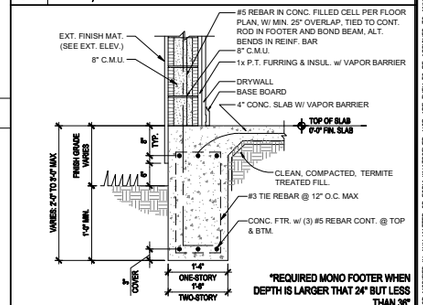

57 TYP. EXT. MONO FOOTER

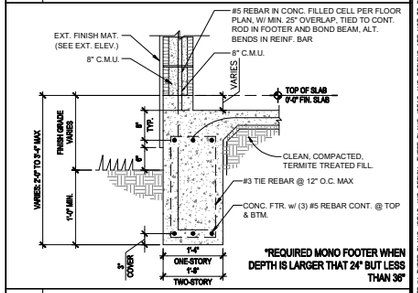

58 TYP. EXT. MONO FOOTER @ GARAGE

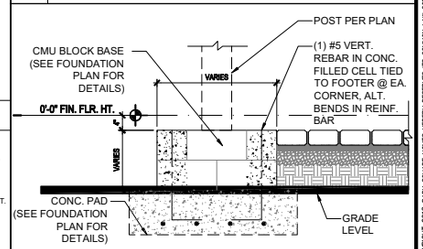

60 TYP. CMU BLK. BASE

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGNS. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
E-mail: premierfloral.com
FL CERT. AUTH.: 29113
FL PE#: 60239
PREMIER STRUCTURAL ENGINEERING INC.

MJS custom home design
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
DESIGNERS - PLANNERS www.mjshomedesigns.com

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

May 21, 2019,7:00pm Carlos Z:\Park Square Homes\MODELS\ORLAND\0 MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\D1 Details.dwg

40-4248
YORKSHIRE
Street Address
Lot Info
City, State, Zip

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

DETAILS
D1

These plans have been electronically signed & sealed by Fred Rodriguez, PE using a digital signature. NO a hard and printed copy of this document are not considered Signed & Sealed. Signature and Seal is verified on any electronic copies.

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variance therefrom before proceeding with the work. Contractor shall be responsible for all dimensions, conditions and specifications reporting to the same prior to construction.

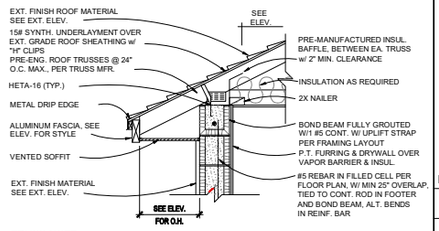

TRUSS NOTE:

BOTTOM CHORD MAY BE SLOPED-SEE FLR. PLAN /TRUSS LAYOUT FOR CEILING CONDITIONS-TYP.

13 TRUSS AT BLOCK

SCALE: 3/4" = 1'-0"

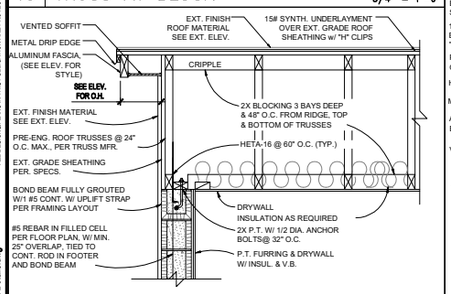

15 GABLE END BLOCKING

SCALE: 3/4" = 1'-0"

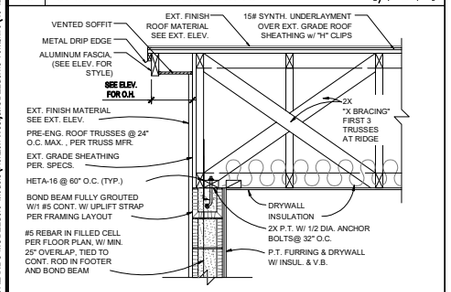

16 GABLE AT BLOCK

SCALE: 3/4" = 1'-0"

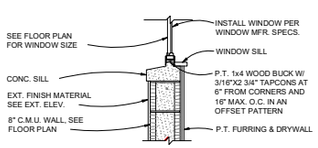

NOTE: PER MAN. SPEC.

17 WINDOW SILL AT BLOCK

SCALE: 3/4" = 1'-0"

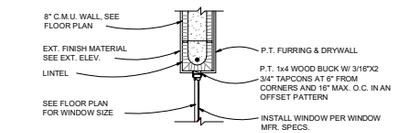

NOTE: PER MAN. SPEC.

18 WINDOW HEAD AT BLOCK

SCALE: 3/4" = 1'-0"

TRUSS NOTE:

BOTTOM CHORD MAY BE SLOPED-SEE FLR. PLAN /TRUSS LAYOUT FOR CEILING CONDITIONS-TYP.

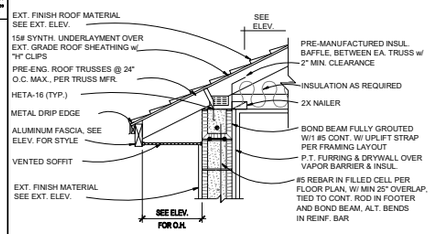

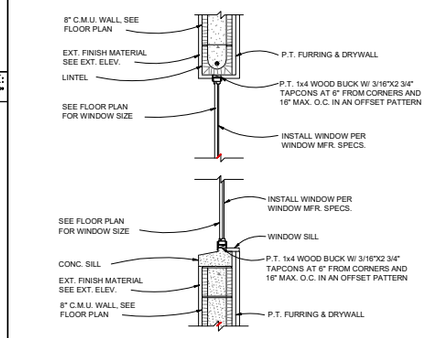

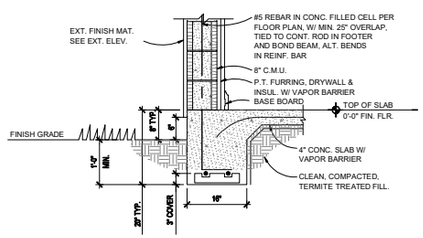

21 SINGLE STORY WALL SECTION

SCALE: 3/4" = 1'-0"

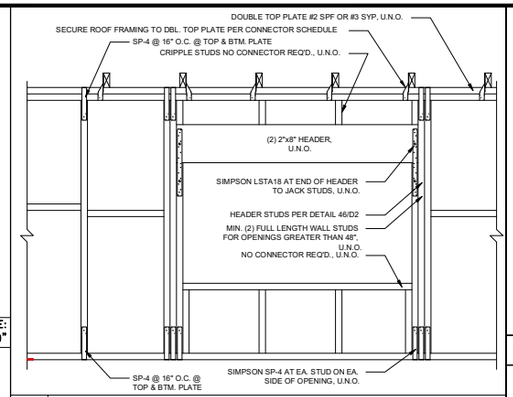

45 WOOD FRAMED OPENING

SCALE: N.T.S.

HEADER NOTE:
ALL HEADERS ABV. OPENING IN LOAD BEARING WALLS TO BE MIN. (2) 2x8 #2 S.Y.P., U.N.O. (UP TO 72" CLEAR SPAN MAX.)

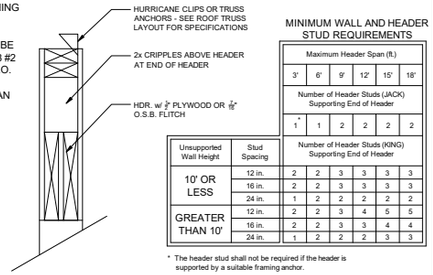

MINIMUM WALL AND HEADER STUD REQUIREMENTS

Maximum Header Span (ft.)					
3'	6'	9'	12'	15'	18'
Number of Header Studs (JACK) Supporting End of Header					
1*	1	2	2	2	2

Unsupported Wall Height	Stud Spacing	Number of Header Studs (KING) Supporting End of Header					
10' OR LESS	12 in.	2	2	3	3	3	3
	16 in.	2	2	3	3	3	3
	24 in.	1	2	2	2	2	2
GREATER THAN 10'	12 in.	2	2	3	4	5	5
	16 in.	2	2	3	3	4	4
	24 in.	1	2	2	2	3	3

* The header stud shall not be required if the header is supported by a suitable framing anchor.

46 TYP. HEADER DETAIL

SCALE: N.T.S.



49 CRIPPLE WALL ON TRUSS

SCALE: N.T.S.

NOTE: CONNECTORS NOTED ON THESE DETAILS ARE SIMPSON STRONG-TIE UNLESS NOTED OTHERWISE

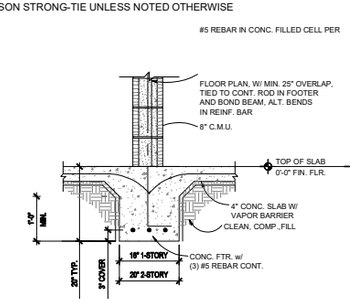

50 INTERIOR BLK. WALL

SCALE: N.T.S.

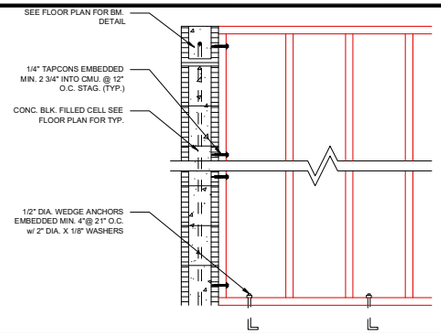

51 FRAME WALL TO CMU ATTACHMENT

SCALE: N.T.S.

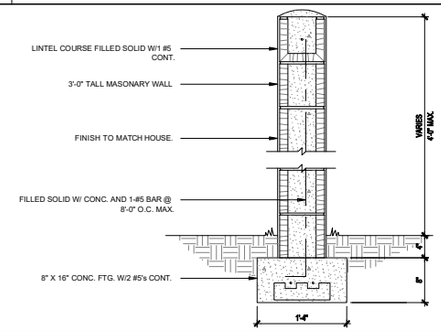

52 WING WALL

SCALE: N.T.S.

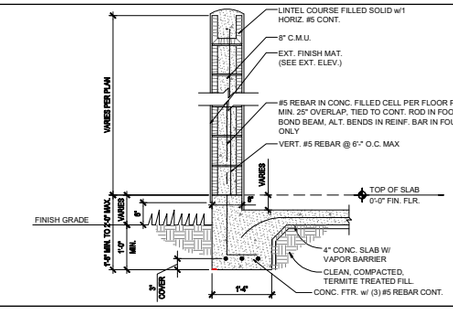

53 PRIVACY WALL

SCALE: N.T.S.

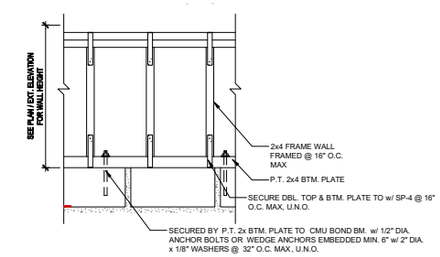

54 KNEEWALL TO MASONRY

SCALE: N.T.S.

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGNS. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
WWW.PREMIERENGINEERING.COM
FL CERT. AUTH.: 29113
FL PE#: 60239

PREMIER ENGINEERING & DEVELOPMENT, INC.

MJS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
custom home design
DESIGNERS - PLANNERS

THESE PLANS HAVE BEEN ELECTRONICALLY SIGNED & SEALED BY MARK MUSGROVE, PE USING A DIGITAL SIGNATURE. NO PRINTED COPY OF THIS DOCUMENT IS VALID UNLESS IT IS SIGNED & SEALED. THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variance from the dimensions, conditions and specifications appearing on these plans.

40-4248
YORKSHIRE
Street Address
Lot Info
City, State, Zip

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000
Park Square HOMES

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

DETAILS
D2

Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\407 Models (Horizon West)\MODELS\The Yorkshire (40-4248)\D2 Details.dwg
May 21, 2018,7:00pm

NOTE:
CONNECTORS NOTED ON THESE DETAILS ARE SIMPSON STRONG-TIE, U.N.O.

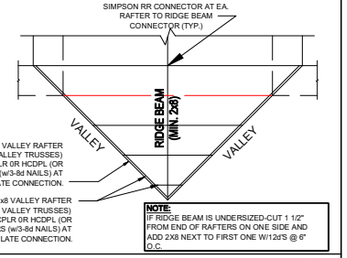

NOTE:
IF RIDGE BEAM IS UNDERSIZED-CUT 1 1/2" FROM END OF RAFTERS ON ONE SIDE AND ADD 2X8 NEXT TO FIRST ONE W/12d'S @ 6" O.C.

TYP. VALLEY CONNECTION

SCALE: N.T.S.

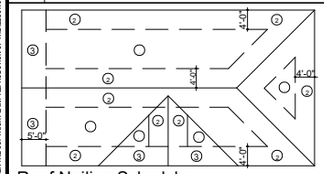

Roof Nailing Schedule

ROOF SHEATHING NAILING ZONE NOTES

ROOF SHEATHING NAILING PATTERN

- ZONE 1 : USE 8D RING SHANK NAILS @ 6" O.C. AT EDGES AND 6" O.C. INTERMEDIATE
- ZONE 2 : USE 8D RING SHANK NAILS 6" O.C.(ALL FIELDS)
- ZONE 3 : USE 8D RING SHANK NAILS 4" O.C.(ALL FIELDS)

WALL SHEATHING NAILING PATTERN

- USE 8D RING SHANK NAILS... PANEL EDGES 4" O.C. AT SHEARWALL SEGMENTS: 8" O.C. INTERMEDIATE PANEL EDGES 6" O.C. ELSEWHERE: 12" O.C.INTERMEDIATE
  1/2" GYPSUM CEILING : USE 5D NAILS @ 7" ON CENTER SECOND FLOOR NAILING : 8D @6" O.C. EDGES (GLUE & NAIL) @ 12" O.C.@ FIELD



BOND BREAK/FLASHING

SCALE: 3" = 1'-0"



BARTOP DETAIL



PAVER PATIO/SIDEWALK EDGE DET.

SCALE: N.T.S.

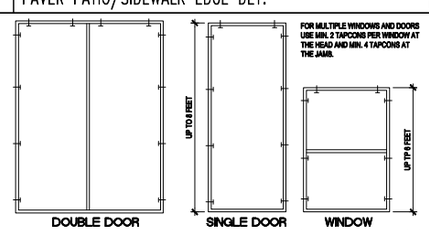

- BUCKS SHALL BE P.T. 1x4 OR 2x6 AT WINDOWS & DOORS IN PINE OR SPRUCE. FOR WINDOWS ATTACH BUCKS TO BLOCK WITH COMMON T NAILS AT PLACEMENT SIMILAR TO TAPCONS SHOWN. FOR DOORS OR FIN. WINDOWS IN BLOCK, ATTACH BUCKS w/ (2) T-NAILS TOP AND BOTTOM AND 8" O.C. STAGGERED IN THE FIELD.
- USE MIN. 2 1/4" T-NAILS w/ 1x BUCK @ 12" O.C. STAGGERED OR MIN. 1/4" x 3" TAPCONS w/ 2x BUCK. START ALL END TAPCONS WITHIN 6" OF CORNERS AND 24" O.C. STAGGERED MAX.
- IN CASES OF BLOCK OPENINGS LARGER THAN DOOR FRAMING. ATTACH ADDITIONAL 2x FRAMING TO THE BLOCK WALL USING 1/4" x 4" TAPCONS AT 3" FROM END AND 12" O.C. IN FIELD. ATTACH TOP FRAMING TO HEADER USING 1/4" TAPCONS w/ (1) 6" FROM END TO END AND 12" O.C. IN THE FIELD.

WINDOW / DOOR BUCK ATTACHMENT

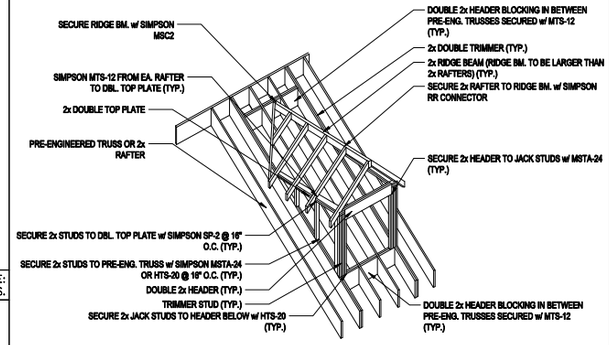

NON-OPERABLE DORMER

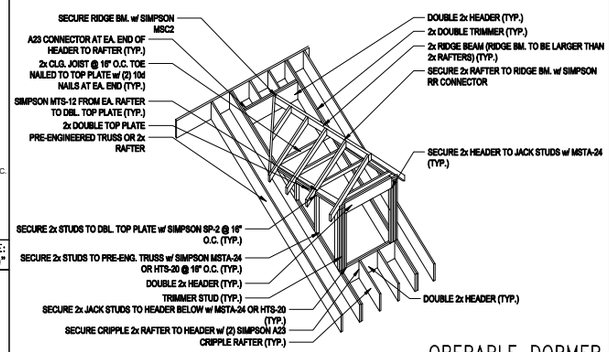

OPERABLE DORMER

TYP. DORMER FRAMING

SCALE: N.T.S.

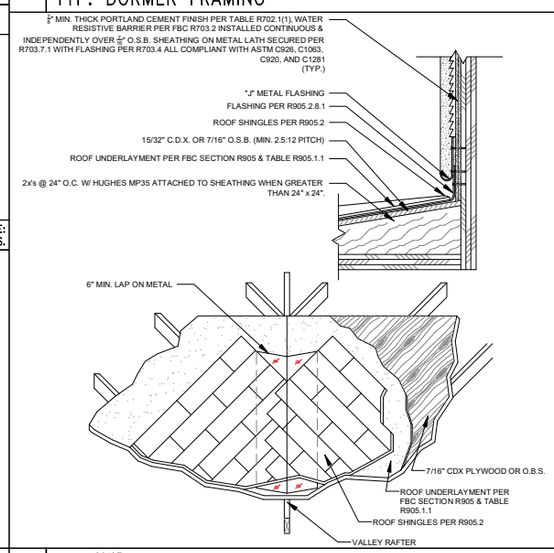

FLASHING DETAIL

SCALE: N.T.S.

WINDOW INSTALLATION (METHOD A-1) (ASTM E 2112-01)

WEATHER RESITIVE BARRIER (WRB) APPLIED PRIOR TO THE WINDOW INSTALLATION.
FLASHING APPLIED OVER THE FACE OF THE MOUNTING FLANGE.

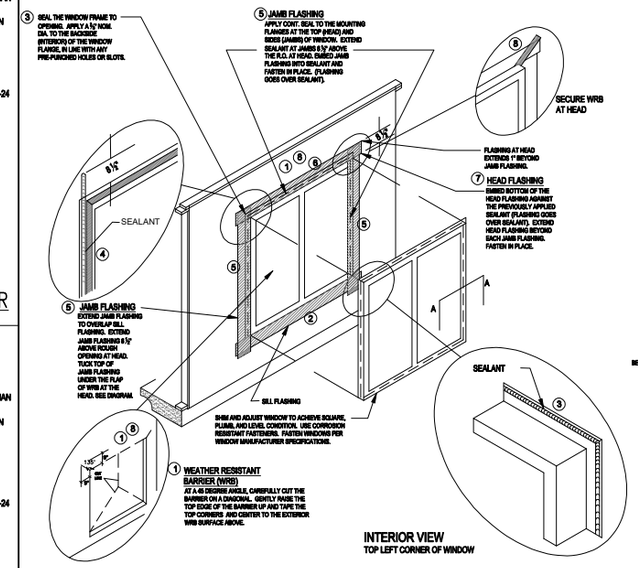

STEPS:

1. IN WATER SHEDDING FASHION, STARTING AT THE BASE OF THE WALL & WORKING TOWARDS THE TOP, INSTALL THE WRB TO THE FACE OF THE SHEATHING.
2. APPLY SILL FLASHING
3. APPLY BEAD OF SEALANT AT BACK OF WINDOW FLANGE & SET WINDOW USING PAN HEAD SCREWS TO FACILITATE INSPECTION.
4. APPLY BEAD OF SEALANT AT SIDE JAMBS. EXTEND 8 1/2"
5. APPLY JAMB FLASHING
6. APPLY BEAD OF SEALANT AT HEAD
7. APPLY HEAD FLASHING
8. REMOVE PREVIOUSLY APPLIED TAPE, ALLOWING WRB TO LAY FLAT OVER HEAD FLASHING. APPLY NEW SHEATHING TAPE OVER DIAGONAL CUT - SEE DIAGRAM.

NOTE: STEPS 4 AND 8 ARE NOT REQUIRED WHEN USING SELF-ADHERING TYPE FLASHING



NOTE:
ALL FLASHING WILL BE SELF ADHEARING AND ROLLED SMOOTH & FLAT WITH A J-ROLLER.

WINDOW FLASHING "METHOD A-1"

SCALE: N.T.S.

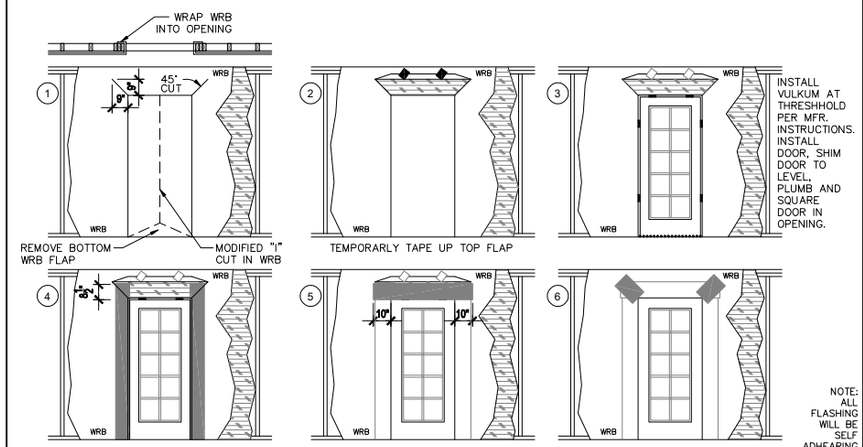

NOTE:
ALL FLASHING WILL BE SELF ADHEARING AND ROLLED SMOOTH & FLAT WITH A J-ROLLER.

EXTERIOR DOOR FLASHING

SCALE: N.T.S.

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGNS. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, FOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
WWW.PARKSQUAREHOMES.COM
FL CERT. AUTH.: 29113
FL PE#: 60239

PREMIER ESTIMATING & DEVELOPMENT, INC.

815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
custom home design
DESIGNERS • PLANNERS

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variance from the dimensions, conditions and specifications appearing on these plans.

These plans have been electronically signed & sealed by Mark Rodrigues, PE using a digital signature. A hard copy and printed copy of this document are not considered signed & sealed. Signature and seal are verified on any electronic copies.

40-4248

YORKSHIRE
Street Address
Lot Info
City, State, Zip

Park Square HOMES
A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

DETAILS

D3

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

May 21, 2019,7:00pm Carlos Z:\Park Square Homes\MODELS\OR LANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\04 Details.dwg

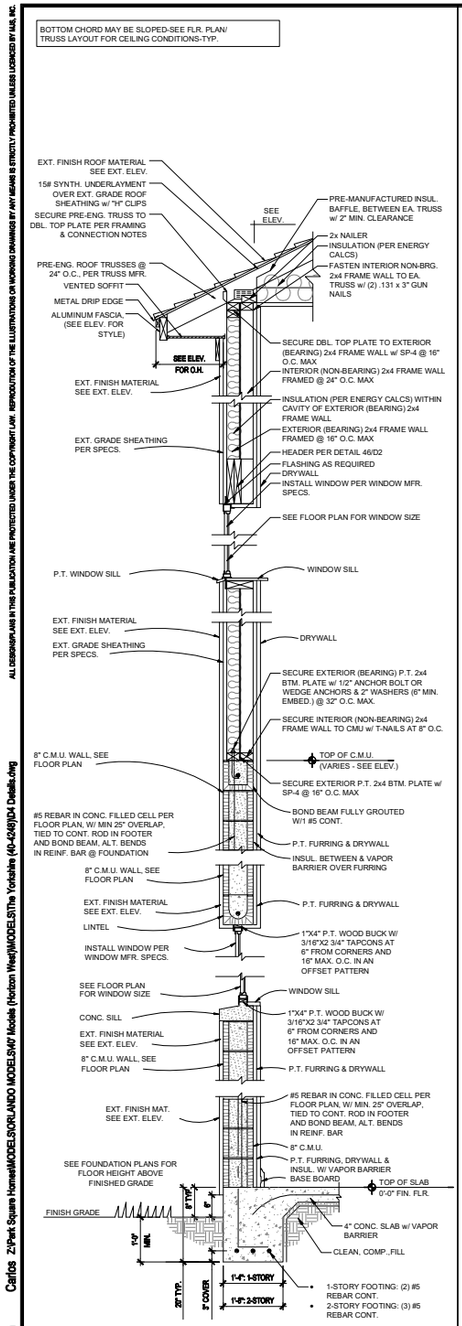

A OPEN 2-STORY WALL SECTION SCALE: 3/4" = 1'-0"

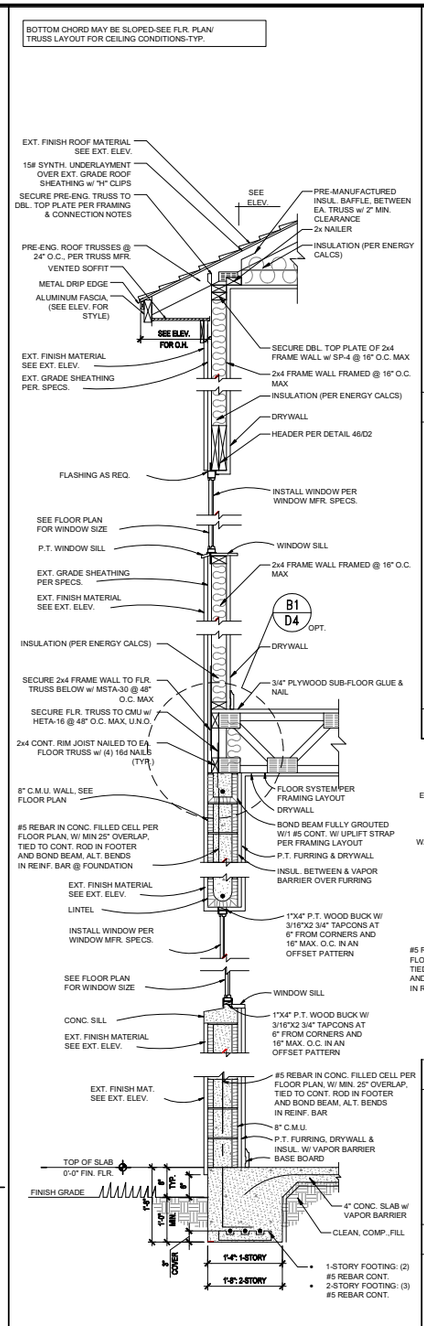

B TWO-STORY WALL SECTION SCALE: 3/4" = 1'-0"

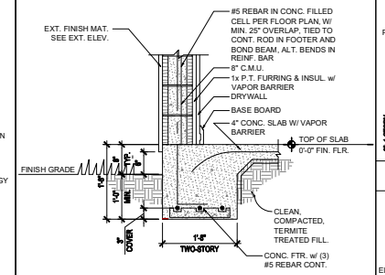

1 2-STORY EXT. WALL SCALE: 3/4" = 1'-0"

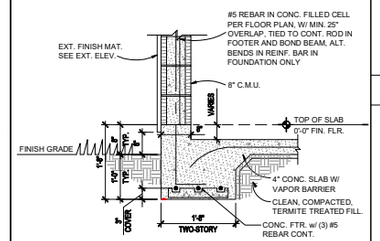

3 GARAGE CURB SCALE: 3/4" = 1'-0"

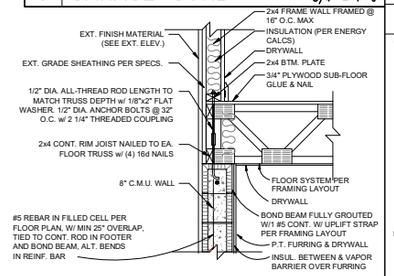

A.T.R. CONNECTION DETAIL SCALE: 3/4" = 1'-0"

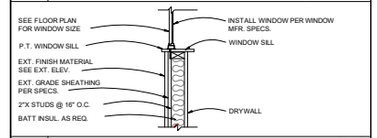

4 WINDOW SILL AT FRAME SCALE: 3/4" = 1'-0"

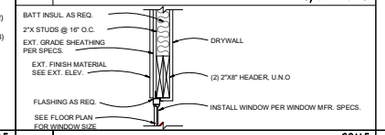

5 WINDOW HEAD AT FRAME SCALE: 3/4" = 1'-0"

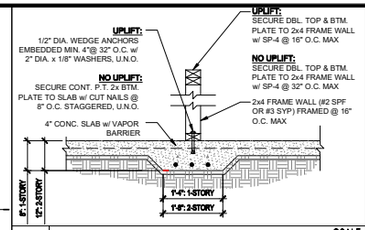

6 INTERIOR LOAD BEARING WALL SCALE: 3/4" = 1'-0"

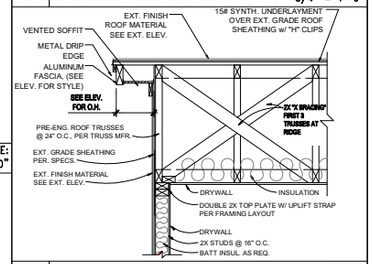

7 GABLE AT FRAME SCALE: N.T.S.

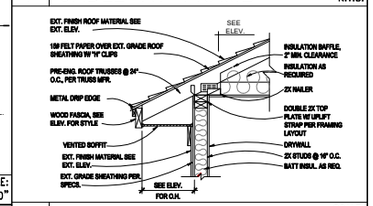

8 TRUSS AT FRAME SCALE: N.T.S.

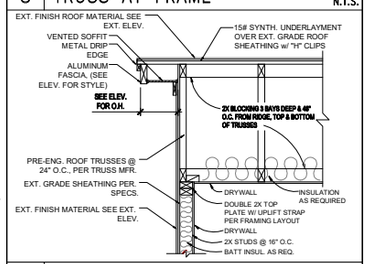

9 GABLE END BLOCKING SCALE: N.T.S.

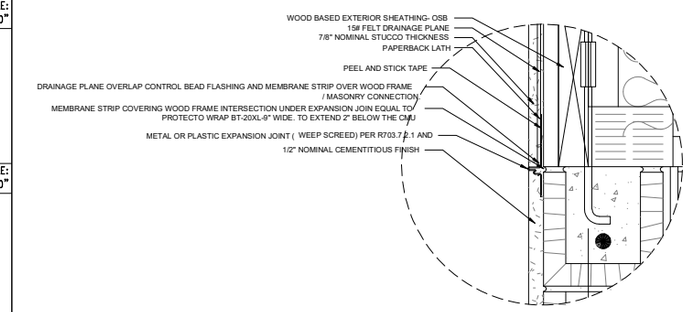

10 STUCCO BOND BREAK/FLASHING DETAIL SCALE: N.T.S.

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATER OR FORM WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000

MJS custom home design DESIGNERS - PLANNERS
815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com

PREMIER STRUCTURAL ENGINEERING, INC.
235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierstructural.com
FL CERT. AUTH.: 29113
FL PE#: 60239

40-4248
YORKSHIRE
Street Address
Lot Info
City, State, Zip

These plans have been electronically signed & sealed by Fred Rodriguez, PE using a digital signature. NO a hard or printed copy of this document are not considered Signed & Sealed. Signature and Seal to be verified on any electronic copies.

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractors shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified in writing of any changes to the dimensions, conditions and specifications appearing on these plans.

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

DETAILS
D4

NAILING SCHEDULE:

- (2) ROWS 8d NAILS @ 3" O.C. AT TOP PLATE AND (1) ROW AT BOTTOM PLATE. NAIL ALL EDGE AT BUILDING CORNERS @ 4" O.C. AND ALL OTHER EDGES AT 6" O.C. & 12" O.C. IN FIELD. BLOCKING SHALL BE PLACED AT ALL SHEATHING JOINTS. NAILS AT EDGES TO BE MIN. 3/8" FROM PANEL EDGE.
- FOR SHEATHING AT LOCATIONS WHERE FLOOR TRUSS IS PARALLEL WITH WALL: FASTEN SHEATHING TO TOP & BOTTOM CHORD MEMBERS AND ALL WEB MEMBERS w/ 8d NAILS @ 3" O.C.
- 1/2" PLYWOOD OR 24/16" STRUCTURAL O.S.B. SHEATHING TO BE USED AS UPLIFT RESISTANCE NO OTHER FASTENERS REQ'D. EXCEPT AS NOTED ON PLANS IN TWO STORY FRAME APPLICATIONS, SHEATHING SHALL EXTEND MIN. 2'-0" W/O BREAK ABV. 2nd FLOOR BOTTOM PLT. TO T.O.M.

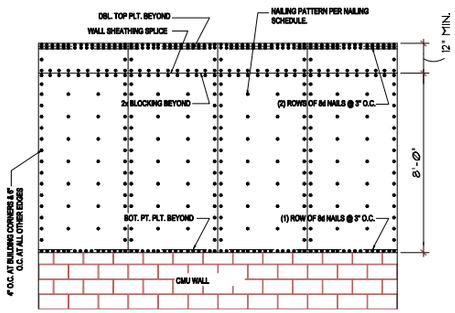

(A) SHEATHING ELEV. BALLOON FRAMING N.T.S.

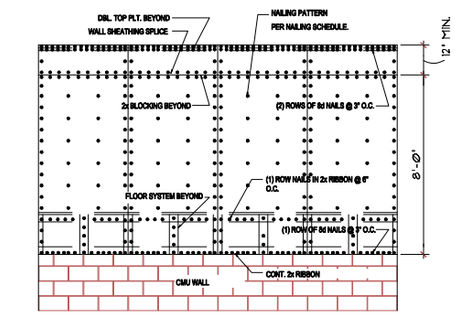

(B) SHEATHING ELEV. 2-STORY FRAMING N.T.S.



(C) SHEATHING BLOCKING @HORIZONTAL JOINTS N.T.S

1 SHEATHING UPLIFT DETAILS SCALE: N.T.S.

NOTE:
SHEARWALL SECTION IS DEFINED AS PORTION OF WALL NO LESS THAN 6'-0" W/O AN OPENING.

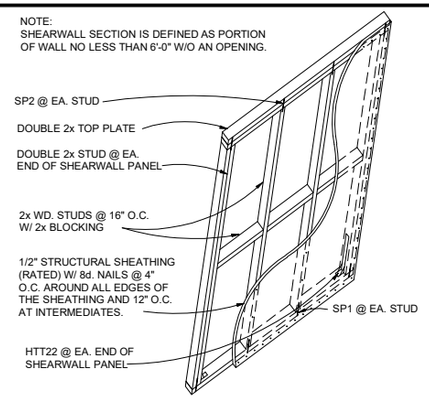

2 2-STORY INTERIOR BEARING WALL

STUD TO STUD CONDITION

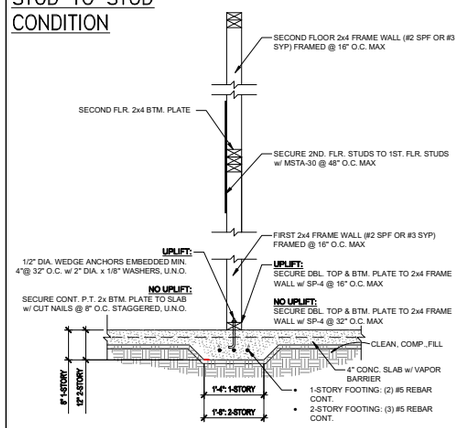

FLR. TRUSS CONDITION

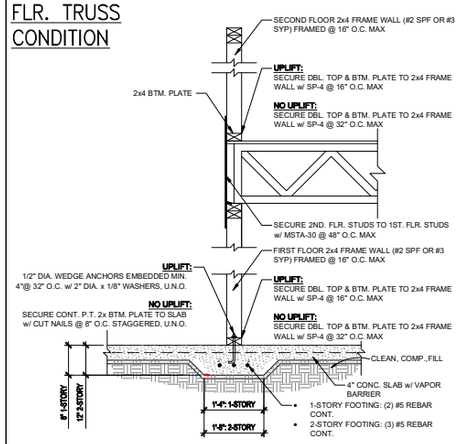

3 2-STORY INT. BEARING WALL SCALE: N.T.S.

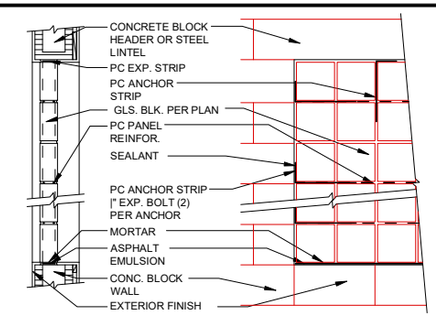

PANEL ANCHOR CONSTRUCTION

PC PANEL REINFORCING (TOP): USED IN PANELS OVER 25"S.F. IN AREA,IS EMBEDDED HORIZONTALLY IN THE MORTAR JOINTS BETWEEN EVERY OTHER COURSE. PANEL REINFORCING IS FORMED OF TWO PARALLEL WIRES, EITHER 1" O.C. (FOR USE WITH "THINLINE" SERIES GLS. BLK.) OR 2" O.C. (FOR USE W/ "PREMIERE" SERIES GLS. BLK.), W/ BUTT WELDED CROSSWIRES AT REGULAR INTERVALS. 4' AND 10' LENGTHS AVAILABLE.

PC PANEL ANCHORS (MIDDLE): ARE USED TO TIE PITTSBURGH CORNING GLASS BLOCK PANELS INTO THE SURROUNDING FRAMEWORK WHEN CHANNELS ARE NOT USED. FORMED FROM 20 GAUGE PERFORATED-THEN GALVANIZED STEEL STRIPS, PANEL ANCHORS ARE AVAIL. IN 1[" WIDTHS X 24" LENGTHS.

EXPANSION STRIPS (BOTTOM): MADE OF WHITE POLYETHYLENE, ARE INSERTED AT THE HEAD AND THE STRIPS REPLACE MORTAR AT THESE POINTS TO CUSHION THE GLASS BLOCK AND ALLOW THE PANEL TO EXPAND & CONTRACT FREELY. FOR METAL CHANNEL OR MASONRY CHASE CONSTRUCTION, PC EXPANSION STRIPS ARE AVAILABLE " THICK X 4" WIDE X 24" LONG. FOR PANEL ANCHOR CONSTRUCTION, STD. 4" WIDE STRIPS ARE EASILY CUT TO 3" WIDTH, FOR 3[" "PREMIERE" SERIES BLK., AND TO 2[" WIDTH, FOR 3_" "THINLINE" SERIES BLOCK.

4 GLASS BLOCK DETAILS SCALE: N.T.S.

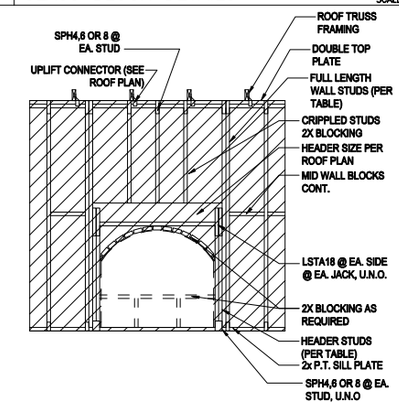

5 TYP. OPENING FRAMING DETAILS SCALE: N.T.S.

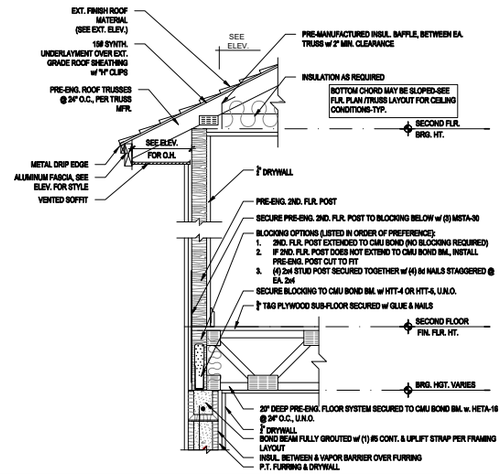

6 2ND. FLR. POST BLOCKING (SQUASH BLOCK) SCALE: 3/4"=1'-0"

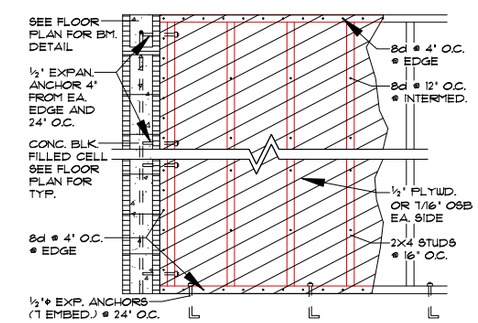

USE ONLY WHEN NOTED AS SHEAR WALL ON PLANS

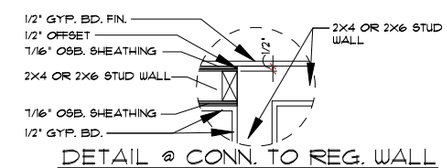

DETAIL @ CONN. TO REG. WALL
1" = 1'-0"

7 SHEAR WALL DETAILS SCALE: N.T.S.

235 Maitland Avenue S.
Suite 108-A
Maitland, FL 32751
Ph: (407) 227-7416
www.premierestructural.com
FL CERT. AUTH.: 29113
FL PE#: 60239
PREMIER STRUCTURAL ENGINEERING INC.

815 Orienta Ave. Suite# 1040
Altamonte Springs, FL. 32701
Ph: (407) 629-6711
Fax: (407) 629-6776
www.mjshomedesigns.com
custom home design
DESIGNERS • PLANNERS
MJS

40-4248
YORKSHIRE
Street Address
Lot Info
City, State, Zip

A division of Park Square Enterprises Inc.
5200 Vineland Rd. Suite #200
Orlando, FL 32811
Phone: (407) 529-3000
Park Square HOMES

ISSUE DATE	00/00/0000
REVISIONS	
PROJECT:	00-0000
SCALE:	AS NOTED
DRAWN BY:	C.C.
DESIGNED BY:	MJS

DETAILS
D5

© COPYRIGHT 2018 PARK SQUARE HOMES HEREBY RESERVES ITS COMMON LAW COPYRIGHTS IN THESE PLANS, IDEAS AND DESIGN. THESE PLANS, IDEAS AND DESIGNS ARE NOT TO BE COPIED OR MODIFIED IN ANY MATTER OR FORM WHATSOEVER, FOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

ALL DESIGNS/PLANS IN THIS PUBLICATION ARE PROTECTED UNDER THE COPYRIGHT LAW. REPRODUCTION OF THE ILLUSTRATIONS OR WORKING DRAWINGS BY ANY MEANS IS STRICTLY PROHIBITED UNLESS LICENSED BY MJS, INC.

May 21, 2018,7:00pm Carlos Z:\Park Square Homes\MODELS\ORLANDO MODELS\40' Models (Horizon West)\MODELS\The Yorkshire (40-4248)\05 Details.dwg

Note: plans have been electronically signed & sealed by Neil Rodriguez, PE using a digital signature. AD is issued and printed copy of this document are not considered Signed & Sealed. Signature and Seal is verified on any electronic copies.

WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE DIMENSIONS. Contractor shall verify and be responsible for dimensions and conditions of the job and MJS, Inc. must be notified of any variance. It is the dimensions, conditions and specifications appearing on these plans.