

4232 (A,B,C)

REEF

PARADISO GRANDE

40' X 71'4

REVISION SCHEDULE			
NO.	DATE	DESCRIPTION	BY
②	04-09-21	-THESE PLANS CREATED USING 4219 SANTA ROSA	DE
		PLANS DATED 03-04-21 PROVIDED BY PSH	
①	06-25-21	-REVISED 2ND FLOOR EXTERIOR FINISH FROM	DH
		STUCCO TO SMOOTH PANEL BOARD	
		-REVISE ALL ARCH SOFFITS TO FLAT	
		-CODE UPDATED TO FBCR 2020, 1TH ED.	
		4 NEC 2017	
②	11-16-21	-INTERIOR DOORS CHANGED TO 6/8 ILO 8/0	AZ
		1ST FLOOR ONLY	
		-WASHER & DRYER OPTIONAL	

SHEET INDEX- ELEVATION "A"

00	COVER SHEET
01A.0	FOUNDATION PLAN
02A.0	FLOOR PLAN W/ DIMENSIONS
03A.0	FLOOR PLAN W/ NOTES
04A.0	UPPER FLOOR PLAN W/ DIMENSIONS
05A.0	UPPER FLOOR PLAN W/ NOTES
06A.0	EXTERIOR ELEVATIONS- FRONT/ REAR
07A.0	EXTERIOR ELEVATIONS- LEFT/ RIGHT
08	CROSS SECTION AND INTERIOR ELEVATIONS
09A.0	ELECTRICAL PLAN
10A.0	UPPER ELECTRICAL PLAN
11A.0	TRUSS LAYOUT
12A.0	UPPER TRUSS LAYOUT
13A.0	PRECAST LINTEL LAYOUT
14	TYPICAL DETAILS/CONNECTOR SCHEDULE
15	TYPICAL DETAILS
16	TYPICAL DETAILS
17	TYPICAL DETAILS
D1	TYPICAL STRUCTURAL DETAILS
D2	TYPICAL STRUCTURAL DETAILS
D3	TYPICAL STRUCTURAL DETAILS
D4	TYPICAL STRUCTURAL DETAILS
D5	TYPICAL STRUCTURAL DETAILS
D6	SOFFIT DETAILS

SHEET INDEX- ELEVATION "B"

00	COVER SHEET
01B.0	FOUNDATION PLAN
02B.0	FLOOR PLAN W/ DIMENSIONS
03B.0	FLOOR PLAN W/ NOTES
04B.0	UPPER FLOOR PLAN W/ DIMENSIONS
05B.0	UPPER FLOOR PLAN W/ NOTES
06B.0	EXTERIOR ELEVATIONS- FRONT/ REAR
07B.0	EXTERIOR ELEVATIONS- LEFT/ RIGHT
08	CROSS SECTION AND INTERIOR ELEVATIONS
09B.0	ELECTRICAL PLAN
10B.0	UPPER ELECTRICAL PLAN
11B.0	TRUSS LAYOUT
12B.0	UPPER TRUSS LAYOUT
13B.0	PRECAST LINTEL LAYOUT
14	TYPICAL DETAILS/CONNECTOR SCHEDULE
15	TYPICAL DETAILS
16	TYPICAL DETAILS
17	TYPICAL DETAILS
D1	TYPICAL STRUCTURAL DETAILS
D2	TYPICAL STRUCTURAL DETAILS
D3	TYPICAL STRUCTURAL DETAILS
D4	TYPICAL STRUCTURAL DETAILS
D5	TYPICAL STRUCTURAL DETAILS
D6	SOFFIT DETAILS

SHEET INDEX- ELEVATION "C"

00	COVER SHEET
01C.0	FOUNDATION PLAN
02C.0	FLOOR PLAN W/ DIMENSIONS
03C.0	FLOOR PLAN W/ NOTES
04C.0	UPPER FLOOR PLAN W/ DIMENSIONS
05C.0	UPPER FLOOR PLAN W/ NOTES
06C.0	EXTERIOR ELEVATIONS- FRONT/ REAR
07C.0	EXTERIOR ELEVATIONS- LEFT/ RIGHT
08	CROSS SECTION AND INTERIOR ELEVATIONS
09C.0	ELECTRICAL PLAN
10C.0	UPPER ELECTRICAL PLAN
11C.0	TRUSS LAYOUT
12C.0	UPPER TRUSS LAYOUT
13C.0	PRECAST LINTEL LAYOUT
14	TYPICAL DETAILS/CONNECTOR SCHEDULE
15	TYPICAL DETAILS
16	TYPICAL DETAILS
17	TYPICAL DETAILS
D1	TYPICAL STRUCTURAL DETAILS
D2	TYPICAL STRUCTURAL DETAILS
D3	TYPICAL STRUCTURAL DETAILS
D4	TYPICAL STRUCTURAL DETAILS
D5	TYPICAL STRUCTURAL DETAILS
D6	SOFFIT DETAILS



THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE


PARADISO GRANDE

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS		BY
Engineering By: DBE and C MICHAEL A. THOMPSON PE 47509 PHONE 407-721-2292		
A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32811 Phone: (407) 529 - 3000		
COVER SHEET		
REEF	PARADISO GRANDE	
4232	DATE 04-09-21	
	SCALE AS NOTED	
	DRAWN RDC	
	JOB 4232	
	SHEET	
	OF	00 SHEETS


$$1/8' = 1' - \emptyset' \quad (11 \times 17) \quad 1/4' = 1' - \emptyset'' \quad (22 \times 34)$$


01A.0
OF SHEETS


$$1/8' = 1' - \emptyset' \quad (11 \times 17) \quad 1/4' = 1' - \emptyset'' \quad (22 \times 34)$$


THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1st EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000. PARADISO GRANDE

PARADISO GRANDE


© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

A DIVISION OF PARK SQUARE
ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811

Engineering By:
DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

REVISIONS	E
-----------	---

REVISIONS	E
-----------	---


$$1/8^{\circ}=1'-0'' \text{ (11} \times 17) \quad 1/4^{\circ}=1'-0'' \text{ (22} \times 34)$$



REVISIONS	BY

TABULATION		
UPPER LIVING	2,294	SF.
LOWER LIVING	1,938	SF.
TOTAL LIVING	4,232	SF.
GARAGE	407	SF.
ENTRY	113	SF.
LANAI	320	SF.
TOTAL UNDER ROOF	5,072	SF.

GENERAL NOTES

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. ALL INTERIOR FRAME WALL DIMENSIONS TO BE $3\frac{1}{2}$ " UNLESS NOTED OTHERWISE.
4. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE $7\frac{1}{2}$ " UNLESS NOTED OTHERWISE.
5. ALL INTERIOR CEILINGS AT 10'-0" UNLESS NOTED OTHERWISE.
6. MECHANICAL EQUIPMENT LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.

FLOOR PLAN W/ DIMENSIONS "A"
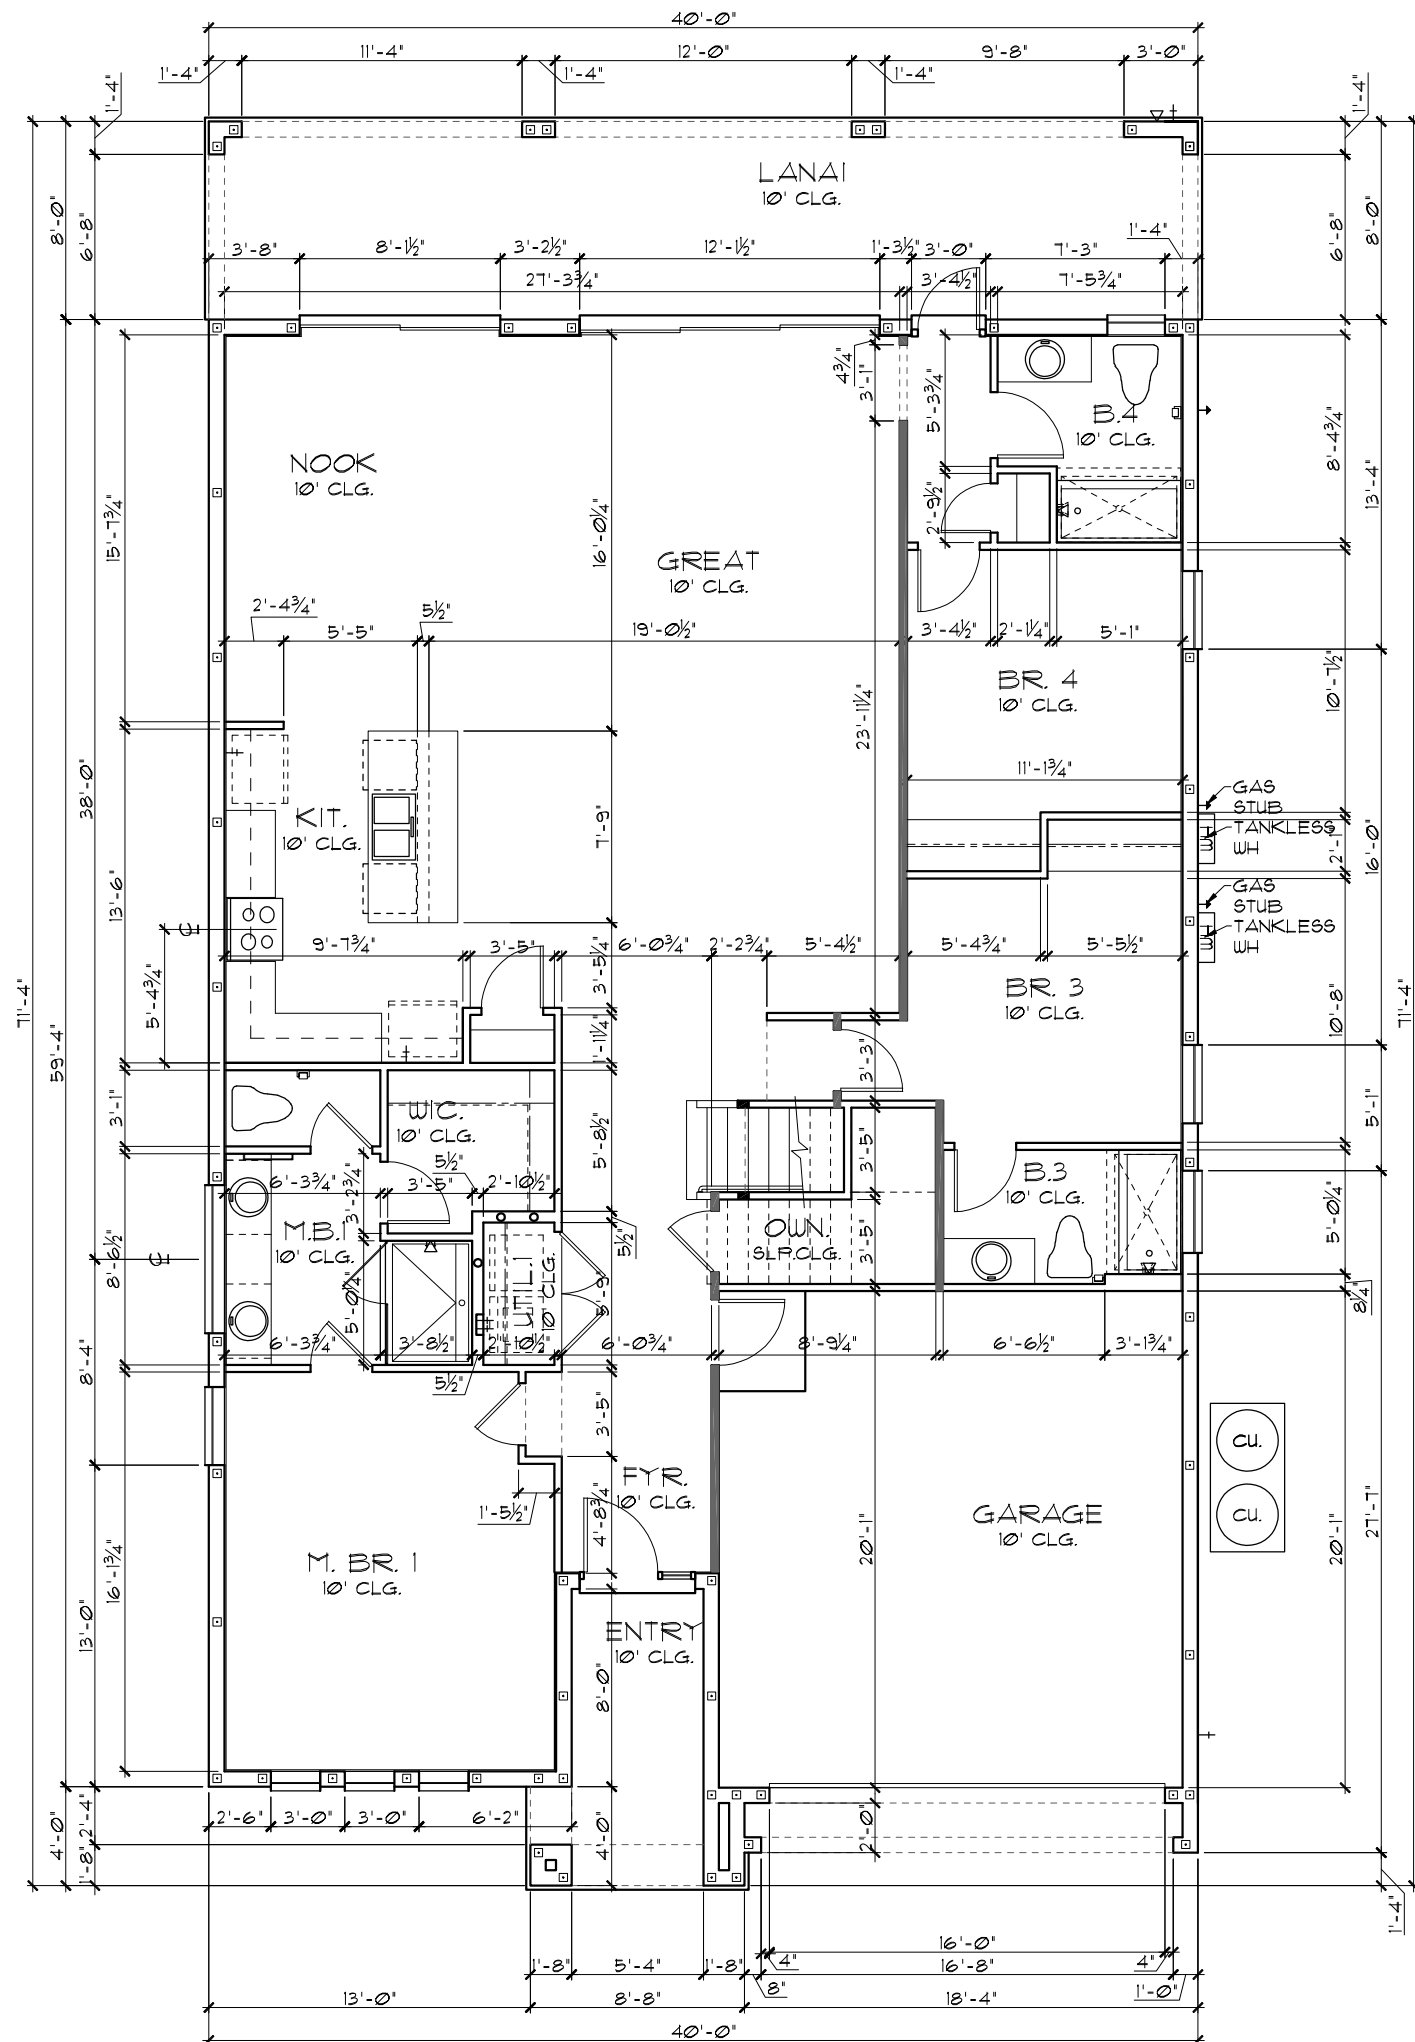
$$1/8^{\circ}=1'-0'' \text{ (11X17)} \quad 1/4^{\circ}=1'-0'' \text{ (22X34)}$$


THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1ST EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

2) COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied, or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

U
U
U
U

PARADISO GRANDE

4232

DATE 04-09-2004

DRAWN RDC

JOB	423
-----	-----

SHEET

02A.0
OF SHEETS

PARADISO GRANDE

**A DIVISION OF PARK SQUARE
ENTERPRISES, INC.**
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

**Park
Square
HOMES**

FLOOR PLAN W/ DIMENSIONS

REEF

PARADISO GRANDE

4232

DATE 04-09-2011

DRAWN RDC

JOB	423
-----	-----

SHEET

02A.0
OF SHEETS

Engineering By:
DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

**A DIVISION OF PARK SQUARE
ENTERPRISES, INC.**
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

**Park
Square
HOMES**

FLOOR PLAN W/ DIMENSIONS

REEF

PARADISO GRANDE

4232

DATE 04-09-2011

DRAWN RDC

JOB	423
-----	-----

SHEET


02A.0
OF SHEETS

TABULATION		
UPPER LIVING	2,294	SF.
LOWER LIVING	1,938	SF.
TOTAL LIVING	4,232	SF.
GARAGE	407	SF.
ENTRY	115	SF.
LANAI	320	SF.
TOTAL UNDER ROOF	5,074	SF.

GENERAL NOTES

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
2. DO NOT SCALE PRINTS CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
3. ALL INTERIOR FRAME WALL DIMENSIONS TO BE $3\frac{1}{2}"$ UNLESS NOTED OTHERWISE.
4. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE $7\frac{1}{2}"$ UNLESS NOTED OTHERWISE.
5. ALL INTERIOR CEILINGS AT **10'-0"** UNLESS NOTED OTHERWISE.
6. MECHANICAL EQUIPMENT LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.

FLOOR PLAN W/ DIMENSIONS "B"
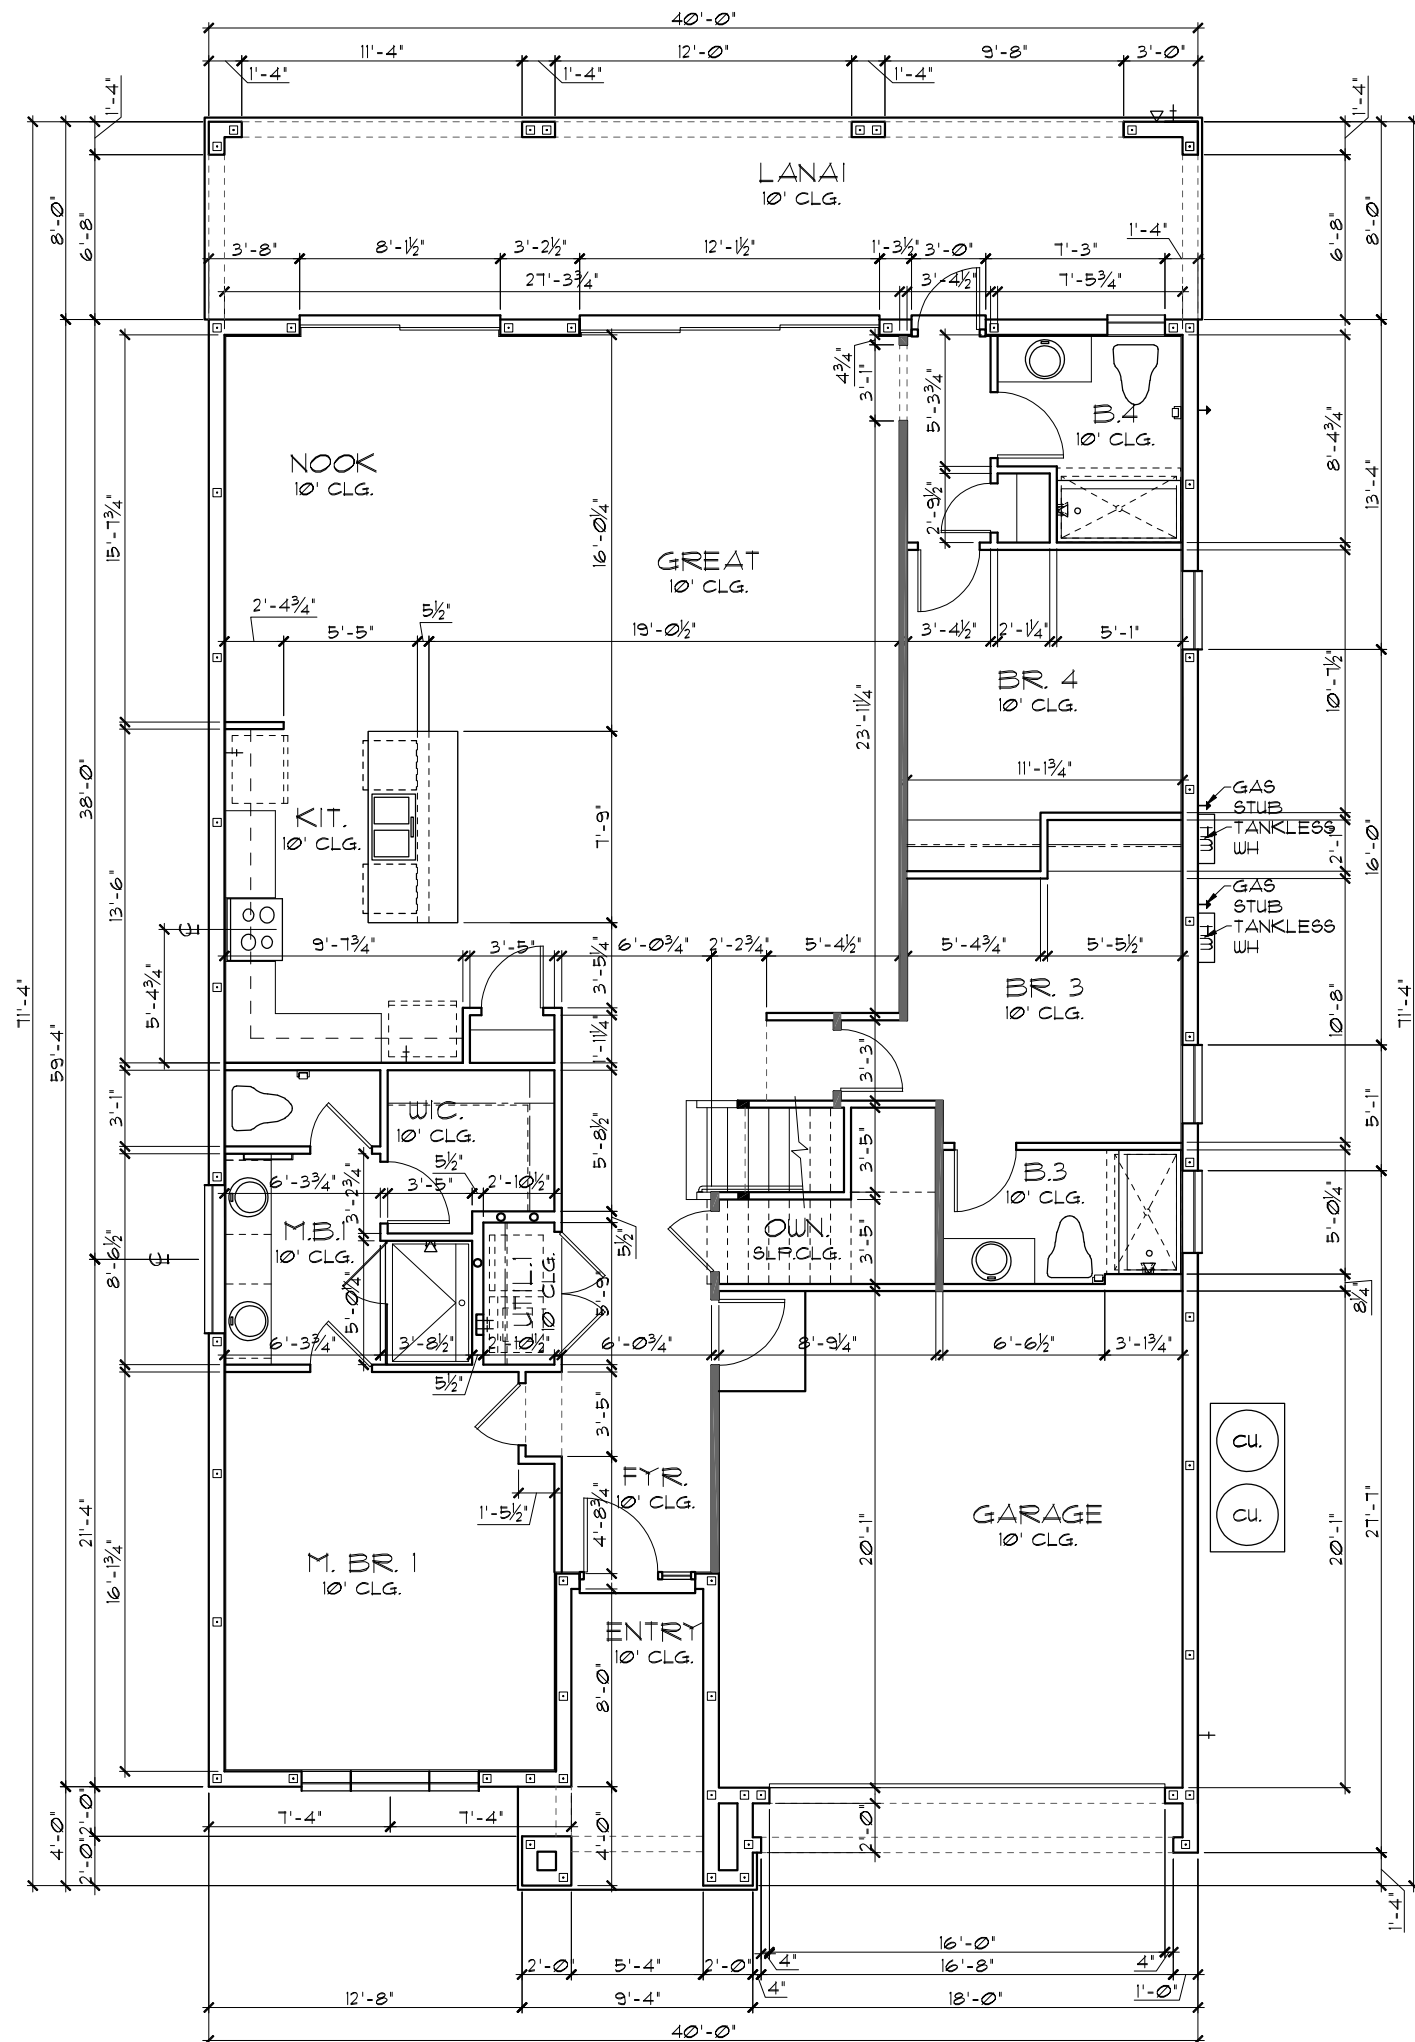
$$1/8'' = 1' - 0'' \quad (11 \times 17) \quad 1/4'' = 1' - 0'' \quad (22 \times 34)$$


THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1st EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

2) COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

LL
LL
LL
LL

PARADISO GRANDE

4232

DATE 04-09-2

SCALE AS NOTED

DRAWN RDC

JOB	4232
-----	------

SHEET

02B.0
OF SHEETS

PARADISO GRANDE

**A DIVISION OF PARK SQUARE
ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000**

**Park
Square
HOMES**

FLOOR PLAN W/ DIMENSIONS

REVISIONS	BY

TABULATION	
UPPER LIVING	2294 SF.
LOWER LIVING	1938 SF.
TOTAL LIVING	4232 SF.
GARAGE	407 SF.
ENTRY	115 SF.
LANAI	320 SF.
TOTAL UNDER ROOF	5,074 SF.

- GENERAL NOTES
1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.

2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.

3. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3½" UNLESS NOTED OTHERWISE.


4. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1½" UNLESS NOTED OTHERWISE.

5. ALL INTERIOR CEILINGS AT 10'-0" UNLESS NOTED OTHERWISE.

6. MECHANICAL EQUIPMENT LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.

FLOOR PLAN W/ DIMENSIONS "C"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

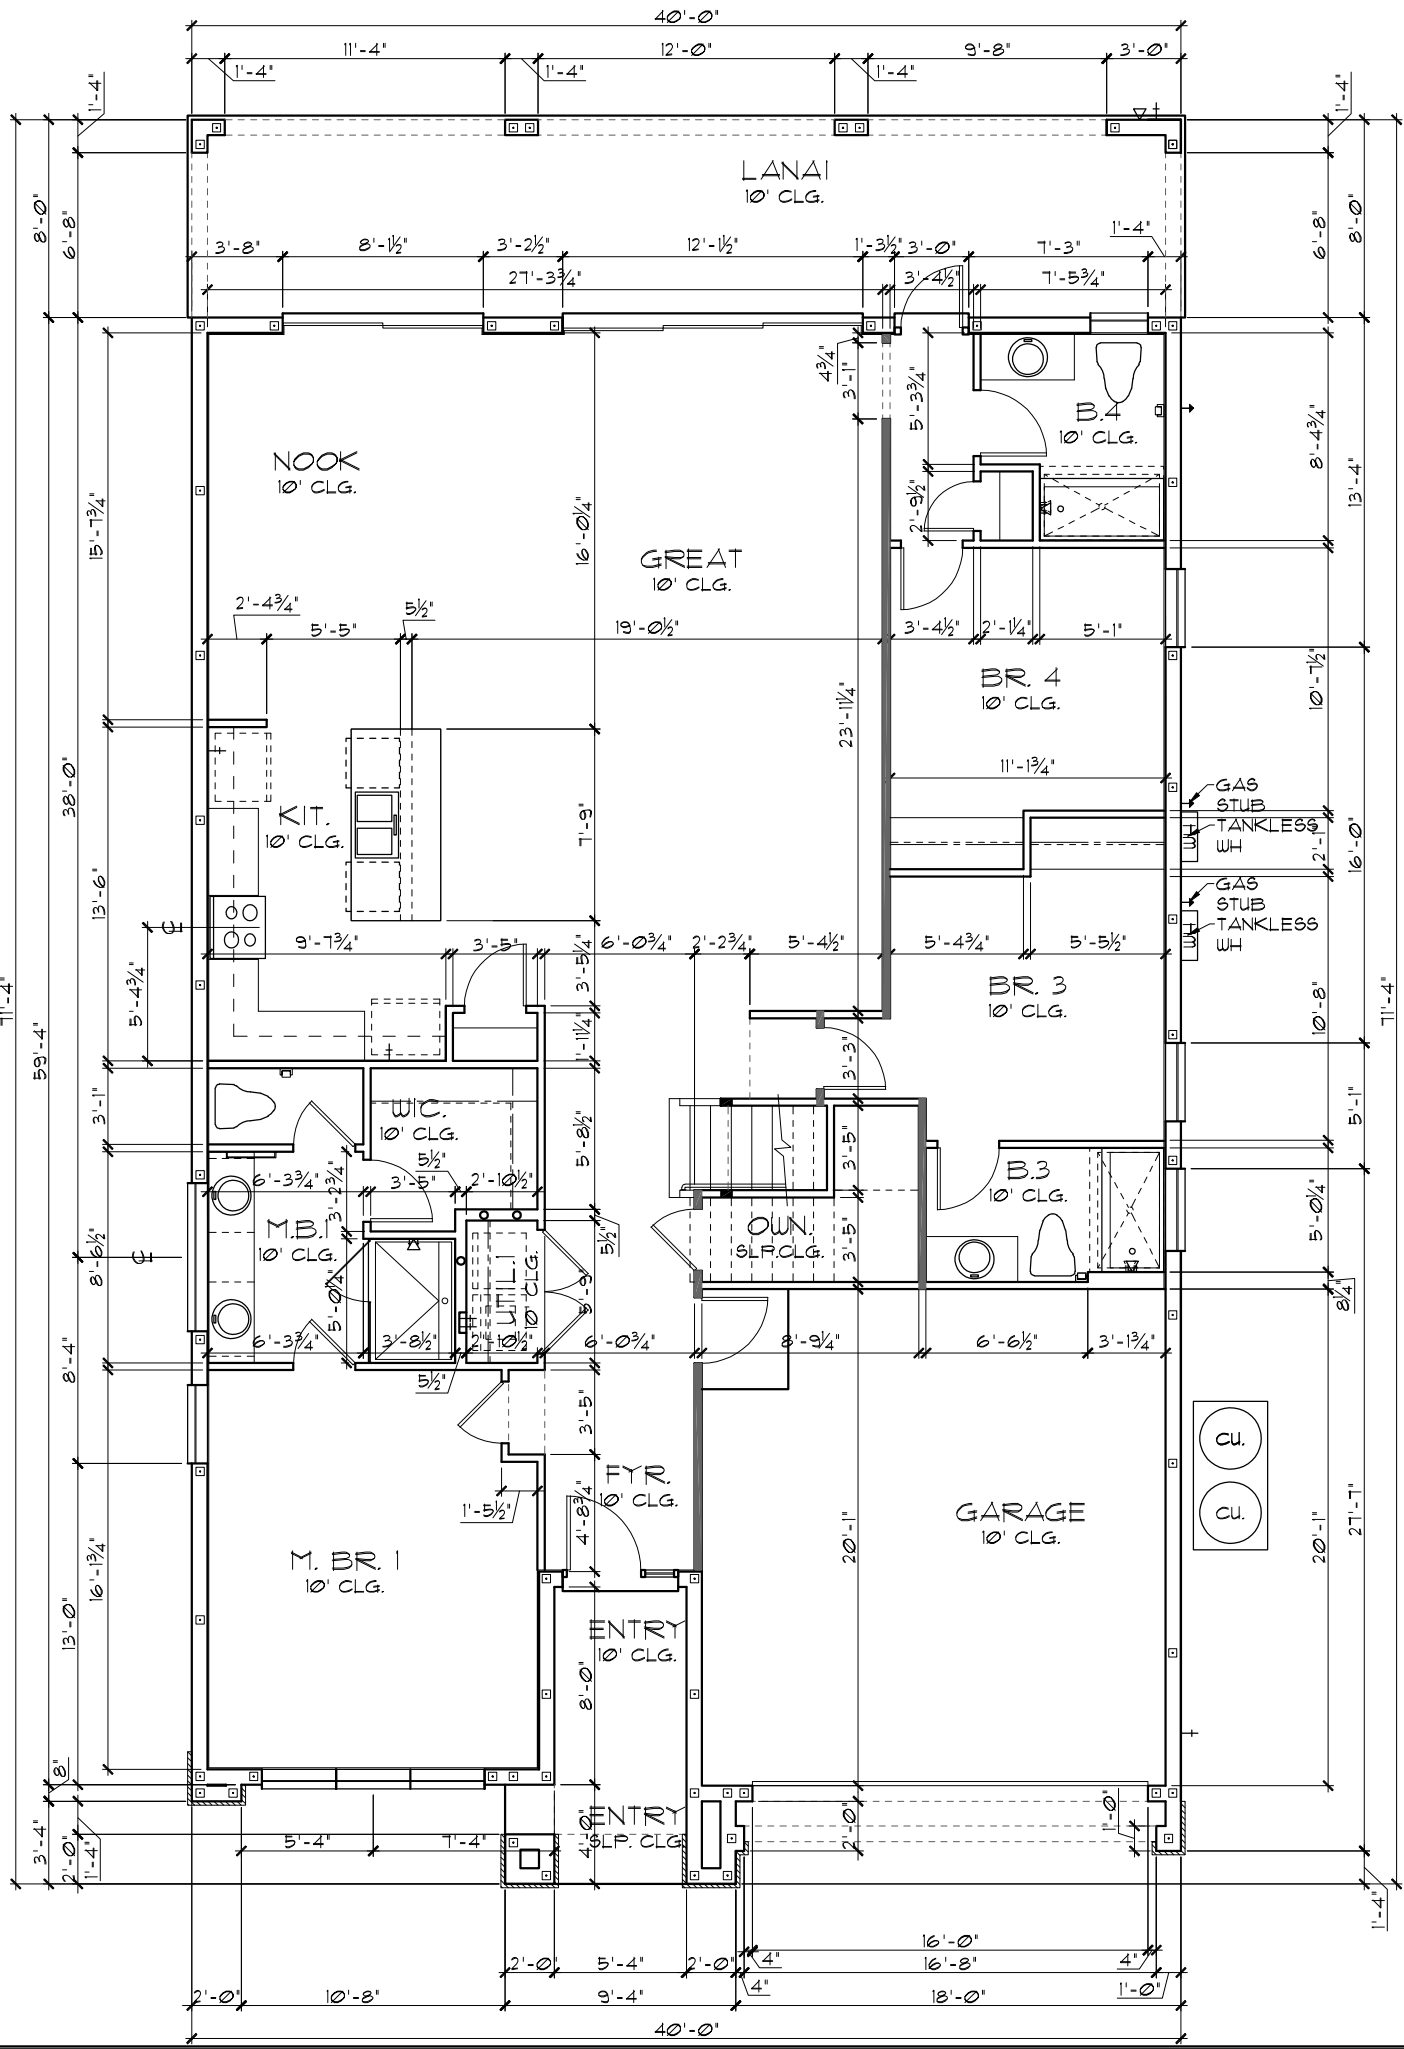

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REEF

PARADISO GRANDE

4232

DATE 04-09-21

SCALE AS NOTED

DRAWN RDC

JOB 4232

SHEET 02C.0

OF SHEETS

Engineering By DBE and C MICHAEL A. THOMPSON PE 47509 PHONE 407-721-2292

A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32811 Phone: (407) 529 - 3000

Engineering By DBE and C MICHAEL A. THOMPSON PE 47509 PHONE 407-721-2292

PARADISO GRANDE





FLOOR PLAN W/ DIMENSIONS

PARADISO GRANDE

LOAD INFORMATION		
PER 1TH EDITION, 2020 FLORIDA BUILDING RESIDENTIAL CODE		
DEAD LOADS		
FLOOR: STRUCTURE	-----	1 PSF
CEILINGS	-----	3 PSF
MECH/ELEC	-----	5 PSF
PARTITIONS	-----	5 PSF
TOTAL	-----	20 PSF
ROOF: SHEATHING	-----	5 PSF
STRUCTURE	-----	1 PSF
CEILINGS	-----	3 PSF
MECH/ELEC	-----	5 PSF
TOTAL	-----	20 PSF
FLOOR LIVE LOADS		
RESIDENTIAL FLOOR:	-----	40 PSF
UNINHABITABLE ATTIC WITHOUT STORAGE:	-----	10 PSF
UNINHABITABLE ATTIC W/LIMITED STORAGE:	-----	20 PSF
ROOMS OTHER THAN SLEEPING ROOM:	-----	40 PSF
SLEEPING ROOM:	-----	30 PSF
STAIR LIVE LOAD:	-----	40 PSF
BALCONIES:	-----	40 PSF
PASSANGER VEHICLE GARAGE:	-----	50 PSF
ROOF LIVE LOADS		
MINIMUM ROOF LIVE LOAD (PSF) TRIBUTARY LOADED AREA (SQ. FT.) FOR ANY STRUCTURAL MEMBER		
ROOF SLOPE	0-200	201-600
0-12 < 4:12	20	16
≥ 4:12 < 12:12	16	14
≥ 12:12	12	12

WIND INFORMATION		
PER 1TH EDITION, 2020 FLORIDA BUILDING RESIDENTIAL CODE		
1. BASIC WIND SPEED:	-----	140 MPH
2. RISK CATEGORY	-----	II
3. WIND EXPOSURE:	-----	B
4. BUILDING TYPE:	-----	V B
5. ENCLOSURE CLASSIFICATION	--- +/- .18, INCLUDED INTERNAL PRESSURE	IN NOTE #6
6. COMPONENT / CLADDING	-----	SEE PLAN DESIGN WIND PRESSURE:
+ XXX DESIGN WIND PRESSURE IAW FLA		
- XXX RESIDENTIAL CODE, SECTION R301		
NOTE: DESIGN PRESSURES BASED ON BASIC WIND SPEED AND NOT ULTIMATE WIND SPEED.		

GENERAL NOTES		
1. PROVIDE RECESS HOT & COLD WATER WITH DRAIN @ WASHER SPACE.		
2. VENT DRYER THRU ROOF.		
3. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.		
4. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.		
5. MECHANICAL EQUIPMENT LOCATION TO BE DETERMINED BY COMMUNITY STANDARDS AND APPLICABLE COUNTY CODES.		
6.  DENOTES CONC. BLOCK WALL HGT. @ 10'-0" A.F.F.		
 DENOTES CONC. BLOCK WALL HGT. @ X'-0" A.F.F.		
7. REFER TO TYPICAL DETAIL SHEET FOR EXTERIOR WALL FINISH SPECIFICATIONS		
8. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES		
9. ANCHOR THE CONDENSER UNIT TO SLAB PER CODE: M1307.1 - M1307.2		
10. ALL INTER. FIRST FLOOR CEILINGS AT 10'-0" UNLESS NOTED OTHERWISE.		
ALL INTER. SECOND FLOOR CEILINGS AT 9'-0" UNLESS NOTED OTHERWISE.		

NOTE: 1. DOOR FROM HOUSE TO GARAGE MUST BE SOLID WOOD DOOR NO LESS THEN 1 3/8" IN THICKNESS, SOLID OR HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1 3/8" THICK, OR 20MIN. FIRE RATED IAW R302.5

EGRESS WINDOW SCHEDULE - R310.2.1- FBCR2020		
SH25	33 1/2" H. X 30" W.	MIN. NET CLEAR OPENING 5.1 SQFT

- NOTE:
- ALL EMERGENCY ESCAPE WINDOW SILLS TO BE NOT MORE THAN 44"MIN. AFF.- R310.2 - FBCR (2020)
 - WINDOWS SILLS LOCATED LESS THAN 24" ABOVE FINISH FLOOR AND GREATER THAN 12" FINISHED GRADE MUST COMPLY WITH FBCR 312.2

PER FBC R301- TABLE R301.5	
GUARDRAILS & HANDRAILS	200 PSF
GUARDRAIL IN - FILL COMPONENTS	50 PSF
STAIRS	40 PSF


NOTE: TEMPERED GLAZING IS REQUIRED AT ALL HAZARDOUS LOCATIONS AS DEFINED IN FBC R308.4

PER FBC R301- TABLE R301.5	
GUARDRAILS & HANDRAILS	200 PSF
GUARDRAIL IN - FILL COMPONENTS	50 PSF
PER FBC R312- R312.12 & R312.13 & R311.7.1	
GUARDRAILS HEIGHT	36" MIN.
HANDRAIL HEIGHT	34" MIN. TO 38" MAX.
GUARDRAIL OPENING LIMITATIONS	4" IN DIAMETER MAX.

NOTE: HANDRAIL CONTINUITY PER R311.7.2.- HANDRAILS FOR STAIRS SHALL BE CONTINUOUS FOR FULL LENGTH OF THE FLIGHT, FROM A POINT DIRECTLY ABOVE THE TOP RISER OF THE FLIGHT TO A POINT DIRECTLY ABOVE THE LOWEST RISER OF THE FLIGHT. HANDRAIL ENDS SHALL BE RETURNED OR SHALL TERMINATE IN NEEL POST OR SAFETY TERMINALS. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE OF NO LESS THAN 1 1/2"(38MM) BETWEEN THE WALL AND THE HANDRAIL.

FLOOR PLAN W/ NOTES "B"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

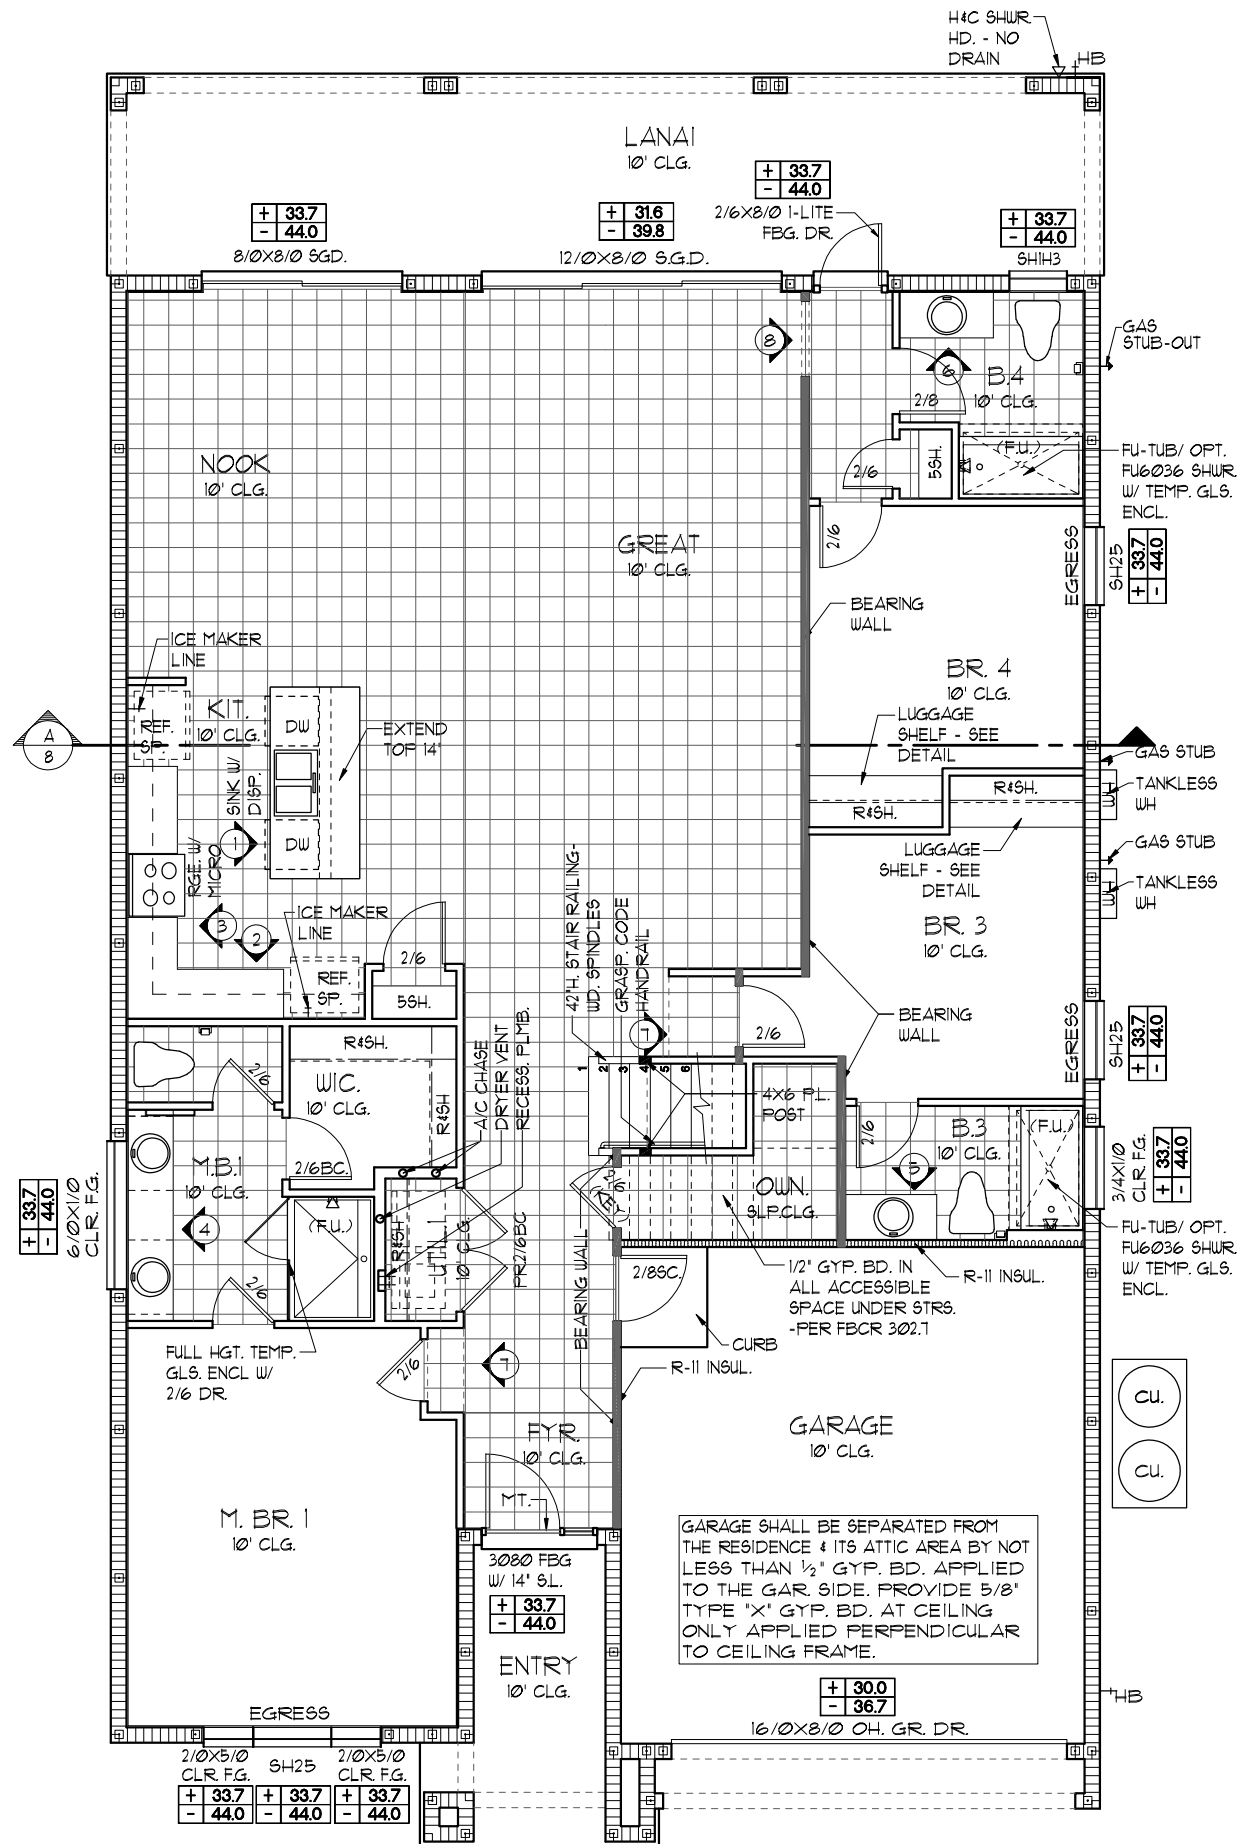

NOTE: ALL INTERIOR DOORS ON THIS FLOOR TO BE: 6'-8" UNO. - VERIFY WITH COLOR SHEET.

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1TH EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE



PARADISO GRANDE

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS		BY
Engineering By: DBE and C		
MICHAEL A. THOMPSON		
PE 47509		
PHONE 407-721-2292		
A DIVISION OF PARK SQUARE ENTERPRISES, INC.		
5200 Vineland Road, Suite 200		
Orlando, Florida 32811		
Phone: (407) 529 - 3000		
Park Square HOMES		
FLOOR PLAN W/ NOTES		
REEF		
PARADISO GRANDE		
4232		
DATE 04-09-21		
SCALE AS NOTED		
DRAWN RDC		
JOB 4232		
SHEET		
03B.0		
OF SHEETS		

LOAD INFORMATION		
PER 1TH EDITION, 2020 FLORIDA BUILDING RESIDENTIAL CODE		
DEAD LOADS		
FLOOR: STRUCTURE	-----	1 PSF
CEILINGS	-----	3 PSF
MECH/ELEC	-----	5 PSF
PARTITIONS	-----	5 PSF
TOTAL	-----	20 PSF
ROOF: SHEATHING	-----	5 PSF
STRUCTURE	-----	1 PSF
CEILINGS	-----	3 PSF
MECH/ELEC	-----	5 PSF
TOTAL	-----	20 PSF
FLOOR LIVE LOADS		
RESIDENTIAL FLOOR:	-----	40 PSF
UNINHABITABLE ATTIC WITHOUT STORAGE:	-----	10 PSF
UNINHABITABLE ATTIC W/LIMITED STORAGE:	-----	20 PSF
ROOMS OTHER THAN SLEEPING ROOM:	-----	40 PSF
SLEEPING ROOM:	-----	30 PSF
STAIR LIVE LOAD:	-----	40 PSF
BALCONIES:	-----	40 PSF
PASSANGER VEHICLE GARAGE:	-----	50 PSF
ROOF LIVE LOADS		
MINIMUM ROOF LIVE LOAD (PSF) TRIBUTARY LOADED AREA (SQ. FT.) FOR ANY STRUCTURAL MEMBER		
ROOF SLOPE	0-200	201-600
0-12 < 4:12	20	16
≥ 4:12 < 12:12	16	14
≥ 12:12	12	12

WIND INFORMATION		
PER 1TH EDITION, 2020 FLORIDA BUILDING RESIDENTIAL CODE		
1. BASIC WIND SPEED:	-----	140 MPH
2. RISK CATEGORY	-----	II
3. WIND EXPOSURE:	-----	B
4. BUILDING TYPE:	-----	V B
5. ENCLOSURE CLASSIFICATION	--- +/- .18, INCLUDED INTERNAL PRESSURE	IN NOTE #6 COEFFICIENT:
6. COMPONENT / CLADDING	-----	SEE PLAN DESIGN WIND PRESSURE:
+ XXX DESIGN WIND PRESSURE IAW FLA		
- XXX RESIDENTIAL CODE, SECTION R301		
NOTE: DESIGN PRESSURES BASED ON BASIC WIND SPEED AND NOT ULTIMATE WIND SPEED.		

GENERAL NOTES		
1. PROVIDE RECESS HOT & COLD WATER WITH DRAIN @ WASHER SPACE.		
2. VENT DRYER THRU ROOF.		
3. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.		
4. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.		
5. MECHANICAL EQUIPMENT LOCATION TO BE DETERMINED BY COMMUNITY STANDARDS AND APPLICABLE COUNTY CODES.		
6.  DENOTES CONC. BLOCK WALL HGT. @ 10'-0" A.F.F.		
 DENOTES CONC. BLOCK WALL HGT. @ X'-0" A.F.F.		
7. REFER TO TYPICAL DETAIL SHEET FOR EXTERIOR WALL FINISH SPECIFICATIONS		
8. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES		
9. ANCHOR THE CONDENSER UNIT TO SLAB PER CODE: M1307.1 - M1307.2		
10. ALL INTER. FIRST FLOOR CEILINGS AT 10'-0" UNLESS NOTED OTHERWISE.		
ALL INTER. SECOND FLOOR CEILINGS AT 9'-0" UNLESS NOTED OTHERWISE.		

NOTE: 1. DOOR FROM HOUSE TO GARAGE MUST BE SOLID WOOD DOOR NO LESS THEN 1 3/8" IN THICKNESS, SOLID OR HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1 3/8" THICK, OR 20MIN. FIRE RATED IAW R302.5

EGRESS WINDOW SCHEDULE - R310.2.1- FBCR2020		
SH25	33 1/2" H. X 30" W.	MIN. NET CLEAR OPENING 5.1 SQFT

- NOTE:
- ALL EMERGENCY ESCAPE WINDOW SILLS TO BE NOT MORE THAN 44" MIN. AFF. - R310.2 - FBCR (2020)
 - WINDOWS SILLS LOCATED LESS THAN 24" ABOVE FINISH FLOOR AND GREATER THAN 12" FINISHED GRADE MUST COMPLY WITH FBCR 312.2

PER FBC R301- TABLE R301.5	
GUARDRAILS & HANDRAILS	200 PSF
GUARDRAIL IN - FILL COMPONENTS	50 PSF
STAIRS	40 PSF


NOTE: TEMPERED GLAZING IS REQUIRED AT ALL HAZARDOUS LOCATIONS AS DEFINED IN FBC R308.4

PER FBC R301- TABLE R301.5	
GUARDRAILS & HANDRAILS	200 PSF
GUARDRAIL IN - FILL COMPONENTS	50 PSF
PER FBC R312- R312.12 & R312.13 & R311.7.1	
GUARDRAILS HEIGHT	36" MIN.
HANDRAIL HEIGHT	34" MIN. TO 38" MAX.
GUARDRAIL OPENING LIMITATIONS	4" IN DIAMETER MAX.

NOTE: HANDRAIL CONTINUITY PER R311.7.2. HANDRAILS FOR STAIRS SHALL BE CONTINUOUS FOR FULL LENGTH OF THE FLIGHT, FROM A POINT DIRECTLY ABOVE THE TOP RISER OF THE FLIGHT TO A POINT DIRECTLY ABOVE THE LOWEST RISER OF THE FLIGHT. HANDRAIL ENDS SHALL BE RETURNED OR SHALL TERMINATE IN NEUEL POST OR SAFETY TERMINALS. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE OF NO LESS THAN 1 1/2" (38MM) BETWEEN THE WALL AND THE HANDRAIL.

FLOOR PLAN W/ NOTES "C"

1/8" = 1'-0" (11X17) 1/4" = 1'-0" (22X34)

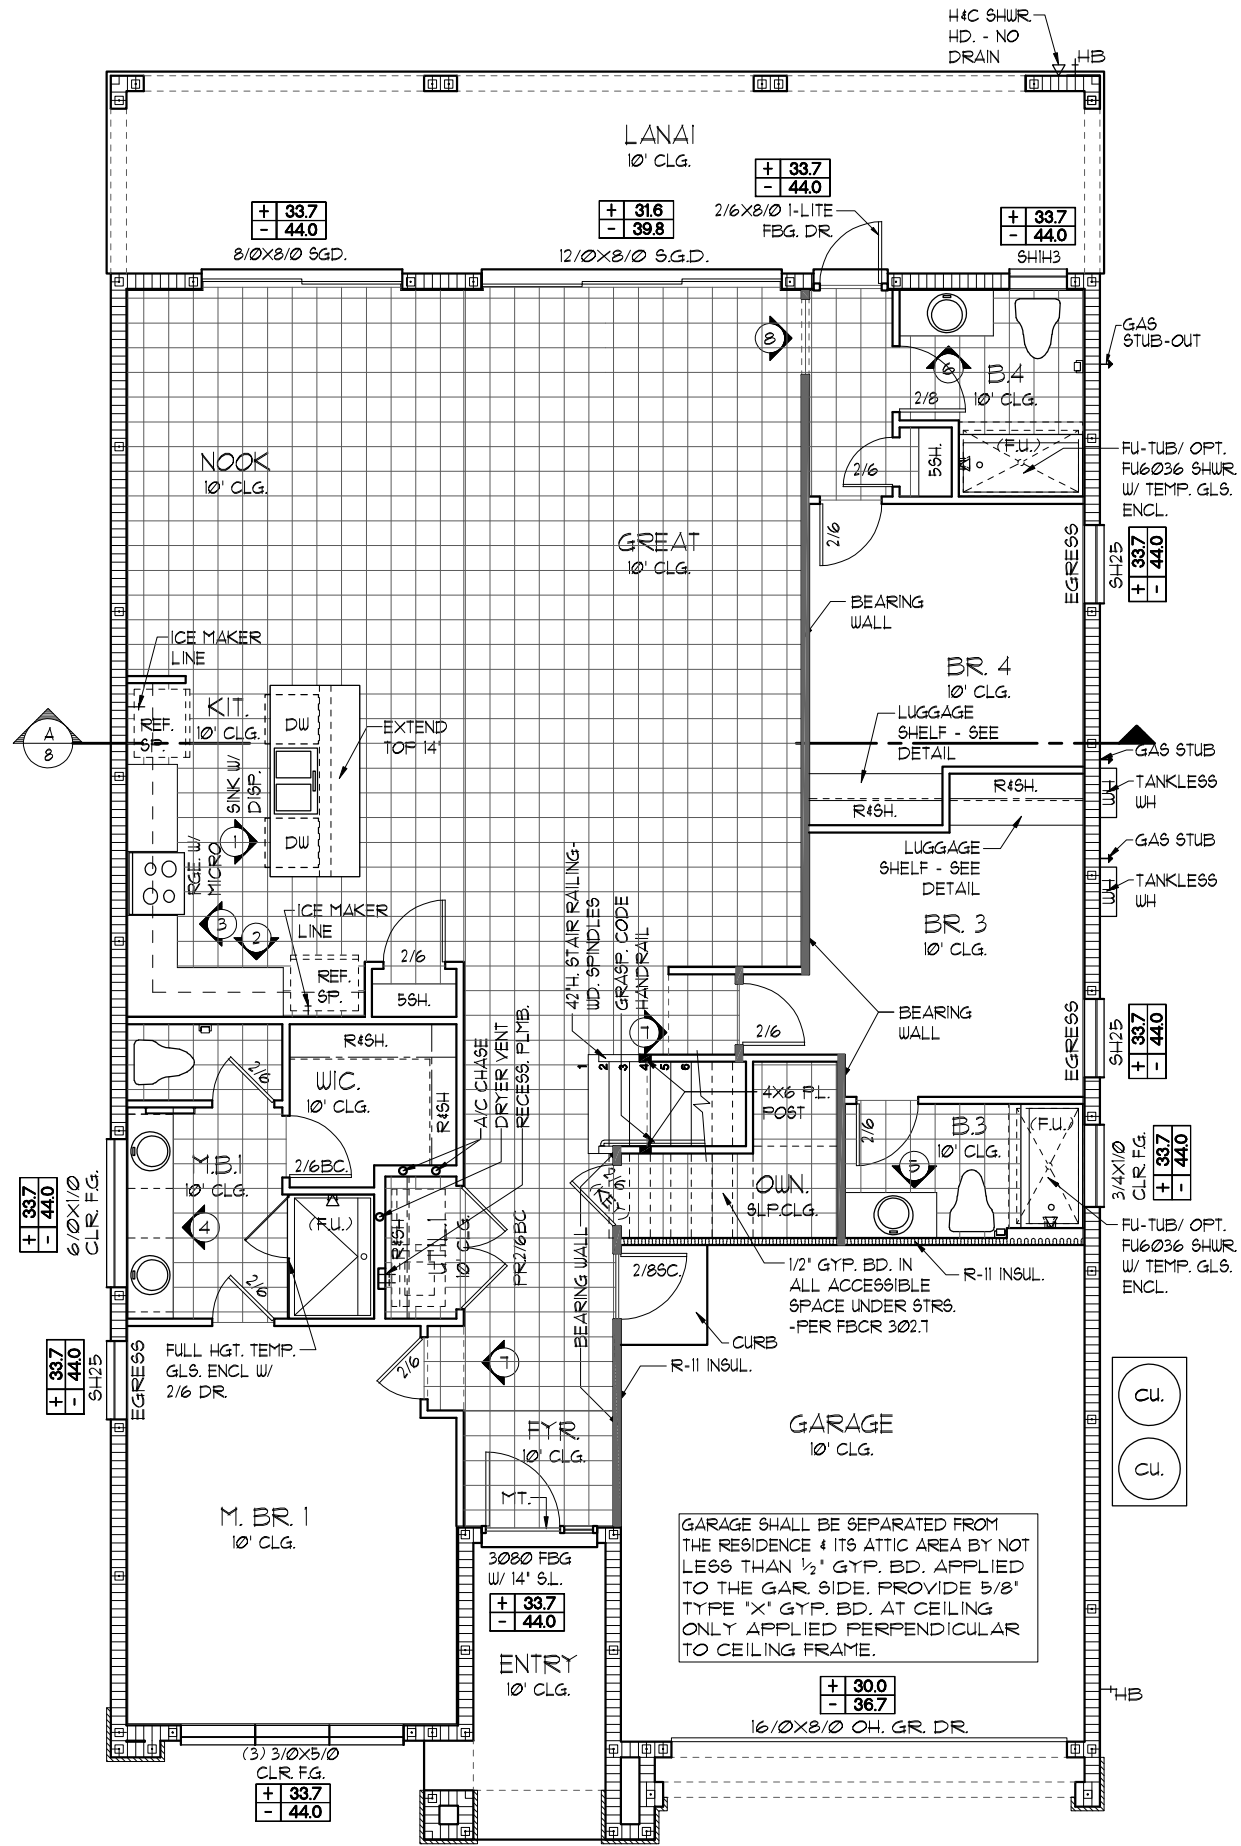

NOTE: ALL INTERIOR DOORS ON THIS FLOOR TO BE: 6'-8" UNO. - VERIFY WITH COLOR SHEET.

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1TH EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

PARADISO GRANDE


© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS		BY
Engineering By: DBE and C		
MICHAEL A. THOMPSON		
PE 47509		
PHONE 407-721-2292		
A DIVISION OF PARK SQUARE ENTERPRISES, INC.		
5200 Vineland Road, Suite 200		
Orlando, Florida 32811		
Phone: (407) 529 - 3000		
FLOOR PLAN W/ NOTES		
REFEED		
PARADISO GRANDE		
4232		
DATE 04-09-21		
SCALE AS NOTED		
DRAWN RDC		
JOB 4232		
SHEET		
03C.0		
OF SHEETS		

- GENERAL NOTES
1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
 2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
 3. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3/2" UNLESS NOTED OTHERWISE.
 4. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1 1/2" UNLESS NOTED OTHERWISE.
 5. ALL INTERIOR CEILINGS AT **9'-0"** UNLESS NOTED OTHERWISE.
 6. MECHANICAL EQUIPMENT LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.

UPPER FLOOR PLAN W/
DIMENSIONS "A"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

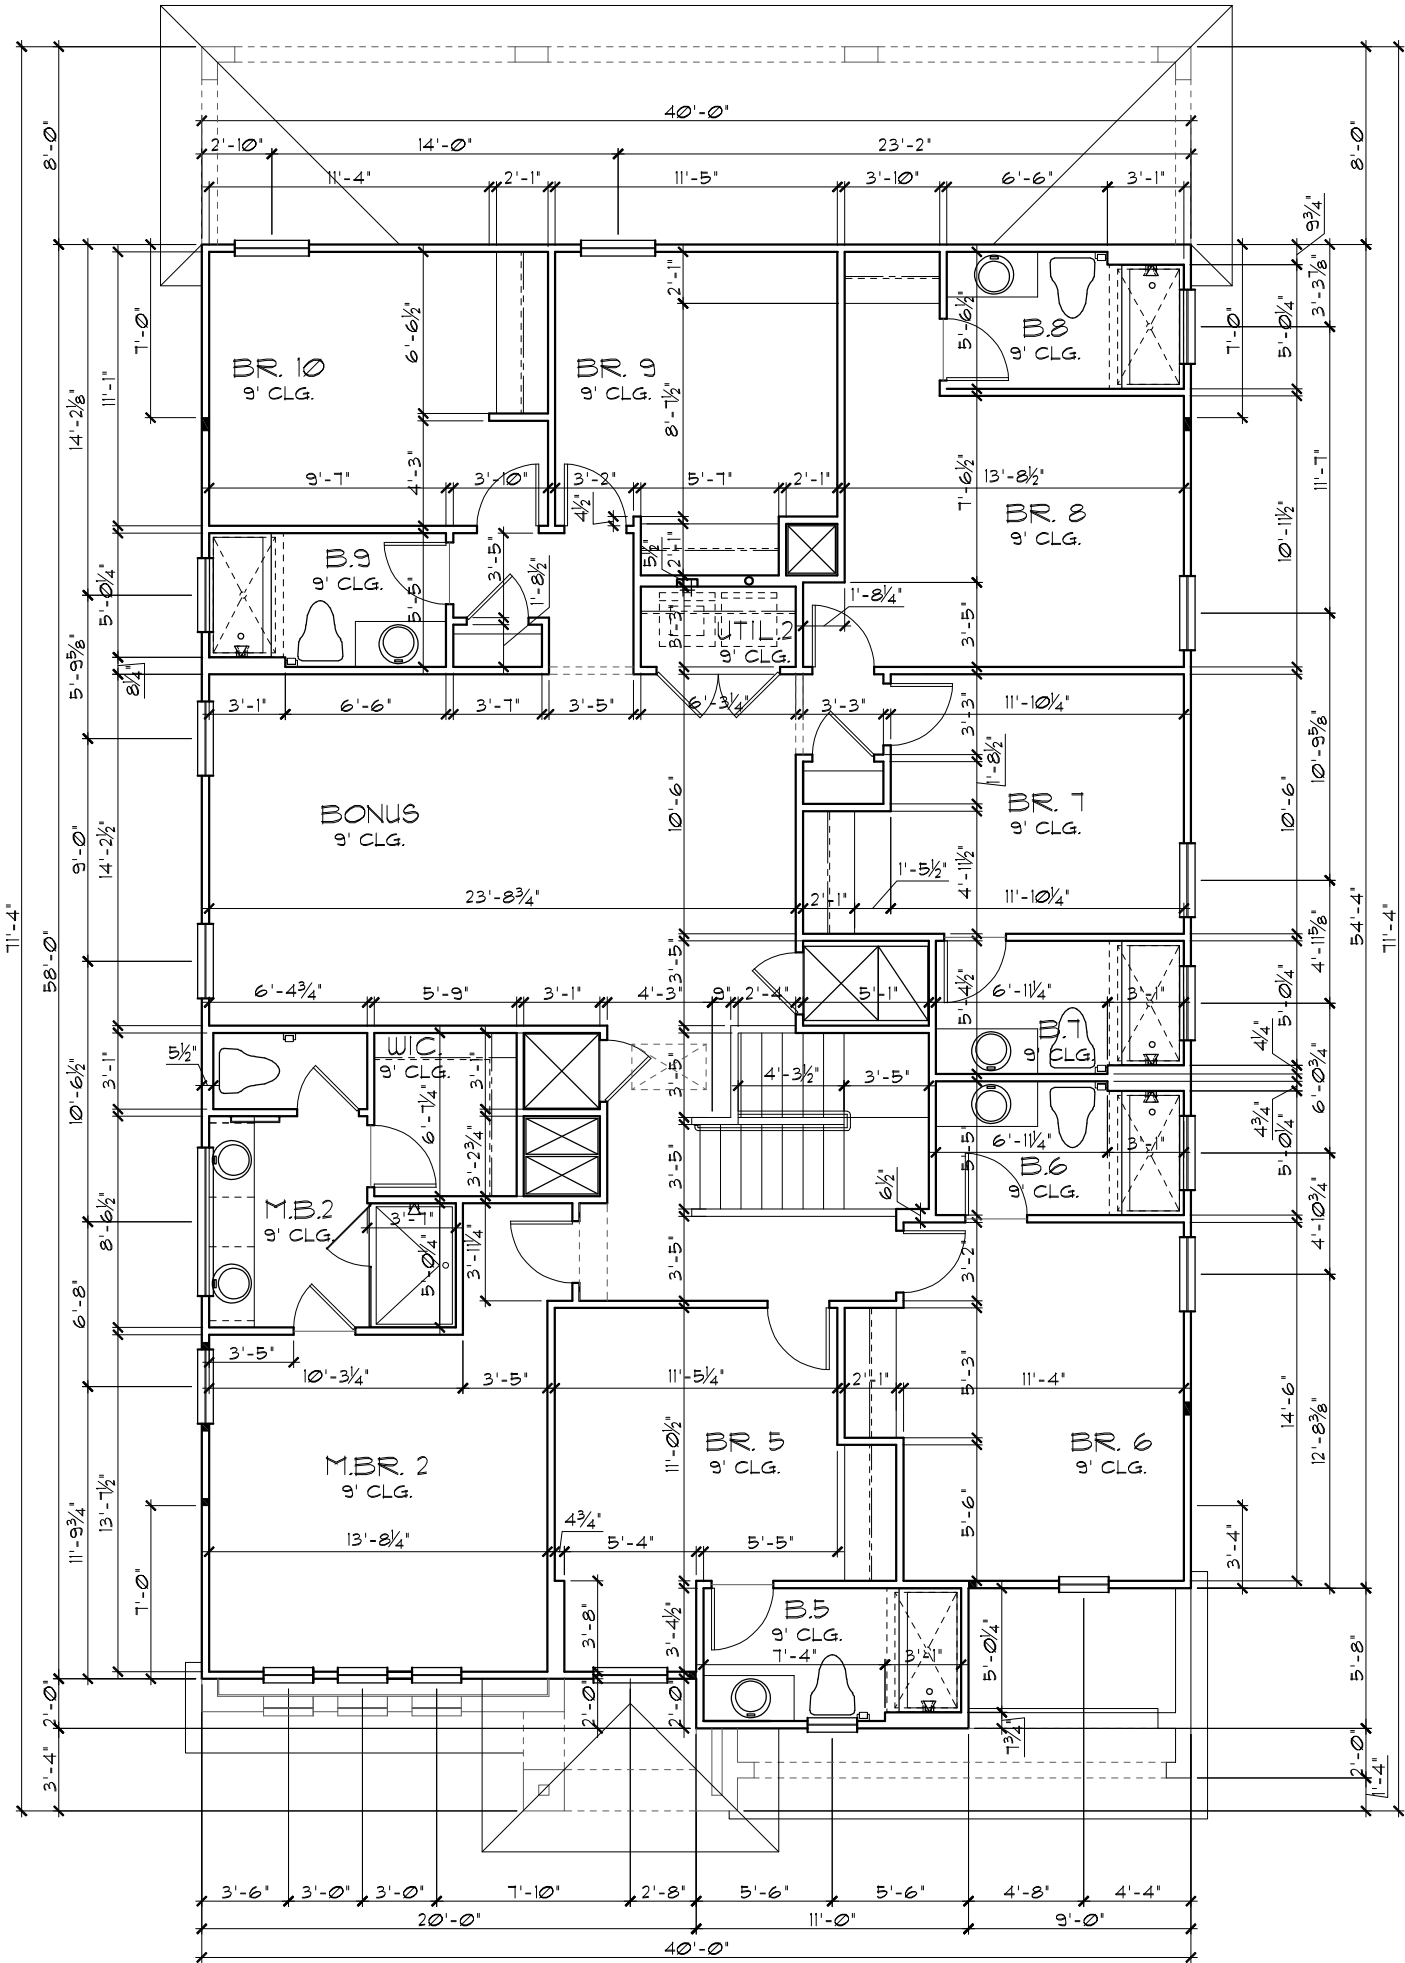

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 11th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE


© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS		BY
Engineering By: DBE and C MICHAEL A. THOMPSON PE 47509 PHONE 407-721-2292		
A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32811 Phone: (407) 529 - 3000		
UPPER FLOOR PLAN W/ DIMENSIONS		
REEF	PARADISO GRANDE	
4232	DATE 04-09-21	
	SCALE AS NOTED	
	DRAWN RDC	
	JOB 4232	
	SHEET	
	04A.0	
	OF SHEETS	

- GENERAL NOTES
1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
 2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
 3. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3½" UNLESS NOTED OTHERWISE.
 4. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1½" UNLESS NOTED OTHERWISE.
 5. ALL INTERIOR CEILINGS AT **9'-0"** UNLESS NOTED OTHERWISE.
 6. MECHANICAL EQUIPMENT LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.

UPPER FLOOR PLAN W/
DIMENSIONS "B"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

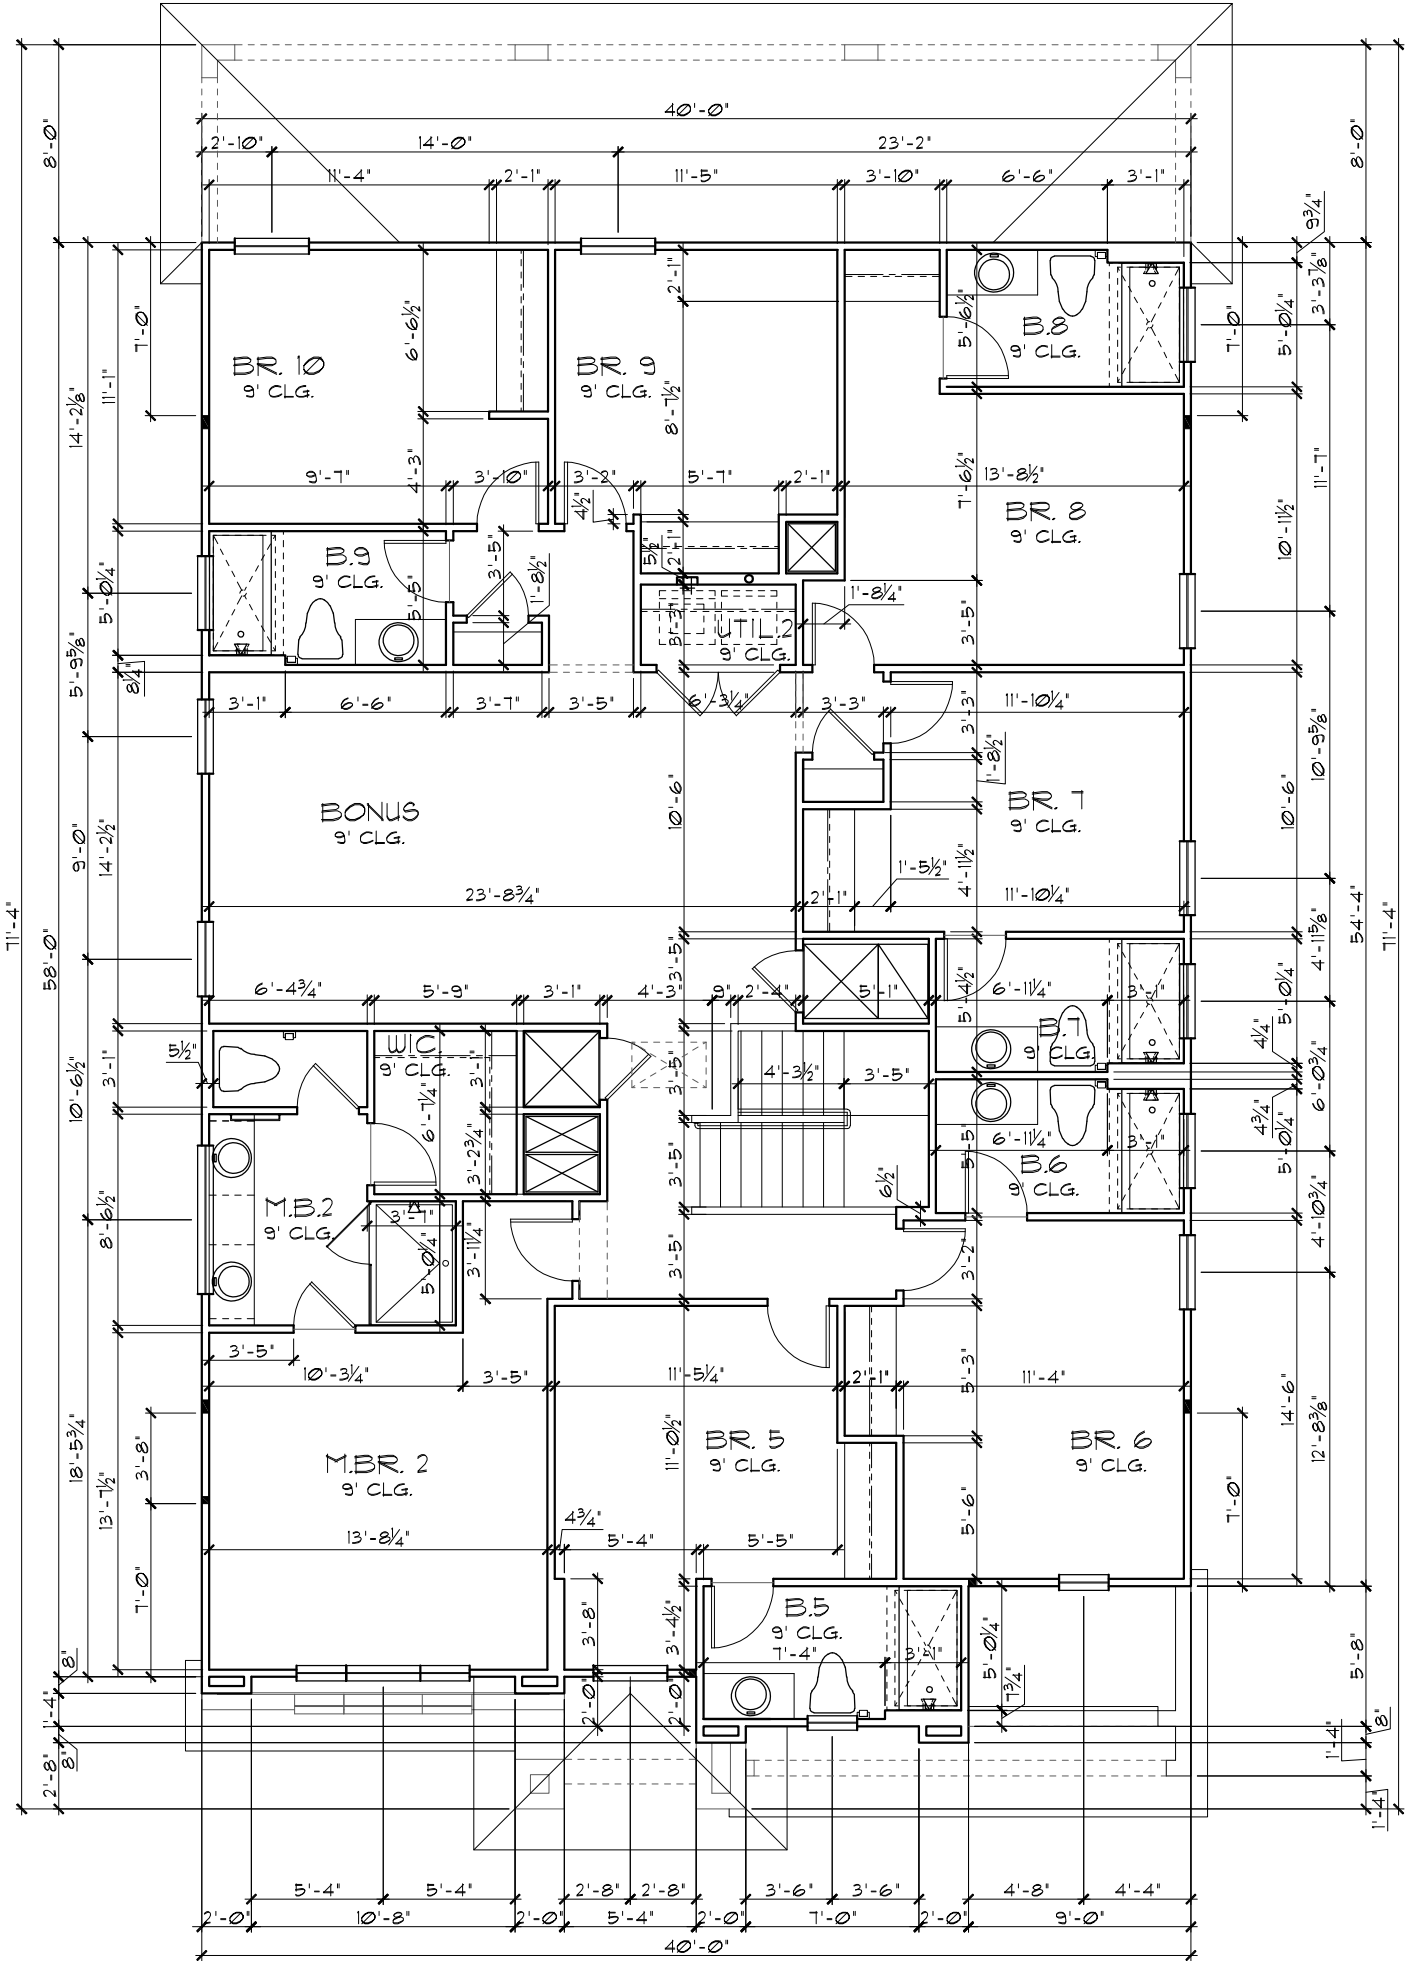

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

PARADISO GRANDE

A DIVISION OF PARK SQUARE ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

Engineering By:
DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

UPPER FLOOR PLAN W/
DIMENSIONS

REEF

PARADISO GRANDE

4232

DATE 04-09-21

SCALE AS NOTED

DRAWN RDC

JOB 4232

SHEET 04B.0

OF 9 SHEETS

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

- GENERAL NOTES
1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.

2. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.

3. ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3½" UNLESS NOTED OTHERWISE.


4. ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1½" UNLESS NOTED OTHERWISE.

5. ALL INTERIOR CEILINGS AT **9'-0"** UNLESS NOTED OTHERWISE.

6. MECHANICAL EQUIPMENT LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.

UPPER FLOOR PLAN W/
DIMENSIONS "C"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

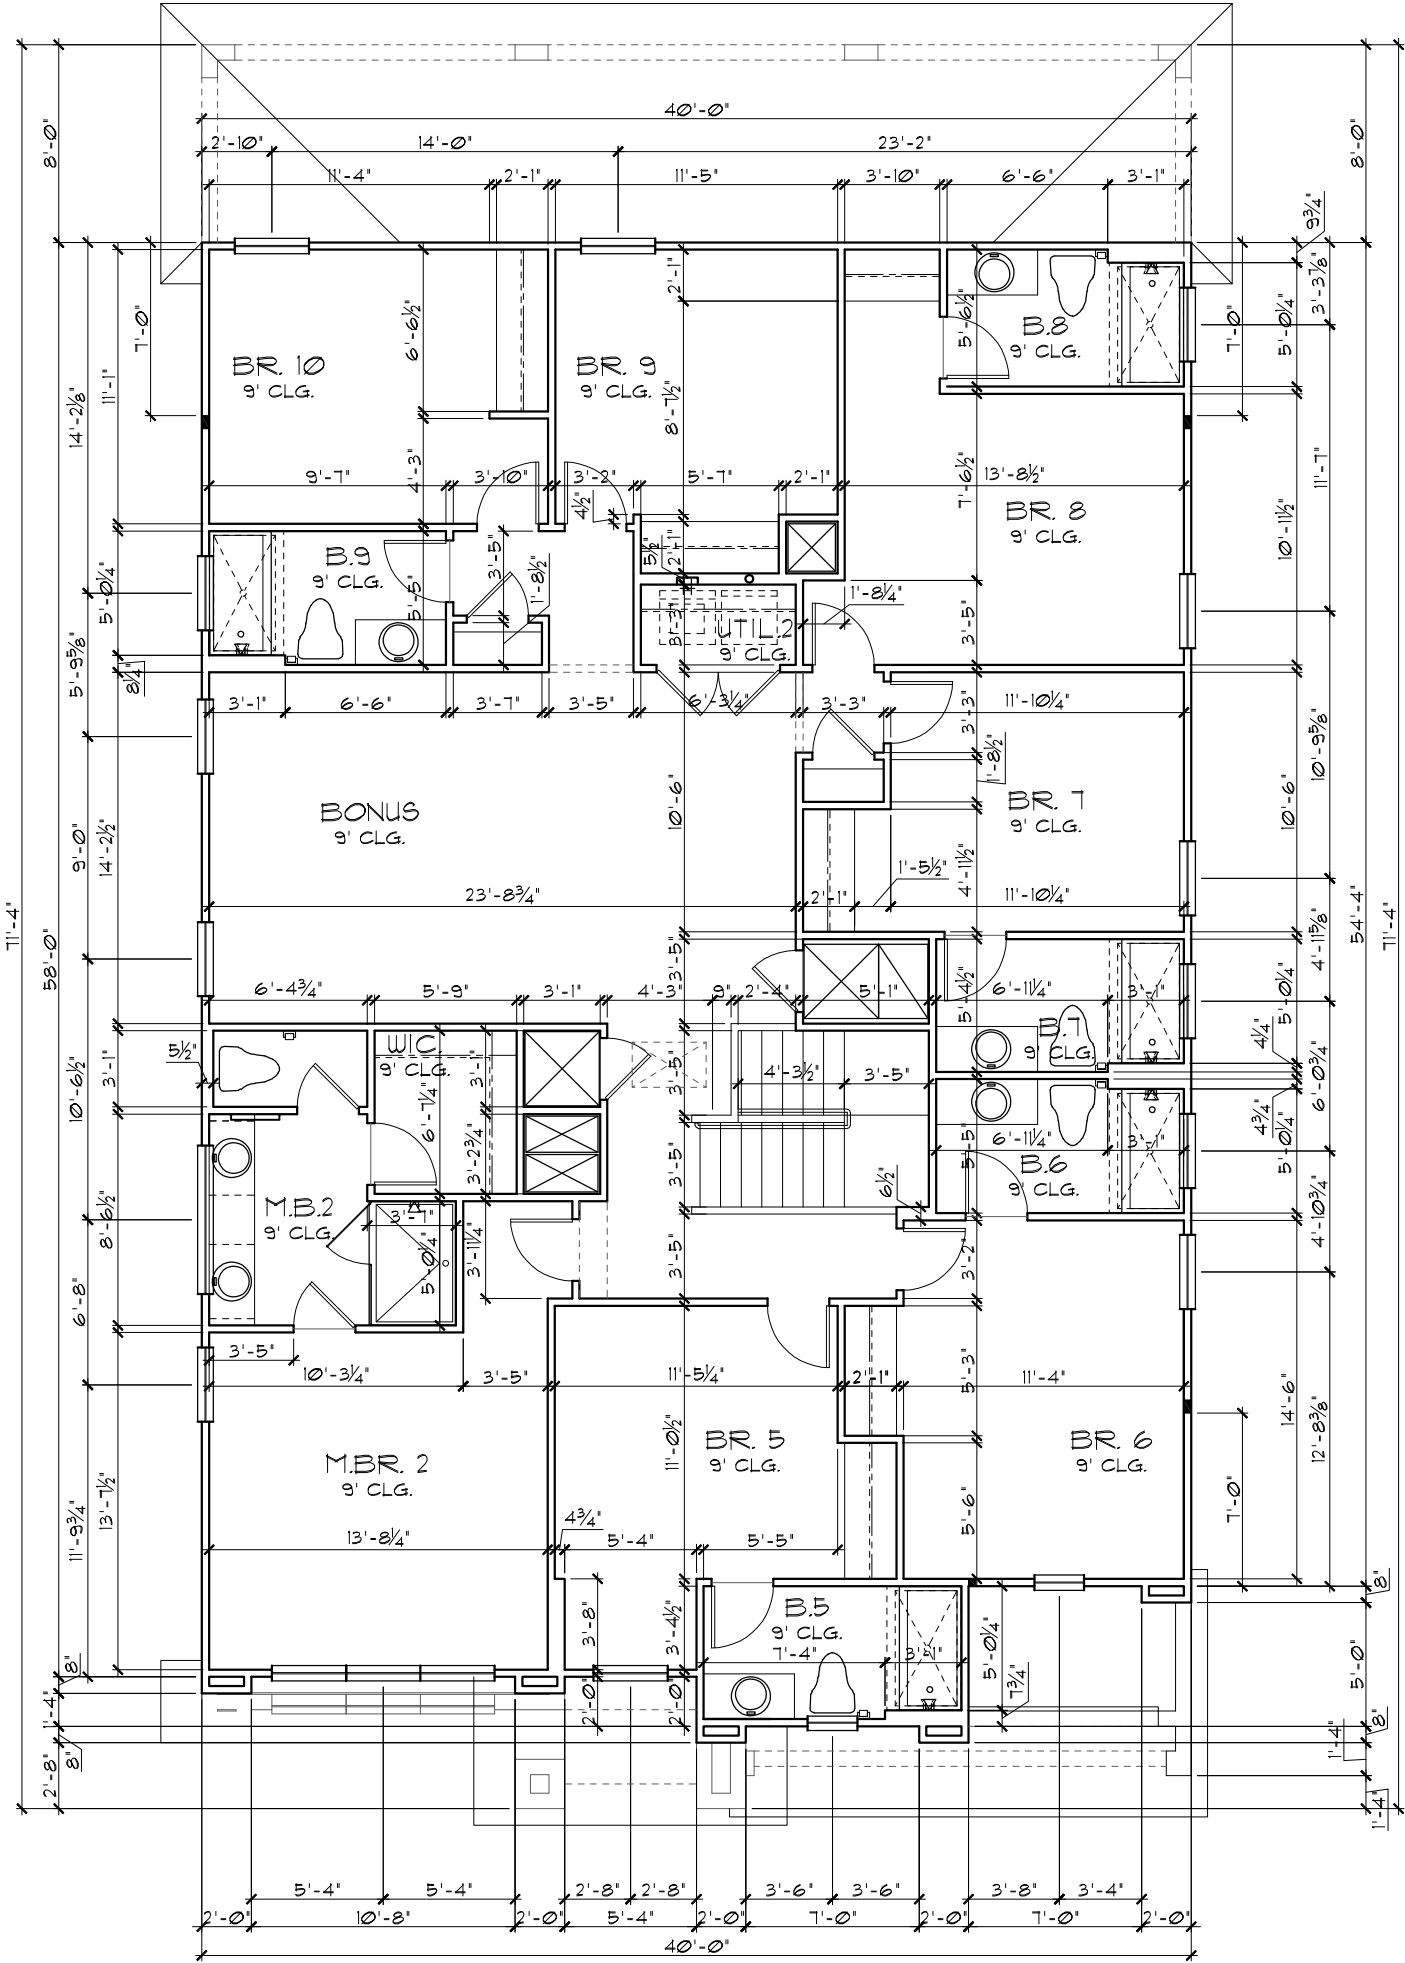

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

UPPER FLOOR PLAN W/
DIMENSIONS

REFEED
PARADISO GRANDE

Engineering By:
DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

A DIVISION OF PARK SQUARE
ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

REVISIONS

BY

4232

DATE 04-09-21

SCALE AS NOTED

DRAWN RDC



JOB 4232

SHEET 04C.0

OF SHEETS

LOAD INFORMATION		
PER 1TH EDITION, 2020 FLORIDA BUILDING RESIDENTIAL CODE		
DEAD LOADS		
FLOOR: STRUCTURE	-----	1 PSF
CEILINGS	-----	3 PSF
MECH/ELEC	-----	5 PSF
PARTITIONS	-----	5 PSF
TOTAL	-----	20 PSF
ROOF: SHEATHING	-----	5 PSF
STRUCTURE	-----	1 PSF
CEILINGS	-----	3 PSF
MECH/ELEC	-----	5 PSF
TOTAL	-----	20 PSF
FLOOR LIVE LOADS		
RESIDENTIAL FLOOR:	-----	40 PSF
UNINHABITABLE ATTIC WITHOUT STORAGE:	-----	10 PSF
UNINHABITABLE ATTIC W/LIMITED STORAGE:	-----	20 PSF
ROOMS OTHER THAN SLEEPING ROOM:	-----	40 PSF
SLEEPING ROOM:	-----	30 PSF
STAIR LIVE LOAD:	-----	40 PSF
BALCONIES:	-----	40 PSF
PASSANGER VEHICLE GARAGE:	-----	50 PSF
ROOF LIVE LOADS		
MINIMUM ROOF LIVE LOAD (PSF) TRIBUTARY LOADED AREA (SQ. FT.) FOR ANY STRUCTURAL MEMBER		
ROOF SLOPE	0-200	201-600
0-12:12	20	16
12:12	16	14
12:12	12	12

WIND INFORMATION		
PER 1TH EDITION, 2020 FLORIDA BUILDING RESIDENTIAL CODE		
1. BASIC WIND SPEED:	-----	140 MPH
2. RISK CATEGORY	-----	II
3. WIND EXPOSURE:	-----	B
4. BUILDING TYPE:	-----	V B
5. ENCLOSURE CLASSIFICATION -- +/- .18, INCLUDED INTERNAL PRESSURE	-----	IN NOTE #6
6. COMPONENT / CLADDING	-----	SEE PLAN DESIGN WIND PRESSURE:
+ XXX DESIGN WIND PRESSURE IAW FLA		
- XXX RESIDENTIAL CODE, SECTION R301		
NOTE: DESIGN PRESSURES BASED ON BASIC WIND SPEED AND NOT ULTIMATE WIND SPEED.		

GENERAL NOTES		
1. PROVIDE RECESS HOT & COLD WATER WITH DRAIN @ WASHER SPACE.		
2. VENT DRYER THRU ROOF.		
3. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.		
4. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.		
5. MECHANICAL EQUIPMENT LOCATION TO BE DETERMINED BY COMMUNITY STANDARDS AND APPLICABLE COUNTY CODES.		
6.  DENOTES CONC. BLOCK WALL HGT. @ N/A		
 DENOTES CONC. BLOCK WALL HGT. @ N/A		
7. REFER TO TYPICAL DETAIL SHEET FOR EXTERIOR WALL FINISH SPECIFICATIONS		
8. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES		
9. ANCHOR THE CONDENSER UNIT TO SLAB PER CODE: M1307.1 - M1307.2		
10. ALL INTER. FIRST FLOOR CEILINGS AT 10'-0" UNLESS NOTED OTHERWISE.		
ALL INTER. SECOND FLOOR CEILINGS AT 9'-0" UNLESS NOTED OTHERWISE.		

NOTE: 1. DOOR FROM HOUSE TO GARAGE MUST BE SOLID WOOD DOOR NO LESS THEN 1 3/8" IN THICKNESS, SOLID OR HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1 3/8" THICK, OR 20MIN. FIRE RATED IAW R302.5		
EGRESS WINDOW SCHEDULE - R310.2.1- FBCR2020		
SH3050	33 1/2" H. X 30" W.	MIN. NET CLEAR OPENING 5.7 SQFT
SH3050	60 1/8" H. X 35 3/4" W. R.O.	

NOTE:	
•	ALL EMERGENCY ESCAPE WINDOW SILLS TO BE NOT MORE THAN 44" MIN. A.F.F. - R310.2 - FBCR (2020)
•	WINDOWS SILLS LOCATED LESS THAN 24" ABOVE FINISH FLOOR AND GREATER THAN 12" FINISHED GRADE MUST COMPLY WITH FBCR 312.2


PER FBC R301- TABLE R301.5	
GUARDRAILS & HANDRAILS	200 PSF
GUARDRAIL IN - FILL COMPONENTS	50 PSF
STAIRS	40 PSF

NOTE: TEMPERED GLAZING IS REQUIRED AT ALL HAZARDOUS LOCATIONS AS DEFINED IN FBC R308.4	
--	--

PER FBC R301- TABLE R301.5	
GUARDRAILS & HANDRAILS	200 PSF
GUARDRAIL IN - FILL COMPONENTS	50 PSF
PER FBC R312- R312.12 & R312.13 & R311.1.8.1	
GUARDRAILS HEIGHT	36" MIN.
HANDRAIL HEIGHT	34" MIN. TO 38" MAX.
GUARDRAIL OPENING LIMITATIONS	4" IN DIAMETER MAX.

NOTE: HANDRAIL CONTINUITY PER R311.1.8.2 - HANDRAILS FOR STAIRS SHALL BE CONTINUOUS FOR FULL LENGTH OF THE FLIGHT, FROM A POINT DIRECTLY ABOVE THE TOP RISER OF THE FLIGHT TO A POINT DIRECTLY ABOVE THE LOWEST RISER OF THE FLIGHT. HANDRAIL ENDS SHALL BE RETURNED OR SHALL TERMINATE IN NEUEL POST OR SAFETY TERMINALS. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE OF NO LESS THAN 1 1/2" (38MM) BETWEEN THE WALL AND THE HANDRAIL.	
---	--

UPPER FLOOR PLAN NOTES "A"		
1/8"=1'-0" (11X17)	1/4"=1'-0" (22X34)	

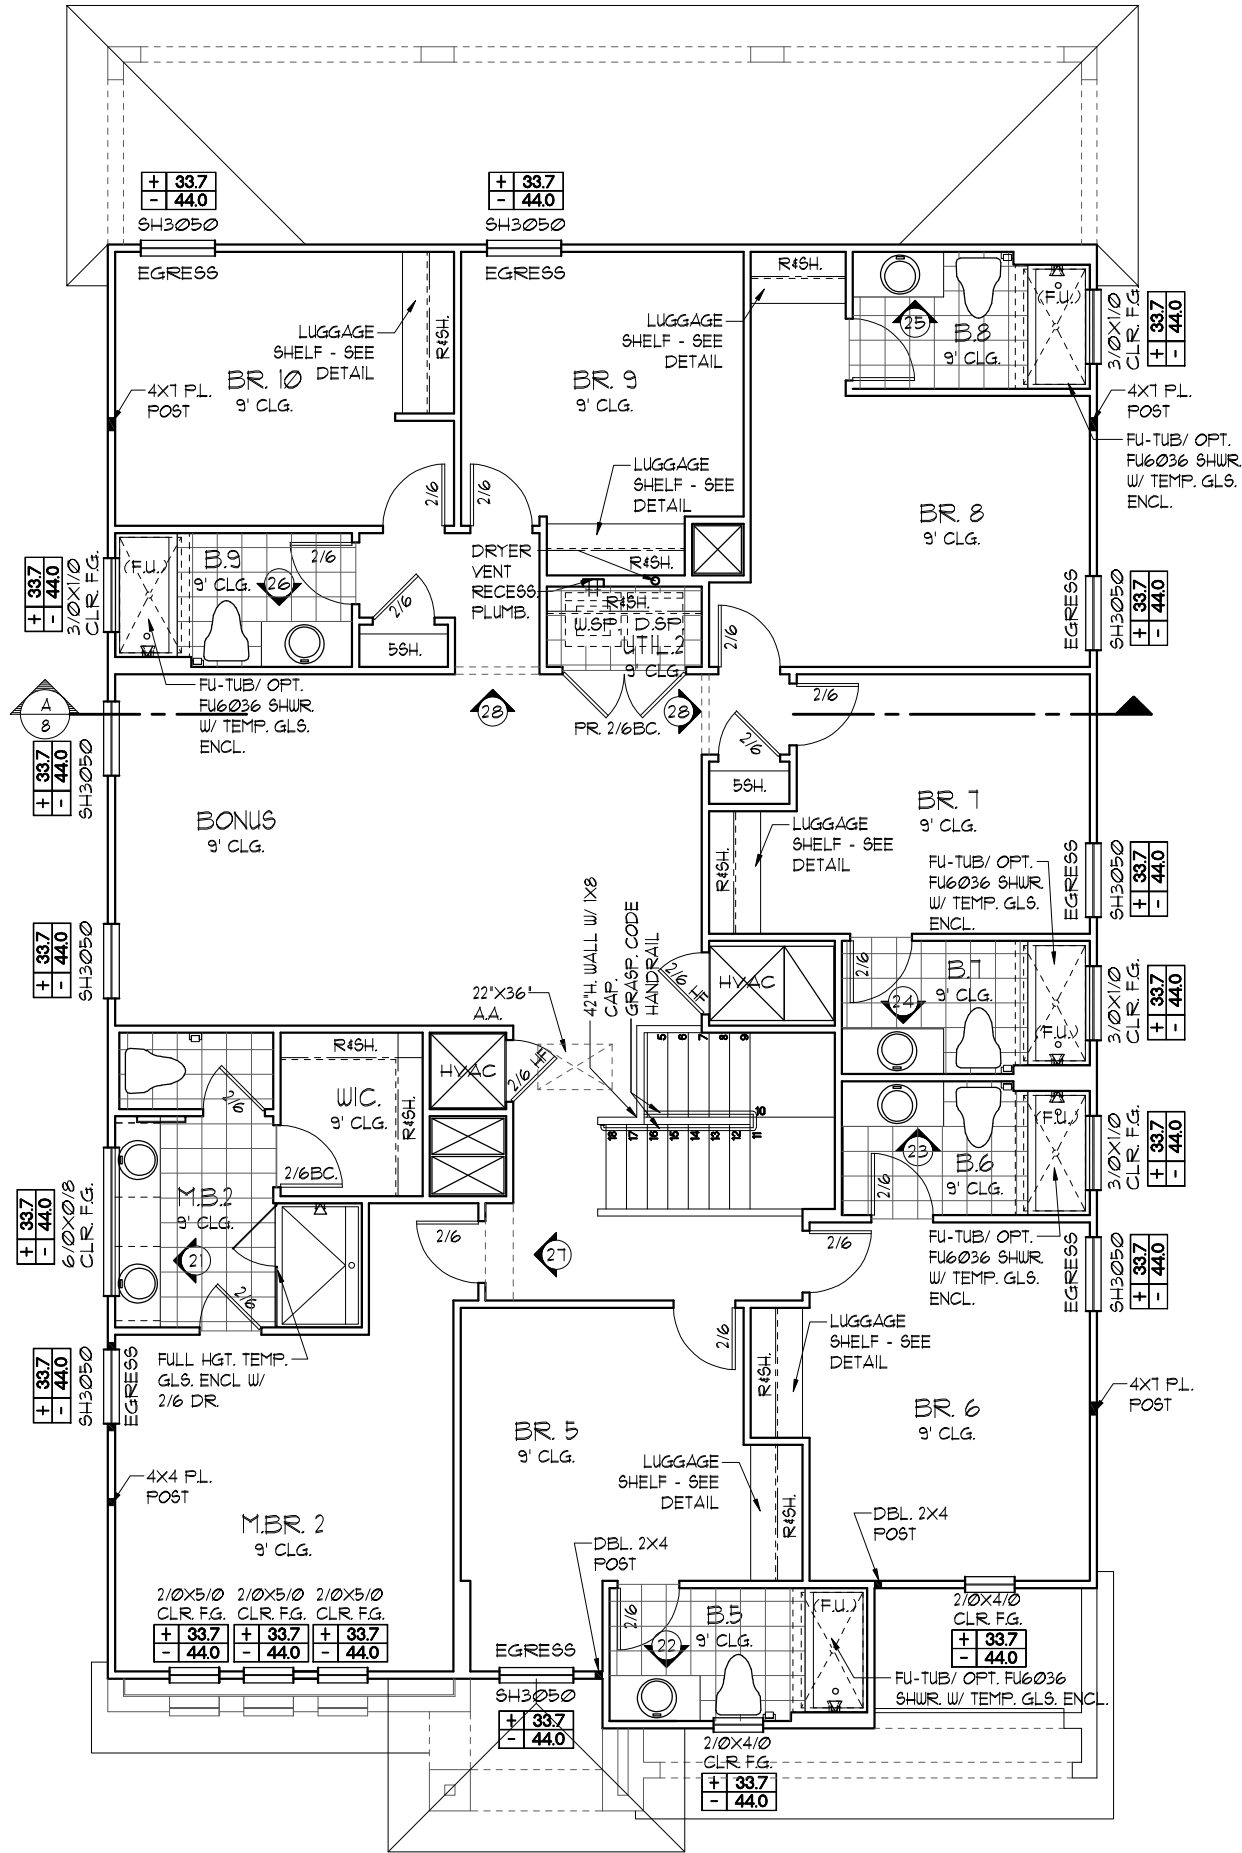

NOTE: ALL INTERIOR DOORS ON THIS FLOOR TO BE: 6'-8" U.N.O. - VERIFY WITH COLOR SHEET.

LOT: 0000, PARADISO GRANDE

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1TH EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

PARADISO GRANDE

FLOOR PLAN W/ NOTES

REEF

PARADISO GRANDE

4232

DATE 04-09-21

SCALE AS NOTED

DRAWN RDC

JOB 4232

SHEET 05A.0

OF SHEETS

Engineering By: DBE and C MICHAEL A. THOMPSON PE 47509 PHONE 407-721-2292



A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32811 Phone: (407) 529 - 3000

REVISIONS

BY

LOAD INFORMATION		
PER 1TH EDITION, 2020 FLORIDA BUILDING RESIDENTIAL CODE		
DEAD LOADS		
FLOOR: STRUCTURE	-----	1 PSF
CEILINGS	-----	3 PSF
MECH/ELEC	-----	5 PSF
PARTITIONS	-----	5 PSF
TOTAL	-----	20 PSF
ROOF: SHEATHING	-----	5 PSF
STRUCTURE	-----	1 PSF
CEILINGS	-----	3 PSF
MECH/ELEC	-----	5 PSF
TOTAL	-----	20 PSF
FLOOR LIVE LOADS		
RESIDENTIAL FLOOR:	-----	40 PSF
UNINHABITABLE ATTIC WITHOUT STORAGE:	-----	10 PSF
UNINHABITABLE ATTIC W/LIMITED STORAGE:	-----	20 PSF
ROOMS OTHER THAN SLEEPING ROOM:	-----	40 PSF
SLEEPING ROOM:	-----	30 PSF
STAIR LIVE LOAD:	-----	40 PSF
BALCONIES:	-----	40 PSF
PASSANGER VEHICLE GARAGE:	-----	50 PSF
ROOF LIVE LOADS		
MINIMUM ROOF LIVE LOAD (PSF) TRIBUTARY LOADED AREA (SQ. FT.) FOR ANY STRUCTURAL MEMBER		
ROOF SLOPE	0-200	201-600
0:12 < 4:12	20	16
≥ 4:12 < 12:12	16	14
≥ 12:12	12	12

WIND INFORMATION		
PER 1TH EDITION, 2020 FLORIDA BUILDING RESIDENTIAL CODE		
1. BASIC WIND SPEED:	-----	140 MPH
2. RISK CATEGORY	-----	II
3. WIND EXPOSURE:	-----	B
4. BUILDING TYPE:	-----	V B
5. ENCLOSURE CLASSIFICATION -- +/- .18, INCLUDED INTERNAL PRESSURE	-----	IN NOTE #6
6. COMPONENT / CLADDING-----	SEE PLAN DESIGN WIND PRESSURE:	
+ XXX DESIGN WIND PRESSURE IAW FLA		
- XXX RESIDENTIAL CODE, SECTION R301		
NOTE: DESIGN PRESSURES BASED ON BASIC WIND SPEED AND NOT ULTIMATE WIND SPEED.		

GENERAL NOTES		
1. PROVIDE RECESS HOT & COLD WATER WITH DRAIN @ WASHER SPACE.		
2. VENT DRYER THRU ROOF.		
3. PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.		
4. DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.		
5. MECHANICAL EQUIPMENT LOCATION TO BE DETERMINED BY COMMUNITY STANDARDS AND APPLICABLE COUNTY CODES.		
6.  DENOTES CONC. BLOCK WALL HGT. @ N/A		
 DENOTES CONC. BLOCK WALL HGT. @ N/A		
7. REFER TO TYPICAL DETAIL SHEET FOR EXTERIOR WALL FINISH SPECIFICATIONS		
8. REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES		
9. ANCHOR THE CONDENSER UNIT TO SLAB PER CODE: M 1307.1 - M1307.2		
10. ALL INTER. FIRST FLOOR CEILINGS AT 10'-0" UNLESS NOTED OTHERWISE.		
ALL INTER. SECOND FLOOR CEILINGS AT 9'-0" UNLESS NOTED OTHERWISE.		

NOTE: 1. DOOR FROM HOUSE TO GARAGE MUST BE SOLID WOOD DOOR NO LESS THEN 1 3/8" IN THICKNESS, SOLID OR HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1 3/8" THICK, OR 20MIN. FIRE RATED IAW R302.5		
EGRESS WINDOW SCHEDULE - R310.2.1- FBCR2020		
SH3050	33 1/2" H. X 30" W.	MIN. NET CLEAR OPENING 5.7 SQFT
SH3050	60 1/8" H. X 35 3/4" W. R.O.	

NOTE:	
• ALL EMERGENCY ESCAPE WINDOW SILLS TO BE NOT MORE THAN 44"MIN. AFF.-	
R310.2 - FBCR (2020)	
• WINDOWS SILLS LOCATED LESS THAN 24" ABOVE FINISH FLOOR AND GREATER THAN 12" FINISHED GRADE MUST COMPLY WITH FBCR 312.2	


PER FBC R301- TABLE R301.5	
GUARDRAILS & HANDRAILS	200 PSF
GUARDRAIL IN - FILL COMPONENTS	50 PSF
STAIRS	40 PSF

NOTE: TEMPERED GLAZING IS REQUIRED AT ALL HAZARDOUS LOCATIONS AS DEFINED IN FBC R308.4	
--	--

PER FBC R301- TABLE R301.5	
GUARDRAILS & HANDRAILS	200 PSF
GUARDRAIL IN - FILL COMPONENTS	50 PSF
PER FBC R312- R312.12 & R312.13 & R311.1.8.1	
GUARDRAILS HEIGHT	36" MIN.
HANDRAIL HEIGHT	34" MIN. TO 38" MAX.
GUARDRAIL OPENING LIMITATIONS	4" IN DIAMETER MAX.

NOTE: HANDRAIL CONTINUITY PER R311.1.8.2- HANDRAILS FOR STAIRS SHALL BE CONTINUOUS FOR FULL LENGTH OF THE FLIGHT, FROM A POINT DIRECTLY ABOVE THE TOP RISER OF THE FLIGHT TO A POINT DIRECTLY ABOVE THE LOWEST RISER OF THE FLIGHT. HANDRAIL ENDS SHALL BE RETURNED OR SHALL TERMINATE IN NEEL POST OR SAFETY TERMINALS. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE OF NO LESS THAN 1 1/2" (38MM) BETWEEN THE WALL AND THE HANDRAIL.	
---	--

UPPER FLOOR PLAN NOTES "B"		
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)		

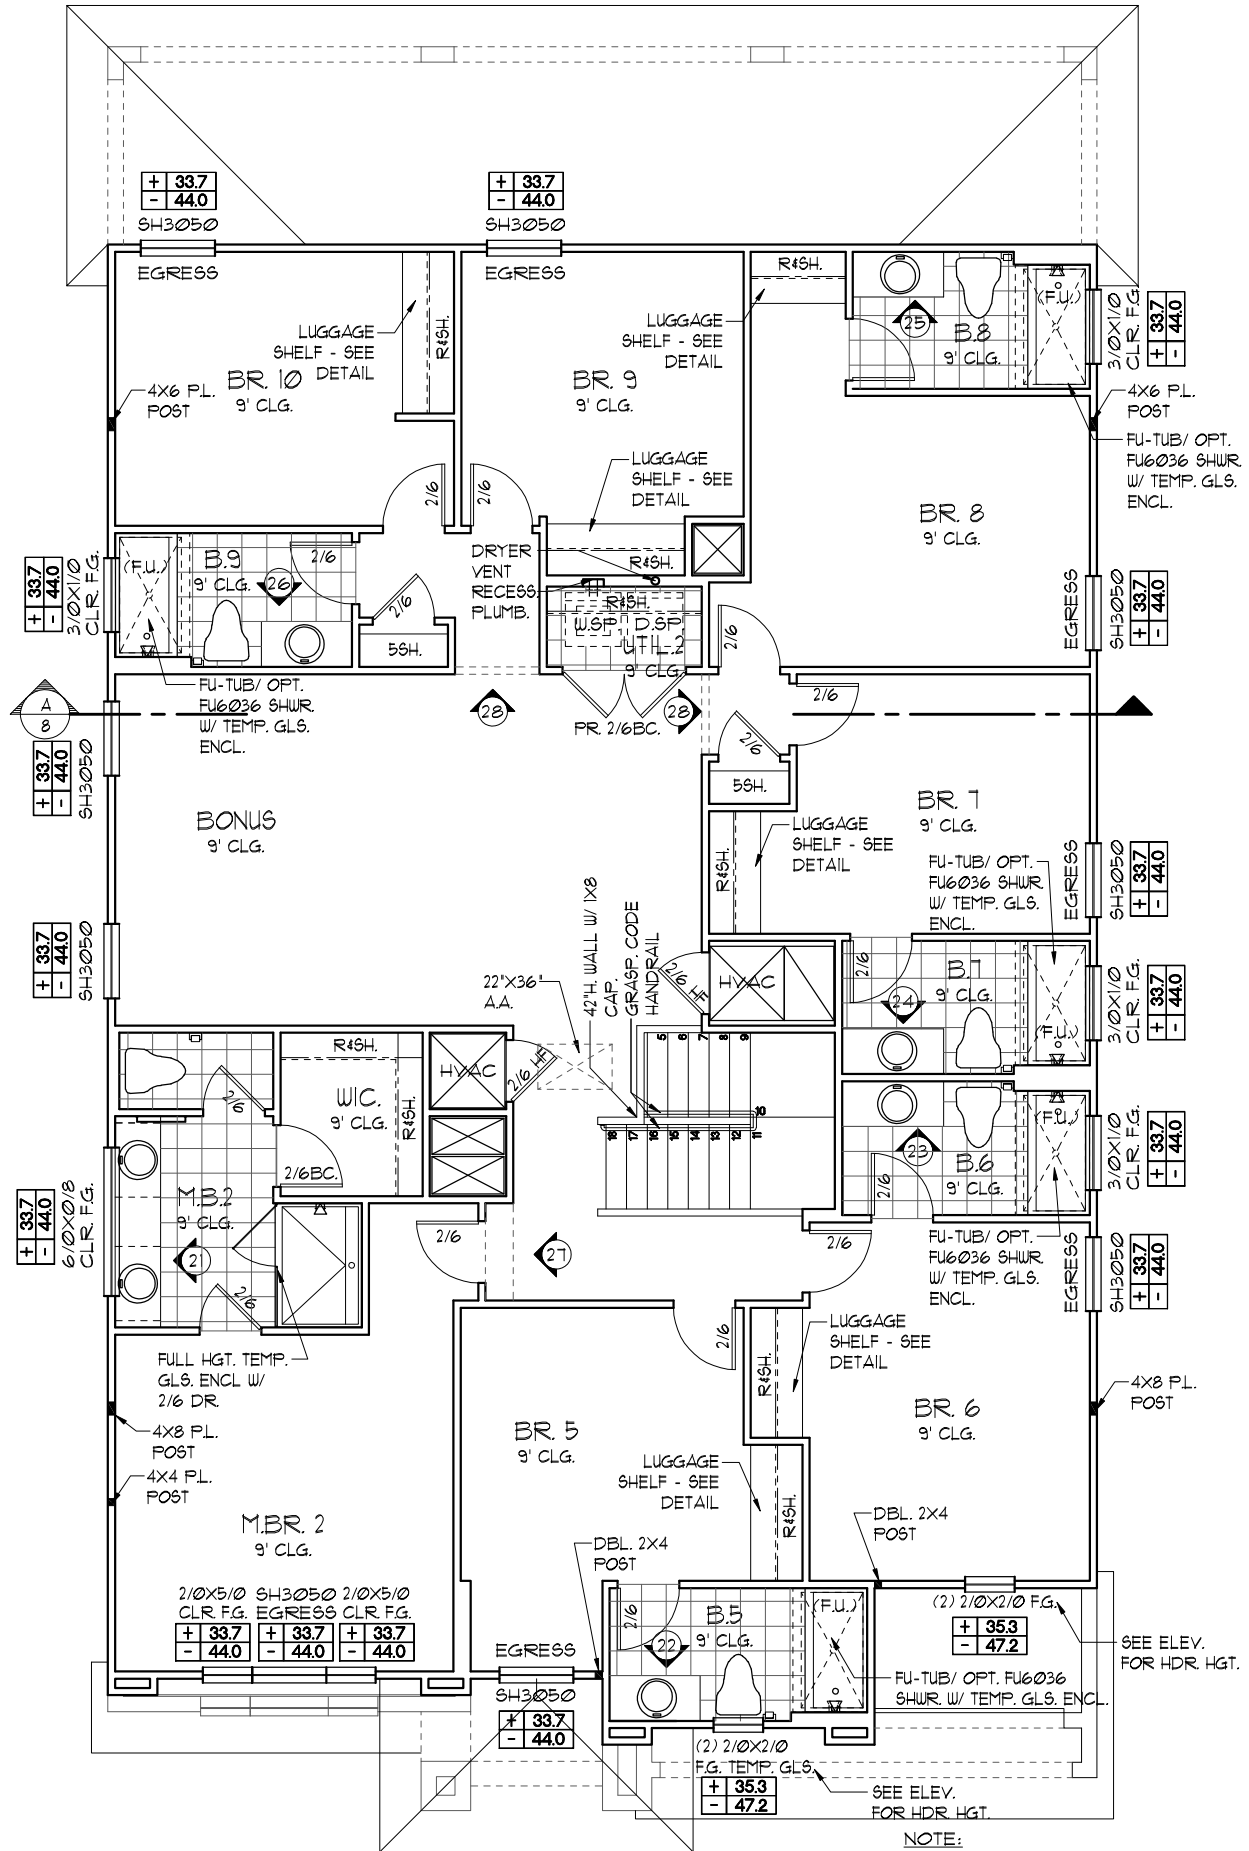

NOTE: ALL INTERIOR DOORS ON THIS FLOOR TO BE: 6'-8" U.N.O. - VERIFY WITH COLOR SHEET.	
---	--

LOT: 0000, PARADISO GRANDE

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1TH EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

PARADISO GRANDE

FLOOR PLAN W/ NOTES

REFEED

PARADISO GRANDE

Engineering By: DBE and C MICHAEL A. THOMPSON PE 47509 PHONE 407-721-2292

A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32811 Phone: (407) 529 - 3000

Park Square HOMES

REVISIONS

BY

DATE

SCALE AS NOTED

DRAWN RDC

JOB 4232

SHEET 05B.0

OF SHEETS

4232

DATE 04-09-21



SCALE AS NOTED

DRAWN RDC



JOB 4232

SHEET 05B.0

OF SHEETS

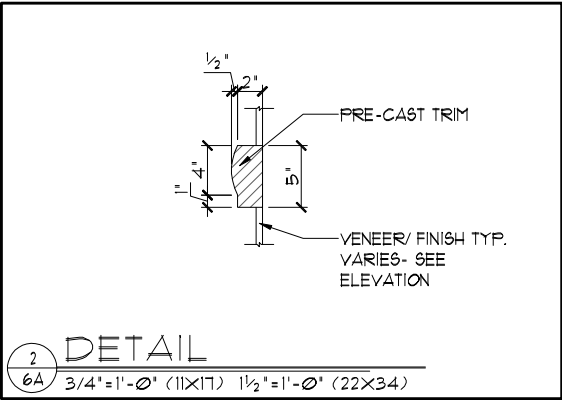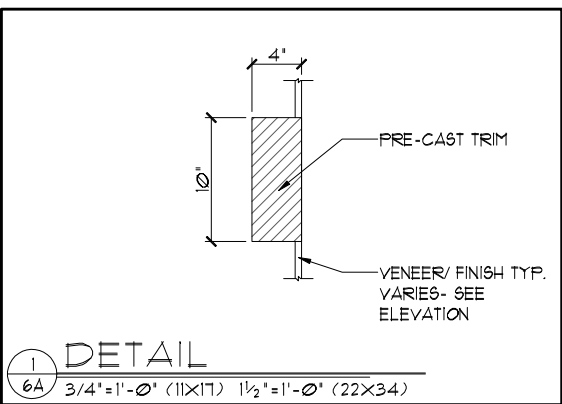

- EXTERIOR FINISH NOTES**
1. LATH TO BE ATTACHED IAW R103.1.1 OF THE 11TH EDITION, FBCR 2020
 2. PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 11TH EDITION, FBCR 2020
 3. WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 11TH EDITION, FBCR 2020
 4. WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 11TH EDITION, FBCR 2020
 5. 'ZIP SYSTEMS' WALL AND ROOF SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL AND ROOF SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS AND ROOF.

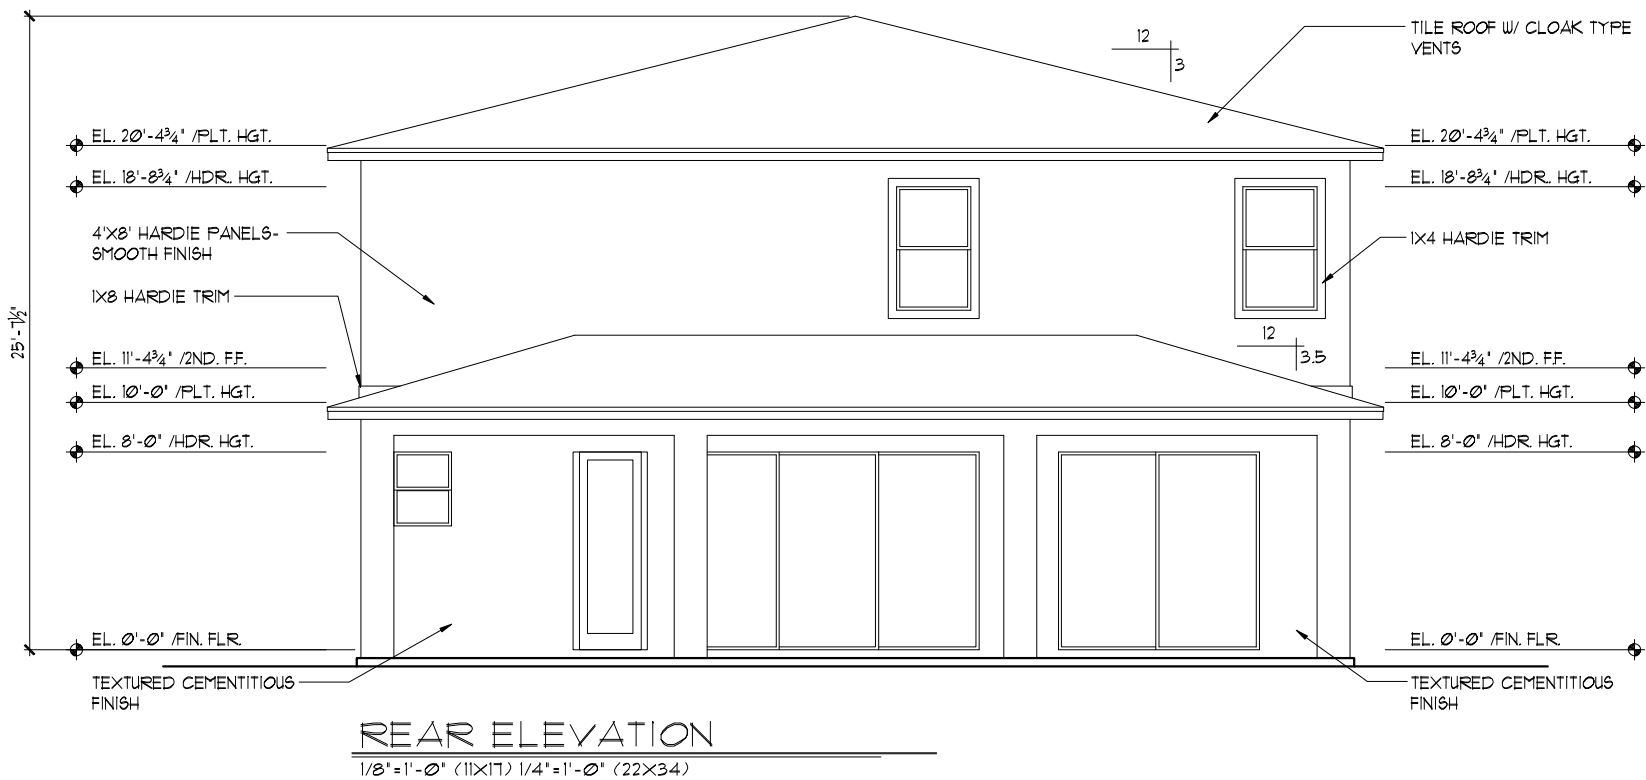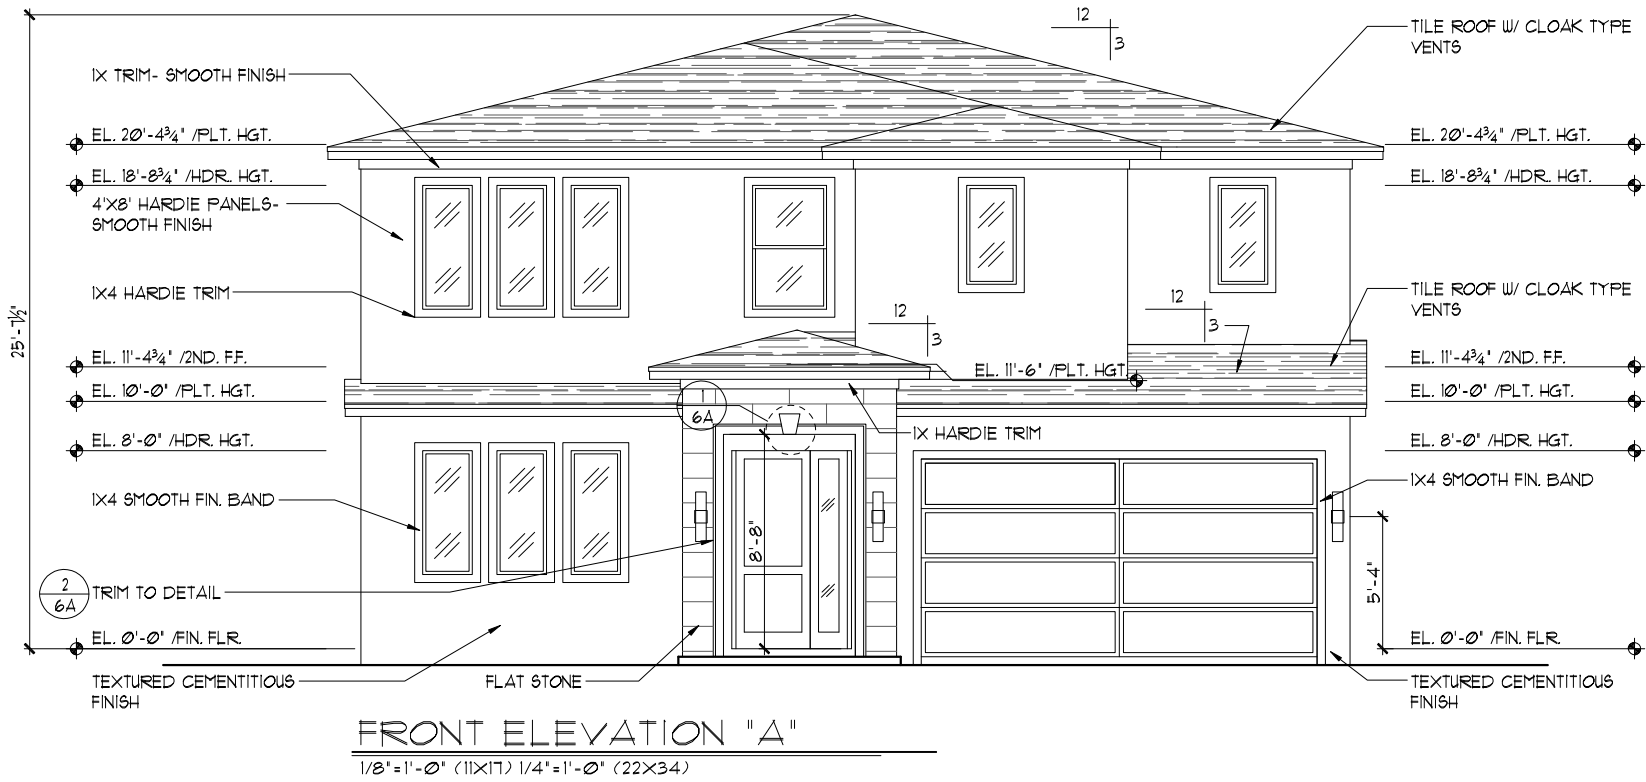

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 11th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH


LOT: 0000, PARADISO GRANDE

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS		BY
Engineering By: DBE and C MICHAEL A. THOMPSON PE 47509 PHONE 407-721-2292		
A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32811 Phone: (407) 529 - 3000		
Park Square HOMES		
EXTERIOR ELEVATION "A"		
FRONT AND REAR		
REEF		
PARADISO GRANDE		
4232		
DATE	04-09-21	
SCALE	AS NOTED	
DRAWN	RDC	
JOB	4232	
SHEET	06A.0	
OF	SHEETS	


EXTERIOR FINISH NOTES

- LATH TO BE ATTACHED IAW R103.1.1 OF THE 11TH EDITION, FBCR 2020
- PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 11TH EDITION, FBCR 2020
- WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 11TH EDITION, FBCR 2020
- WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 11TH EDITION, FBCR 2020
- 'ZIP SYSTEMS' WALL AND ROOF SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL AND ROOF SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS AND ROOF.

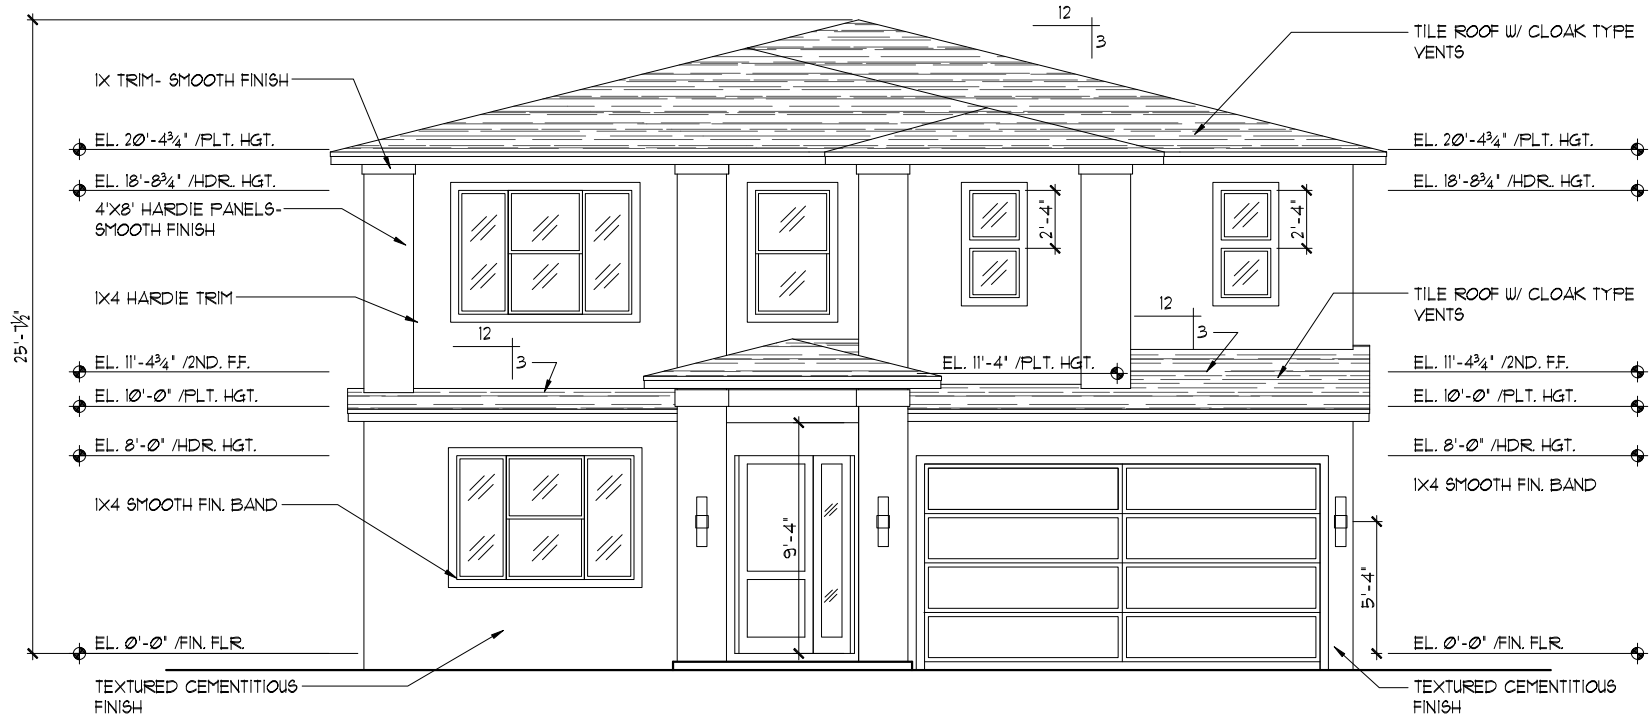

FRONT ELEVATION "B"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

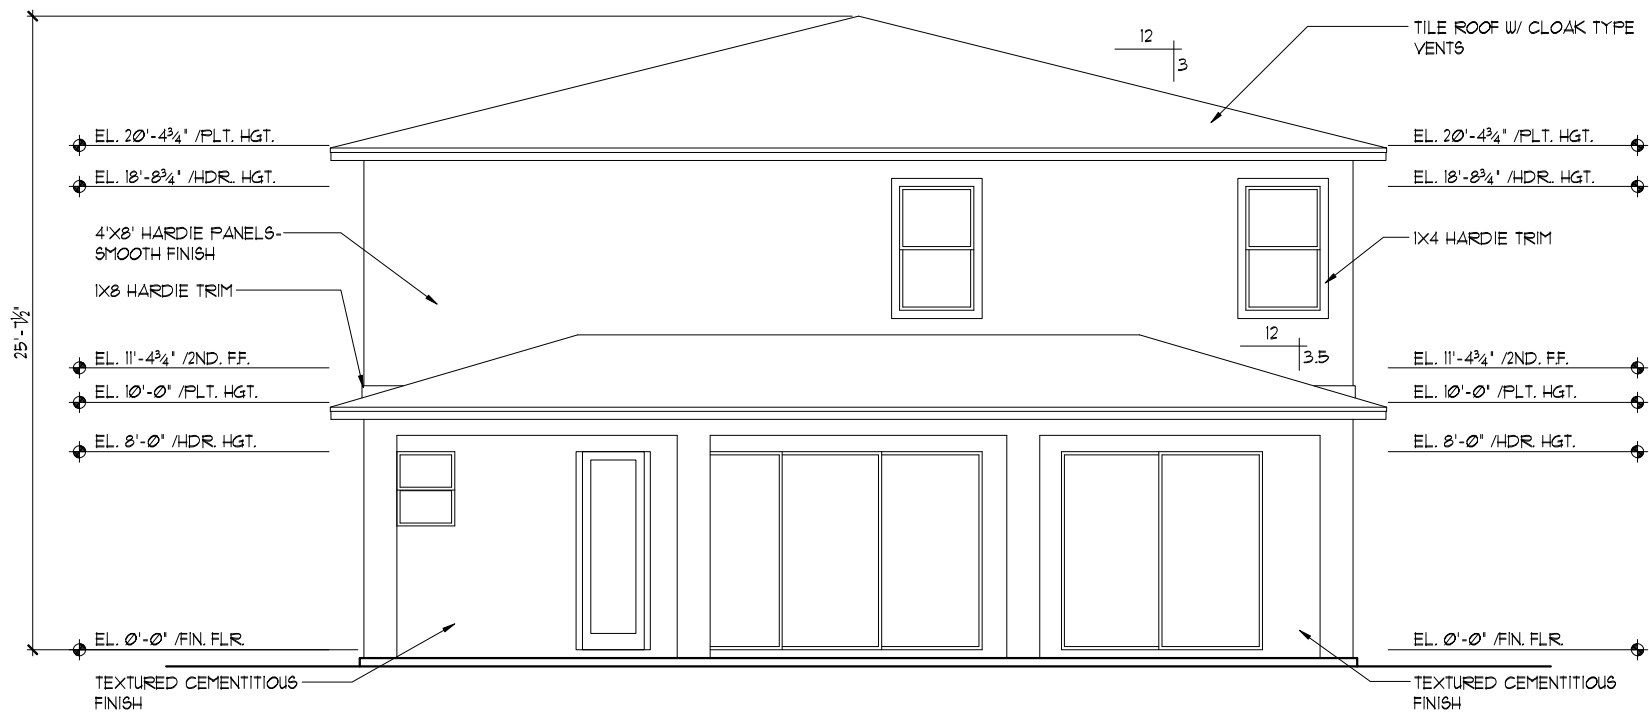

REAR ELEVATION

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 11TH EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH



LOT: 0000, PARADISO GRANDE

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS		BY
Engineering By: DBE and C MICHAEL A. THOMPSON PE 47509 PHONE 407-721-2292		
A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32811 Phone: (407) 529 - 3000		
EXTERIOR ELEVATION "B" FRONT AND REAR		
REEF		PARADISO GRANDE
4232		
DATE 04-09-21		
SCALE AS NOTED		
DRAWN RDC		
JOB 4232		
SHEET 06B.0		
OF SHEETS		

EXTERIOR FINISH NOTES

1. LATH TO BE ATTACHED IAW R103.1.1 OF THE 11TH EDITION, FBCR 2020
2. PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 11TH EDITION, FBCR 2020
3. WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 11TH EDITION, FBCR 2020
4. WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 11TH EDITION, FBCR 2020
5. 'ZIP SYSTEMS' WALL AND ROOF SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL AND ROOF SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS AND ROOF.

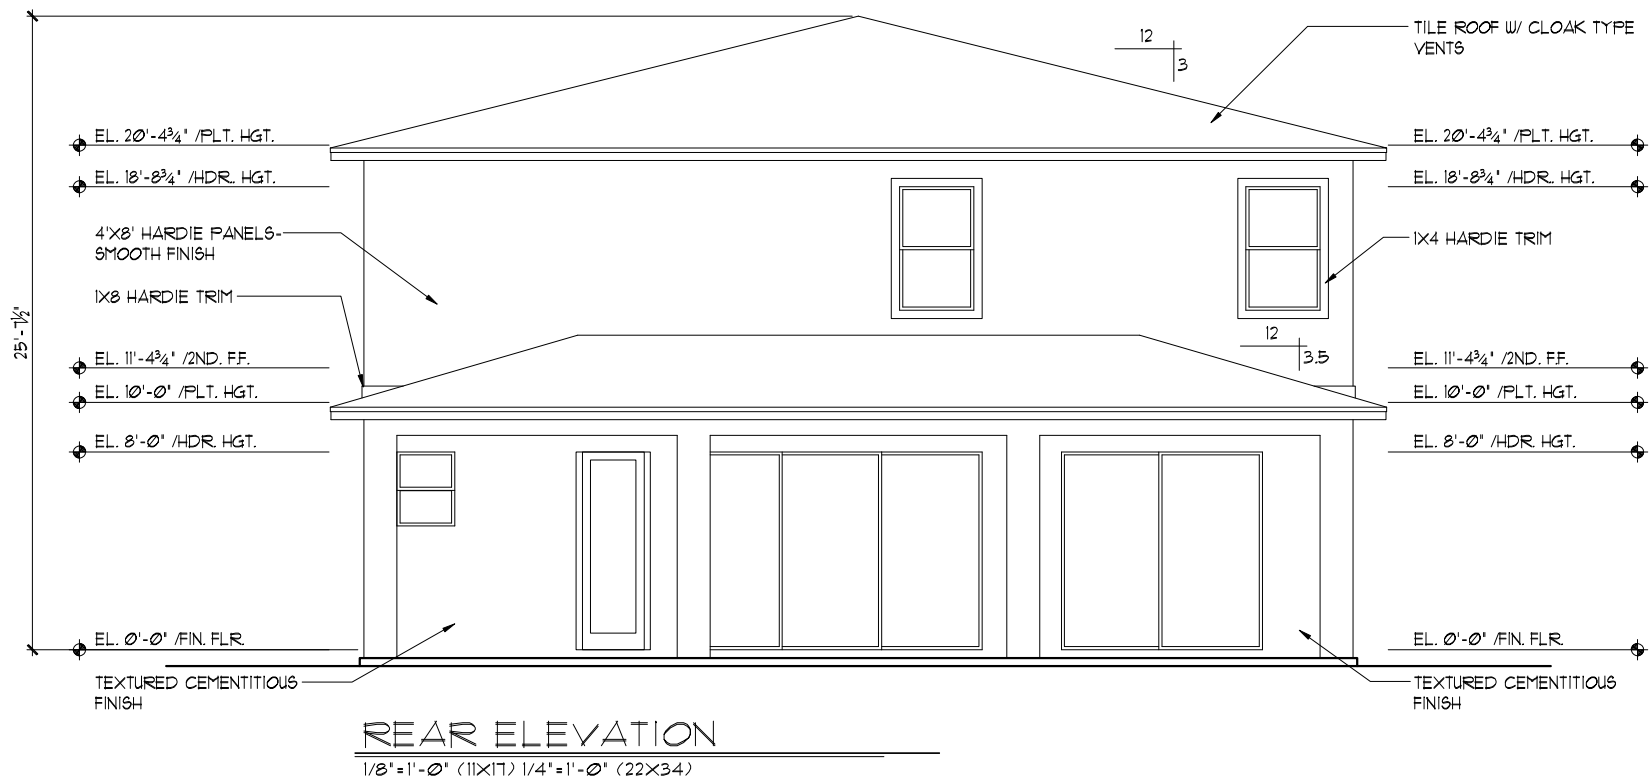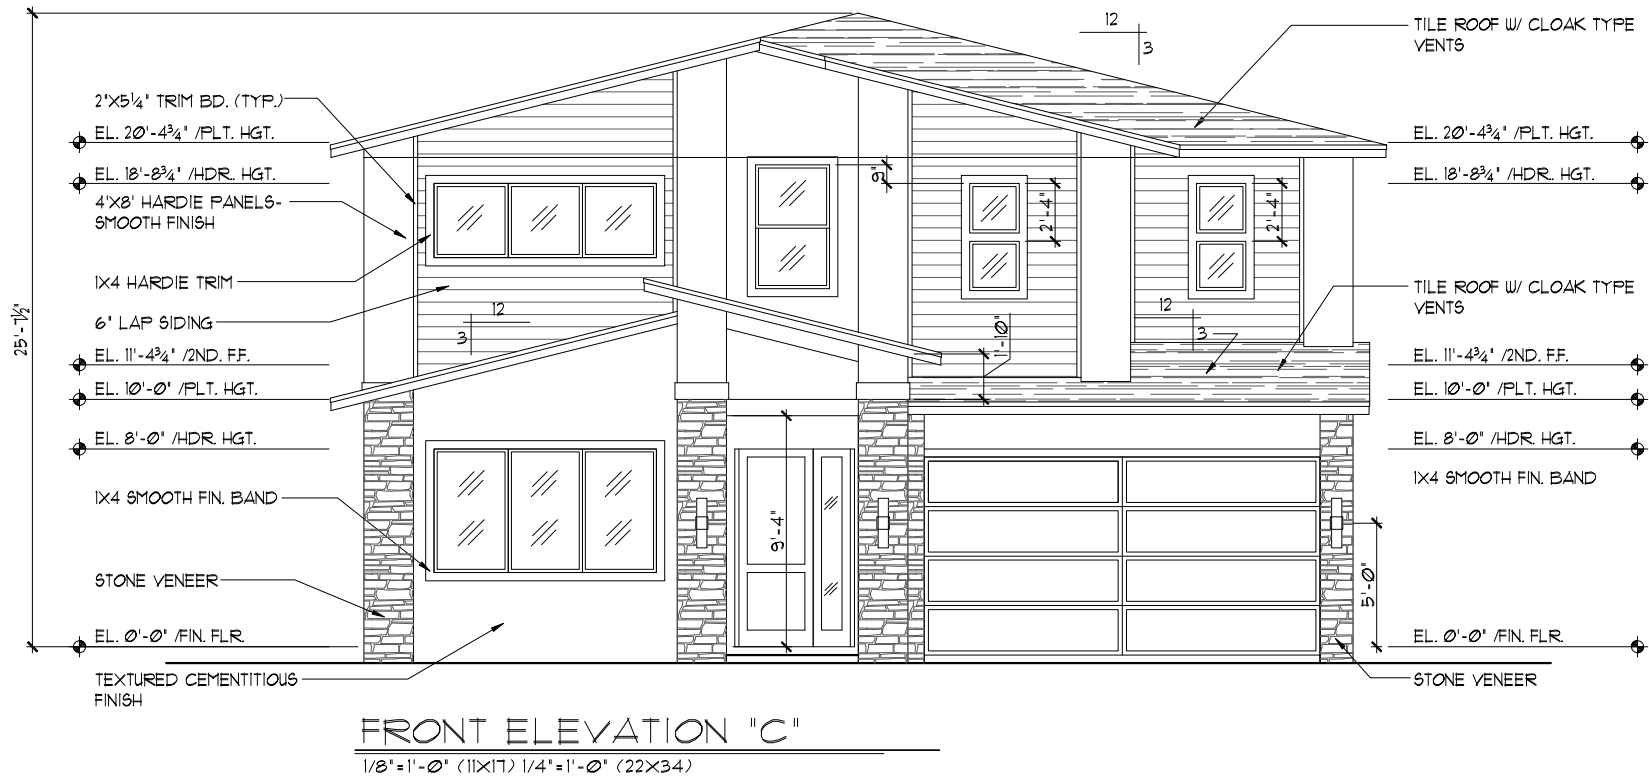

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 11th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS		BY
Engineering By:		DBE and C
MICHAEL A. THOMPSON		PE 47509
PHONE 407-721-2292		
A DIVISION OF PARK SQUARE ENTERPRISES, INC.		
5200 Vineland Road, Suite 200		
Orlando, Florida 32811		
Phone: (407) 528 - 3000		
REAR		
EXTERIOR ELEVATION "C"		
FRONT AND REAR		
4232		
DATE 04-09-21		
SCALE AS NOTED		
DRAWN RDC		
JOB 4232		
SHEET 06C.0		
OF 06C.0		
SHEETS		


- EXTERIOR FINISH NOTES
1. LATH TO BE ATTACHED IAW R103.1.1 OF THE 1TH EDITION, FBCR. 2020

2. PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 1TH EDITION, FBCR. 2020

3. WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 1TH EDITION, FBCR. 2020

4. WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 1TH EDITION, FBCR. 2020

5. 'ZIP SYSTEMS' WALL AND ROOF SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL AND ROOF SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS AND ROOF.

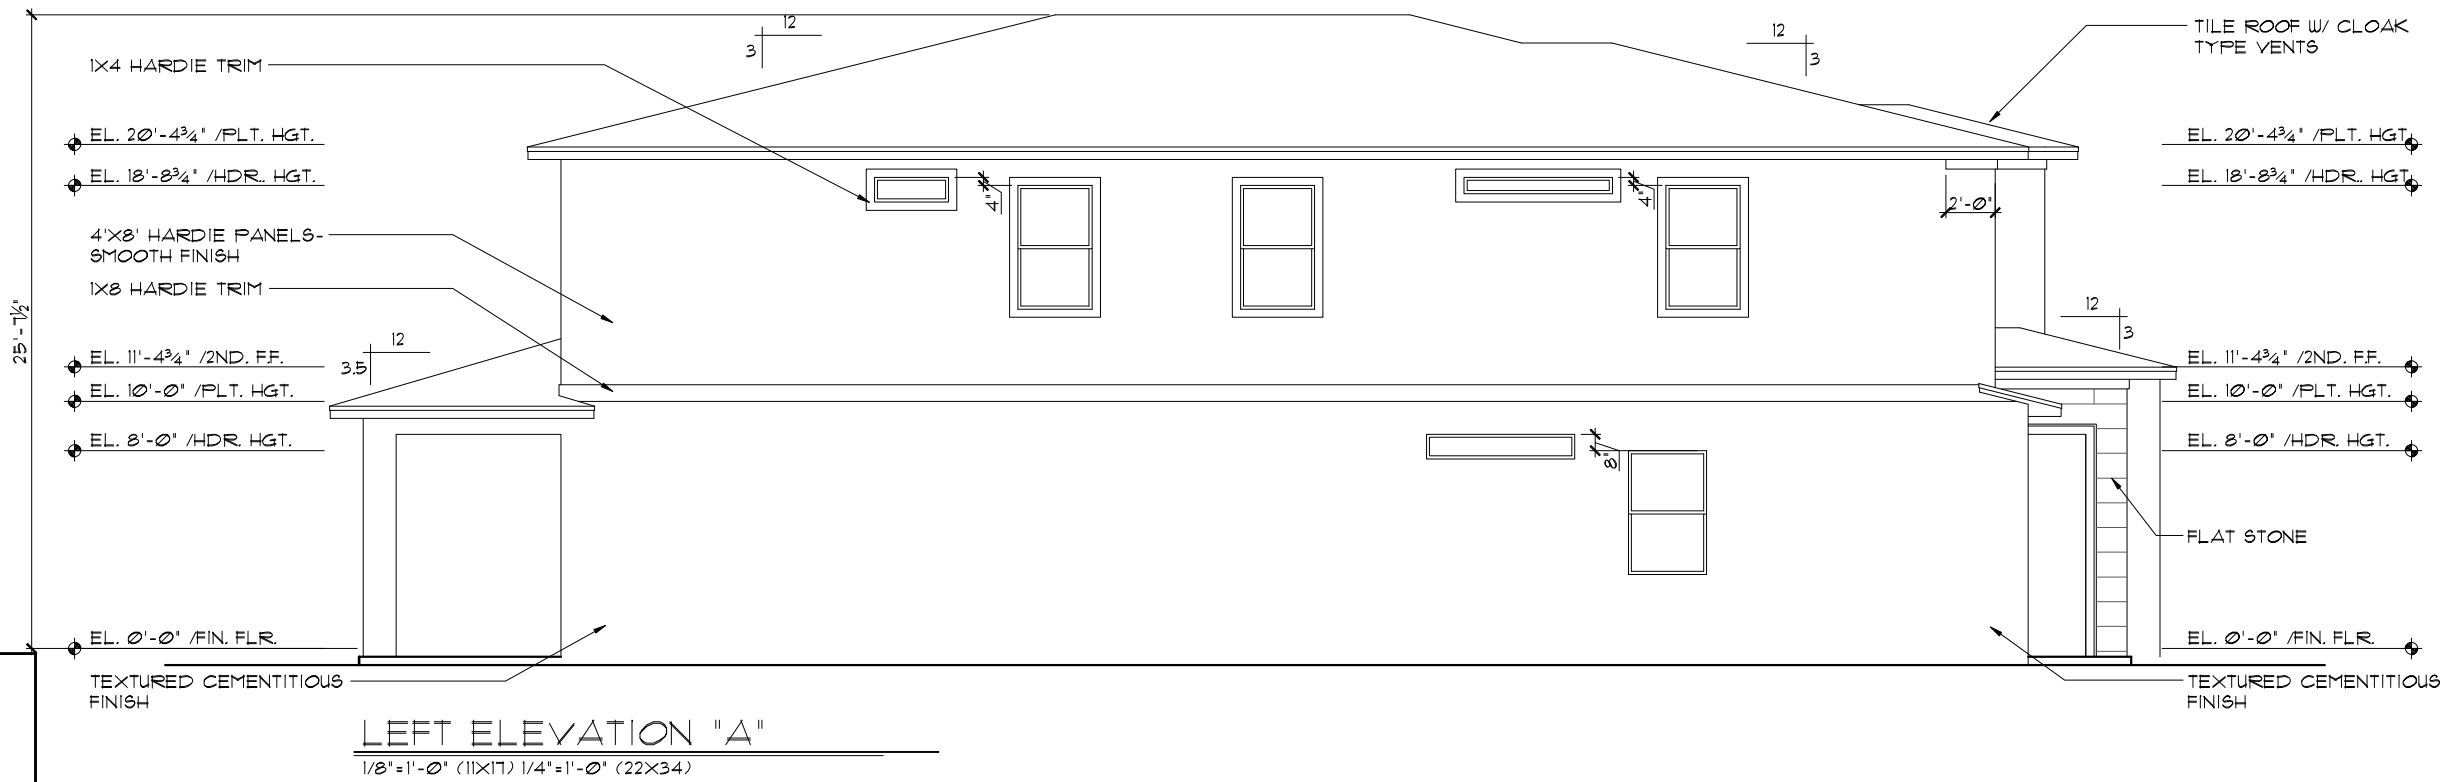

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1TH EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

PARADISO GRANDE

Engineering By:
DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

A DIVISION OF PARK SQUARE
ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

REVISIONS

BY

EXTERIOR ELEVATIONS "A"
LEFT AND RIGHT

REEF

PARADISO GRANDE

4232

DATE 04-09-21

SCALE AS NOTED

DRAWN RDC

JOB 4232

SHEET 07A.0

OF SHEETS



- EXTERIOR FINISH NOTES
1. LATH TO BE ATTACHED IAW R103.1.1 OF THE 1TH EDITION, FBCR. 2020

2. PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 1TH EDITION, FBCR. 2020

3. WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 1TH EDITION, FBCR. 2020

4. WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 1TH EDITION, FBCR. 2020

5. 'ZIP SYSTEMS' WALL AND ROOF SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL AND ROOF SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS AND ROOF.

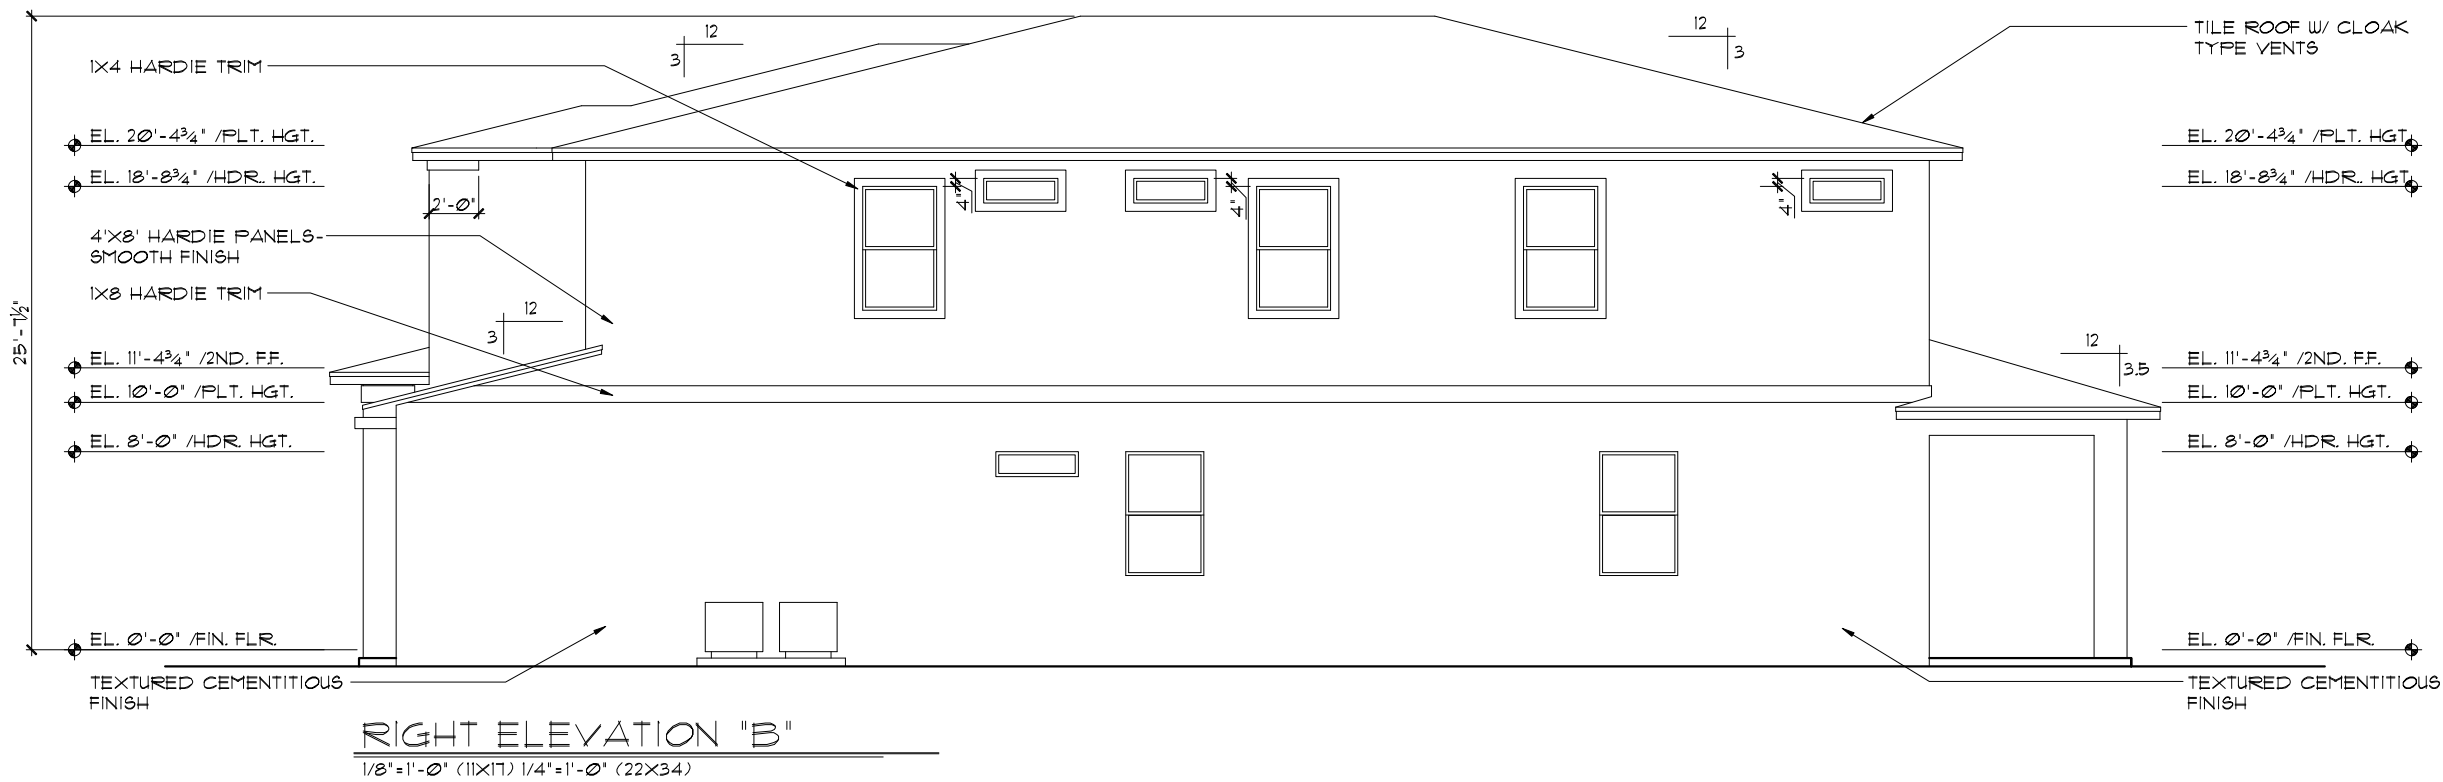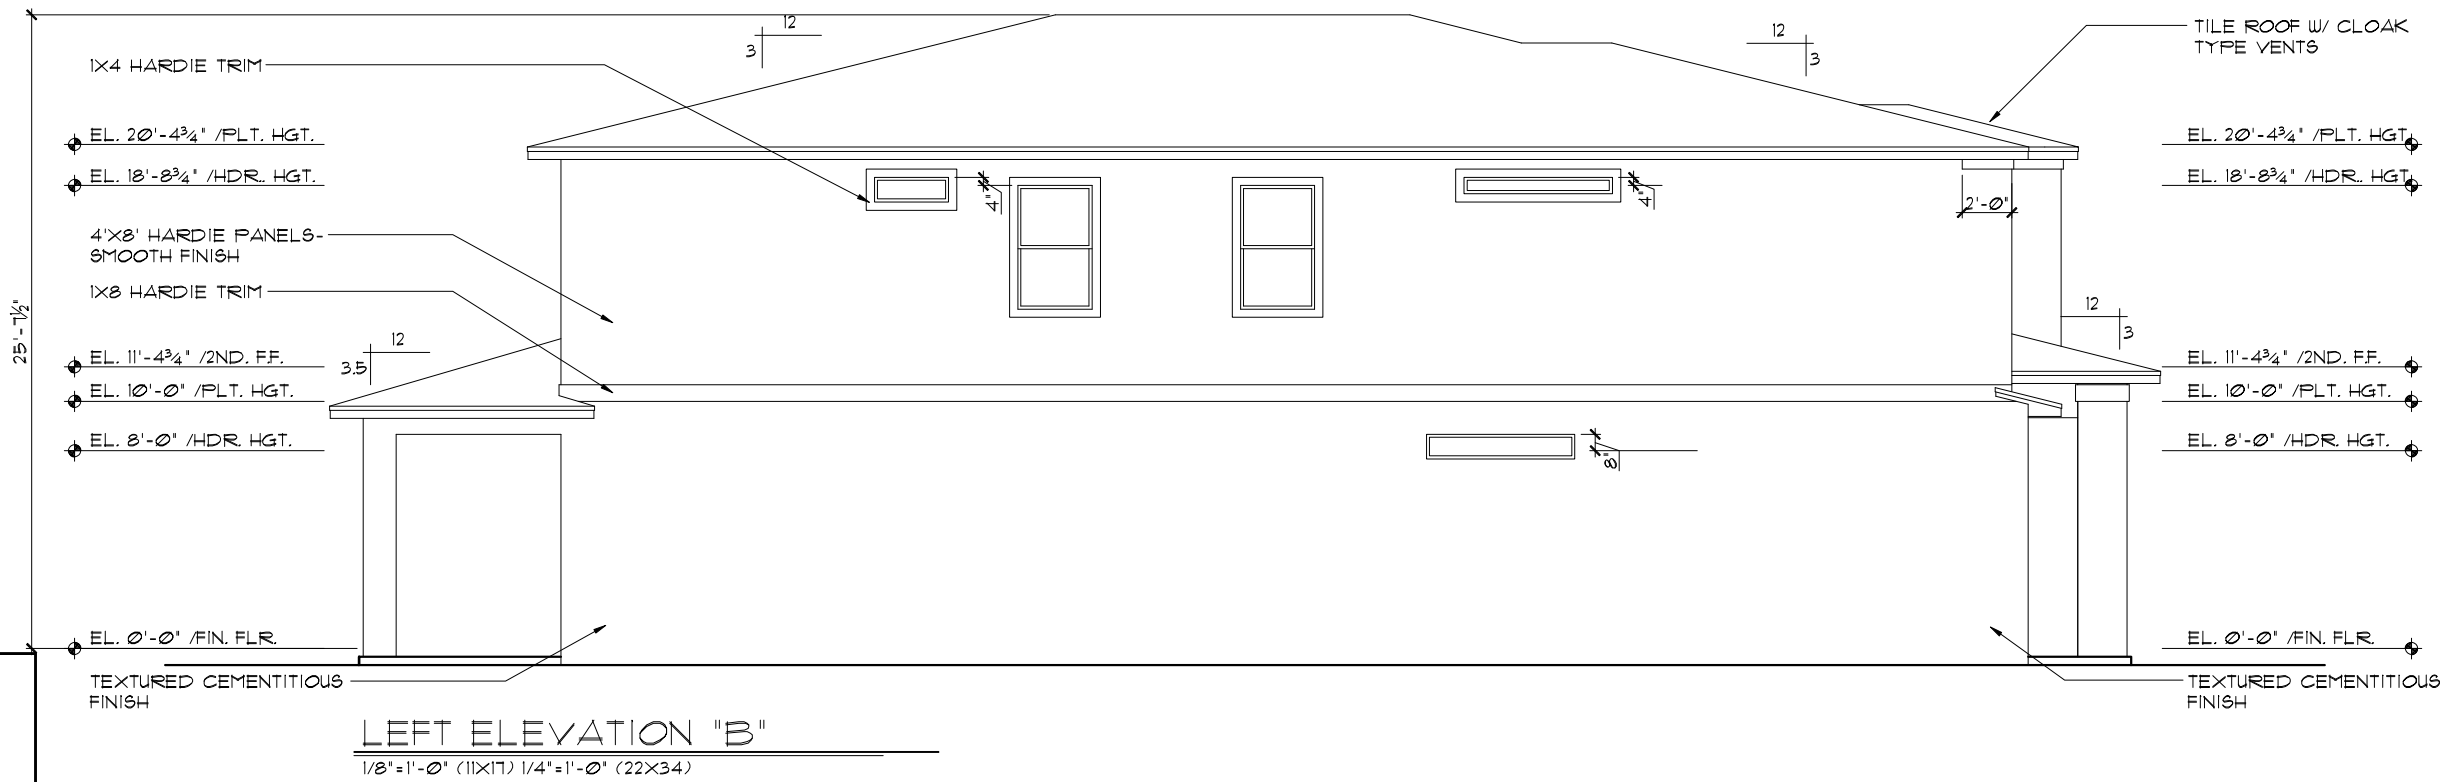

LOT: 0000, PARADISO GRANDE

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1TH EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without the express written permission from Park Square Homes.

PARADISO GRANDE

Engineering By:
DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

A DIVISION OF PARK SQUARE
ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

REVISIONS

BY

REF

PARADISO GRANDE

4232

DATE 04-09-21

SCALE AS NOTED


DRAWN RDC

JOB 4232

SHEET 07B.0

OF SHEETS


EXTERIOR ELEVATIONS "B"
LEFT AND RIGHT

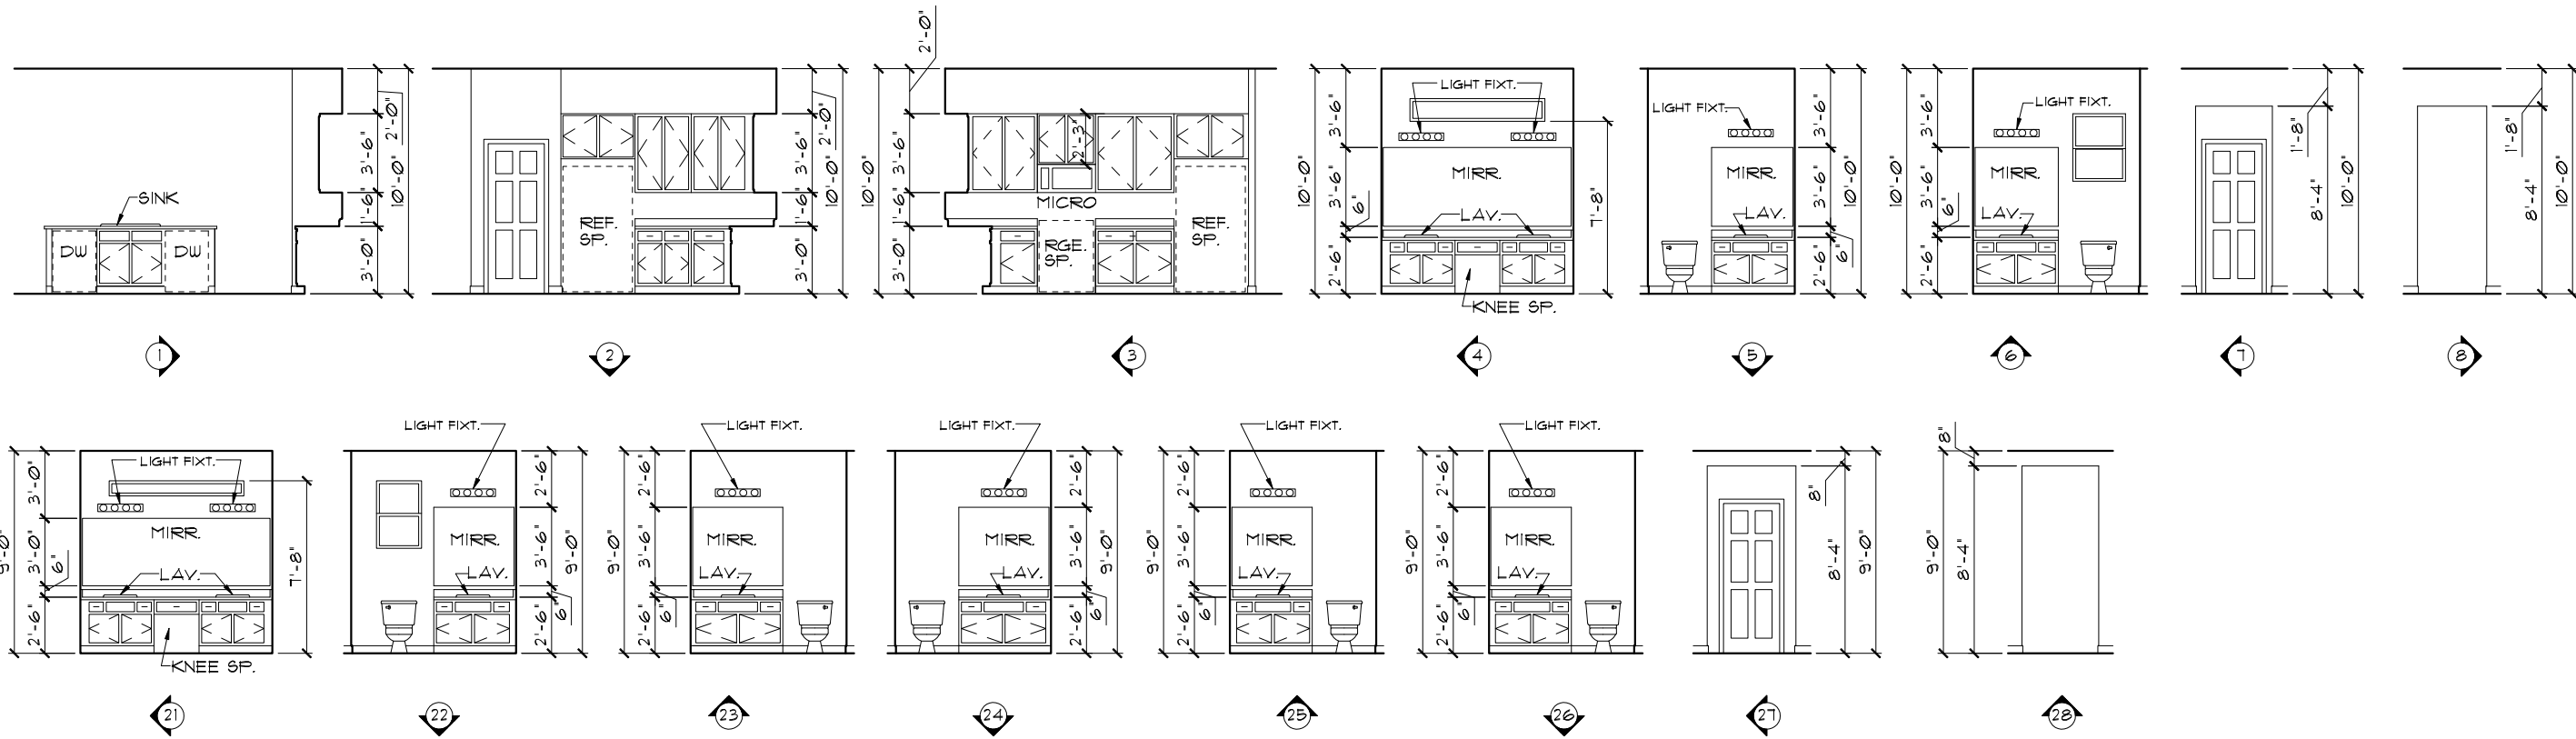

INTERIOR ELEVATIONS


1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

NOTE: INTERIOR ELEVATIONS ARE CONCEPTUAL ONLY. SEE CABINET SHOP DRAWINGS FOR FINAL VERIFICATION.

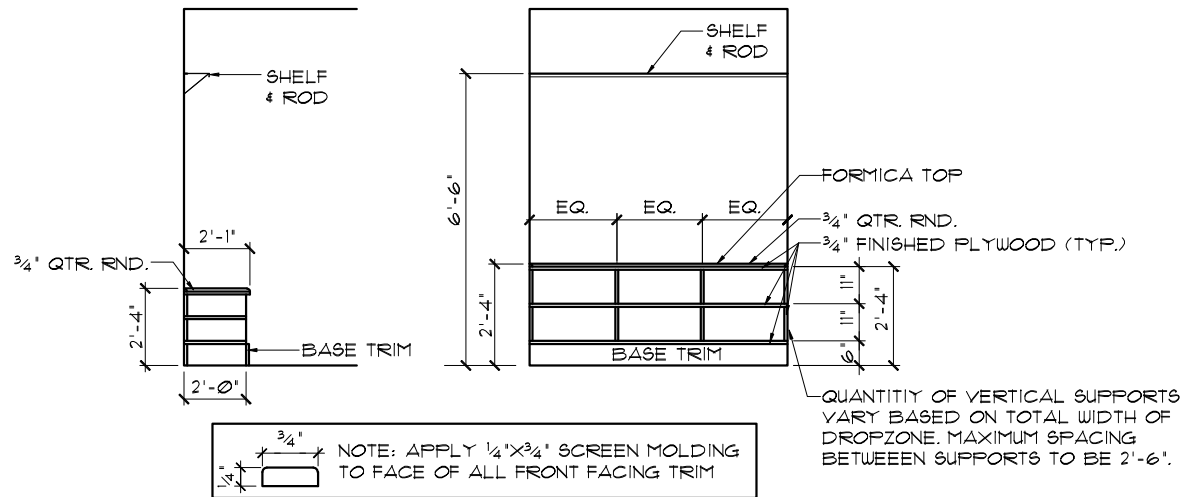

LUGGAGE SHELF DETAIL

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

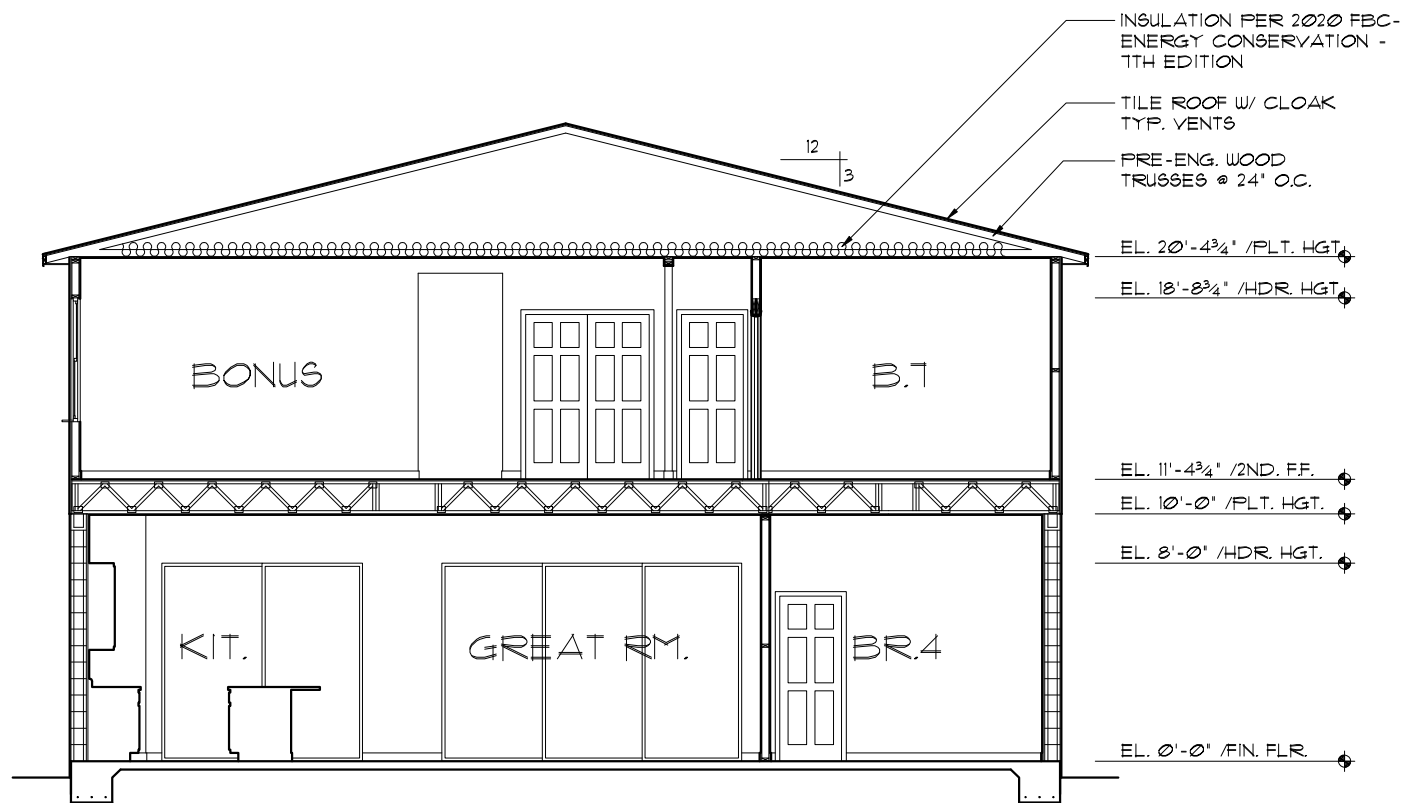

CROSS SECTION

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 11th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS	BY
Engineering By: DBE and C	
MICHAEL A. THOMPSON	
PE 47509	
PHONE 407-721-2292	
A DIVISION OF PARK SQUARE ENTERPRISES, INC.	
5200 Vineland Road, Suite 200	
Orlando, Florida 32811	
Phone: (407) 529 - 3000	
CROSS SECTION / INTERIOR ELEVATIONS	
REEF	PARADISO GRANDE
4232	
DATE 04-09-21	
SCALE AS NOTED	
DRAWN RDC	
JOB 4232	
SHEET 08	
OF SHEETS	

MECHANICAL/GENERAL NOTES
PER 1TH ED. 2020 FLA BLD. CODE-RESIDENTIAL

1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION 610.1 ABC.1

2.)APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION, SERVICE, REPAIR AND REPLACEMENT WITHOUT REMOVING PERMANENT CONSTRUCTION.
A) CHAPTER 13 OF THE FBC-R 2020 1TH SECTION M1305.1

3.) AIR CONDITIONING SYSTEM SHALL BE COMPLETELY BALANCED. ALL ROOMS ISOLATED FROM THE RETURN AIR SHALL BE PROVIDED WITH MEANS TO COMPLY WITH SECTION M1602 OF THE FBCR CODE 2020 1TH EDITION.

4.) IAW NEC 2017- 210.12-ALL 15A OR 20A, 120V BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES IN THE FOLLOWING LOCATIONS REQUIRE AFCI PROTECTION- KITCHEN, FAMILY RMS, DINING RMS, LIVING RMS, PARLORS, LIBRARIES, BEDROOMS, DENS, CLOSETS, SUNROOMS, RECREATION RMS, HALLWAYS OR SIMILAR AREAS SHALL BE PROTECTED BY A LISTED AFCI DEVICE OF THE COMBINATION TYPE.

5.) IAW NEC 2017- 406.12, ALL 15A AND 20A, 125V RECEPTACLES SHALL BE LISTED AS TAMPER RESISTANT.
6.) ALL OUTLETS IN BATHROOMS AND LAUNDRY ROOM SHALL BE GFCI

7.) SMOKE ALARMS SHALL BE IN ALL SLEEPING AREAS. SHALL BE INTERCONNECTED, SHALL BE WITHIN 1' TO 3' OF PEAK & SHALL BE 3' FROM THE SUPPLY OR RETURN AIR- STREAM & EQUIPPED W/ A BATTERY BACKUP. ALARMS MAY NOT BE CONNECTED WHERE ALARMS ARE WIRELESS & ALL ALARMS SOUND UPON ACTIVATION IAW FBCR R314.3 & R314.4. MODEL* TO BE USED ON THIS JOB TO BE:
BRK: SMOKE-9120B, C/O- SC9120B
KIDDE: SMOKE-21007581, C/O 21006377-N

8.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2020, 1TH ED. P2801.7


9.) ALL EQUIPMENT & APPLIANCES, INCLUDING WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS IT IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2020, 1TH ED.

10.)THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3

11.) ALL ELECTRICAL WORK TO BE DONE PER NFPA70-**NEC 2017**

12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN ACCORDANCE WITH NEC 250.53(AX2)

12.) ALL DWELLING UNIT RECEPTACLE WILL BE IN ACCORDANCE WITH NFPA70-NEC2017 - ARTICLE 210-52

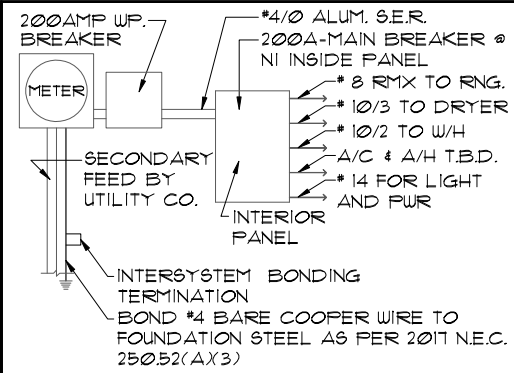

ELECTRICAL RISER DIAGRAM

NOTE:
N.T.S.
ELECTRICAL MATERIALS AND INSTALLATIONS SHALL COMPLY W/ APPLICABLE PROVISIONS OF THE NATIONAL ELEC. CODE 250.52(AX1) TO (6), LOCAL CODES, AND THE LOCAL POWER COMPANY.

250.52(AX3) Concrete-Encased Electrode.
Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

There are two types of concrete-encased electrodes: (1) steel reinforcing bars or rods which are not less than 1/2 inch in diameter and at least 20 ft. long, encased in 2 inches of concrete; (2) 20 ft. of bare copper conductor not smaller than No. 4 AWG encased in 2 inches of concrete.

The steel reinforcing rods must be in a location that is in direct contact with the earth. The reinforcing rods can be connected with tie wires, and a single length of rod can be used as the concrete-encased electrode. The reinforcing rods cannot be coated with non-conductive material.


Section 250.50 requires a concrete-encased electrode to be connected to the grounding electrode system if it is present. Several states have modified this requirement to say a concrete-encased electrode must be used as a grounding electrode only if it is available. In those jurisdictions, if the footings or foundations have been poured before the electrical contractor arrives at the site, and a reinforcing rod is not available for use as a grounding electrode, then a grounding connection to the reinforcing rod is not required.

NOTE: IF MORE THAN 12 SMOKE ALARMS OR CARBON MONOXIDE ALARM COMBINATION ARE INSTALLED IN THE HOME CRIME PREVENTION WILL PULL A SEPARATE FIRE PERMIT AND THE SYSTEM WILL BE MONITORED

ELECTRICAL LEGEND			
⚡	SINGLE POLE SWITCH	⏏	OUTLET, TV/CABLE
⚡	THREE WAY SWITCH	☎	OUTLET, PHONE
⏏	OUTLET 110-115	📺	INTERCOM
⏏	OUT. 110-115, SPLIT WIRED	🔔	CHIMES
⏏	OUT. 110-115, W/ USB	🚬	SMOKE DETECTOR
⏏	OUT. 110-115, CLG. MOUNT.	☑	CARBON MONOXIDE
⏏	OUT. 110-115, FLR. MOUNT.	🔑	PUSH BUTTON
🌀	3PCL. PURPOSE 220-240	🌀	EXHAUST FAN
💡	LIGHT FIXT., CLG. MTD.	🌀	EX. FAN/LIGHT COMBO
💡	LIGHT FIXT., WALL MTD.	🌀	DISPOSAL
💡	LED LIGHT FIXT., RECESSED	🔌	ELECTRICAL PANEL
💡	LIGHT FIXT., REC. ADJUST.	🌀	CEILING FAN, PREWIRE
💡	LIGHT FIXT., PULL CHAIN	🌀	CEILING FAN, INSTALL
💡	LED- LIGHT FIXT.,FLUORESCENT	🔌	ELECT. JUNCTION BOX
💡	LIGHT FIXT., EXT. FLOODS	🔌	THERMOSTAT
EXIT	LIGHT FIXT., EMERG. EXIT	🔌	DISCONNECT SWITCH
🔌	LIGHT FIXT., EXIT/BACKUP	🔌	ELEC. POWER METER

ELECTRICAL PLAN "OPT. LED"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

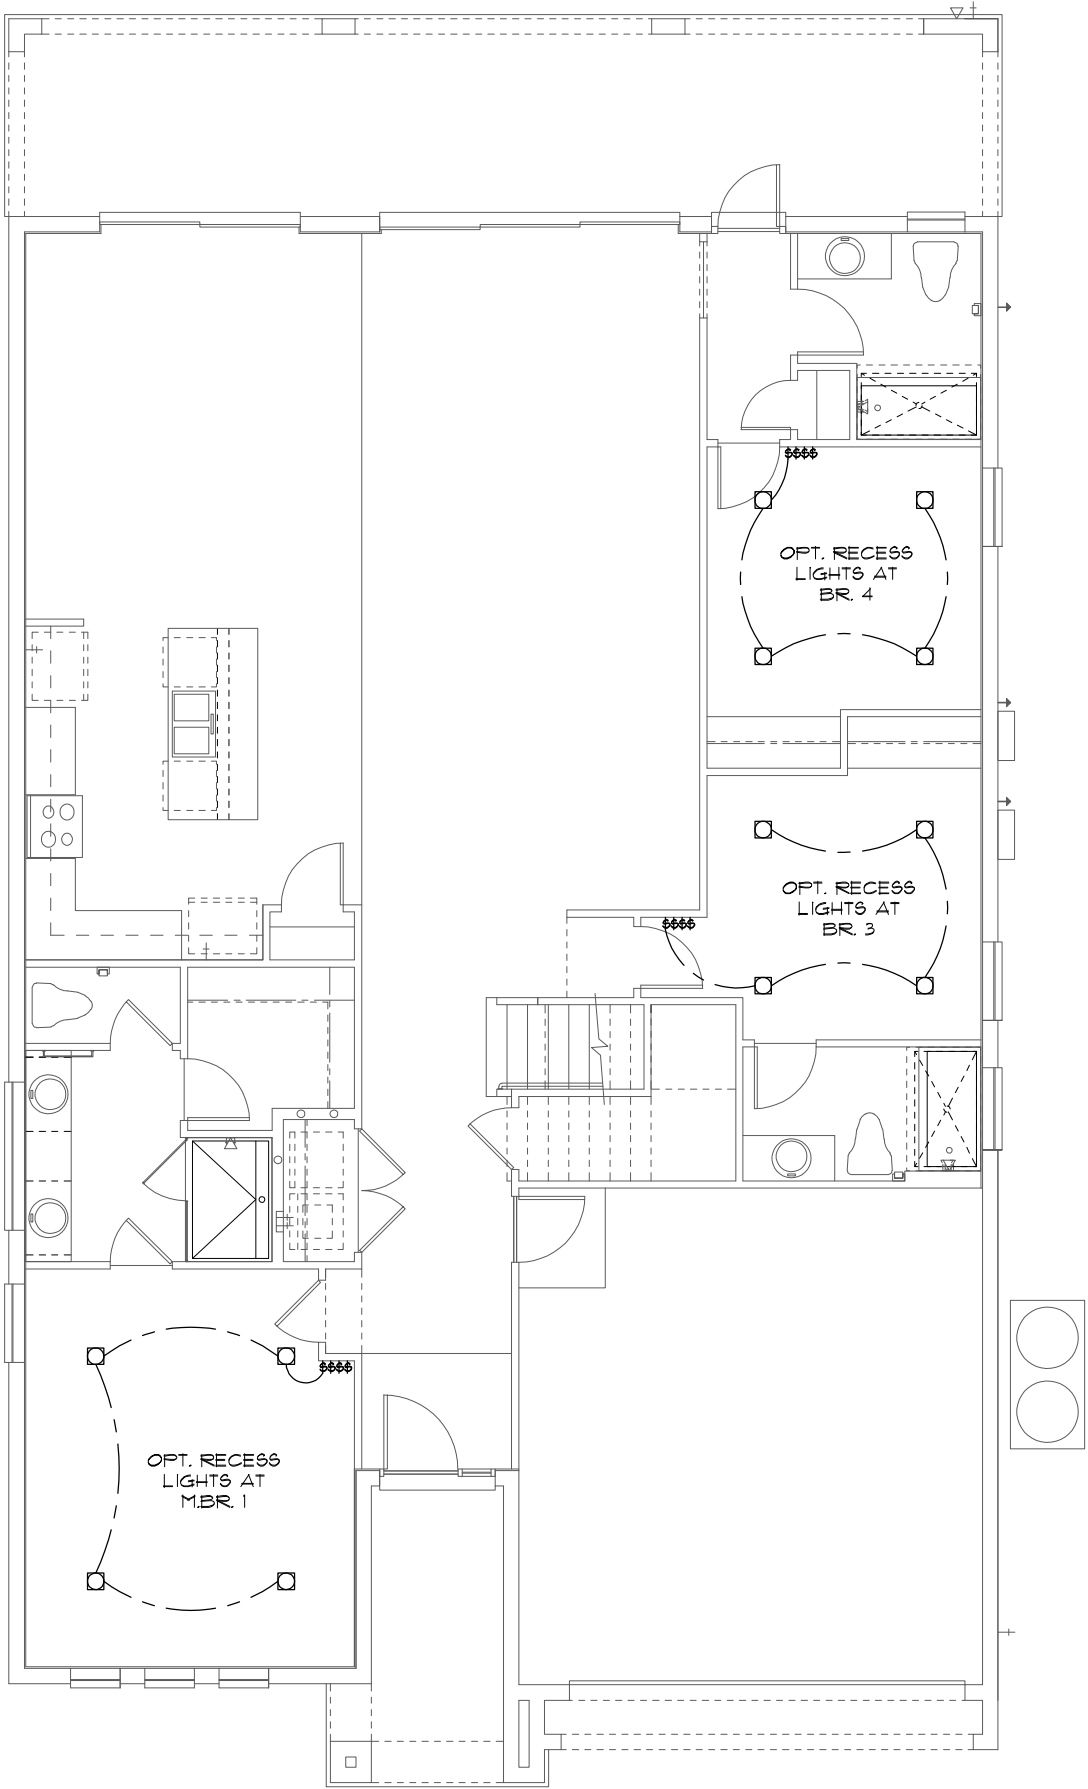

LED RECESS OPTION

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH
LOT: 0000, PARADISO GRANDE
PARADISO GRANDE

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS		BY
Engineering By: DBE and C MICHAEL A. THOMPSON PE 47509 PHONE 407-721-2292		
A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32811 Phone: (407) 529 - 3000		
ELECTRICAL PLAN		
REEF	PARADISO GRANDE	
4232		
DATE 04-09-21		
SCALE AS NOTED		
DRAWN RDC		
JOB 4232		
SHEET 09.0		
OF SHEETS		

MECHANICAL/GENERAL NOTES

1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE
COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY
CODE FOR BUILDING CONSTRUCTION 610.1 ABC.

A) CHAPTER 13 OF THE FBC-R 2020 7TH
SECTION M1305.1


4.) 1AW NEC 2017- 210.12- ALL 15A OR 20A, 120V
BRANCH CIRCUITS SUPPLYING OUTLETS OR
DEVICES IN THE FOLLOWING LOCATIONS REQUIRE
AFCI PROTECTION- KITCHEN, FAMILY RMS, DINING
RMS, LIVING RMS, PARLORS, LIBRARIES,
BEDROOMS, DENS, CLOSETS, SUNROOMS,
RECREATION RMS, HALLWAYS OR SIMILAR AREAS
SHALL BE PROTECTED BY A LISTED AFCI DEVICE
OF THE COMBINATION TYPE.

6.) ALL OUTLETS IN BATHROOMS AND LAUNDRY ROOM SHALL BE GFCI

8.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2020, TTH ED. P2801.1

10.) THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3

12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN ACCORDANCE WITH NEC 250.53(A)(2)

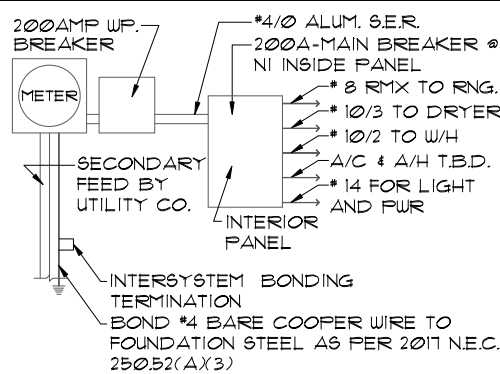

ELECTRICAL RISER DIAGRAM

NOTE: N.T.S.
ELECTRICAL MATERIALS AND INSTALLATIONS SHALL COMPLY W/ APPLICABLE PROVISIONS OF THE NATIONAL ELEC. CODE 250.52(A)(1) TO (6), LOCAL CODES, AND THE LOCAL POWER COMPANY.

Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

The steel reinforcing rods must be in a location that is in direct contact with the earth. The reinforcing rods can be connected with tie wires, and a single length of rod can be used as the concrete-encased electrode. The reinforcing rods cannot be coated with non-conductive material.

NOTE: THE FIRE ALARM SYSTEM
CONSIST OF (1) FIRE ALARM C
PANEL - 32 ZONE FL-FACP-LT
WITH (1) SMOKE DETECTOR OVI
ALARM CONTROL PANEL


NOTE: THE FIRE ALARM SYSTEM WILL
CONSIST OF (1) FIRE ALARM CONTROL
PANEL - 32 ZONE FL-FACP-LTEVS
WITH (1) SMOKE DETECTOR OVER FIRE
ALARM CONTROL PANEL.
ALL INSTALLATION FOR THIS
MACURCO CARBON MONOXIDE
DETECTOR CM-E14 CONVENTIONAL
SMOKE DETECTION FIREWOLF FW2-S
SHALL BE INSTALLED PURSUANT THE
MANUFACTURE REQUIREMENTS AND
NEC 2017 CODE REQUIREMENTS

NOTE : SMOKE DETECTORS AND CARBON MONOXIDE











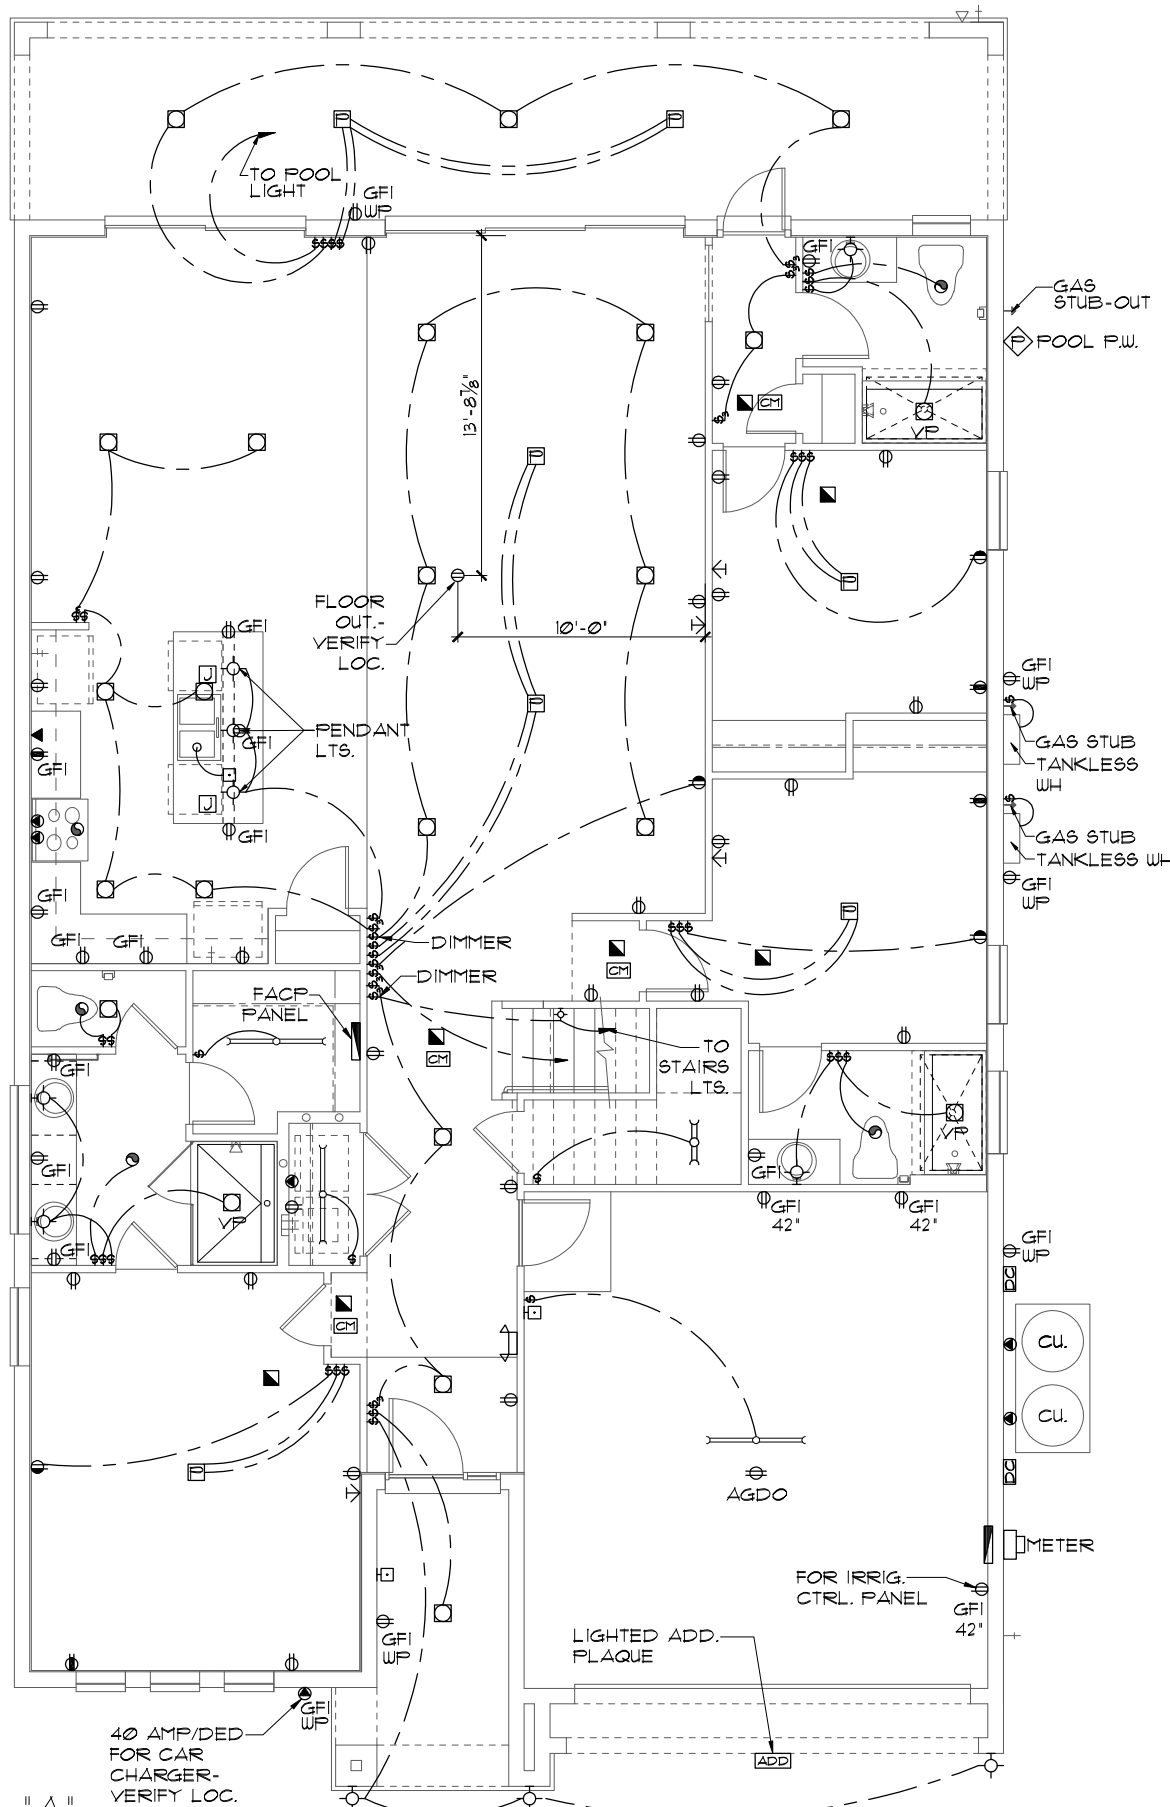























DETECTORS WILL BE INSTALLED PER FBC RESIDENTIAL. THE SMOKE DETECTORS WILL BE INTERCONNECTED AND SOUND OFF UPON AN ALARM. THE CO DETECTORS WILL SOUND OFF WHEN IN ALARM.

FIRE ALARM CONTRACTOR:


CPSS - CRIME PREVENTION SECURITY SYSTEM
4701 SW 34 STREET - GAINESVILLE - FL-32608
LIC. #EF20001021
PHONE : 352-376-1499
TOLL FREE : 800 - 949-1799







ELECTRICAL LEGEND

	SINGLE POLE SWITCH		OUTLET, TV/CABLE
	THREE WAY SWITCH		OUTLET, PHONE
	OUTLET 10-115		INTERCOM
	OUT. 110-115, SPLIT WIRED		CHIMES
	OUT. 110-115, W/ USB		SMOKE DETECTOR/SMOKE ALARM W/INTEGRATED SOUNDER BASE
	OUT. 110-115, CLG. MOUNT.		CARBON MONOXIDE
	OUT. 110-115, FLR. MOUNT.		PUSH BUTTON
	9FCL. PURPOSE 220-240		EXHAUST FAN
	LIGHT FIXT., CLG. MTD.		EX. FAN/LIGHT COMBO
	LIGHT FIXT., WALL MTD.		DISPOSAL
	LED LIGHT FIXT., RECESSED		ELECTRICAL PANEL
	LIGHT FIXT., REC. ADJUST.		CEILING FAN, REWIRE
	LIGHT FIXT., PULL CHAIN		CEILING FAN, INSTALL
	LED LIGHT FIXT., FLUORESCENT		ELECT. JUNCTION BOX
	LIGHT FIXT., EXT. FLOODS		THERMOSTAT
	LIGHT FIXT., EMERG. EXIT		DISCONNECT SWITCH
	LIGHT FIXT., EXIT/BACKUP		ELEC. POWER METER

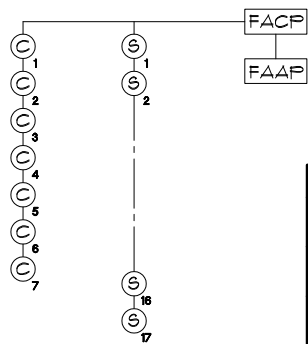RISER DIAGRAM



LEGEND

LEGEND	
	CONTROL PANEL
	ANNUNCIATOR
	CARBON MONOXIDE DETECTOR
	SMOKE DETECTOR

ELECTRICAL PLAN "A"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1TH EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

REVISIONS		B'
Engineering By: DBE and C MICHAEL A. THOMPSON PE 47509 PHONE 407-721-2292		
A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32818 Phone: (407) 529 - 3000		
Park Square HOMES		
ELECTRICAL PLAN		
REEF		
PARADISO GRANDE		
4232		
DATE	04-09-	
SCALE AS NOTED		
DRAWN	RD	
JOB	4232	
SHEET	09A.C	
OF	SHEETS	

MECHANICAL/GENERAL NOTES

1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE
COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY
CODE FOR BUILDING CONSTRUCTION 610.1 ABC.1

A) CHAPTER 13 OF THE FBC-R 2020 1TH
SECTION M1305.1

4.) IAW NEC 2017- 210.12- ALL 15A OR 20A, 120V
BRANCH CIRCUITS SUPPLYING OUTLETS OR
DEVICES IN THE FOLLOWING LOCATIONS REQUIRE
AFCI PROTECTION- KITCHEN, FAMILY RMS, DINING
RMS, LIVING RMS, PARLORS, LIBRARIES,
BEDROOMS, DENS, CLOSETS, SUNROOMS,
RECREATION RMS, HALLWAYS OR SIMILAR AREAS
SHALL BE PROTECTED BY A LISTED AFCI DEVICE
OF THE COMBINATION TYPE.

6.) ALL OUTLETS IN BATHROOMS AND LAUNDRY ROOM SHALL BE GFCI

2.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2020, 7TH ED. P220.17

10.) THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3

12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN ACCORDANCE WITH NEC 250.53(A)(2)



Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.


The steel reinforcing rods must be in a location that is in direct contact with the earth. The reinforcing rods can be connected with tie wires, and a single length of rod can be used as the concrete-encased electrode. The reinforcing rods cannot be coated with non-conductive material.

NOTE: THE FIRE ALARM SYSTEM
CONSIST OF (1) FIRE ALARM C

ALL INSTALLATION FOR THIS
MACURCO CARBON MONOXIDE
DETECTOR CM-EI&CONVENTION
SMOKE DETECTION FIREWOLF F
SHALL BE INSTALLED PURSUANT
MANUFACTURE REQUIREMENTS
NEC 2017 CODE REQUIREMENTS

DETECTORS WILL BE INSTALLED PER FBC RESIDENTIAL. THE SMOKE DETECTORS WILL BE INTERCONNECTED AND SOUND OFF UPON AN ALARM. THE CO DETECTORS WILL SOUND OFF WHEN IN ALARM.

CPSS - CRIME PREVENTION SECURITY SYSTEM
4701 SW 34 STREET - GAINESVILLE - FL-32608
LIC. #EF20001021
PHONE : 352-376-1499
TOLL FREE : 800 - 949-1799

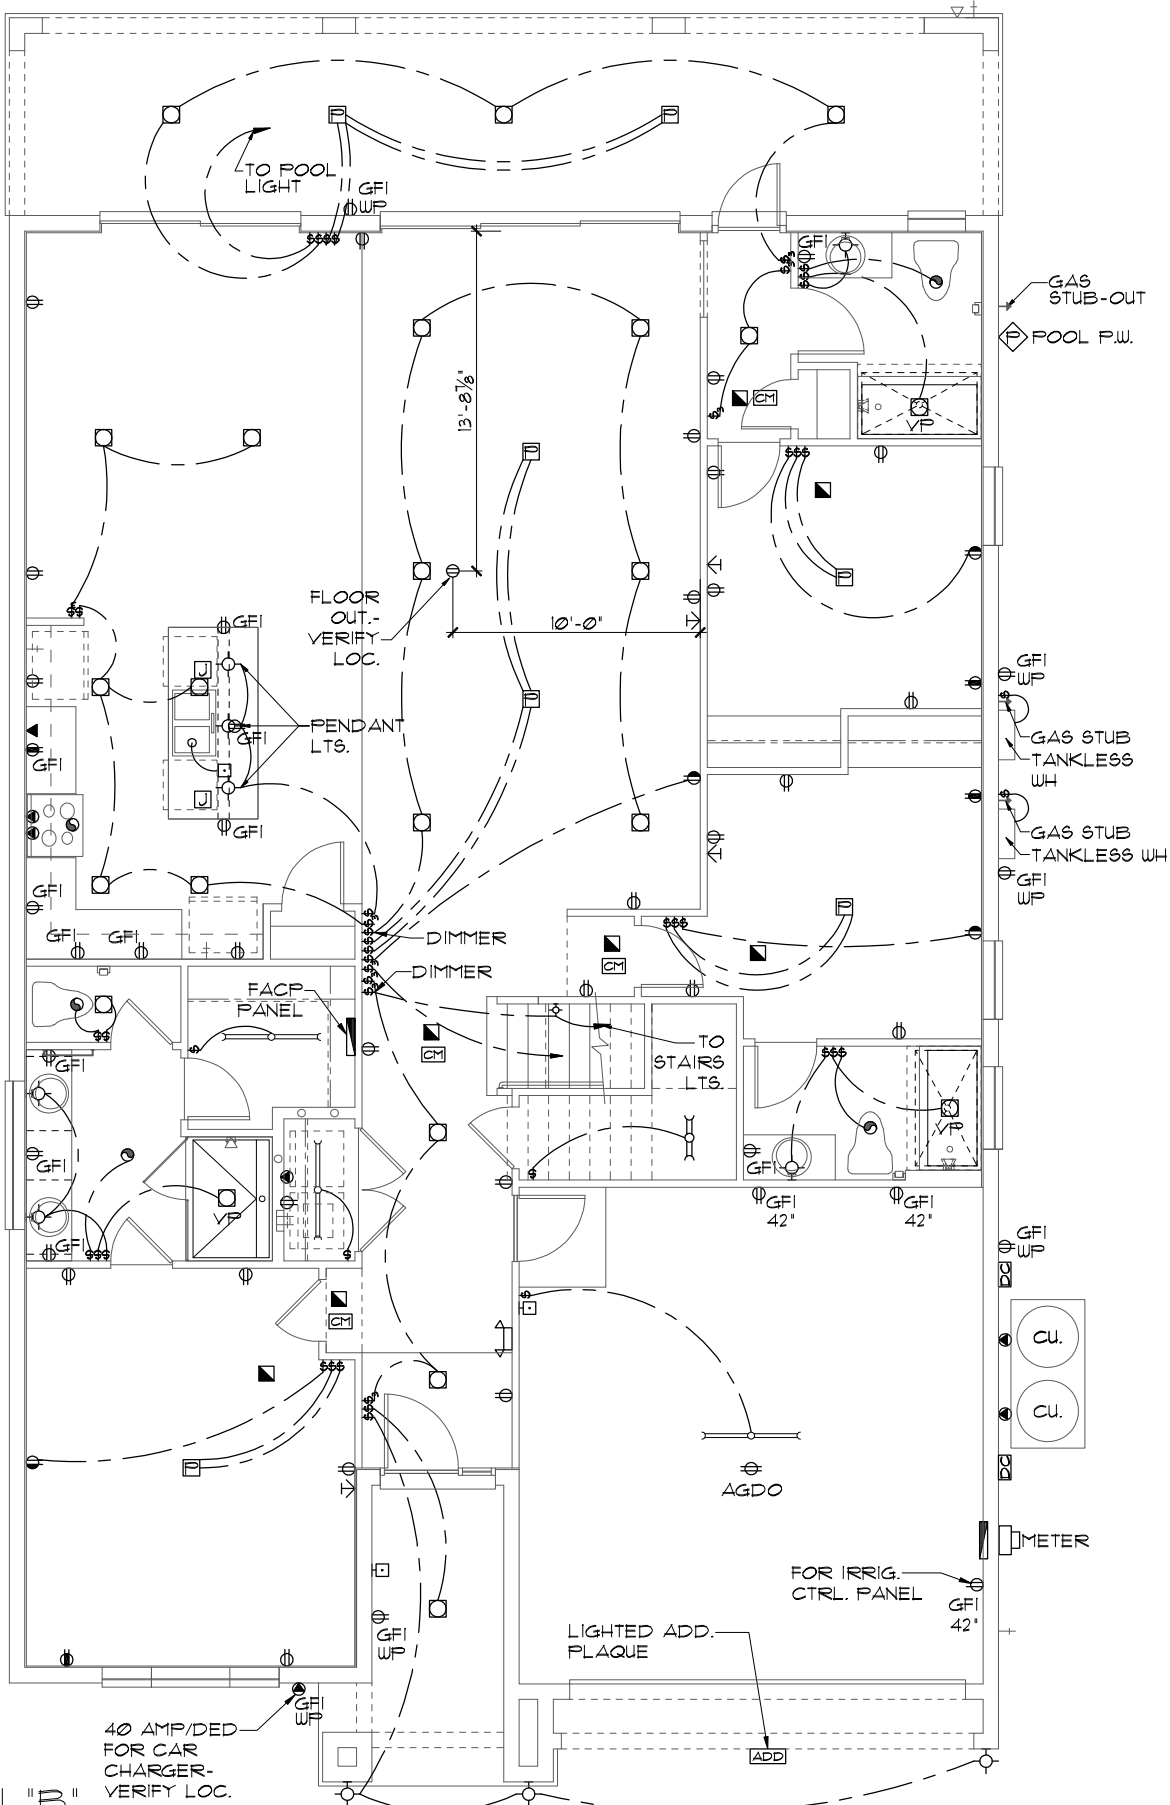

	SINGLE POLE SWITCH		OUTLET, TV/CABLE
	THREE WAY SWITCH		OUTLET, PHONE
	OUTLET 10-115		INTERCOM
	OUT. 110-115, SPLIT WIRED		CHIMES
	OUT. 110-115, W/ USB		SMOKE DETECTOR/SMOKE ALARM W/INTEGRATED SOUNDER BASE
	OUT. 110-115, CLG. MOUNT.		CARBON MONOXIDE
	OUT. 110-115, FLR. MOUNT.		PUSH BUTTON
	5PCL. PURPOSE 220-240		EXHAUST FAN
	LIGHT FIXT., CLG. MTD.		EX. FAN/LIGHT COMBO
	LIGHT FIXT., WALL MTD.		DISPOSAL
	LED LIGHT FIXT., RECESSED		ELECTRICAL PANEL
	LIGHT FIXT., REC. ADJUST.		CEILING FAN, PREWIRE
	LIGHT FIXT., PULL CHAIN		CEILING FAN, INSTALL
	LED LIGHT FIXT., FLUORESCENT		ELECT. JUNCTION BOX
	LIGHT FIXT., EXT. FLOODS		THERMOSTAT
	LIGHT FIXT., EMERG. EXIT		DISCONNECT SWITCH
	LIGHT FIXT., EXIT/BACKUP		ELEC. POWER METER

The diagram illustrates a fire alarm system with the following components and connections:

- FACP (Fire Alarm Control Panel)** is connected to a vertical line of **Carbon Monoxide Detectors (C1-C7)**.
- FAAP (Fire Alarm Annunciator Panel)** is connected to a vertical line of **Smoke Detectors (S1-S2)**.
- A dashed line indicates a break in the wiring between the two vertical lines of detectors.

LEGEND	
FACP	CONTROL PANEL
FAAP	ANNUNCIATOR
C	CARBON MONOXIDE DETECTOR
S	SMOKE DETECTOR

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

LOT: 0000, PARADISO GRANDE

PARADISO GRANDE

Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

© COPYRIGHT 2015

**A DIVISION OF PARK SQUARE
ENTERPRISES, INC.**
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

ELECTRICAL PLAN

REEF	PARADISO GRANDE
------	-----------------

4232	
DATE	04-09-2017
SCALE AS NOTED	
DRAWN	RD
JOB	42
SHEET	
09B.C	
OF	SHEET

MECHANICAL/GENERAL NOTES

PER 1TH ED. 2020 FLA BLD. CODE-RESIDENTIAL
1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE
COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY
CODE FOR BUILDING CONSTRUCTION 6101 ABC.1

2.)APPLIANCES SHALL BE ACESSEIBLE FOR
INSPECTION, SERVICE, REPAIR AND REPLACEMENT
WITHOUT REMOVING PERMANENT CONSTRUCTION.
A) CHAPTER 13 OF THE FBC-R 2020 1TH
SECTION M1305.1

3.) AIR CONDITIONING SYSTEM SHALL BE
COMPLETELY BALANCED. ALL ROOMS ISOLATED
FROM THE RETURN AIR SHALL BE PROVIDED WITH
MEANS TO COMPLY WITH SECTION M1602 OF THE
FBCR CODE 2020 1TH EDITION.

4.) IAW NEC 2017- 210.12-ALL 15A OR 20A, 120V
BRANCH CIRCUITS SUPPLYING OUTLETS OR
DEVICES IN THE FOLLOWING LOCATIONS REQUIRE
AFCI PROTECTION- KITCHEN, FAMILY RMS, DINING
RMS, LIVING RMS, PARLORS, LIBRARIES,
BEDROOMS, DENS, CLOSETS, SUNROOMS,
RECREATION RMS, HALLWAYS OR SIMILAR AREAS
SHALL BE PROTECTED BY A LISTED AFCI DEVICE
OF THE COMBINATION TYPE.

5.) IAW NEC 2017- 406.12, ALL 15A AND 20A, 125V
RECEPTACLES SHALL BE LISTED AS TAMPER
RESISTANT.
6.) ALL OUTLETS IN BATHROOMS AND LAUNDRY
ROOM SHALL BE GFCI

7.) SMOKE ALARMS SHALL BE IN ALL SLEEPING
AREAS. SHALL BE INTERCONNECTED, SHALL BE
WITHIN 1' TO 3' OF PEAK & SHALL BE 3' FROM THE
SUPPLY OR RETURN AIR- STREAM & EQUIPPED W/
A BATTERY BACKUP. ALARMS MAY NOT BE
CONNECTED WHERE ALARMS ARE WIRELESS & ALL
ALARMS SOUND UPON ACTIVATION IAW FBCR R314.3
& R314.4.

8.) ALL WATER HEATERS HAVING AN IGNITION
SOURCE TO BE ELEVATED SUCH THAT THE SOURCE
OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR
UNLESS WATER HEATER IS LISTED AS FLAMMABLE
VAPOR IGNITION RESISTANT. IAW FBCR 2020,
1TH ED. P2801.7


9.) ALL EQUIPMENT & APPLIANCES, INCLUDING
WATER HEATERS HAVING AN IGNITION SOURCE TO
BE ELEVATED SUCH THAT THE SOURCE OF IGNITION
IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS IT IS
LISTED AS FLAMMABLE VAPOR IGNITION
RESISTANT. IAW FBCR 2020, 1TH ED.

10.)THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH
SHALL BE DETERMINED BY ONE OF THE METHODS
SPECIFIED IN SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3

11.) ALL ELECTRICAL WORK TO BE DONE PER
NFPAT0-NEC 2017

12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN
ACCORDANCE WITH NEC 250.53(A)2)

12.) ALL DWELLING UNIT RECEPTACLE WILL BE IN
ACCORDANCE WITH NFPAT0-NEC2017 - ARTICLE
210-52

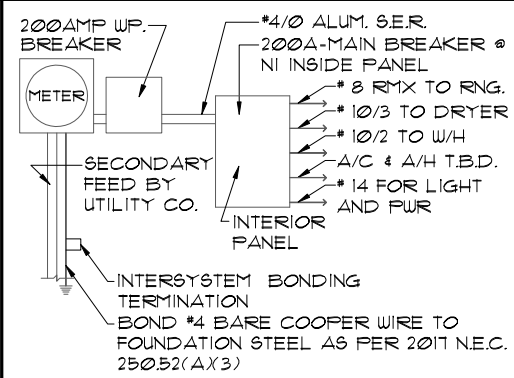

ELECTRICAL RISER DIAGRAM

NOTE:
N.T.S.
ELECTRICAL MATERIALS AND INSTALLATIONS SHALL
COMPLY W/ APPLICABLE PROVISIONS OF THE NATIONAL
ELEC. CODE 250.52(A)1) TO (6), LOCAL CODES, AND
THE LOCAL POWER COMPANY.

250.52(A)3) Concrete-Encased Electrode.
Concrete-encased electrodes can be horizontal or
vertical and must be at least 20 ft. long.

Concrete-encased electrodes can be horizontal or
vertical and must be at least 20 ft. long.

There are two types of concrete-encased
electrodes: (1) steel reinforcing bars or rods which
are not less than 1/2 inch in diameter and at least 20
ft. long, encased in 2 inches of concrete; (2) 20 ft.
of bare copper conductor not smaller than No. 4
AWG encased in 2 inches of concrete.

The steel reinforcing rods must be in a location that
is in direct contact with the earth. The reinforcing
rods can be connected with tie wires, and a single
length of rod can be used as the concrete-encased
electrode. The reinforcing rods cannot be coated
with non-conductive material.


Section 250.50 requires a concrete-encased
electrode to be connected to the grounding
electrode system if it is present. Several states
have modified this requirement to say a
concrete-encased electrode must be used as a
grounding electrode only if it is available. In those
jurisdictions, if the footings or foundations have
been poured before the electrical contractor
arrives at the site, and a reinforcing rod is not
available for use as a grounding electrode, then a
grounding connection to the reinforcing rod is not
required.

NOTE: THE FIRE ALARM SYSTEM WILL
CONSIST OF (1) FIRE ALARM CONTROL
PANEL - 32 ZONE FL-FACP-LTEVS
WITH (1) SMOKE DETECTOR OVER FIRE
ALARM CONTROL PANEL.
ALL INSTALLATION FOR THIS
MACURCO CARBON MONOXIDE
DETECTOR CM-EI&CONVENTIONAL
SMOKE DETECTION FIREWOLF FW2-S
SHALL BE INSTALLED PURSUANT THE
MANUFACTURE REQUIREMENTS AND
NEC 2017 CODE REQUIREMENTS


NOTE : SMOKE DETECTORS AND CARBON MONOXIDE
DETECTORS WILL BE INSTALLED PER FBC RESIDENTIAL. THE
SMOKE DETECTORS WILL BE INTERCONNECTED AND SOUND OFF
UPON AN ALARM. THE CO DETECTORS WILL SOUND OFF WHEN IN
ALARM.

FIRE ALARM CONTRACTOR:
CPSS - CRIME PREVENTION SECURITY SYSTEM
4701 SW 34 STREET - GAINESVILLE - FL-32608
LIC. #EF20001021
PHONE : 352-376-1499
TOLL FREE : 800 - 949-1799

ELECTRICAL LEGEND			
ⓘ	SINGLE POLE SWITCH	◀	OUTLET, TV/CABLE
ⓘ	THREE WAY SWITCH	◀	OUTLET, PHONE
ⓘ	OUTLET 110-115	◻	INTERCOM
ⓘ	OUT. 110-115, SPLIT WIRED	◻	CHIMES
ⓘ	OUT. 110-115, W/ USB	◻	SMOKE DETECTOR/SMOKE ALARM W/INTEGRATED SOUNDER BASE
ⓘ	OUT. 110-115, CLG. MOUNT.	◻	CARBON MONOXIDE
ⓘ	OUT. 110-115, FLR. MOUNT.	◻	PUSH BUTTON
ⓘ	3PCL. PURPOSE 220-240	◻	EXHAUST FAN
ⓘ	LIGHT FIXT., CLG. MTD.	◻	EX. FAN/LIGHT COMBO
ⓘ	LIGHT FIXT., WALL MTD.	◻	DISPOSAL
ⓘ	LED LIGHT FIXT., RECESSED	◻	ELECTRICAL PANEL
ⓘ	LIGHT FIXT., REC. ADJUST.	◻	CEILING FAN, PREWIRE
ⓘ	LIGHT FIXT., PULL CHAIN	◻	CEILING FAN, INSTALL
ⓘ	LED LIGHT FIXT.,FLUORESCENT	◻	ELECT. JUNCTION BOX
ⓘ	LIGHT FIXT., EXT. FLOODS	◻	THERMOSTAT
ⓘ	LIGHT FIXT., EMERG. EXIT	◻	DISCONNECT SWITCH
ⓘ	LIGHT FIXT., EXIT/BACKUP	◻	ELEC. POWER METER

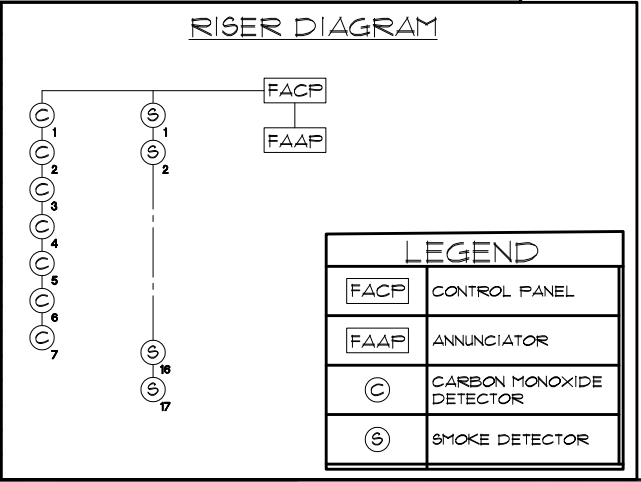

LEGEND	
FACP	CONTROL PANEL
FAAP	ANNUNCIATOR
Ⓢ	CARBON MONOXIDE DETECTOR
Ⓢ	SMOKE DETECTOR

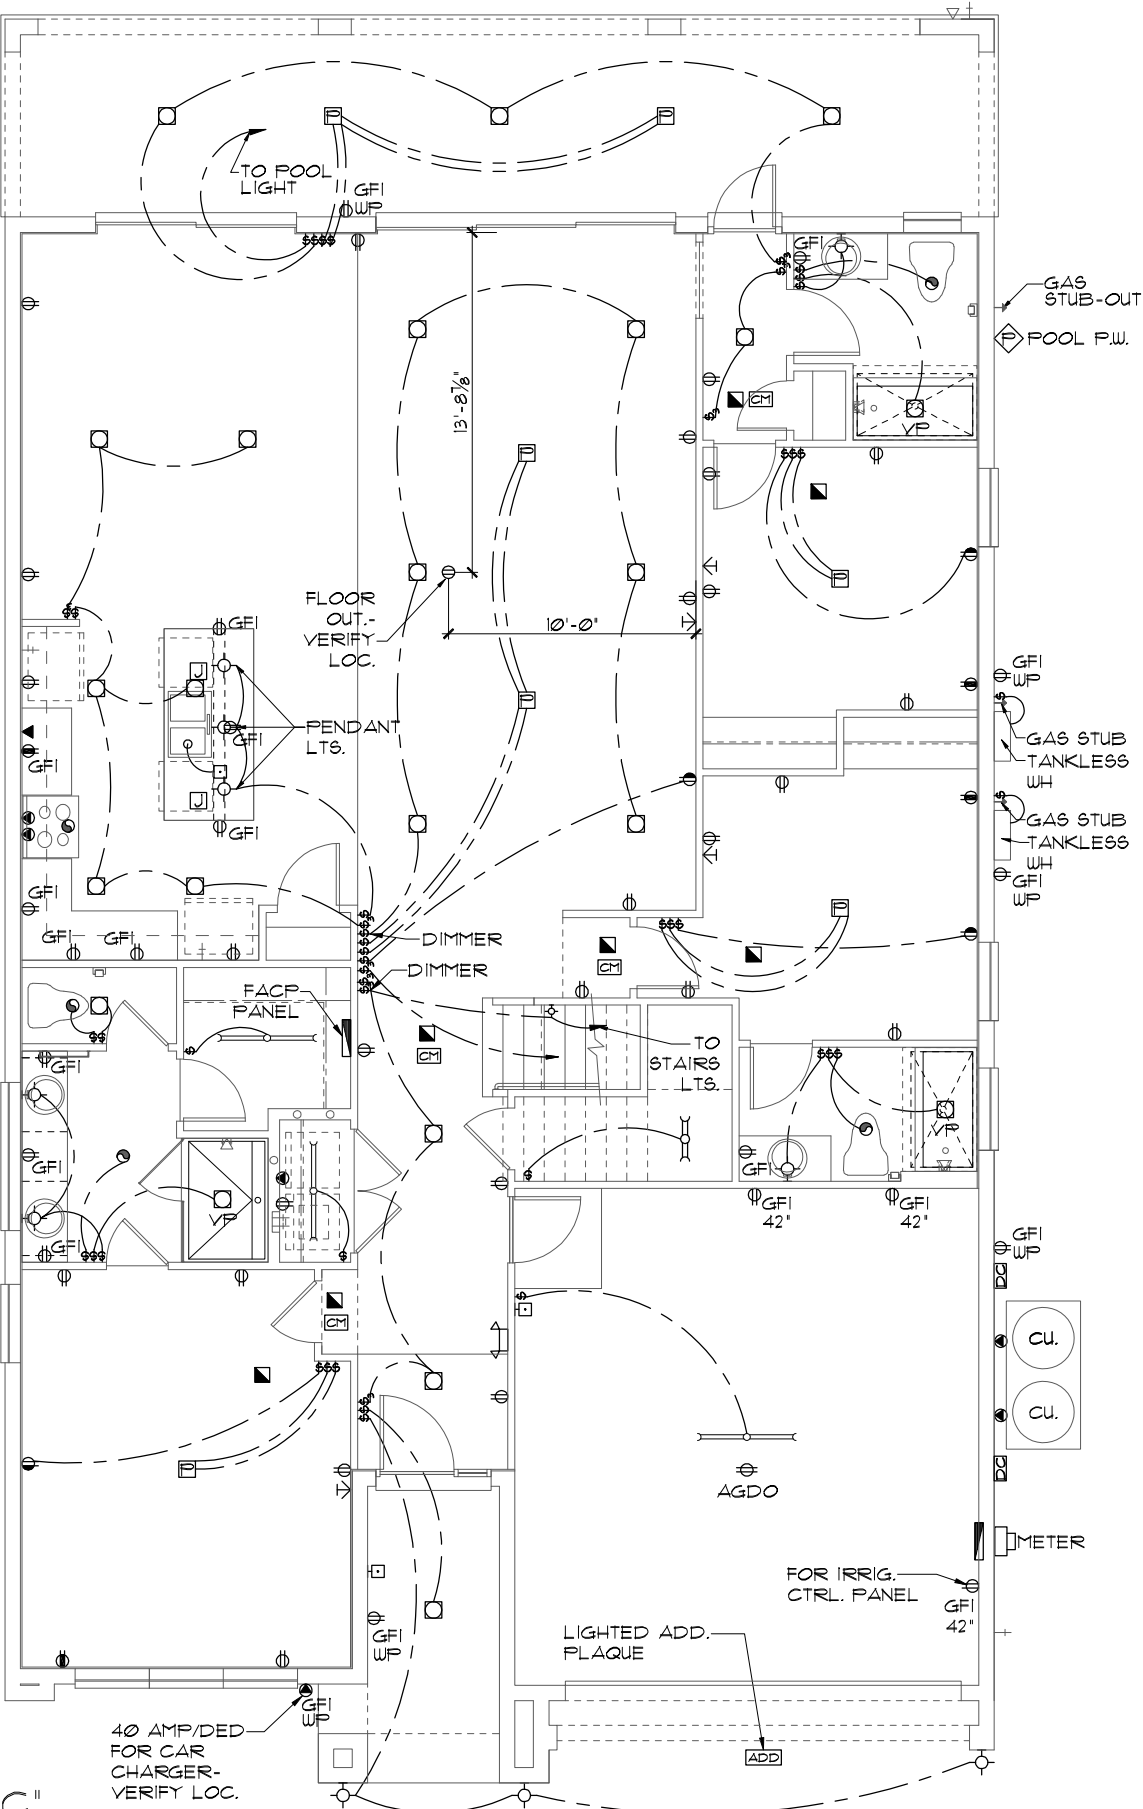

ELECTRICAL PLAN "C"
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

Paradiso Grande Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

Engineering By:
DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

A DIVISION OF PARK SQUARE
ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

ELECTRICAL PLAN

REEF

PARADISO GRANDE

4232	DATE	04-09-21
	SCALE	AS NOTED
	DRAWN	RDC
	JOB	4232
	SHEET	09C.0
	OF	SHEETS

MECHANICAL/GENERAL NOTES
PER 1TH ED. 2020 FLA BLD. CODE-RESIDENTIAL

1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION 610.1 ABC.1

2.)APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION, SERVICE, REPAIR AND REPLACEMENT WITHOUT REMOVING PERMANENT CONSTRUCTION.
A) CHAPTER 13 OF THE FBC-R 2020 1TH SECTION M1305.1

3.) AIR CONDITIONING SYSTEM SHALL BE COMPLETELY BALANCED. ALL ROOMS ISOLATED FROM THE RETURN AIR SHALL BE PROVIDED WITH MEANS TO COMPLY WITH SECTION M1602 OF THE FBCR CODE 2020 1TH EDITION.

4.) IAW NEC 2017- 210.12-ALL 15A OR 20A, 120V BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES IN THE FOLLOWING LOCATIONS REQUIRE AFCI PROTECTION- KITCHEN, FAMILY RMS, DINING RMS, LIVING RMS, PARLORS, LIBRARIES, BEDROOMS, DENS, CLOSETS, SUNROOMS, RECREATION RMS, HALLWAYS OR SIMILAR AREAS SHALL BE PROTECTED BY A LISTED AFCI DEVICE OF THE COMBINATION TYPE.

5.) IAW NEC 2017- 406.12, ALL 15A AND 20A, 125V RECEPTACLES SHALL BE LISTED AS TAMPER RESISTANT.

6.) ALL OUTLETS IN BATHROOMS AND LAUNDRY ROOM SHALL BE GFCI

7.) SMOKE ALARMS SHALL BE IN ALL SLEEPING AREAS. SHALL BE INTERCONNECTED, SHALL BE WITHIN 1' TO 3' OF PEAK & SHALL BE 3' FROM THE SUPPLY OR RETURN AIR- STREAM & EQUIPPED W/ A BATTERY BACKUP. ALARMS MAY NOT BE CONNECTED WHERE ALARMS ARE WIRELESS & ALL ALARMS SOUND UPON ACTIVATION IAW FBCR R314.3 & R314.4. MODEL* TO BE USED ON THIS JOB TO BE:
BRK: SMOKE-9120B, C/O- SC9120B
KIDDE: SMOKE-21007581, C/O 21006377-N

8.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2020, 1TH ED. P2801.7


9.) ALL EQUIPMENT & APPLIANCES, INCLUDING WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS IT IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2020, 1TH ED.

10.)THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3

11.) ALL ELECTRICAL WORK TO BE DONE PER NFPA70-**NEC 2017**

12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN ACCORDANCE WITH NEC 250.53(A2)

12.) ALL DWELLING UNIT RECEPTACLE WILL BE IN ACCORDANCE WITH NFPA70-NEC2017 - ARTICLE 210-52

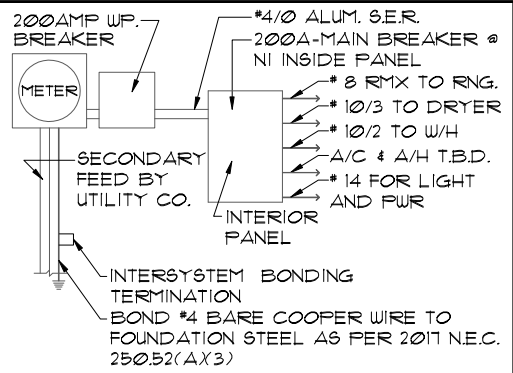

ELECTRICAL RISER DIAGRAM
NOTE:
N.T.S.
ELECTRICAL MATERIALS AND INSTALLATIONS SHALL COMPLY W/ APPLICABLE PROVISIONS OF THE NATIONAL ELEC. CODE 250.52(A)(1) TO (6), LOCAL CODES, AND THE LOCAL POWER COMPANY.

250.52(A)(3) Concrete-Encased Electrode.
Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

There are two types of concrete-encased electrodes: (1) steel reinforcing bars or rods which are not less than 1/2 inch in diameter and at least 20 ft. long, encased in 2 inches of concrete; (2) 20 ft. of bare copper conductor not smaller than No. 4 AWG encased in 2 inches of concrete.


The steel reinforcing rods must be in a location that is in direct contact with the earth. The reinforcing rods can be connected with tie wires, and a single length of rod can be used as the concrete-encased electrode. The reinforcing rods cannot be coated with non-conductive material.

Section 250.50 requires a concrete-encased electrode to be connected to the grounding electrode system if it is present. Several states have modified this requirement to say a concrete-encased electrode must be used as a grounding electrode only if it is available. In those jurisdictions, if the footings or foundations have been poured before the electrical contractor arrives at the site, and a reinforcing rod is not available for use as a grounding electrode, then a grounding connection to the reinforcing rod is not required.

NOTE: IF MORE THAN 12 SMOKE ALARMS OR CARBON MONOXIDE ALARM COMBINATION ARE INSTALLED IN THE HOME CRIME PREVENTION WILL PULL A SEPARATE FIRE PERMIT AND THE SYSTEM WILL BE MONITORED

ELECTRICAL LEGEND		
ⓘ	SINGLE POLE SWITCH	OUTLET, TV/CABLE
ⓘ	THREE WAY SWITCH	OUTLET, PHONE
	OUTLET 110-115	INTERCOM
OUT. 110-115, SPLIT WIRED		CHIMES
OUT. 110-115, W/ USB		SMOKE DETECTOR
OUT. 110-115, CLG. MOUNT.		CARBON MONOXIDE
OUT. 110-115, FLR. MOUNT.		PUSH BUTTON
SFCL. PURPOSE 220-240		EXHAUST FAN
LIGHT FIXT., CLG. MTD.		EX. FAN/LIGHT COMBO
LIGHT FIXT., WALL MTD.		DISPOSAL
LED LIGHT FIXT., RECESSED		ELECTRICAL PANEL
LIGHT FIXT., REC. ADJUST.		CEILING FAN, PREWIRE
LIGHT FIXT., PULL CHAIN		CEILING FAN, INSTALL
LED- LIGHT FIXT.,FLUORESCENT		ELECT. JUNCTION BOX
LIGHT FIXT., EXT. FLOODS		THERMOSTAT
EXIT LIGHT FIXT., EMERG. EXIT		DISCONNECT SWITCH
LIGHT FIXT., EXIT/BACKUP		ELEC. POWER METER

UPPER ELECTRICAL PLAN "OPT. LED"
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

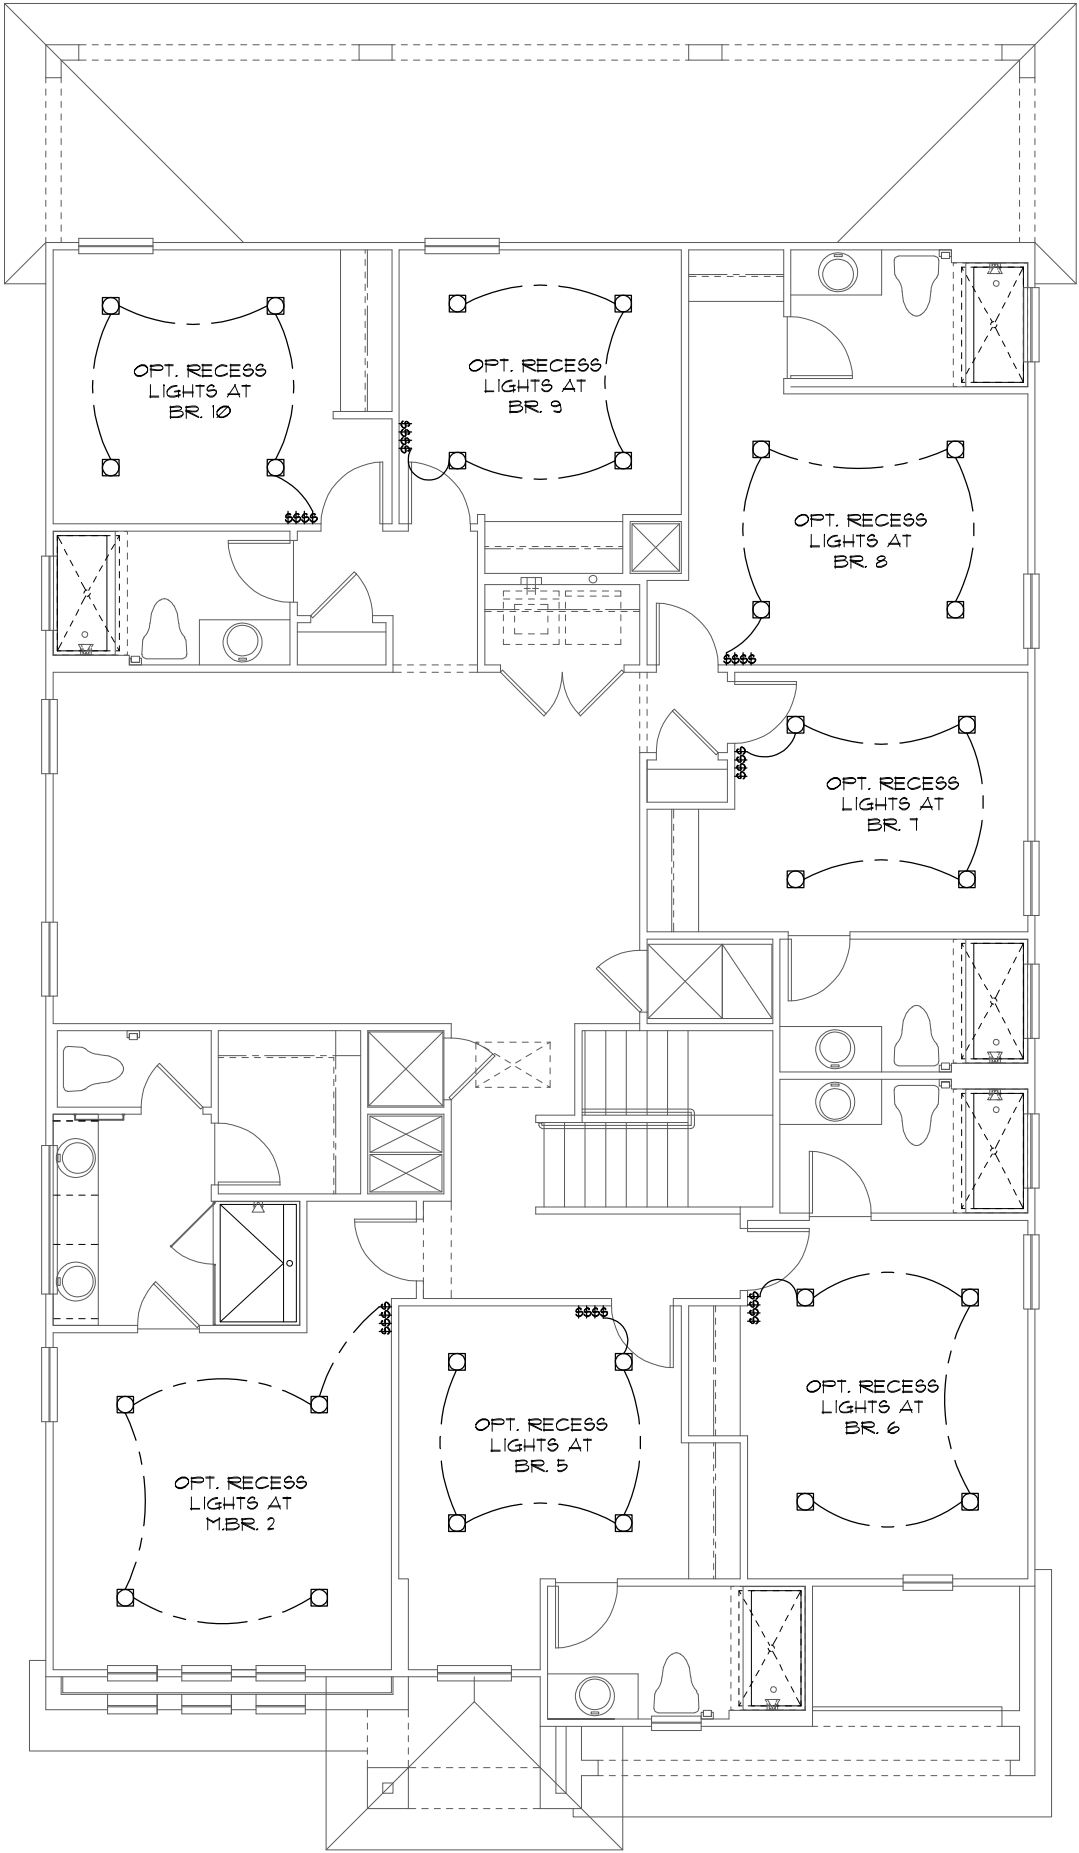

LED RECESS OPTION
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

PARADISO GRANDE

REEF

PARADISO GRANDE

4232

DATE 04-09-21

SCALE AS NOTED

DRAWN RDC

JOB 4232

SHEET 10.0 OF SHEETS

ELECTRICAL PLAN

Park Square HOMES

A DIVISION OF PARK SQUARE ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

Engineering By:
DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

REVISIONS BY

$1/8'' = 1' - 0''$ (11X17) $1/4'' = 1' - 0''$ (22X34)

MECHANICAL/GENERAL NOTES
PER 1TH ED. 2020 FLA BLD. CODE-RESIDENTIAL

1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION 610.1 ABC.1

2.)APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION, SERVICE, REPAIR AND REPLACEMENT WITHOUT REMOVING PERMANENT CONSTRUCTION.

A) CHAPTER 13 OF THE FBC-R 2020 1TH SECTION M1305.1

3.) AIR CONDITIONING SYSTEM SHALL BE COMPLETELY BALANCED. ALL ROOMS ISOLATED FROM THE RETURN AIR SHALL BE PROVIDED WITH MEANS TO COMPLY WITH SECTION M1602 OF THE FBCR CODE 2020 1TH EDITION.

4.) 1AW NEC 2017- 210.12- ALL 15A OR 20A, 120V BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES IN THE FOLLOWING LOCATIONS REQUIRE AFCI PROTECTION- KITCHEN, FAMILY RMS, DINING RMS, LIVING RMS, PARLORS, LIBRARIES, BEDROOMS, DENS, CLOSETS, SUNROOMS, RECREATION RMS, HALLWAYS OR SIMILAR AREAS SHALL BE PROTECTED BY A LISTED AFCI DEVICE OF THE COMBINATION TYPE.

5.) 1AW NEC 2017- 406.12, ALL 15A AND 20A, 125V RECEPTACLES SHALL BE INSTALLED AS TAMPER RESISTANT.

6.) ALL OUTLETS IN BATHROOMS AND LAUNDRY ROOM SHALL BE GFCI

7.) SMOKE ALARMS SHALL BE IN ALL SLEEPING AREAS. SHALL BE INTERCONNECTED, SHALL BE WITHIN 1' TO 3' OF PEAK & SHALL BE 3' FROM THE SUPPLY OR RETURN AIR- STREAM & EQUIPPED W/ A BATTERY BACKUP. ALARMS MAY NOT BE CONNECTED WHERE ALARMS ARE WIRELESS & ALL ALARMS SOUND UPON ACTIVATION 1AW FBCR R314.3 & R314.4.

8.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. 1AW FBCR 2020, 1TH ED. P2801.7


9.) ALL EQUIPMENT & APPLIANCES, INCLUDING WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS IT IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. 1AW FBCR 2020, 1TH ED.

10.)THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3

11.) ALL ELECTRICAL WORK TO BE DONE PER NFPA70-**NEC 2017**

12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN ACCORDANCE WITH NEC 250.53(A)(2)

12.) ALL DWELLING UNIT RECEPTACLE WILL BE IN ACCORDANCE WITH NFPA70-NEC2017 - ARTICLE 210-52

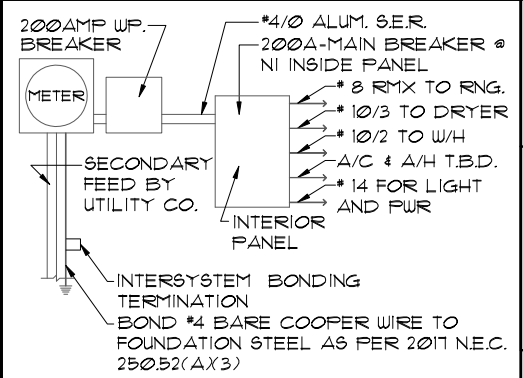

ELECTRICAL RISER DIAGRAM

NOTE: NTS.
ELECTRICAL MATERIALS AND INSTALLATIONS SHALL COMPLY W/ APPLICABLE PROVISIONS OF THE NATIONAL ELEC. CODE 250.52(A)(1) TO (6), LOCAL CODES, AND THE LOCAL POWER COMPANY.

250.52(A)(3) Concrete-Encased Electrode.
Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

There are two types of concrete-encased electrodes: (1) steel reinforcing bars or rods which are not less than 1/2 inch in diameter and at least 20 ft. long, encased in 2 inches of concrete; (2) 20 ft. of bare copper conductor not smaller than No. 4 AWG encased in 2 inches of concrete.


The steel reinforcing rods must be in a location that is in direct contact with the earth. The reinforcing rods can be connected with tie wires, and a single length of rod can be used as the concrete-encased electrode. The reinforcing rods cannot be coated with non-conductive material.

Section 250.50 requires a concrete-encased electrode to be connected to the grounding electrode system if it is present. Several states have modified this requirement to say a concrete-encased electrode must be used as a grounding electrode only if it is available. In those jurisdictions, if the footings or foundations have been poured before the electrical contractor arrives at the site, and a reinforcing rod is not available for use as a grounding electrode, then a grounding connection to the reinforcing rod is not required.


NOTE: THE FIRE ALARM SYSTEM WILL CONSIST OF (1) FIRE ALARM CONTROL PANEL - 32 ZONE FL-FACP-LTEVS WITH (1) SMOKE DETECTOR OVER FIRE ALARM CONTROL PANEL.
ALL INSTALLATION FOR THIS MACURCO CARBON MONOXIDE DETECTOR CM-EI&CONVENTIONAL SMOKE DETECTION FIREWOLF FW2-S SHALL BE INSTALLED PURSUANT THE MANUFACTURE REQUIREMENTS AND NEC 2017 CODE REQUIREMENTS

NOTE : SMOKE DETECTORS AND CARBON MONOXIDE DETECTORS WILL BE INSTALLED PER FBC RESIDENTIAL. THE SMOKE DETECTORS WILL BE INTERCONNECTED AND SOUND OFF UPON AN ALARM. THE CO DETECTORS WILL SOUND OFF WHEN IN ALARM.

FIRE ALARM CONTRACTOR:
CPSS - CRIME PREVENTION SECURITY SYSTEM
4701 SW 34 STREET - GAINESVILLE - FL-32608
LIC. #EF20001021
PHONE : 352-376-1499
TOLL FREE : 800 - 949-1799

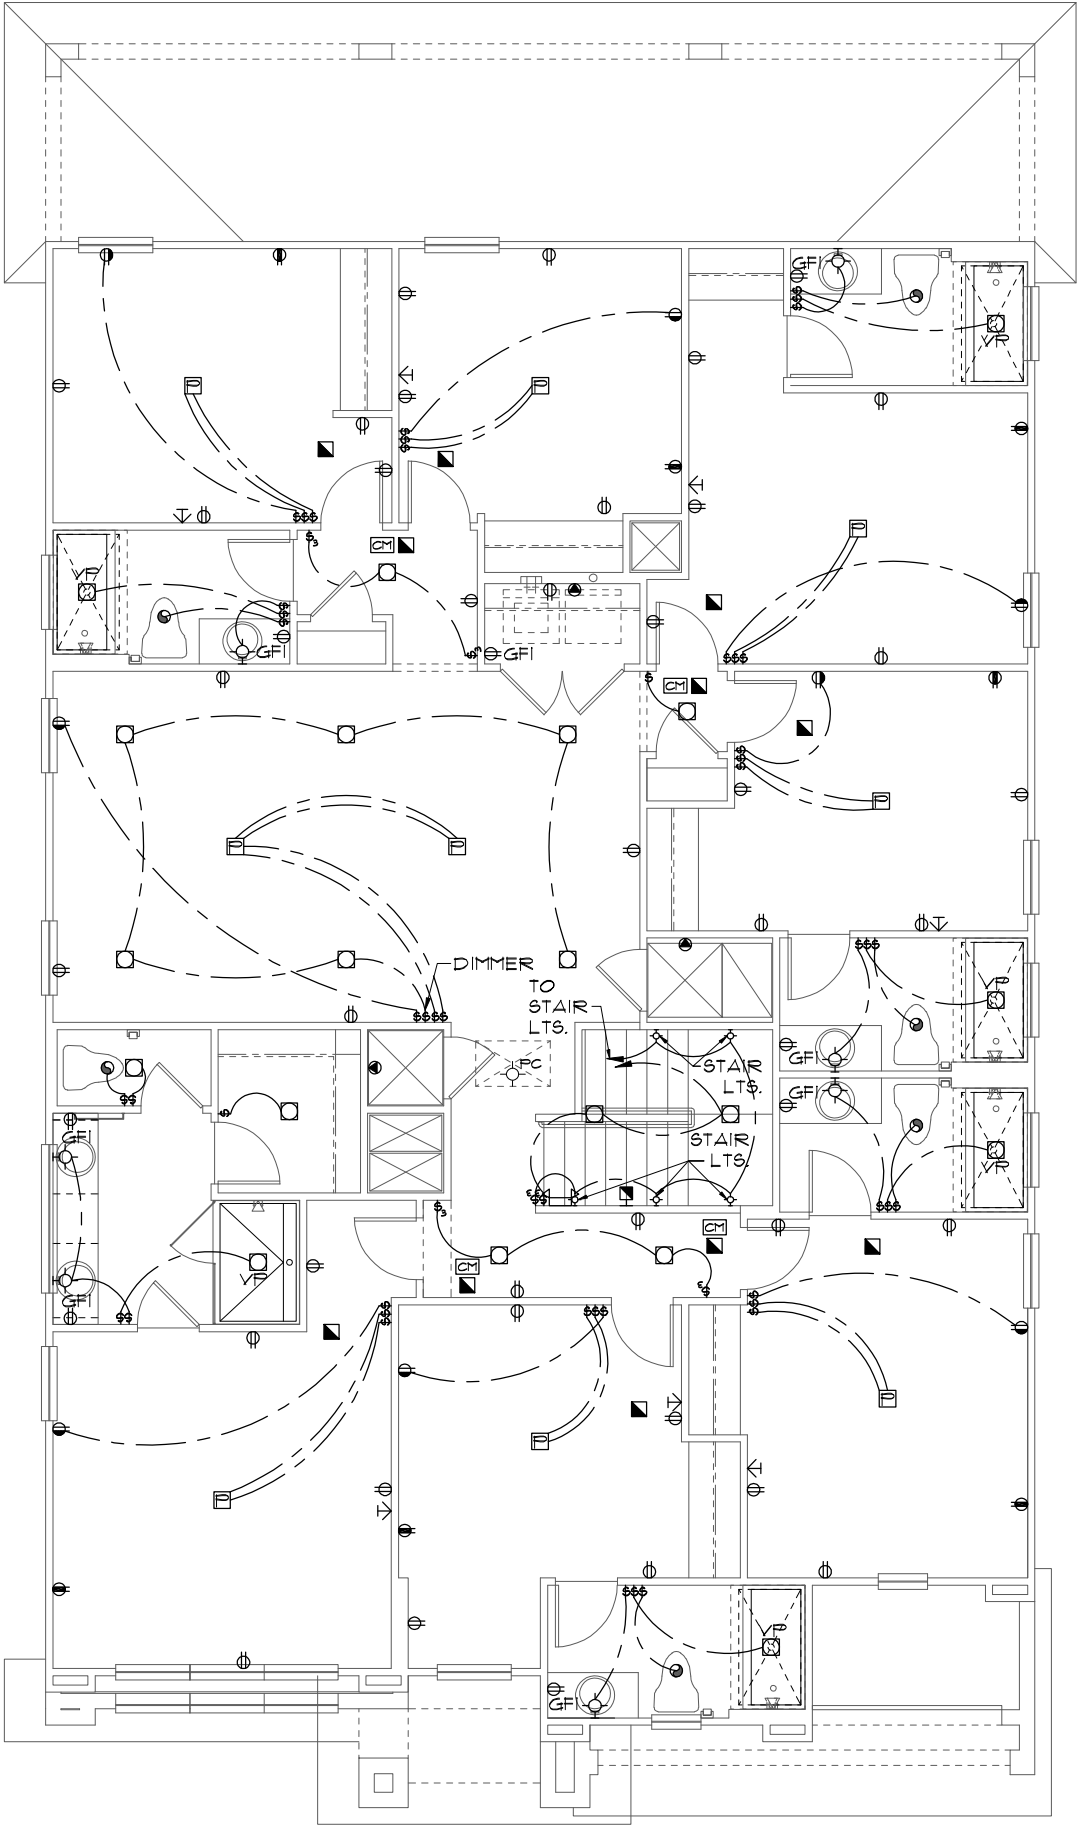

ELECTRICAL LEGEND			
ⓘ	SINGLE POLE SWITCH	⬅	OUTLET, TV/CABLE
ⓘ	THREE WAY SWITCH	⬅	OUTLET, PHONE
ⓘ	OUTLET 110-115	⬅	INTERCOM
ⓘ	OUT. 110-115, SPLIT WIRED	⬅	CHIMES
ⓘ	OUT. 110-115, W/ USB	⬅	SMOKE DETECTOR/SMOKE ALARM W/INTEGRATED SOUNDER BASE
ⓘ	OUT. 110-115, CLG. MOUNT.	⬅	CARBON MONOXIDE
ⓘ	OUT. 110-115, FLR. MOUNT.	⬅	PUSH BUTTON
ⓘ	SFCL. PURPOSE 220-240	⬅	EXHAUST FAN
ⓘ	LIGHT FIXT., CLG. MTD.	⬅	EX. FAN/LIGHT COMBO
ⓘ	LIGHT FIXT., WALL MTD.	⬅	DISPOSAL
ⓘ	LED LIGHT FIXT., RECESSED	⬅	ELECTRICAL PANEL
ⓘ	LIGHT FIXT., REC. ADJUST.	⬅	CEILING FAN, PREWIRE
ⓘ	LIGHT FIXT., PULL CHAIN	⬅	CEILING FAN, INSTALL
ⓘ	LED LIGHT FIXT.,FLUORESCENT	⬅	ELECT. JUNCTION BOX
ⓘ	LIGHT FIXT., EXT. FLOODS	⬅	THERMOSTAT
ⓘ	LIGHT FIXT., EMERG. EXIT	⬅	DISCONNECT SWITCH
ⓘ	LIGHT FIXT., EXIT/BACKUP	⬅	ELEC. POWER METER

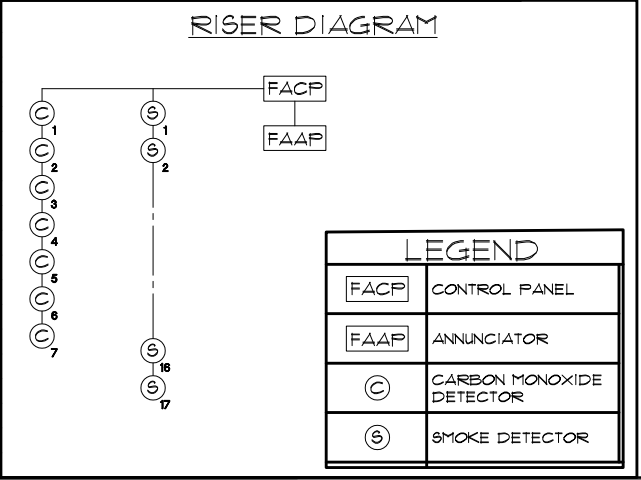

LEGEND	
FACP	CONTROL PANEL
FAAP	ANNUNCIATOR
Ⓢ	CARBON MONOXIDE DETECTOR
Ⓢ	SMOKE DETECTOR

UPPER ELECTRICAL PLAN "C"
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

LOT: 0000, PARADISO GRANDE

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

PARADISO GRANDE

Engineering By:
DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

A DIVISION OF PARK SQUARE ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

REEF

PARADISO GRANDE

4232

DATE 04-09-21

SCALE AS NOTED

DRAWN RDC

JOB 4232

SHEET 10C.0


OF SHEETS

NOTES

1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 11TH EDITION (2020) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC91 I.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. TILE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2020, 11TH EDITION R905.3.3. Underlayment materials required to comply with ASTM D226, D1970, D4869 and D6757 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R905.1.1. Underlayment shall be applied and attached in accordance with Table R905.1.1.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
 - O-HAGIN - 1" X 19" HOLE
9. TILE ROOF TO BE INSTALLED IAW FBCR 2020, 11TH EDITION ASTM C1492-R905.3.5

TRUSS LAYOUT "A"


1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

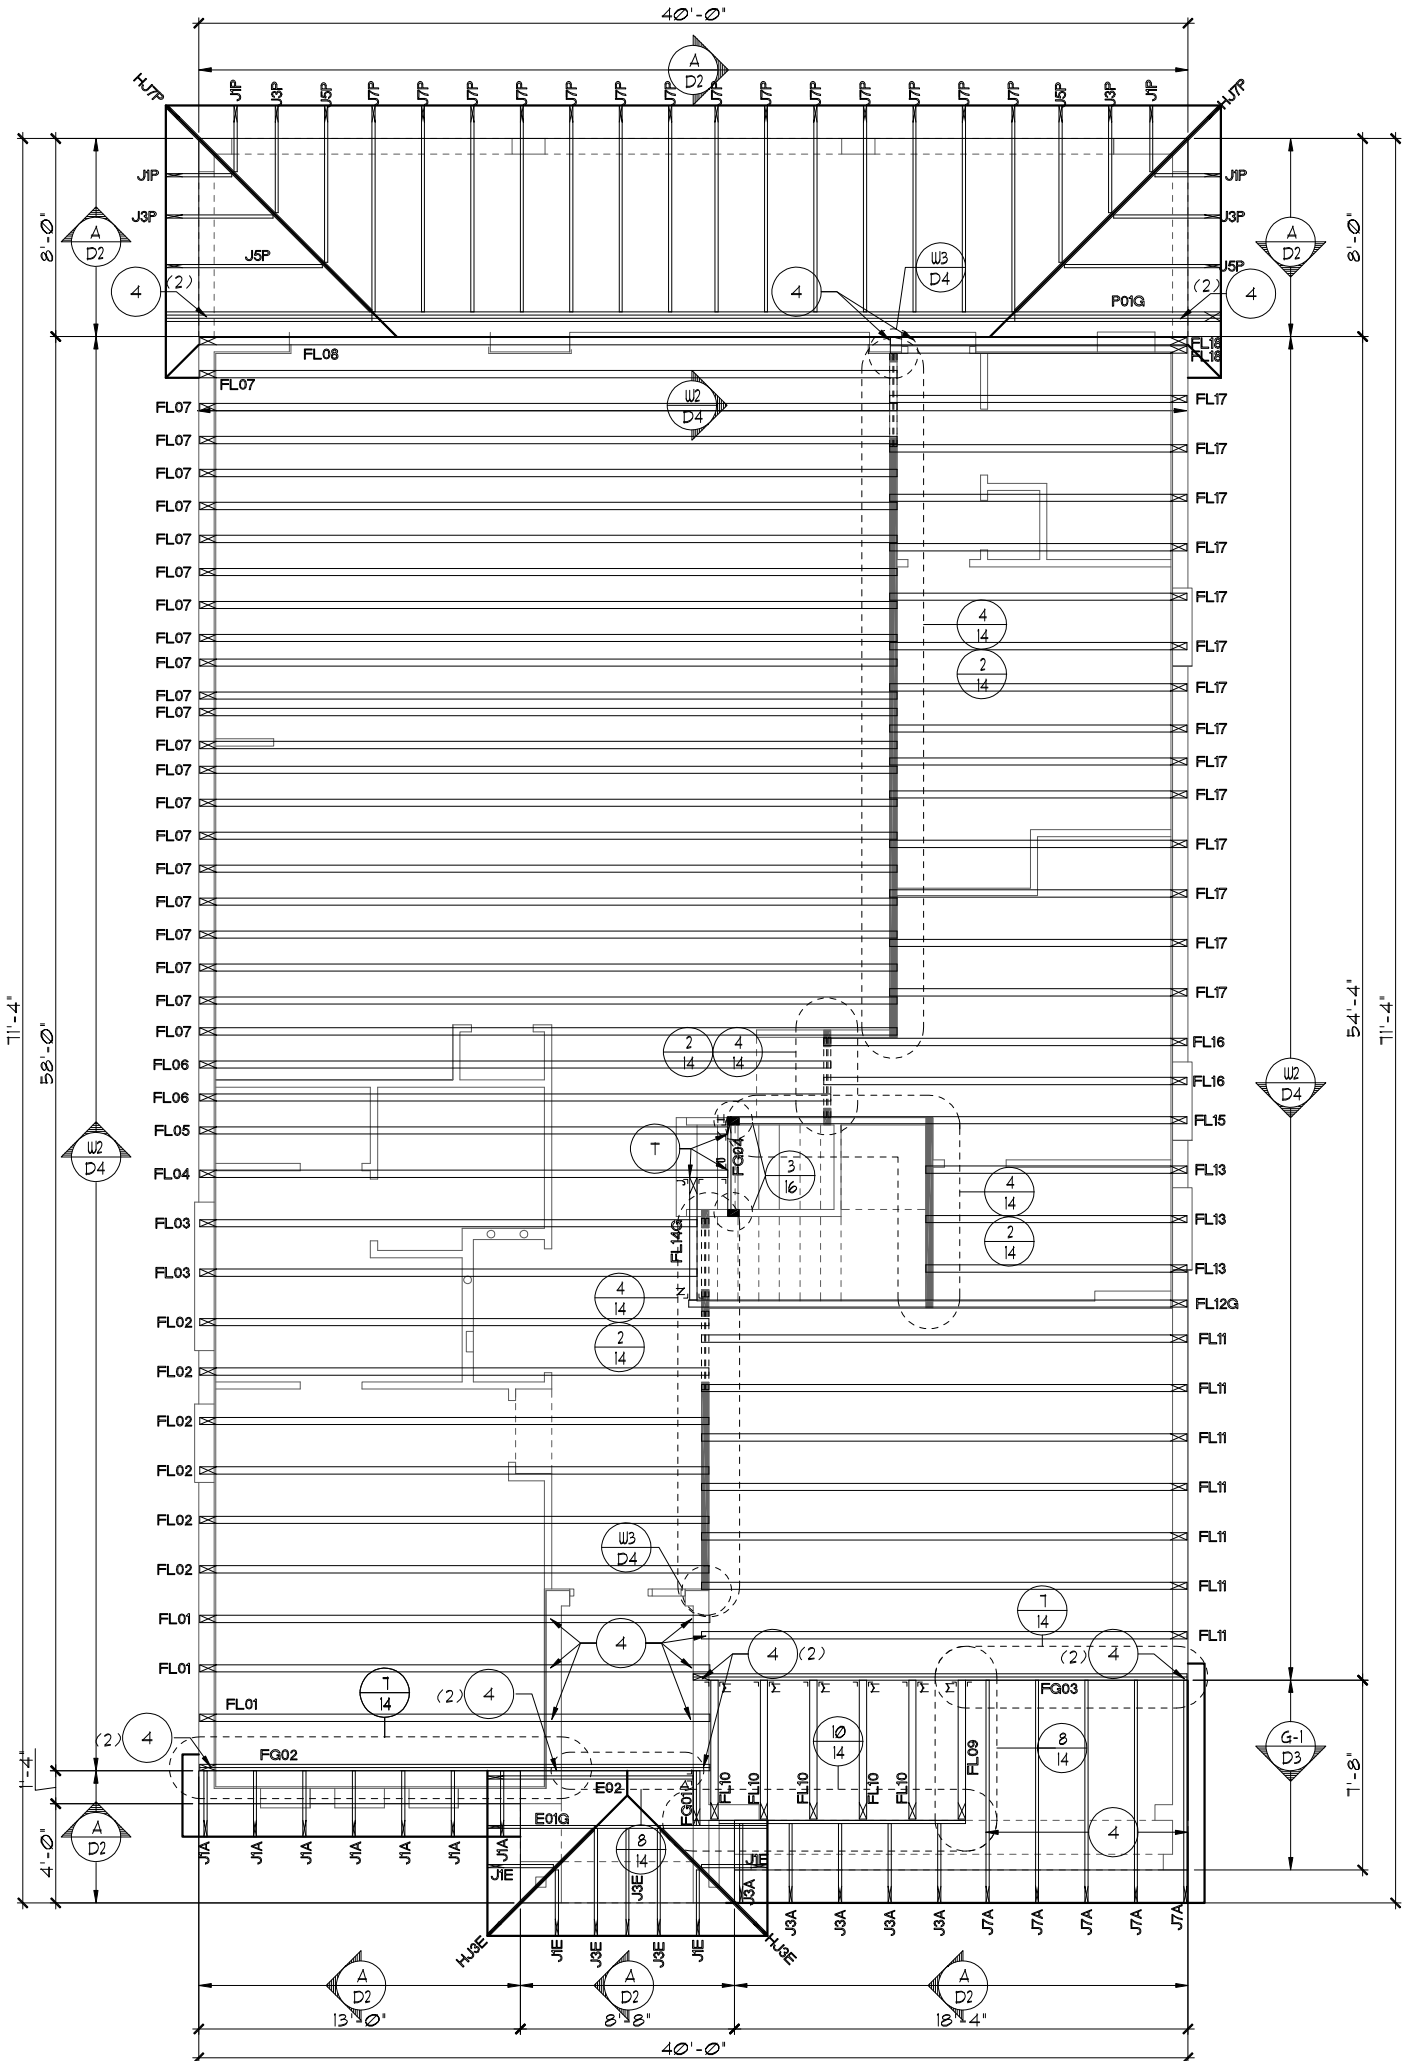

- NOTES**
1. TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
 2. TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
 3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 11TH EDITION (2020) FLORIDA RESIDENTIAL CODE.
 4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
 5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC61.1.
 6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
 7. TILE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2020, 11TH EDITION R305.3.3. Underlayment materials required to comply with ASTM D226, D1970, D4869 and D6757 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
 8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
 - O-HAGIN - 1' X 19" HOLE
 9. TILE ROOF TO BE INSTALLED IAW FBCR 2020, 11TH EDITION ASTM C1492-R305.3.5

TRUSS LAYOUT "A"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

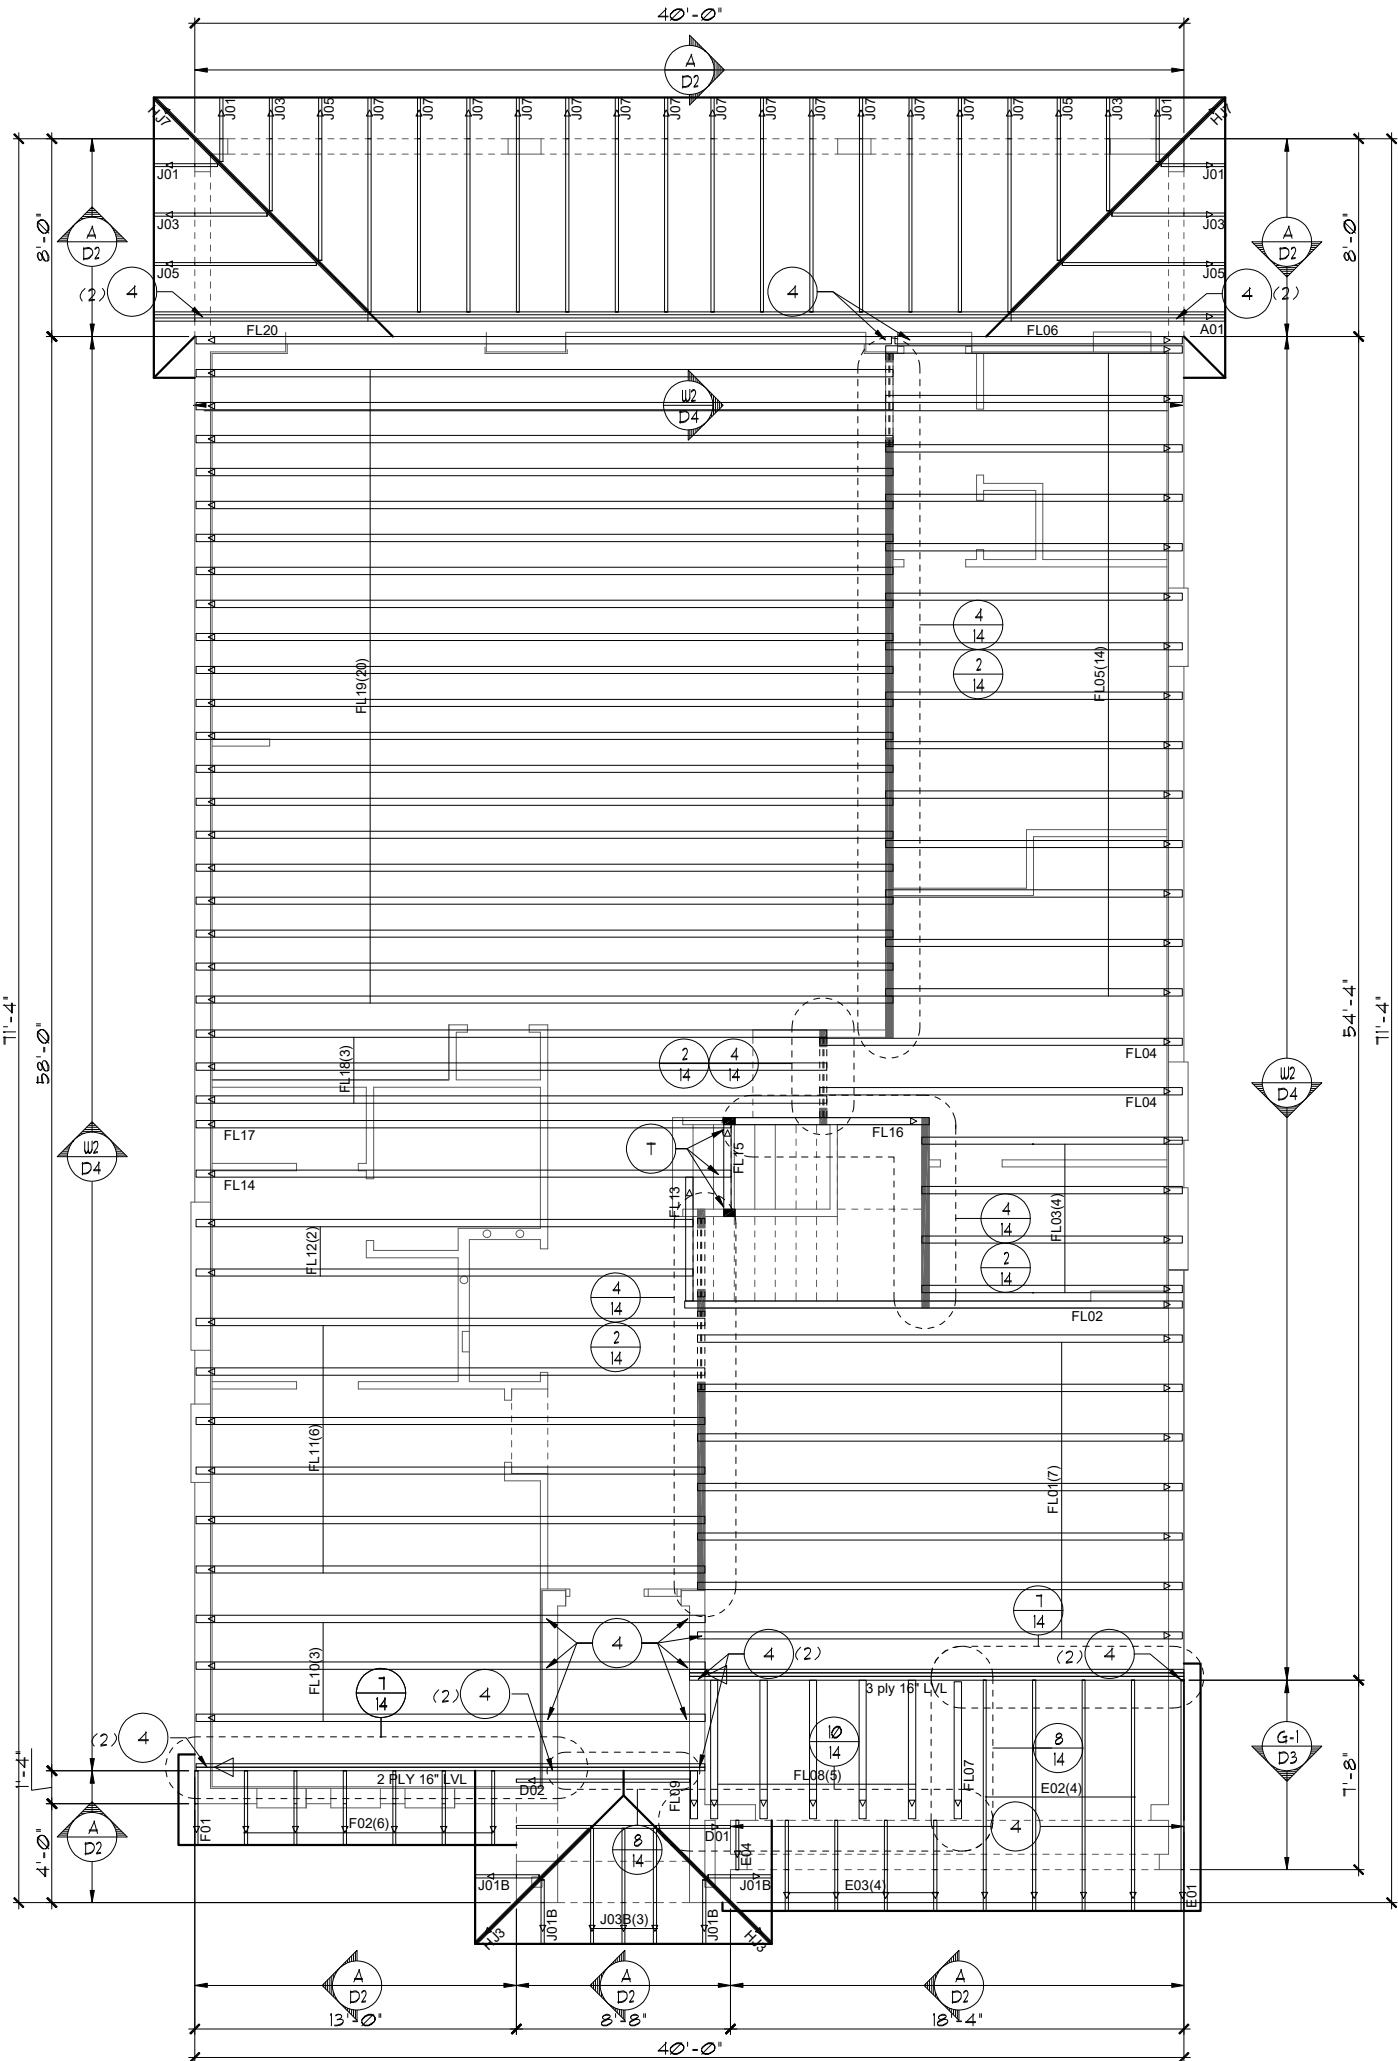

LOT: 0000, PARADISO GRANDE

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 11th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

PARADISO GRANDE

Engineering By:
DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

TRUSS LAYOUT

REFE

PARADISO GRANDE

4232

DATE 04-09-21

SCALE AS NOTED

DRAWN RDC

JOB 4232

SHEET 11A.0

OF SHEETS

Engineering By:
DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

A DIVISION OF PARK SQUARE ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000


Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

NOTES

1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 11TH EDITION (2020) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC91 I.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. TILE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2020, 11TH EDITION R905.3.3.
Underlayment materials required to comply with ASTM D226, D1970, D4869 and D6757 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R905.1.1. Underlayment shall be applied and attached in accordance with Table R905.1.1.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
• O-HAGIN - 1" X 19" HOLE
9. TILE ROOF TO BE INSTALLED IAW FBCR 2020, 11TH EDITION ASTM C1492-R905.3.5

TRUSS LAYOUT "B"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

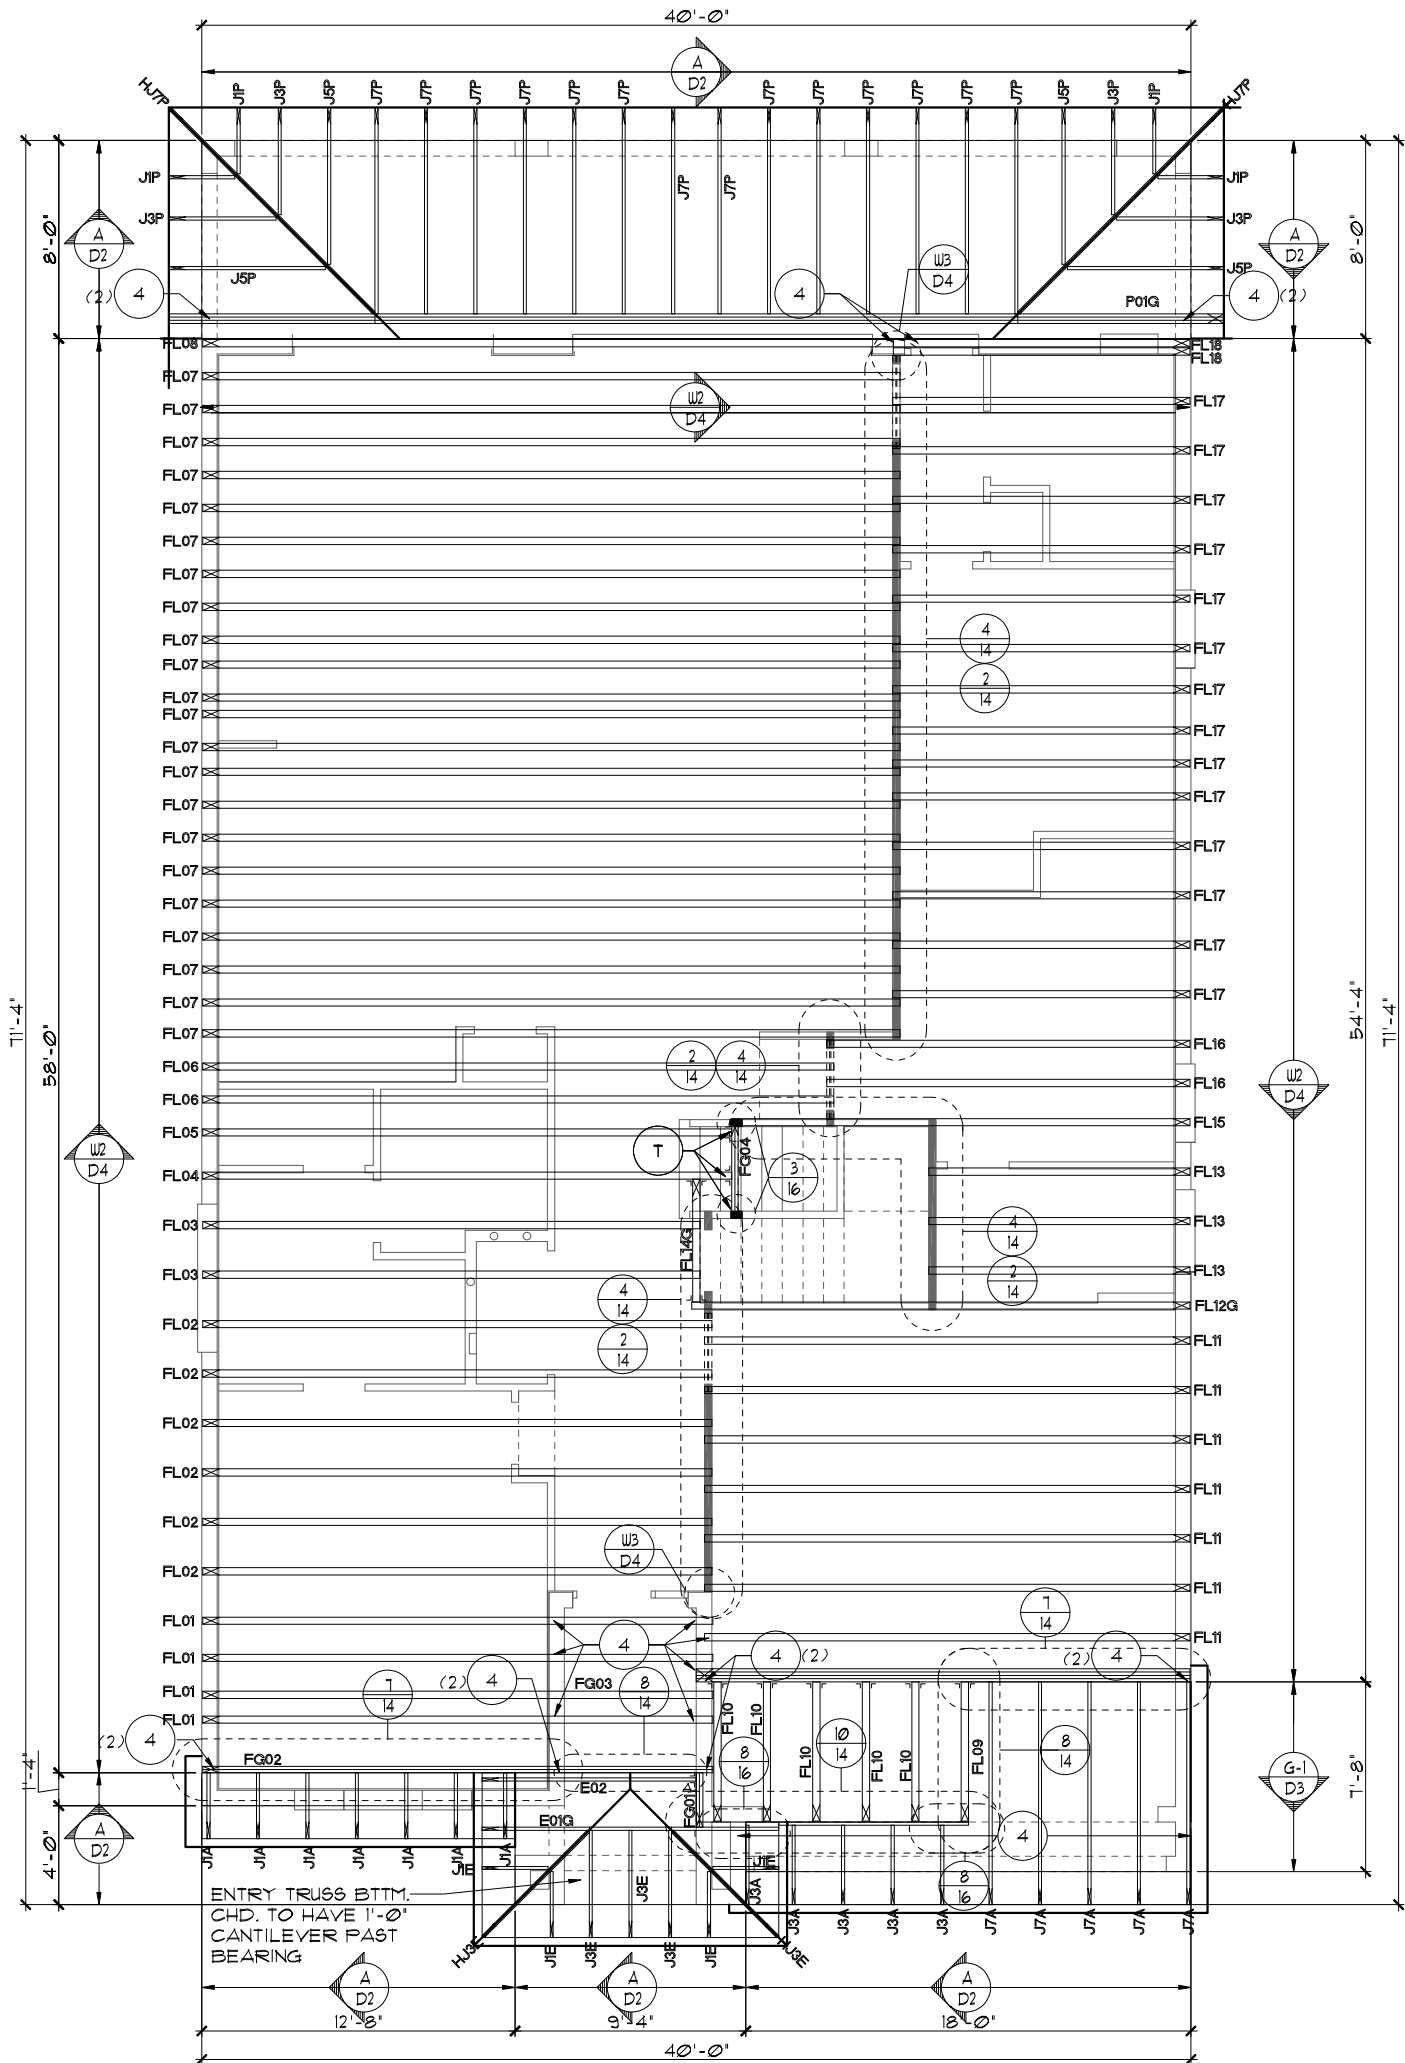


TRUSS LAYOUT "B"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

NOTES

1. TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 11TH EDITION (2020) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC61.1.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. TILE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2020, 11TH EDITION R305.3.3. Underlayment materials required to comply with ASTM D226, D1970, D4869 and D6757 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
 - O-HAGIN - 1' X 19" HOLE
9. TILE ROOF TO BE INSTALLED IAW FBCR 2020, 11TH EDITION ASTM C1492-R305.3.5

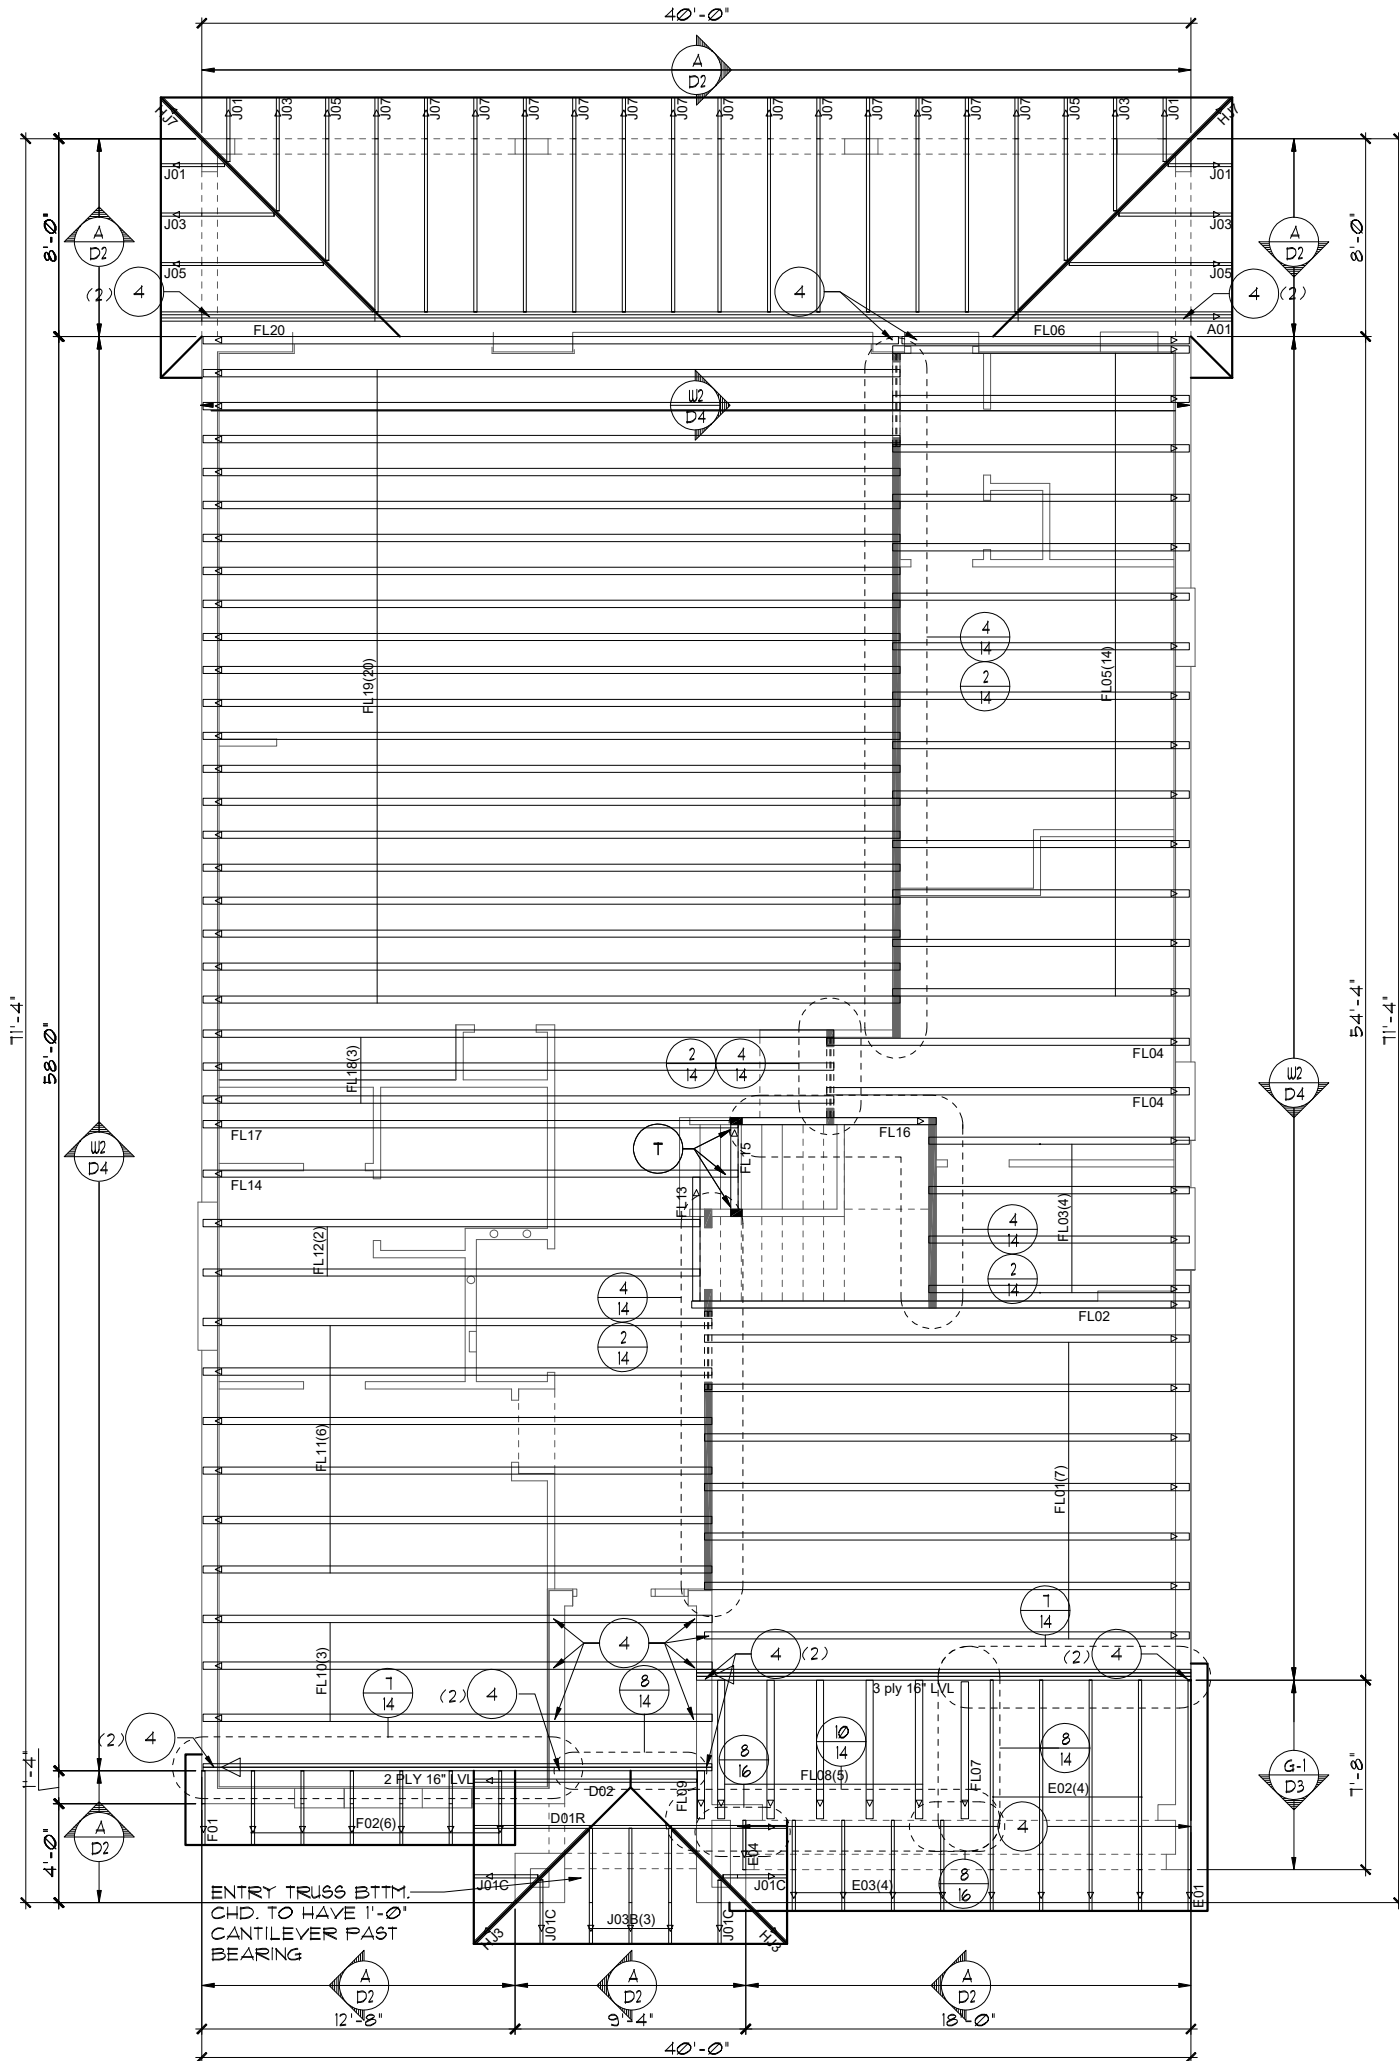

LOT: 0000, PARADISO GRANDE

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 11TH EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and design are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.


REVISIONS	BY
Engineering By: DBE and C MICHAEL A. THOMPSON PE 47509 PHONE 407-721-2292	
A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32811 Phone: (407) 529 - 3000	
TRUSS LAYOUT	
REFEEL	PARADISO GRANDE
4232	DATE 04-09-21
SCALE AS NOTED	DRAWN RDC
JOB 4232	SHEET 11B.0
OF SHEETS	

NOTES

1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 11TH EDITION (2020) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC91 I.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. TILE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2020, 11TH EDITION R905.3.3.
Underlayment materials required to comply with ASTM D226, D1970, D4869 and D6757 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R905.1.1. Underlayment shall be applied and attached in accordance with Table R905.1.1.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
• O-HAGIN - 1" X 19" HOLE
9. TILE ROOF TO BE INSTALLED IAW FBCR 2020, 11TH EDITION ASTM C1492-R905.3.5

TRUSS LAYOUT "C"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

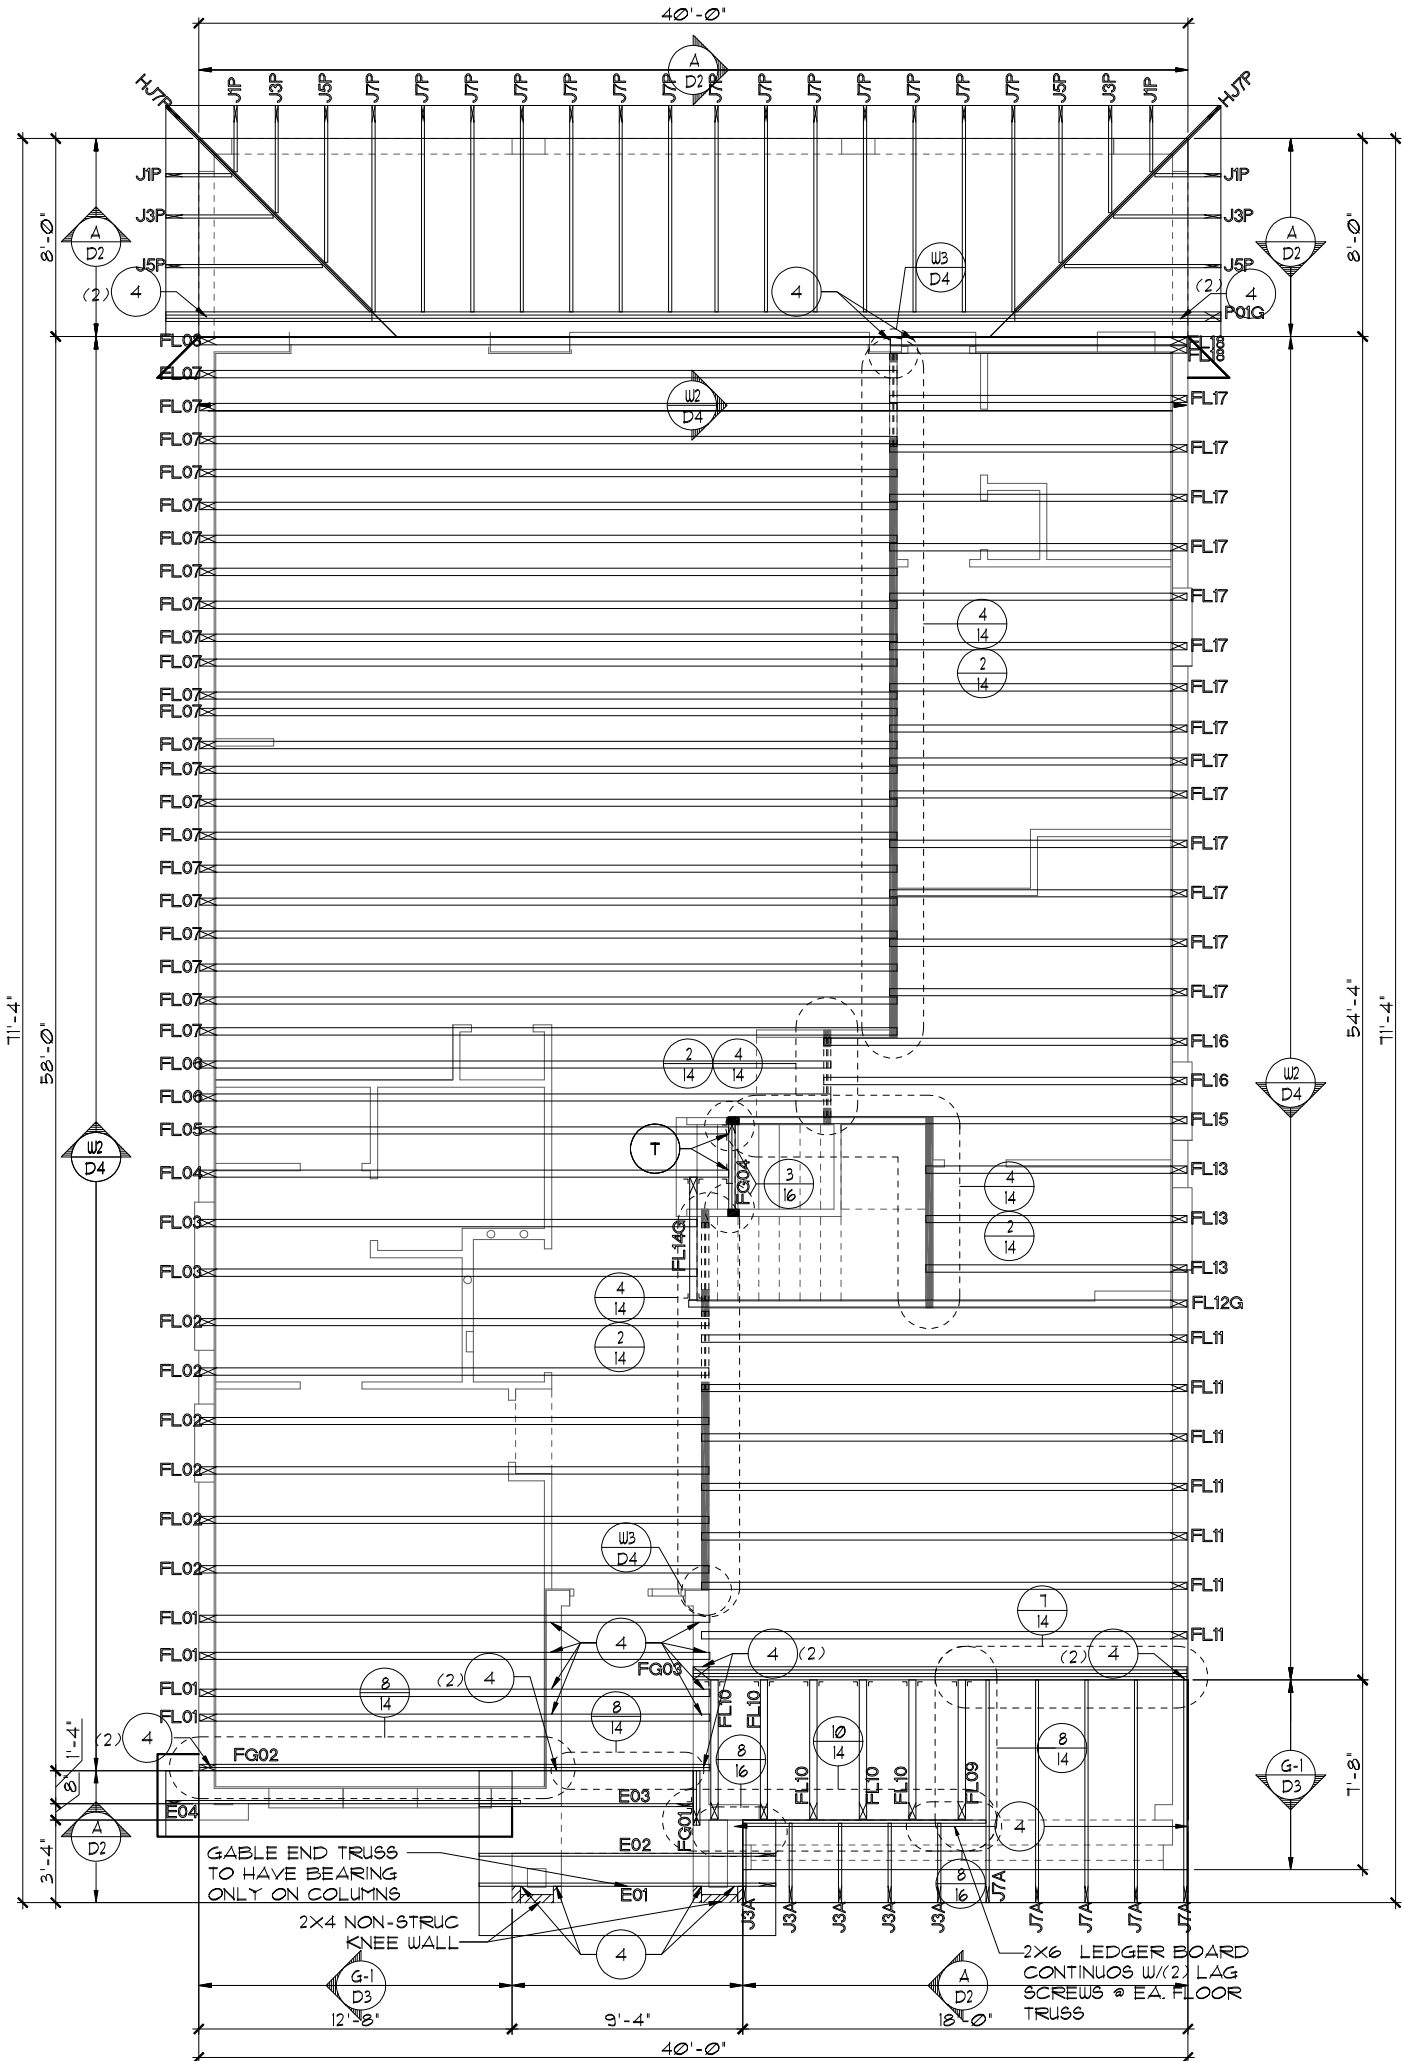

PARADISO GRANDE

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 11TH EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

Copyright 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and design are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

Engineering By
DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

A DIVISION OF PARK SQUARE
ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

Park Square
HOMES

TRUSS LAYOUT

REEF

4232

DATE 04-09-21

SCALE AS NOTED

DRAWN RDC


JOB 4232

SHEET

11C.0

OF SHEETS

1. TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 7TH EDITION (2020) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS, IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC91 I.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. TILE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2020, 7TH EDITION R305.3.3.
Underlayment materials required to comply with ASTM D226, D1970, D4869 and D6751 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.I. Underlayment shall be applied and attached in accordance with Table R305.1.I.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
 - O-HAGIN - 1" X 19" HOLE
9. TILE ROOF TO BE INSTALLED IAW FBCR 2020, 7TH EDITION
ASTM C1432-R305.3.5

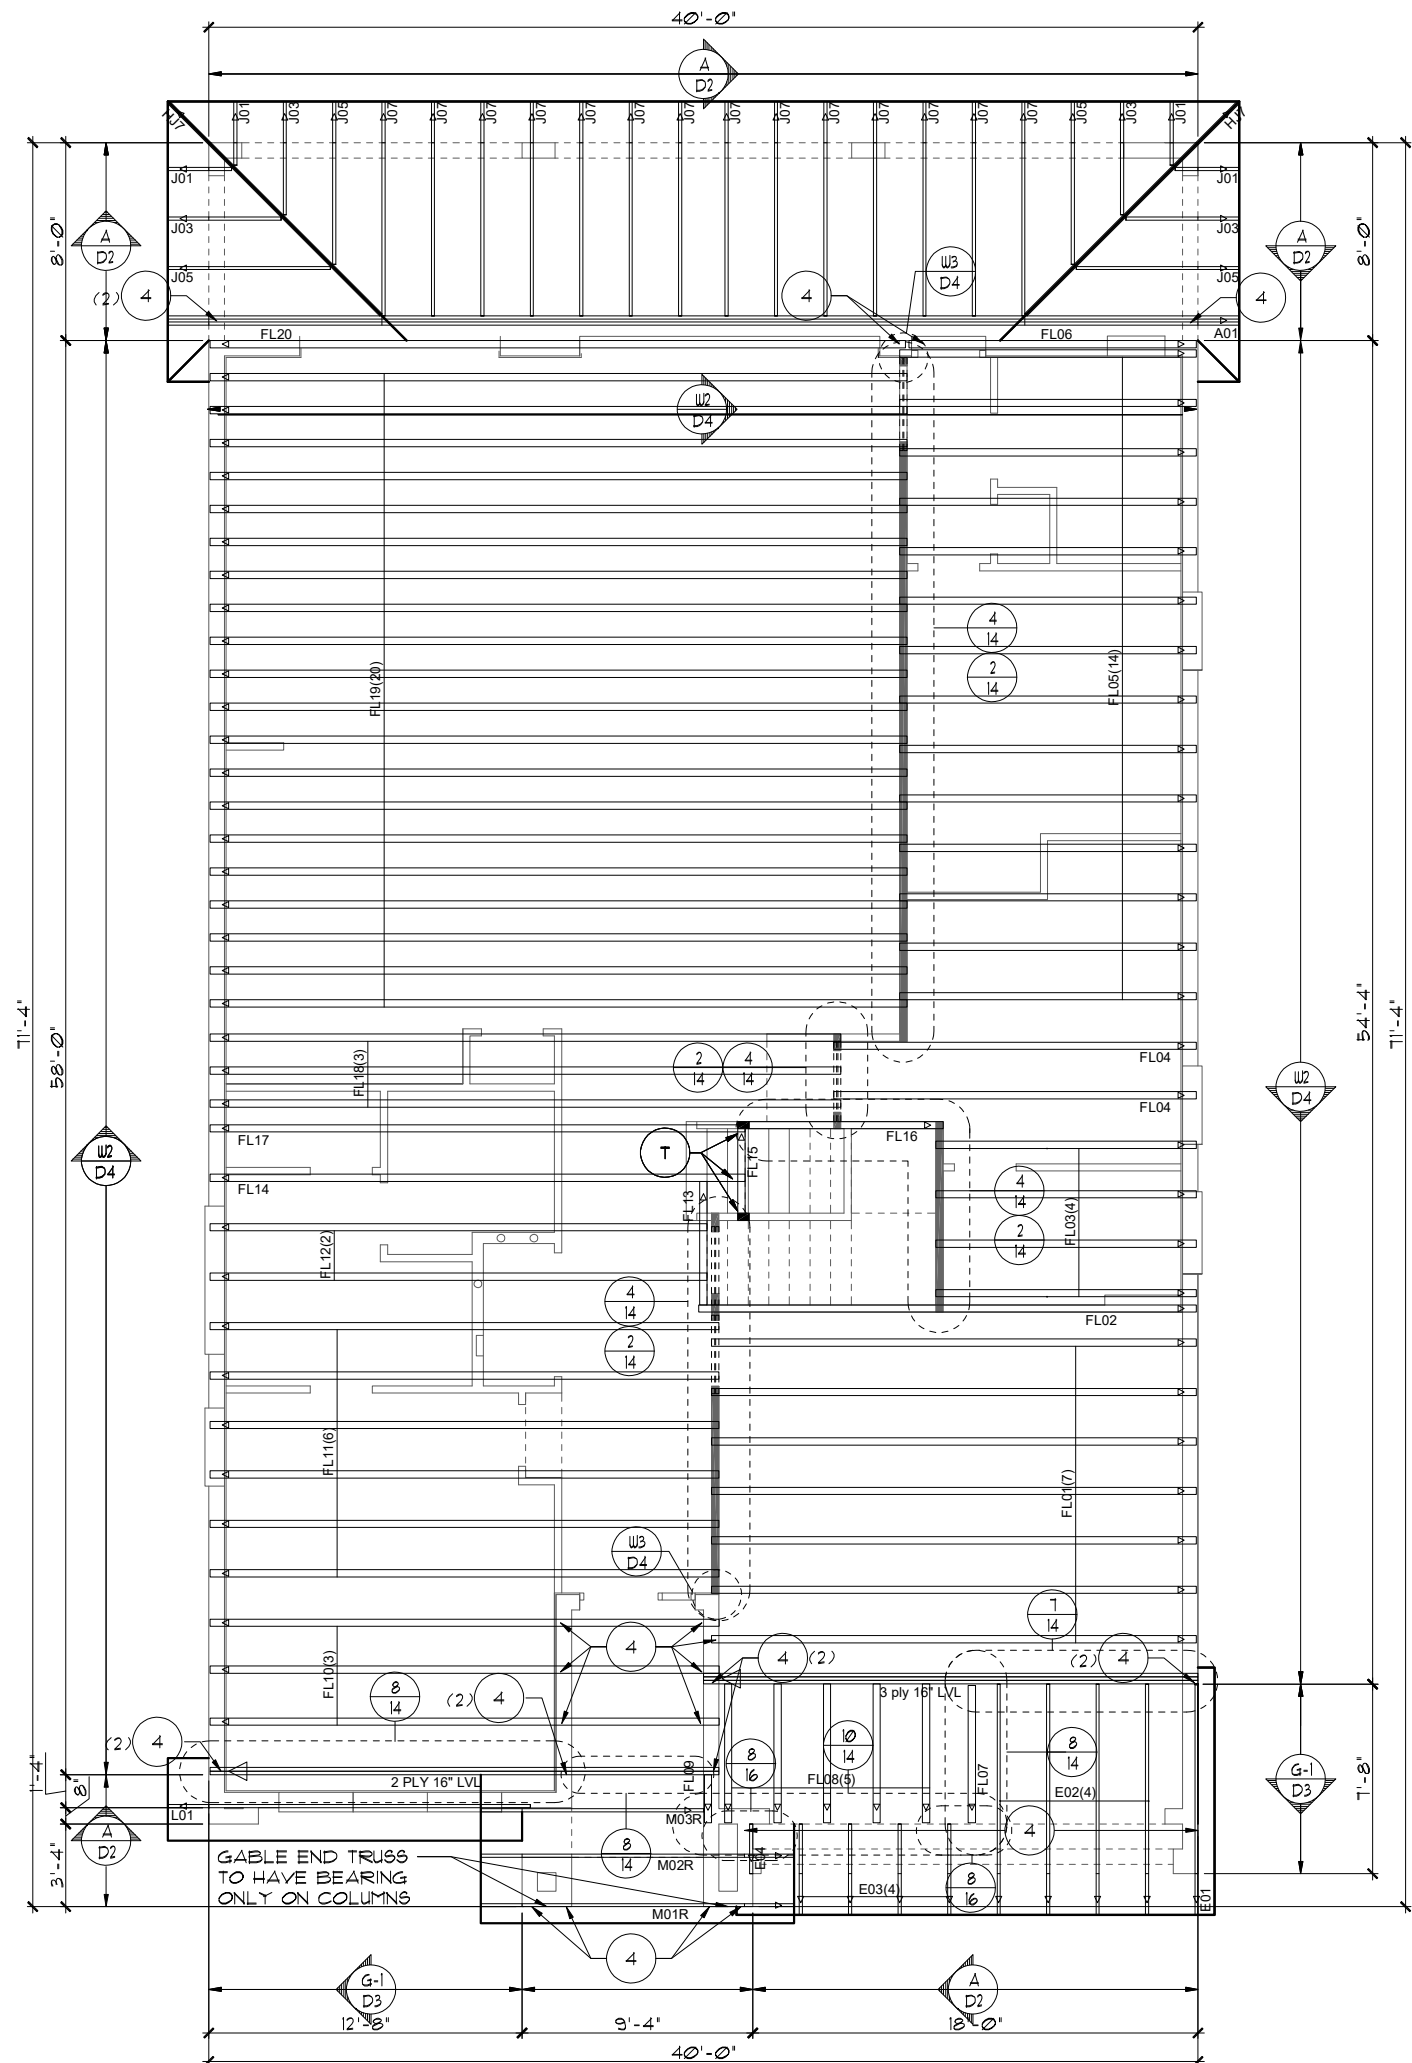

$$1/8'' = 1' - \emptyset'' \quad (11 \times 17) \quad 1/4'' = 1' - \emptyset'' \quad (22 \times 34)$$

OF SHEETS

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1TH EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

UPPER PORTION PERCENTAGE: 49%
LOWER PORTION PERCENTAGE: 51%

1. TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 1TH EDITION (2020) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC91 I.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. TILE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2020, 7TH EDITION R305.3.3.
Underlayment materials required to comply with ASTM D226, D1970, D4869 and D6757 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
 - O-HAGIN - 1" X 19" HOLE
9. TILE ROOF TO BE INSTALLED IAW FBCR 2020, 7TH EDITION ASTM C1432-R305.3.5


$$1/8'' = 1' - \emptyset' \quad (11 \times 17) \quad 1/4'' = 1' - \emptyset'' \quad (22 \times 34)$$

12A.0
OF SHEET

ATTIC VENTILATION CALCULATIONS

PER FBC2020 1TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/50 OF VENTED SPACE:

TOTAL VENTED SPACE: $\frac{2,387\text{S.F.}}{300} = \underline{7.96\text{S.F.}}$ NET FREE REQUIRED

UPPER PORTION VENTILATION TOTAL: **3.88S.F.**
PROVIDED W/OFF RIDGE VENTS: **4** VENTS @ **979S.F.** /VENT.
(TILE: O'HAGIN MODEL "S", SHINGLE: LOMANCO T10-D OR MILLENNIUM METAL)
LOWER PORTION VENTILATION TOTAL: **17.4S.F.**
PROVIDED W/OFFITS @ EAVE: **200L.F.** @ **0.087SF** VENTING/L.F.


UPPER PORTION PERCENTAGE: **49%**
LOWER PORTION PERCENTAGE: **51%**

NOTES

1. TYPICAL ROOF GABLE OVERHANG TO BE **8"** UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE **20"** UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 1TH EDITION (2020) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC91.1.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2020, 1TH EDITION R305.1.1. - Underlayment materials required to comply with ASTM D226, D1910, D4869 and D6151 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
 - LOMANCO : (2) 9 1/4" DIA. CIRCLES
 - MILLENNIUM METAL : 2 1/2" X 46" HOLE

TRUSS LAYOUT "A"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

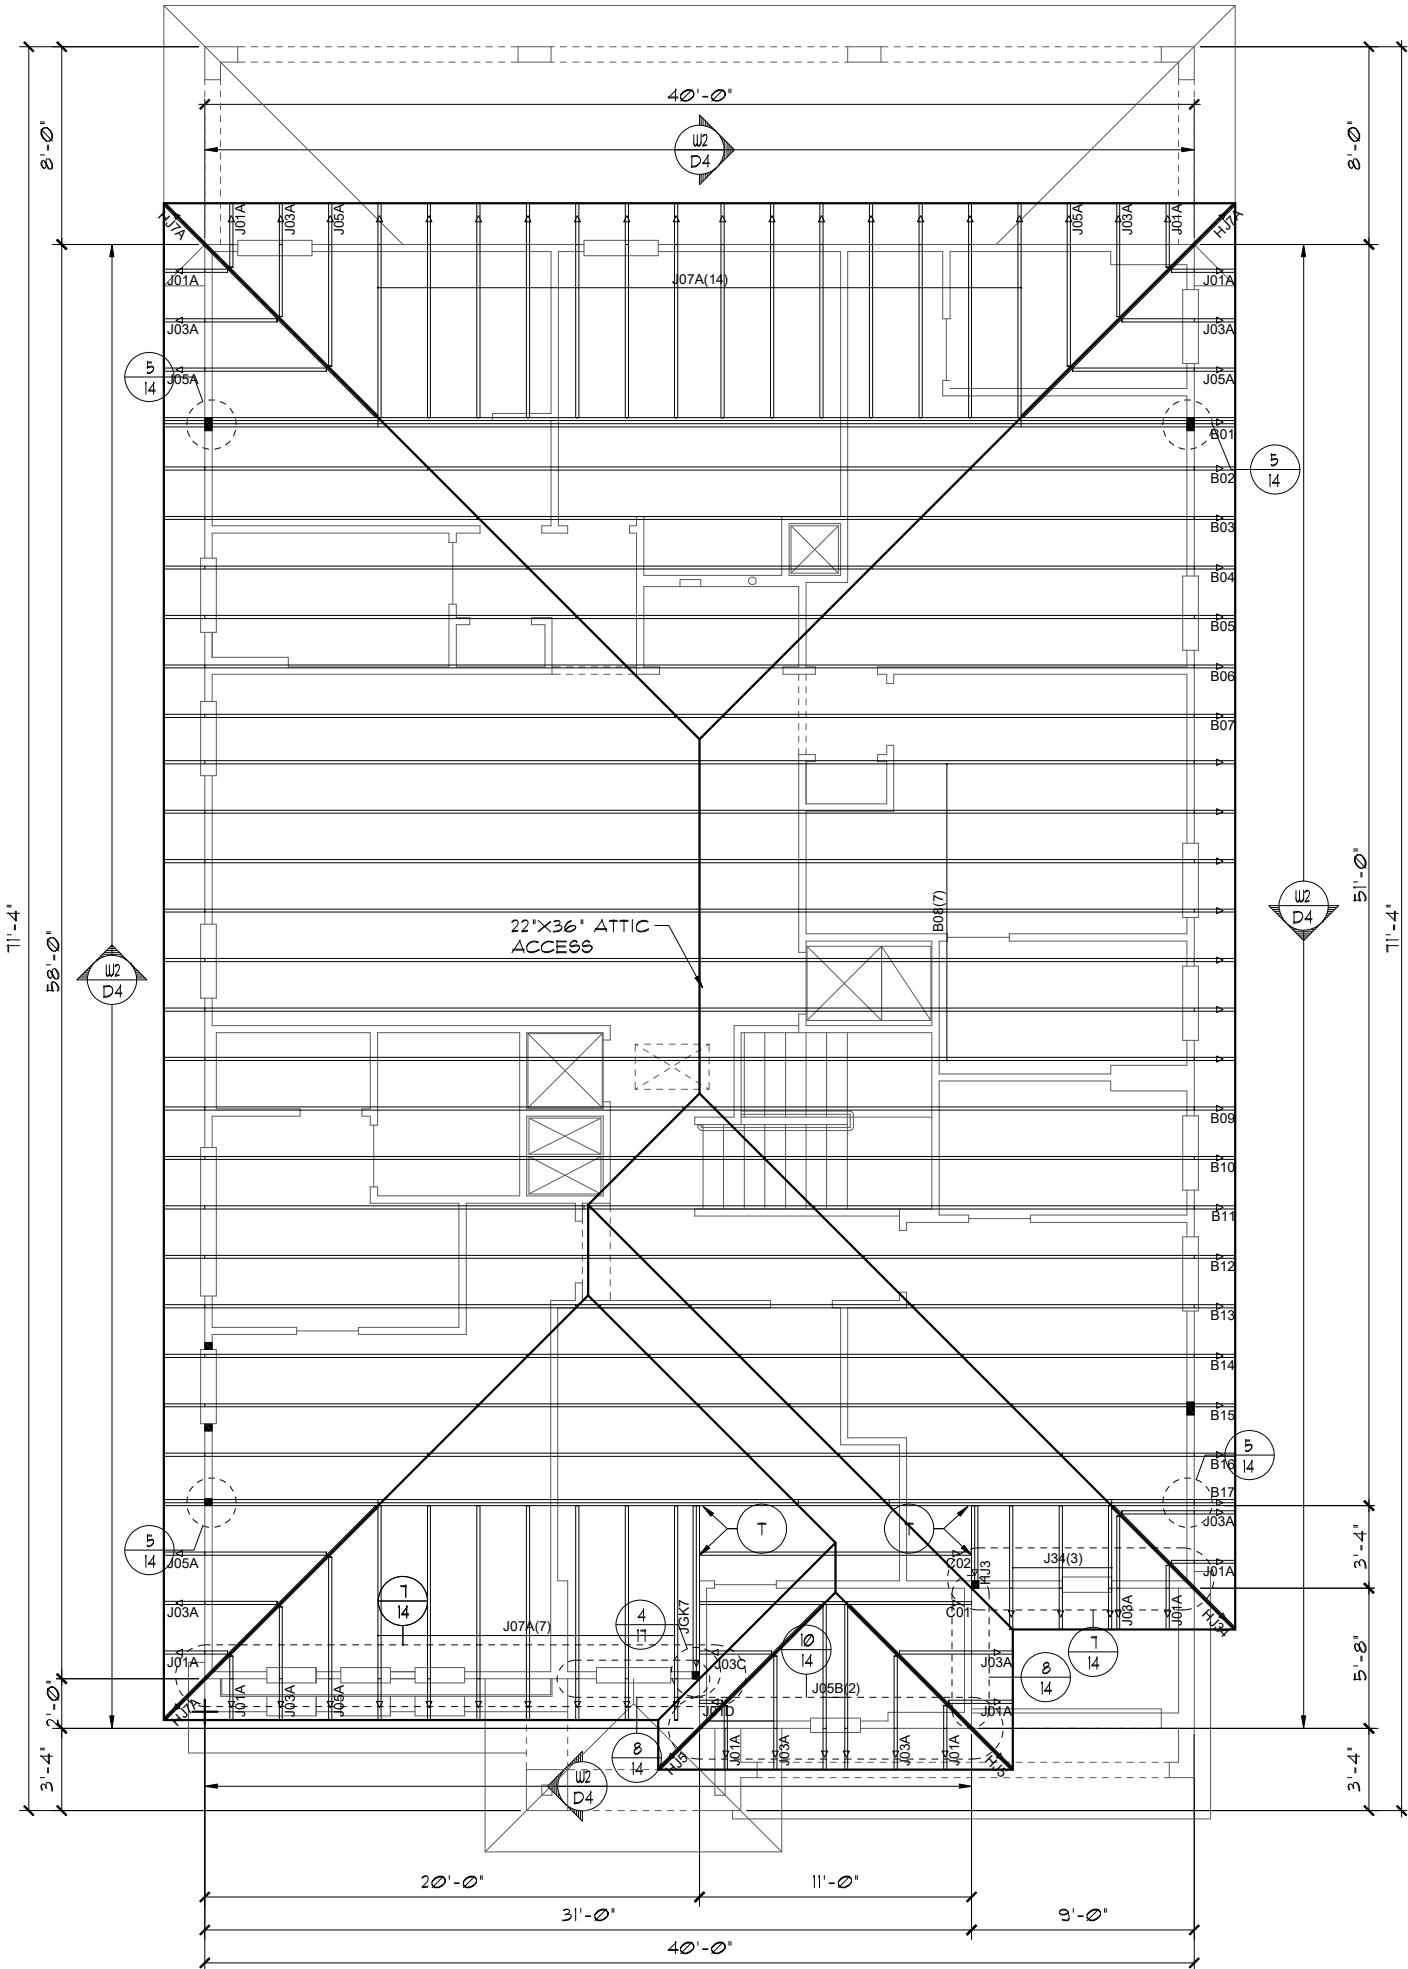


PER FBC2020 TTH EDITION R306: MIN. 40% - MAX. 50%
OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF
ATTIC SPACE AND THE BALANCE TO BE IN LOWER
PORTION (EAVES).

TOTAL VENTED SPACE: $\frac{2,387\text{S.F.}}{300} = \frac{7.96\text{S.F.}}{\text{NET FREE REQUIRED}}$

UPPER PORTION VENTILATION TOTAL: 3.88SF.
 PROVIDED W/OFF RIDGE VENTS: 4 VENTS @ .97SF. /VENT.
 (TILE: O'HAGIN MODEL 'S', SHINGLE: LOMANCO T70-D OR
 MILLENNIUM METAL)
 LOWER PORTION VENTILATION TOTAL: 17.4SF.
 PROVIDED W/SOFFITS @ EAVE: 200LF. @ 0.087SF VENTING/L.F.

UPPER PORTION PERCENTAGE: 49%
LOWER PORTION PERCENTAGE: 51%

1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 11TH EDITION (2020) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC91 I.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. TILE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2020, 11TH EDITION R305.3.3.
Underlayment materials required to comply with ASTM D226, D1970, D4869 and D6757 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
 - O-HAGIN - 1' X 19" HOLE
9. TILE ROOF TO BE INSTALLED IAW FBCR 2020, 11TH EDITION ASTM C1492-R305.3.5

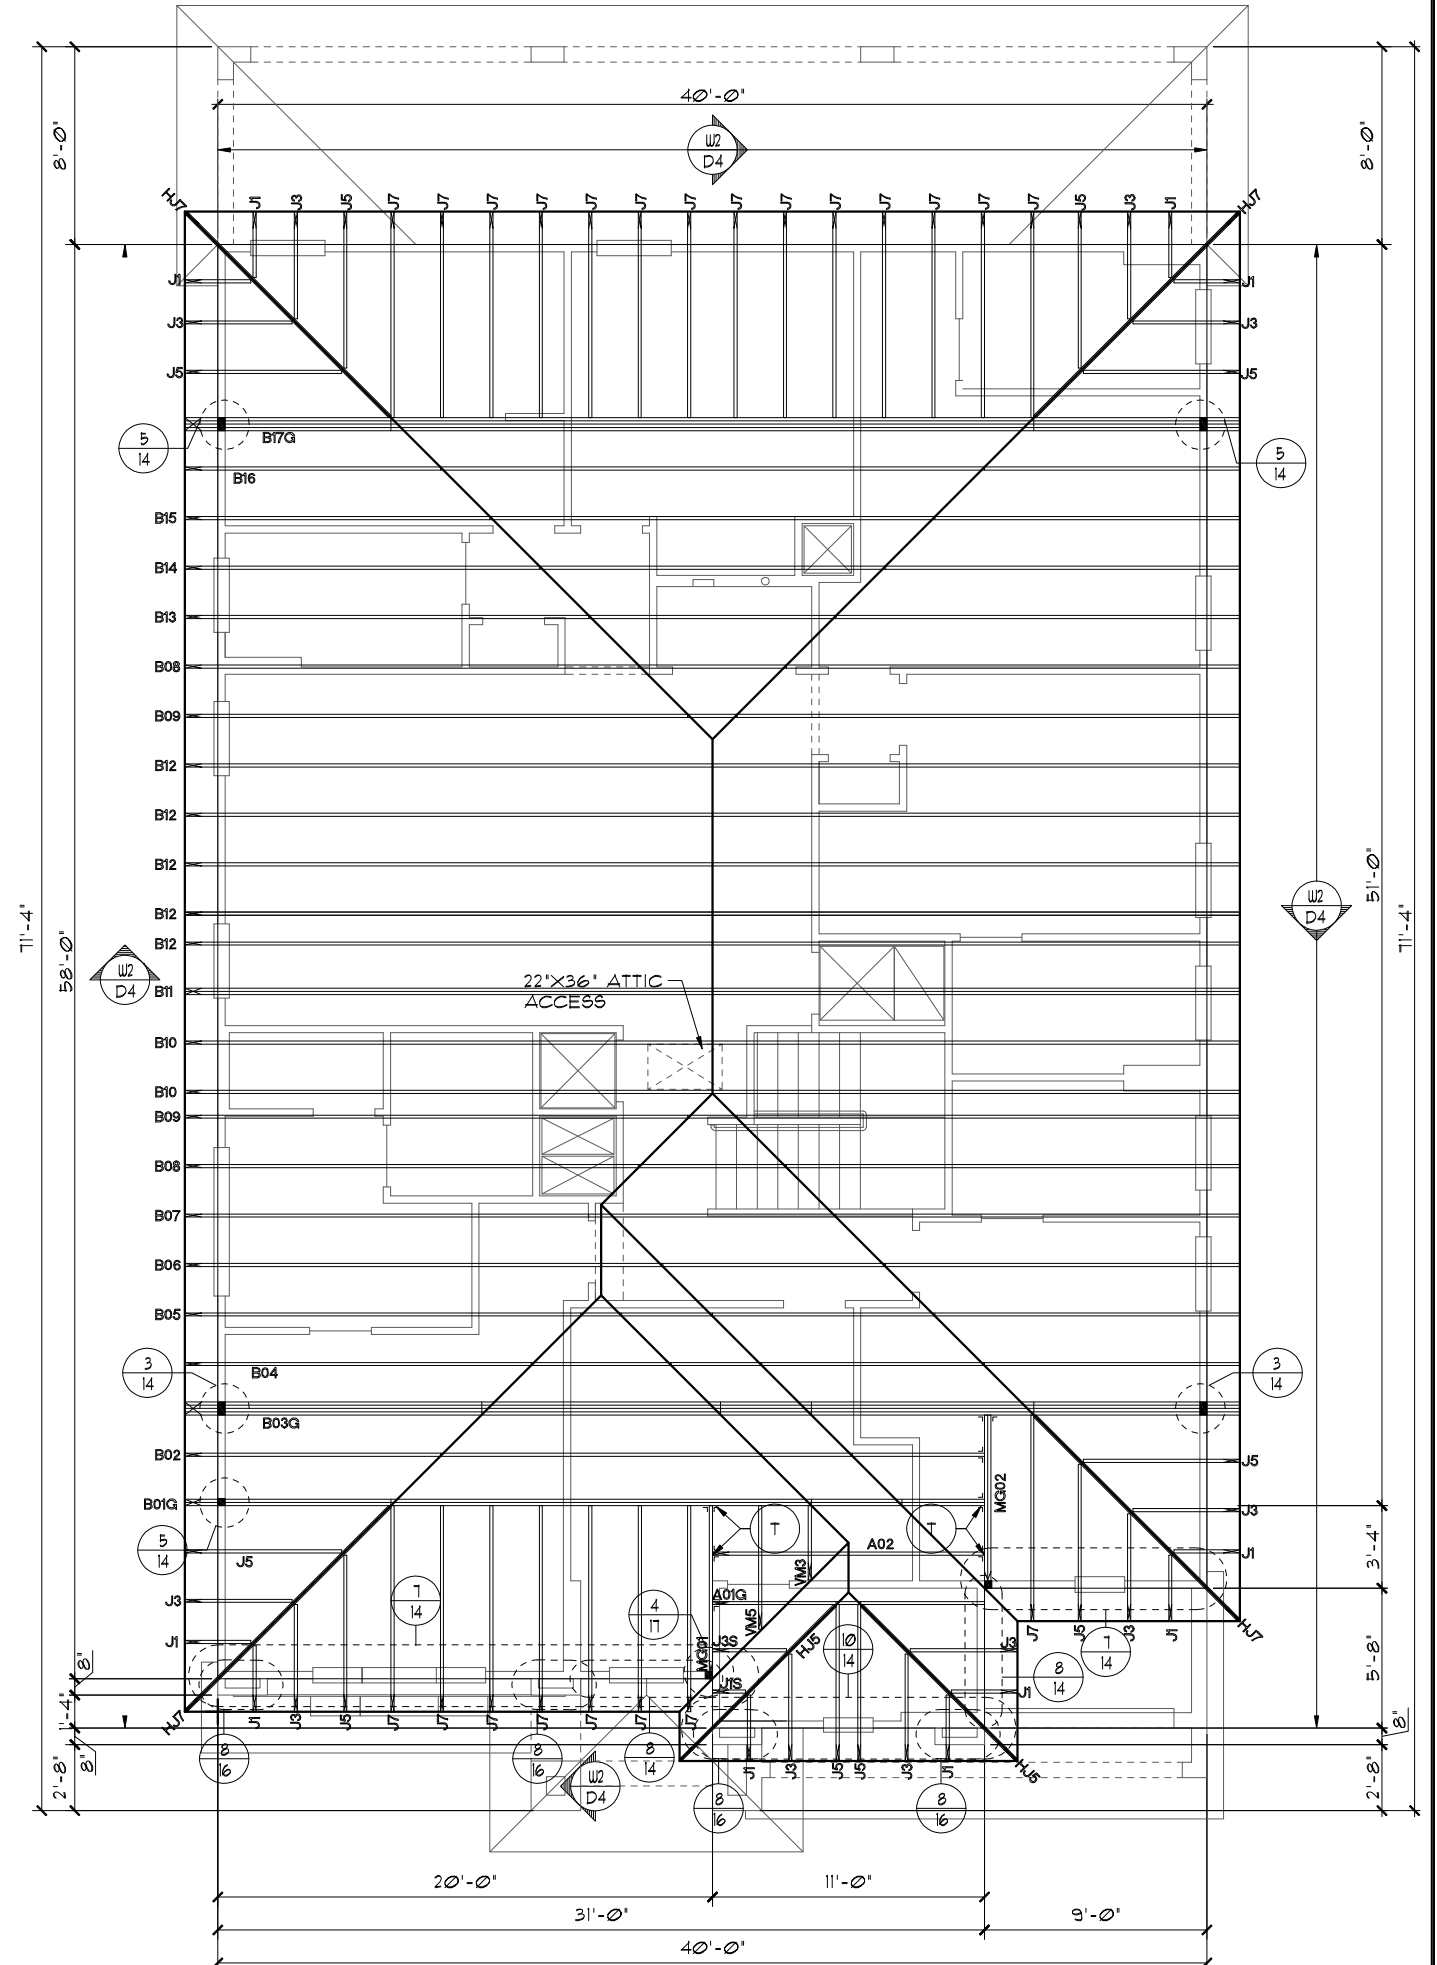
$$1/8^{\circ} = 1^{\circ} - \emptyset^{\circ} \quad (11 \times 17) \quad 1/4^{\circ} = 1^{\circ} - \emptyset^{\circ} \quad (22 \times 34)$$

DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

Park
Square
HOMES

HOUSLAI

L
U
U
U
Y

PARADISO GRANDE

232

E 04-09-2

LE AS NOTED

AWN RDC

423

ET

2B.0
SHEETS

LOT: 0000 BABARICO CRAIDE

LOT: 0000, PARADISO GRANDE

and designs are not to be copied

ATTIC VENTILATION CALCULATIONS

PER FBC2020 1TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/50 OF VENTED SPACE:

TOTAL VENTED SPACE: $\frac{2,387\text{S.F.}}{300} = \frac{7,96\text{S.F.}}{\text{REQUIRED}}$ NET FREE

UPPER PORTION VENTILATION TOTAL: **3,88S.F.**
PROVIDED W/OFF RIDGE VENTS: **4** VENTS @ **97S.F.** /VENT.
(TILE: O'HAGIN MODEL "S", SHINGLE: LOMANCO T10-D OR MILLENNIUM METAL)
LOWER PORTION VENTILATION TOTAL: **17.4S.F.**
PROVIDED W/OFFITS @ EAVE: **200L.F.** @ **0.087SF** VENTING/L.F.


UPPER PORTION PERCENTAGE: **49%**
LOWER PORTION PERCENTAGE: **51%**

NOTES

1. TYPICAL ROOF GABLE OVERHANG TO BE **8"** UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE **20"** UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 1TH EDITION (2020) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC91.1.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2020, 1TH EDITION R305.1.1. - Underlayment materials required to comply with ASTM D226, D1910, D4869 and D6151 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
 - LOMANCO : (2) 3 1/4" DIA. CIRCLES
 - MILLENNIUM METAL : 2 1/2" X 46" HOLE

TRUSS LAYOUT "B"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

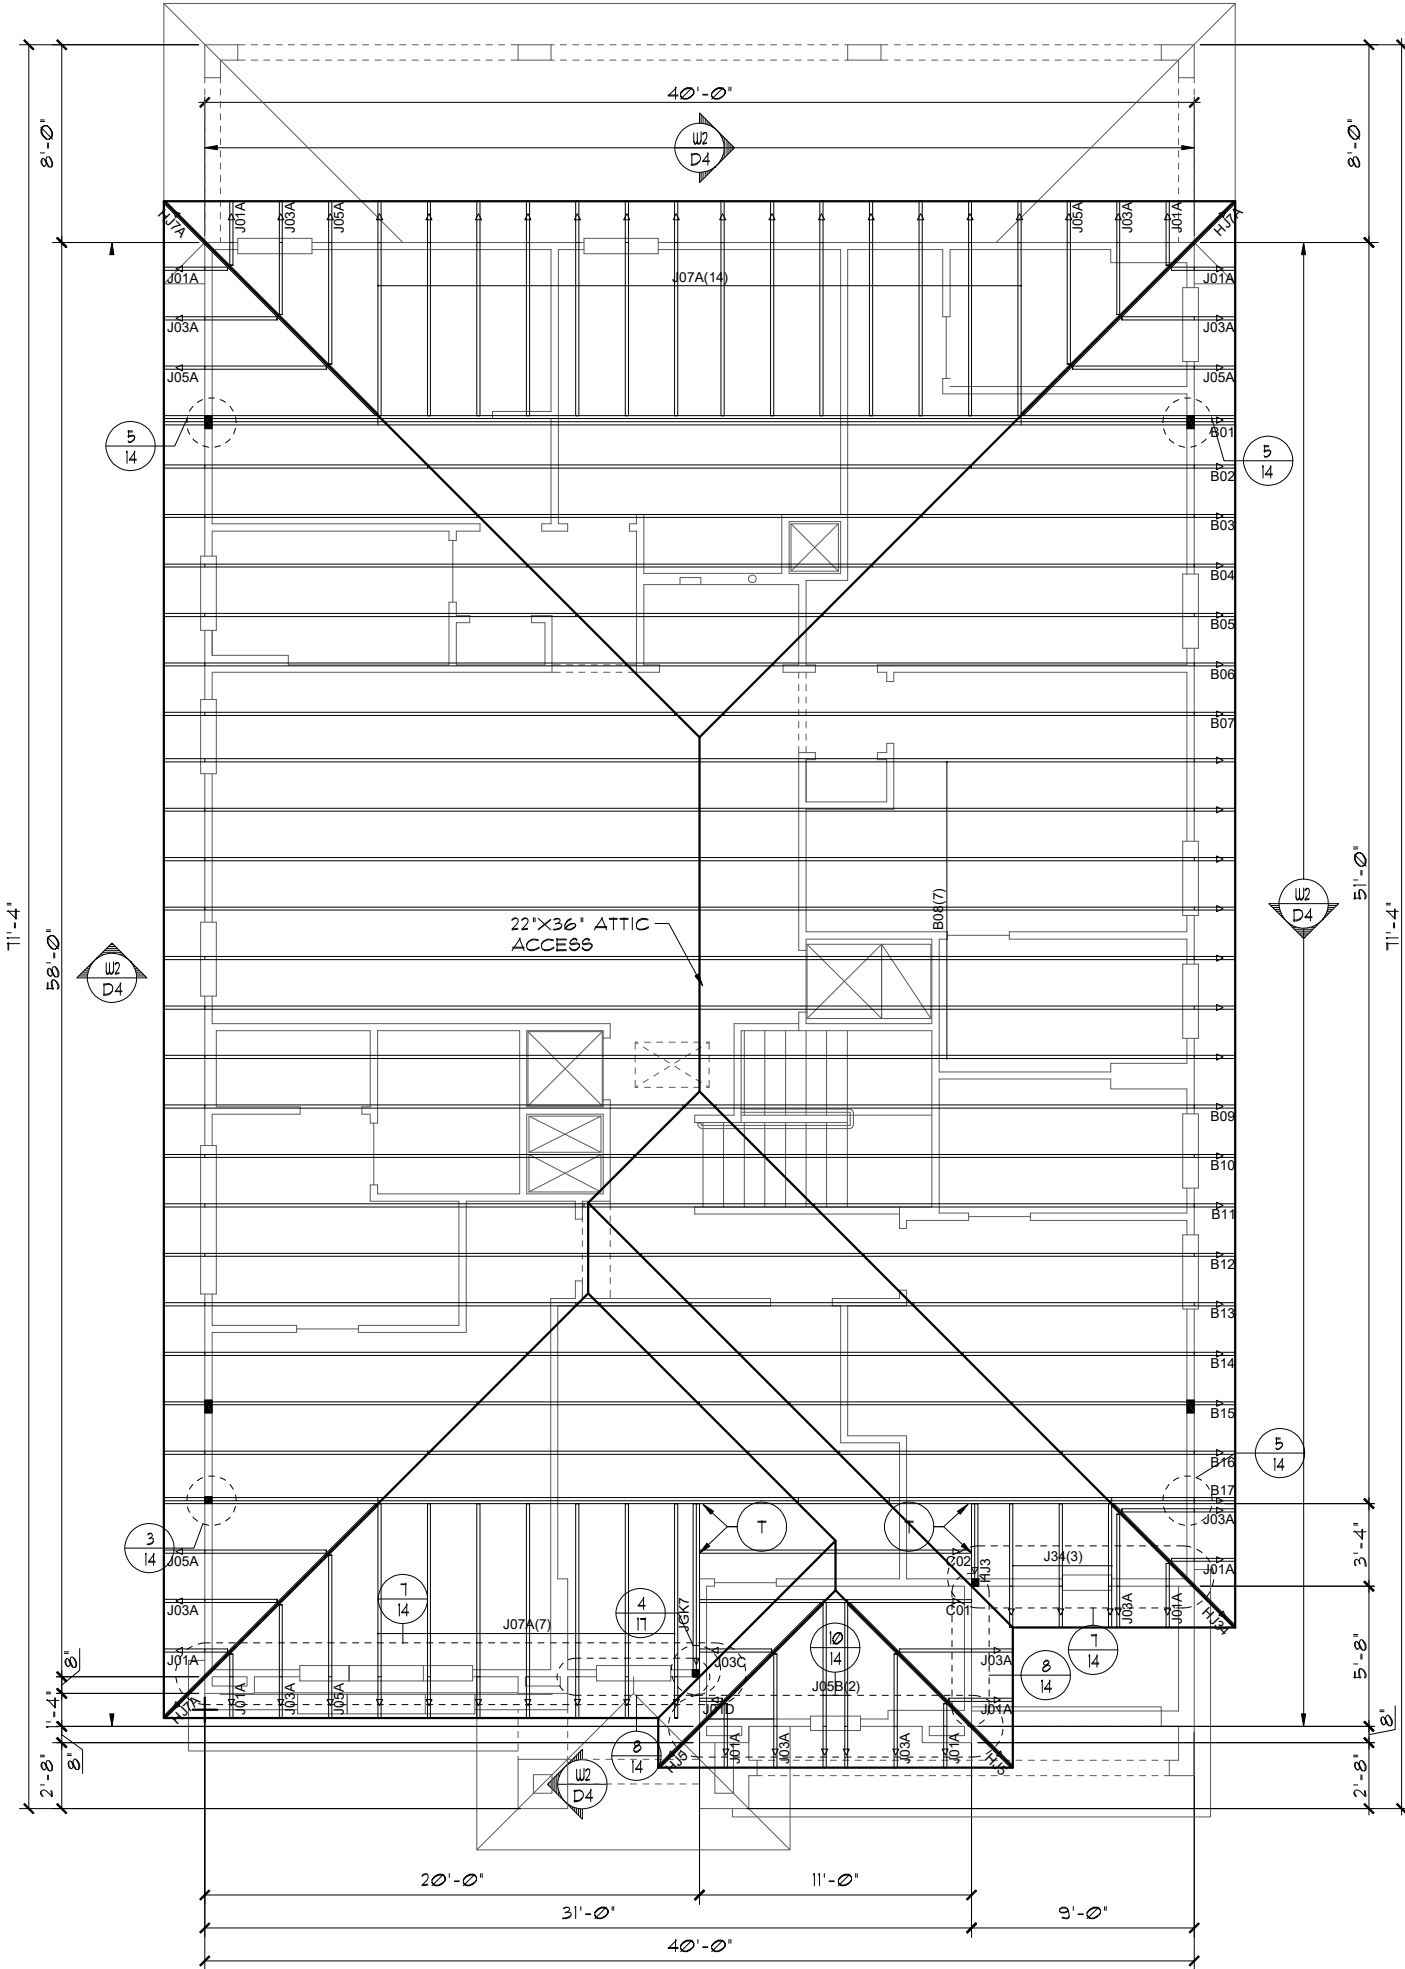


PER FBC2020 7TH EDITION R806: MIN. 40% - MAX. 50%
OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF
ATTIC SPACE AND THE BALANCE TO BE IN LOWER
PORTION (EAVES).

TOTAL VENTED SPACE: $\frac{2,387\text{S.F.}}{300} = \frac{7.96\text{S.F.}}{\text{NET FREE REQUIRED}}$

UPPER PORTION VENTILATION TOTAL: **3.88S.F.**
 PROVIDED W/OFF RIDGE VENTS: **4 VENTS @ .97S.F. /VENT.**
 (TILE: O'HAGIN MODEL 'S', SHINGLE: LOMANCO T10-D OR
 MILLENNIUM METAL)
 LOWER PORTION VENTILATION TOTAL: **17.4S.F.**
 PROVIDED W/SOFFITS @ EAVE: **200L.F. @ 0.087S.F. VENTING/L.F.**

UPPER PORTION PERCENTAGE: **49%**
LOWER PORTION PERCENTAGE: **51%**

1. TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 1TH EDITION (2020) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/UTCA BC91 I.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. TILE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2020, 1TH EDITION R305.3.3.
Underlayment materials required to comply with ASTM D226, D1910, D4869 and D6757 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
 - O-HAGIN - 1' X 19" HOLE
9. TILE ROOF TO BE INSTALLED IAW FBCR 2020, 1TH EDITION ASTM C1492-R305.3.5

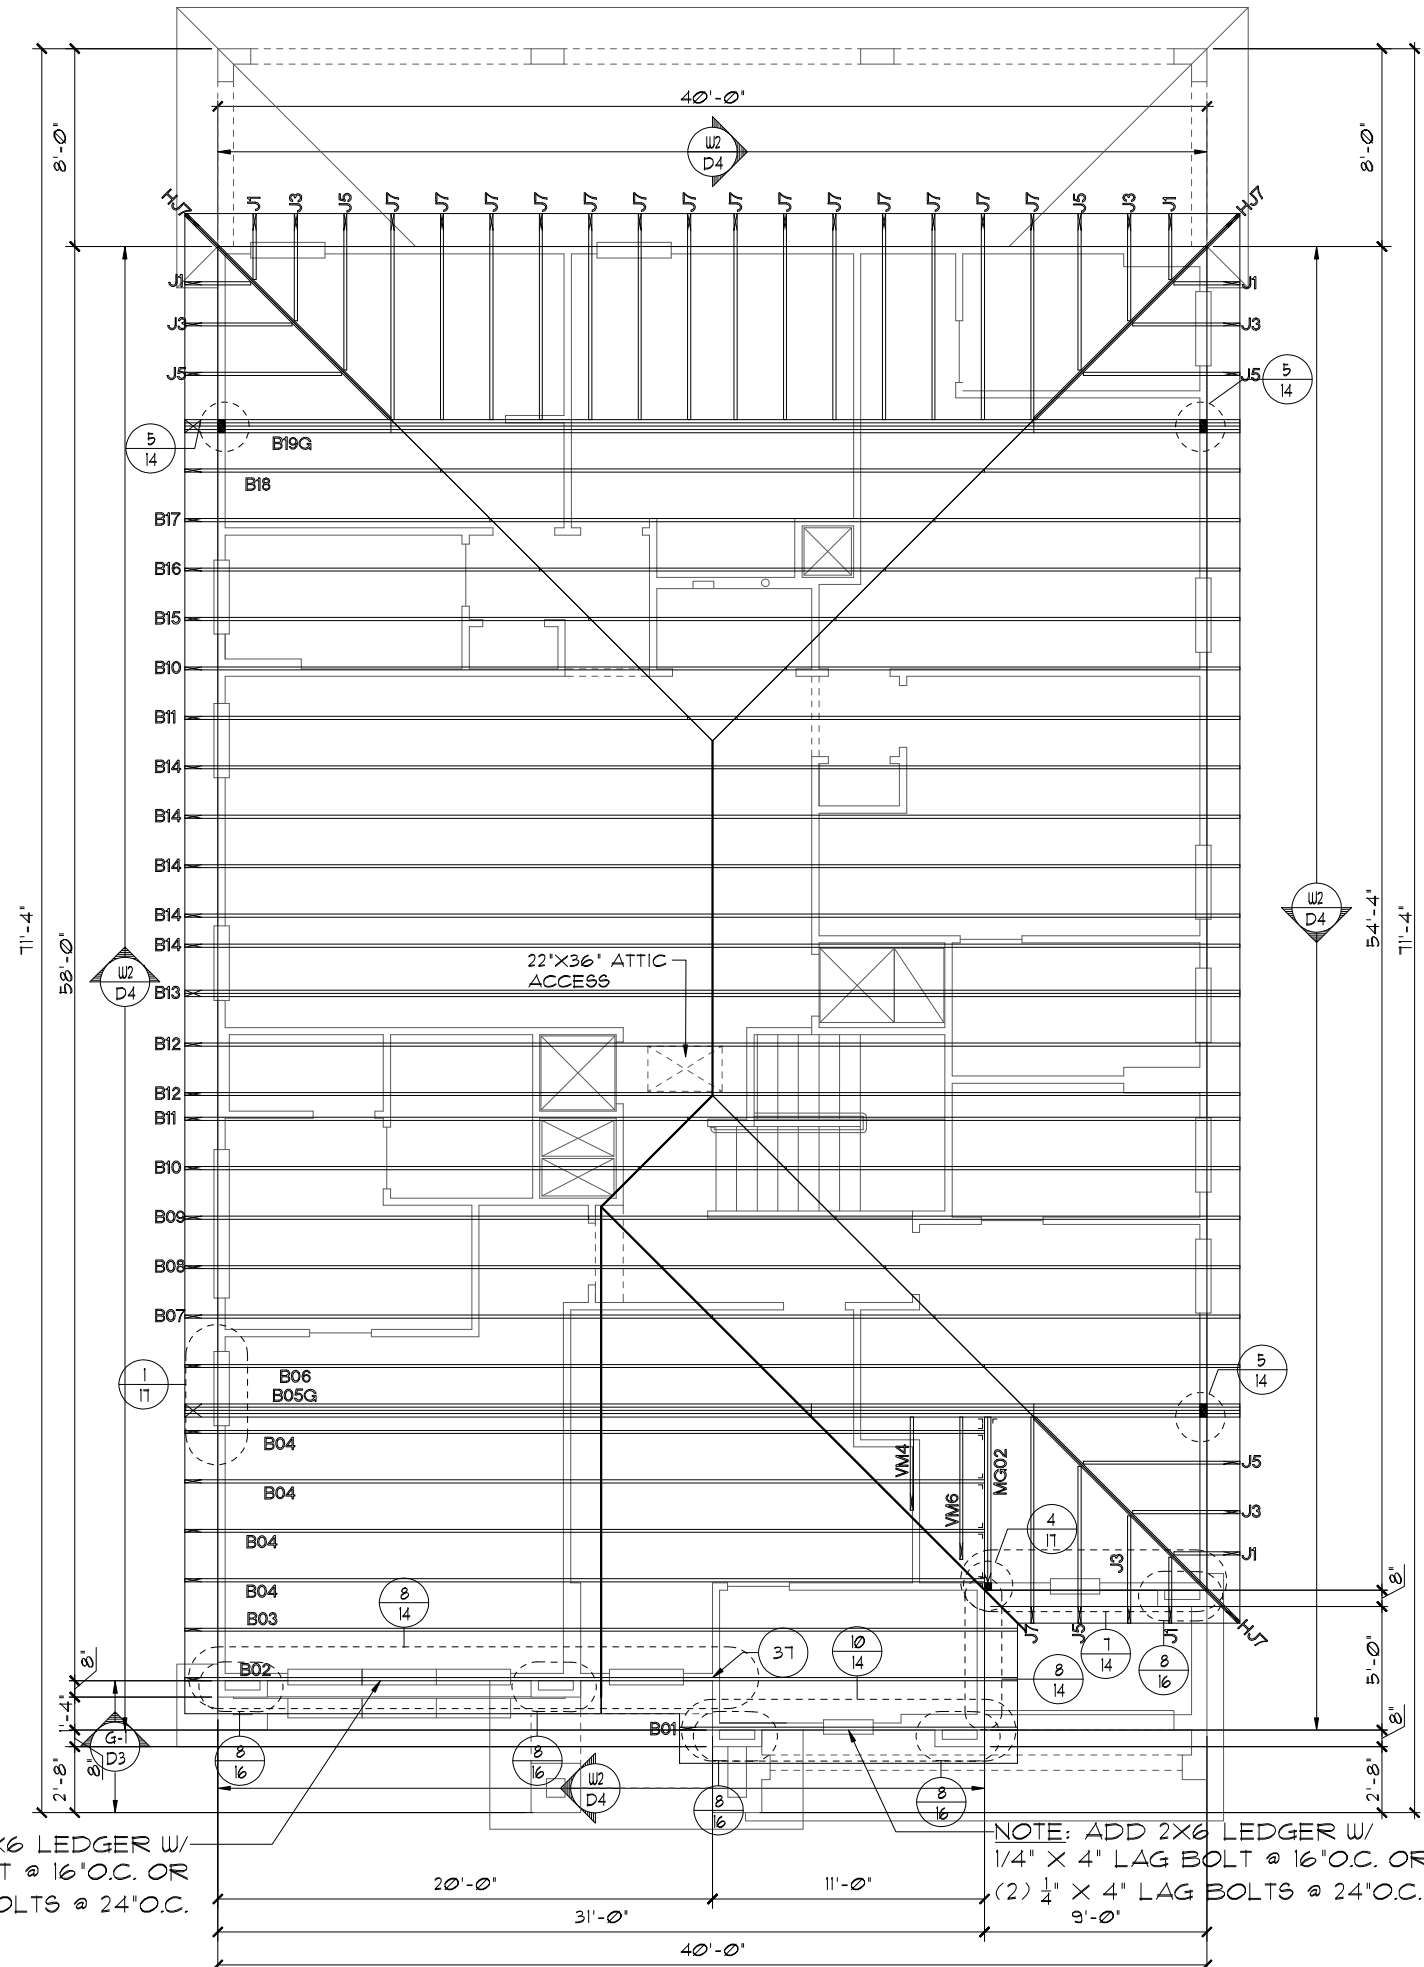

NOTE: ADD 2X6 LEDGER W/
1/4" X 4" LAG BOLT @ 16"O.C. OR
(2) 1/2" X 4" LAG BOLTS @ 24"O.C.

NOTE: ADD 2X6 LEDGER W/
1/4" X 4" LAG BOLT @ 16" O.C. OR
(2) 1/4" X 4" LAG BOLTS @ 24" O.C.

1/8" = 1'-0" (11x17) 1/4" = 1'-0" (22x34)

Park Square HOMES

TRUSS LAYOUT

LL
LL
LL
LL

PARADISO GRANDE

4232

DATE 04-09-2010

SCALE AS NOTED

DRAWN RDC

JOB	423
-----	-----

SHEET

12C.0
OF SHEETS

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1st EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH


PER FBC2020 TTH EDITION R806: MIN. 40% - MAX. 50%
OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF
ATTIC SPACE AND THE BALANCE TO BE IN LOWER
PORTION (EAVES).

TOTAL VENTED SPACE: $\frac{2,387\text{S.F.}}{300} = \frac{7.96\text{S.F.}}{\text{NET FREE REQUIRED}}$

UPPER PORTION VENTILATION TOTAL: 3.88SF.
 PROVIDED W/OFF RIDGE VENTS: 4 VENTS @ .97SF./VENT.
 (TILE: O'HAGIN MODEL "S", SHINGLE: LOMANCO T70-D OR
 MILLENNIUM METAL)
 LOWER PORTION VENTILATION TOTAL: 17.4SF.
 PROVIDED W/SOFFITS @ EAVE: 200LF. @ 0.087SF VENTING/L.F.

UPPER PORTION PERCENTAGE: 49%
LOWER PORTION PERCENTAGE: 51%

1. TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 1TH EDITION (2020) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC91 I.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. TILE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2020, 1TH EDITION R305.3.3.
Underlayment materials required to comply with ASTM D226, D1970, D4869 and D6757 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
 - O-HAGIN - 1" X 19" HOLE
9. TILE ROOF TO BE INSTALLED IAW FBCR 2020, 1TH EDITION ASTM C1492-R305.3.5

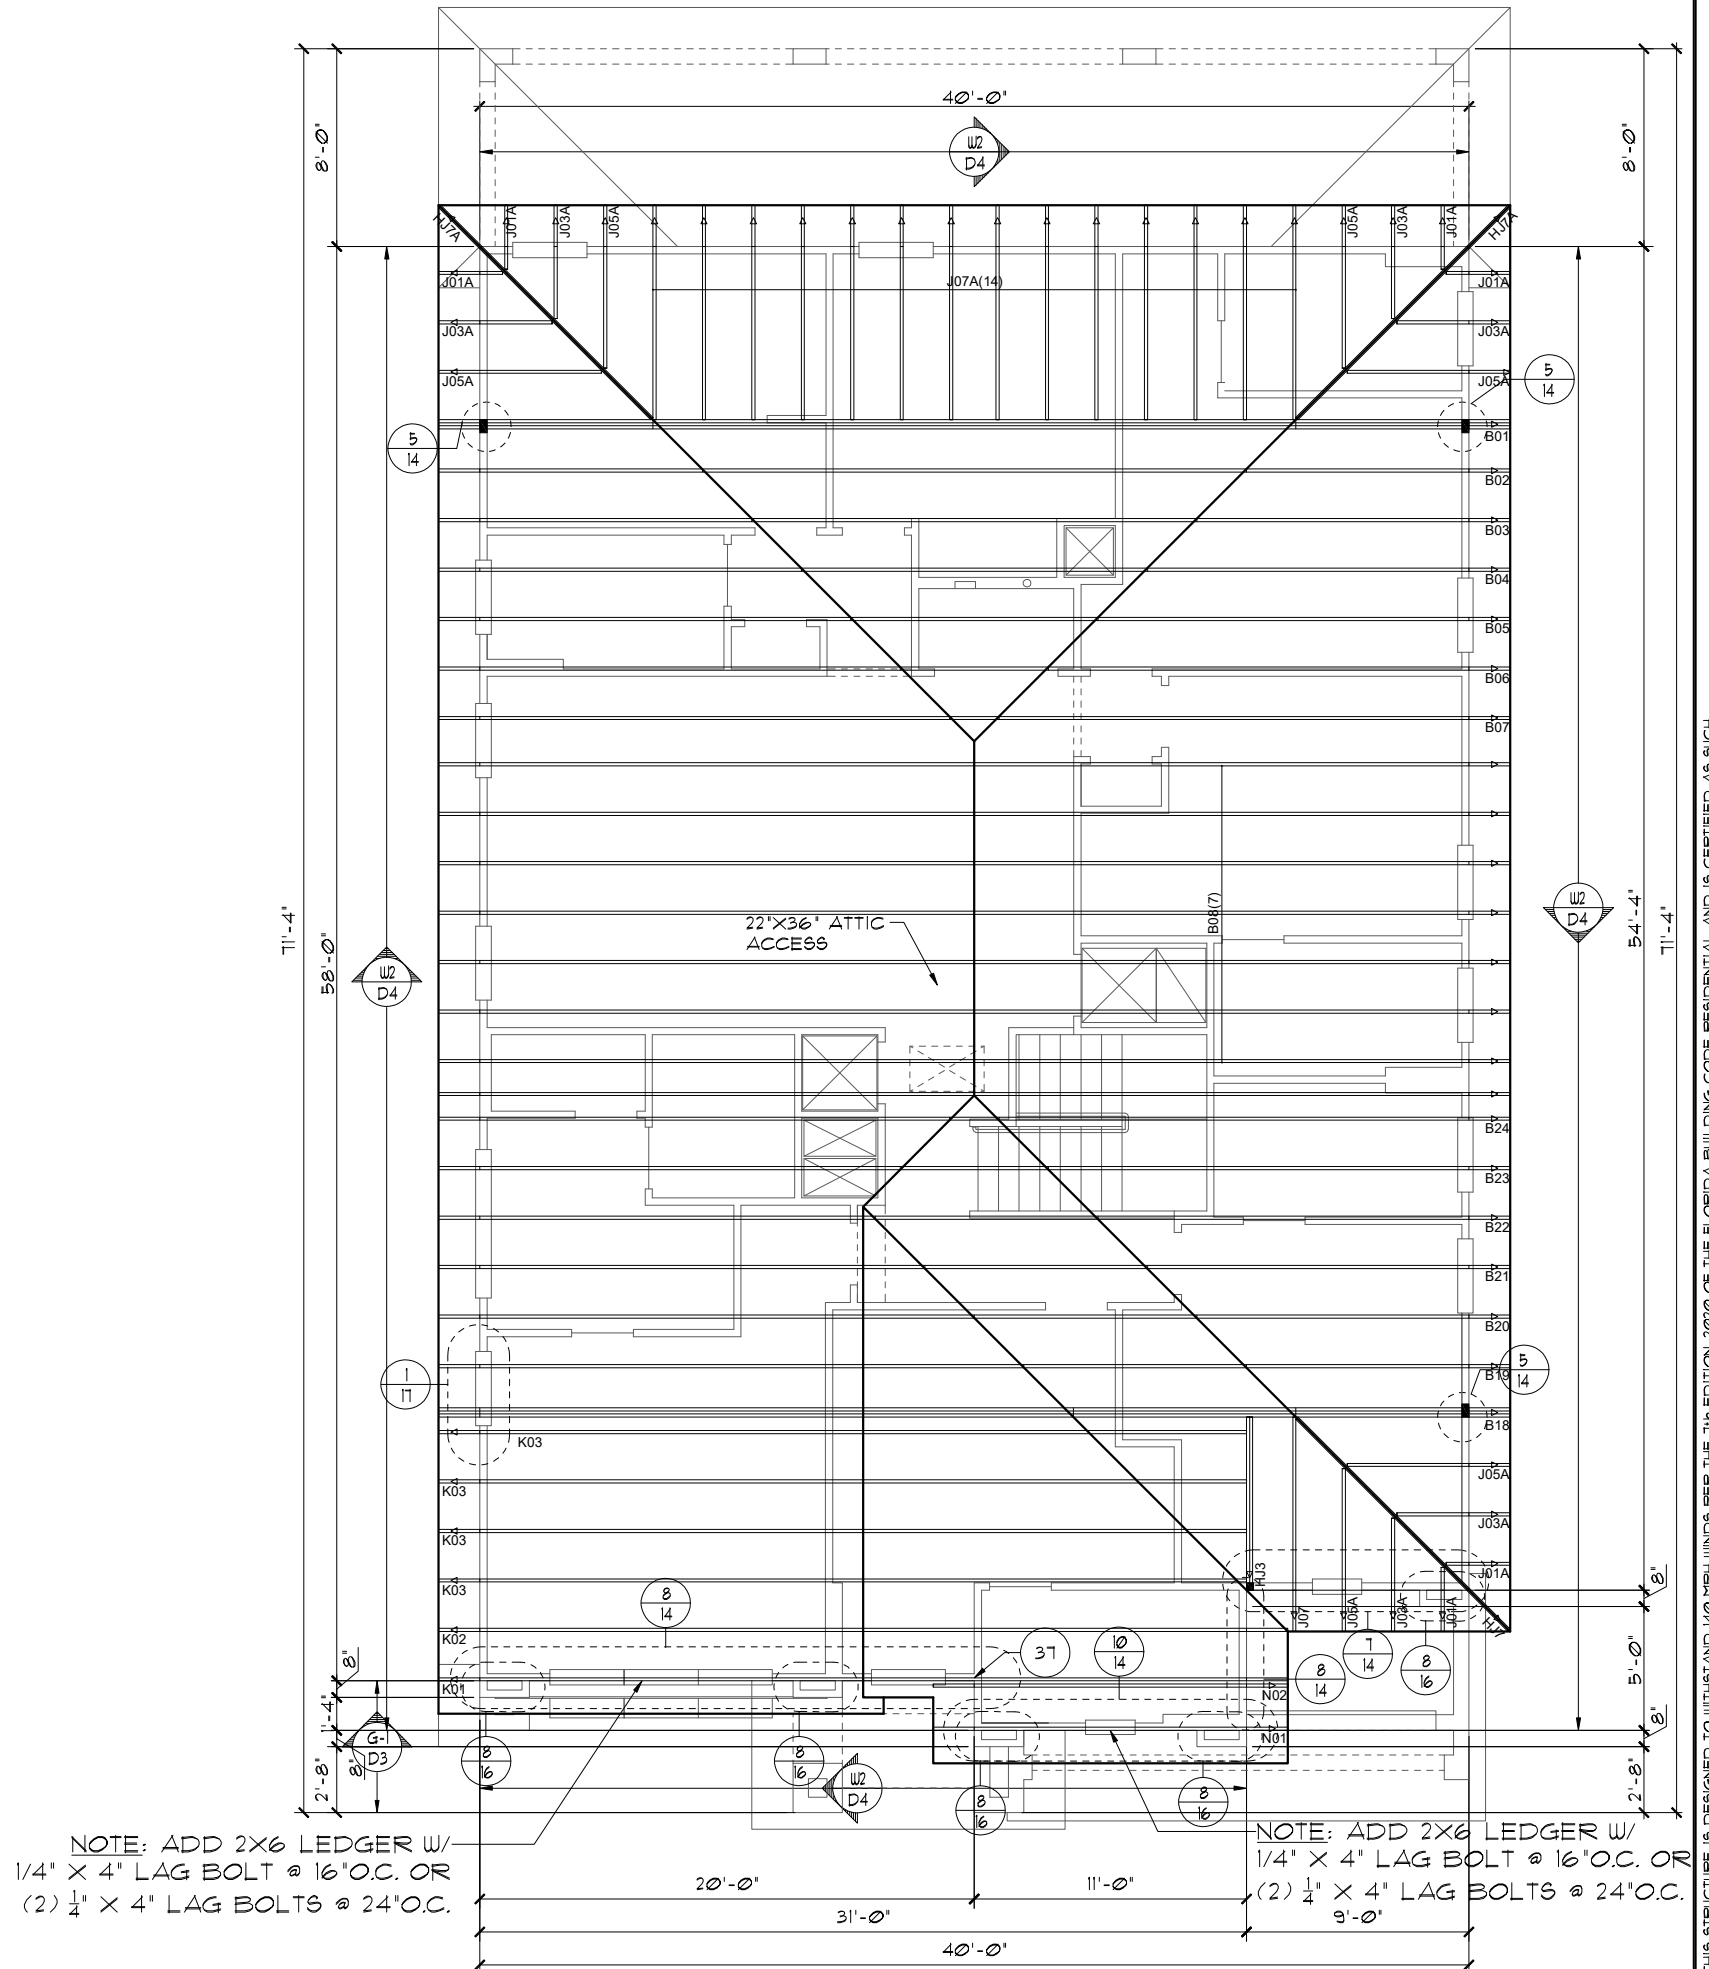
$$1/8'' = 1' - \emptyset'' \quad (11 \times 17) \quad 1/4'' = 1' - \emptyset'' \quad (22 \times 34)$$

DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

**Park
Square
HOMES**

THUS LAYOU

上

PARADISO GRANDE

4232

ATE 04-09-2


SCALE AS NOTED	
RAWN	RDC

OB 423

SHEET

12C.0
F SHEETS

LOT: 0000 BABARICO CRANDE

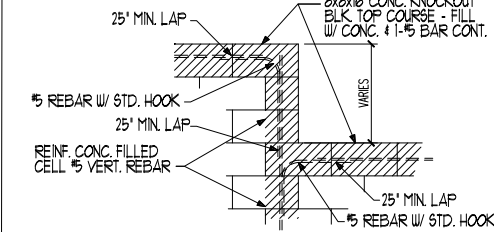


BLOCK WALL HT. TRANSITION DETAIL

CAST CRETE / LOTT'S
/ WEKIWA / FLORIDA ROCK
LINTEL SCHEDULE

LINTEL NO.	LENGTH	TYPE	COMMENTS
L 1	11'-4"	8F30-1B/1T	GARAGE DOOR
L 2	4'-6"	8F24-0B/1T	3/4X1/0 F.G.
L 3	4'-6"	8F24-0B/1T	SH25
L 4	4'-4"	8F24-0B/1T	SH25
L 5	3'-6"	8F24-0B/1T	SH1H3
L 6	4'-4"	8RF20-0B/1T	POOL BA. DOOR
L 7	13'-4"	8F24-0B/1T	12/0X8/0 S.G.D.
L 8	9'-4"	8F24-0B/1T	8/0X8/0 S.G.D.
L 9	8'-0"	8F16-1B/1T	L.A.N.A.I
L 10	11'-0"	8F16-1B/1T	L.A.N.A.I
L 11	13'-4"	8F16-1B/1T	L.A.N.A.I
L 12	13'-4"	8F16-1B/1T	L.A.N.A.I
L 13	8'-0"	8F16-1B/1T	L.A.N.A.I
L 14	1'-6"	8F16-0B/1T	6/0X1/0 F.G.
L 15	4'-6"	8F24-0B/1T	SH25
L 16	3'-6"	8F24-0B/1T	3/0X5/0 CLR. F.G.
L 17	3'-0"	8F24-0B/1T	3/0X5/0 CLR. F.G.
L 18	3'-6"	8F24-0B/1T	3/0X5/0 CLR. F.G.
L 19	5'-10"	8RF20-0B/1T	FRONT DOOR
L 20	6'-6"	8F16-0B/1T	FRONT ENTRY
L 21	3'-6"	8F16-0B/1T	FRONT ENTRY
L 22	19'-4"	8F24-0B/1T	GARAGE ENTRY
L 23			
L 24			
L 25			
L 26			
L 27			

PRE CAST LINTEL LAYOUT "A"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

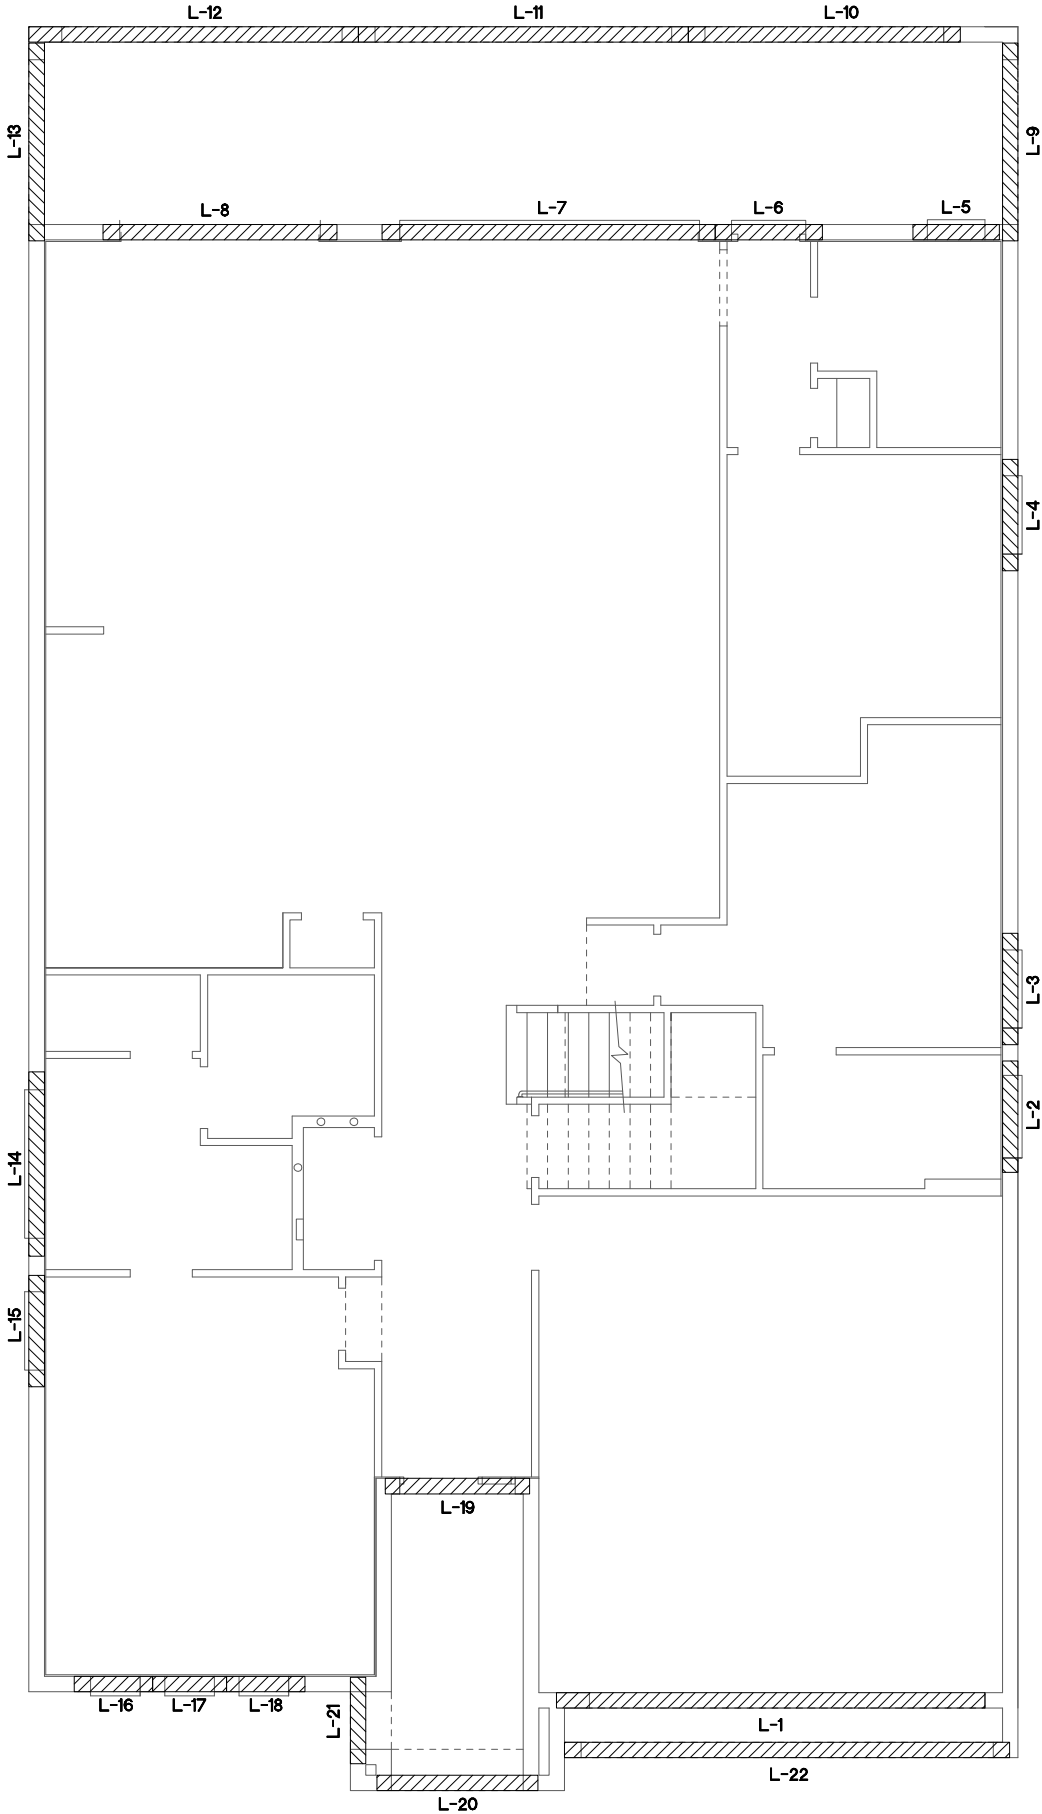


THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

PARADISO GRANDE

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS	BY
Engineering By: DBE and C MICHAEL A. THOMPSON PE 47509 PHONE 407-721-2292	
A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32811 Phone: (407) 529 - 3000	
PRE CAST LINTEL LAYOUT	
REEF	PARADISO GRANDE
4232	DATE 04-09-21
SCALE AS NOTED	
DRAWN	RDC
JOB	4232
SHEET	
13A.0	OF SHEETS

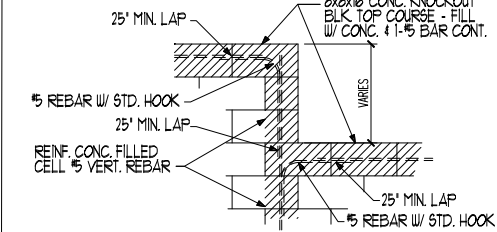


BLOCK WALL HT. TRANSITION DETAIL

CAST CRETE / LOTT'S / WEKIWA / FLORIDA ROCK LINTEL SCHEDULE			
LINTEL NO.	LENGTH	TYPE	COMMENTS
L 1	11'-4"	8F30-1B/1T	GARAGE DOOR
L 2	4'-6"	8F24-0B/1T	3/4X1/0 F.G.
L 3	4'-6"	8F24-0B/1T	SH25
L 4	4'-4"	8F24-0B/1T	SH25
L 5	3'-6"	8F24-0B/1T	SH1H3
L 6	4'-4"	8RF20-0B/1T	POOL BA. DOOR
L 7	13'-4"	8F24-0B/1T	12/0X8/0 S.G.D.
L 8	9'-4"	8F24-0B/1T	8/0X8/0 S.G.D.
L 9	8'-0"	8F16-1B/1T	L.A.N.A.I
L 10	11'-0"	8F16-1B/1T	L.A.N.A.I
L 11	13'-4"	8F16-1B/1T	L.A.N.A.I
L 12	13'-4"	8F16-1B/1T	L.A.N.A.I
L 13	8'-0"	8F16-1B/1T	L.A.N.A.I
L 14	1'-6"	8F16-0B/1T	6/0X1/0 F.G.
L 15	8'-8"	8F24-0B/1T	SH25, (2) 2/0X5/0 CLR. F.G.
L 16	5'-10"	8RF20-0B/1T	FRONT DOOR
L 17	6'-6"	8F8-0B/1T	FRONT ENTRY
L 18	3'-6"	8F8-0B/1T	FRONT ENTRY
L 19	19'-4"	8F24-0B/1T	GARAGE ENTRY
L 20			
L 21			
L 22			
L 23			
L 24			
L 25			
L 26			
L 27			

PRE CAST LINTEL LAYOUT "B"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

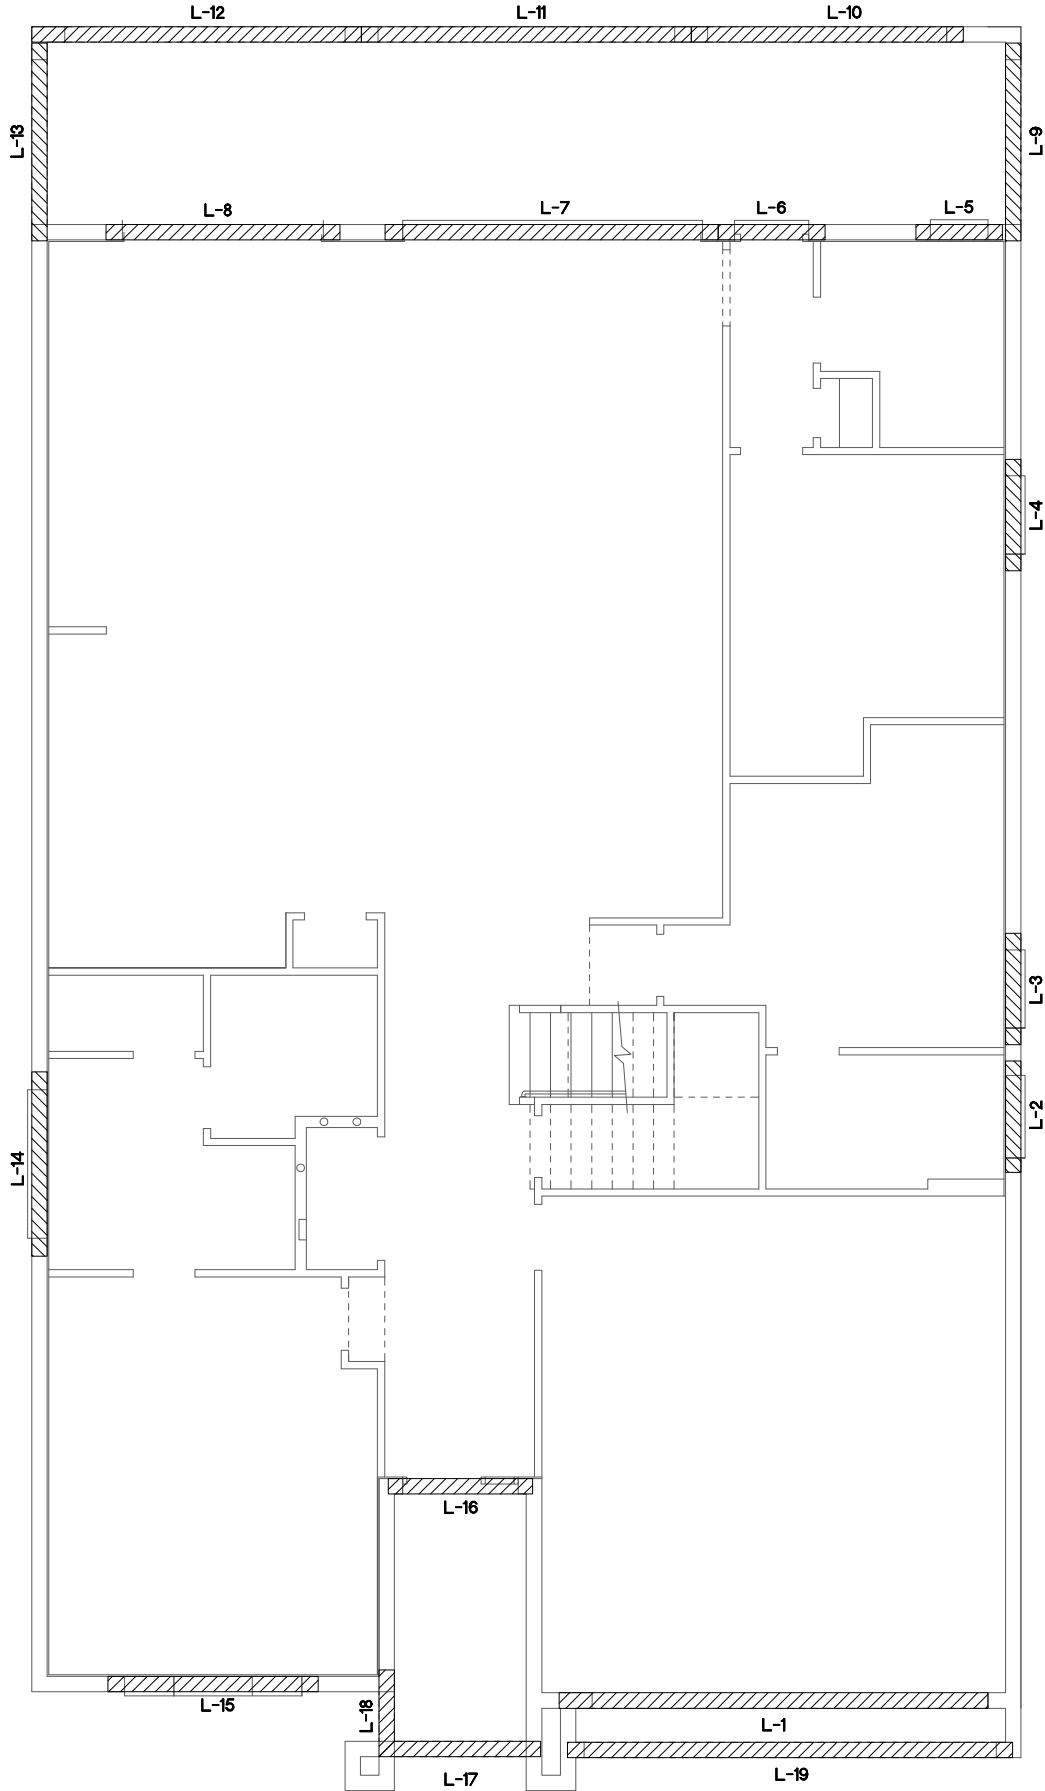


THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

PARADISO GRANDE

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS		BY
Engineering By: DBE and C MICHAEL A. THOMPSON PE 47509 PHONE 407-721-2292		
A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32811 Phone: (407) 529 - 3000		
PRE CAST LINTEL LAYOUT		
REEF	PARADISO GRANDE	
4232	DATE	04-09-21
	SCALE	AS NOTED
	DRAWN	RDC
	JOB	4232
	SHEET	
13B.0		
OF		SHEETS

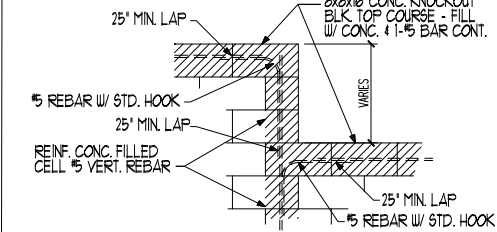


BLOCK WALL HT. TRANSITION DETAIL

CAST CRETE / LOTT'S / WEKIWA / FLORIDA ROCK LINTEL SCHEDULE			
LINTEL NO.	LENGTH	TYPE	COMMENTS
L 1	11'-4"	8F30-1B/1T	GARAGE DOOR
L 2	4'-6"	8F24-0B/1T	3/4X1/0 F.G.
L 3	4'-6"	8F24-0B/1T	SH2B
L 4	4'-6"	8F24-0B/1T	SH2B
L 5	3'-6"	8F24-0B/1T	SH1H3
L 6	4'-4"	8RF20-0B/1T	POOL BA. DOOR
L 7	13'-4"	8F24-0B/1T	12/0X8/0 S.G.D.
L 8	9'-4"	8F24-0B/1T	8/0X8/0 S.G.D.
L 9	8'-0"	8F16-1B/1T	L.A.N.A.I
L 10	11'-0"	8F16-1B/1T	L.A.N.A.I
L 11	13'-4"	8F16-1B/1T	L.A.N.A.I
L 12	13'-4"	8F16-1B/1T	L.A.N.A.I
L 13	8'-0"	8F16-1B/1T	L.A.N.A.I
L 14	1'-6"	8F16-0B/1T	6/0X1/0 F.G.
L 15	4'-6"	8F24-0B/1T	SH2B
L 16	10'-6"	8F24-0B/1T	(3) 3/0X5/0 CLR. F.G.
L 17	5'-10"	8RF20-0B/1T	FRONT DOOR
L 18	19'-4"	8F24-0B/1T	GARAGE ENTRY
L 19	6'-6"	8F8-0B/1T	FRONT ENTRY
L 20	3'-6"	8F8-0B/1T	FRONT ENTRY
L 21			
L 22			
L 23			
L 24			
L 25			
L 26			
L 27			

PRE CAST LINTEL LAYOUT "C"

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

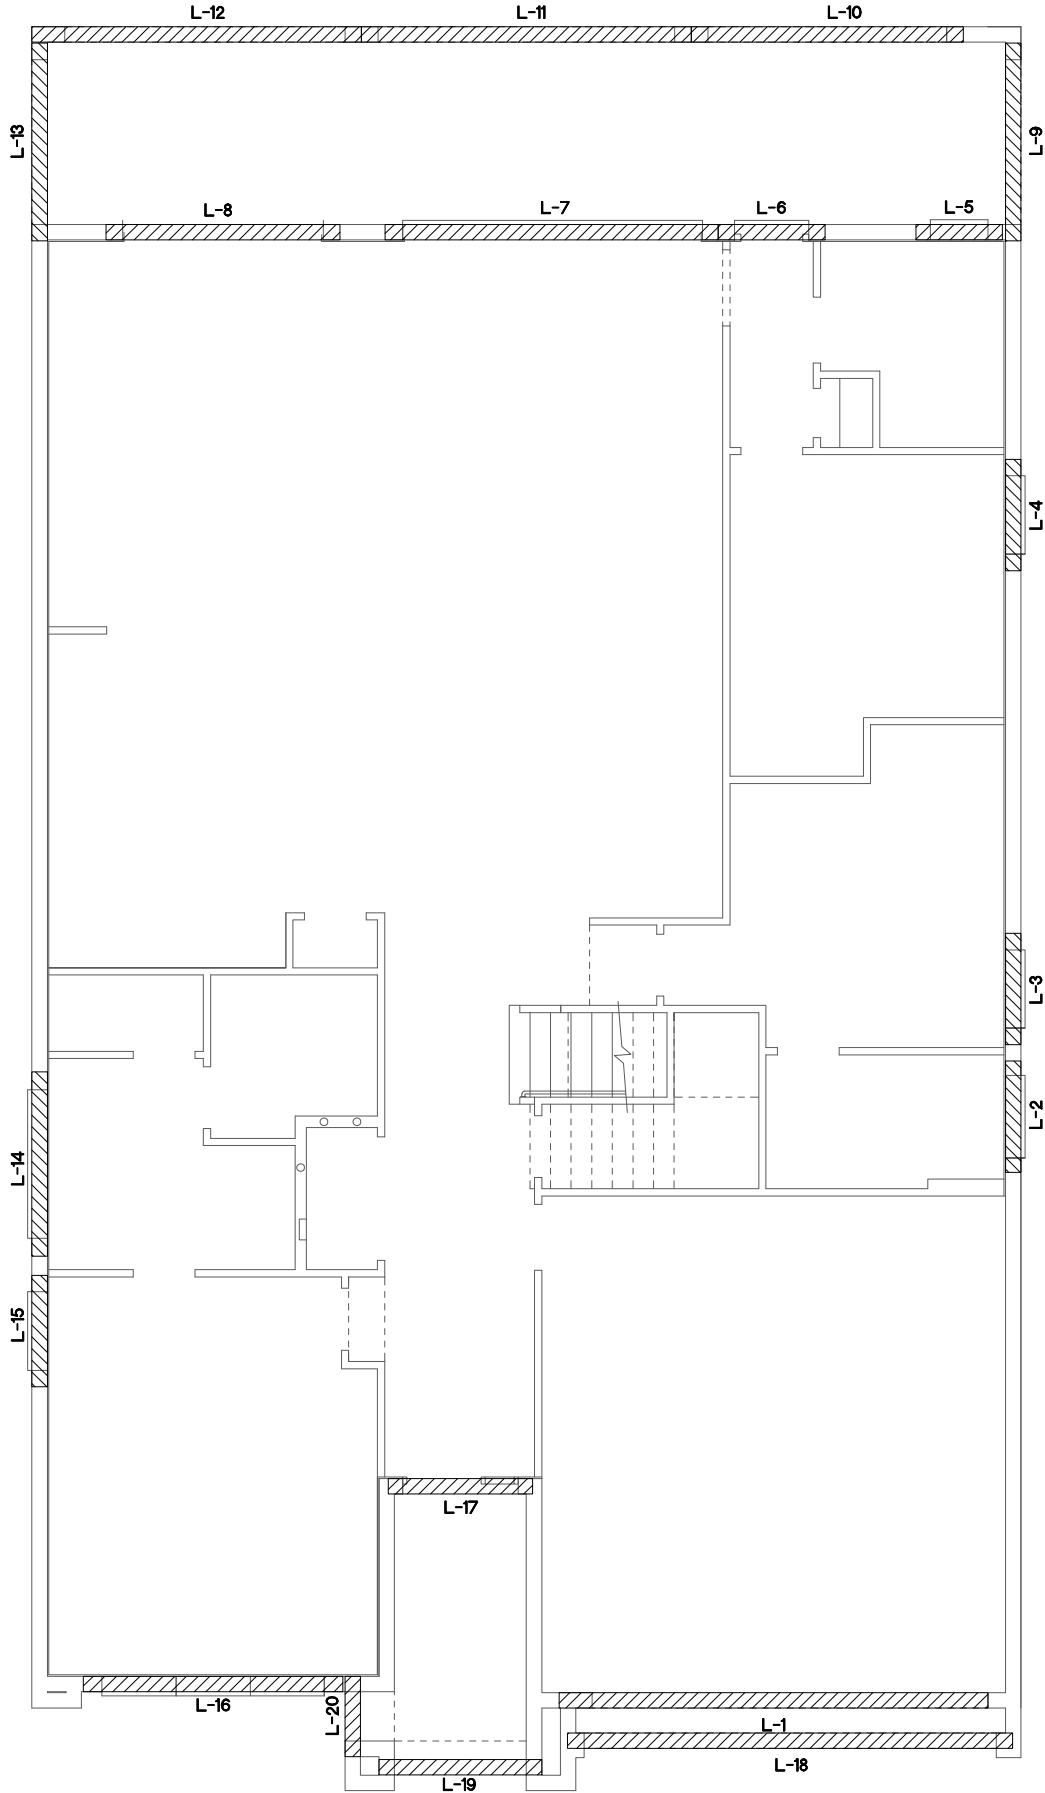


THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1th EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE


PARADISO GRANDE

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.


REVISIONS		BY
Engineering By: DBE and C MICHAEL A. THOMPSON PE 47509 PHONE 407-721-2292		
A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32811 Phone: (407) 529 - 3000		
Park Square HOMES		
PRE CAST LINTEL LAYOUT		
REEF		PARADISO GRANDE
4232		
DATE	04-09-21	
SCALE	AS NOTED	
DRAWN	RDC	
JOB	4232	
SHEET	13C.0	
OF	SHEETS	

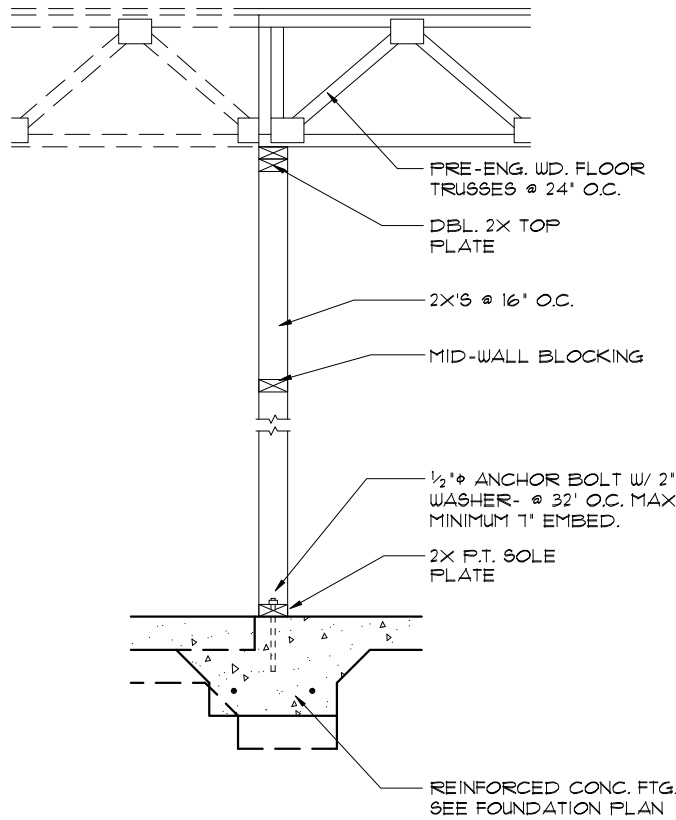


4 DETAIL
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

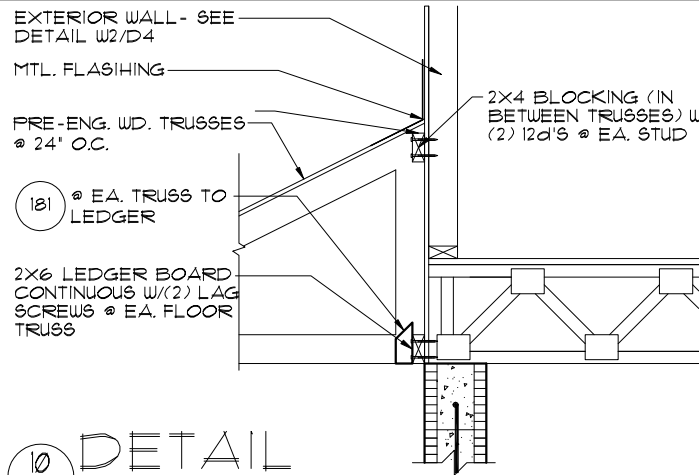


10 DETAIL
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

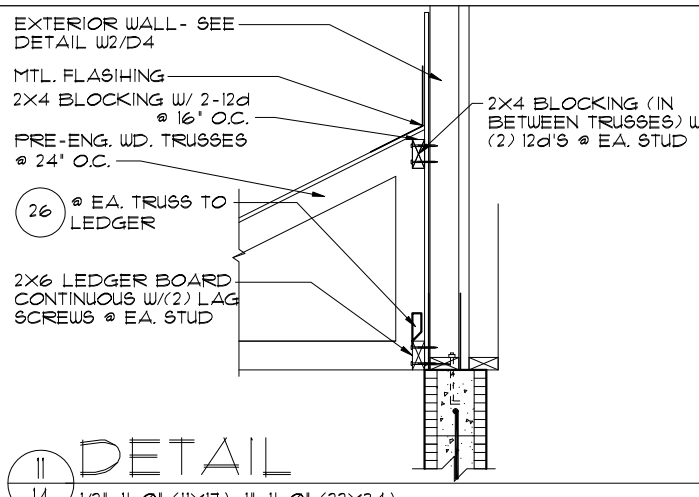


11 DETAIL
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

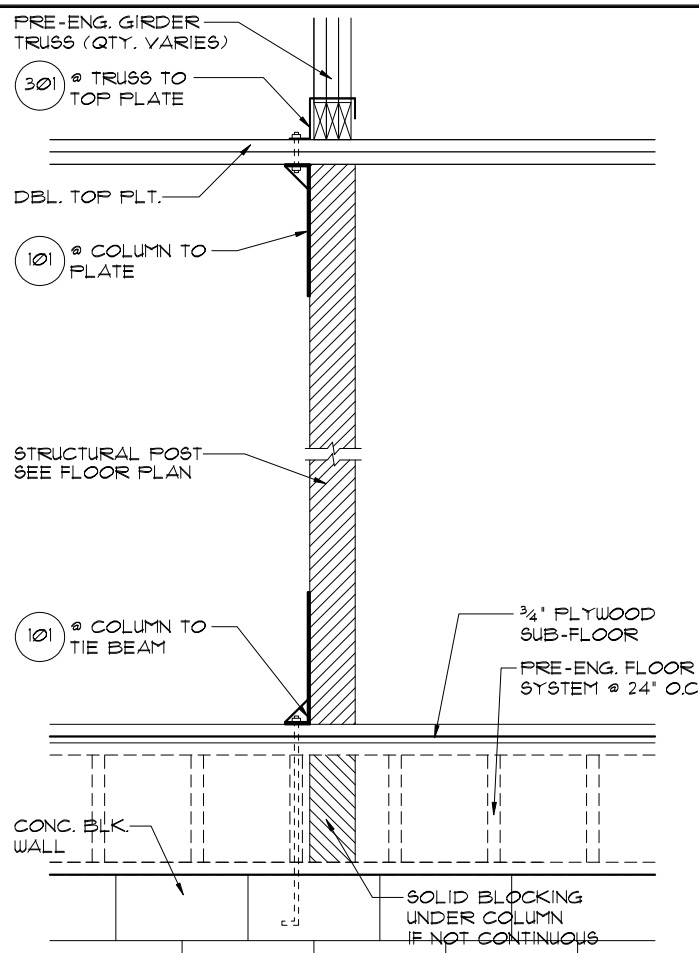


3 DETAIL
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

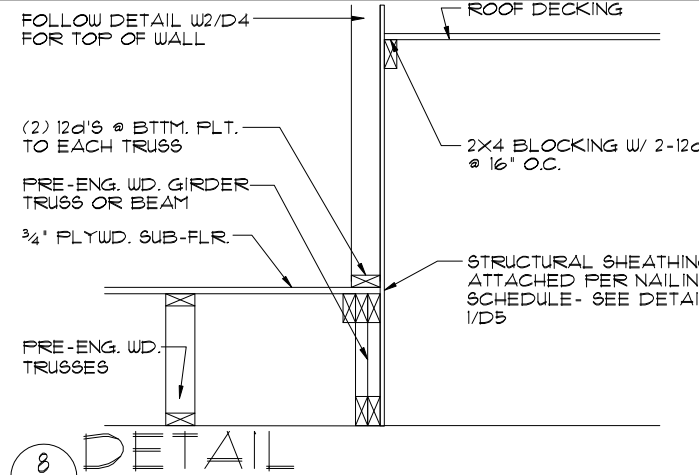


8 DETAIL
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

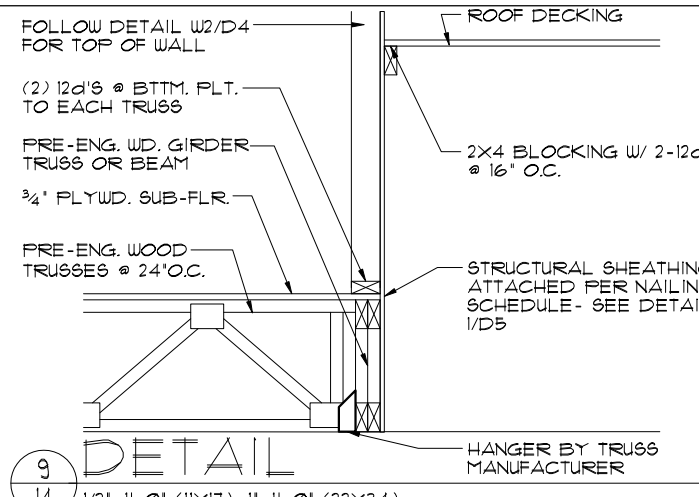


9 DETAIL
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

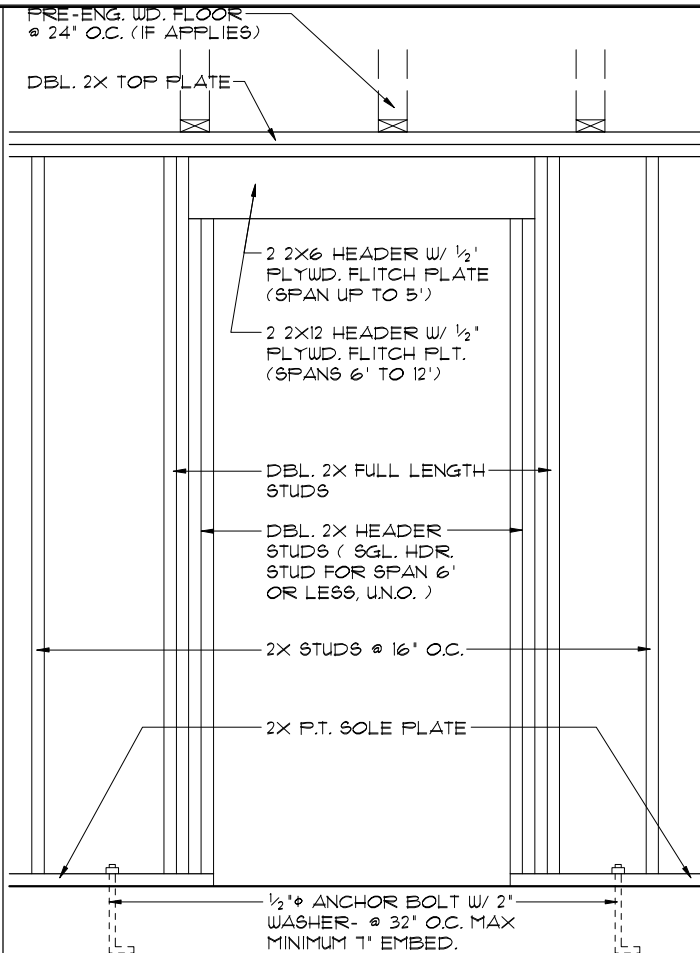


2 DETAIL (BRG. W/O UPLIFT)
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

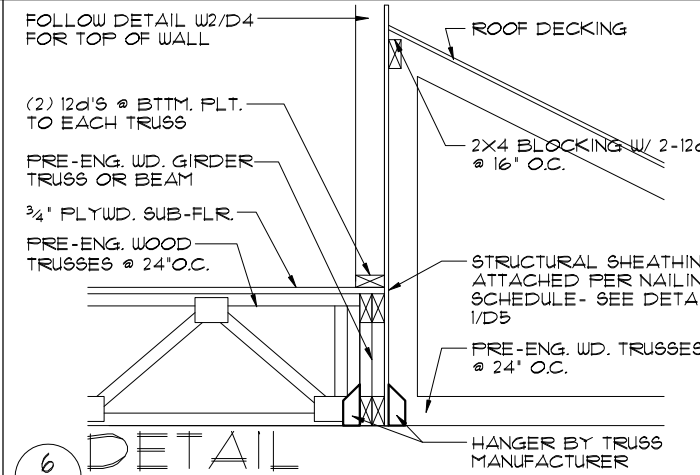


6 DETAIL
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

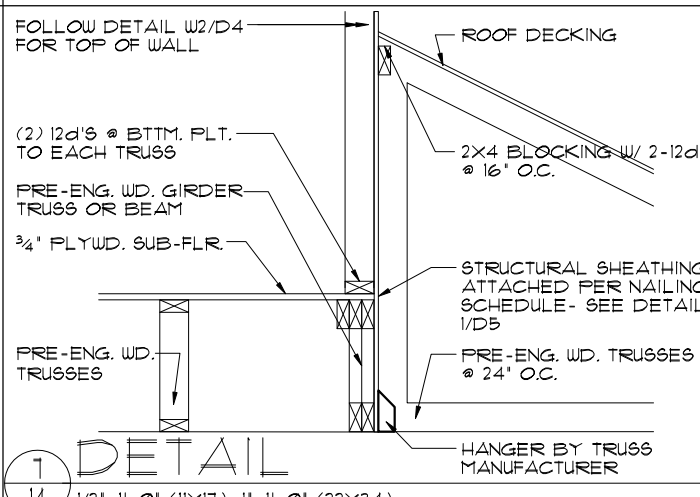

1 DETAIL
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

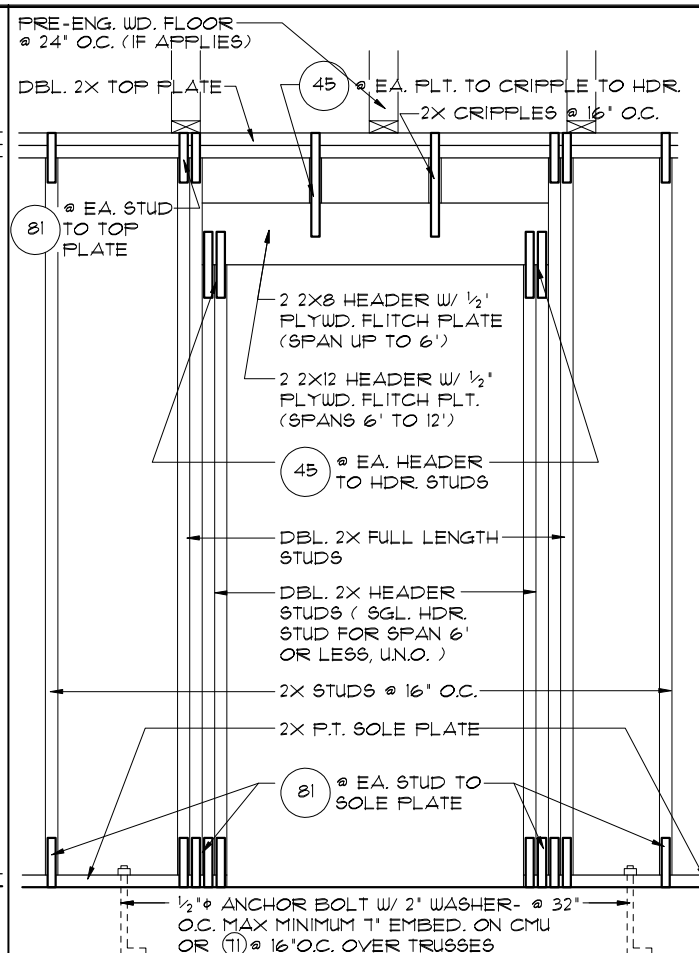

1 DETAIL (BRG. W/ UPLIFT)
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

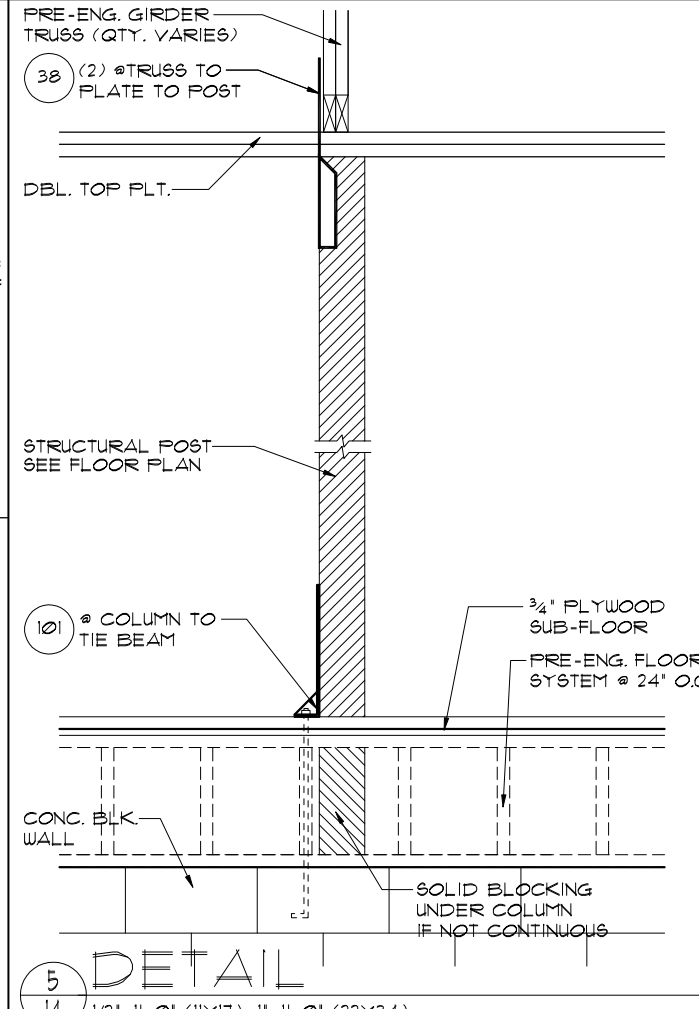

5 DETAIL
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1st EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

PARADISO GRANDE

A DIVISION OF PARK SQUARE ENTERPRISES, INC.

5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000


TYPICAL DETAILS

REFE PARADISO GRANDE


4232
DATE 04-09-21
SCALE AS NOTED
DRAWN RDC
JOB 4232
SHEET 14
OF SHEETS

Engineering By: DBE and C, MICHAEL A. THOMPSON, PE 47509, PHONE 407-721-2292

REVISIONS BY

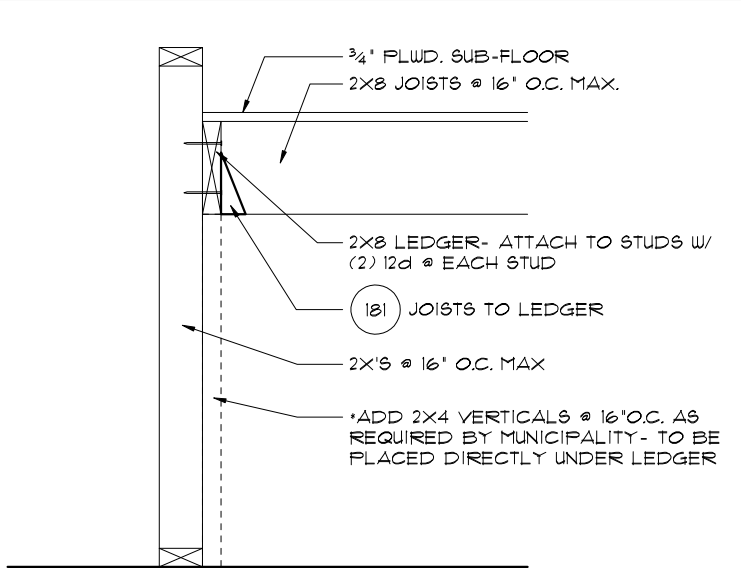

4
15 TYP. STAIR CONNECT.
3/4"= 1'-0" (11X17) 1 1/2"= 1'-0" (22"X34") PLATFORM FRAMING

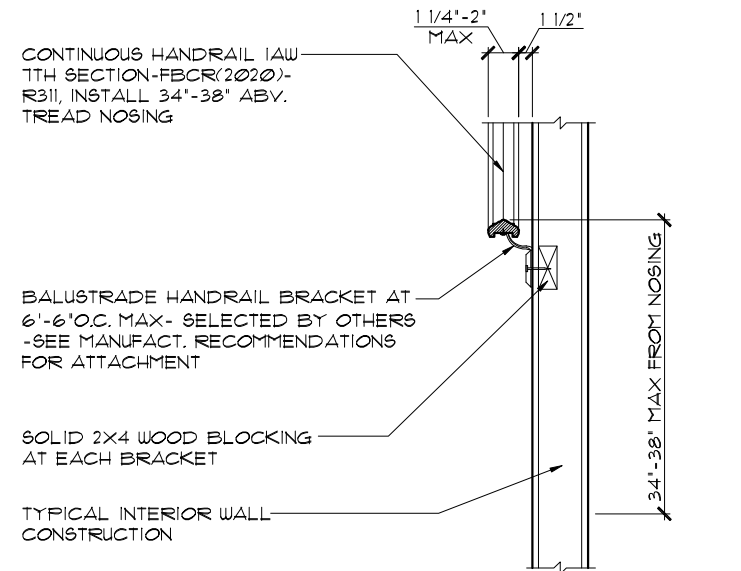

5
15 TYP. HANDRAIL DET.
3/4"= 1'-0" (11X17) 1 1/2"= 1'-0" (22"X34")

NOTES:
STAIRWAY CONSTRUCTION TO CONFORM TO
FBCR 2020, 7TH EDITION SECTION R311.7


MAX. HGT. OF RISER TO BE 7 3/4"
MIN. WIDTH OF TREAD TO BE
9"(EXCLUSIVE OF NOSING)
ALL TREADS LESS THAN 10" IN WIDTH
SHALL HAVE APPROX. 1" OF NOSING
3/16" MAX. VARIATION IN RISERS/TREADS
ADJACENT TO EACH OTHER
3/8" MAX. VARIATION IN ANY RISER/TREAD

HAND RAIL CIRCULAR CROSS SECTION DIA.
TO BE 1 1/4" - 2" OR TO PROVIDE EQUIVALENT
GRASPABILITY.


WINDERS: MIN. 6" WIDE @ NARROW END

34"MIN.-38"MAX., HANDRAIL HGT.


HEADROOM CLEARANCE MIN. 6'-8"

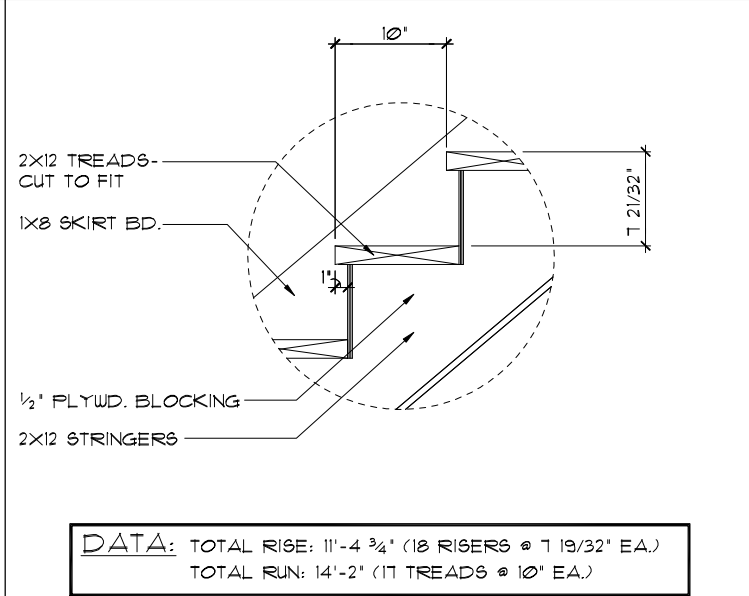

1
15 STAIR DETAIL
3/4"= 1'-0" (11X17) 1 1/2"= 1'-0" (22"X34") STAIR DATA

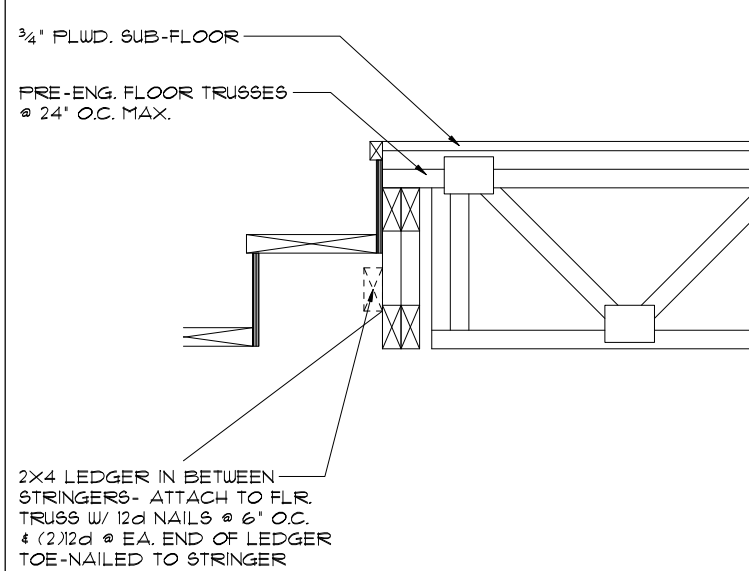

2
15 TYP. STAIR CONNECT.
3/4"= 1'-0" (11X17) 1 1/2"= 1'-0" (22"X34") STRINGER TO FLOOR TRUSS

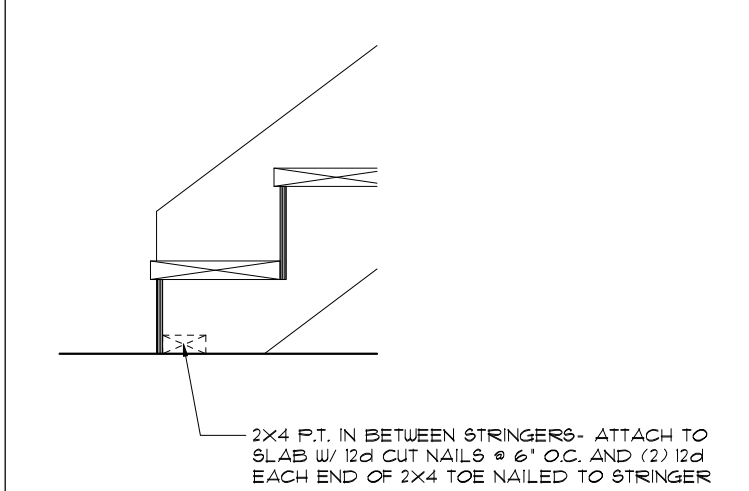

3
15 TYP. STAIR CONNECT.
3/4"= 1'-0" (11X17) 1 1/2"= 1'-0" (22"X34") STRINGER TO FLOOR

CONNECTOR SCHEDULE						
CONNECT. TYPE	SIMPSON		USP		MAX. UPLIFT	LAT. LDS. FI / F2
	DESCRIPTION	FASTENERS PER CONNECTOR	DESCRIPTION	FASTENERS PER CONNECTOR		
4	HETA20	14-10d x 1 1/2"	ETA20	14-10d	1810	65 / 960
5	DETAL20	18-10d x 1 1/2"	N/A	N/A	2,480	2000/ 1370
20	H3	RFT: 4-8d / PLT: 4-8d	RT3	RFT: 4-8d / PLT: 4-8d	455	125 / 160
21	H1	RFT: 6-8dx1 1/2" / PLT: 4-8d	RT15	RFT: 5-8dx1 1/2" / PLT: 5-8d	475	485 / 165
22	H10S	RFT: 8-8d x 1 1/2" PLT: 8-8d x 1 1/2"	RT16	RFT: 8-8d x 1 1/2" PLT: 8-8d	930	585/525
23	LU526	HDR: 4-10d/JST: 4-10d	JU526	HDR: 4-10d/JST: 4-10d	935	N/A
24	H7	RFT / TR5: 4-8d PLT / STD: 10-8d	RT20	RFT / TR5: 9-10d PLT / STD: 13-10d	985	400 / N/A
26	H25	RFT: 5-8d / PLT: 5-8d	RT1	RFT: 5-8d / PLT: 5-8d	415	150 / 150
34	A34	H: 4-8dx1 1/2" / P: 4-8dx1 1/2"	MP34	H: 4-8dx1 1/2" / P: 4-8dx1 1/2"	365	280 / 303
35	A35F	H: 4-8dx1 1/2" / P: 4-8dx1 1/2"	MPA1F	H: 6-8dx1 1/2" / P: 6-8dx1 1/2"	440	440 / N/A
37	MT512	14-10d	MTW12	14-10d	1,000	N/A
38	MT516	14-10d	MTW16	14-10d	1,000	N/A
43	LSTA12	10-10d	LSTA12	10-10d	905	N/A
45	ST18	14-16d	ST18	14-16d	1,200	N/A
47	LSTA24	18-10d	LSTA24	18-10d	1,295	N/A
71	MSTA36	26-10d	MSTA36	26-10d	2,135	N/A
72	MSTC66	64-16d SINKERS	N/A	N/A	5,495	N/A
79	SF1	STD: 6-10d / PLT: 4-10d	SPT22	STD: 4-10d / PLT: 4-10d	535	560 / 260
80	SF2	STD: 6-10d / PLT: 6-10d	SPT224	STD: 6-10d / PLT: 6-10d	605	560 / 260
81	SPH468	12-10d x 1 1/2"	TP46,48	12-10d x 1 1/2"	885	N/A
90	ABU66	12-16d	PAU66	12-16d	2,240	N/A
89	CB66	(2) 5/8" BOLTS	PA8X8	4-10d	2,300	985
92	ABU44	12-16d	PAU44	12-16d	2,200	N/A
93	AC6 (MAX)	28-16d	PBS66	24-16d	1,815	1,070
94	AC4 (MAX)	28-16d	PBS44	24-16d	1,815	1,070
95	HTS20	20-10d	HTW20	20-10d	1,450	N/A
96	HD8A	SILL: 1/8" BOLT STUD: (3) 1/8" X 5 1/2" BOLTS	HHD8A	SILL: 1/8" BOLT STUD: (3) 1/8" X 5 1/2" BOLTS	7,910	N/A
97	MTT28B	24-16d	MTS21B	24-16d	4,455	N/A
98	HTT16	SILL: 5/8" BOLT STRAP: 18-16d	HTT16	SILL: 5/8" BOLT STRAP: 18-16d	4,175	N/A
99	A35	H: 4-8dx1 1/2" / P: 4-8dx1 1/2"	MPA1	H: 6-8dx1 1/2" / P: 6-8dx1 1/2"	440	440 / N/A
100	HTT22	5/8" BOLT / 32-16d Sinkers	HTT22	3/4" BOLT / 32-16d	5,260	N/A
101	HTT4	5/8" BOLT / 18-16d X 2 1/2"	N/A	N/A	3,640	N/A
102	HTT5	5/8" BOLT / 26-10d	N/A	N/A	4,275	N/A
103	VGTR/L	32-6DS 1/4" X 3" / (2) 5/8" BLT	N/A	N/A	3,990	N/A
104	HDU8-SDS25	7/8" BLT / 20-SDS 1/4" X 2 1/2"	N/A	N/A	5,020	N/A
110	HCP2	12-10d x 1 1/2"	HHCP2	20-10d x 1 1/2"	520	260 / N/A
167	HHU846	H: 14-16d / J: 6-16d	THD46	H: 8-18d / J: 12-10d	1,550	N/A
168	U46	H: 8-10d / J: 4-10d	SHH46	H: 8-16d / J: 4-16d	710	N/A
181	HUS26	20-16d	THD26	H: 20-16d / J: 10-10d	1,550	N/A
184	HUC28-2	H: 14-16d / J: 4-10d	N/A	N/A	1,085	N/A
214	HUC212-3TF	HD: 16-3/16" X 1 1/2" TAPCON BM: 6-16d	HDO212-3	HD: 18-3/16" X 1 1/2" TAPCON BM: 6-10d	1,135	N/A
215	HGU5210-2	HDR: 46-16d / JST: 10-16d	EHUH210-2	HDR: 40-16d / JST: 16-10d	2,720	N/A
216	HUS412	BLOCK: 10-1/4" X 1 1/2" TC JOIST: 10-16d	HUS412	BLOCK: 10-1/4" X 1 1/2" TC JOIST: 10-16d	3,240	N/A
217	HUS212-2	BLOCK: 10-1/4" X 1 1/2" TC JOIST: 10-16d	HUS212-2	BLOCK: 10-1/4" X 1 1/2" TC JOIST: 10-16d	2,630	N/A
219	MBHA412	H: 1-ATR 3/4" X 8 TOP FACE JOIST: 18-10d	NFM35X12U	H: 1-1/2" J-BOLT J: 5-1/2" BOLTS	3,145	N/A
220	N/A	N/A	NFM 3X12	BLK: 1/2" X J / JST: 14-10d	1,620	N/A
226	MBHA4.75/12	HDR: (2) 3/4" X 8" JOIST: 18-10d	NFM45U	HDR: MIN. 1/2" X J BOLT JOIST: (5) 1/2" X BOLTS	2,160	N/A
231	MBHA3.56/16	HDR: (2) 3/4" X 8" JOIST: 18-10d	NFM3.5X16U	HDR: MIN. 1/2" X J BOLT JOIST: (5) 1/2" X BOLTS	3,450	N/A
232	MBHA5.50/16	HDR: (2) 3/4" X 8" JOIST: 18-10d	NFM5.5X16U	HDR: MIN. 1/2" X J BOLT JOIST: (5) 1/2" X BOLTS	3,450	N/A
240	H15	R: 4-10dx1 1/2" / P: 4-10dx1 1/2"	N/A	N/A	1,300	480 / N/A
241	LGT2	30-16d-sinker	LUGT2	32-10d	2,000	1015 / 440
301	MG1	(1) 3/4" BLTS / GIR: 22-10d	N/A	N/A	3,965	N/A
302	HGT-2 or 3	LTL: 3/4" BLTS / GIR: 8-10d	USC63	LTL: 3/4" BLTS / GIR: 8-16d	6,485	N/A
303	HGT-4	LTL: 3/4" BLTS / GIR: 16-10d	N/A	N/A	9,250	N/A
401	SUR/L414	FACE: 18-16d / JST: 8-16d	N/A	N/A	1,700	N/A
T	CONNECTORS TO BE SPECIFIED AND PROVIDED BY TRUSS MANUFACTURERS					

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1st EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, PARADISO GRANDE

PARADISO GRANDE

© COPYRIGHT 2015 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

Engineering By
DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

A DIVISION OF PARK SQUARE
ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

Park Square
HOMES

TYPICAL DETAILS /
CONNECTOR SCHEDULE

REEF
PARADISO GRANDE

4232

DATE 04-09-21
SCALE AS NOTED
DRAWN RDC
JOB 4232
SHEET 15
OF SHEETS

16 OF SHEET


REEF

SAFE LOAD TABLES FOR GRAVITY, UPLIFT & LATERAL LOADS

8" PRECAST & PRESTRESSED U-LINTELS									
GRAVITY									
LENGTH	TYPE	8F8-1B	8F12-1B	8F16-1B	8F20-1B	8F24-1B	8F28-1B	8F32-1B	8F36-1B
2'-10" (34')	PRECAST	2302	3166	4473	6039	7526	9004	10472	11936
3'-6" (42')	PRECAST	2302	3166	4473	6039	7526	9004	10472	11936
4'-0" (48')	PRECAST	2029	2646	4473	6039	7526	9004	10472	11936
4'-6" (54')	PRECAST	1651	1781	1913	2051	2189	2327	2465	2603
5'-4" (64')	PRECAST	1184	1223	1301	1380	1458	1537	1615	1694
5'-10" (70')	PRECAST	912	1459	2464	4144	5458	6437	7280	8023
6'-6" (78')	PRECAST	937	1255	2101	3263	4746	6398	8111	9885
7'-6" (90')	PRECAST	167	1029	1675	2610	3839	5336	6913	8541
9'-4" (112')	PRECAST	913	632	1045	1469	1910	2369	2844	3327
10'-6" (126')	PRECAST	456	658	1025	1514	2081	2714	3350	3987
11'-4" (136')	PRECAST	445	598	935	1369	1854	2359	2875	3391
12'-0" (144')	PRECAST	414	545	864	1254	1699	2174	2659	3144
13'-4" (160')	PRECAST	362	427	726	1029	1331	1635	1939	2243
14'-0" (168')	PRECAST	338	381	648	919	1190	1462	1734	2006
14'-8" (176')	PRESTRESSED	NR	455	700	1003	1335	1714	2153	2666
15'-4" (184')	PRESTRESSED	NR	NR	NR	NR	NR	NR	NR	NR
17'-4" (208')	PRESTRESSED	NR	310	530	950	1400	1800	2200	2600
19'-4" (232')	PRESTRESSED	NR	NR	NR	NR	NR	NR	NR	NR
21'-4" (256')	PRESTRESSED	NR	240	400	750	1030	1400	1720	2030
22'-0" (264')	PRESTRESSED	NR	NR	NR	NR	NR	NR	NR	NR
24'-0" (288')	PRESTRESSED	NR	160	300	570	870	1250	1660	2110

8" PRECAST W/ 2" RECESS DOOR U-LINTELS									
GRAVITY									
LENGTH	TYPE	8R16	8R16-1B	8R16-1B	8R16-1B	8R16-1B	8R16-1B	8R16-1B	8R16-1B
4'-4" (52')	PRECAST	1489	1951	3053	4362	5854	7526	9298	11070
4'-6" (54')	PRECAST	1351	1871	2782	3954	5275	6747	8369	10041
5'-8" (68')	PRECAST	785	1032	1602	2350	3258	4326	5454	6642
5'-10" (70')	PRECAST	735	1023	1591	2331	3239	4307	5435	6563
6'-8" (80')	PRECAST	822	1071	1641	2390	3300	4370	5500	6670
7'-6" (90')	PRECAST	665	914	1384	2054	2864	3834	4864	5934
9'-8" (116')	PRECAST	371	535	928	1491	2179	2915	3651	4387

8" PRECAST & PRESTRESSED U-LINTELS									
UPLIFT									
LENGTH	TYPE	8F8-1T	8F12-1T	8F16-1T	8F20-1T	8F24-1T	8F28-1T	8F32-1T	8F36-1T
2'-10" (34')	PRECAST	2121	2818	4101	5332	6563	7794	9025	10256
3'-6" (42')	PRECAST	2121	2818	4101	5332	6563	7794	9025	10256
4'-0" (48')	PRECAST	1818	2415	3698	4929	6160	7391	8622	9853
4'-6" (54')	PRECAST	1660	2257	3540	4771	5992	7223	8454	9685
5'-4" (64')	PRECAST	1393	1990	3273	4504	5735	6966	8197	9428
5'-10" (70')	PRECAST	1272	1869	3152	4383	5614	6845	8076	9307
6'-6" (78')	PRECAST	1141	1738	3031	4262	5493	6724	7955	9186
7'-6" (90')	PRECAST	959	1556	2839	4070	5301	6532	7763	8994
9'-4" (112')	PRECAST	801	1398	2681	3912	5143	6374	7605	8836
10'-6" (126')	PRECAST	716	1313	2596	3827	5058	6289	7520	8751
11'-4" (136')	PRECAST	666	1263	2477	3708	4939	6170	7401	8632
12'-0" (144')	PRECAST	607	1204	2418	3649	4880	6111	7342	8573
13'-4" (160')	PRECAST	500	1100	2314	3545	4776	6007	7238	8469
14'-0" (168')	PRECAST	458	1058	2272	3503	4734	5965	7196	8427
14'-8" (176')	PRESTRESSED	NR	243	395	547	699	851	1003	1155
15'-4" (184')	PRESTRESSED	NR	228	380	532	684	836	988	1140
17'-4" (208')	PRESTRESSED	NR	188	330	472	614	756	898	1040
19'-4" (232')	PRESTRESSED	NR	165	307	449	591	733	875	1017
21'-4" (256')	PRESTRESSED	NR	145	287	429	571	713	855	997
22'-0" (264')	PRESTRESSED	NR	142	284	426	568	710	852	994
24'-0" (288')	PRESTRESSED	NR	121	263	405	547	689	831	973

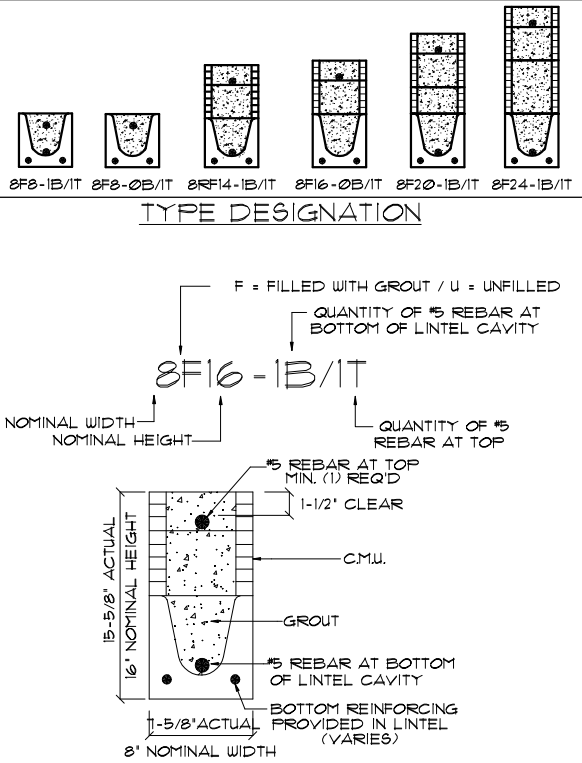

MATERIALS

1. f'c precast lintels = 3500 psi.
2. f'c prestressed lintels = 6000 psi.
3. f'c grout = 3000 psi w/ maximum 3/8" aggregate.
4. Concrete masonry units (CMU) per ASTM C90 w/ minimum net area compressive strength = 1900 psi.
5. Rebar provided in precast lintel per ASTM A615 GR60. Field rebar per ASTM A615 GR40 or GR60.
6. Prestressing strand per ASTM A416 grade 270 low relaxation.
7. 1/32 wire per ASTM A510.
8. Mortar per ASTM C270 type M or S.





GENERAL NOTES

1. Provide full mortar head and bed joints.
2. Shore filled lintels as required.
3. Installation of lintel must comply with the architectural and/or structural drawings.
4. Lintels are manufactured with 5-1/2' long notches at the ends to accommodate vertical cell reinforcing and grouting.
5. All lintels meet or exceed L/360 vertical deflection, except lintels 17'-4" and longer with a nominal height of 8' meet or exceed L/180.
6. Bottom field added rebar to be located at the bottom of the lintel cavity.
7. 1/32" diameter wire stirrups are welded to the bottom steel for mechanical anchorage.
8. Cast-in-place concrete may be provided in composite lintel in lieu of concrete masonry units.
9. Safe load ratings based on rational design analysis per ACI 318 and ACI 530.

SAFE LOAD TABLE NOTES

1. All values based on minimum 4" bearing. Exception: Safe loads for unfilled lintels must be reduced by 20% if bearing length is less than 6-1/2". Safe loads for all recessed lintels based on 8" nominal bearing.
2. N.R. = Not Rated.
3. Safe loads are total superimposed allowable load on the section specified.
4. Safe loads based on grade 40 or grade 60 field rebar.
5. Additional lateral load capacity can be obtained by the designer by providing additional reinforced masonry above the precast lintel.
6. One #1 rebar may be substituted for two #5 rebars in 8" lintels only.
7. The designer may evaluate concentrated loads from the safe load tables by calculating the maximum resisting moment and shear at d-away from the face of support.
8. For composite lintel heights not shown, use safe load from next lower height.
9. All safe loads in units of pounds per linear foot.

8" PRECAST W/ 2" RECESS DOOR U-LINTELS									
UPLIFT									
LENGTH	TYPE	8R16-1T	8R16-1T	8R16-1T	8R16-1T	8R16-1T	8R16-1T	8R16-1T	8R16-1T
4'-4" (52')	PRECAST	1244	1513	2413	3760	5112	6461	7810	9159
4'-6" (54')	PRECAST	1192	1461	2361	3708	5059	6408	7757	9106
5'-8" (68')	PRECAST	924	1192	1795	2423	3055	3687	4319	4951
5'-10" (70')	PRECAST	896	1164	1767	2400	3032	3664	4296	4928
6'-8" (80')	PRECAST	718	986	1468	1987	2509	3035	3561	4087
7'-6" (90')	PRECAST	688	956	1438	1957	2479	3005	3531	4057
9'-8" (116')	PRECAST	533	821	1203	1623	2043	2463	2883	3303

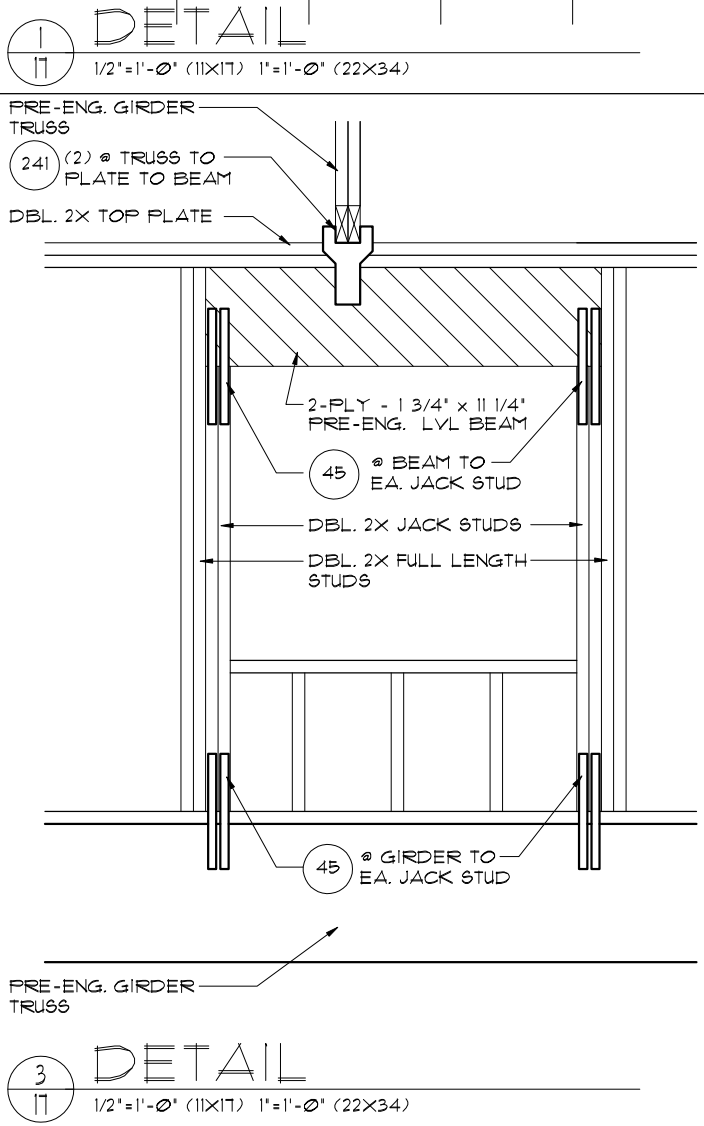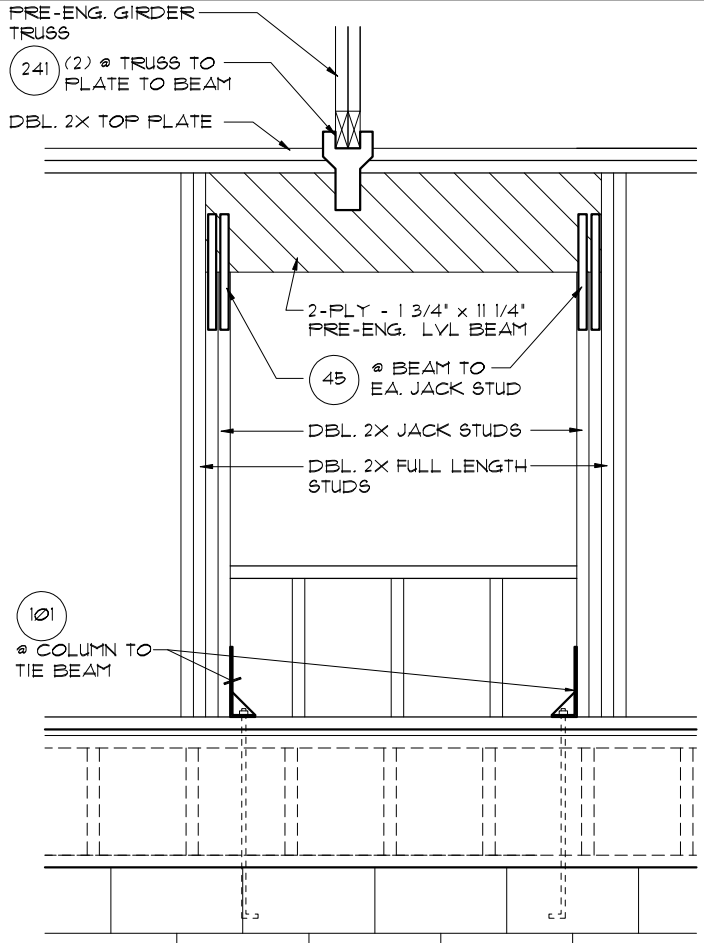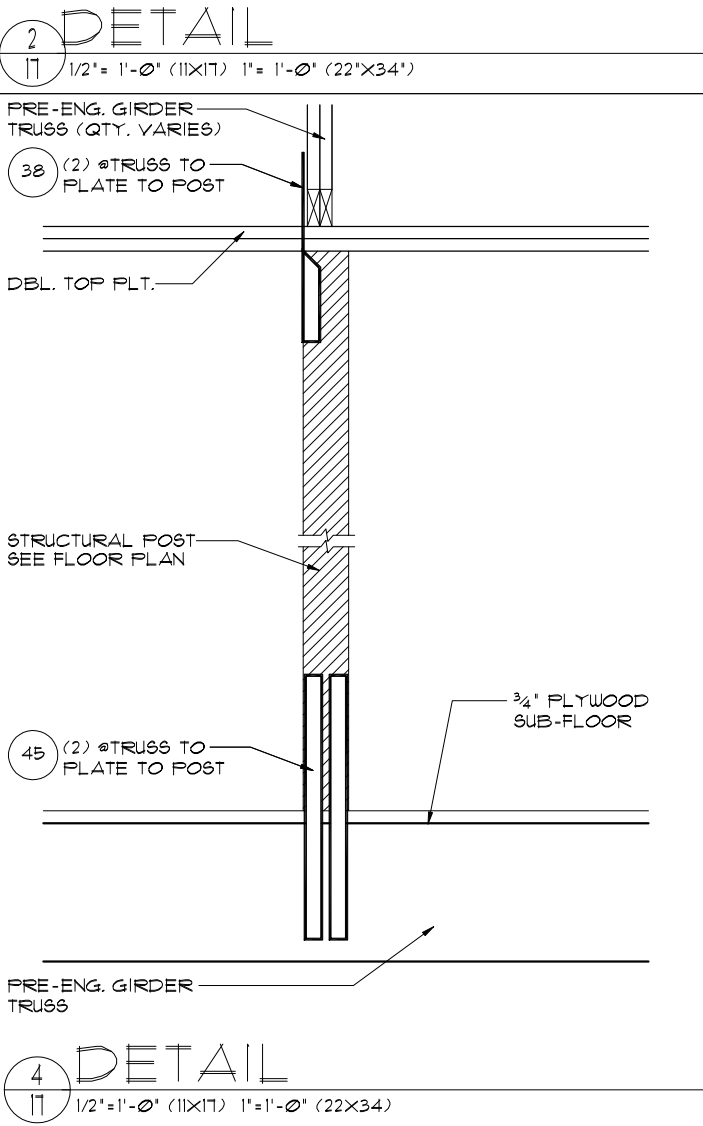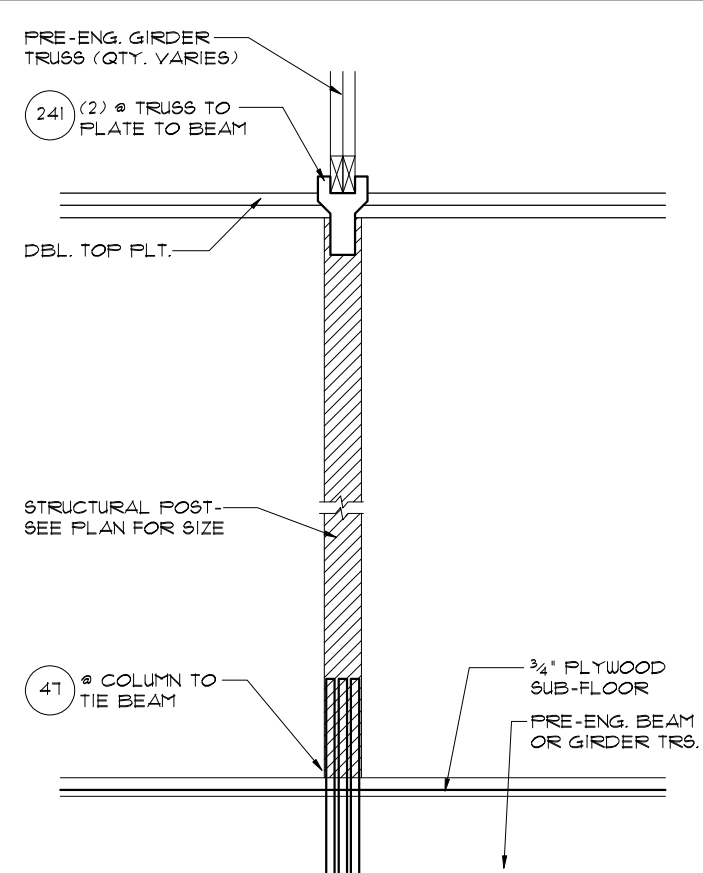

LOT: 0000, PARADISO GRANDE

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 1st EDITION, 2020 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

PARADISO GRANDE

Engineering By:
DBE and C
MICHAEL A. THOMPSON
PE 47509
PHONE 407-721-2292

A DIVISION OF PARK SQUARE ENTERPRISES, INC.
5200 Vineland Road, Suite 200
Orlando, Florida 32811
Phone: (407) 529 - 3000

Park Square HOMES

PRE CAST LINTEL DATA / STRUCTURAL DETAILS

REEF

PARADISO GRANDE

4232

DATE 04-09-21

SCALE AS NOTED

DRAWN RDC

JOB 4232

SHEET 17

OF SHEETS