



PARK SQUARE HOMES
2468 - CATALINA
ELEV. "A", "B", "C", "D"

DISCLAIMER

IT IS THE CONTRACTOR'S SUB-CONTRACTOR'S RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

REVISIONS			REVISIONS			DRAWING INDEX					
REV.#	DATE	DESCRIPTION	REV.#	DATE	DESCRIPTION	PAGE	DESCRIPTION	PAGE	DESCRIPTION	PAGE	DESCRIPTION
	8/21/23	CDs				CO	COVER	4A	ROOF PLAN LAY OUT ELEVATION A	SO	STRUCTURAL NOTES
	11/15/23	2023 CODE UPDATES				CO.1	GENERAL NOTES	4B	ROOF PLAN LAY OUT ELEVATION B	S1	FOUNDATION PLAN
	11/27/23	CLIENT CHANGES				S1	SLAB PLAN ELEVATION A	4C	ROOF PLAN LAY OUT ELEVATION C	S2	FLOOR FRAMING PLAN
	12/5/23	MARK-UPS PER NICK 12/5/23				S2	SLAB PLAN ELEVATION B	4D	ROOF PLAN LAY OUT ELEVATION D	S3	ROOF FRAMING PLAN
	1/4/24	FINAL MARK-UPS PER NICK 1-4-24				S3	SLAB PLAN ELEVATION C	5	INTERIOR ELEVATIONS	L1	LINTEL PLAN
						S4	SLAB PLAN ELEVATION D	5.1	BUILDING SECTION ELEVATION A	D1	STRUCTURAL DETAILS
						S5	SLAB PLAN - OPTIONS	5.1	BUILDING SECTION ELEVATION B	D2	STRUCTURAL DETAILS
						1A	FIRST FLOOR ELEVATION A	5.1	BUILDING SECTION ELEVATION C	D3	STRUCTURAL DETAILS
						1B	FIRST FLOOR ELEVATION B	5.1	BUILDING SECTION ELEVATION D	D4	STRUCTURAL DETAILS
						1C	FIRST FLOOR ELEVATION C	E1	1ST FLOOR ELECTRICAL FLOOR PLANS ELEVATION A	D5	STRUCTURAL DETAILS
						1D	FIRST FLOOR ELEVATION D	E1	1ST FLOOR ELECTRICAL FLOOR PLANS ELEVATION B		
						1E	FIRST FLOOR OPTIONS	E1	1ST FLOOR ELECTRICAL FLOOR PLANS ELEVATION C		
						3A	EXTERIOR ELEVATIONS A	E1	1ST FLOOR ELECTRICAL FLOOR PLANS ELEVATION D		
						3A_1	EXTERIOR ELEVATIONS A	WP1	FLASHING DETAILS		
						3B	EXTERIOR ELEVATIONS B	WP2	FLASHING DETAILS		
						3B_1	EXTERIOR ELEVATIONS B				
						3C	EXTERIOR ELEVATIONS C				
						3C_1	EXTERIOR ELEVATIONS C				
						3D	EXTERIOR ELEVATIONS D				
						3D_1	EXTERIOR ELEVATIONS D				

GENERAL NOTES

1. MISCELLANEOUS
- a. PLANS ARE TO SCALE AS NOTED, UNLESS SPECIFIED N.T.S
DO NOT SCALE PLANS.

b. ALL DIMENSIONS AND SITUATIONS PERTAINING TO THE BUILDING ARE TO BE VERIFIED PRIOR
TO BEGINNING OF CONSTRUCTION. NOTIFY B & A DESIGN STUDIO, INC. OF ANY DISCREPANCIES.

c. ALL WALL THICKNESS DIMENSIONS AS SHOWN ARE NOMINAL. ACTUAL WALL THICKNESS DIMENSIONS
MAY BE + OR -.
2. EXTERIOR WALLS:
- a. ASSUME ALL EXTERIOR WALLS TO BE LOAD BEARING.

b. SEE FOUNDATION PLAN FOR CMU WALL REINFORCEMENT LOCATIONS.

c. INTERIOR SURFACE OF CMU WALL TO HAVE 1/2" GPBD APPLIED TO 1x P.T. VERTICAL FURRING BATTS SPACED
@ 16" O.C. ATTACH FURRING TO CONCRETE WALL AS REQUIRED.

d. SECOND FLOOR EXTERIOR WALLS TO BE WOOD STUDS.
3. INTERIOR WALLS:
- a. WOOD FRAMING:

i. ALL PLATES AND SLEEPERS ON CONCRETE SLAB, WHICH ARE IN DIRECT CONTACT WITH THE EARTH,
SHALL BE PRESSURE TREATED.

ii. ALL INTERIOR WALL PLATES, OTHER THAN SHEAR WALLS, ON CONCRETE SLAB TO BE ATTACHED WITH
POWER ACTUATED FASTENERS, SPACED @ 48" O.C. MAX.

iii. ALL WOOD BRG. INTERIOR PARTITIONS SHALL BE 2x4 STUDS SPACED @ 16" O.C. WITH DOUBLE TOP PLATE.
TOWNHOMES

iv. FIREBLOCKING/ DRAFTSTOPPING TO BE PROVIDED IN THE FLOOR/CEILING ASSEMBLIES ABOVE AND IN
LINE WITH THE TENANT SEPARATION, WHEN TENANT SEPARATION WALLS DO NOT EXTEND TO THE FLOOR
SHEATHING ABOVE AND IN OTHER LOCATIONS PER SECTION R302.11 OF THE 2023 FBCR
8TH EDITION.
COMBUSTIBLE CONSTRUCTION

v. FIREBLOCKING/ DRAFTSTOPPING TO BE PROVIDED TO CUT OFF BOTH VERTICAL AND HORIZONTAL
CONCEALED DRAFT OPENINGS AND TO FORM AN EFFECTIVE FIRE BARRIER BETWEEN STORIES,
AND BETWEEN A TOP STORY AND THE ROOF SPACE PER FBC R302.11, 8TH EDITION.
- a. WOOD:
- a. WOOD CONSTRUCTION SHALL CONFORM TO THE AMERICAN FOREST & PAPER ASSOCIATION (AF&PA)
"NATIONAL SPECIFICATION FOR WOOD CONSTRUCTION", LATEST EDITION.

b. ALL WOOD IN CONTACT WITH CONCRETE OR CONCRETE BLOCK IS TO BE PRESSURE TREATED.

c. SEE STRUCTURAL GENERAL NOTES.
5. FINISHES:
- a. ACCESSIBLE SPACE UNDER STAIRS SHALL BE PROTECTED BY 1/2" GYPSUM BOARD.

b. ALL INTERIOR WALLS SHALL HAVE STANDARD 1/2" GYP BD, EXCEPT IN HIGH HUMIDITY AND WET AREAS.

c. HIGH HUMIDITY AND WET AREAS SHALL HAVE 1/2" DENSSHIELD TILE BACKER GYPSUM BOARD.

d. ALL INTERIOR CEILINGS SHALL HAVE 1/2" SAG- RESISTANT GYP BD.

e. ALL EXTERIOR CEILINGS (PORCH & PATIOS) SHALL HAVE 1/2" SAG- RESISTANT GYP SOFFIT BOARD.

f. STUCCO SURFACES TO HAVE STOPS, WEEP SCREEDS, AND EXPANSION JOINTS PER CODE.

g. TILE IN TUBS, SHOWERS, AND WALL PANELS IN SHOWER AREAS ARE TO HAVE CEMENT, FIBER-CEMENT, OR
GLASS MAT GYPSUM BACKERS R702.3.7 / R702.4.2 2023 FBCR 8TH EDITION.

h. 2023 FBCR 8TH EDITION TABLE R302.6: 5/8" TYPE "X" GYPSUM BOARD OR EQUIVALENT IS REQUIRED FOR A
GARAGE CEILING WITH HABITABLE ROOMS ABOVE. ½" MINIMUM GYPSUM BOARD IS REQUIRED ON GARAGE
SIDE OF INTERIOR WALLS.
6. CABINETS:
- a. CABINET MANUFACTURE'S SHOP DRAWINGS TAKE PRECEDENCE OVER THE INTERIOR CABINET
ELEVATIONS SHOWN ON THESE DRAWINGS.

b. SEE SUPPLIER / MFR'S DRAWINGS FOR KITCHEN, CABINETRY/MILLWORK, AND RESTROOM LAYOUTS.
7. HARDWARE:
- a. ALL LOCKING ARRANGEMENTS SHALL COMPLY WITH NFPA 101.

8. WINDOW & DOORS:
- a. MISCELLANEOUS:
- i. WINDOW AND DOOR SUPPLIERS SHALL PROVIDE CURRENT ROUGH OPENING INFORMATION WHICH,
SHALL HAVE PRECEDENCE OVER THE WINDOW AND DOOR SCHEDULES ON PLAN.

ii. CONTRACTOR AND SUPPLIER TO VERIFY WINDOW LOCATION, TYPE (FIN vs. FLANGE), HEADER HEIGHTS,
AND ROUGH OPENINGS PRIOR TO DELIVERY.

iii. WINDOW ROUGH OPENING INCLUDES 1x P.T. FRAME ATTACHED TO CMU's.

iv. DOOR ROUGH OPENING INCLUDES 2x P.T. FRAME ATTACHED TO CMU's.

v. ALL GLASS LOCATED IN HAZARDOUS LOCATIONS SHALL COMPLY WITH SECTION R308 OF THE 2023
FBCR 8TH EDITION.

vi. WINDOW CONTRACTOR TO VERIFY ROUGH OPENINGS OF ALL FIELD ASSEMBLED FIXED GLASS
WINDOW UNITS PRIOR TO INSTALLATION.

vii. ALL WINDOWS IN WIND BORN DEBRIS AREAS SHALL BE PROTECTED FROM WIND BORN DEBRIS.
PROVIDE SHUTTERS CERTIFIED TO
MEET MIAMI-DADE IMPACT TEST. SHUTTERS MUST BE ROLL-DOWN, PANEL ACCORDIAN OR OTHER
APPROVED DESIGN TYPE. BUILDER TO SUBMIT MANUFACTURER, MODEL NO. INSTALLATION
INSTRUCTIONS, & COPY OF MIAMI-DADE IMPACT TEST DATA FOR PROPOSED SHUTTERS.

viii. GARAGE OVERHEAD DOORS SHALL BE LISTED AND TESTED FOR 30 SECONDS AT DESIGN PRESURE (+/-)
TO INCLUDE A 10 SECOND GUST AT 1.5 TIMES THE DESIGN PRESSURE AND BEAR A PERMANENT DESGIN
LABEL.
- b. INSTALLATION:
- i. WINDOWS & DOORS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S
INSTALLATION INSTRUCTIONS.

ii. ALL WINDOW HEADS SHALL BE SET ABOVE FINISH FLOOR AS FOLLOWS:

1. FIRST FLOOR AT 8'-0".

2. SECOND FLOOR PER PLAN.
- c. ASSEMBLIES:
- i. WINDOW AND DOOR ASSEMBLIES TO CONFORM TO 2023 FBCR CHAPTER 6, SECTION 609

ii. INTERIOR FACE OF WINDOW, FASTEN BUCK TO MASONRY W/ ¼"x 3" TAPCONS, 6" FROM EDGES AND
16" O.C. MAX. 2x P.T. BUCKS/NAILERS SHALL EXTEND BEYOND.

iii. BUCKS LESS THAN 2x TO BE FASTENED W/ CUT NAILS OR EQUIVALENT. STRUCTURAL CONNECTION
OF WINDOW TO STRUCTURE BY OTHERS IN THIS CASE.

iv. SEE EXTERIOR ELEVATIONS FOR STYLE AND DIVIDED LITE CONFIGURATIONS.
- d. TESTING:
- i. EXTERIOR WINDOWS AND SLIDING DOORS SHALL BE TESTED AND COMPLY WITH AAMA/WDMA/CSA
101/I.S.2/A440 OR TAS 202 (HVHZ SHALL COMPLY WITH TAS 202 AND ASTM E1300). EXTERIOR SIDE
HINGED DOORS SHALL COMPLY WITH AAMA/WDMA/CSA 101/1.S.2/A440 OR ANSI/WMA100 OR
SECTION R609.5 IN THE 2023 FBCR.

ii. ALL GARAGE/OVERHEAD DOORS SHALL BE LISTED AND TESTED FOR 30 SECONDS AT DESIGN PRESSURE
(+/-) TO INCLUDE A 10 SECOND GUST AT 1.5 TIMES THE DESIGN PRESSURE.
9. INSULATION:
- a. INSULATE ALL EXTERIOR FRAME WALLS WITH R-13 BATT FIBERGLASS INSULATION.

b. INSULATE CONDITIONED ATTIC SPACE WITH R-30 BLOWN FIBERGLASS. INACCESSIBLE ATTIC SPACE
SHALL RECEIVE R-30 BATT INSULATION.

c. INSULATE ALL CMU WALLS (THAT REQUIRE 1" P.T. FURRING STRIPS) WITH R4.1 FI-FOIL PANELS.

d. APPLY HILTI FOAM FILLER AT EXTERIOR WALLS AROUND:

i. WINDOW FRAMES

ii. EXTERIOR DOOR FRAMES

iii. GAPS AROUND PIPES, VENTS, OUTLETS, ETC.

e. INSULATE ALL ATTIC KNEE WALLS WITH R-30 BATTS.

f. APPLY OWENS CORNING ENERGY COMPLETE TO THE TOP OF ALL CONDINTIONED SPACE
WALLS THAT INTERACT WITH UNCONDITIONED ATTIC SPACE ABOVE.

DISCLAIMER

IT IS THE CONTRACTOR'S/ SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.





PARK SQUARE HOMES
2468 CATALINA
MASTER

Title:
GENERAL NOTES

project no.2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

CO_1

COPYRIGHT © 2023 KEESEE ASSOCIATES RESERVES COPYRIGHT & OTHER RIGHTS RESTRICTING THESE DOCUMENTS TO THE ORIGINAL SITE OR PURPOSE FOR WHICH THEY WERE PREPARED. REPRODUCTIONS, CHANGES OR ADJUSTMENTS ARE PROHIBITED.

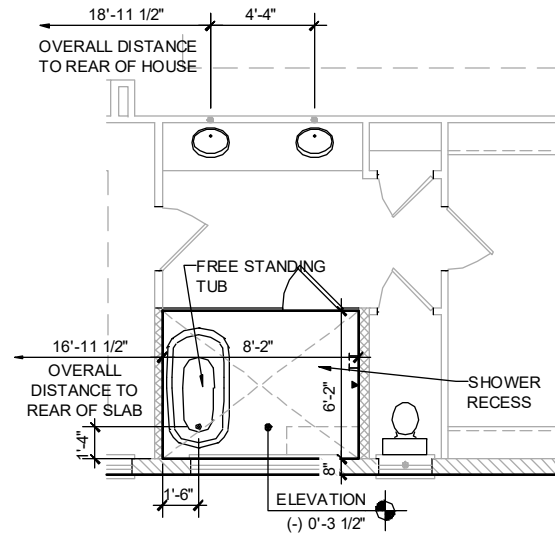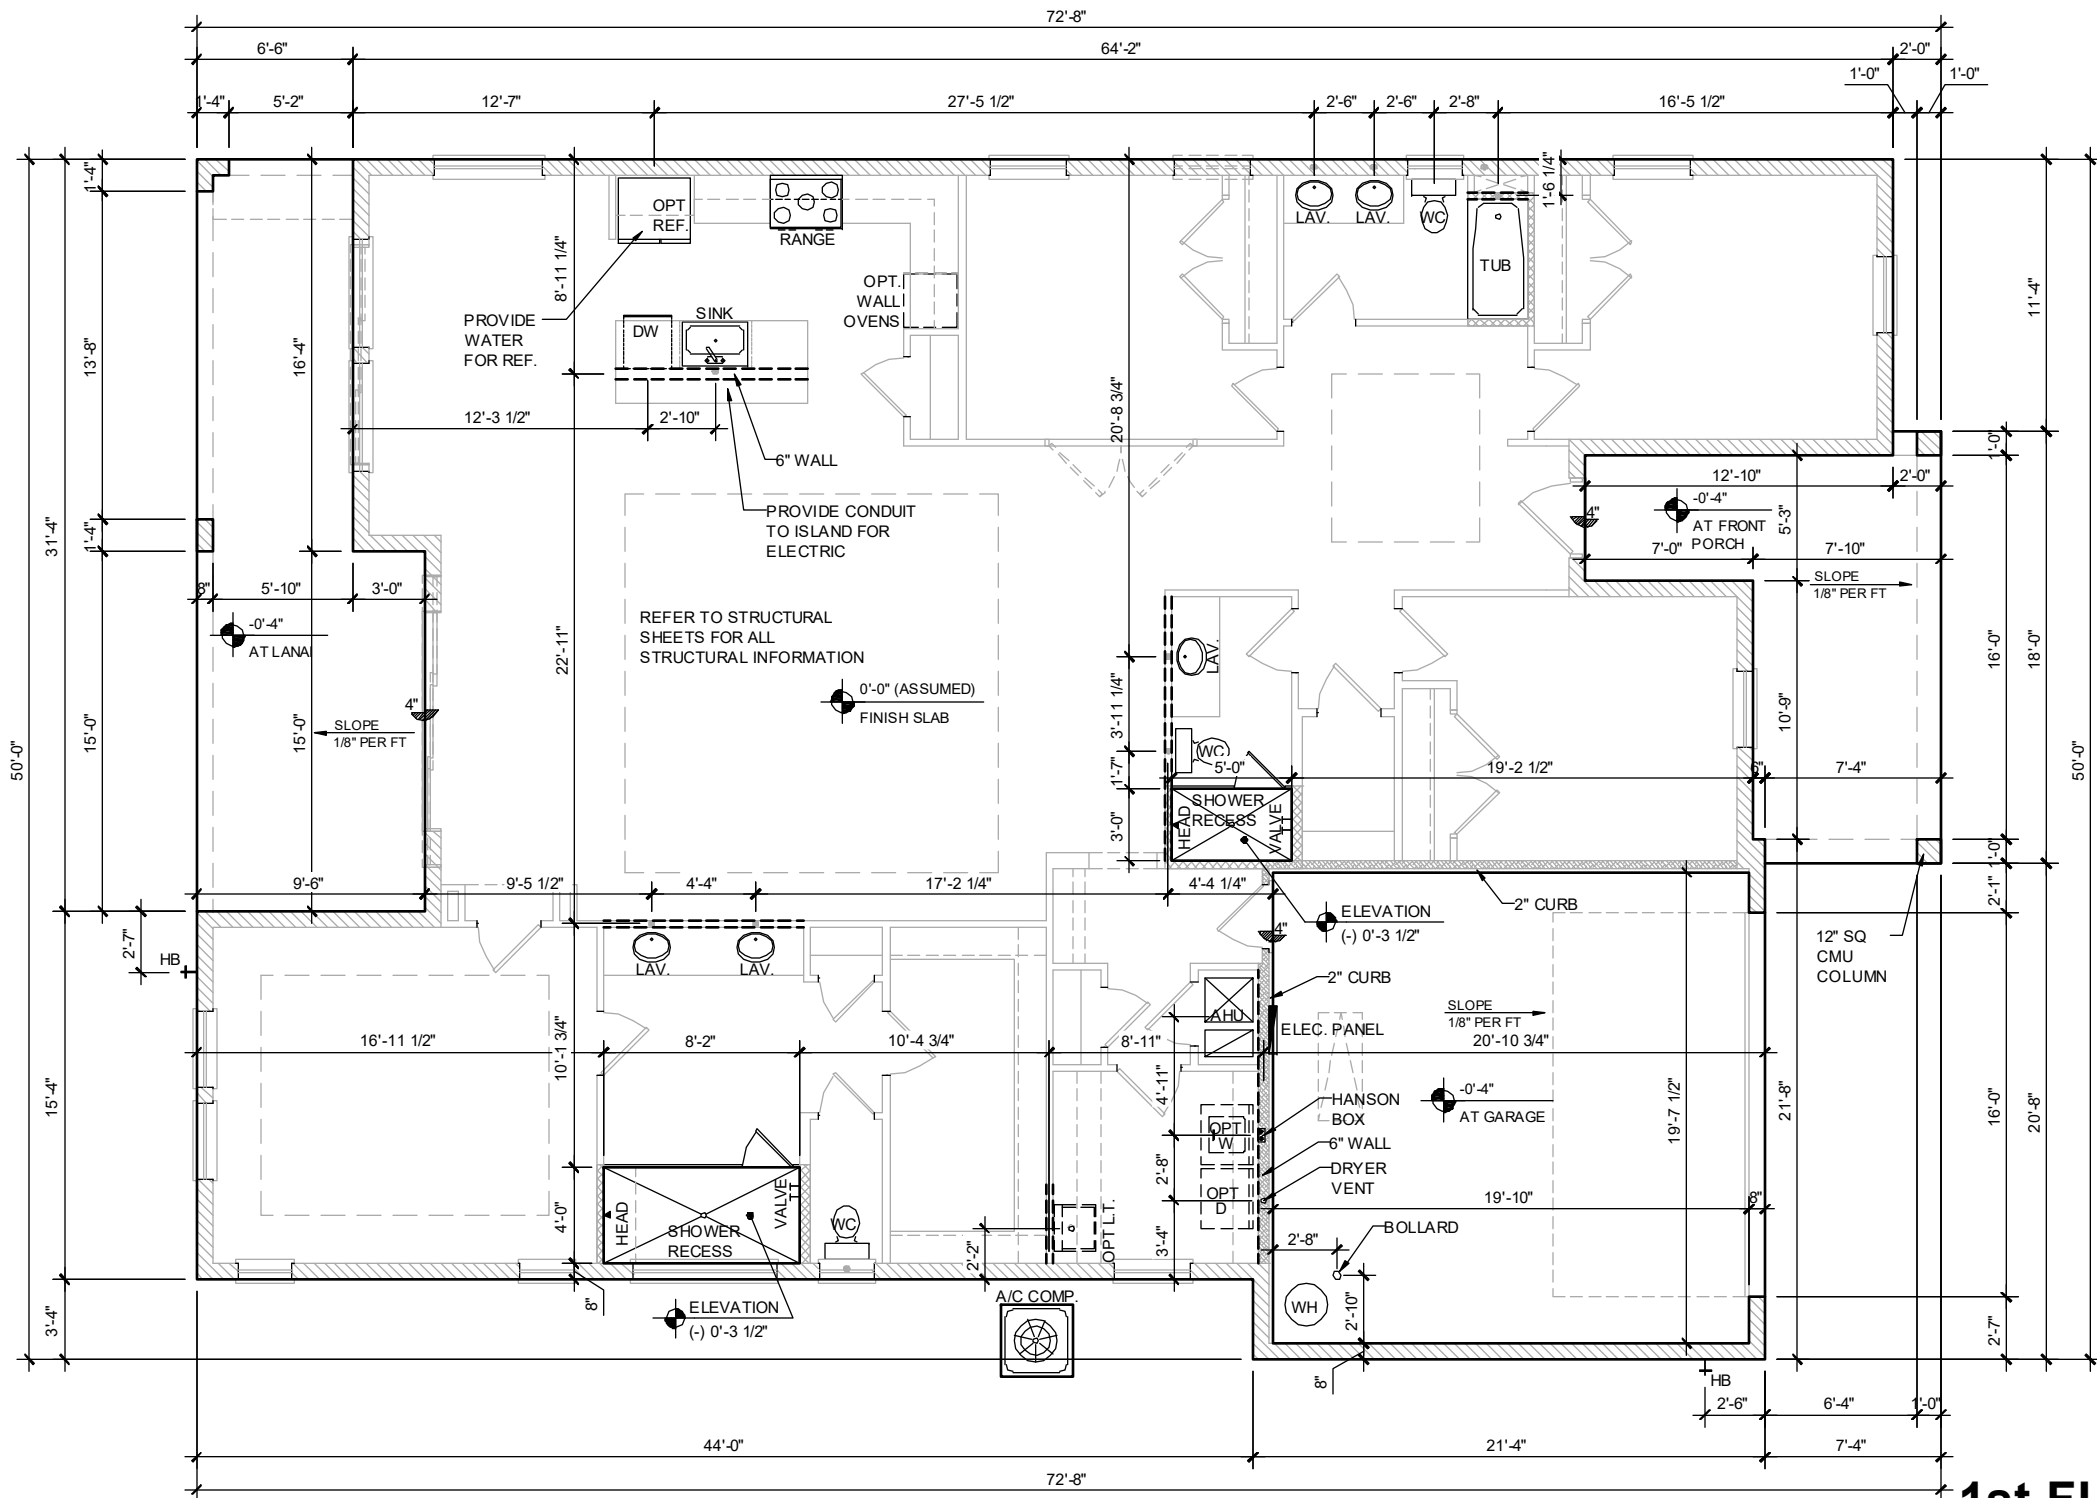

1st FLOOR SLAB PLAN ELEV. "A"

1/8" = 1'-0"

WATER HEATER:
PROVIDE MIN. 40 GALLON WATER HEATER

WATER HEATERS SHALL BE INSTALLED A MIN. OF 18" ABOVE FLOOR PER FBCE G2408.2

EXCEPTION:
APPLIANCES THAT ARE LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT.
DO NOT HAVE TO HAVE THE IGNITION SOURCE ELEVATED.

WET AREAS:
ALL WET AREAS TO BE FRAME WITH STUDS @ 16" O.C.


AREA CALCULATION	
1st FLR. LIVING	2,468 SQ. FT.
TOTAL LIVING	2,468 SQ. FT.
FRONT PORCH	171 SQ. FT.
LANAI	249 SQ. FT.
GARAGE	425 SQ. FT.
TOTAL UNDER ROOF	3,313 SQ. FT.

DISCLAIMER

IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

LEGEND

INDICATES 8x8x16 (NOM.) C.M.U. (EXTERIOR LOAD BEARING) 10'-0" TOP OF CMU
INDICATES WALLS TO BE UTILIZED FOR TRUSS BEARING 2x4 WOOD STUDS @ 16" O.C. U.N.O.
INDICATES WOOD STUDS 24" O.C. MAX. (NON LOAD BEARING INTERIOR PARTITIONS ONLY.) (U.N.O.)
INDICATES WET WALLS, 2X WOOD STUDS @ 12" O.C.



KEESEE ASSOCIATES
ARCHITECTURE | DESIGN | PLANNING
A03003115

248 Bushland Lane Suite 200
Hollywood, FL 33071
352.971.1205
keesee.com

AL



BD

ITEG

THOMPSON ENGINEERING GROUP, INC.
4401 Windward Road Suite A9 Orlando, FL 32811
Ph: (407) 734-1450
Fax: (407) 734-1750
www.iteg.com

PARK SQUARE HOMES
2468 CATALINA
MASTER

Title:
1ST. FLOOR
SLAB PLAN
project no.2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN
S1

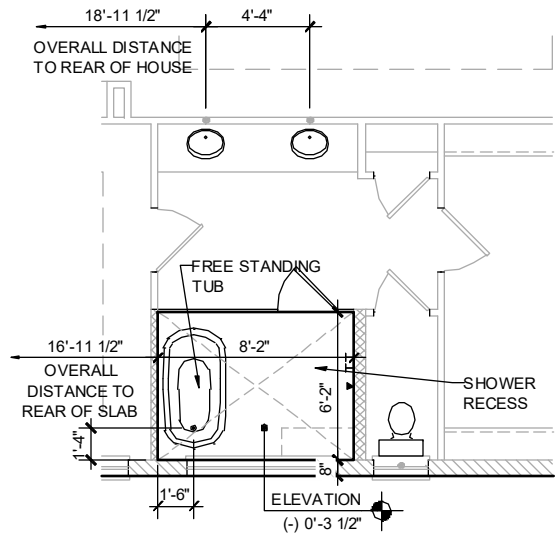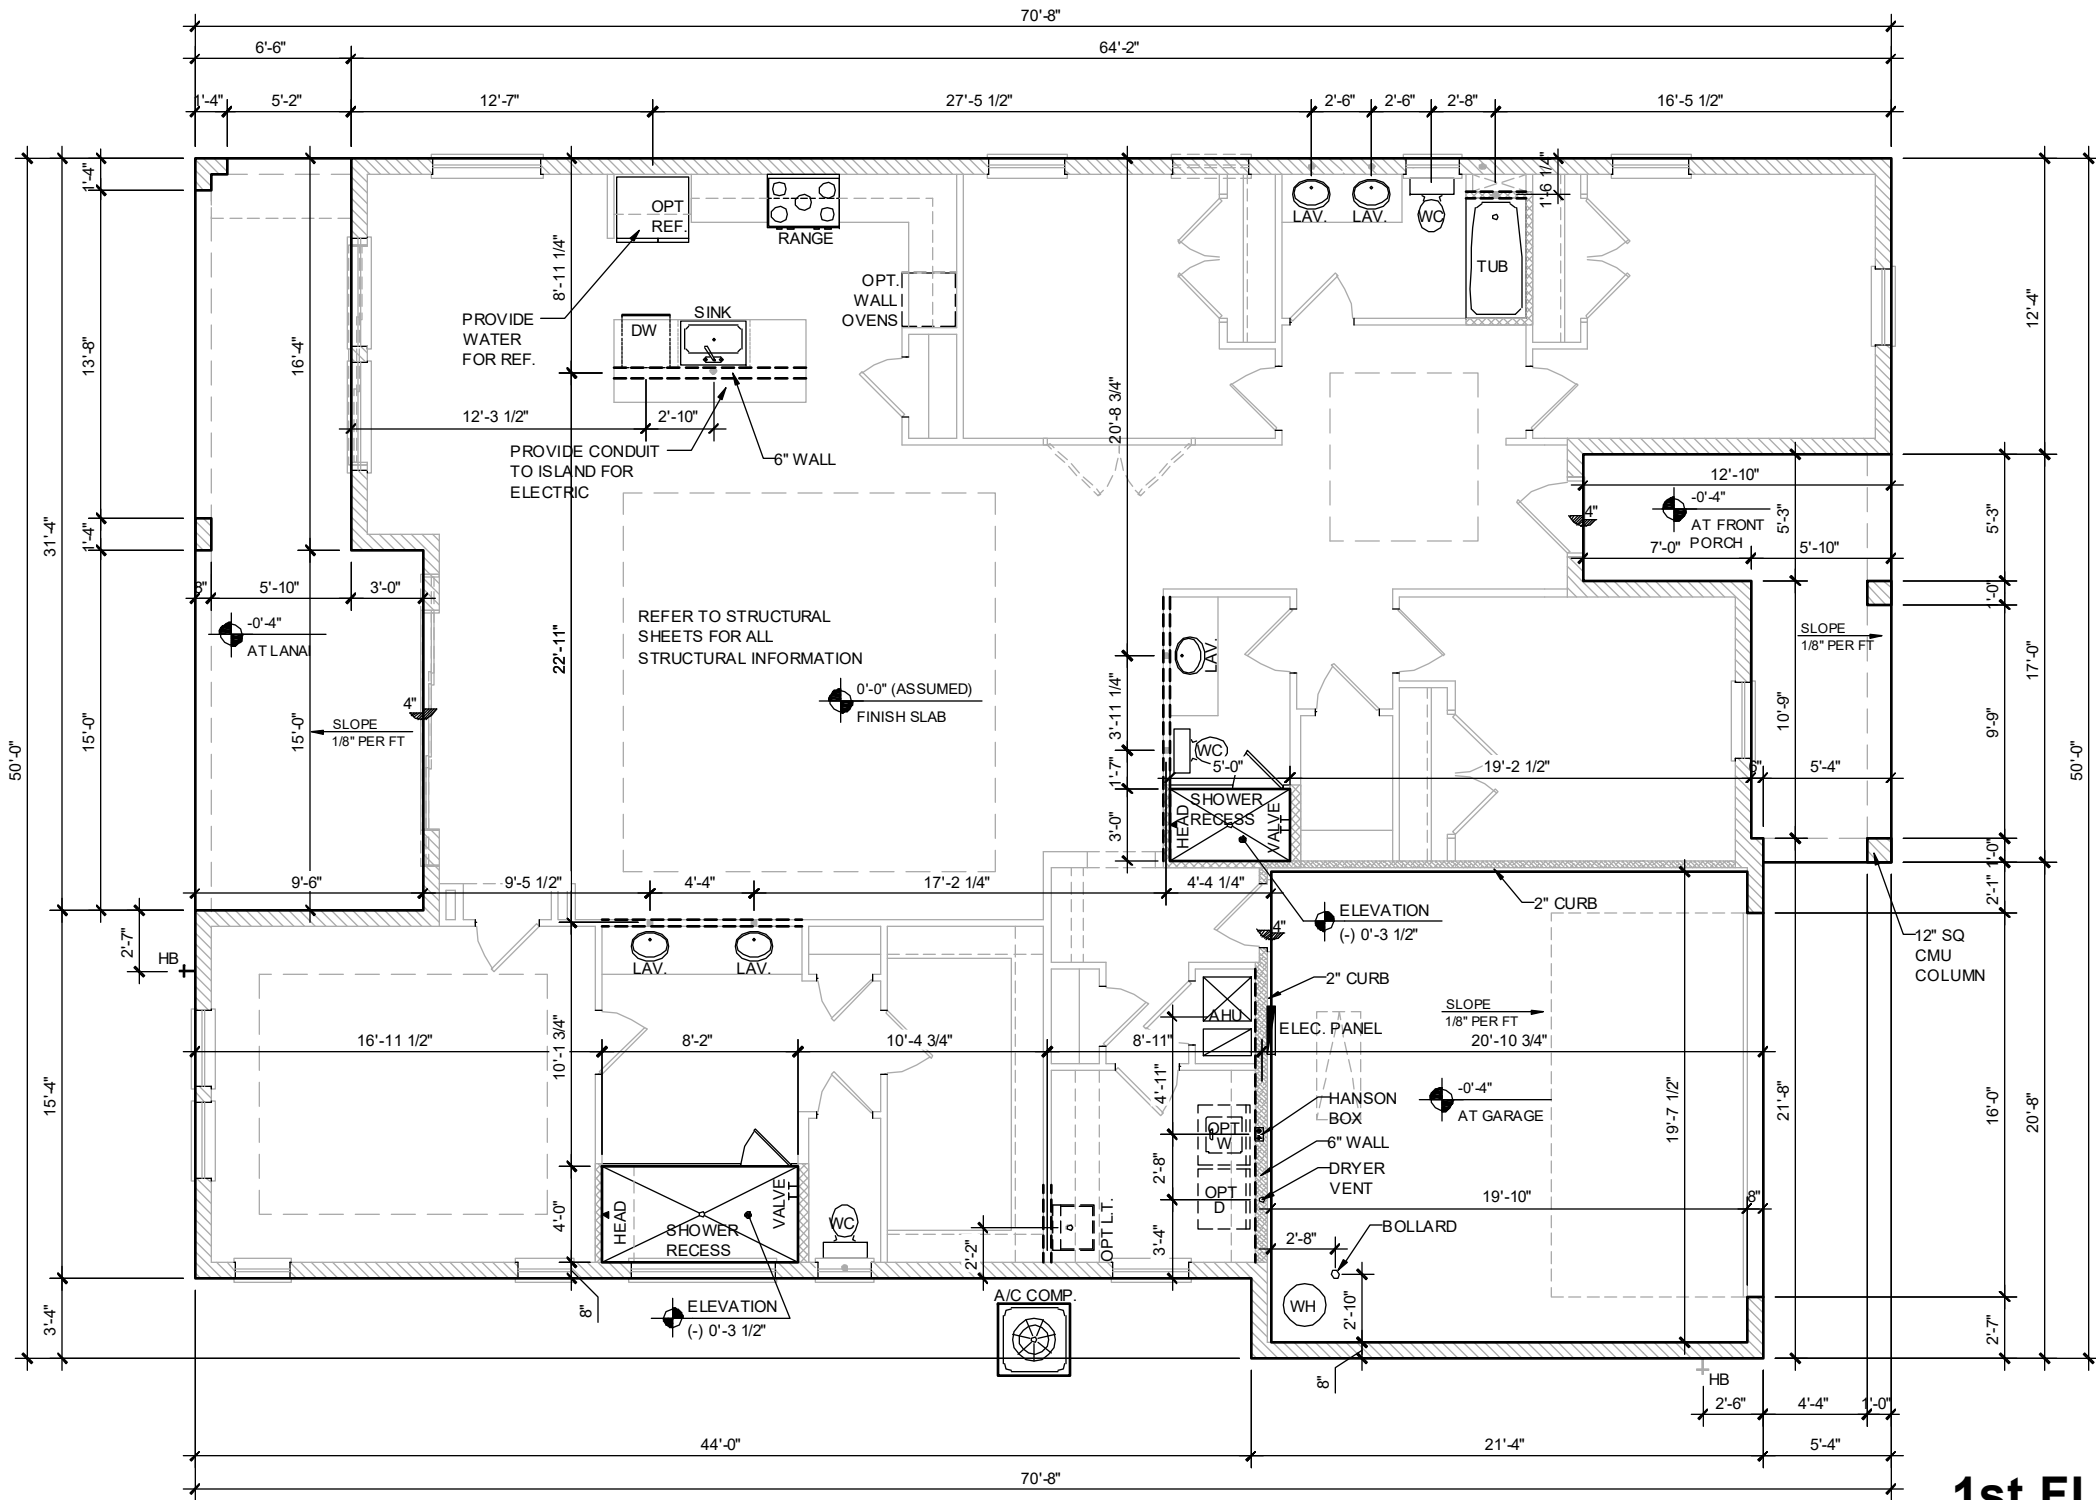

1st FLOOR SLAB PLAN ELEV. "B"

1/8" = 1'-0"

WATER HEATER:
PROVIDE MIN. 40 GALLON WATER HEATER

WATER HEATERS SHALL BE INSTALLED A MIN. OF 18" ABOVE FLOOR PER FBCR G2408.2

EXCEPTION:
APPLIANCES THAT ARE LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. DO NOT HAVE TO HAVE THE IGNITION SOURCE ELEVATED.

WET AREAS:
ALL WET AREAS TO BE FRAME WITH STUDS @ 16" O.C.

AREA CALCULATION	
1st FLR. LIVING	2,468 SQ. FT.
TOTAL LIVING	2,468 SQ. FT.
FRONT PORCH	171 SQ. FT.
LANAI	249 SQ. FT.
GARAGE	425 SQ. FT.
TOTAL UNDER ROOF	3,313 SQ. FT.

DISCLAIMER

IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

LEGEND

- INDICATES 8x8x16 (NOM.) C.M.U. (EXTERIOR LOAD BEARING) 10'-0" TOP OF CMU
- INDICATES WALLS TO BE UTILIZED FOR TRUSS BEARING 2x4 WOOD STUDS @ 16" O.C. U.N.O.
- INDICATES WOOD STUDS 24" O.C. MAX. (NON LOAD BEARING INTERIOR PARTITIONS ONLY.) (U.N.O.)
- INDICATES WET WALLS, 2X WOOD STUDS @ 12" O.C.

KEESEE ASSOCIATES ARCHITECTURE | DESIGN | PLANNING

2468 Catalina Way, Suite 200
Orlando, FL 32811
407.724.1750
www.teegee.com

AL, BD, CE, DE, FE, GE, HE, IE, JE, KE, LE, ME, NE, OE, PE, QE, RE, SE, TE, UE, VE, WE, XE, YE, ZE

ITEG



THOMPSON ENGINEERING GROUP, INC.
4401 Windward Road Suite A9 Orlando, FL 32811
Ph: (407) 724-1950
Fax: (407) 724-1750
www.iteg.com

PARK SQUARE HOMES
2468 CATALINA
MASTER

title:
1ST. FLOOR
SLAB PLAN

project no.2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

S2

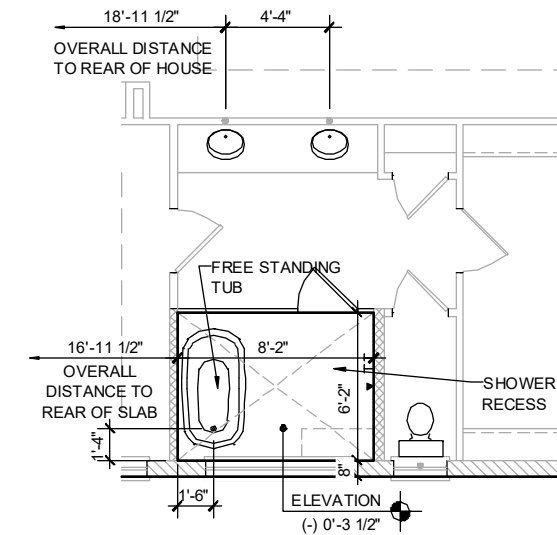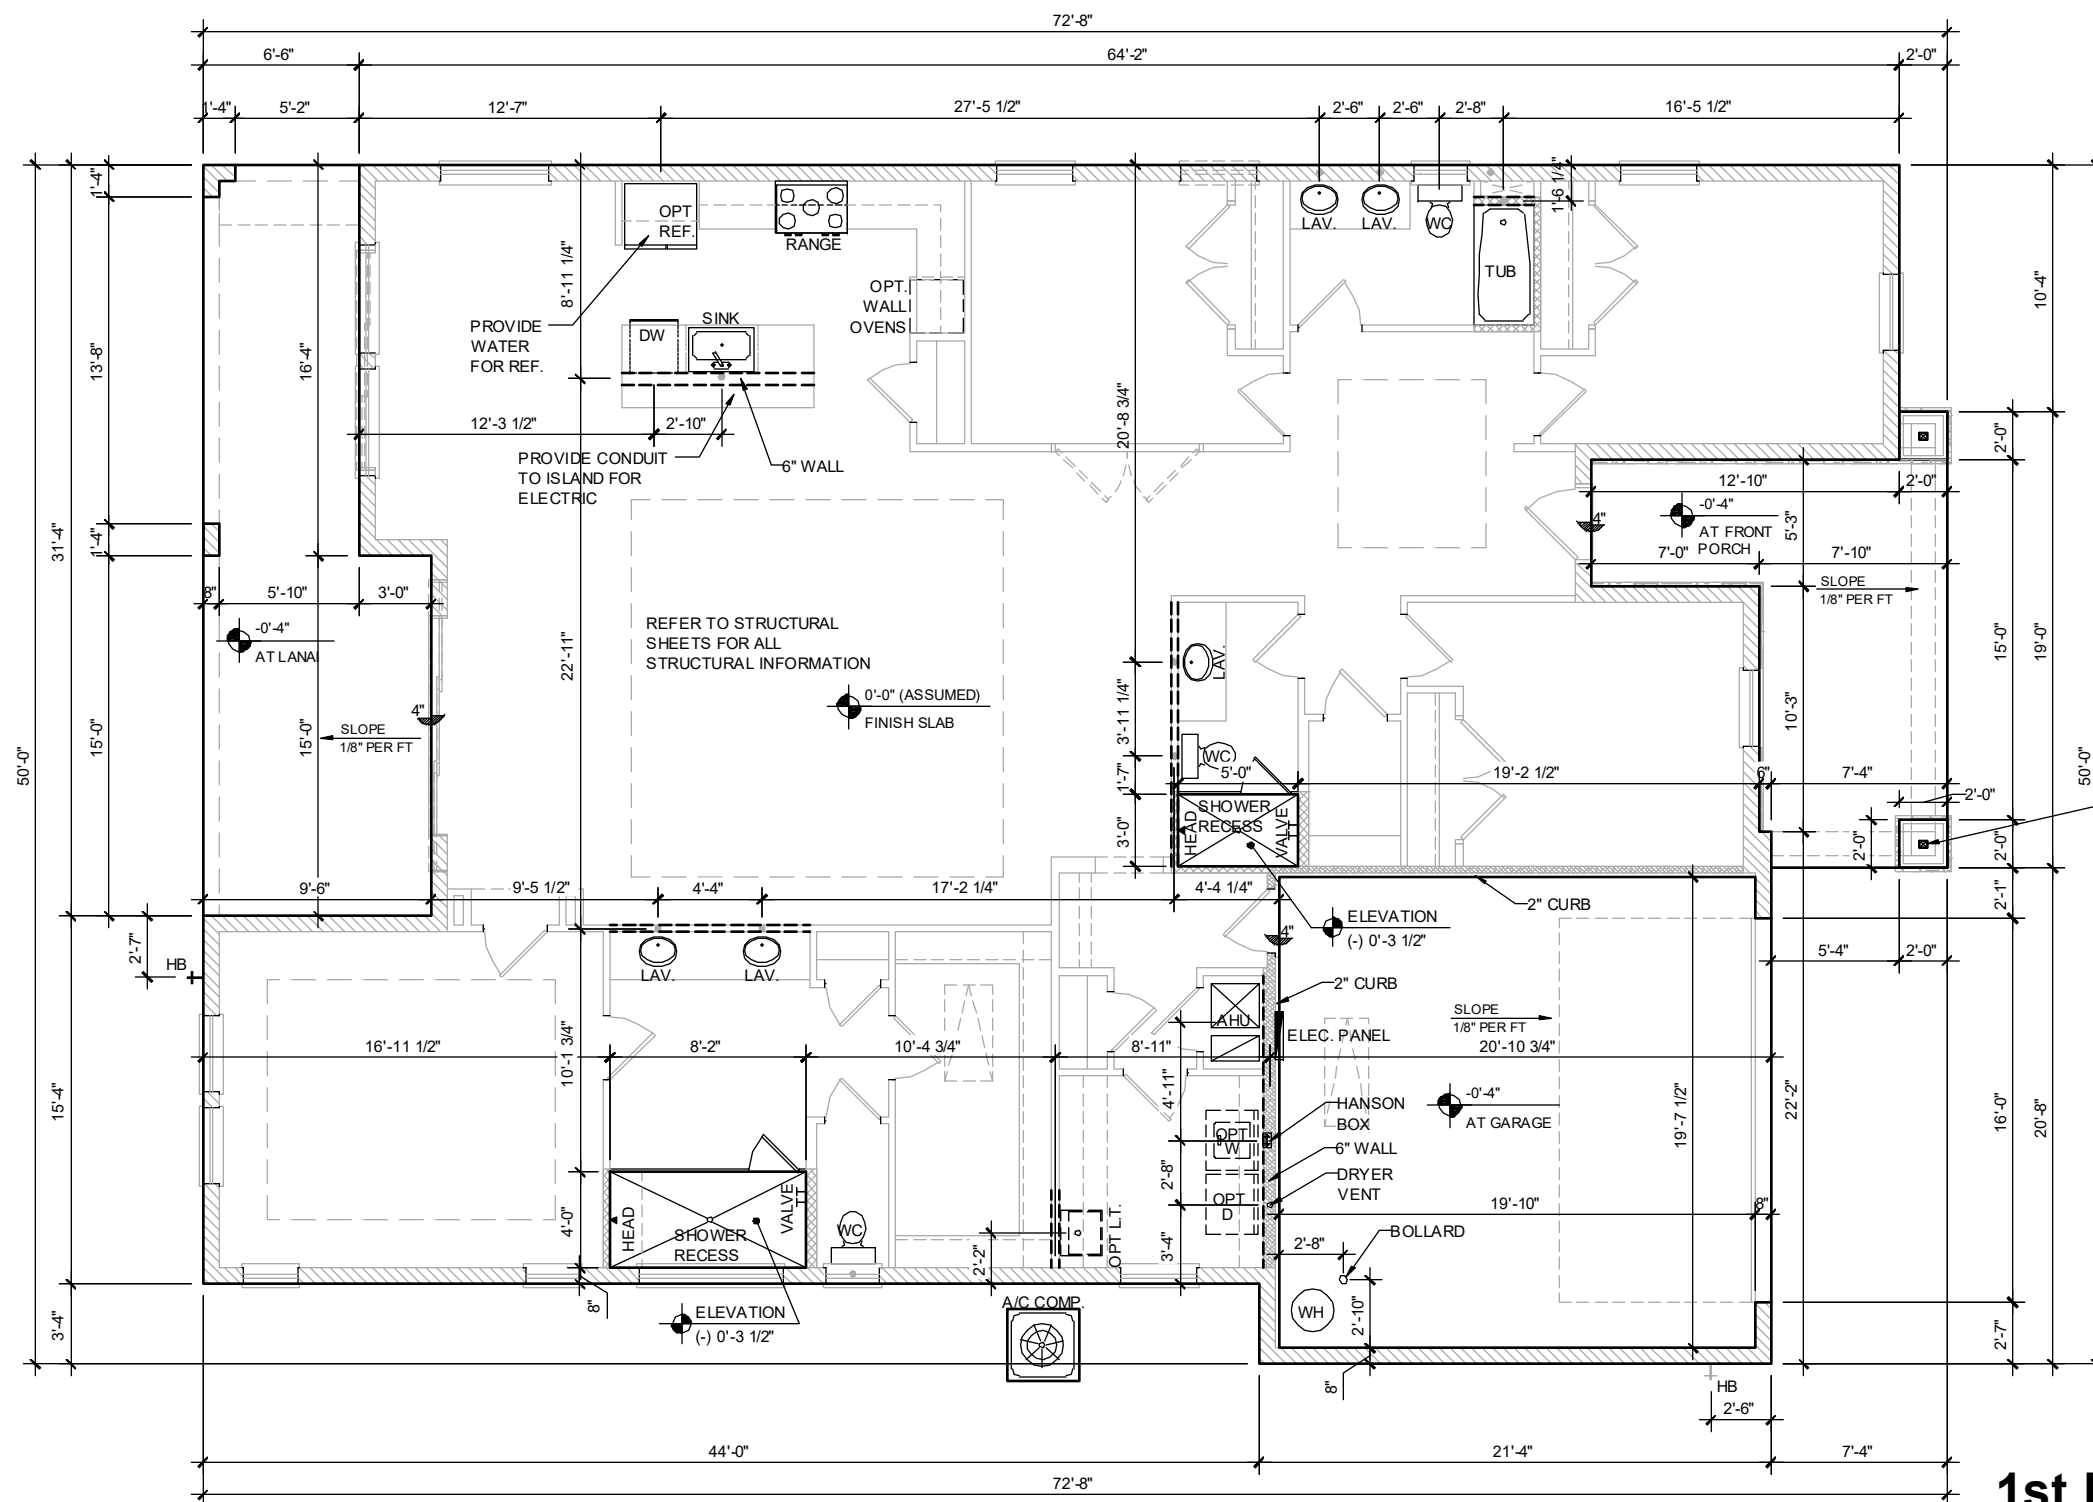

PARTIAL OPTION STANDING
TUB WET AREA SLAB PLAN

$$1/8" = 1'-0"$$

4X4 POST WITH 12" NECK
20" BASE TAPERED
CRAFTSMAN HARDIE
COLUMN WRAP ON
24" SQ. CMU BASE

1st FLOOR SLAB PLAN ELEV. "C"

$$1/8'' = 1'-0''$$

WATER HEATER:
PROVIDE MIN. 40 GALLON WATER HEATER

WATER HEATERS SHALL BE INSTALLED A MIN. OF 18" ABOVE FLOOR PER FBCR
G2408.2

EXCEPTION:
APPLIANCES THAT ARE LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT.
DO NOT HAVE TO HAVE THE IGNITION SOURCE ELEVATED.

WET AREAS:
ALL WET AREAS TO BE FRAME WITH STUDS @ 16" O.C.

AREA CALCULATION	
1st FLR. LIVING	2,468 SQ. FT.
TOTAL LIVING	2,468 SQ. FT.
FRONT PORCH	171 SQ. FT.
LANAI	249 SQ. FT.
GARAGE	425 SQ. FT.
TOTAL UNDER ROOF	3,313 SQ. FT.

DISCLAIMER

IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOMER CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

LEGEND



LEGEND
INDICATES 8x8x16 (NOM.) C.M.U. (EXTERIOR LOAD BEARING) 10'-0" TOP OF CMU
INDICATES WALLS TO BE UTILIZED FOR TRUSS BEARING 2x4 WOOD STUDS @ 16" O.C. U.N.O.
INDICATES WOOD STUDS 24" O.C. MAX.
(NON LOAD BEARING INTERIOR PARTITIONS ONLY.) (U.N.O.)
INDICATES WET WALLS, 2X WOOD STUDS @ 12" O.C.

title;

1ST. FLOOR
SLAB PLAN

project no.2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

S3

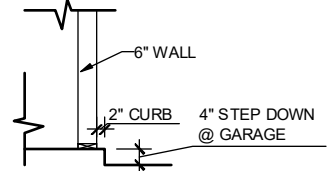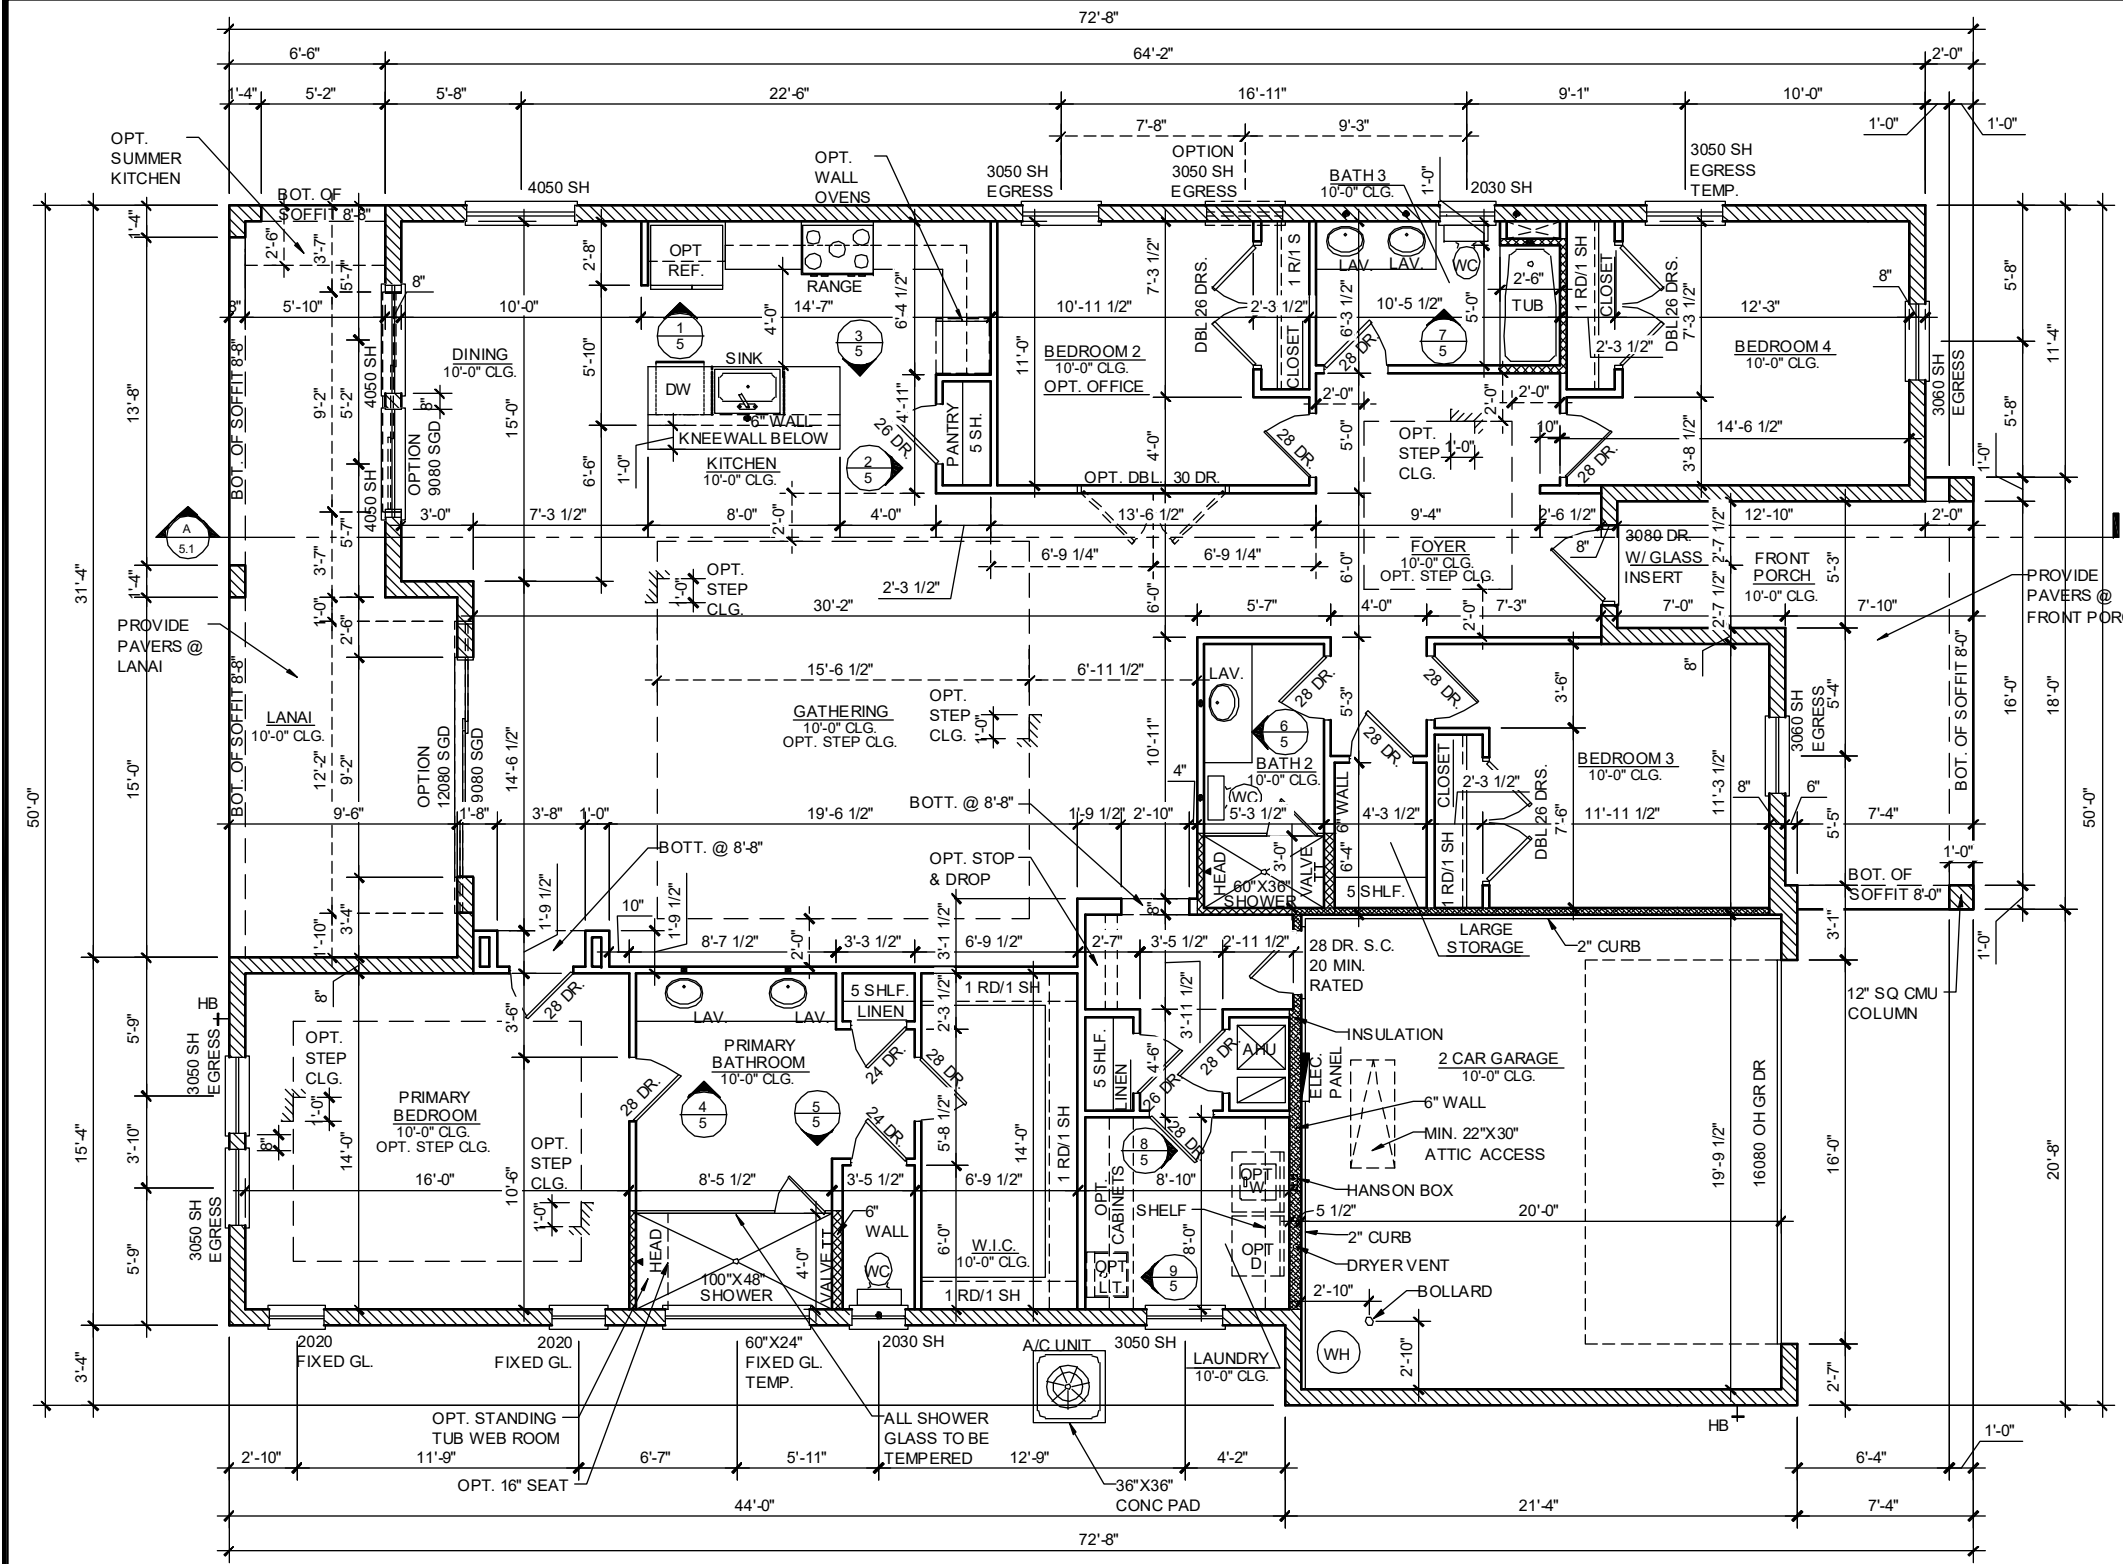

NOTE: SEE COLOR SHEET FOR INTERIOR DOOR HEIGHT REQUIREMENTS.

1st FLOOR PLAN ELEV. "A"

1/8" = 1'-0"

WATER HEATER:
PROVIDE MIN. 40 GALLON WATER HEATER

WATER HEATERS SHALL BE INSTALLED A MIN. OF 18" ABOVE FLOOR PER FBCE G2408.2

EXCEPTION:
APPLIANCES THAT ARE LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. DO NOT HAVE TO HAVE THE IGNITION SOURCE ELEVATED.

WET AREAS:
ALL WET AREAS TO BE FRAME WITH STUDS @ 16" O.C.

WINDOWS SCHEDULE GENERAL NOTES:

- CONTRACTOR AND SUPPLIER TO VERIFY WINDOW SIZES, LOCATION, TYPE (FIN vs. FLANGE) AND HEADER HEIGHTS PRIOR TO DELIVERY.
 - HEADER HEIGHTS ARE DIMENSIONED ABOVE FINISH FLOOR (A.F.F.)
 - WINDOW G.C. TO VERIFY ROUGH OPENINGS OF ALL FIELD ASSEMBLED FIXED GLASS WINDOW UNITS PRIOR TO INSTALLATION.
- SEE EXTERIOR ELEVATIONS FOR STYLE AND DIVIDED LITE CONFIGURATIONS.
 - HEIGHT AT ROUND TOP ALLOWS 2" FOR ARCH FRAMING.
 - ALL WINDOWS ON 1ST. FLOOR TO BE 8'-0" HDR. U.N.O.


AREA CALCULATION	
1st FLR. LIVING	2,468 SQ. FT.
TOTAL LIVING	2,468 SQ. FT.
FRONT PORCH	171 SQ. FT.
LANAI	249 SQ. FT.
GARAGE	425 SQ. FT.
TOTAL UNDER ROOF	3,313 SQ. FT.

DISCLAIMER

IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

LEGEND

- INDICATES 8x8x16 (NOM.) C.M.U. (EXTERIOR LOAD BEARING) 10'-0" TOP OF CMU
- INDICATES WALLS TO BE UTILIZED FOR TRUSS BEARING 2x4 WOOD STUDS @ 16" O.C. U.N.O.
- INDICATES WOOD STUDS 24" O.C. MAX. (NON LOAD BEARING INTERIOR PARTITIONS ONLY.) (U.N.O.)
- INDICATES WET WALLS, 2X WOOD STUDS @ 12" O.C.



Keese Associates
ARCHITECTURE | DESIGN | PLANNING
A03003115

248 S. Bunkie Lane, Suite 200
Hollywood, FL 33011
Tel: (407) 734-1450
Fax: (407) 734-1750
www.keese.com



HTEG
THOMPSON ENGINEERING GROUP, INC.
4401 Windward Road Suite A9 Orlando, FL 32811
Ph: (407) 734-1450
Fax: (407) 734-1750
www.hteg.com

PARK SQUARE HOMES
2468 CATALINA
MASTER

Title:
1ST. FLOOR PLAN

Project no. 2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

1A

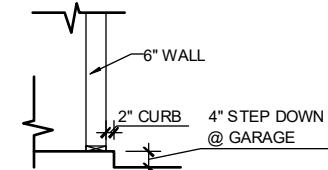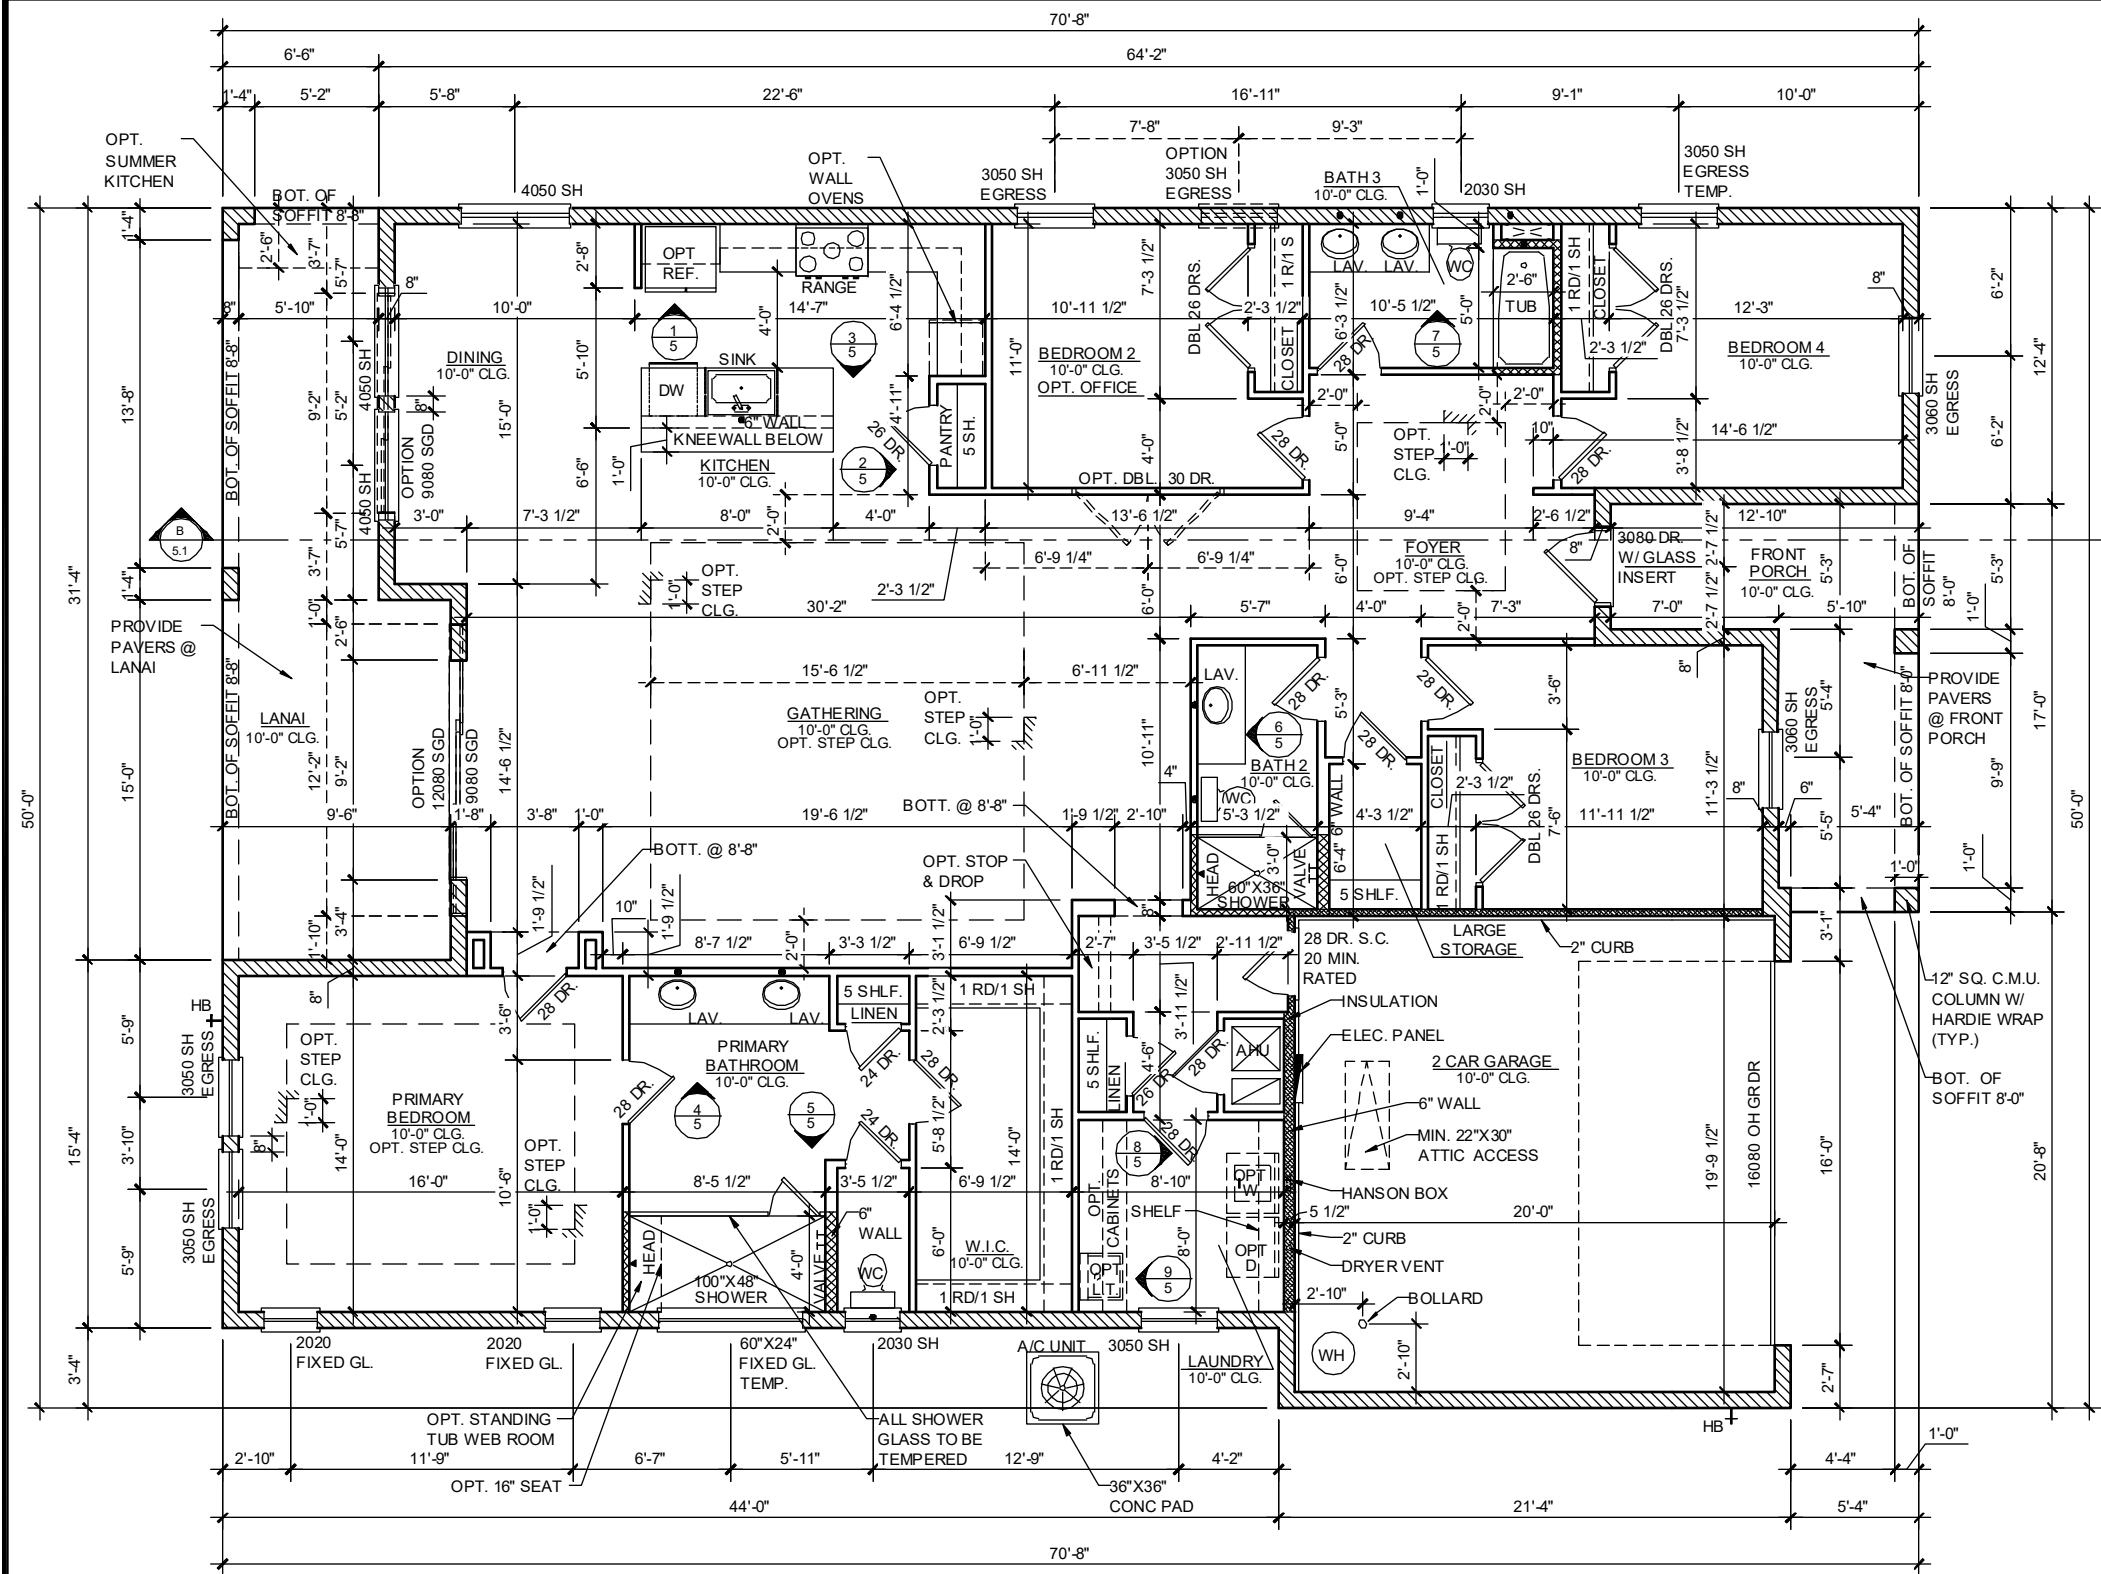

CURB @ GARAGE DETAIL
1/2" = 1'-0"

**NOTE: SEE COLOR SHEET
FOR INTERIOR DOOR
HEIGHT REQUIREMENTS.**

1st FLOOR PLAN ELEV. "B"

1/8" = 1'-0"

WATER HEATER:
PROVIDE MIN. 40 GALLON WATER HEATER

WATER HEATERS SHALL BE INSTALLED A MIN. OF 18" ABOVE FLOOR PER FBCR G2408.2

EXCEPTION:
APPLIANCES THAT ARE LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. DO NOT HAVE TO HAVE THE IGNITION SOURCE ELEVATED.

WET AREAS:
ALL WET AREAS TO BE FRAME WITH STUDS @ 16" O.C.

WINDOWS SCHEDULE GENERAL NOTES:

- CONTRACTOR AND SUPPLIER TO VERIFY WINDOW SIZES, LOCATION, TYPE (FIN vs. FLANGE) AND HEADER HEIGHTS PRIOR TO DELIVERY.
 - HEADER HEIGHTS ARE DIMENSIONED ABOVE FINISH FLOOR (A.F.F.)
 - WINDOW G.C. TO VERIFY ROUGH OPENINGS OF ALL FIELD ASSEMBLED FIXED GLASS WINDOW UNITS PRIOR TO INSTALLATION.
- SEE EXTERIOR ELEVATIONS FOR STYLE AND DIVIDED LITE CONFIGURATIONS.
 - HEIGHT AT ROUND TOP ALLOWS 2" FOR ARCH FRAMING.
 - ALL WINDOWS ON 1ST. FLOOR TO BE 8'-0" HDR. U.N.O.

AREA CALCULATION

1st FLR. LIVING	2,468 SQ. FT.
TOTAL LIVING	2,468 SQ. FT.
FRONT PORCH	135 SQ. FT.
LANAI	249 SQ. FT.
GARAGE	425 SQ. FT.
TOTAL UNDER ROOF	3,277 SQ. FT.



DISCLAIMER

IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

LEGEND

INDICATES 8x8x16 (NOM.) C.M.U. (EXTERIOR LOAD BEARING) 10'-0" TOP OF CMU
INDICATES WALLS TO BE UTILIZED FOR TRUSS BEARING 2x4 WOOD STUDS @ 16" O.C. U.N.O.
INDICATES WOOD STUDS 24" O.C. MAX. (NON LOAD BEARING INTERIOR PARTITIONS ONLY.) (U.N.O.)
INDICATES WET WALLS, 2X WOOD STUDS @ 12" O.C.



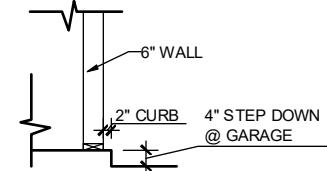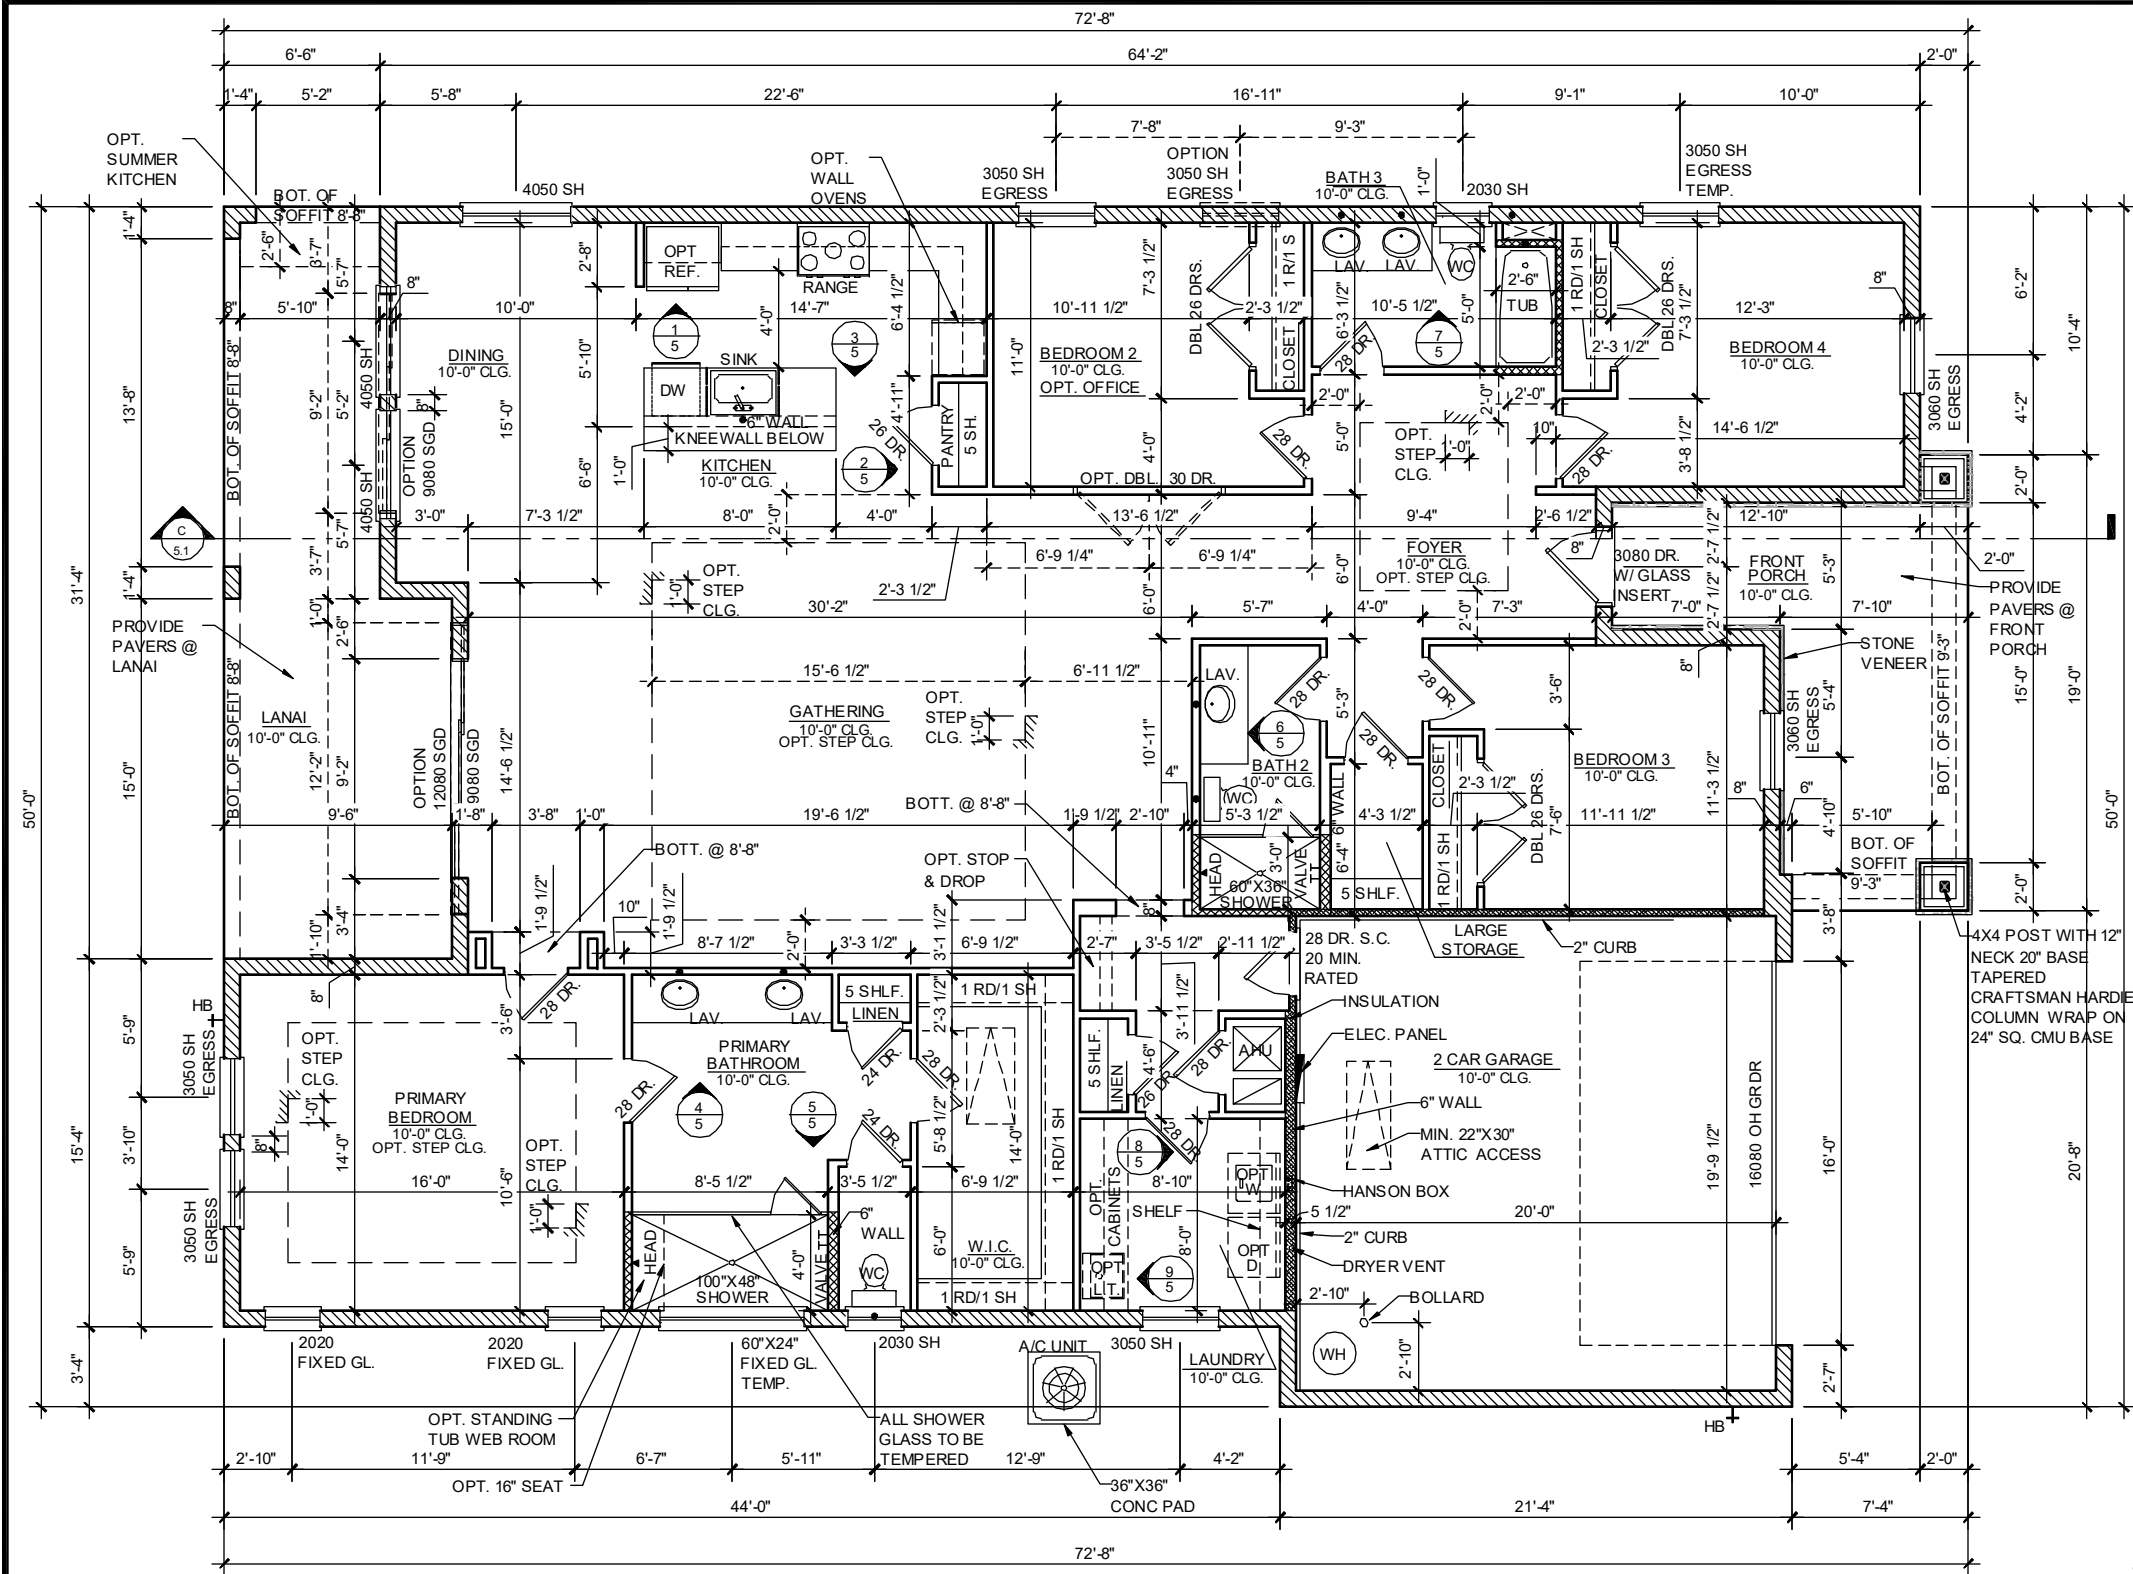

CURB @ GARAGE DETAIL
1/2" = 1'-0"

NOTE: SEE COLOR SHEET FOR INTERIOR DOOR HEIGHT REQUIREMENTS.

1st FLOOR PLAN ELEV. "C"

1/8" = 1'-0"

WATER HEATER:
PROVIDE MIN. 40 GALLON WATER HEATER

WATER HEATERS SHALL BE INSTALLED A MIN. OF 18" ABOVE FLOOR PER FBCR G2408.2

EXCEPTION:
APPLIANCES THAT ARE LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. DO NOT HAVE TO HAVE THE IGNITION SOURCE ELEVATED.

WET AREAS:
ALL WET AREAS TO BE FRAME WITH STUDS @ 16" O.C.

WINDOWS SCHEDULE GENERAL NOTES:

- CONTRACTOR AND SUPPLIER TO VERIFY WINDOW SIZES, LOCATION, TYPE (FIN vs. FLANGE) AND HEADER HEIGHTS PRIOR TO DELIVERY.
 - HEADER HEIGHTS ARE DIMENSIONED ABOVE FINISH FLOOR (A.F.F.)
 - WINDOW G.C. TO VERIFY ROUGH OPENINGS OF ALL FIELD ASSEMBLED FIXED GLASS WINDOW UNITS PRIOR TO INSTALLATION.
- SEE EXTERIOR ELEVATIONS FOR STYLE AND DIVIDED LITE CONFIGURATIONS.
 - HEIGHT AT ROUND TOP ALLOWS 2" FOR ARCH FRAMING.
 - ALL WINDOWS ON 1ST. FLOOR TO BE 8'-0" HDR. U.N.O.


AREA CALCULATION	
1st FLR. LIVING	2,468 SQ. FT.
TOTAL LIVING	2,468 SQ. FT.
FRONT PORCH	173 SQ. FT.
LANAI	249 SQ. FT.
GARAGE	425 SQ. FT.
TOTAL UNDER ROOF	3,315 SQ. FT.



DISCLAIMER

IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

LEGEND

INDICATES 8x8x16 (NOM.) C.M.U. (EXTERIOR LOAD BEARING) 10'-0" TOP OF CMU
INDICATES WALLS TO BE UTILIZED FOR TRUSS BEARING 2x4 WOOD STUDS @ 16" O.C. U.N.O.
INDICATES WOOD STUDS 24" O.C. MAX. (NON LOAD BEARING INTERIOR PARTITIONS ONLY.) (U.N.O.)
INDICATES WET WALLS, 2X WOOD STUDS @ 12" O.C.



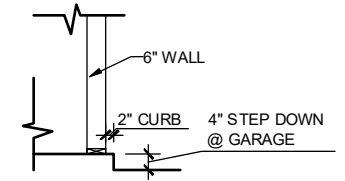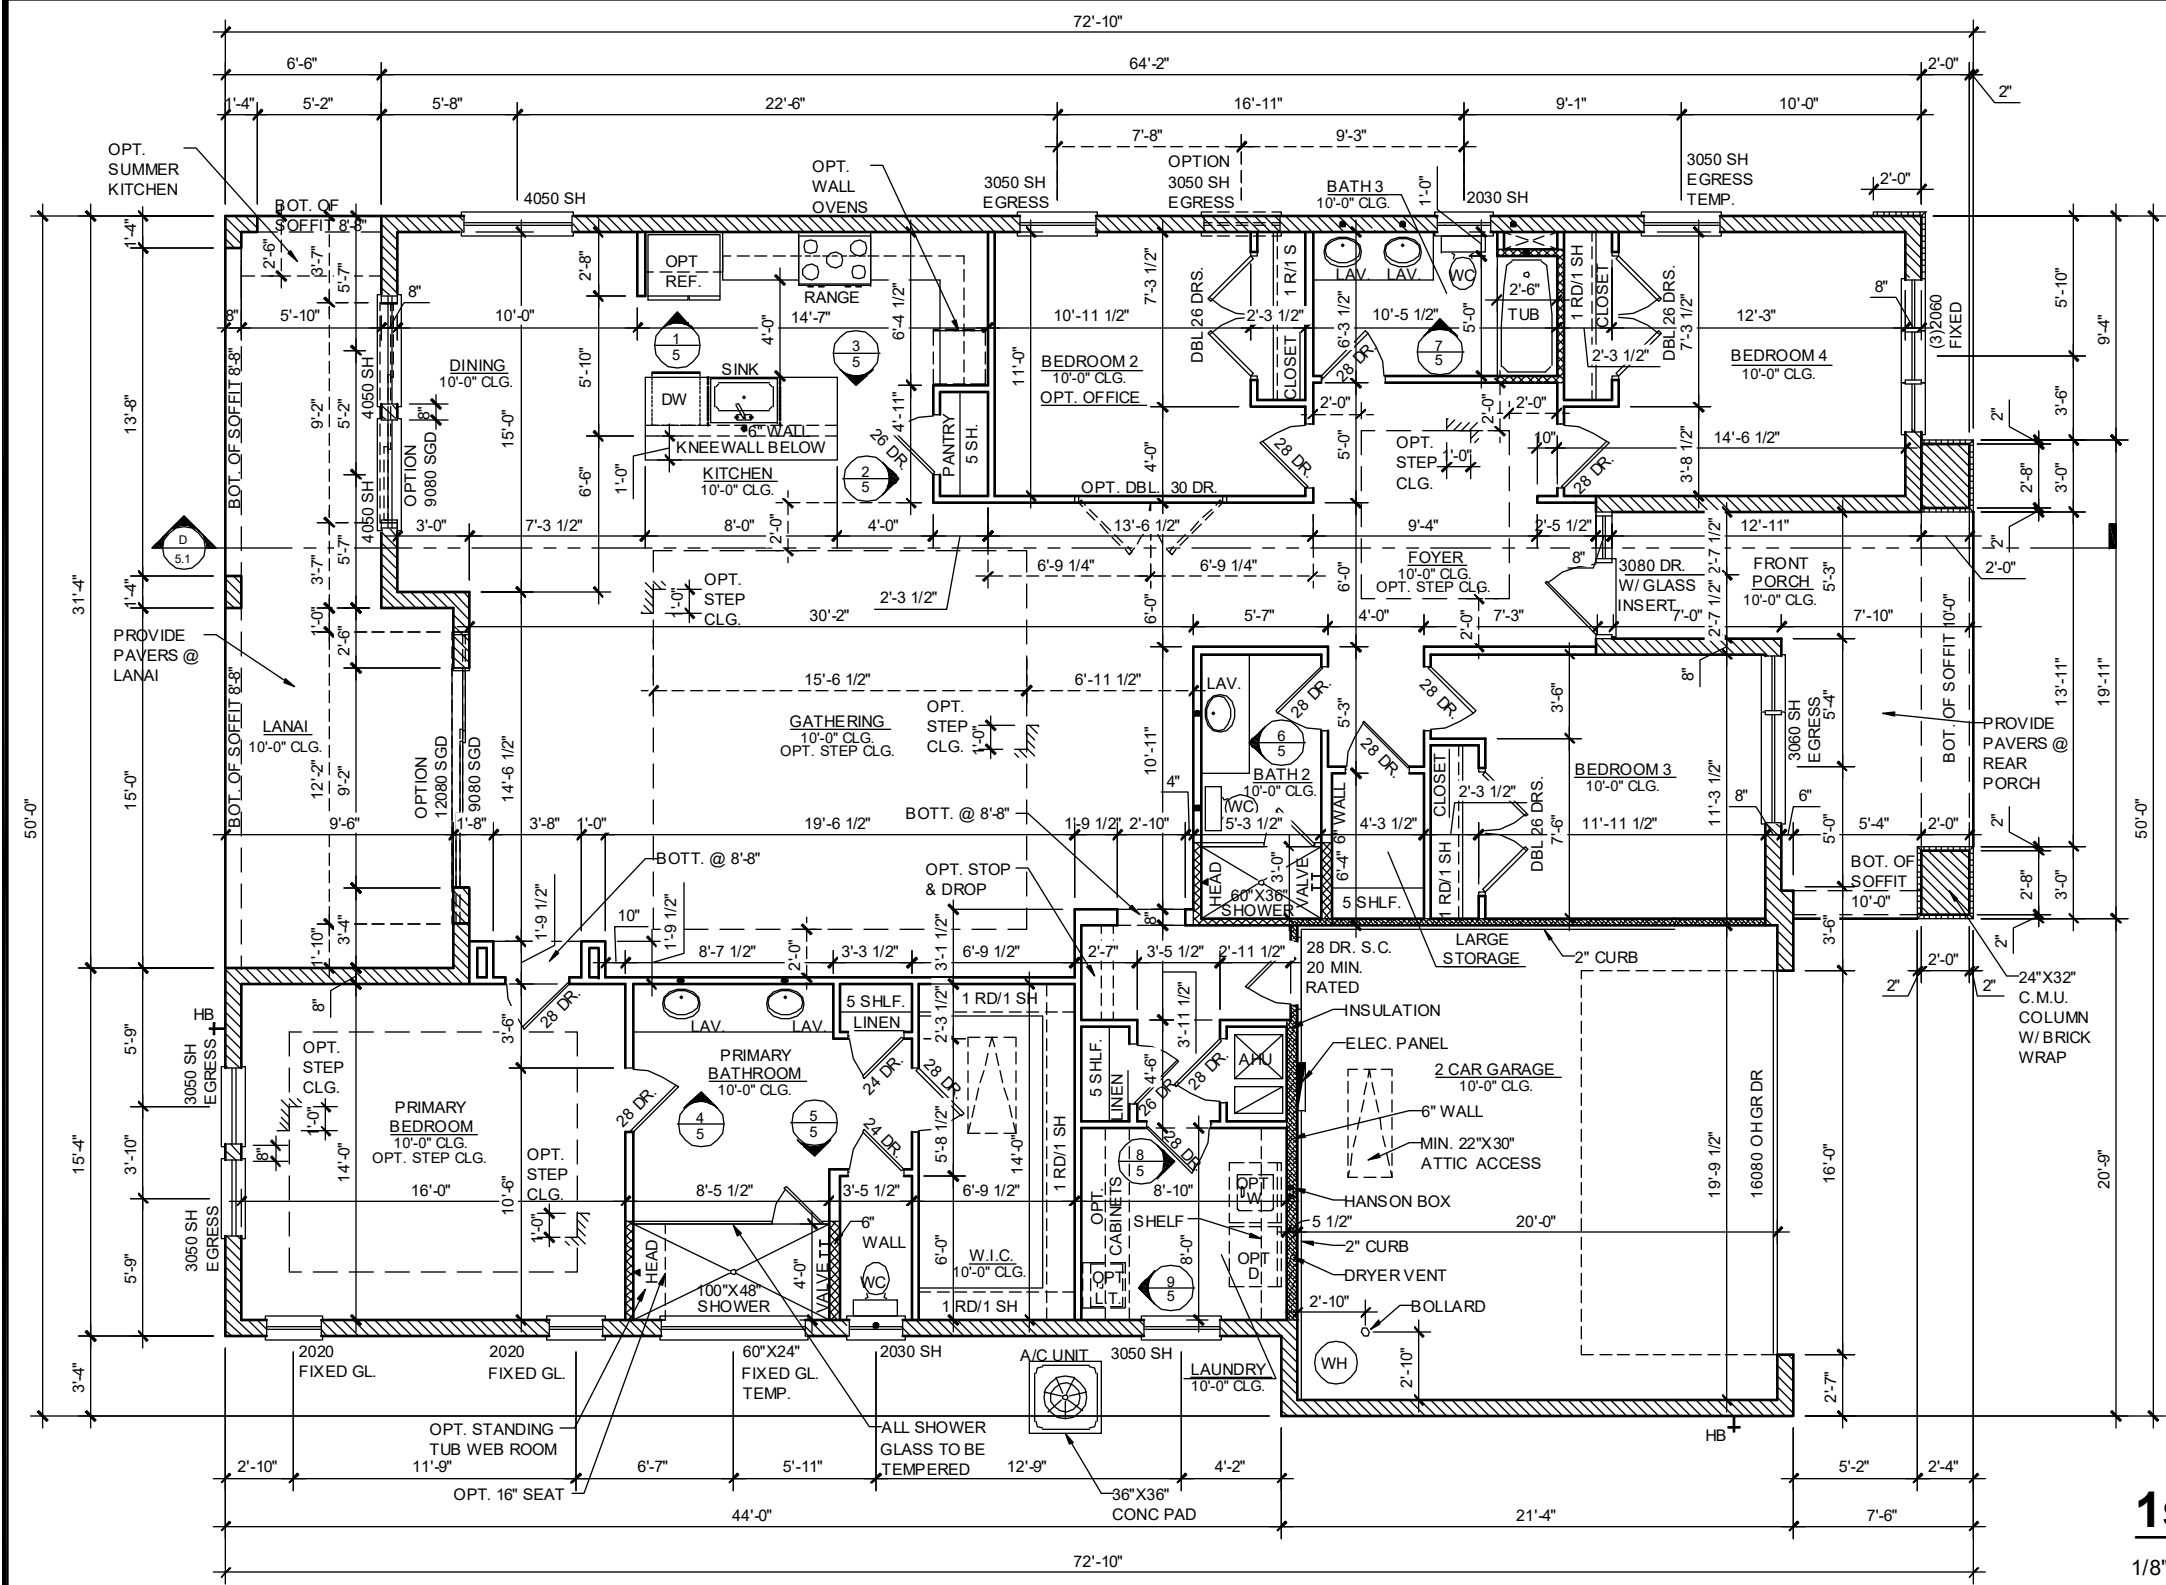

NOTE: SEE COLOR SHEET FOR INTERIOR DOOR HEIGHT REQUIREMENTS.

1st FLOOR PLAN ELEV. "D"

1/8" = 1'-0"

WATER HEATER:
PROVIDE MIN. 40 GALLON WATER HEATER

WATER HEATERS SHALL BE INSTALLED A MIN. OF 18" ABOVE FLOOR PER FBCR G2408.2

EXCEPTION:
APPLIANCES THAT ARE LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. DO NOT HAVE TO HAVE THE IGNITION SOURCE ELEVATED.

WET AREAS:
ALL WET AREAS TO BE FRAME WITH STUDS @ 16" O.C.

- WINDOWS SCHEDULE GENERAL NOTES:**
- CONTRACTOR AND SUPPLIER TO VERIFY WINDOW SIZES, LOCATION, TYPE (FIN vs. FLANGE) AND HEADER HEIGHTS PRIOR TO DELIVERY.
 - HEADER HEIGHTS ARE DIMENSIONED ABOVE FINISH FLOOR (A.F.F.)
 - WINDOW G.C. TO VERIFY ROUGH OPENINGS OF ALL FIELD ASSEMBLED FIXED GLASS WINDOW UNITS PRIOR TO INSTALLATION.
- SEE EXTERIOR ELEVATIONS FOR STYLE AND DIVIDED LITE CONFIGURATIONS.
 - HEIGHT AT ROUND TOP ALLOWS 2" FOR ARCH FRAMING.
 - ALL WINDOWS ON 1ST. FLOOR TO BE 8'-0" HDR. U.N.O.

AREA CALCULATION	
1st FLR. LIVING	2,468 SQ. FT.
TOTAL LIVING	2,468 SQ. FT.
FRONT PORCH	178 SQ. FT.
LANAI	249 SQ. FT.
GARAGE	425 SQ. FT.
TOTAL UNDER ROOF	3,320 SQ. FT.

DISCLAIMER

IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.



LEGEND

INDICATES 8x8x16 (NOM.) C.M.U. (EXTERIOR LOAD BEARING) 10'-0" TOP OF CMU

INDICATES WALLS TO BE UTILIZED FOR TRUSS BEARING 2x4 WOOD STUDS @ 16" O.C. U.N.O.

INDICATES WOOD STUDS 24" O.C. MAX. (NON LOAD BEARING INTERIOR PARTITIONS ONLY.) (U.N.O.)

INDICATES WET WALLS, 2X WOOD STUDS @ 12" O.C.

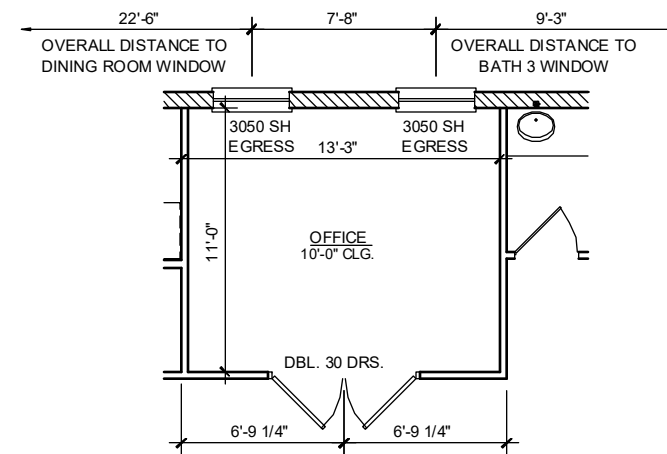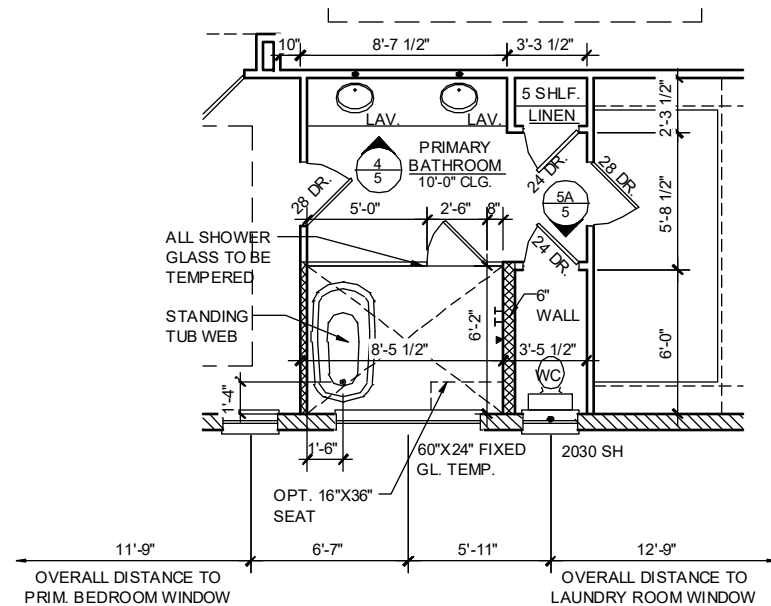

NOTE: SEE COLOR SHEET
FOR INTERIOR DOOR
HEIGHT REQUIREMENTS.

OPTIONS

$$1/8'' = 1'-0''$$

WATER HEATER:
PROVIDE MIN. 40 GALLON WATER HEATER

WATER HEATERS SHALL BE INSTALLED A MIN. OF 18" ABOVE FLOOR PER FBCR
G2408.2

EXCEPTION:
APPLIANCES THAT ARE LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT.
DO NOT HAVE TO HAVE THE IGNITION SOURCE ELEVATED.

WET AREAS:
ALL WET AREAS TO BE FRAME WITH STUDS @ 16" O.C.

WINDOWS SCHEDULE GENERAL NOTES:

- CONTRACTOR AND SUPPLIER TO VERIFY WINDOW SIZES, LOCATION, TYPE (FIN vs. FLANGE) AND HEADER HEIGHTS PRIOR TO DELIVERY.
 - HEADER HEIGHTS ARE DIMENSIONED ABOVE FINISH FLOOR (A.F.F.)
 - WINDOW G.C. TO VERIFY ROUGH OPENINGS OF ALL FIELD ASSEMBLED FIXED GLASS WINDOW UNITS PRIOR TO INSTALLATION.
1. SEE EXTERIOR ELEVATIONS FOR STYLE AND DIVIDED LITE CONFIGURATIONS.
 2. HEIGHT AT ROUND TOP ALLOWS 2" FOR ARCH FRAMING.
 3. ALL WINDOWS ON 1ST. FLOOR TO BE 8'-0" HDR, U.N.O.

AREA CALCULATION

1st FLR. LIVING	2,468 SQ. FT.
TOTAL LIVING	2,468 SQ. FT.
FRONT PORCH	171 SQ. FT.
LANAI	249 SQ. FT.
GARAGE	425 SQ. FT.
TOTAL UNDER ROOF	3,313 SQ. FT.

DISCLAIMER

IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOMER CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

LEGEND


INDICATES 8x8x16 (NOM.) C.M.U. (EXTERIOR LOAD BEARING) 10'-0" TOP OF CMU

INDICATES WALLS TO BE UTILIZED FOR TRUSS BEARING 2x4 WOOD STUDS @ 16" O.C. U.N.O.


INDICATES WOOD STUDS 24" O.C. MAX. (NON LOAD BEARING INTERIOR PARTITIONS ONLY.) (U.N.O.)

INDICATES WET WALLS, 2X WOOD STUDS @ 12" O.C.


© 2023 KENNEDY ASSOCIATES RESERVES COPYRIGHT & OTHER RIGHTS RESTRICTING THESE DOCUMENTS TO THE ORIGINAL SITE OR PURPOSE FOR WHICH THEY WERE PREPARED. REPRODUCTIONS, CHANGES OR ASSIGNMENTS ARE PROHIBITED.

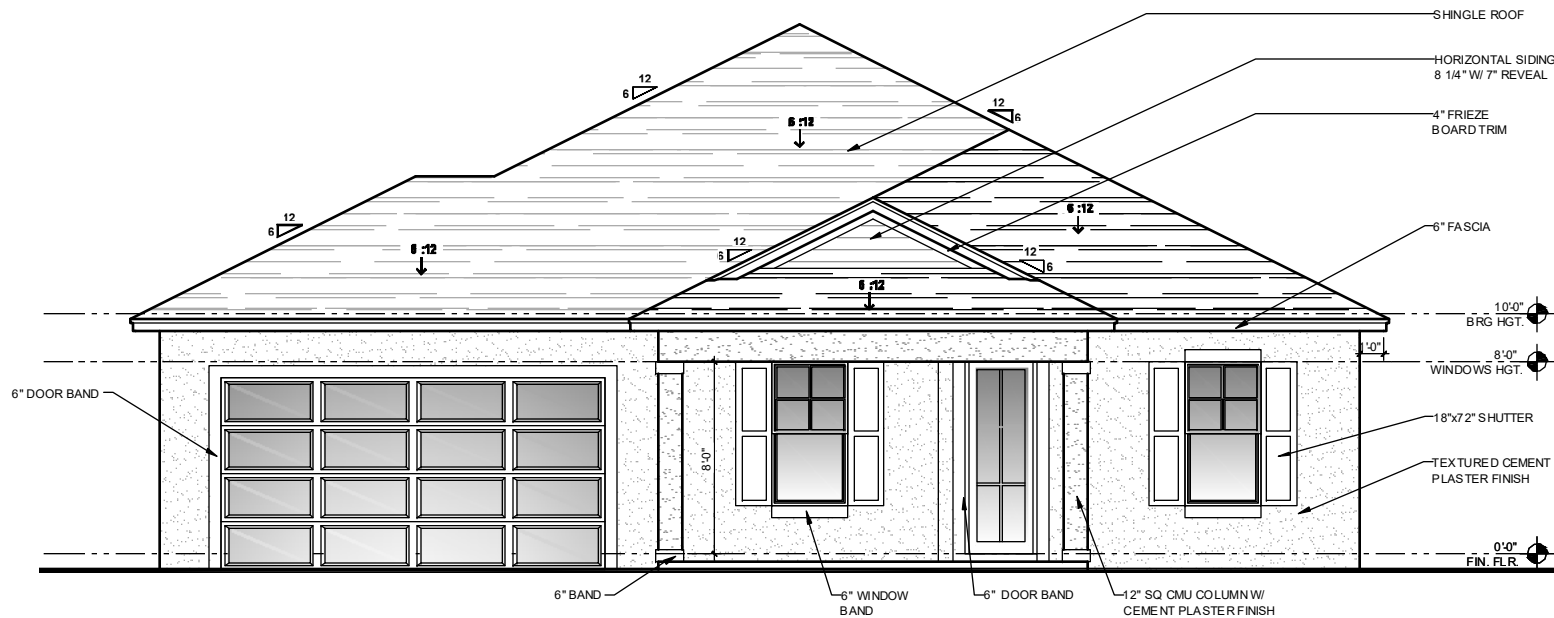

FRONT ELEVATION "A"
1/8" = 1'-0"

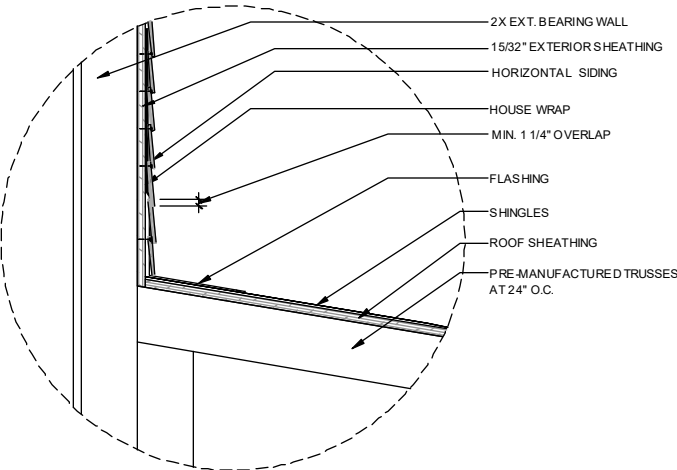

A
3A WALL TO ROOF FLASHING DETAIL
SCALE 1/8" = 1'-0"

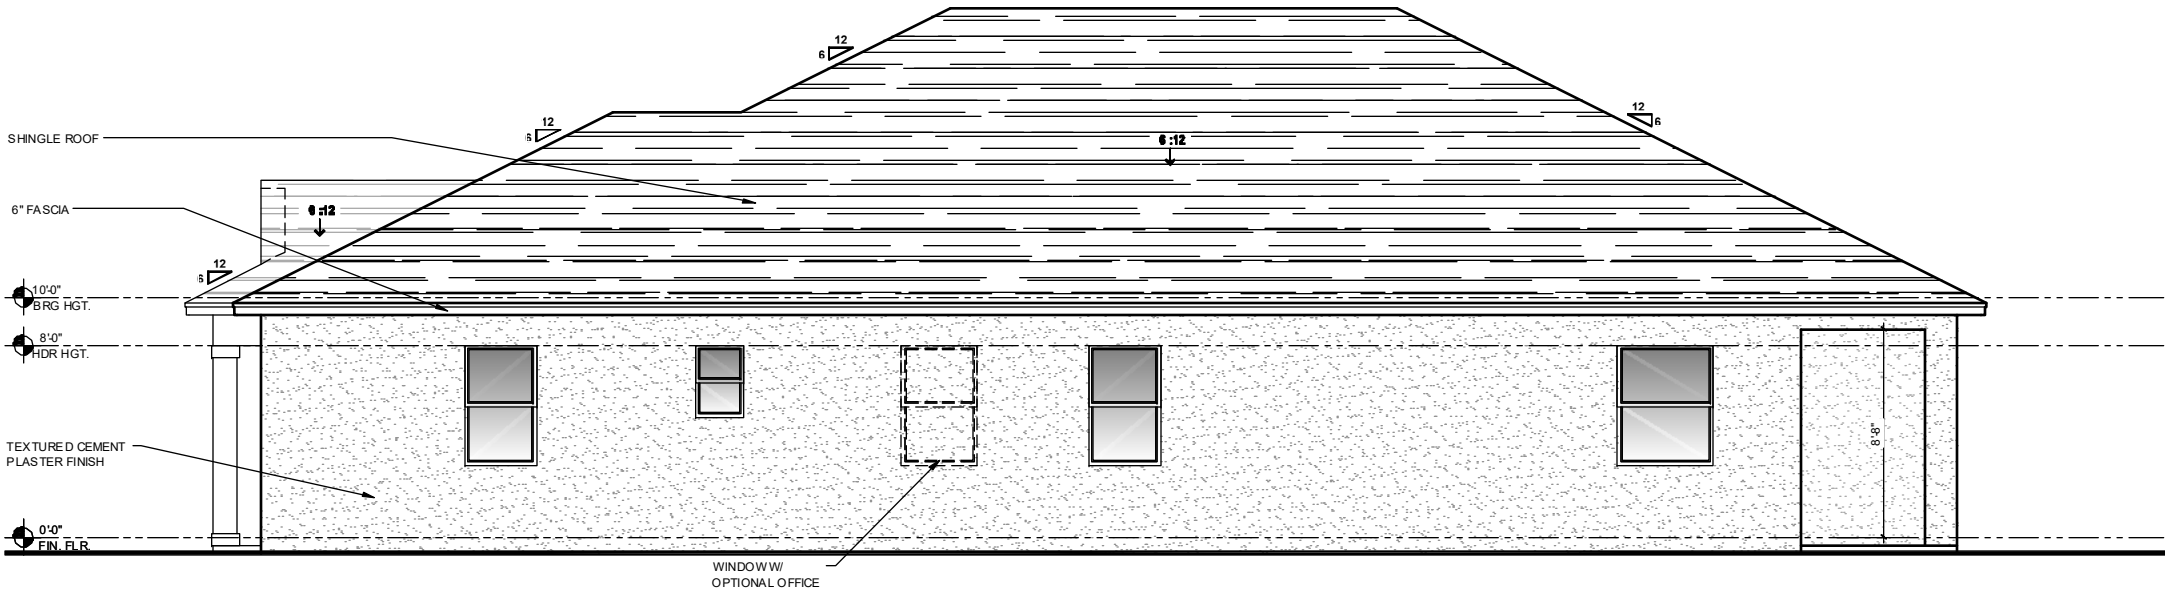

RIGHT ELEVATION "A"
1/8" = 1'-0"

EXTERIOR PLASTER

R703.7 EXTERIOR PLASTER.
INSTALLATION OF THESE MATERIALS SHALL BE IN COMPLIANCE WITH ASTM C926, ASTM C1063 OR ASTM C1787 AND THE PROVISIONS OF THIS CODE.

R703.7.1 LATH.
LATH AND LATH ATTACHMENTS SHALL BE OF CORROSION-RESISTANT MATERIALS. EXPANDED METAL OR WOVEN WIRE LATH SHALL BE ATTACHED WITH 1 1/2-INCH-LONG (38 MM), 11 GAGE NAILS HAVING A 7/16-INCH (11.1 MM) HEAD, OR 1 1/2-INCH-LONG (22.2 MM), 16 GAGE STAPLES, SPACED IN ACCORDANCE WITH ASTM C1063 OR C1787, OR AS OTHERWISE APPROVED. (Refer to sheet SM1 for the engineered method for Lath attachment).

Lathing Accessories
Attachments shall be of corrosion-resistant materials. Wood Application: 16 Ga x1-1/2" long (3/4" x1" crown) staples @ 6" O.C. vertically/horizontally into the framing members. Masonry Application: Concrete stud nail, 3/8" (10 mm) head dia. min. @ 6" O.C. vertically/horizontally or compatible adhesives, exterior gun-grade, construction adhesive with 1" dabs @ 6" O.C. or in a semi-continuous bead between the solid plaster base and the solid portion of the key attachment flange. Control Joints: Install control joint lathing accessories in conformance with ASTM C1063. Lath shall not be continuous through control joints, but shall be stopped and tied at each side. All accessories shall be in accordance with the latest ASTM C1063 & ASTM C1861.

R703.7.2 PLASTER.
PLASTERING WITH CEMENT PLASTER SHALL BE NOT LESS THAN THREE COATS WHERE APPLIED OVER ANY TYPE OF CODE-APPROVED LATH AND SHALL BE NOT LESS THAN TWO COATS WHERE DIRECTLY APPLIED OVER MASONRY, CONCRETE, CLAY, BRICK, STONE OR TILE. IF THE PLASTER SURFACE IS COMPLETELY COVERED BY VENEER OR OTHER FACING MATERIAL OR IS COMPLETELY CONCEALED, PLASTER APPLICATION NEED BE ONLY TWO COATS, PROVIDED THE TOTAL THICKNESS IS AS SET FORTH IN TABLE R702.1(1).

ON WOOD-FRAME CONSTRUCTION WITH AN ON-GRADE FLOOR SLAB SYSTEM, EXTERIOR PLASTER SHALL BE APPLIED TO COVER, BUT NOT EXTEND BELOW, LATH, PAPER AND SCREED. CEMENT PLASTER SHALL BE IN ACCORDANCE WITH ASTM C926. CEMENT MATERIALS SHALL BE IN ACCORDANCE WITH ONE OF THE FOLLOWING:

1. MASONRY CEMENT CONFORMING TO ASTM C91 TYPE M, S OR N.
2. PORTLAND CEMENT CONFORMING TO ASTM C150 TYPE I, II OR III.
3. BLENDED HYDRAULIC CEMENT CONFORMING TO ASTM C595 TYPE IP, IS(S-70), IL OR IT(S-70).
4. HYDRAULIC CEMENT CONFORMING TO ASTM C1157 TYPE GU, HE, MS, HS OR MH.
5. PLASTER (STUCCO) CEMENT CONFORMING TO ASTM C1328.

THE PROPORTION OF AGGREGATE TO CEMENTITIOUS MATERIALS SHALL BE AS SET FORTH IN TABLE R702.1(3).

R703.7.2.1 WEEP SCREEDS.
A MINIMUM 0.0194-INCH (0.5 MM) (NO. 26 GALVANIZED SHEET GAGE), CORROSION-RESISTANT WEEP SCREED OR PLASTIC WEEP SCREED, WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 3 1/2 INCHES (89 MM) SHALL BE PROVIDED AT OR BELOW THE FOUNDATION PLATE LINE ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C926. THE WEEP SCREED SHALL BE PLACED NOT LESS THAN 4 INCHES (102 MM) ABOVE THE EARTH OR 2 INCHES (51 MM) ABOVE PAVED AREAS AND SHALL BE OF A TYPE THAT WILL ALLOW TRAPPED WATER TO DRAIN TO THE EXTERIOR OF THE BUILDING. THE WEATHER-RESISTANT BARRIER SHALL LAP THE ATTACHMENT FLANGE. THE EXTERIOR LATH SHALL COVER AND TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP SCREED.

R703.7.3 WATER-RESISTIVE BARRIERS.
WATER-RESISTIVE BARRIERS SHALL BE INSTALLED AS REQUIRED IN SECTION R703.2 AND, WHERE APPLIED OVER WOOD-BASED SHEATHING, SHALL INCLUDE A WATER-RESISTIVE VAPOR-PERMEABLE BARRIER WITH A PERFORMANCE AT LEAST EQUIVALENT TO TWO LAYERS OF GRADE D PAPER. THE INDIVIDUAL LAYERS SHALL BE INSTALLED INDEPENDENTLY SUCH THAT EACH LAYER PROVIDES A SEPARATE CONTINUOUS PLANE AND ANY FLASHING (INSTALLED IN ACCORDANCE WITH SECTION R703.4) INTENDED TO DRAIN TO THE WATER-RESISTIVE BARRIER IS DIRECTED BETWEEN THE LAYERS.

R312.2.1 Window sills opening height.

In dwelling units, where the top of the sill of an operable window opening is located less than 24 inches (610mm) above the finished floor and greater than 72 inches (1829 mm) above the finished grade or other surface below on the exterior of the building, the operable window shall comply with one of the following.

1. Operable windows with openings that will not allow a 4 inch diameter(102 mm) sphere to pass through the opening where the opening is in it's largest open position.
2. Operable windows that are provided with window fall prevention devices that comply with ASTM F2090.
3. Operable windows that are provided with window opening control devices that comply with Section R312.2.2.

ROOF CRITERIA

12" OVERHANG U.N.O. / PLUMB CUT FASCIA / ROOF PITCH PER ELEVATION / SHINGLES U.N.O.

ROOF PITCH VARIES PER SUBDIVISIONS IT IS THE CONTRACTORS RESPONSIBILITY TO VERIFY ROOF SLOPE REQUIREMENTS WITH TRUSS MANUFACTURER.

FLASHING SHALL BE INSTALLED AT WALL AND ROOF INTERSECTIONS, AT GUTTERS, AT ALL CHANGES IN ROOF SLOPE OR DIRECTION, AND AROUND ROOF OPENINGS.

STEP FLASHING SHALL BE USED ON ALL ROOF TO WALL INTERSECTIONS ON RAKES.

ATTENTION CONTRACTORS ALL PENETRATIONS THROUGH ROOF ARE TO BE LOCATED ON REAR OR IF NECESSARY ON THE SIDE OF THE ROOF BEHIND THE FRONT FACADE ZONE.

ASPHALT SHINGLES (IF APPLICABLE) :


1. WIND RESISTANCE OF ASPHALT SHINGLES. - ASPHALT SHINGLES SHALL BE INSTALLED IN ACCORDANCE WITH 2023 FBCR (8TH EDITION), SECTION R905.2.6 AND R905.2.6.1.

2. ASPHALT SHINGLES SHALL ONLY BE USED ON ROOF SLOPES OF TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL (2:12) OR GREATER. FOR ROOF SLOPES FROM TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL (2:12) AND LESS THAN FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL (4:12), TWO LAYERS OF UNDERLAYMENT COMPLYING WITH ASTM D226, TYPE II, ASTM D4869, TYPE III OR TYPE IV OR ASTM D8257 IS REQUIRED IN ACCORDANCE WITH SECTION R905.1.1.

FOR ROOF SLOPES FROM FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL (4:12) AND GREATER, ONE LAYER OF UNDERLAYMENT COMPLYING WITH ASTM D226, TYPE II, ASTM D4869, TYPE III OR IV OR ASTM D8257 IS REQUIRED IN ACCORDANCE WITH SECTION R905.1.1.

3. AS AN ALTERNATIVE, THE ENTIRE ROOF DECK SHALL BE COVERED WITH AN APPROVED SELF-ADHERING POLYMER MODIFIED BITUMEN UNDERLAYMENT COMPLYING WITH ASTM D1970 INSTALLED IN ACCORDANCE WITH BOTH THE UNDERLAYMENT MANUFACTURER'S AND ROOF COVERING MANUFACTURER'S INSTALLATION INSTRUCTIONS FOR THE DECK MATERIAL, ROOF VENTILATION CONFIGURATION AND CLIMATE EXPOSURE FOR THE ROOF COVERING TO BE INSTALLED. REFER TO R905.1.1.1.


CLAY AND CONCRETE TILE (IF APPLICABLE) :
PER FBCR 2023 8TH EDITION R905.3, THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS, OR RECOMMENDATIONS OF FRSA/TRI FLORIDA HIGH WIND CONCRETE AND CLAY ROOF TILE INSTALLATION MANUAL, 7TH EDITION WHERE THE VASD IS DETERMINED IN ACCORDANCE WITH SECTION R301.2.1.3. THE REQUIRED UNDERLAYMENT SHALL COMPLY WITH THE MANUFACTURER'S INSTRUCTIONS IN ACCORDANCE WITH THE FRSA/TRI FLORIDA HIGH WIND CONCRETE AND CLAY ROOF TILE INSTALLATION MANUAL, 7TH EDITION WHERE THE VASD IS DETERMINED IN ACCORDANCE WITH SECTION R301.2.1.3.

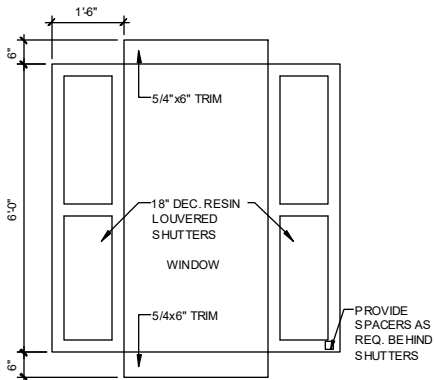

B
3A WINDOW TRIM & SHUTTER DETAIL
SCALE: 1/2" = 1'-0"


DISCLAIMER

IT IS THE CONTRACTOR'S SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

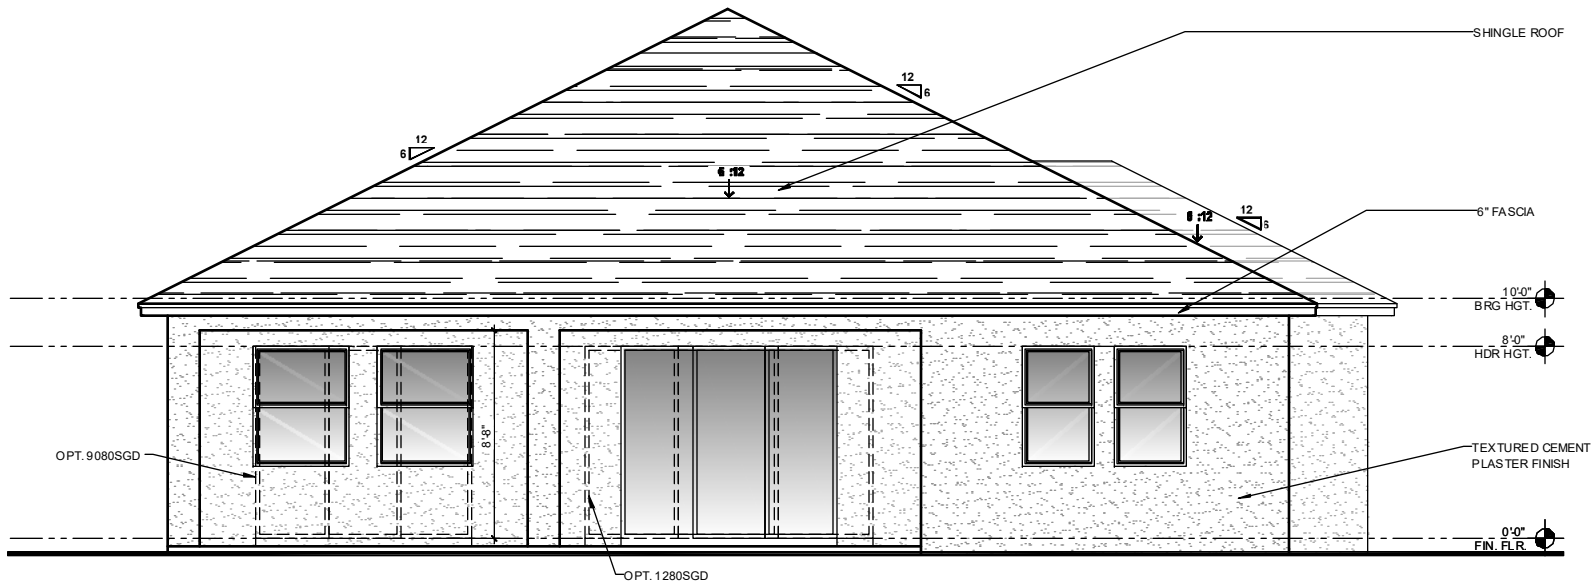

REAR ELEVATION "A"

1/8" = 1'-0"

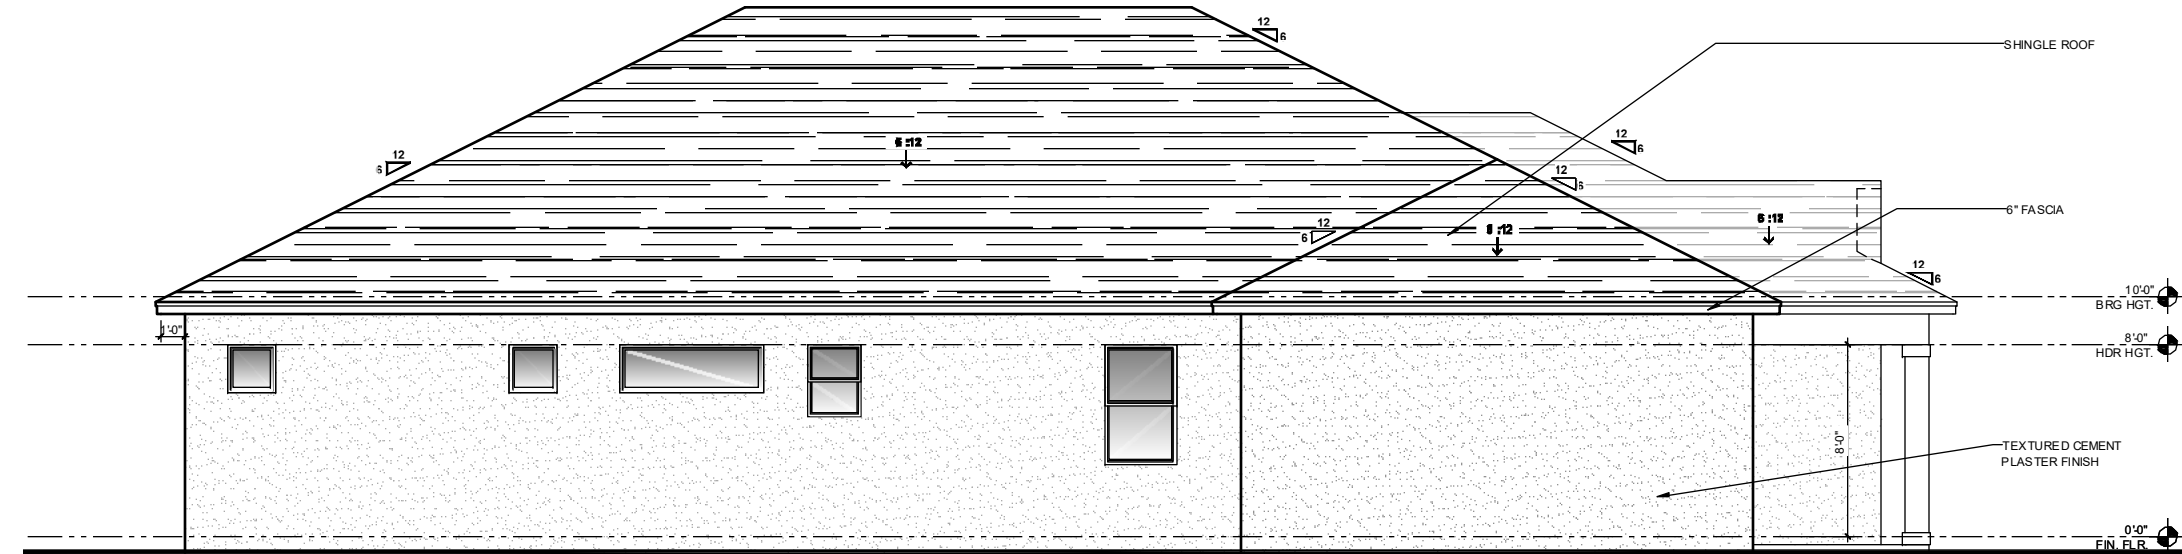

LEFT ELEVATION "A"

1/8" = 1'-0"

EXTERIOR PLASTER

R703.7 EXTERIOR PLASTER.
INSTALLATION OF THESE MATERIALS SHALL BE IN COMPLIANCE WITH
ASTM C926, ASTM C1063 OR ASTM C1787 AND THE PROVISIONS OF THIS
CODE.

R703.7.1 LATH.
LATH AND LATH ATTACHMENTS SHALL BE OF CORROSION-RESISTANT
MATERIALS. EXPANDED METAL OR WOVEN WIRE LATH SHALL BE
ATTACHED WITH 1 1/2-INCH-LONG (38 MM), 11 GAGE NAILS HAVING A
7/16-INCH (11.1 MM) HEAD, OR 1 1/2-INCH-LONG (22.2 MM), 16 GAGE
STAPLES, SPACED IN ACCORDANCE WITH ASTM C1063 OR C1787, OR AS
OTHERWISE APPROVED. (Refer to sheet SN1 for the engineered method
for Lath attachment.)

Lathing Accessories
Attachments shall be of corrosion-resistant materials. Wood Application: 16
Ga. x1-1/2" long (3/4"-1" crown) staples @ 6" O.C. vertically/horizontally into the
framing members. Masonry Application: Concrete stud nail, 3/8" (10 mm) head
dia. min. @ 6" O.C. vertically/horizontally or compatible adhesives, exterior
gun-grade, construction adhesive with 1" slabs @ 6" O.C. or in a semi-continuous
bead between the solid plaster base and the solid portion of the key attachment
flange. Control Joints: Install control joint lathing accessories in conformance with
ASTM C1063. Lath shall not be continuous through control joints, but shall be
stopped and tied at each side. All accessories shall be in accordance with the
latest ASTM C1063 & ASTM C1861.

R703.7.2 PLASTER.
PLASTERING WITH CEMENT PLASTER SHALL BE NOT LESS THAN THREE
COATS WHERE APPLIED OVER ANY TYPE OF CODE-APPROVED LATH AND
SHALL BE NOT LESS THAN TWO COATS WHERE DIRECTLY APPLIED OVER
MASONRY, CONCRETE, CLAY, BRICK, STONE OR TILE. IF THE PLASTER
SURFACE IS COMPLETELY COVERED BY VENEER OR OTHER FINISHING
MATERIAL OR IS COMPLETELY CONCEALED, PLASTER APPLICATION
NEED BE ONLY TWO COATS, PROVIDED THE TOTAL THICKNESS IS AS SET
FORTH IN TABLE R702.1(1).

ON WOOD-FRAME CONSTRUCTION WITH AN ON-GRADE FLOOR SLAB
SYSTEM, EXTERIOR PLASTER SHALL BE APPLIED TO COVER, BUT NOT
EXTEND BELOW, LATH, PAPER AND SCREED. CEMENT PLASTER SHALL BE
IN ACCORDANCE WITH ASTM C926. CEMENT MATERIALS SHALL BE IN
ACCORDANCE WITH ONE OF THE FOLLOWING:

1. MASONRY CEMENT CONFORMING TO ASTM C91 TYPE M, S OR N.
2. PORTLAND CEMENT CONFORMING TO ASTM C150 TYPE I, II OR III.
3. BLENDED HYDRAULIC CEMENT CONFORMING TO ASTM C595 TYPE IP,
IS(S<70), IL OR IT(S<70).
4. HYDRAULIC CEMENT CONFORMING TO ASTM C1157 TYPE GU, HE, MS,
HS OR MH.
5. PLASTER (STUCCO) CEMENT CONFORMING TO ASTM C1328.

THE PROPORTION OF AGGREGATE TO CEMENTITIOUS MATERIALS SHALL
BE AS SET FORTH IN TABLE R702.1(3).

R703.7.2.1 WEEP SCREEDS.

A MINIMUM 0.019-INCH (0.5 MM) (NO. 26 GALVANIZED SHEET GAGE),
CORROSION-RESISTANT WEEP SCREED OR PLASTIC WEEP SCREED,
WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 3 1/2 INCHES (89
MM) SHALL BE PROVIDED AT OR BELOW THE FOUNDATION PLATE LINE
ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C926. THE
WEEP SCREED SHALL BE PLACED NOT LESS THAN 4 INCHES (102 MM)
ABOVE THE EARTH OR 2 INCHES (51 MM) ABOVE PAVED AREAS AND
SHALL BE OF A TYPE THAT WILL ALLOW TRAPPED WATER TO DRAIN TO
THE EXTERIOR OF THE BUILDING. THE WEATHER-RESISTANT BARRIER
SHALL LAP THE ATTACHMENT FLANGE. THE EXTERIOR LATH SHALL
COVER AND TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP
SCREED.

R703.7.3 WATER-RESISTIVE BARRIERS.

WATER-RESISTIVE BARRIERS SHALL BE INSTALLED AS REQUIRED IN
SECTION R703.2 AND, WHERE APPLIED OVER WOOD-BASED SHEATHING,
SHALL INCLUDE A WATER-RESISTIVE VAPOR-PERMEABLE BARRIER WITH
A PERFORMANCE AT LEAST EQUIVALENT TO TWO LAYERS OF GRADE D
PAPER. THE INDIVIDUAL LAYERS SHALL BE INSTALLED INDEPENDENTLY
SUCH THAT EACH LAYER PROVIDES A SEPARATE CONTINUOUS PLANE
AND ANY FLASHING (INSTALLED IN ACCORDANCE WITH SECTION R703.4)
INTENDED TO DRAIN TO THE WATER-RESISTIVE BARRIER IS DIRECTED
BEHIND THE LAYERS.

R312.2.1 Window sills opening height.

In dwelling units, where the top of the sill of an operable window opening is located less than 24 inches (610mm) above the
finished floor and greater than 72 inches (1829 mm) above the finished grade or other surface below on the exterior of the
building, the operable window shall comply with one of the following.

1. Operable windows with openings that will not allow a 4 inch diameter(102 mm) sphere to pass through the opening where
the opening is in it's largest open position.
2. Operable windows that are provided with window fall prevention devices that comply with ASTM F2090.
3. Operable windows that are provided with window opening control devices that comply with Section R312.2.2.

ROOF CRITERIA

12" OVERHANG U.N.O. / PLUMB CUT FASCIA / ROOF PITCH PER ELEVATION /
SHINGLES U.N.O.

ROOF PITCH VARIES PER SUBDIVISIONS IT IS THE CONTRACTORS RESPONSIBILITY TO
VERIFY ROOF SLOPE REQUIREMENTS WITH TRUSS MANUFACTURER.

FLASHING SHALL BE INSTALLED AT WALL AND ROOF INTERSECTIONS, AT GUTTERS,
AT ALL CHANGES IN ROOF SLOPE OR DIRECTION, AND AROUND ROOF OPENINGS.

STEP FLASHING SHALL BE USED ON ALL ROOF TO WALL INTERSECTIONS ON RAKES.

ATTENTION CONTRACTORS ALL PENETRATIONS THROUGH ROOF ARE TO BE
LOCATED ON REAR OR IF NECESSARY ON THE SIDE OF THE ROOF BEHIND THE
FRONT FACADE ZONE.

ASPHALT SHINGLES (IF APPLICABLE):

1. WIND RESISTANCE OF ASPHALT SHINGLES. - ASPHALT SHINGLES SHALL BE
INSTALLED IN ACCORDANCE WITH 2023 FBCR (8TH EDITION), SECTION R905.2.6 AND
R905.2.6.1.

2. ASPHALT SHINGLES SHALL ONLY BE USED ON ROOF SLOPES OF
TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL (2:12) OR GREATER.

FOR ROOF SLOPES FROM TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL

(2:12) AND LESS THAN FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL

(4:12), TWO LAYERS OF UNDERLAYMENT COMPLYING WITH ASTM D226,

TYPE II, ASTM D4869, TYPE III OR TYPE IV OR ASTM D8257 IS

REQUIRED IN ACCORDANCE WITH SECTION R905.1.1.

FOR ROOF SLOPES FROM FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL (4:12) AND

GREATER, ONE LAYER OF UNDERLAYMENT COMPLYING WITH ASTM D226, TYPE II,

ASTM D4869, TYPE III OR IV OR ASTM D8257 IS REQUIRED IN ACCORDANCE WITH

SECTION R905.1.1.

3. AS AN ALTERNATIVE, THE ENTIRE ROOF DECK SHALL BE COVERED WITH AN

APPROVED SELF-ADHERING POLYMER MODIFIED BITUMEN UNDERLAYMENT

COMPLYING WITH ASTM D1970 INSTALLED IN ACCORDANCE WITH BOTH THE

UNDERLAYMENT MANUFACTURER'S AND ROOF COVERING MANUFACTURER'S

INSTALLATION INSTRUCTIONS FOR THE DECK MATERIAL, ROOF VENTILATION

CONFIGURATION AND CLIMATE EXPOSURE FOR THE ROOF COVERING TO BE

INSTALLED. REFER TO R905.1.1.1.

CLAY AND CONCRETE TILE (IF APPLICABLE):

PER FBCR 2023 8TH EDITION R905.3, THE INSTALLATION OF CLAY AND CONCRETE
TILE SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION

INSTRUCTIONS, OR RECOMMENDATIONS OF FRSA/TRI FLORIDA HIGH WIND

CONCRETE AND CLAY ROOF TILE INSTALLATION MANUAL,

7TH EDITION WHERE THE VASD IS DETERMINED IN ACCORDANCE WITH SECTION

R301.2.1.3. THE REQUIRED UNDERLAYMENT SHALL COMPLY WITH THE


MANUFACTURER'S INSTRUCTIONS IN ACCORDANCE WITH THE FRSA/TRI FLORIDA

HIGH WIND CONCRETE AND CLAY ROOF TILE INSTALLATION MANUAL, 7TH EDITION

WHERE THE VASD IS DETERMINED IN ACCORDANCE WITH SECTION R301.2.1.3.




DISCLAIMER


IT IS THE CONTRACTOR'S SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL
INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF
CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT
RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR
CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES &
THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION.
NO EXCEPTIONS.

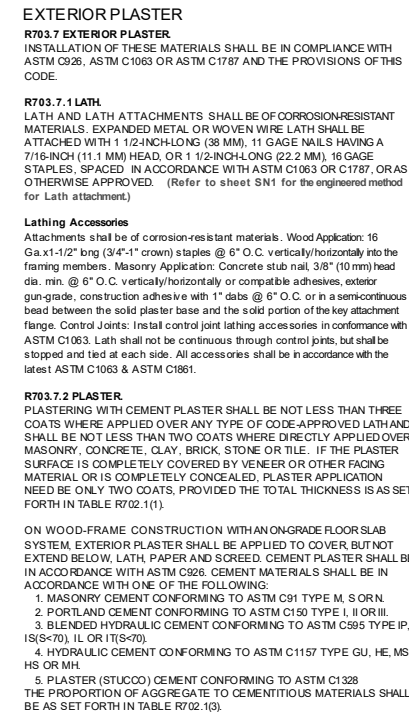

ASPHALT SHINGLES (IF APPLICABLE) :

1. WIND RESISTANCE OF ASPHALT SHINGLES. - ASPHALT SHINGLES SHALL BE INSTALLED IN ACCORDANCE WITH 2023 FBCR (8TH EDITION), SECTION R905.2.6 AND R905.2.6.1.
2. ASPHALT SHINGLES SHALL ONLY BE USED ON ROOF SLOPES OF TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL (2:12) OR GREATER. FOR ROOF SLOPES FROM TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL (2:12) AND LESS THAN FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL (4:12), TWO LAYERS OF UNDERLAYMENT COMPLYING WITH ASTM D226, TYPE II, ASTM D4869, TYPE III OR TYPE IV OR ASTM D8257 IS REQUIRED IN ACCORDANCE WITH SECTION R905.1.1.
- FOR ROOF SLOPES FROM FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL (4:12) AND GREATER, ONE LAYER OF UNDERLAYMENT COMPLYING WITH ASTM D226, TYPE II, ASTM D4869, TYPE III OR IV OR ASTM D8257 IS REQUIRED IN ACCORDANCE WITH SECTION R905.1.1.
3. AS AN ALTERNATIVE, THE ENTIRE ROOF DECK SHALL BE COVERED WITH AN APPROVED SELF-ADHERING POLYMER MODIFIED BITUMEN UNDERLAYMENT COMPLYING WITH ASTM D1970 INSTALLED IN ACCORDANCE WITH BOTH THE UNDERLAYMENT MANUFACTURER'S AND ROOF COVERING MANUFACTURER'S INSTALLATION INSTRUCTIONS FOR THE DECK MATERIAL, ROOF VENTILATION CONFIGURATION AND CLIMATE EXPOSURE FOR THE ROOF COVERING TO BE INSTALLED. REFER TO R905.1.1.1.

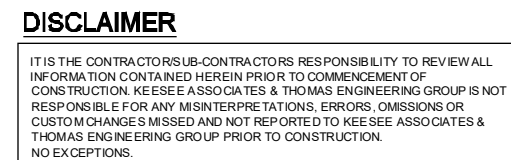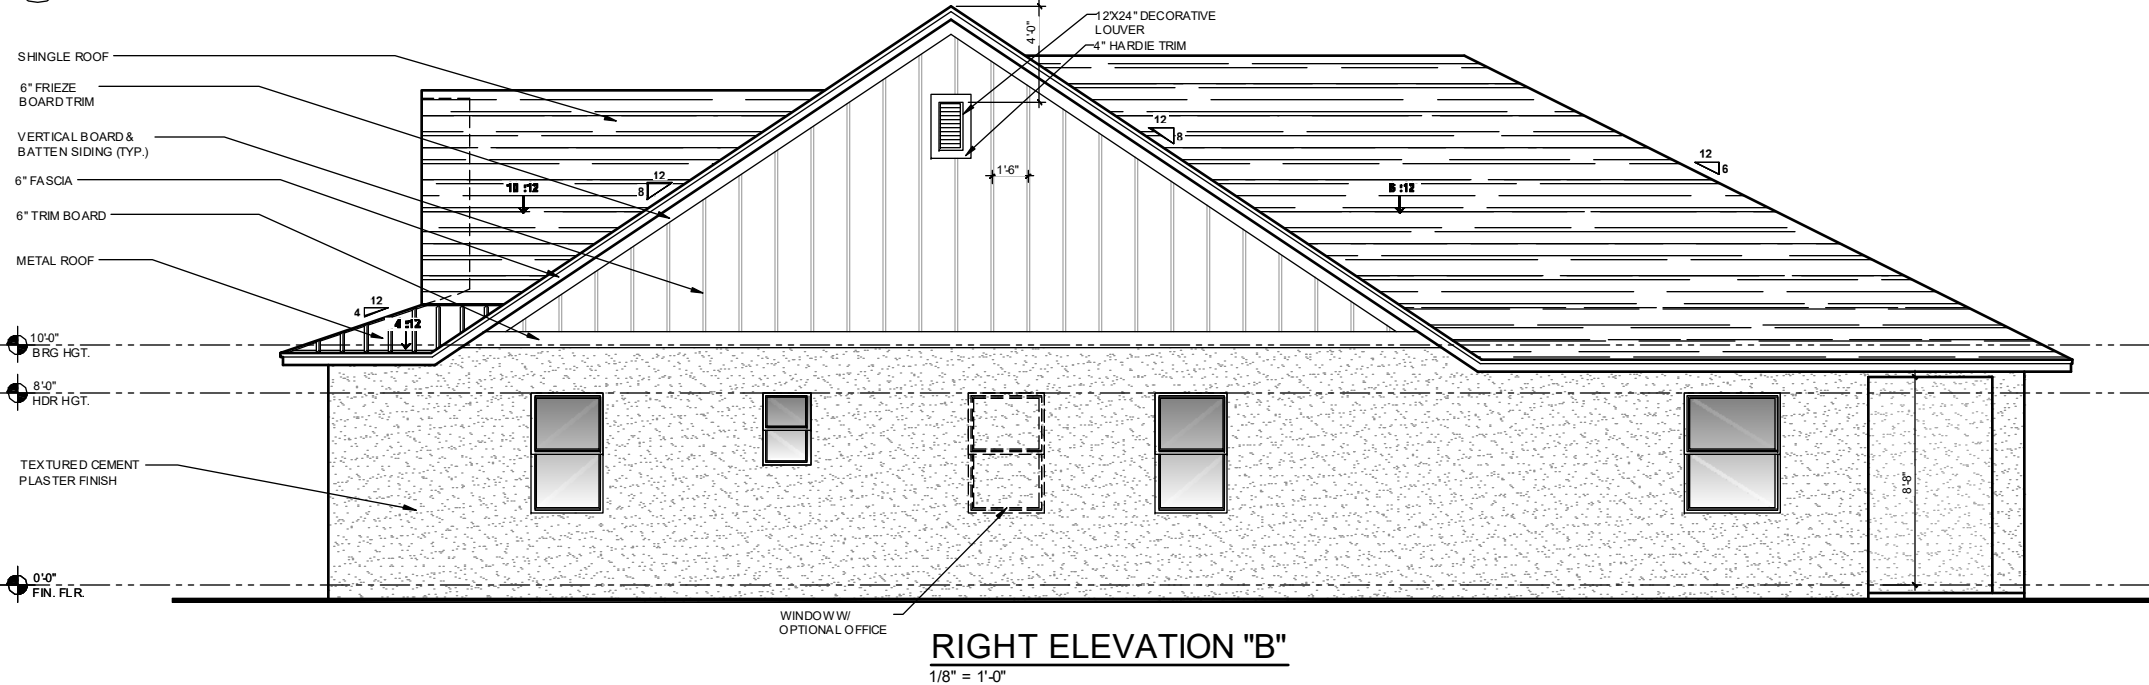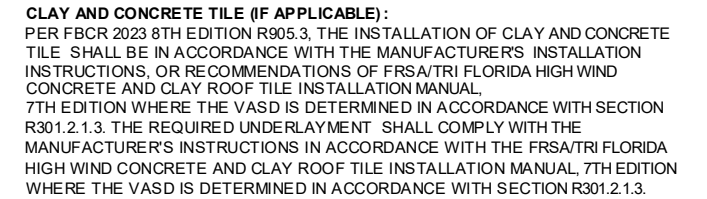

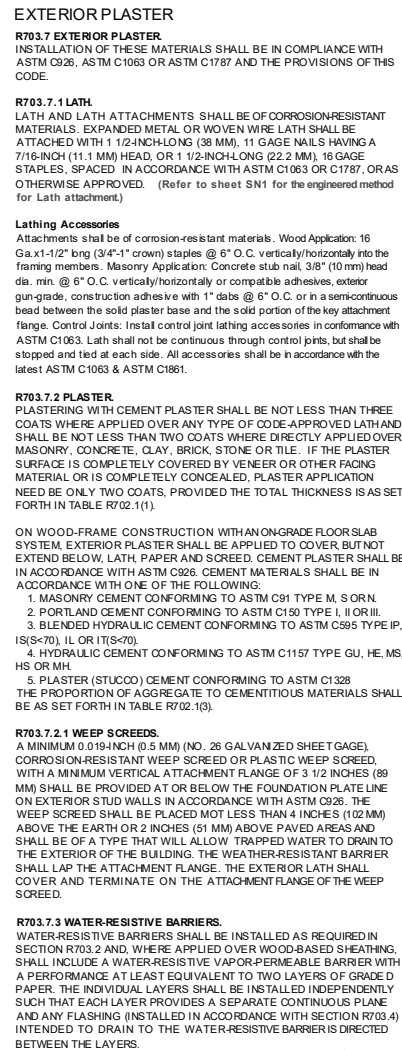


1/8" = 1'-0"




1. Operable windows with openings that will not allow a 4 inch diameter(102 mm) sphere to pass through the opening where the opening is in it's largest open position.
2. Operable windows that are provided with window fall prevention devices that comply with ASTM F2090.
3. Operable windows that are provided with window opening control devices that comply with Section R312.2.2.


IT IS THE CONTRACTOR'S SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

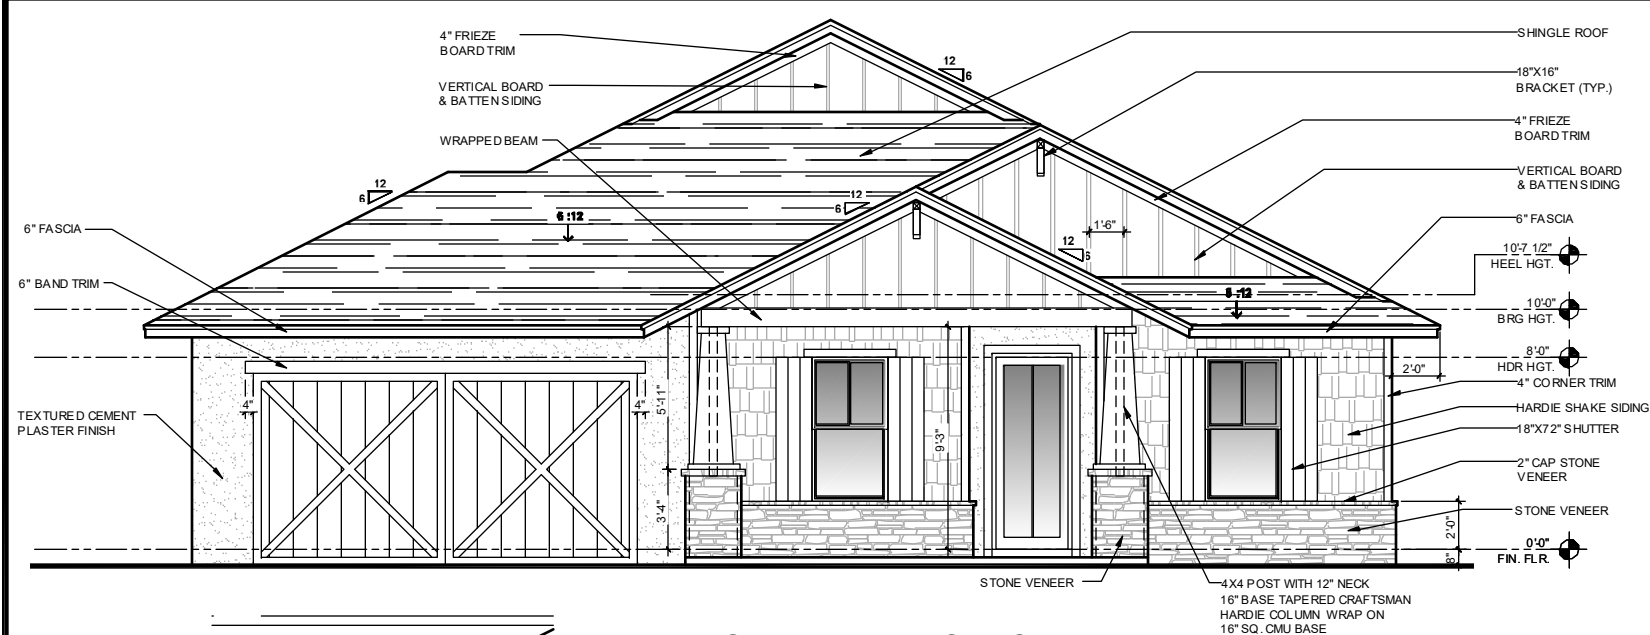


FRONT ELEVATION "C"
1/8" = 1'-0"

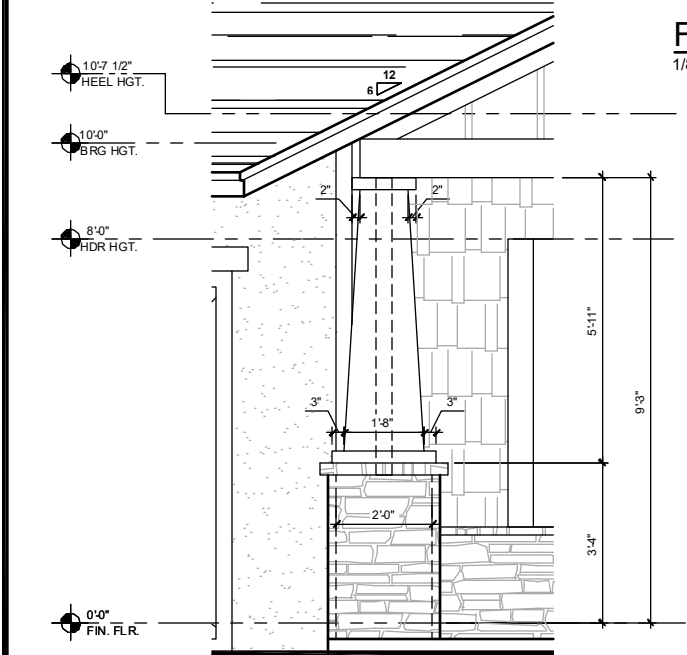


A WALL TO ROOF FLASHING DETAIL
SCALE: 2"=1'-0"

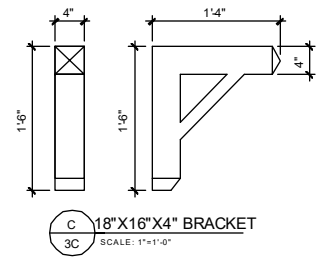

C 18"X16"X4" BRACKET
SCALE: 1"=1'-0"

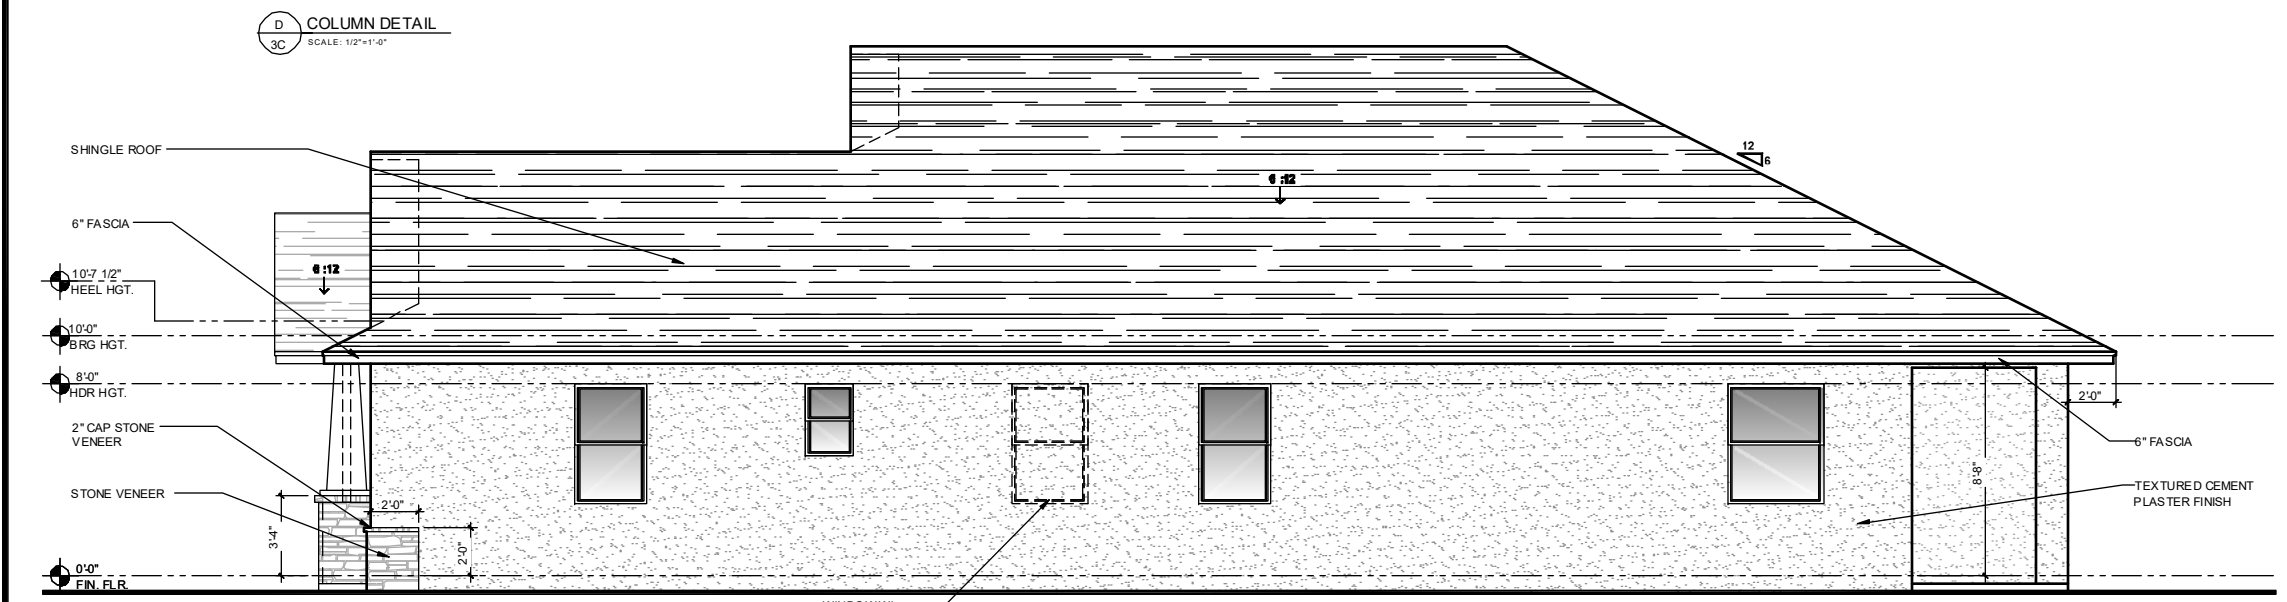

RIGHT ELEVATION "C"
1/8" = 1'-0"

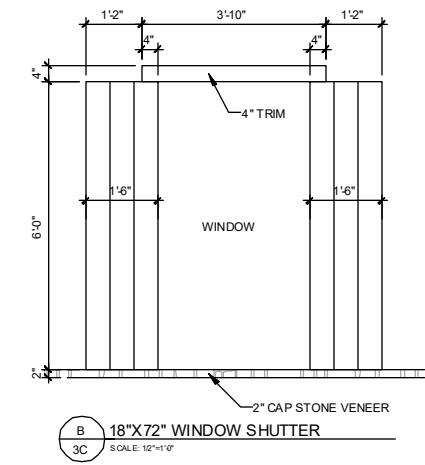

B 18"X72" WINDOW SHUTTER
SCALE: 12"=1'-0"

ROOF CRITERIA

12" OVERHANG U.N.O. / PLUMB CUT FASCIA / ROOF PITCH PER ELEVATION / SHINGLES U.N.O.
ROOF PITCH VARIES PER SUBDIVISIONS IT IS THE CONTRACTORS RESPONSIBILITY TO VERIFY ROOF SLOPE REQUIREMENTS WITH TRUSS MANUFACTURER.
FLASHING SHALL BE INSTALLED AT WALL AND ROOF INTERSECTIONS, AT GUTTERS, AT ALL CHANGES IN ROOF SLOPE OR DIRECTION, AND AROUND ROOF OPENINGS.
STEP FLASHING SHALL BE USED ON ALL ROOF TO WALL INTERSECTIONS ON RAKES.
ATTENTION CONTRACTORS ALL PENETRATIONS THROUGH ROOF ARE TO BE LOCATED ON REAR OR IF NECESSARY ON THE SIDE OF THE ROOF BEHIND THE FRONT FACADE ZONE.

ASPHALT SHINGLES (IF APPLICABLE) :

1. WIND RESISTANCE OF ASPHALT SHINGLES. - ASPHALT SHINGLES SHALL BE INSTALLED IN ACCORDANCE WITH 2023 FBCR (8TH EDITION), SECTION R905.2.6 AND R905.2.6.1.
2. ASPHALT SHINGLES SHALL ONLY BE USED ON ROOF SLOPES OF TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL (2:12) OR GREATER. FOR ROOF SLOPES FROM TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL (2:12) AND LESS THAN FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL (4:12), TWO LAYERS OF UNDERLAYMENT COMPLYING WITH ASTM D226, TYPE II, ASTM D4869, TYPE III OR TYPE IV OR ASTM D8257 IS REQUIRED IN ACCORDANCE WITH SECTION R905.1.1.
FOR ROOF SLOPES FROM FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL (4:12) AND GREATER, ONE LAYER OF UNDERLAYMENT COMPLYING WITH ASTM D226, TYPE II, ASTM D4869, TYPE III OR IV OR ASTM D8257 IS REQUIRED IN ACCORDANCE WITH SECTION R905.1.1.
3. AS AN ALTERNATIVE, THE ENTIRE ROOF DECK SHALL BE COVERED WITH AN APPROVED SELF-ADHERING POLYMER MODIFIED BITUMEN UNDERLAYMENT COMPLYING WITH ASTM D1970 INSTALLED IN ACCORDANCE WITH BOTH THE UNDERLAYMENT MANUFACTURER'S AND ROOF COVERING MANUFACTURER'S INSTALLATION INSTRUCTIONS FOR THE DECK MATERIAL, ROOF VENTILATION CONFIGURATION AND CLIMATE EXPOSURE FOR THE ROOF COVERING TO BE INSTALLED. REFER TO R905.1.1.1.

CLAY AND CONCRETE TILE (IF APPLICABLE) :

PER FBCR 2023 8TH EDITION R905.3, THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS, OR RECOMMENDATIONS OF FRSA/TRI FLORIDA HIGH WIND CONCRETE AND CLAY ROOF TILE INSTALLATION MANUAL, 7TH EDITION WHERE THE VASD IS DETERMINED IN ACCORDANCE WITH SECTION R301.2.1.3. THE REQUIRED UNDERLAYMENT SHALL COMPLY WITH THE MANUFACTURER'S INSTRUCTIONS IN ACCORDANCE WITH THE FRSA/TRI FLORIDA HIGH WIND CONCRETE AND CLAY ROOF TILE INSTALLATION MANUAL, 7TH EDITION WHERE THE VASD IS DETERMINED IN ACCORDANCE WITH SECTION R301.2.1.3.

DISCLAIMER

IT IS THE CONTRACTOR'S SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

R312.2.1 Window sills opening height.

In dwelling units, where the top of the sill of an operable window opening is located less than 24 inches (610mm) above the finished floor and greater than 72 inches (1829 mm) above the finished grade or other surface below on the exterior of the building, the operable window shall comply with one of the following.
1. Operable windows with openings that will not allow a 4 inch diameter(102 mm) sphere to pass through the opening where the opening is in it's largest open position.
2. Operable windows that are provided with window fall prevention devices that comply with ASTM F2090.
3. Operable windows that are provided with window opening control devices that comply with Section R312.2.2.

DISCLAIMER

IT IS THE CONTRACTOR'S SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & FLORIDA DESIGN SOLUTIONS INC. IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & FLORIDA DESIGN SOLUTIONS INC. PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

Keese Associates
ARCHITECTURE | DESIGN | PLANNING
A03003115
268 Summit Lane, Suite 200
Maitland, FL 32751
(407) 744-1750
www.keese.com

AL BD.

ITEG
THOMPSON ENGINEERING GROUP, INC.
4401 Vineland Road Suite A9 Orlando, FL 32811
PH (407) 734-1650
Fax (407) 734-1750
www.iteg.com

PARK SQUARE HOMES
2468 CATALINA
MASTER

title:
ELEVATIONS

project no.2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

3C

ROOF CRITERIA

12" OVERHANG U.N.O. / PLUMB CUT FASCIA / ROOF PITCH PER ELEVATION / SHINGLES U.N.O.

ROOF PITCH VARIES PER SUBDIVISIONS IT IS THE CONTRACTORS RESPONSIBILITY TO VERIFY ROOF SLOPE REQUIREMENTS WITH TRUSS MANUFACTURER.

FLASHING SHALL BE INSTALLED AT WALL AND ROOF INTERSECTIONS, AT GUTTERS, AT ALL CHANGES IN ROOF SLOPE OR DIRECTION, AND AROUND ROOF OPENINGS.

STEP FLASHING SHALL BE USED ON ALL ROOF TO WALL INTERSECTIONS ON RAKES.

ATTENTION CONTRACTORS ALL PENETRATIONS THROUGH ROOF ARE TO BE LOCATED ON REAR OR IF NECESSARY ON THE SIDE OF THE ROOF BEHIND THE FRONT FACADE ZONE.

ASPHALT SHINGLES (IF APPLICABLE) :

1. WIND RESISTANCE OF ASPHALT SHINGLES. - ASPHALT SHINGLES SHALL BE INSTALLED IN ACCORDANCE WITH 2023 FBCR (8TH EDITION), SECTION R905.2.6 AND R905.2.6.1.

2. ASPHALT SHINGLES SHALL ONLY BE USED ON ROOF SLOPES OF TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL (2:12) OR GREATER. FOR ROOF SLOPES FROM TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL (2:12) AND LESS THAN FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL (4:12), TWO LAYERS OF UNDERLAYMENT COMPLYING WITH ASTM D226, TYPE II, ASTM D4869, TYPE III OR TYPE IV OR ASTM D8257 IS REQUIRED IN ACCORDANCE WITH SECTION R905.1.1.

FOR ROOF SLOPES FROM FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL (4:12) AND GREATER, ONE LAYER OF UNDERLAYMENT COMPLYING WITH ASTM D226, TYPE II, ASTM D4869, TYPE III OR IV OR ASTM D8257 IS REQUIRED IN ACCORDANCE WITH SECTION R905.1.1.

3. AS AN ALTERNATIVE, THE ENTIRE ROOF DECK SHALL BE COVERED WITH AN APPROVED SELF-ADHERING POLYMER MODIFIED BITUMEN UNDERLAYMENT COMPLYING WITH ASTM D1970 INSTALLED IN ACCORDANCE WITH BOTH THE UNDERLAYMENT MANUFACTURER'S AND ROOF COVERING MANUFACTURER'S INSTALLATION INSTRUCTIONS FOR THE DECK MATERIAL, ROOF VENTILATION CONFIGURATION AND CLIMATE EXPOSURE FOR THE ROOF COVERING TO BE INSTALLED. REFER TO R905.1.1.1.


CLAY AND CONCRETE TILE (IF APPLICABLE) :

PER FBCR 2023 8TH EDITION R905.3, THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS, OR RECOMMENDATIONS OF FRSA/TRI FLORIDA HIGH WIND CONCRETE AND CLAY ROOF TILE INSTALLATION MANUAL, 7TH EDITION WHERE THE VASD IS DETERMINED IN ACCORDANCE WITH SECTION R301.2.1.3. THE REQUIRED UNDERLAYMENT SHALL COMPLY WITH THE MANUFACTURER'S INSTRUCTIONS IN ACCORDANCE WITH THE FRSA/TRI FLORIDA HIGH WIND CONCRETE AND CLAY ROOF TILE INSTALLATION MANUAL, 7TH EDITION WHERE THE VASD IS DETERMINED IN ACCORDANCE WITH SECTION R301.2.1.3.

R312.2.1 Window sills opening height.


In dwelling units, where the top of the sill of an operable window opening is located less than 24 inches (610mm) above the finished floor and greater than 72 inches (1829 mm) above the finished grade or other surface below on the exterior of the building, the operable window shall comply with one of the following.

1. Operable windows with openings that will not allow a 4 inch diameter(102 mm) sphere to pass through the opening where the opening is in it's largest open position.
2. Operable windows that are provided with window fall prevention devices that comply with ASTM F2090.
3. Operable windows that are provided with window opening control devices that comply with Section R312.2.2.

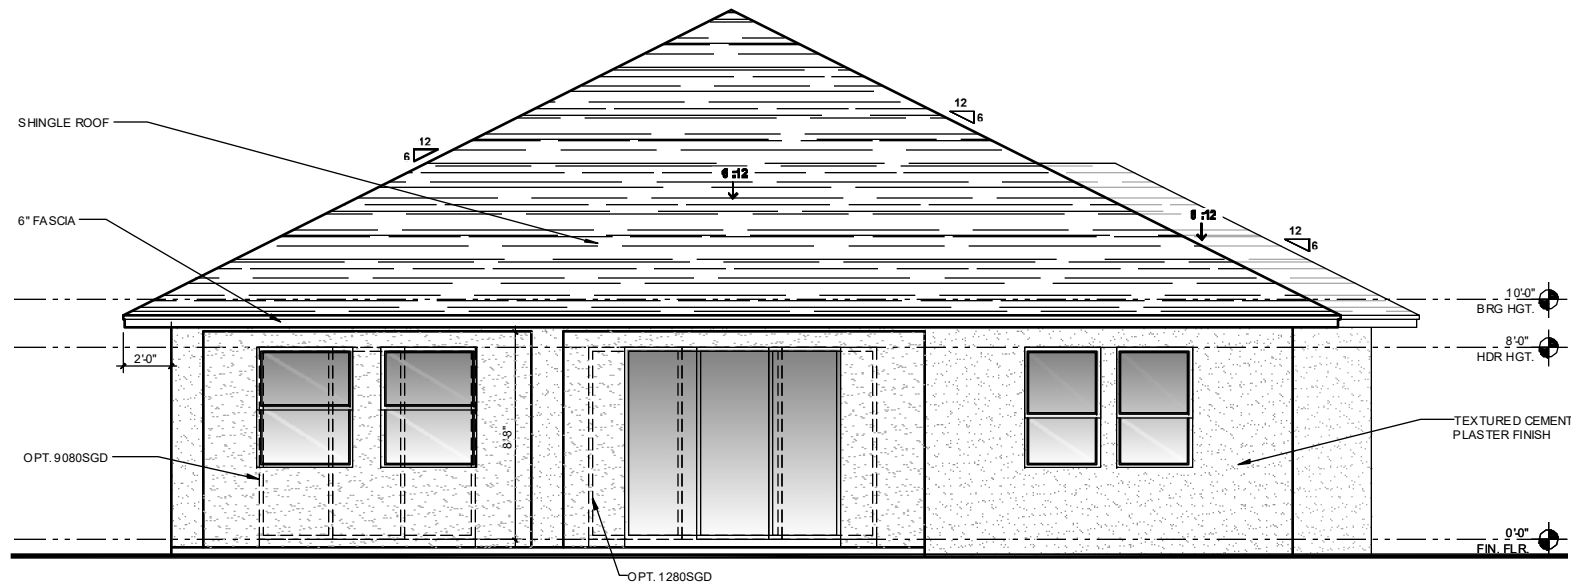

REAR ELEVATION "C"

1/8" = 1'-0"

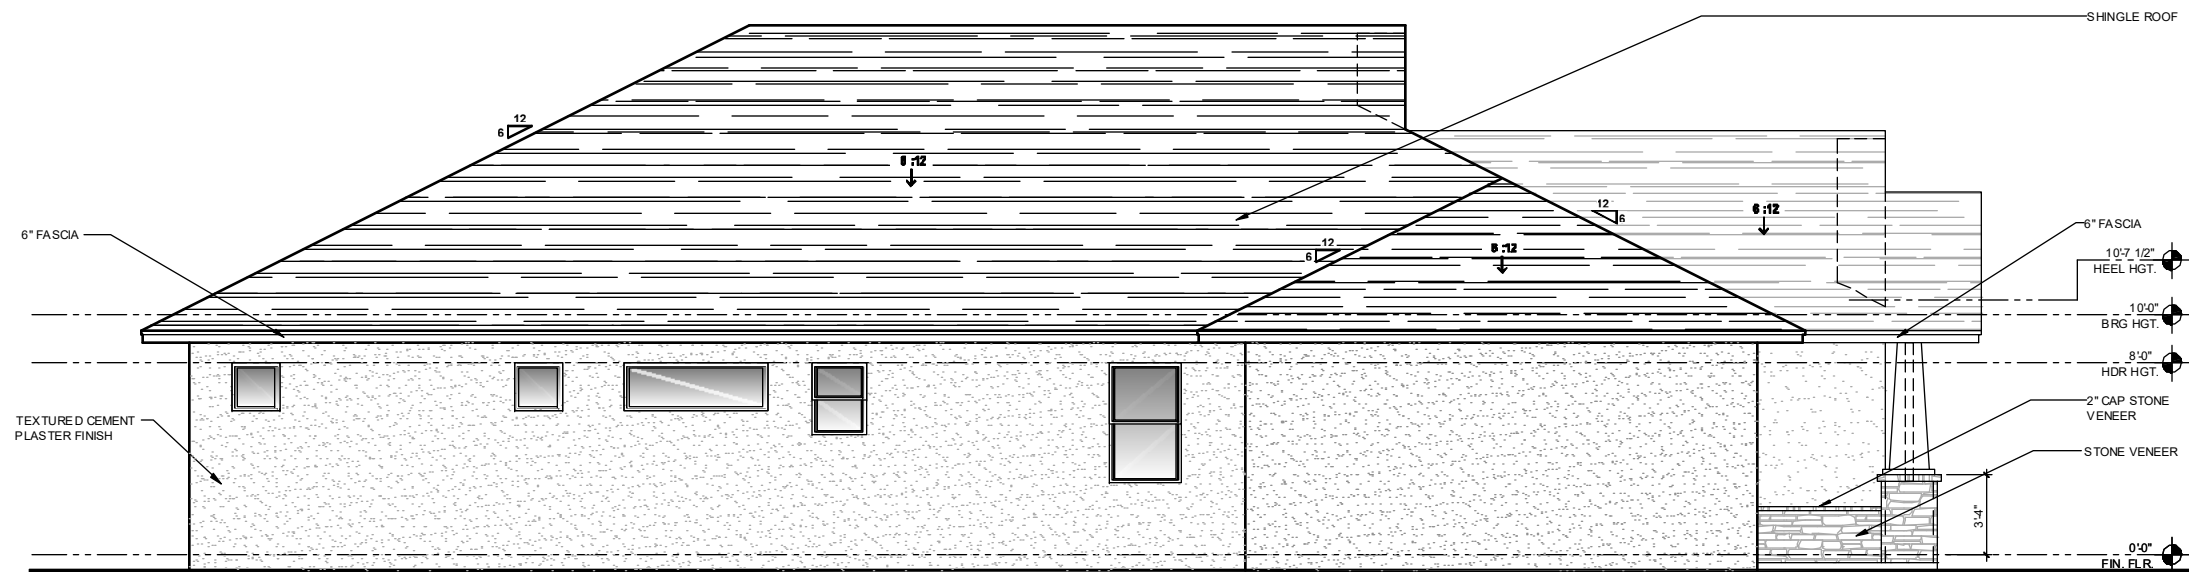


LEFT ELEVATION "C"

1/8" = 1'-0"


DISCLAIMER

IT IS THE CONTRACTOR'S SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESSEE ASSOCIATES & FLORIDA DESIGN SOLUTIONS INC. IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESSEE ASSOCIATES & FLORIDA DESIGN SOLUTIONS INC. PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

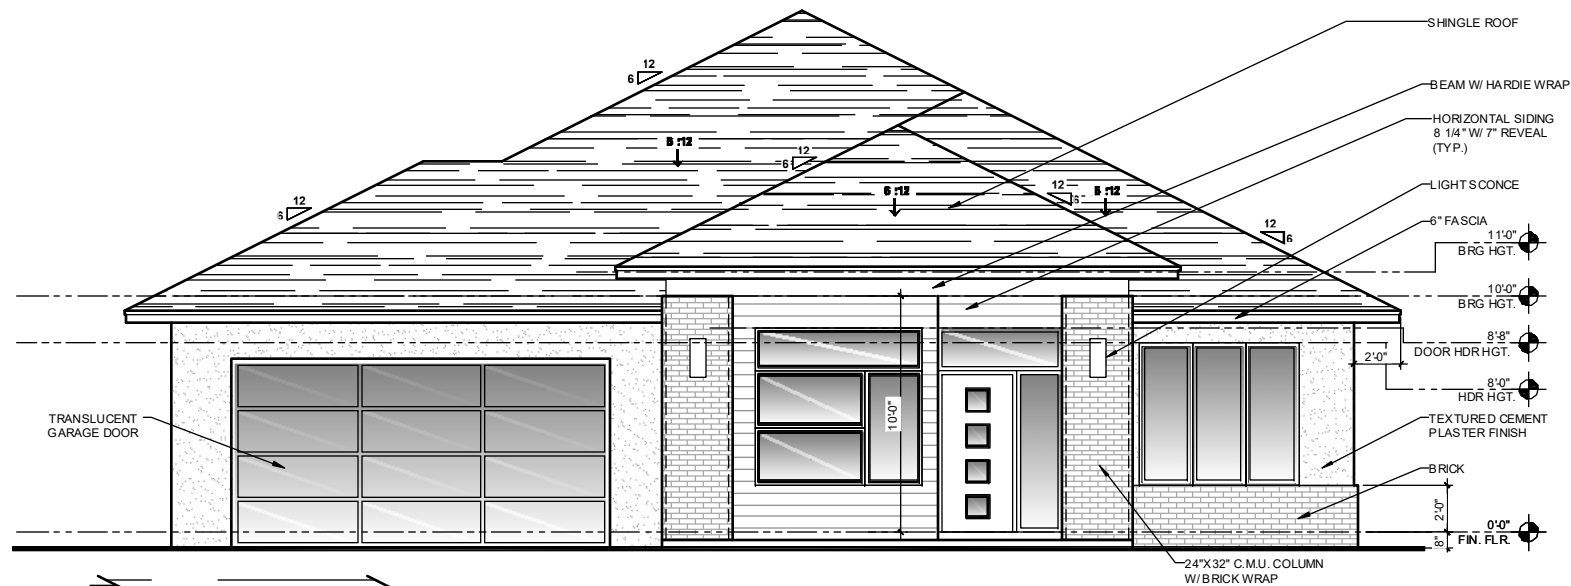


FRONT ELEVATION "D"

1/8" = 1'-0"

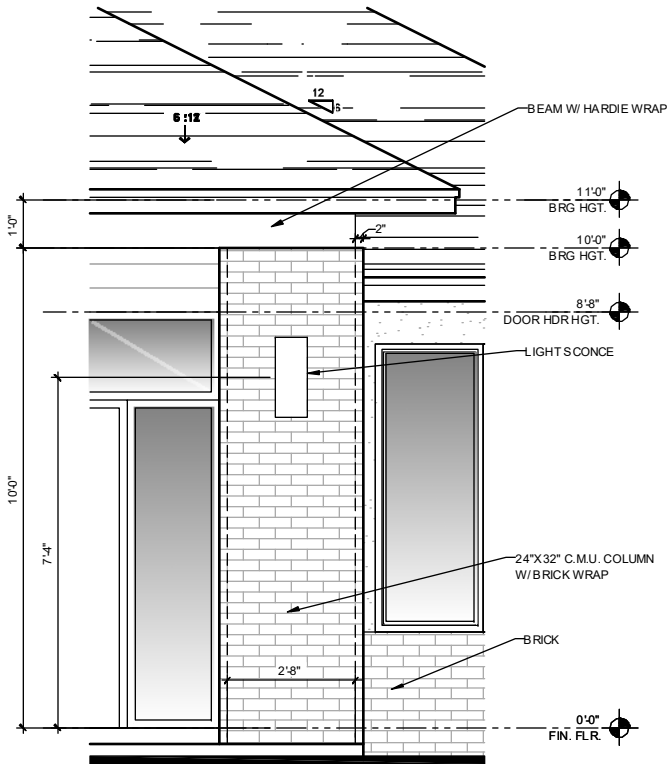

COLUMN DETAIL

SCALE 1/2" = 1'-0"

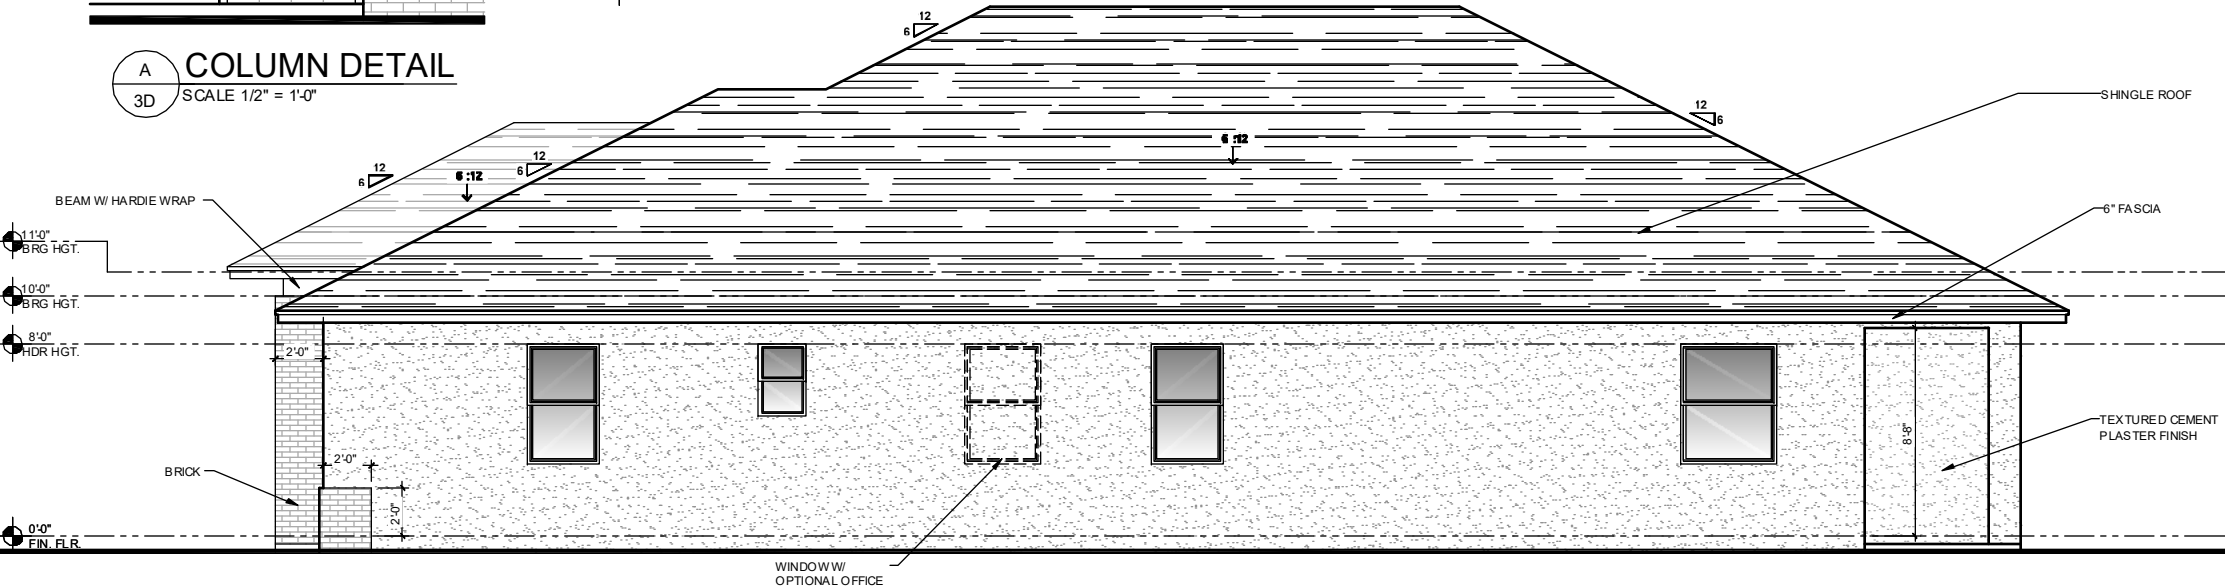

RIGHT ELEVATION "D"

1/8" = 1'-0"

EXTERIOR PLASTER

R703.7 EXTERIOR PLASTER.
INSTALLATION OF THESE MATERIALS SHALL BE IN COMPLIANCE WITH ASTM C926, ASTM C1063 OR ASTM C1787 AND THE PROVISIONS OF THIS CODE.

R703.7.1 LATH.
LATH AND LATH ATTACHMENTS SHALL BE OF CORROSION-RESISTANT MATERIALS. EXPANDED METAL OR WOVEN WIRE LATH SHALL BE ATTACHED WITH 1 1/2-INCH-LONG (38 MM), 11 GAGE NAILS HAVING A 7/16-INCH (11.1 MM) HEAD, OR 1 1/2-INCH-LONG (22.2 MM), 16 GAGE STAPLES, SPACED IN ACCORDANCE WITH ASTM C1063 OR C1787, OR AS OTHERWISE APPROVED. (Refer to sheet SN1 for the engineered method for Lath attachment)

Lathing Accessories
Attachments shall be of corrosion-resistant materials. Wood Application: 16 Gs x 1-1/2" long (3/4" x 1" crown) staples @ 6" O.C. vertically/horizontally into the framing members. Masonry Application: Concrete stud nail, 3/8" (10 mm) head dia. min. @ 6" O.C. vertically/horizontally or compatible adhesives, exterior gun-grade, construction adhesive with 1" date @ 6" O.C. or in a semi-continuous bead between the solid plaster base and the solid portion of the key attachment flange. Control Joints: Install control joint lathing accessories in conformance with ASTM C1063. Lath shall not be continuous through control joints, but shall be stopped and tied at each side. All accessories shall be in accordance with the latest ASTM C1063 & ASTM C1661.

R703.7.2 PLASTER.
PLASTERING WITH CEMENT PLASTER SHALL BE NOT LESS THAN THREE COATS WHERE APPLIED OVER ANY TYPE OF CODE-APPROVED LATH AND SHALL BE NOT LESS THAN TWO COATS WHERE DIRECTLY APPLIED OVER MASONRY, CONCRETE, CLAY, BRICK, STONE OR TILE. IF THE PLASTER SURFACE IS COMPLETELY COVERED BY VENEER OR OTHER FACING MATERIAL OR IS COMPLETELY CONCEALED, PLASTER APPLICATION NEED BE ONLY TWO COATS, PROVIDED THE TOTAL THICKNESS IS AS SET FORTH IN TABLE R702.1(1).

ON WOOD-FRAME CONSTRUCTION WITH AN ON-GRADE FLOOR SLAB SYSTEM, EXTERIOR PLASTER SHALL BE APPLIED TO COVER, BUT NOT EXTEND BELOW, LATH, PAPER AND SCREED. CEMENT PLASTER SHALL BE IN ACCORDANCE WITH ASTM C926. CEMENT MATERIALS SHALL BE IN ACCORDANCE WITH ONE OF THE FOLLOWING:

1. MASONRY CEMENT CONFORMING TO ASTM C91 TYPE M, S OR N.
2. PORTLAND CEMENT CONFORMING TO ASTM C150 TYPE I, II OR III.
3. BLENDED HYDRAULIC CEMENT CONFORMING TO ASTM C595 TYPE IP, IS(S-70), IL OR IT(S-70).
4. HYDRAULIC CEMENT CONFORMING TO ASTM C1157 TYPE GU, HE, HS, HS OR MH.
5. PLASTER (STUCCO) CEMENT CONFORMING TO ASTM C1328

THE PROPORTION OF AGGREGATE TO CEMENTITIOUS MATERIALS SHALL BE AS SET FORTH IN TABLE R702.1(5).

R703.7.2.1 WEEP SCREEDS.
A MINIMUM 0.019-INCH (0.5 MM) (NO. 26 GALVANIZED SHEET GAGE), CORROSION-RESISTANT WEEP SCREED OR PLASTIC WEEP SCREED, WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 3 1/2 INCHES (89 MM) SHALL BE PROVIDED AT OR BELOW THE FOUNDATION PLATE LINE ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C926. THE WEEP SCREED SHALL BE PLACED NOT LESS THAN 4 INCHES (102 MM) ABOVE THE EARTH OR 2 INCHES (51 MM) ABOVE PAVED AREAS AND SHALL BE OF A TYPE THAT WILL ALLOW TRAPPED WATER TO DRAIN TO THE EXTERIOR OF THE BUILDING. THE WEATHER-RESISTANT BARRIER SHALL LAP THE ATTACHMENT FLANGE. THE EXTERIOR LATH SHALL COVER AND TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP SCREED.

R703.7.3 WATER-RESISTIVE BARRIERS.
WATER-RESISTIVE BARRIERS SHALL BE INSTALLED AS REQUIRED IN SECTION R703.2 AND, WHERE APPLIED OVER WOOD-BASED SHEATHING, SHALL INCLUDE A WATER-RESISTIVE VAPOR-PERMEABLE BARRIER WITH A PERFORMANCE AT LEAST EQUIVALENT TO TWO LAYERS OF GRADE D PAPER. THE INDIVIDUAL LAYERS SHALL BE INSTALLED INDEPENDENTLY SUCH THAT EACH LAYER PROVIDES A SEPARATE CONTINUOUS PLANE AND ANY FLASHING (INSTALLED IN ACCORDANCE WITH SECTION R703.4) INTENDED TO DRAIN TO THE WATER-RESISTIVE BARRIER IS DIRECTED BETWEEN THE LAYERS.

R312.2.1 Window sills opening height.

In dwelling units, where the top of the sill of an operable window opening is located less than 24 inches (610mm) above the finished floor and greater than 72 inches (1829 mm) above the finished grade or other surface below on the exterior of the building, the operable window shall comply with one of the following:

1. Operable windows with openings that will not allow a 4 inch diameter(102 mm) sphere to pass through the opening where the opening is in it's largest open position.
2. Operable windows that are provided with window fall prevention devices that comply with ASTM F2090.
3. Operable windows that are provided with window opening control devices that comply with Section R312.2.2.

ROOF CRITERIA

12" OVERHANG U.N.O. / PLUMB CUT FASCIA / ROOF PITCH PER ELEVATION / SHINGLES U.N.O.

ROOF PITCH VARIES PER SUBDIVISIONS IT IS THE CONTRACTORS RESPONSIBILITY TO VERIFY ROOF SLOPE REQUIREMENTS WITH TRUSS MANUFACTURER.

FLASHING SHALL BE INSTALLED AT WALL AND ROOF INTERSECTIONS, AT GUTTERS, AT ALL CHANGES IN ROOF SLOPE OR DIRECTION, AND AROUND ROOF OPENINGS.

STEP FLASHING SHALL BE USED ON ALL ROOF TO WALL INTERSECTIONS ON RAKES.

ATTENTION CONTRACTORS ALL PENETRATIONS THROUGH ROOF ARE TO BE LOCATED ON REAR OR IF NECESSARY ON THE SIDE OF THE ROOF BEHIND THE FRONT FACADE ZONE.

ASPHALT SHINGLES (IF APPLICABLE) :


1. WIND RESISTANCE OF ASPHALT SHINGLES. - ASPHALT SHINGLES SHALL BE INSTALLED IN ACCORDANCE WITH 2023 FBCR (8TH EDITION), SECTION R905.2.6 AND R905.2.6.1.
2. ASPHALT SHINGLES SHALL ONLY BE USED ON ROOF SLOPES OF TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL (2:12) OR GREATER. FOR ROOF SLOPES FROM TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL (2:12) AND LESS THAN FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL (4:12), TWO LAYERS OF UNDERLAYMENT COMPLYING WITH ASTM D226, TYPE II, ASTM D4869, TYPE III OR TYPE IV OR ASTM D8257 IS REQUIRED IN ACCORDANCE WITH SECTION R905.1.1. FOR ROOF SLOPES FROM FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL (4:12) AND GREATER, ONE LAYER OF UNDERLAYMENT COMPLYING WITH ASTM D226, TYPE II, ASTM D4869, TYPE III OR IV OR ASTM D8257 IS REQUIRED IN ACCORDANCE WITH SECTION R905.1.1.
3. AS AN ALTERNATIVE, THE ENTIRE ROOF DECK SHALL BE COVERED WITH AN APPROVED SELF-ADHERING POLYMER MODIFIED BITUMEN UNDERLAYMENT COMPLYING WITH ASTM D1970 INSTALLED IN ACCORDANCE WITH BOTH THE UNDERLAYMENT MANUFACTURER'S AND ROOF COVERING MANUFACTURER'S INSTALLATION INSTRUCTIONS FOR THE DECK MATERIAL, ROOF VENTILATION CONFIGURATION AND CLIMATE EXPOSURE FOR THE ROOF COVERING TO BE INSTALLED. REFER TO R905.1.1.1.

CLAY AND CONCRETE TILE (IF APPLICABLE) :

PER FBCR 2023 8TH EDITION R905.3, THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS, OR RECOMMENDATIONS OF FRSA/TRI FLORIDA HIGH WIND CONCRETE AND CLAY ROOF TILE INSTALLATION MANUAL, 7TH EDITION WHERE THE VASD IS DETERMINED IN ACCORDANCE WITH SECTION R301.2.1.3. THE REQUIRED UNDERLAYMENT SHALL COMPLY WITH THE MANUFACTURER'S INSTRUCTIONS IN ACCORDANCE WITH THE FRSA/TRI FLORIDA HIGH WIND CONCRETE AND CLAY ROOF TILE INSTALLATION MANUAL, 7TH EDITION WHERE THE VASD IS DETERMINED IN ACCORDANCE WITH SECTION R301.2.1.3.

DISCLAIMER

IT IS THE CONTRACTOR'S SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.




PARK SQUARE HOMES
2468 CATALINA
MASTER

title:
ELEVATIONS

project no.2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

3D

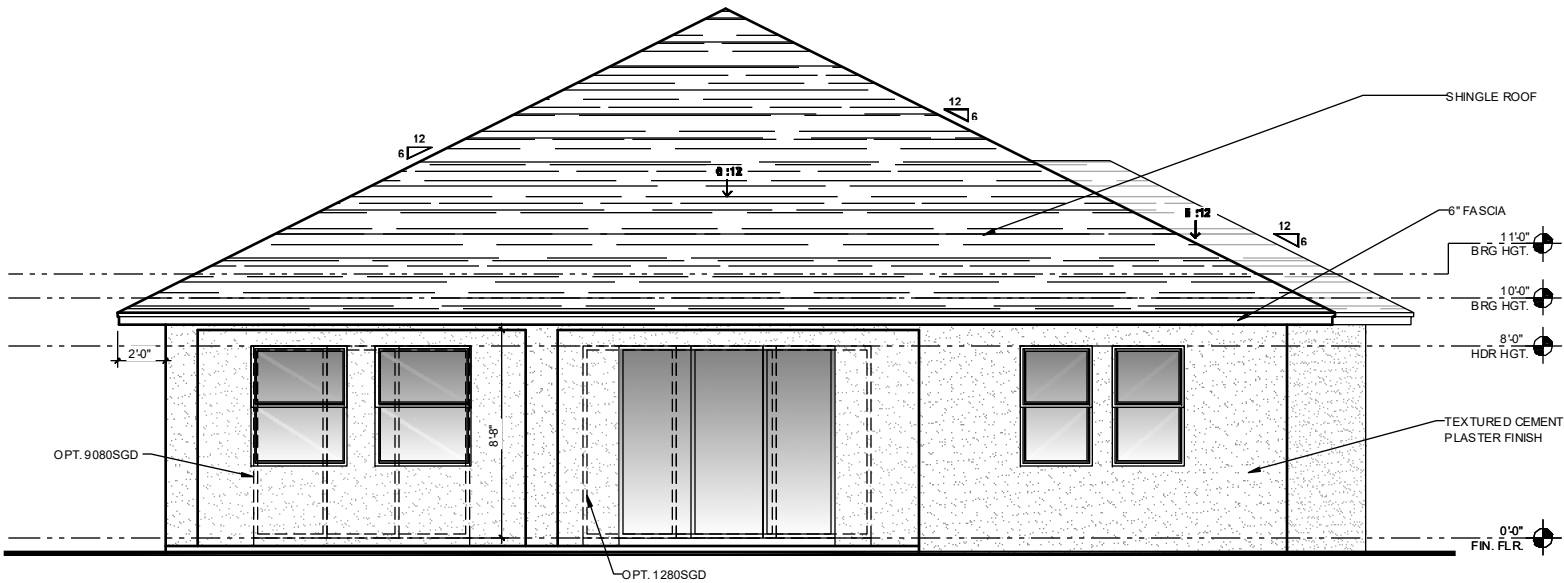

REAR ELEVATION "D"

1/8" = 1'-0"

EXTERIOR PLASTER

R703.7 EXTERIOR PLASTER
INSTALLATION OF THESE MATERIALS SHALL BE IN COMPLIANCE WITH ASTM C926, ASTM C1063 OR ASTM C1787 AND THE PROVISIONS OF THIS CODE.

R703.7.1 LATH
LATH AND LATH ATTACHMENTS SHALL BE OF CORROSION-RESISTANT MATERIALS. EXPANDED METAL OR WOVEN WIRE LATH SHALL BE ATTACHED WITH 1 1/2-INCH-LONG (38 MM), 11 GAGE NAILS HAVING A 7/16-INCH (11.1 MM) HEAD, OR 1 1/2-INCH-LONG (22.2 MM), 16 GAGE STAPLES, SPACED IN ACCORDANCE WITH ASTM C1063 OR C1787, OR AS OTHERWISE APPROVED. (Refer to sheet SM1 for the engineered method for Lath attachment)

Lathing Accessories
Attachments shall be of corrosion-resistant materials. Wood Application: 16 Ga x1-1/2" ring (3/4"-1" crown) staples @ 6" O.C. vertically/horizontally into the framing members. Masonry Application: Concrete stud nail, 3/8" (10 mm) head dia. min. @ 6" O.C. vertically/horizontally or compatible adhesives, exterior gun-grade, construction adhesive with 1" dabs @ 6" O.C. or in a semi-continuous bead between the solid plaster base and the solid portion of the key attachment flange. Control Joints: Install control joint lathing accessories in conformance with ASTM C1063. Lath shall not be continuous through control joints, but shall be stopped and tied at each side. All accessories shall be in accordance with the latest ASTM C1063 & ASTM C1861.

R703.7.2 PLASTER
PLASTERING WITH CEMENT PLASTER SHALL BE NOT LESS THAN THREE COATS WHERE APPLIED OVER ANY TYPE OF CODE-APPROVED LATH AND SHALL BE NOT LESS THAN TWO COATS WHERE DIRECTLY APPLIED OVER MASONRY, CONCRETE, CLAY, BRICK, STONE OR TILE. IF THE PLASTER SURFACE IS COMPLETELY COVERED BY VENEER OR OTHER FACING MATERIAL OR IS COMPLETELY CONCEALED, PLASTER APPLICATION NEED BE ONLY TWO COATS, PROVIDED THE TOTAL THICKNESS IS AS SET FORTH IN TABLE R702.1(1).

ON WOOD-FRAME CONSTRUCTION WITH AN ON-GRADE FLOOR SLAB SYSTEM, EXTERIOR PLASTER SHALL BE APPLIED TO COVER, BUT NOT EXTEND BELOW, LATH, PAPER AND SCREED. CEMENT PLASTER SHALL BE IN ACCORDANCE WITH ASTM C926. CEMENT MATERIALS SHALL BE IN ACCORDANCE WITH ONE OF THE FOLLOWING:
1. MASONRY CEMENT CONFORMING TO ASTM C91 TYPE M, S OR N.
2. PORTLAND CEMENT CONFORMING TO ASTM C150 TYPE I, II OR III.
3. BLENDED HYDRAULIC CEMENT CONFORMING TO ASTM C595 TYPE IP, IS(S-70), IL OR IT(S-70).
4. HYDRAULIC CEMENT CONFORMING TO ASTM C1157 TYPE GU, HE, MS, HS OR MH.
5. PLASTER (STUCCO) CEMENT CONFORMING TO ASTM C1328
THE PROPORTION OF AGGREGATE TO CEMENTITIOUS MATERIALS SHALL BE AS SET FORTH IN TABLE R702.1(3).

R703.7.2.1 WEEP SCREEDS.
A MINIMUM 0.0194-INCH (0.5 MM) (NO. 26 GALVANIZED SHEET GAGE), CORROSION-RESISTANT WEEP SCREED OR PLASTIC WEEP SCREED, WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 3 1/2 INCHES (89 MM) SHALL BE PROVIDED AT OR BELOW THE FOUNDATION PLATE LINE ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C926. THE WEEP SCREED SHALL BE PLACED NOT LESS THAN 4 INCHES (102 MM) ABOVE THE EARTH OR 2 INCHES (51 MM) ABOVE PAVED AREAS AND SHALL BE OF A TYPE THAT WILL ALLOW TRAPPED WATER TO DRAIN TO THE EXTERIOR OF THE BUILDING. THE WEATHER-RESISTANT BARRIER SHALL LAP THE ATTACHMENT FLANGE. THE EXTERIOR LATH SHALL COVER AND TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP SCREED.

R703.7.3 WATER-RESISTIVE BARRIERS.
WATER-RESISTIVE BARRIERS SHALL BE INSTALLED AS REQUIRED IN SECTION R703.2 AND, WHERE APPLIED OVER WOOD-BASED SHEATHING, SHALL INCLUDE A WATER-RESISTIVE VAPOR-PERMEABLE BARRIER WITH A PERFORMANCE AT LEAST EQUIVALENT TO TWO LAYERS OF GRADE D PAPER. THE INDIVIDUAL LAYERS SHALL BE INSTALLED INDEPENDENTLY SUCH THAT EACH LAYER PROVIDES A SEPARATE CONTINUOUS PLANE AND ANY FLASHING (INSTALLED IN ACCORDANCE WITH SECTION R703.4) INTENDED TO DRAIN TO THE WATER-RESISTIVE BARRIER IS DIRECTED BETWEEN THE LAYERS.

R312.2.1 Window sills opening height.

In dwelling units, where the top of the sill of an operable window opening is located less than 24 inches (610mm) above the finished floor and greater than 72 inches (1829 mm) above the finished grade or other surface below on the exterior of the building, the operable window shall comply with one of the following.

1. Operable windows with openings that will not allow a 4 inch diameter(102 mm) sphere to pass through the opening where the opening is in it's largest open position.
2. Operable windows that are provided with window fall prevention devices that comply with ASTM F2090.
3. Operable windows that are provided with window opening control devices that comply with Section R312.2.2.

ROOF CRITERIA

12" OVERHANG U.N.O. / PLUMB CUT FASCIA / ROOF PITCH PER ELEVATION / SHINGLES U.N.O.

ROOF PITCH VARIES PER SUBDIVISIONS IT IS THE CONTRACTORS RESPONSIBILITY TO VERIFY ROOF SLOPE REQUIREMENTS WITH TRUSS MANUFACTURER.

FLASHING SHALL BE INSTALLED AT WALL AND ROOF INTERSECTIONS, AT GUTTERS, AT ALL CHANGES IN ROOF SLOPE OR DIRECTION, AND AROUND ROOF OPENINGS.

STEP FLASHING SHALL BE USED ON ALL ROOF TO WALL INTERSECTIONS ON RAKES.


ATTENTION CONTRACTORS ALL PENETRATIONS THROUGH ROOF ARE TO BE LOCATED ON REAR OR IF NECESSARY ON THE SIDE OF THE ROOF BEHIND THE FRONT FACADE ZONE.

ASPHALT SHINGLES (IF APPLICABLE) :

1. WIND RESISTANCE OF ASPHALT SHINGLES. - ASPHALT SHINGLES SHALL BE INSTALLED IN ACCORDANCE WITH 2023 FBCR (8TH EDITION), SECTION R905.2.6 AND R905.2.6.1.
2. ASPHALT SHINGLES SHALL ONLY BE USED ON ROOF SLOPES OF TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL (2:12) OR GREATER. FOR ROOF SLOPES FROM TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL (2:12) AND LESS THAN FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL (4:12), TWO LAYERS OF UNDERLAYMENT COMPLYING WITH ASTM D226, TYPE II, ASTM D4869, TYPE III OR TYPE IV OR ASTM D8257 IS REQUIRED IN ACCORDANCE WITH SECTION R905.1.1. FOR ROOF SLOPES FROM FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL (4:12) AND GREATER, ONE LAYER OF UNDERLAYMENT COMPLYING WITH ASTM D226, TYPE II, ASTM D4869, TYPE III OR IV OR ASTM D8257 IS REQUIRED IN ACCORDANCE WITH SECTION R905.1.1.
3. AS AN ALTERNATIVE, THE ENTIRE ROOF DECK SHALL BE COVERED WITH AN APPROVED SELF-ADHERING POLYMER MODIFIED BITUMEN UNDERLAYMENT COMPLYING WITH ASTM D1970 INSTALLED IN ACCORDANCE WITH BOTH THE UNDERLAYMENT MANUFACTURER'S AND ROOF COVERING MANUFACTURER'S INSTALLATION INSTRUCTIONS FOR THE DECK MATERIAL, ROOF VENTILATION CONFIGURATION AND CLIMATE EXPOSURE FOR THE ROOF COVERING TO BE INSTALLED. REFER TO R905.1.1.1.

CLAY AND CONCRETE TILE (IF APPLICABLE) :

PER FBCR 2023 8TH EDITION R905.3, THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS, OR RECOMMENDATIONS OF FRSA/TRI FLORIDA HIGH WIND CONCRETE AND CLAY ROOF TILE INSTALLATION MANUAL, 7TH EDITION WHERE THE VASD IS DETERMINED IN ACCORDANCE WITH SECTION R301.2.1.3. THE REQUIRED UNDERLAYMENT SHALL COMPLY WITH THE MANUFACTURER'S INSTRUCTIONS IN ACCORDANCE WITH THE FRSA/TRI FLORIDA HIGH WIND CONCRETE AND CLAY ROOF TILE INSTALLATION MANUAL, 7TH EDITION WHERE THE VASD IS DETERMINED IN ACCORDANCE WITH SECTION R301.2.1.3.

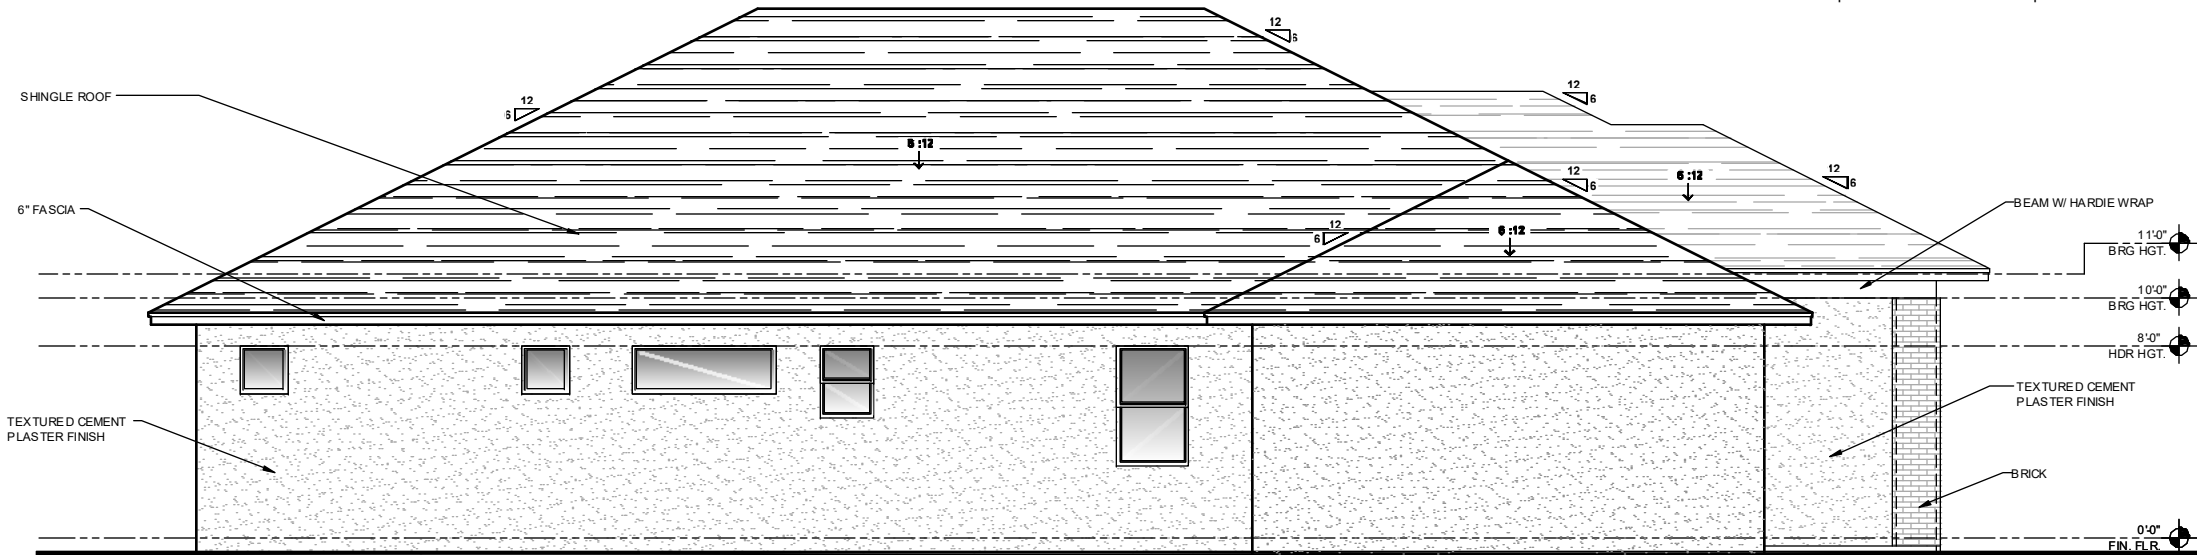

LEFT ELEVATION "D"

1/8" = 1'-0"

DISCLAIMER

IT IS THE CONTRACTOR'S SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.




PARK SQUARE HOMES
2468 CATALINA
MASTER

Title:
ELEVATIONS

Project no. 2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

3D_1

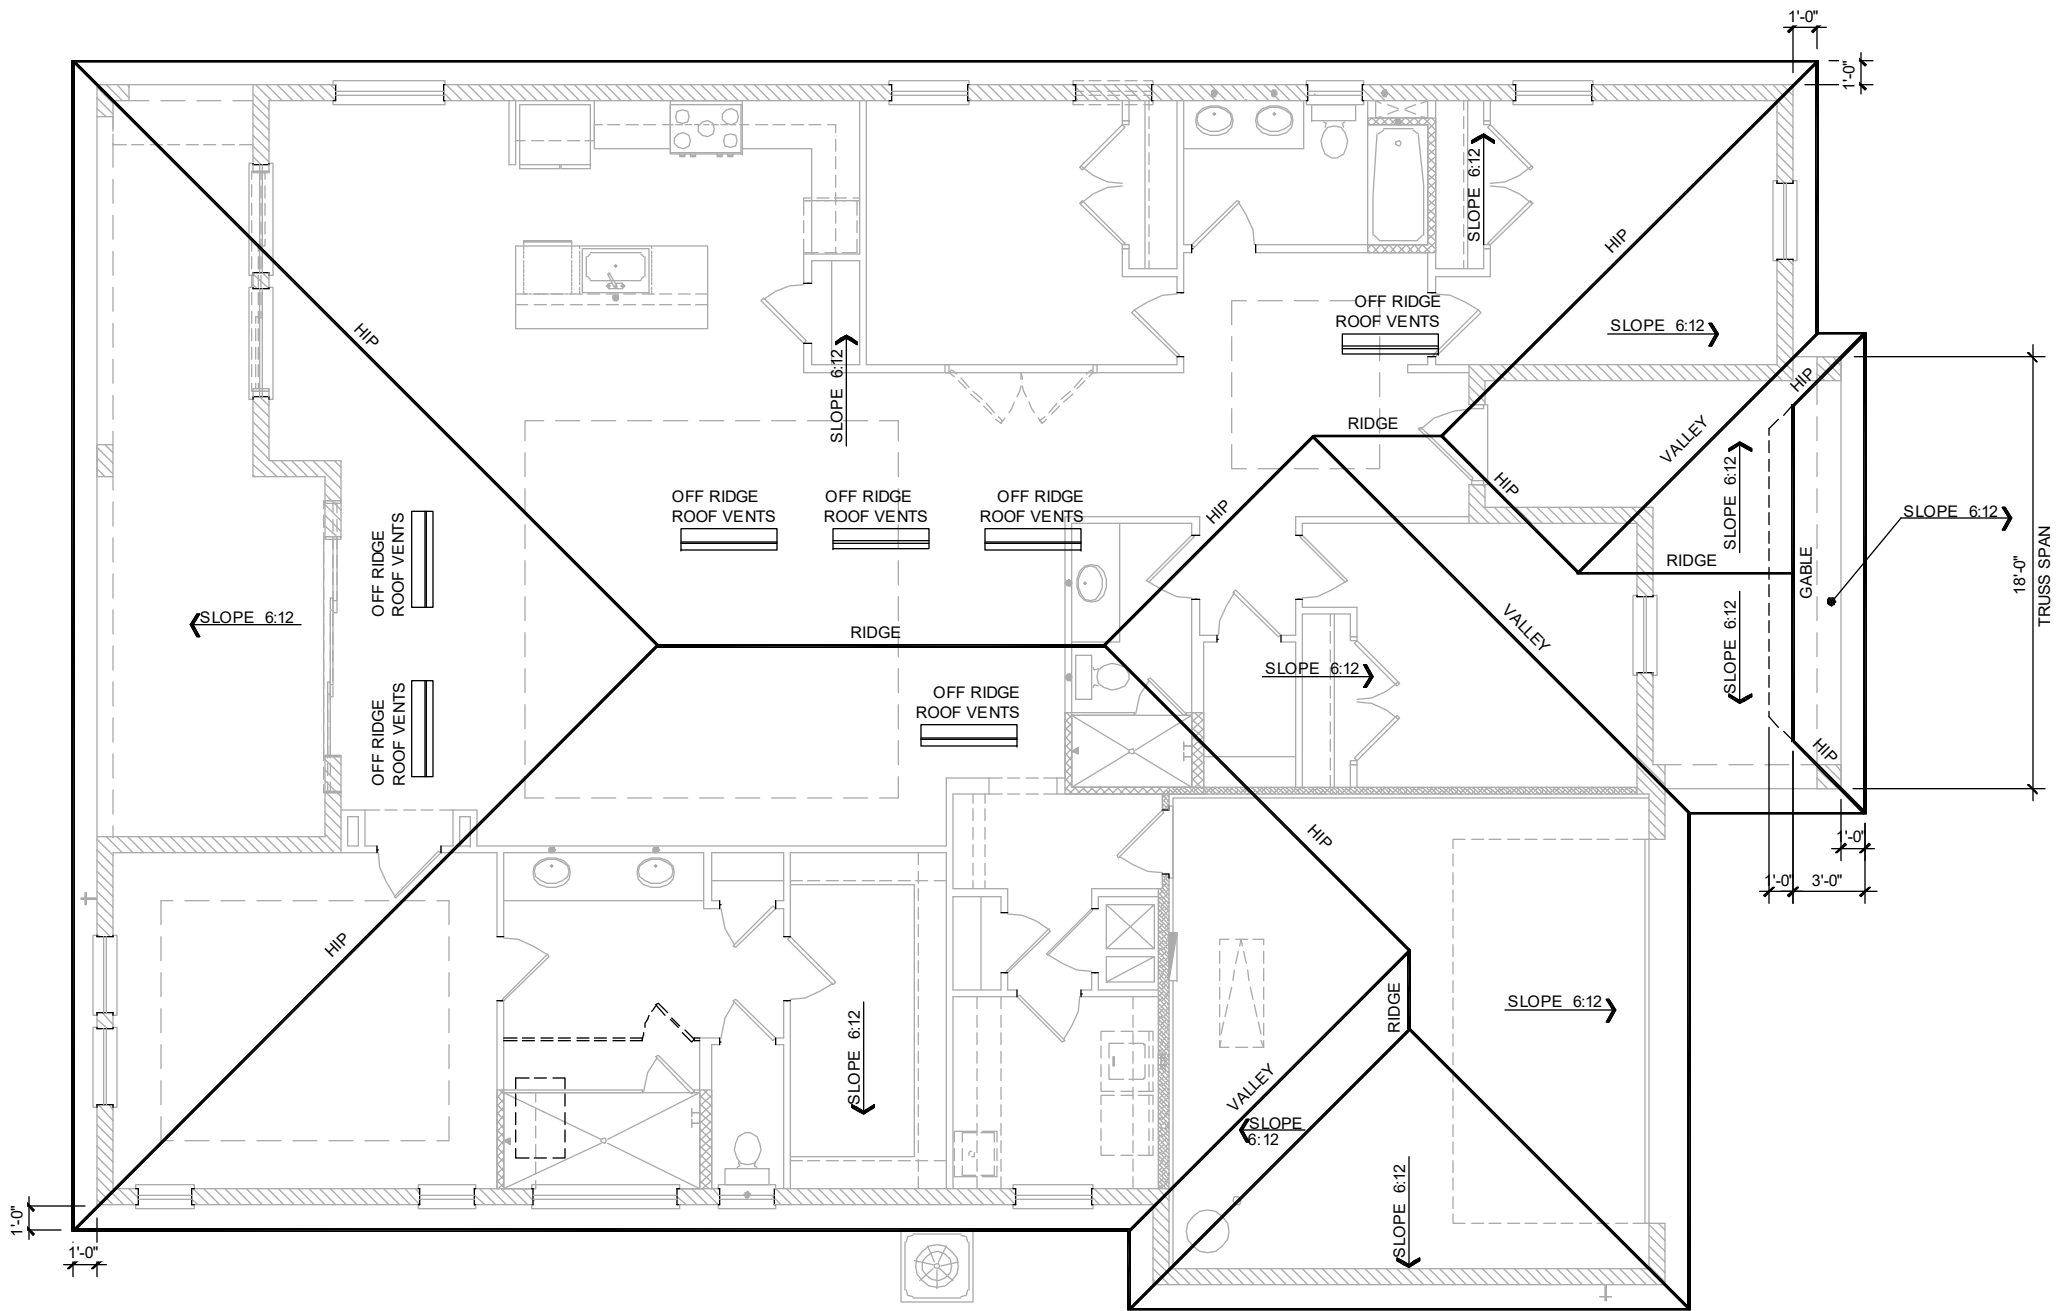

- GENERAL NOTES:**
1. THE ROOF PLAN DEPICTED IS NOT INTENDED TO SERVE AS A TRUSS DESIGN.
 2. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS AND ELEVATIONS FOR BEARING HEIGHTS.
 3. TRUSS SPACING SHALL BE 24" O.C. MAX. UNLESS OTHERWISE NOTED. CONVENTIONAL FRAMING SHALL BE 16" O.C. MAX. OR AS OTHERWISE NOTED.
 4. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON-BEARING WALLS AND AT VOLUME AREA UNLESS NOTED OTHERWISE.
 5. ALIGN TRUSSES AND HAND FRAMING SO ALL GYPSUM WALL BOARD WILL BE CONTINUOUS FROM FLOOR TO CEILING.
 6. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:
 - A) ALL CEILING HUNG SOFFITS AND SOFFITS WITH CABINETS AS SHOWN ON PLANS.
 - B) ATTIC LOCATED HVAC UNITS AS SHOWN ON PLANS.
 7. REFER TO MANUFACTURER SPECIFICATIONS FOR INSTALLATION REQUIREMENTS OF ALL HARDWARE BEFORE INSTALLATION.
 8. PROVIDE BRACING AND BLOCKING PER BCSI IN ADDITION TO BRACING AND BLOCKING SHOWN ON PLANS.

VENTILATION REQUIRED

3315 S.F. / 300 = 11.05
11.05 / 2 = 5.525
5.525 * 144 = 795.6
795.6 SQ. IN.
795.6 SQ. IN. OF VENT REQUIRED

OFF-RIDGE VENTS

796 SQ. IN. REQUIRED
796 SQ. IN. PROVIDED (OFF-RIDGE VENTS)

ROOF PLAN ELEVATION "A"

1/8" = 1'-0"

DISCLAIMER

IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.




PARK SQUARE HOMES
2468 CATALINA
MASTER

title:
ROOF PLAN

project no.2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

4A

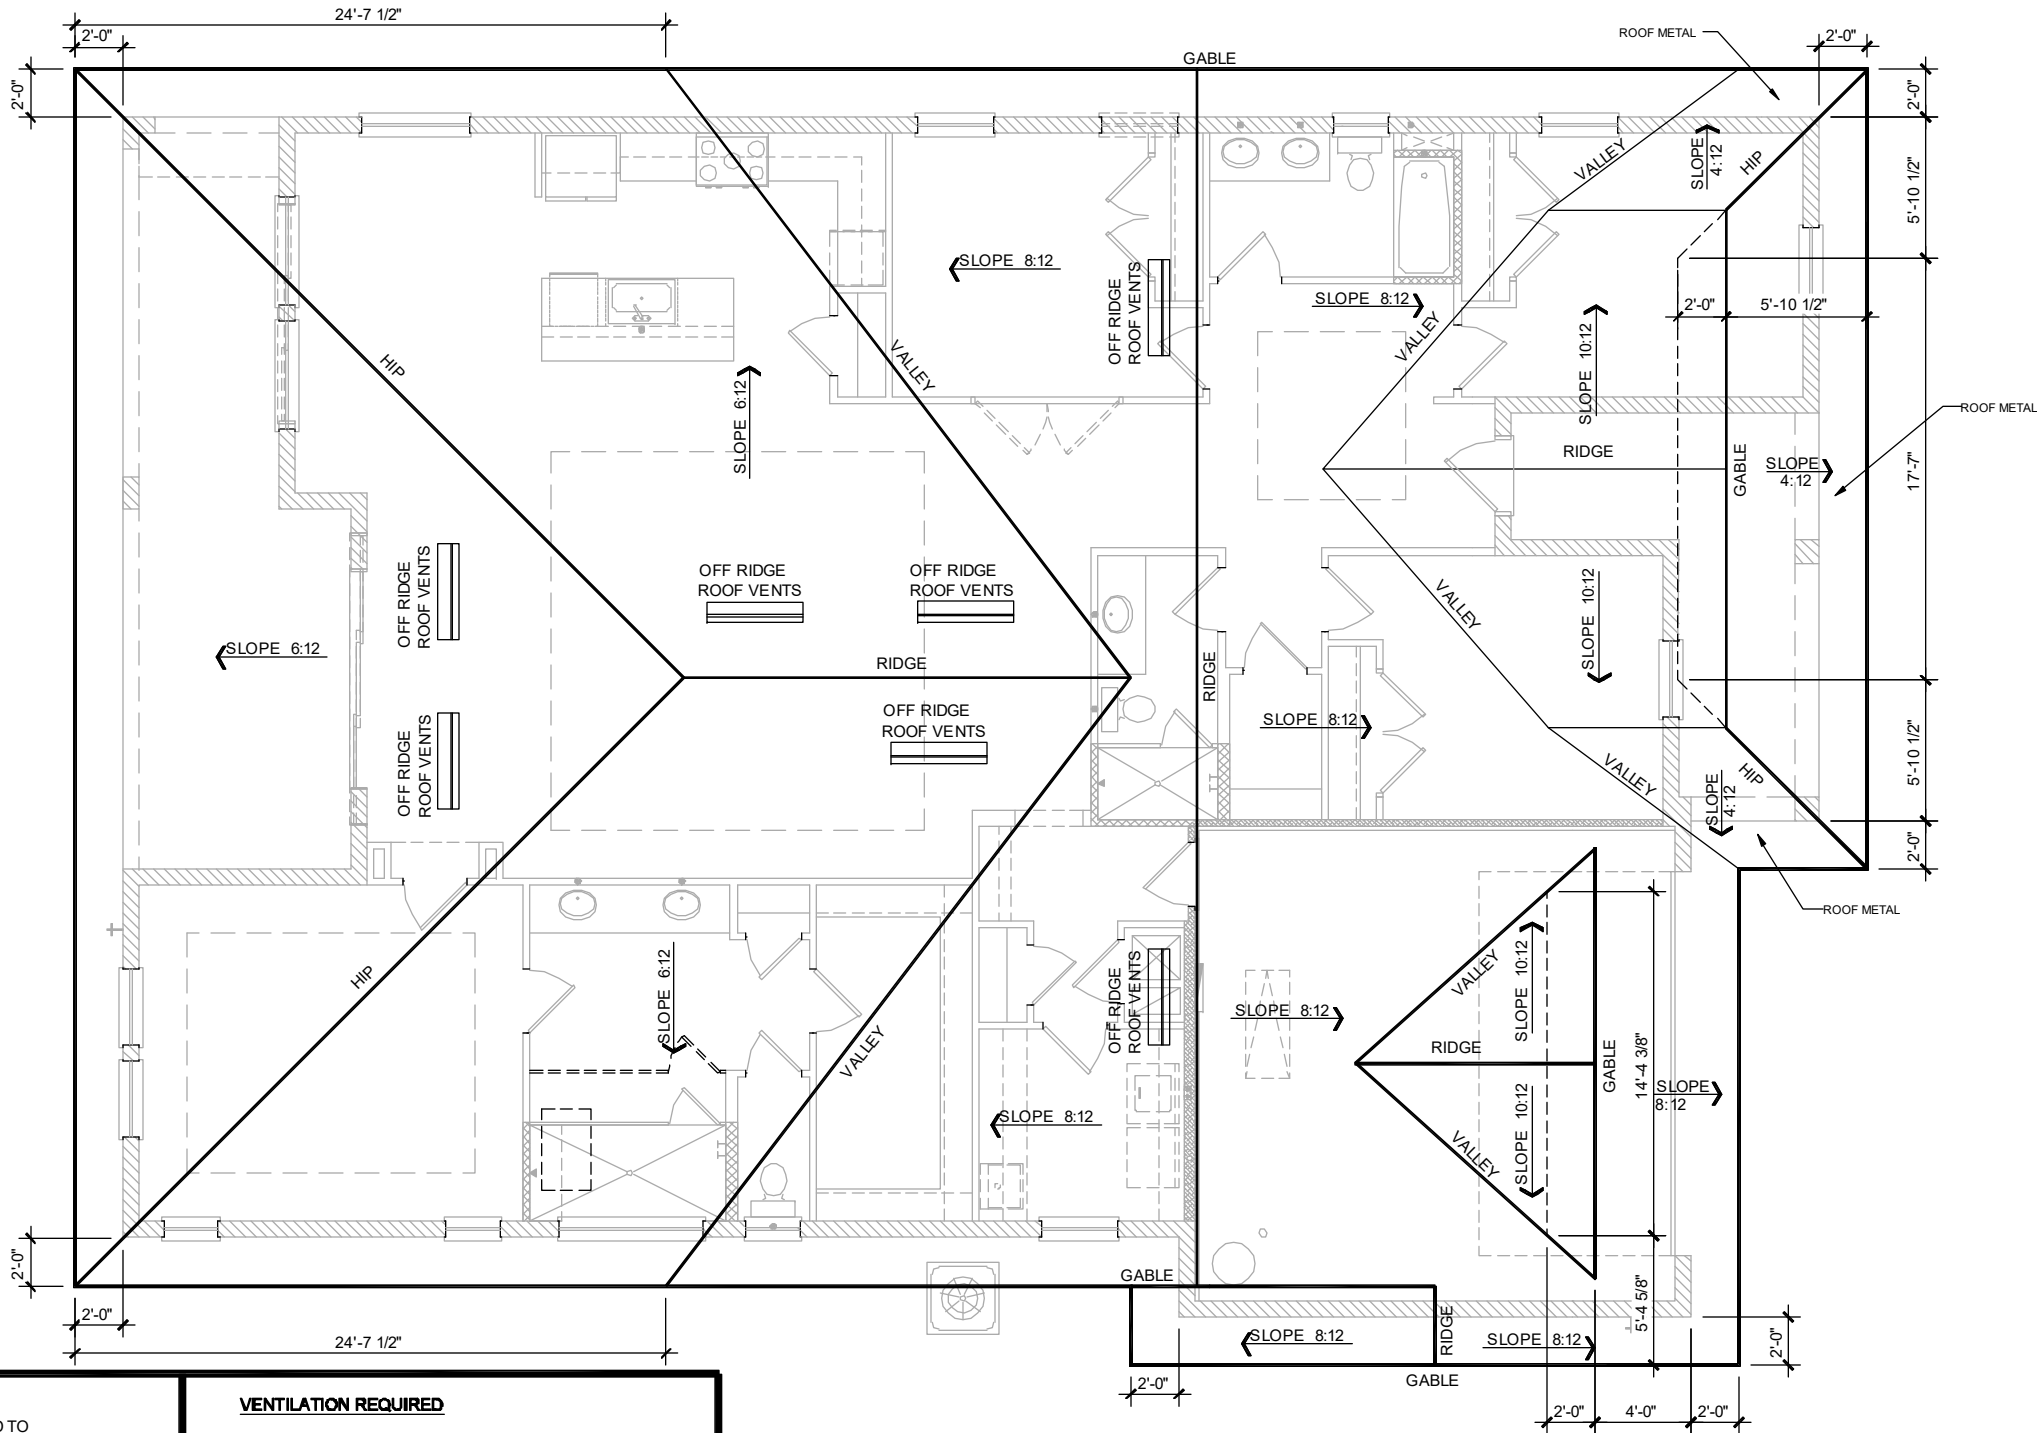

- GENERAL NOTES:**
1. THE ROOF PLAN DEPICTED IS NOT INTENDED TO SERVE AS A TRUSS DESIGN.
 2. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS AND ELEVATIONS FOR BEARING HEIGHTS.
 3. TRUSS SPACING SHALL BE 24" O.C. MAX. UNLESS OTHERWISE NOTED. CONVENTIONAL FRAMING SHALL BE 16" O.C. MAX. OR AS OTHERWISE NOTED.
 4. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON-BEARING WALLS AND AT VOLUME AREA UNLESS NOTED OTHERWISE.
 5. ALIGN TRUSSES AND HAND FRAMING SO ALL GYPSUM WALL BOARD WILL BE CONTINUOUS FROM FLOOR TO CEILING.
 6. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:
 - A) ALL CEILING HUNG SOFFITS AND SOFFITS WITH CABINETS AS SHOWN ON PLANS.
 - B) ATTIC LOCATED HVAC UNITS AS SHOWN ON PLANS.
 7. REFER TO MANUFACTURER SPECIFICATIONS FOR INSTALLATION REQUIREMENTS OF ALL HARDWARE BEFORE INSTALLATION.
 8. PROVIDE BRACING AND BLOCKING PER BCSI IN ADDITION TO BRACING AND BLOCKING SHOWN ON PLANS.

VENTILATION REQUIRED

3278 S.F. / 300 = 10.926
10.926 / 2 = 5.463
5.463 * 144 = 786.672
786.672 SQ. IN.
786.7 SQ. IN. OF VENT REQUIRED

OFF-RIDGE VENTS


788 SQ. IN. REQUIRED
788 SQ. IN. PROVIDED (OFF-RIDGE VENTS)

ROOF PLAN ELEVATION "B"

1/8" = 1'-0"

DISCLAIMER

IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

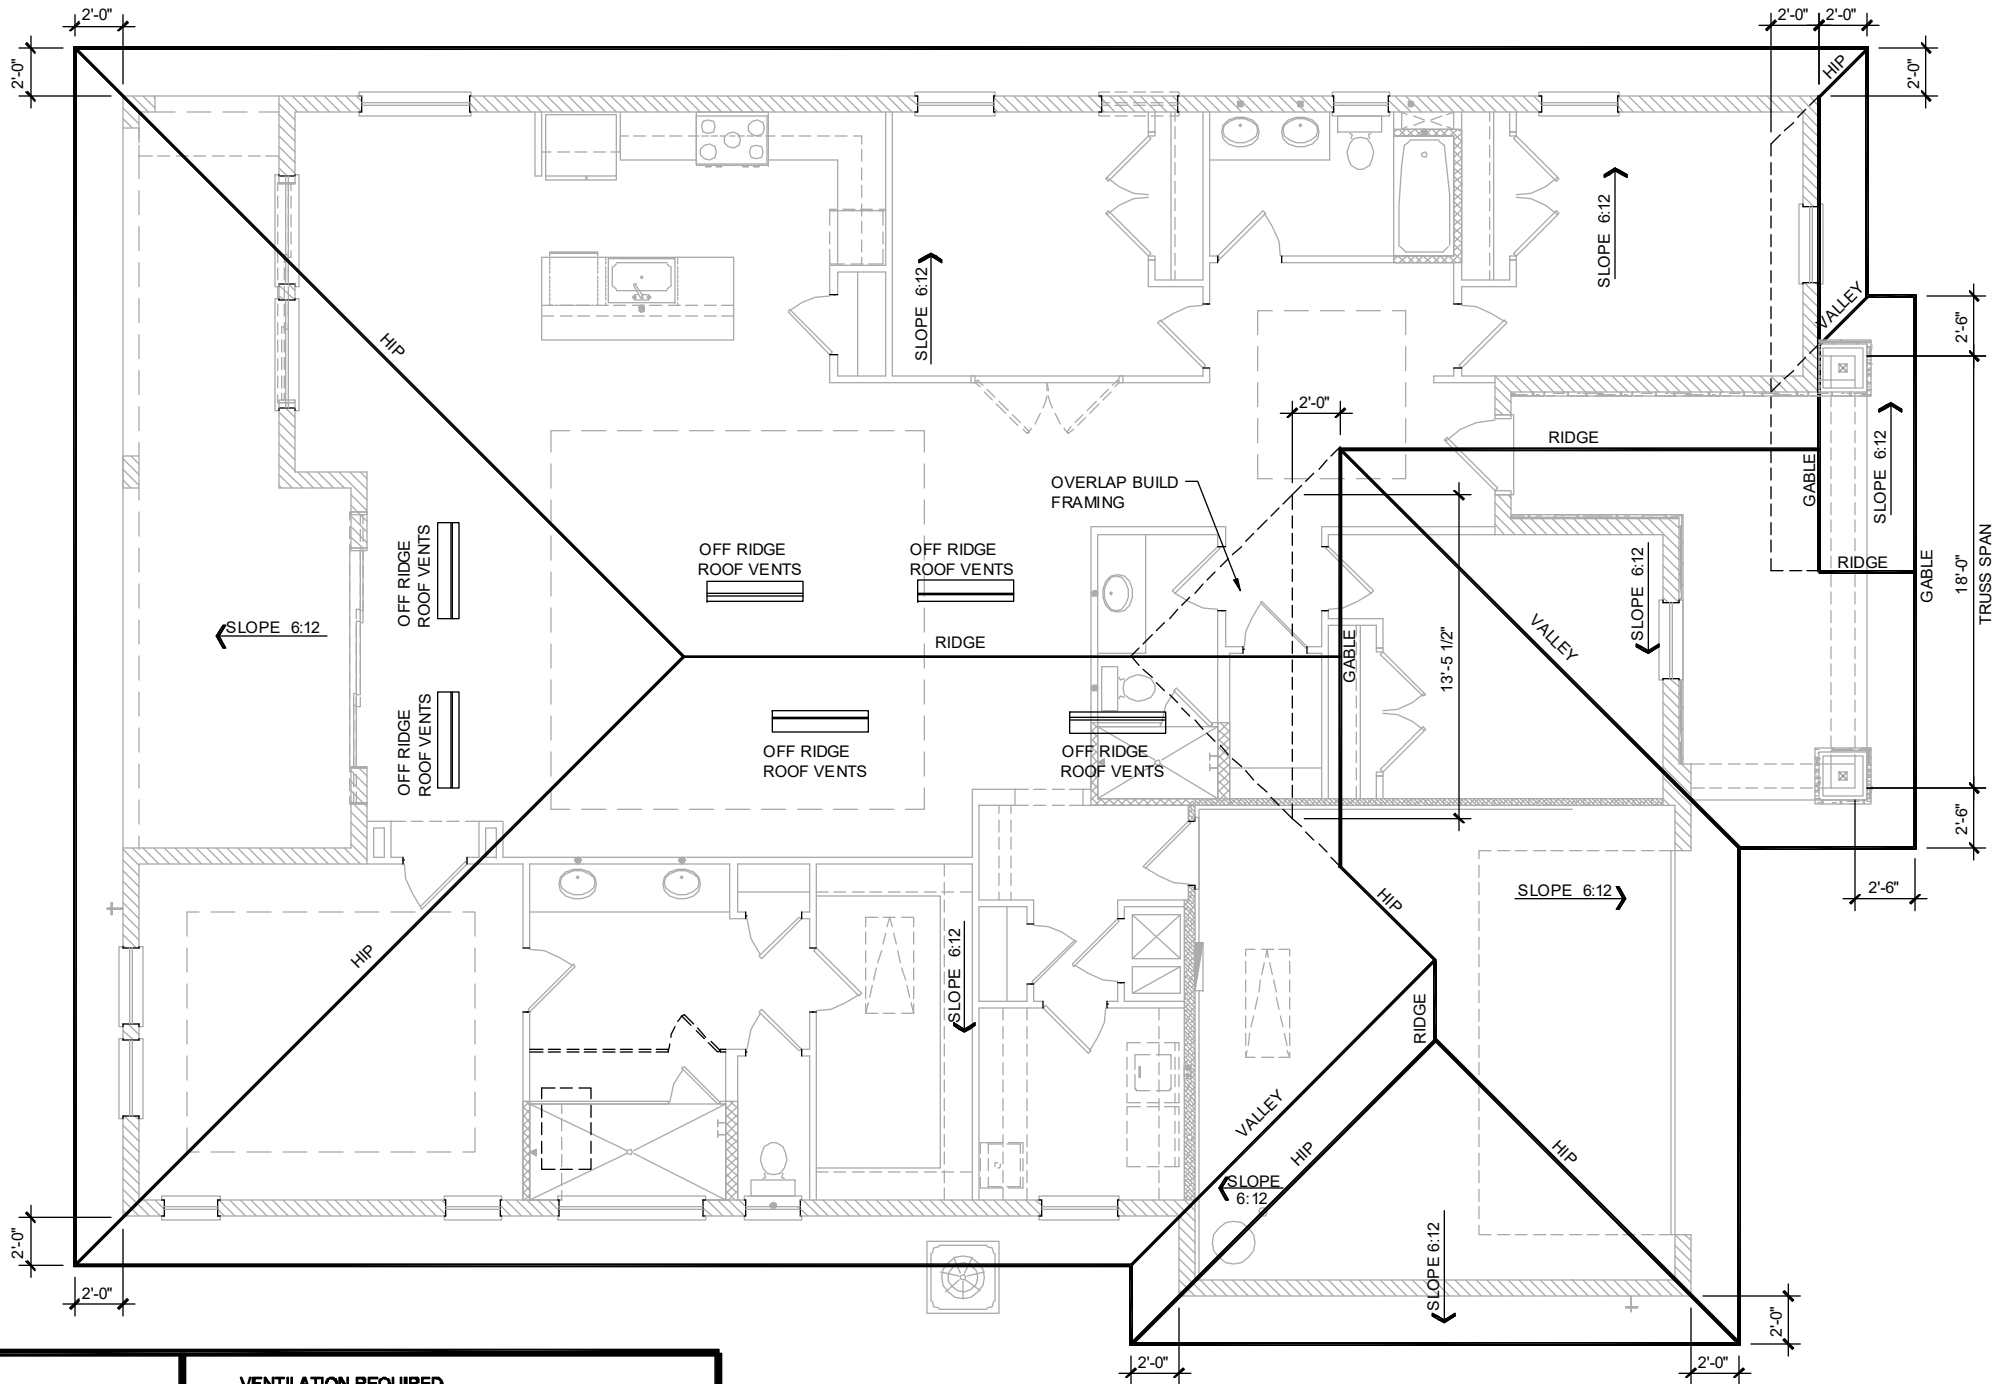

- GENERAL NOTES:**
1. THE ROOF PLAN DEPICTED IS NOT INTENDED TO SERVE AS A TRUSS DESIGN.
 2. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS AND ELEVATIONS FOR BEARING HEIGHTS.
 3. TRUSS SPACING SHALL BE 24" O.C. MAX. UNLESS OTHERWISE NOTED. CONVENTIONAL FRAMING SHALL BE 16" O.C. MAX. OR AS OTHERWISE NOTED.
 4. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON-BEARING WALLS AND AT VOLUME AREA UNLESS NOTED OTHERWISE.
 5. ALIGN TRUSSES AND HAND FRAMING SO ALL GYPSUM WALL BOARD WILL BE CONTINUOUS FROM FLOOR TO CEILING.
 6. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:
 - A) ALL CEILING HUNG SOFFITS AND SOFFITS WITH CABINETS AS SHOWN ON PLANS.
 - B) ATTIC LOCATED HVAC UNITS AS SHOWN ON PLANS.
 7. REFER TO MANUFACTURER SPECIFICATIONS FOR INSTALLATION REQUIREMENTS OF ALL HARDWARE BEFORE INSTALLATION.
 8. PROVIDE BRACING AND BLOCKING PER BCSI IN ADDITION TO BRACING AND BLOCKING SHOWN ON PLANS.

VENTILATION REQUIRED

3302 S.F. / 300 = 11.006
11.006 / 2 = 5.503
5.503 * 144 = 792.432
792.432 SQ. IN.
792 SQ. IN. OF VENT REQUIRED

OFF-RIDGE VENTS


792 SQ. IN. REQUIRED
792 SQ. IN. PROVIDED (OFF-RIDGE VENTS)

ROOF PLAN ELEVATION "C"

1/8" = 1'-0"

DISCLAIMER

IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.




PARK SQUARE HOMES
2468 CATALINA
MASTER

title:
ROOF PLAN

project no.2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

4C



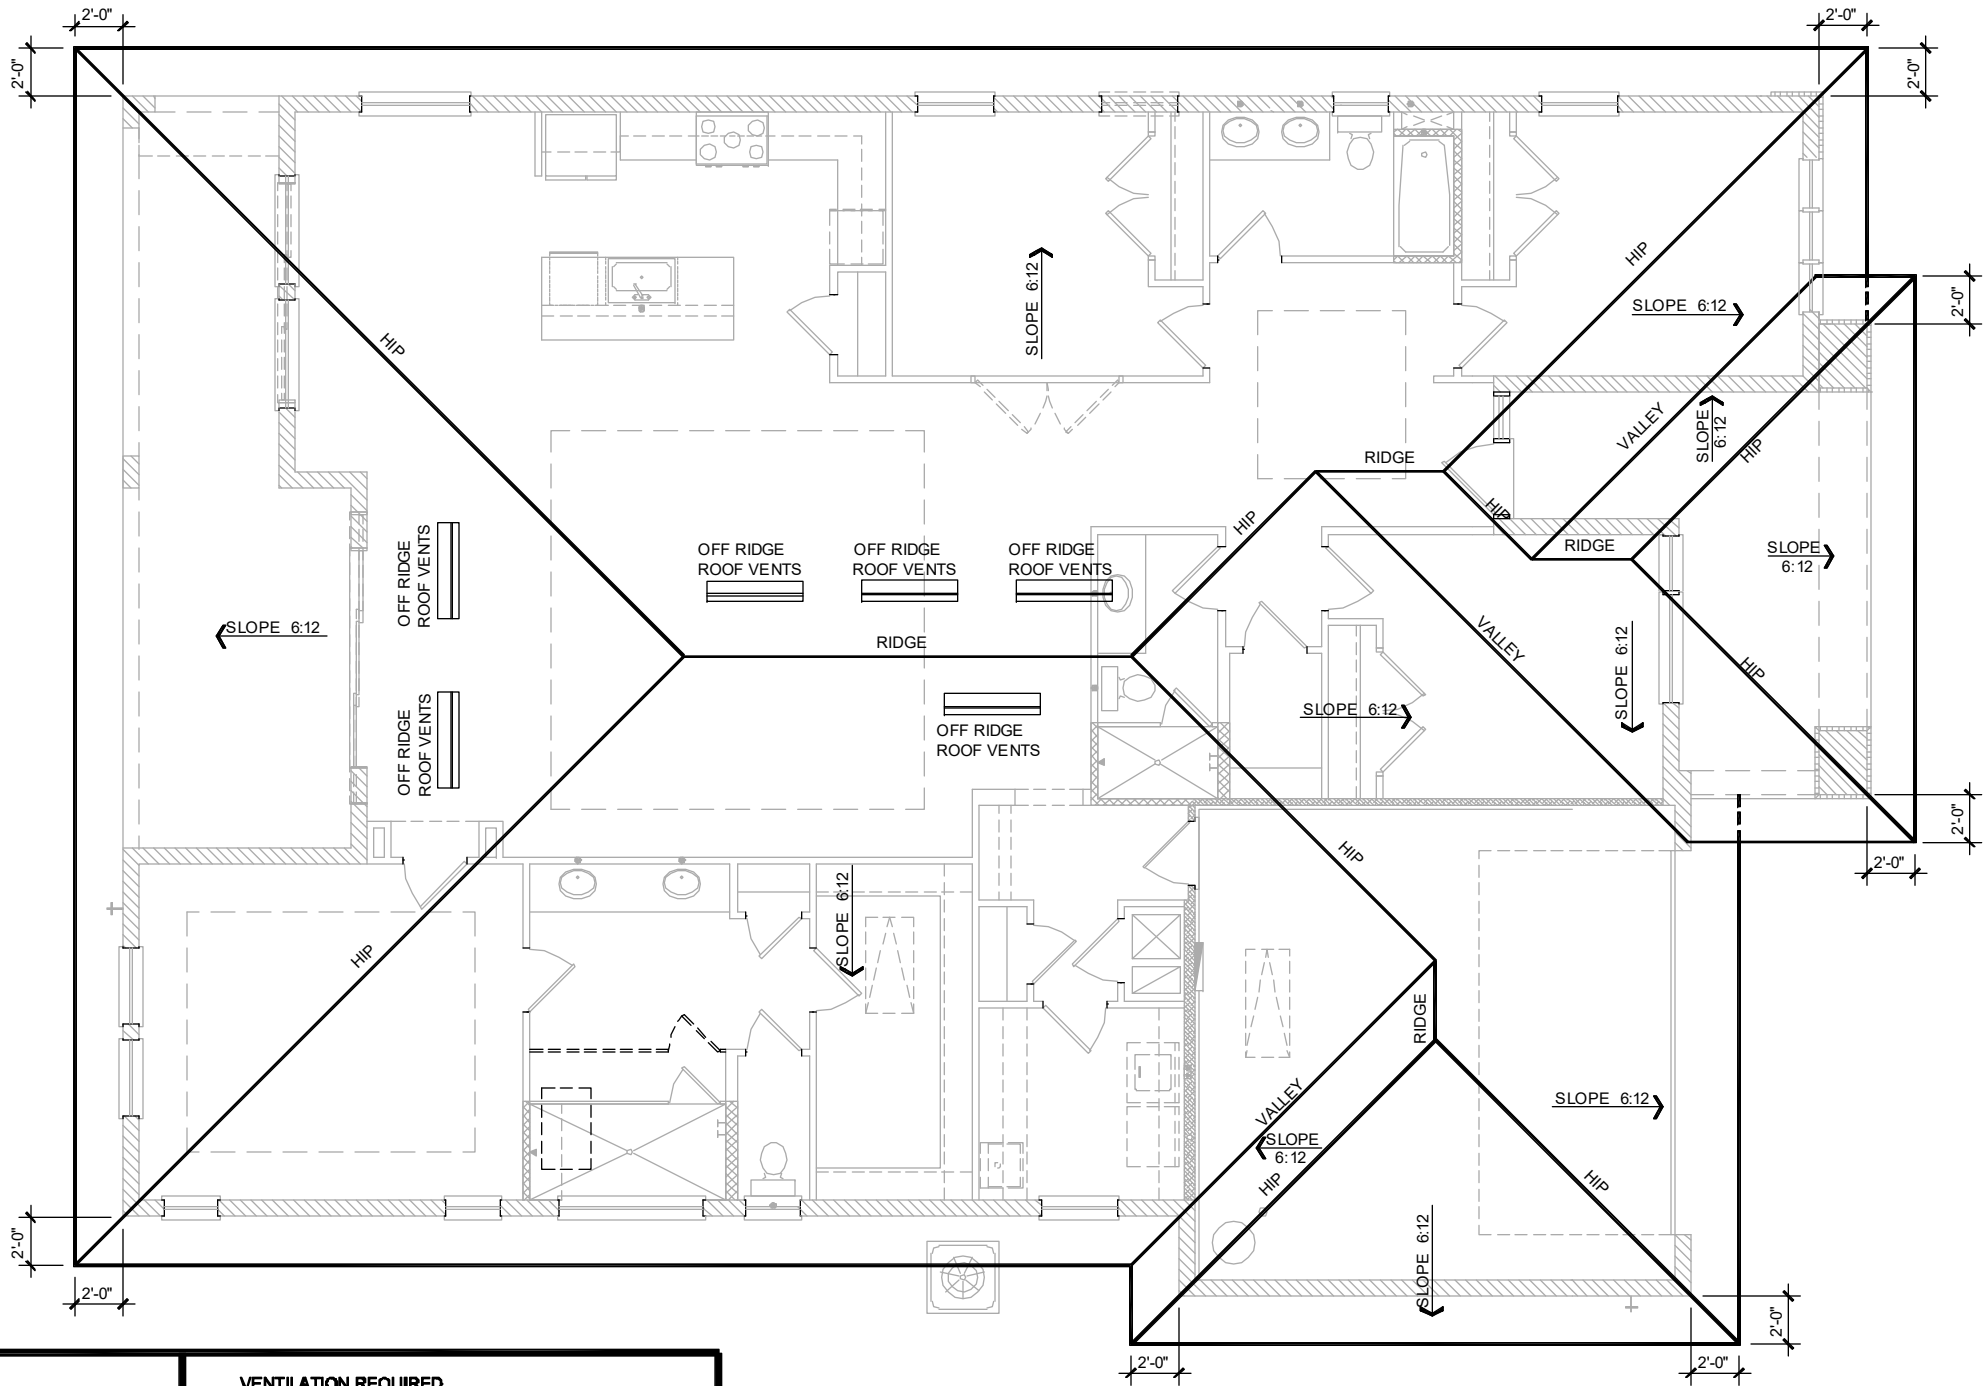

- GENERAL NOTES:**
1. THE ROOF PLAN DEPICTED IS NOT INTENDED TO SERVE AS A TRUSS DESIGN.
 2. TOP PLATE HEIGHTS VARY. SEE BUILDING SECTIONS, WALL SECTIONS AND ELEVATIONS FOR BEARING HEIGHTS.
 3. TRUSS SPACING SHALL BE 24" O.C. MAX. UNLESS OTHERWISE NOTED. CONVENTIONAL FRAMING SHALL BE 16" O.C. MAX. OR AS OTHERWISE NOTED.
 4. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON-BEARING WALLS AND AT VOLUME AREA UNLESS NOTED OTHERWISE.
 5. ALIGN TRUSSES AND HAND FRAMING SO ALL GYPSUM WALL BOARD WILL BE CONTINUOUS FROM FLOOR TO CEILING.
 6. TRUSS MANUFACTURER TO INSURE DESIGN CONSIDERATION TO THE FOLLOWING ADDITIONAL LOADS:
 - A) ALL CEILING HUNG SOFFITS AND SOFFITS WITH CABINETS AS SHOWN ON PLANS.
 - B) ATTIC LOCATED HVAC UNITS AS SHOWN ON PLANS.
 7. REFER TO MANUFACTURER SPECIFICATIONS FOR INSTALLATION REQUIREMENTS OF ALL HARDWARE BEFORE INSTALLATION.
 8. PROVIDE BRACING AND BLOCKING PER BCSI IN ADDITION TO BRACING AND BLOCKING SHOWN ON PLANS.

VENTILATION REQUIRED

3318 S.F. / 300 = 11.06
11.06 / 2 = 5.53
5.53 * 144 = 796.32
796.32 SQ. IN.
796.32 SQ. IN. OF VENT REQUIRED

OFF-RIDGE VENTS


796 SQ. IN. REQUIRED
796 SQ. IN. PROVIDED (OFF-RIDGE VENTS)

ROOF PLAN ELEVATION "D"

1/8" = 1'-0"

DISCLAIMER

IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.




PARK SQUARE HOMES
2468 CATALINA
MASTER

title:
ROOF PLAN

project no.2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

4D

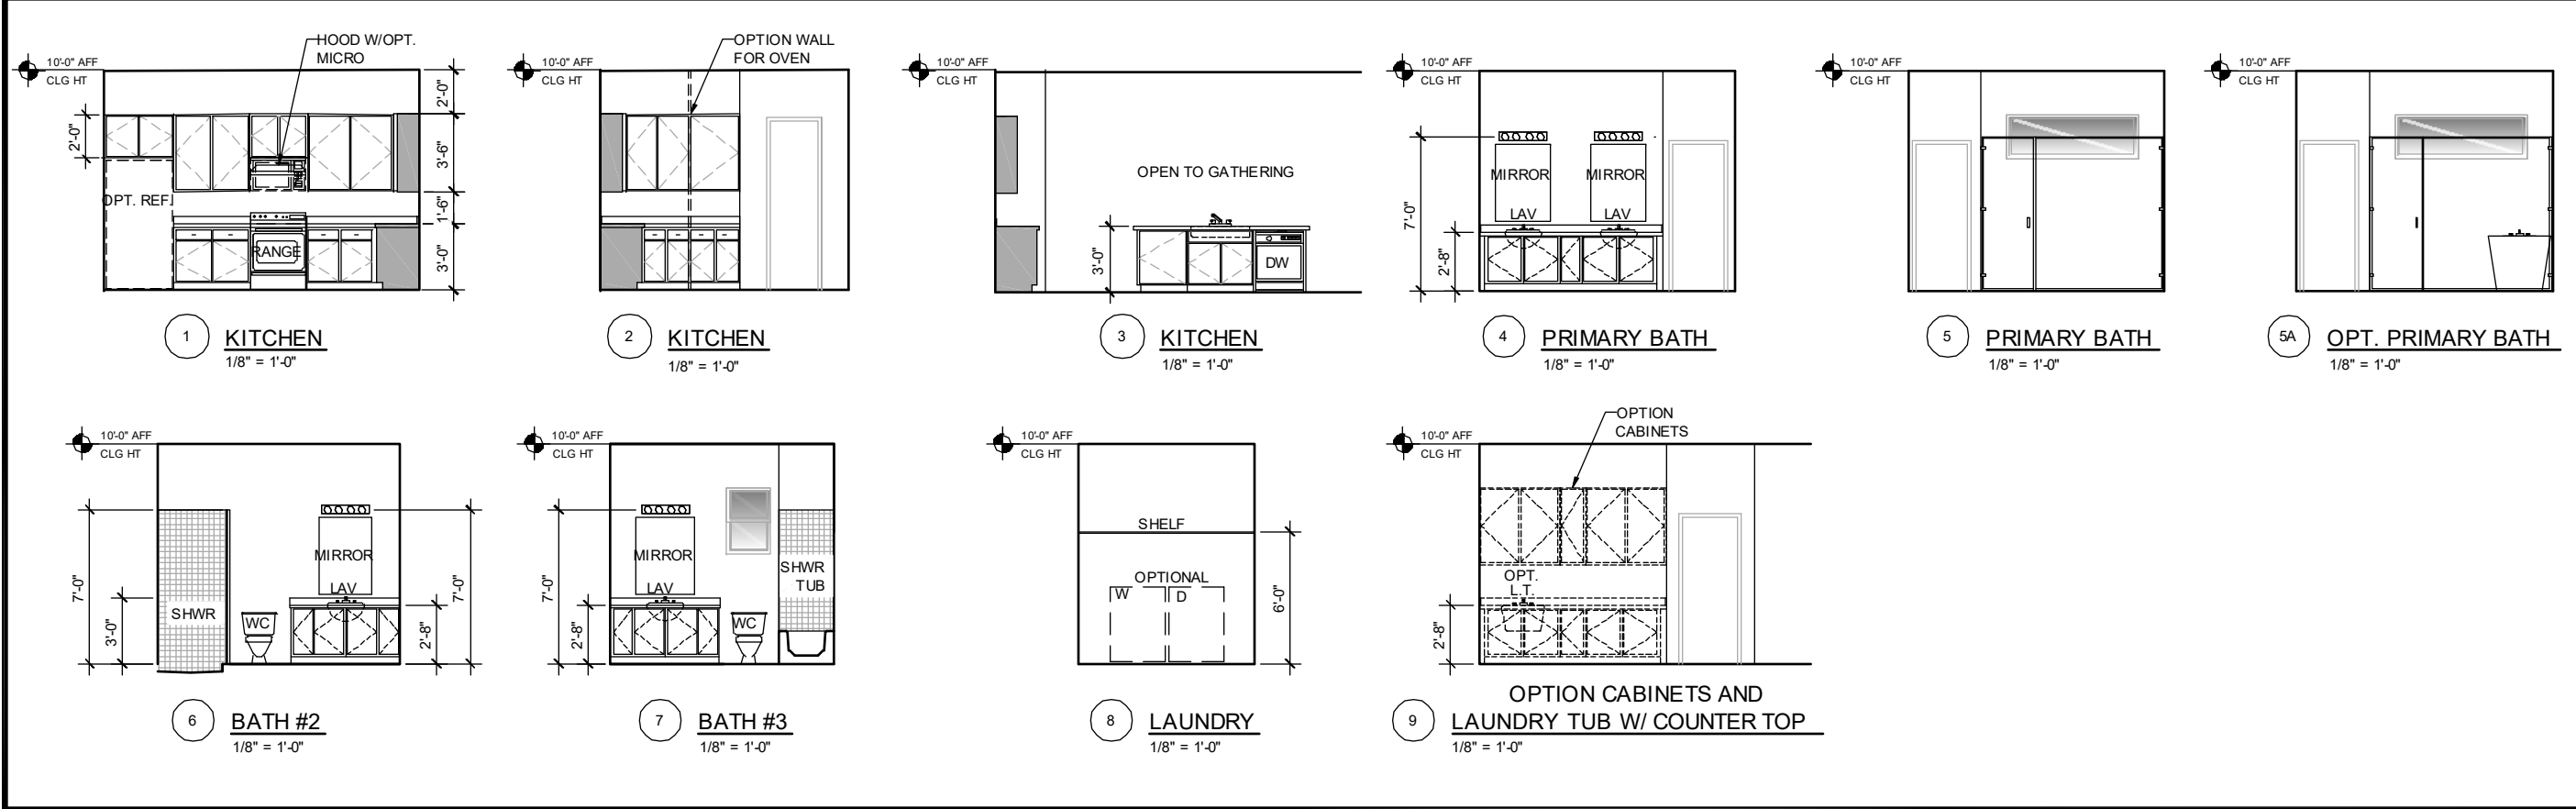

NOTE: INTERIOR ELEVATIONS ARE CONCEPTUAL ONLY. SEE CABINET SHOP DRAWINGS FOR FINAL VERIFICATION

DISCLAIMER

IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESSEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESSEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

KEESSEE ASSOCIATES ARCHITECTURE | DESIGN | PLANNING

248 Bushnell Lane, Suite 200
Hollywood, FL 33071
352.971.1200
keesee.com

AI

BD

ITEG



THOMPSON ENGINEERING GROUP, INC.

4401 Vineland Road Suite A9 Orlando, FL 32811
Ph: (407) 734-1450
Fax: (407) 734-1750
www.teg.com

PARK SQUARE HOMES
2468 CATALINA
MASTER



title:
INTERIOR
ELEVATIONS

project no.2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

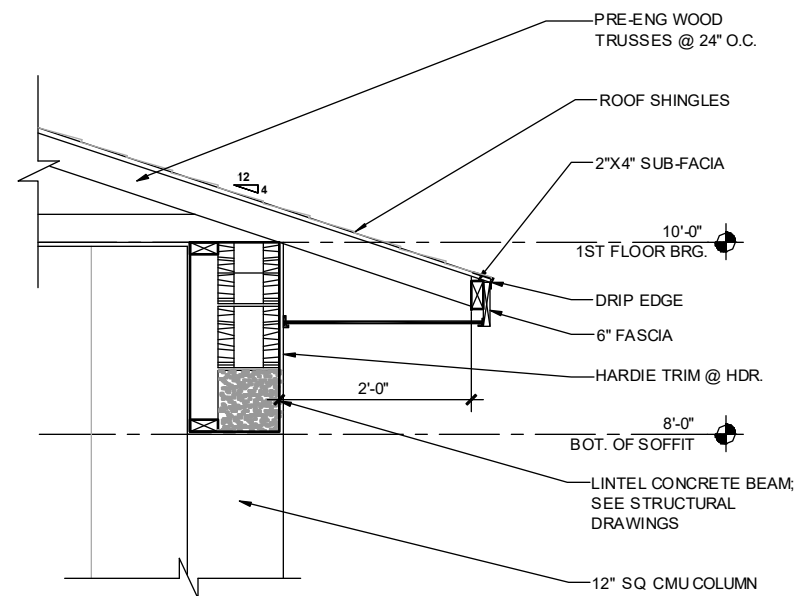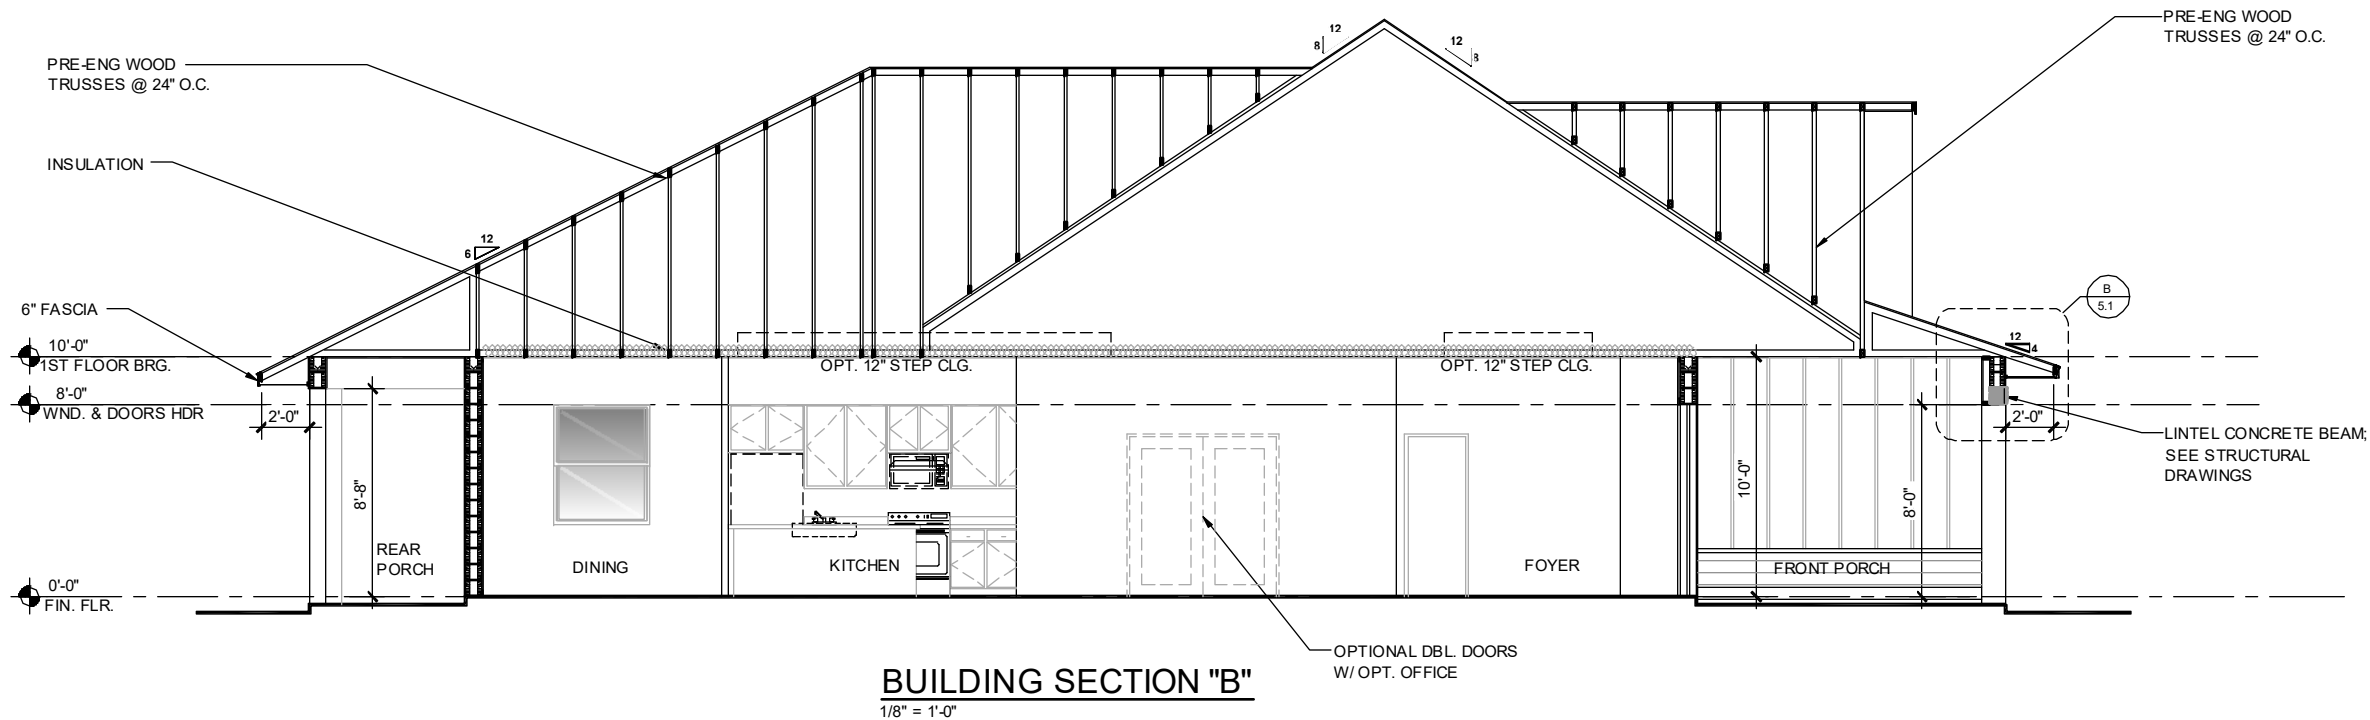



DISCLAIMER

IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

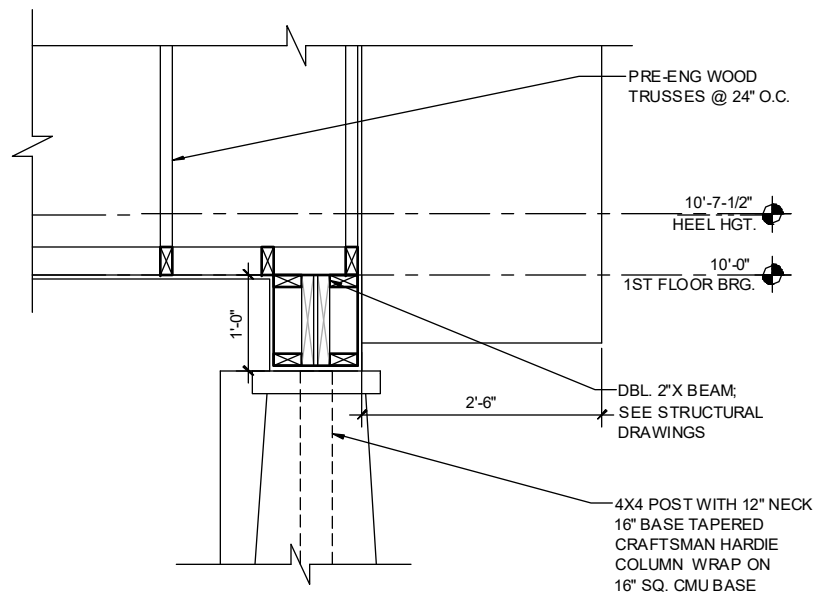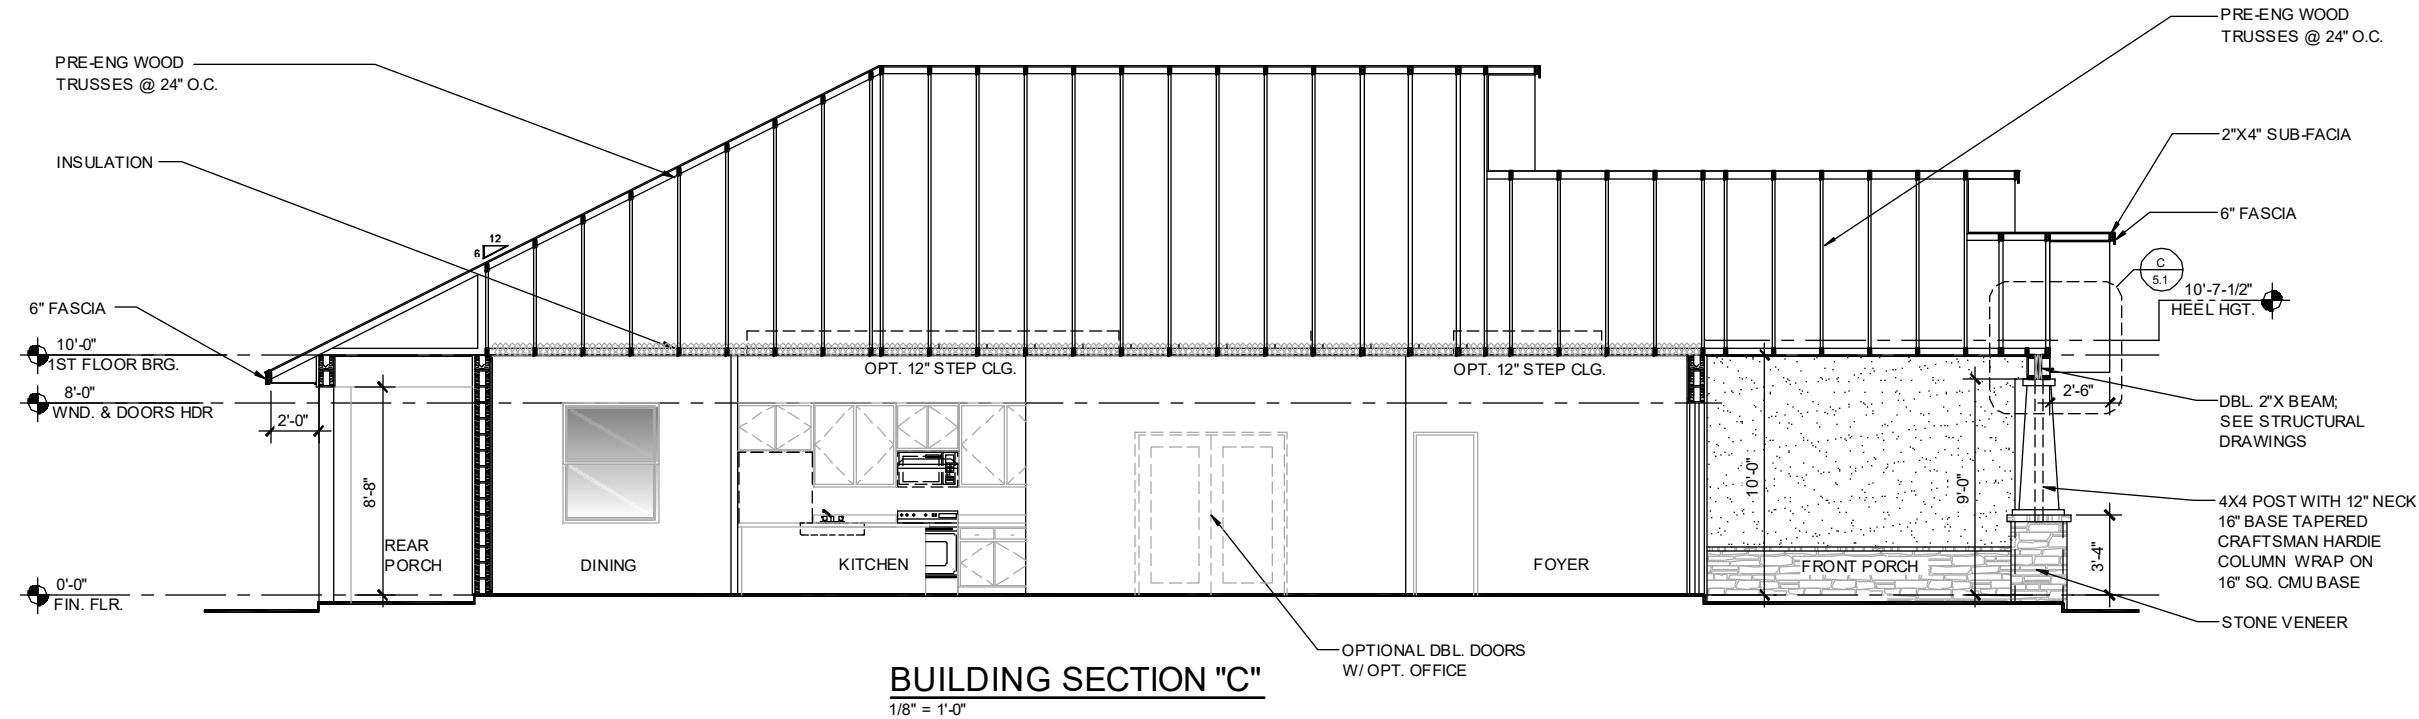


DISCLAIMER


IT IS THE CONTRACTOR'S/SUB-CONTRACTOR'S RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

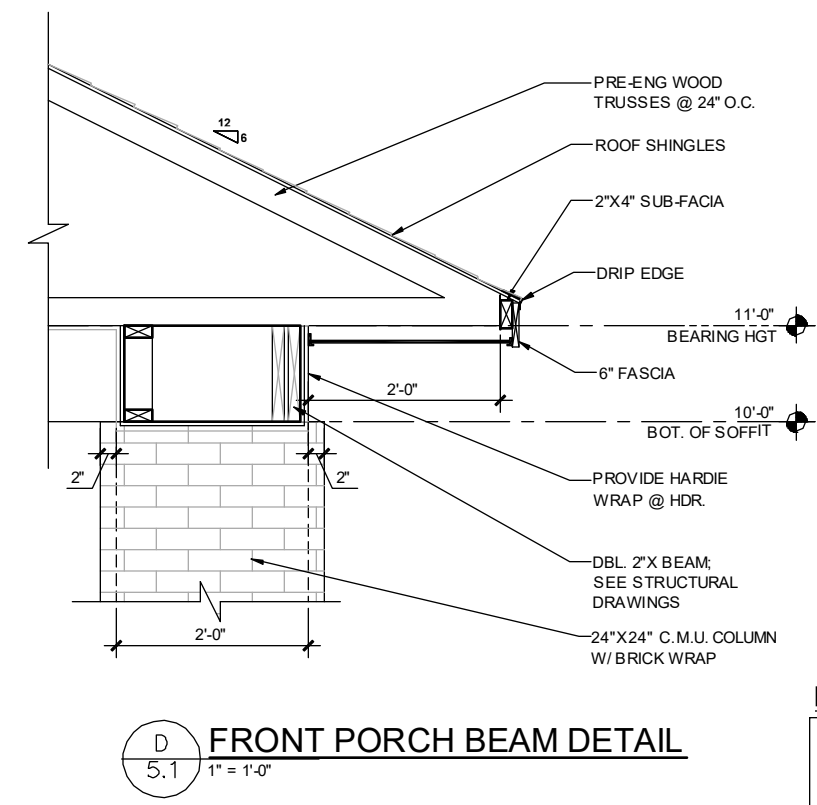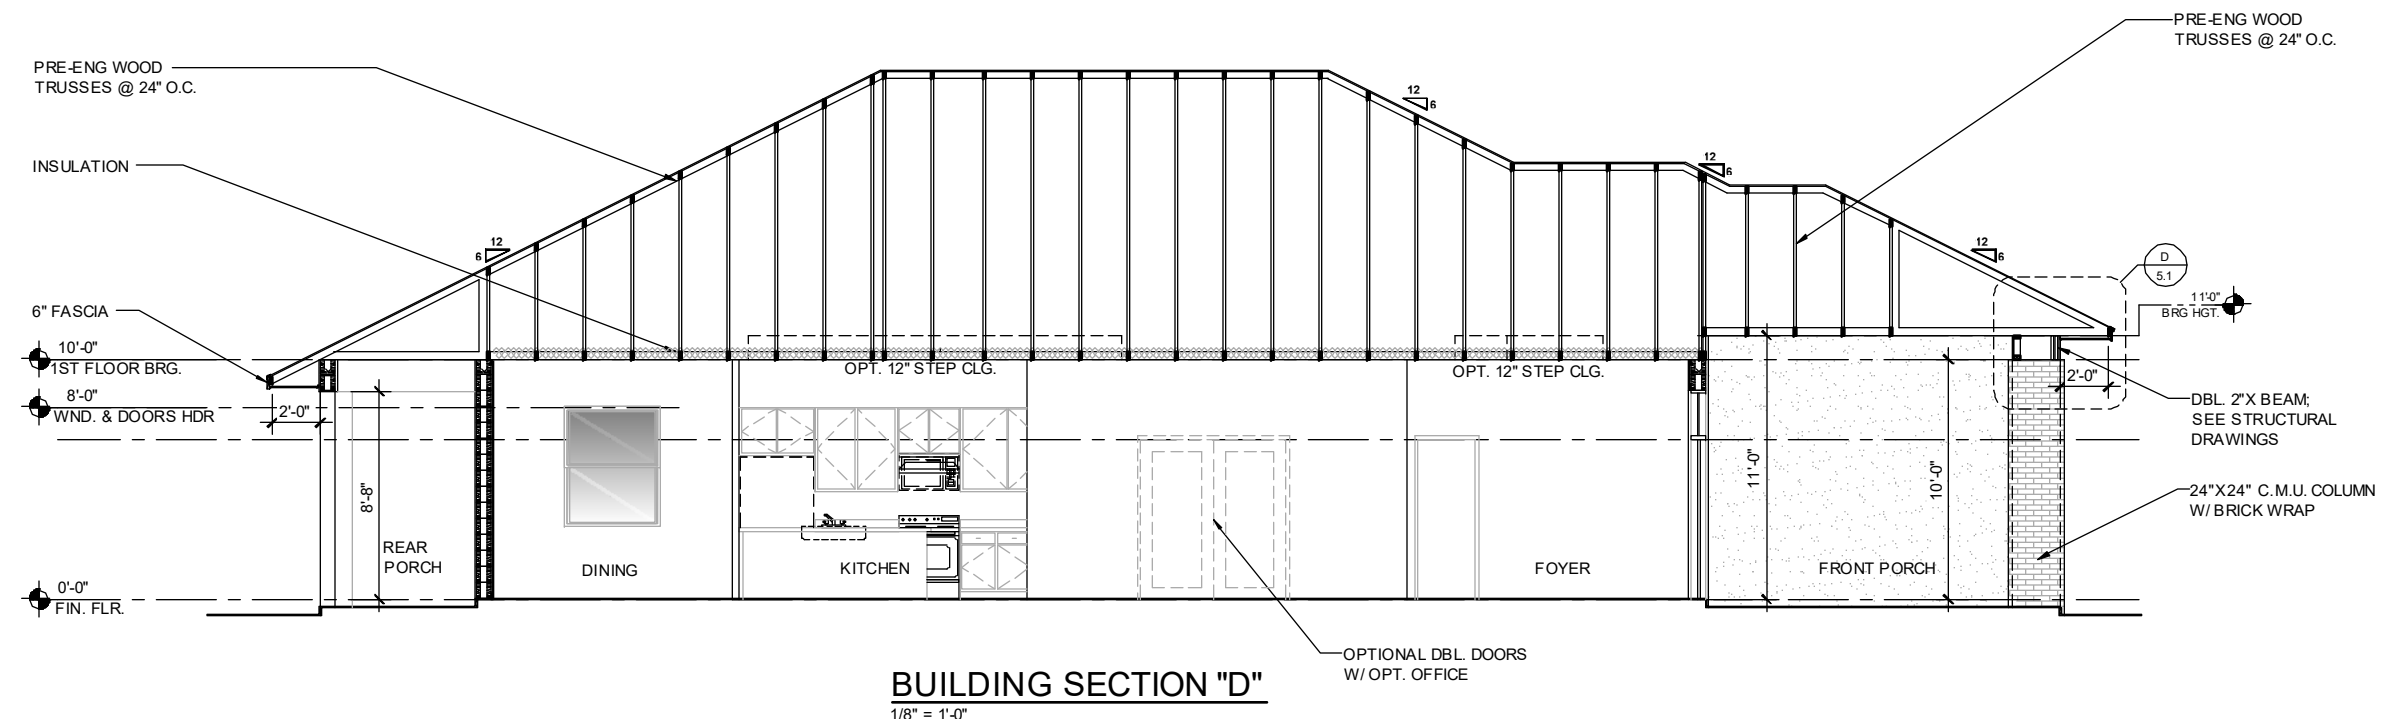

DISCLAIMER
IT IS THE CONTRACTOR'S/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESSEE ASSOCIATES & THOMPSON ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESSEE ASSOCIATES & THOMPSON ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

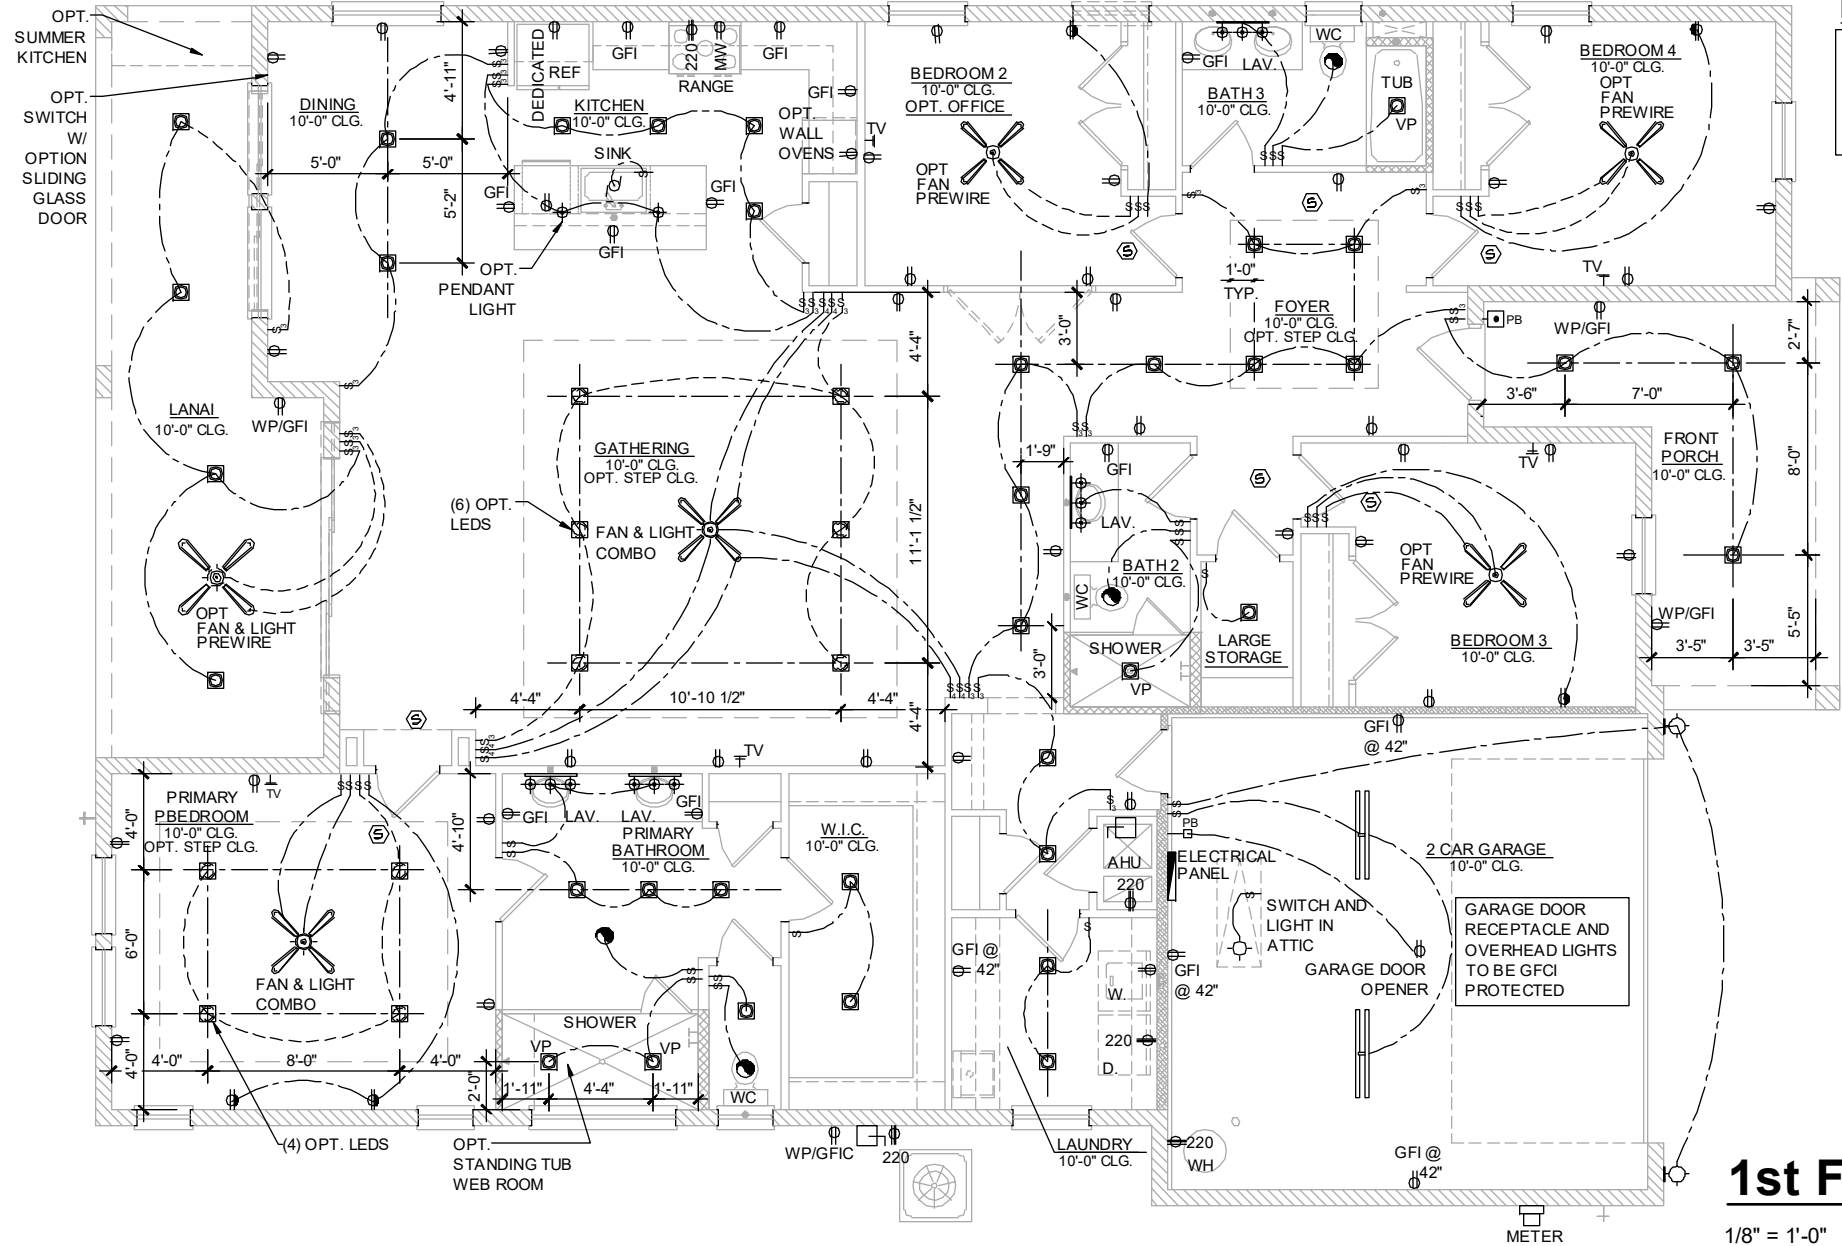


DISCLAIMER
IT IS THE CONTRACTOR'S/ SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

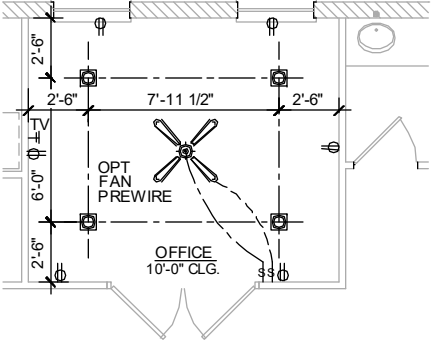

PARTIAL OPTION OFFICE ELECTRICAL PLAN

1/8" = 1'-0"

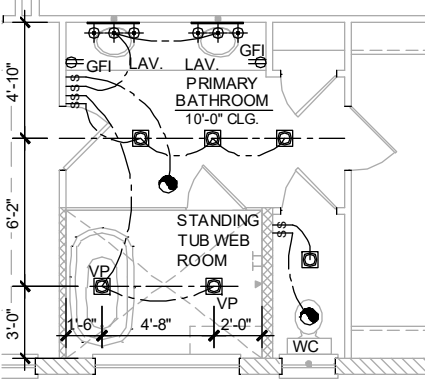

PARTIAL OPTION SUMMER KITCHEN ELECTRICAL FLOOR PLAN


1/8" = 1'-0"

PARTIAL OPTION STANDING TUB ELECTRICAL FLOOR PLAN

1/8" = 1'-0"

1st FLOOR ELECTRICAL PLAN ELEV. "A"

1/8" = 1'-0"

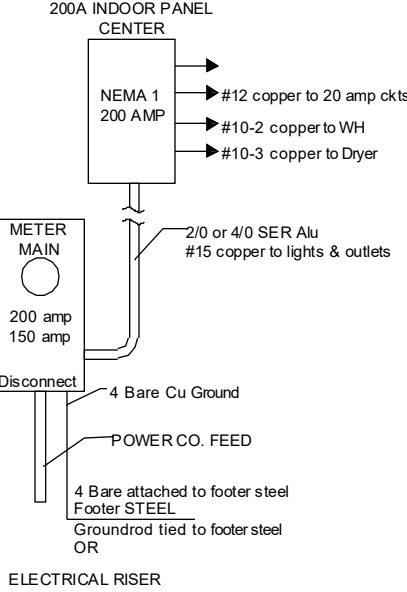

GENERAL NOTES

- FAN, PHONE, & CATV LOCATIONS PER CONTRACT.
- ALL SMOKE/CARBON MONOXIDE DETECTORS TO BE INSTALLED PER 2023 FBCR REFERENCED NFPA 72 AND R314. SMOKE DETECTORS SHALL BE HARDWIRED INTO AN AC ELECTRICAL POWER SOURCE AND SHALL BE EQUIPPED WITH A MONITORED BATTERY BACKUP AND SHALL BE INTERCONNECTED.
- ARCH FAULT BREAKERS: ALL BRANCH CIRCUITS SERVING BEDROOMS, FAMILY ROOMS, HALLWAYS, KITCHEN, LIVING ROOMS, DINING ROOMS, PARLORS, LIBRARIES, DENS, SUNROOMS, REC. ROOMS, CLOSETS AND LAUNDRY AREAS SHALL BE PROTECTED BY ARCH FAULT BREAKERS, PER 2023 FBCR. (REFER TO CHAPTERS 34 - 43)
- NEC 2020 210.52(G)(1) GARAGES. IN EACH ATTACHED GARAGE AND IN EACH DETACHED GARAGE WITH ELECTRIC POWER, AT LEAST ONE RECEPTACLE OUTLET SHALL BE INSTALLED IN EACH VEHICLE BAY, NOT MORE THAN 1.7M (5-1/2 FT.) ABOVE THE FLOOR.
- TAMPER-RESISTANT "TR" RECEPTACLES: ALL 125-VOLT, 15 & 20 AMPERE ELECTRICAL OUTLETS (RECEPTACLES) IN LIVING ROOM AREAS, BATHROOMS, KITCHEN, GARAGE, LAUNDRY ROOM, AND EXTERIOR LOCATIONS MUST BE "TAMPER-RESISTANT" PER 2023 FBCR. (REFER TO CHAPTERS 34 - 43)
- ALL ELECTRICAL WORK AND APPLIANCES SHALL CONFORM TO 2023 FBCR REFERENCED NFPA 70.
- EXCEPTIONS FROM GFI REQUIREMENTS SHALL BE PERMITTED PROVIDED LOCATION WHERE EXCEPTION IS DESIRED IS ALLOWED PER 2023 FBCR REFERENCED NFPA 70.
- UNLESS OTHERWISE INDICATED OR GOVERNED BY CODE, INSTALL SWITCHES AND RECEPTACLES AT THE FOLLOWING HEIGHTS ABOVE FINISH FLOOR.

ELECTRICAL DEVICES

SWITCHES AND WALL OUTLETS OVER COUNTERS	48" TO C.L.
REMAINING SWITCHES	48" TO C.L.
WALL OUTLETS	12" TO C.L.
TELEPHONE OUTLETS	12" TO C.L.
TELEVISION OUTLETS	12" TO C.L.
EXTERIOR GFIS	12" TO C.L.
GARAGE GFIS (ABOVE GARAGE FLOOR)	48" TO C.L.
THERMOSTAT	54" TO C.L.
DOOR BELL CHIMES	84" TO C.L.
DOOR BELL BUTTON	LEVEL W/ DOOR HANDLE
KITCHEN HOOD FAN "WHIP"	66" TO C.L.
KITCHEN WALL HUNG MICROWAVE RECEPTACLE	76" TO C.L.
KITCHEN DISHWASHER RECEPTACLE	UNDER SINK
KITCHEN RANGE	24" TO C.L.
KITCHEN REFRIGERATOR	48" TO C.L.
WASHER/DRYER OUTLET	36" TO C.L.
HOLLYWOOD LIGHTS	84" TO C.L.

C.L. = CENTER LINE

NFPA 70

ADD GFCI PROTECTION TO RECEPTACLES IN LAUNDRY ROOMS AND UTILITY ROOMS OF DWELLINGS WHERE INSTALLED WITHIN 6' OF THE OUTSIDE EDGE OF A SINK. THIS WOULD INCLUDE THE RECEPTACLE INSTALLED FOR A WASHING MACHINE.

RECEPTACLE OUTLETS SHALL NOT BE REQUIRED ON A WALL DIRECTLY BEHIND A RANGE OR SINK TO FULFILL THE REQUIREMENT FOR AN OUTLET EVERY 24". THE WIDTH OF THE SINK OR RANGE IS NOT TO BE INCLUDED IN THE SPACING OF THE OUTLETS UNLESS THE DISTANCE FROM THE SINK OR RANGE IS GREATER THAN 12" FOR STRAIGHT COUNTER TOPS AND 18" FOR SINKS AND RANGES INSTALLED IN CORNER COUNTERS.

ABOVE FIN. FLR.

ELECTRICAL KEY

	DUPLEX CONVENIENCE OUTLET		PENDANT FIXTURE
	WEATHERPROOF DUPLEX OUTLET		SURFACE MOUNTED LIGHT FIXTURE
	GROUND FAULT INTERRUPTER DUPLEX OUTLET		WALL MOUNTED LIGHT FIXTURE
	HALF-SWITCHED DUPLEX OUTLET		FLUORESCENT LIGHT FIXTURE
	DUPLEX OUTLET IN FLOOR		WALL MOUNTED STRIP LIGHT
	220 VOLT OUTLET		UNDERCABINET LIGHTING (OPTIONAL)
	DISPOSAL		WALL SCENCE
	WALL SWITCH		EXHAUST FAN
	THREE-WAY SWITCH		EXHAUST FAN & LIGHT COMBO
	FOUR-WAY SWITCH		OUTLET FOR GARAGE DOOR OPENER
	DIMMER SWITCH		SOFFIT OUTLET (OPTIONAL)
	MOTION DETECTOR SWITCH (OPTIONAL)		CHIMES
	PRE-WIRED SPEAKER		PUSHBUTTON SWITCH
	FLUSHMOUNT LED		SMOKE DETECTOR/CARBON MONOXIDE DETECTORS
	FLUSHMOUNT LED - VAPOR PROOF		TELEPHONE OUTLET PREWIRE
	MONO POINT TRACK HEAD (OPTIONAL)		

Keese Associates
ARCHITECTURE | DESIGN | PLANNING
268 S. Orange Ave. Suite 200
Orlando, FL 32801
(407) 941-1200
www.keese.com


ITEG
THOMPSON ENGINEERING GROUP, INC.
4401 Windward Road Suite A9 Orlando, FL 32811
Ph: (407) 734-1450
Fax: (407) 734-1750
www.iteg.com

PARK SQUARE HOMES
2468 CATALINA
MASTER

Title:
ELECTRICAL FIRST FLOOR PLAN


project no. 2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

E1

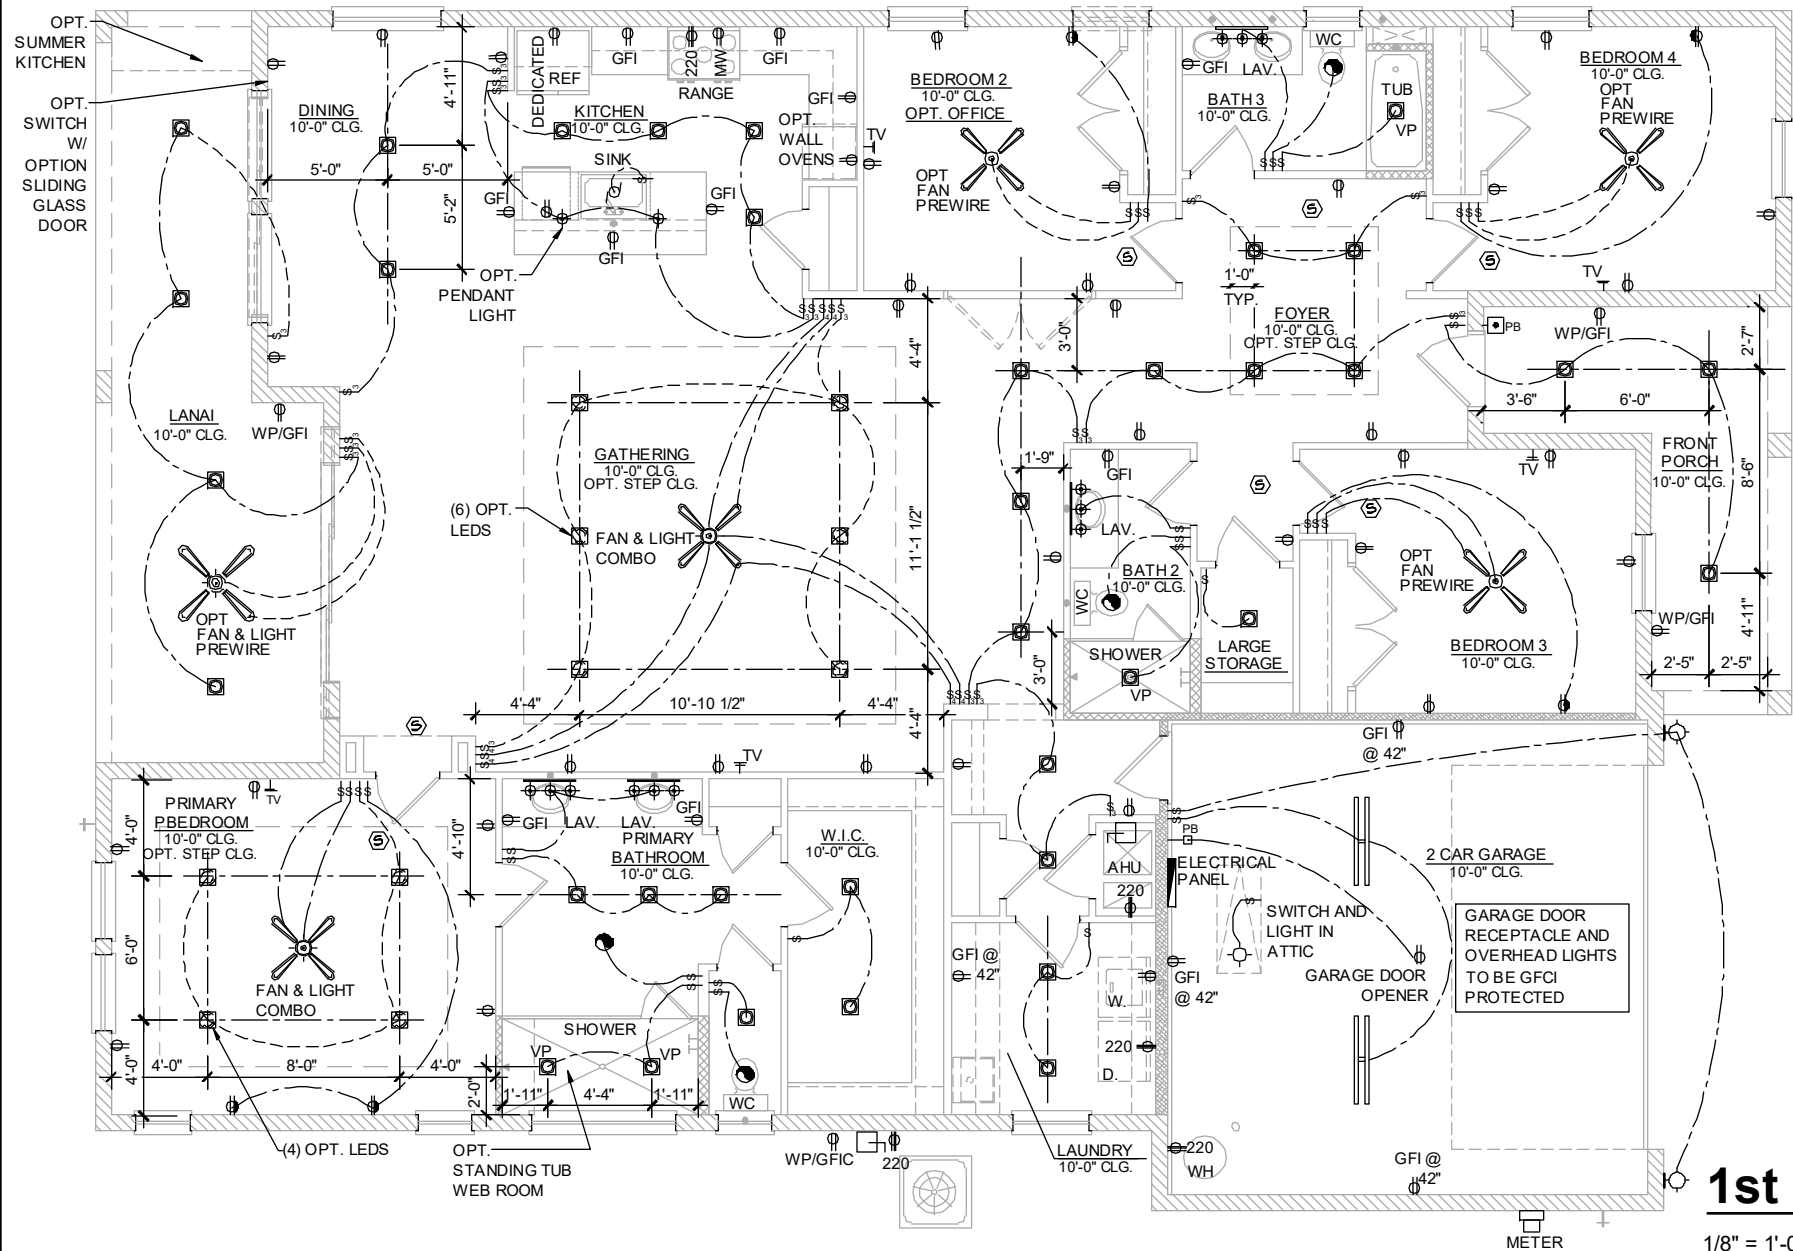


DISCLAIMER


IT IS THE CONTRACTOR'S/CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

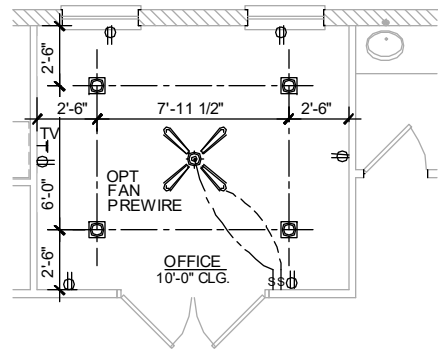

PARTIAL OPTION OFFICE ELECTRICAL PLAN

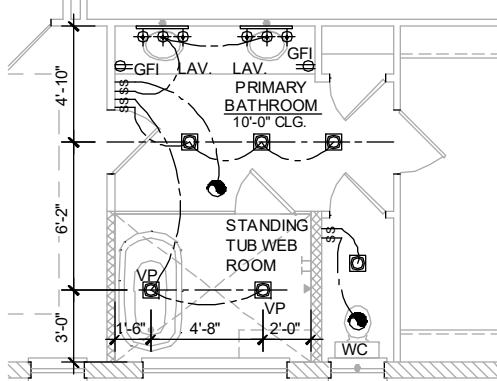

PARTIAL OPTION STANDING TUB ELECTRICAL FLOOR PLAN

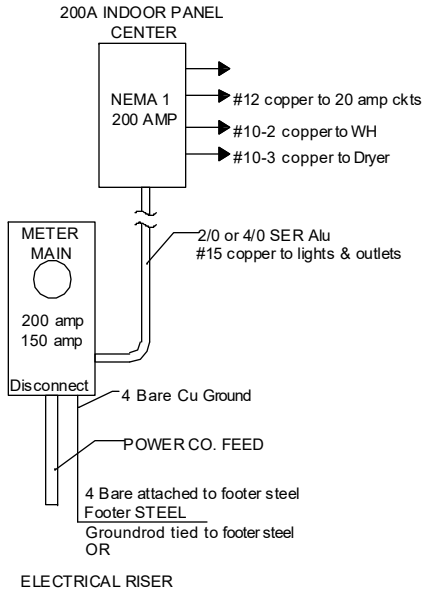

PARTIAL OPTION SUMMER KITCHEN ELECTRICAL FLOOR PLAN

1st FLOOR ELECTRICAL PLAN ELEV. "B"

GENERAL NOTES

- 1. FAN, PHONE, & CATV LOCATIONS PER CONTRACT.
- 2. ALL SMOKE/CARBON MONOXIDE DETECTORS TO BE INSTALLED PER 2023 FBCR REFERENCED NFPA 72 AND R314. SMOKE DETECTORS SHALL BE HARDWIRED INTO AN AC ELECTRICAL POWER SOURCE AND SHALL BE EQUIPPED WITH A MONITORED BATTERY BACKUP AND SHALL BE INTERCONNECTED.
- 3. ARCH FAULT BREAKERS: ALL BRANCH CIRCUITS SERVING BEDROOMS, FAMILY ROOMS, HALLWAYS, KITCHEN, LIVING ROOMS, DINING ROOMS, PARLORS, LIBRARIES, DENS, SUNROOMS, REC. ROOMS, CLOSETS AND LAUNDRY AREAS SHALL BE PROTECTED BY ARCH FAULT BREAKERS, PER 2023 FBCR. (REFER TO CHAPTERS 34 - 43)
- 4. NEC 2020 210.52(G)(1) GARAGES: IN EACH ATTACHED GARAGE AND IN EACH DETACHED GARAGE WITH ELECTRIC POWER, AT LEAST ONE RECEPTACLE OUTLET SHALL BE INSTALLED IN EACH VEHICLE BAY, NOT MORE THAN 1.7M (5-1/2 FT.) ABOVE THE FLOOR.
- 5. TAMPER-RESISTANT "TR" RECEPTACLES: ALL 125-VOLT, 15 & 20 AMPERE ELECTRICAL OUTLETS (RECEPTACLES) IN LIVING ROOM AREAS, BATHROOMS, KITCHEN, GARAGE, LAUNDRY ROOM, AND EXTERIOR LOCATIONS MUST BE "TAMPER-RESISTANT" PER 2023 FBCR. (REFER TO CHAPTERS 34 - 43)
- 6. ALL ELECTRICAL WORK AND APPLIANCES SHALL CONFORM TO 2023 FBCR REFERENCED NFPA 70.
- 7. EXCEPTIONS FROM GFI REQUIREMENTS SHALL BE PERMITTED PROVIDED LOCATION WHERE EXCEPTION IS DESIRED IS ALLOWED PER 2023 FBCR REFERENCED NFPA 70.
- 8. UNLESS OTHERWISE INDICATED OR GOVERNED BY CODE, INSTALL SWITCHES AND RECEPTACLES AT THE FOLLOWING HEIGHTS ABOVE FINISH FLOOR.

ELECTRICAL DEVICES

SWITCHES AND WALL OUTLETS OVER COUNTERS	48" TO C.L.
REMAINING SWITCHES	48" TO C.L.
WALL OUTLETS	12" TO C.L.
TELEPHONE OUTLETS	12" TO C.L.
TELEVISION OUTLETS	12" TO C.L.
EXTERIOR GFI'S	12" TO C.L.
GARAGE GFI'S (ABOVE GARAGE FLOOR)	48" TO C.L.
THERMOSTAT	54" TO C.L.
DOOR BELL CHIMES	84" TO C.L.
DOOR BELL BUTTON	LEVEL W/ DOOR HANDLE
KITCHEN HOOD FAN "WHIP"	66" TO C.L.
KITCHEN WALL HUNG MICROWAVE RECEPTACLE	76" TO C.L.
KITCHEN DISHWASHER RECEPTACLE	UNDER SINK
KITCHEN RANGE	24" TO C.L.
KITCHEN REFRIGERATOR	48" TO C.L.
WASHER/DRYER OUTLET	36" TO C.L.
HOLLYWOOD LIGHTS	84" TO C.L.

C.L. = CENTER LINE

NFPA 70


ADD GFCI PROTECTION TO RECEPTACLES IN LAUNDRY ROOMS AND UTILITY ROOMS OF DWELLINGS WHERE INSTALLED WITHIN 6' OF THE OUTSIDE EDGE OF A SINK. THIS WOULD INCLUDE THE RECEPTACLE INSTALLED FOR A WASHING MACHINE.

RECEPTACLE OUTLETS SHALL NOT BE REQUIRED ON A WALL DIRECTLY BEHIND A RANGE OR SINK TO FULFILL THE REQUIREMENT FOR AN OUTLET EVERY 24". THE WIDTH OF THE SINK OR RANGE IS NOT TO BE INCLUDED IN THE SPACING OF THE OUTLETS UNLESS THE DISTANCE FROM THE SINK OR RANGE IS GREATER THAN 12" FOR STRAIGHT COUNTER TOPS AND 18" FOR SINKS AND RANGES INSTALLED IN CORNER COUNTERS.


ABOVE FIN. FLR.

ELECTRICAL KEY


	DUPLEX CONVENIENCE OUTLET		PENDANT FIXTURE
	WEATHERPROOF DUPLEX OUTLET		SURFACE MOUNTED LIGHT FIXTURE
	GROUND FAULT INTERRUPTER DUPLEX OUTLET		WALL MOUNTED LIGHT FIXTURE
	HALF-SWITCHED DUPLEX OUTLET		FLUORESCENT LIGHT FIXTURE
	DUPLEX OUTLET IN FLOOR		WALL MOUNTED STRIP LIGHT
	220 VOLT OUTLET		UNDERCABINET LIGHTING (OPTIONAL)
	DISPOSAL		WALL SCONCE
	WALL SWITCH		EXHAUST FAN
	THREE-WAY SWITCH		EXHAUST FAN & LIGHT COMBO
	FOUR-WAY SWITCH		OUTLET FOR GARAGE DOOR OPENER
	DIMMER SWITCH		SOFFIT OUTLET (OPTIONAL)
	MOTION DETECTOR SWITCH (OPTIONAL)		CHIMES
	PRE-WIRED SPEAKER		PUSHBUTTON SWITCH
	FLUSHMOUNT LED		SMOKE DETECTOR/CARBON MONOXIDE DETECTORS
	FLUSHMOUNT LED - VAPOR PROOF		TELEPHONE OUTLET PREWIRE
	MONO POINT TRACK HEAD (OPTIONAL)		

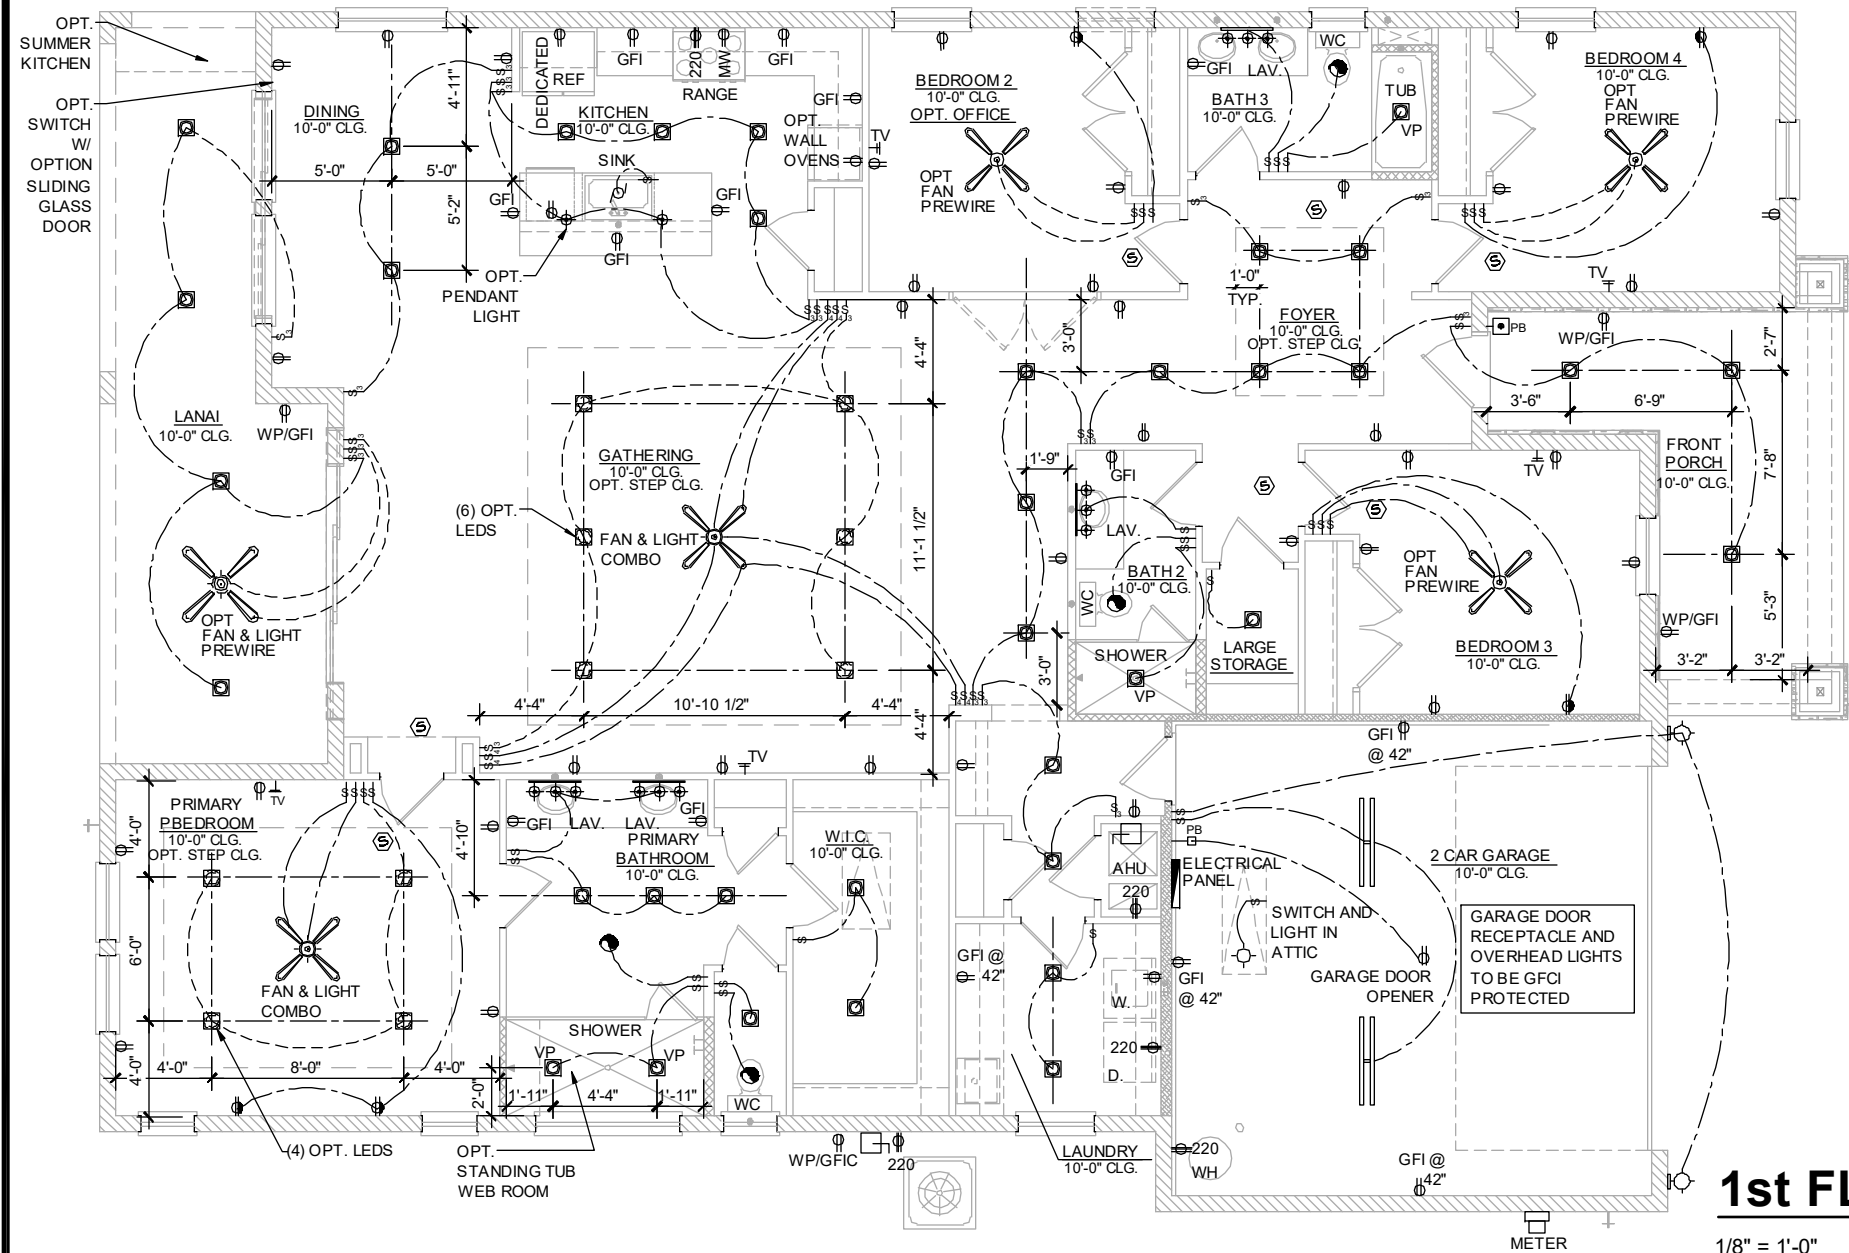

DISCLAIMER
IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

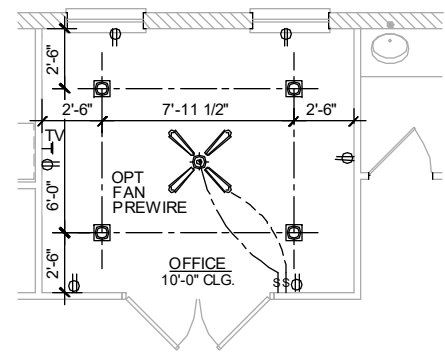

PARTIAL OPTION OFFICE ELECTRICAL PLAN


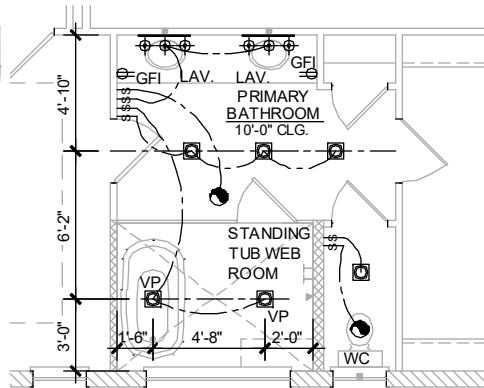


PARTIAL OPTION SUMMER KITCHEN ELECTRICAL FLOOR PLAN

PARTIAL OPTION STANDING TUB ELECTRICAL FLOOR PLAN

1st FLOOR ELECTRICAL PLAN ELEV. "C"

1/8" = 1'-0"

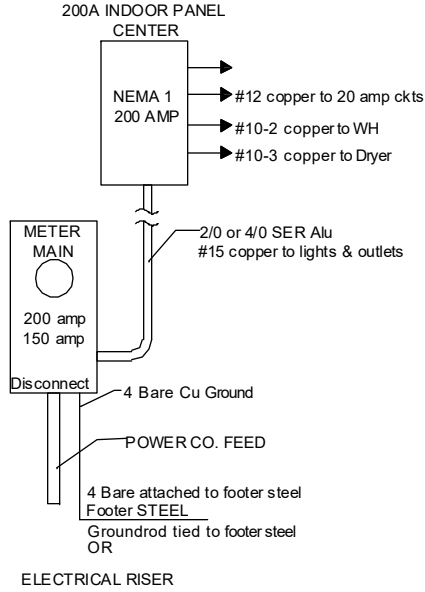

GENERAL NOTES

- FAN, PHONE, & CATV LOCATIONS PER CONTRACT.
- ALL SMOKE/CARBON MONOXIDE DETECTORS TO BE INSTALLED PER 2023 FBCR REFERENCED NFPA 72 AND R314. SMOKE DETECTORS SHALL BE HARDWIRED INTO AN AC ELECTRICAL POWER SOURCE AND SHALL BE EQUIPPED WITH A MONITORED BATTERY BACKUP AND SHALL BE INTERCONNECTED.
- ARCH FAULT BREAKERS: ALL BRANCH CIRCUITS SERVING BEDROOMS, FAMILY ROOMS, HALLWAYS, KITCHEN, LIVING ROOMS, DINING ROOMS, PARLORS, LIBRARIES, DENS, SUNROOMS, REC. ROOMS, CLOSETS AND LAUNDRY AREAS SHALL BE PROTECTED BY ARCH FAULT BREAKERS, PER 2023 FBCR. (REFER TO CHAPTERS 34 - 43)
- NEC 2020 210.52(G)(1) GARAGES. IN EACH ATTACHED GARAGE AND IN EACH DETACHED GARAGE WITH ELECTRIC POWER, AT LEAST ONE RECEPTACLE OUTLET SHALL BE INSTALLED IN EACH VEHICLE BAY, NOT MORE THAN 1.7M (5-1/2 FT.) ABOVE THE FLOOR.
- TAMPER-RESISTANT "TR" RECEPTACLES: ALL 125-VOLT, 15 & 20 AMPERE ELECTRICAL OUTLETS (RECEPTACLES) IN LIVING ROOM AREAS, BATHROOMS, KITCHEN, GARAGE, LAUNDRY ROOM, AND EXTERIOR LOCATIONS MUST BE "TAMPER-RESISTANT" PER 2023 FBCR. (REFER TO CHAPTERS 34 - 43)
- ALL ELECTRICAL WORK AND APPLIANCES SHALL CONFORM TO 2023 FBCR REFERENCED NFPA 70.
- EXCEPTIONS FROM GFI REQUIREMENTS SHALL BE PERMITTED PROVIDED LOCATION WHERE EXCEPTION IS DESIRED IS ALLOWED PER 2023 FBCR REFERENCED NFPA 70.
- UNLESS OTHERWISE INDICATED OR GOVERNED BY CODE, INSTALL SWITCHES AND RECEPTACLES AT THE FOLLOWING HEIGHTS ABOVE FINISH FLOOR.

ELECTRICAL DEVICES

	ABOVE FIN. FLR
SWITCHES AND WALL OUTLETS OVER COUNTERS	48" TO C.L.
REMAINING SWITCHES	48" TO C.L.
WALL OUTLETS	12" TO C.L.
TELEPHONE OUTLETS	12" TO C.L.
TELEVISION OUTLETS	12" TO C.L.
EXTERIOR GFIS	12" TO C.L.
GARAGE GFIS (ABOVE GARAGE FLOOR)	48" TO C.L.
THERMOSTAT	54" TO C.L.
DOOR BELL CHIMES	84" TO C.L.
DOOR BELL BUTTON	LEVEL W/ DOOR HANDLE
KITCHEN HOOD FAN "WHIP"	66" TO C.L.
KITCHEN WALL HUNG MICROWAVE RECEPTACLE	76" TO C.L.
KITCHEN DISHWASHER RECEPTACLE	UNDER SINK
KITCHEN RANGE	24" TO C.L.
KITCHEN REFRIGERATOR	48" TO C.L.
WASHER/DRYER OUTLET	36" TO C.L.
HOLLYWOOD LIGHTS	84" TO C.L.


C.L. = CENTER LINE

NFPA 70
ADD GFCI PROTECTION TO RECEPTACLES IN LAUNDRY ROOMS AND UTILITY ROOMS OF DWELLINGS WHERE INSTALLED WITHIN 6' OF THE OUTSIDE EDGE OF A SINK. THIS WOULD INCLUDE THE RECEPTACLE INSTALLED FOR A WASHING MACHINE.


RECEPTACLE OUTLETS SHALL NOT BE REQUIRED ON A WALL DIRECTLY BEHIND A RANGE OR SINK TO FULFILL THE REQUIREMENT FOR AN OUTLET EVERY 24". THE WIDTH OF THE SINK OR RANGE IS NOT TO BE INCLUDED IN THE SPACING OF THE OUTLETS UNLESS THE DISTANCE FROM THE SINK OR RANGE IS GREATER THAN 12" FOR STRAIGHT COUNTER TOPS AND 18" FOR SINKS AND RANGES INSTALLED IN CORNER COUNTERS.

ELECTRICAL KEY

	DUPLEX CONVENIENCE OUTLET		PENDANT FIXTURE
	WEATHERPROOF DUPLEX OUTLET		SURFACE MOUNTED LIGHT FIXTURE
	GROUND FAULT INTERRUPTER DUPLEX OUTLET		WALL MOUNTED LIGHT FIXTURE
	HALF-SWITCHED DUPLEX OUTLET		FLUORESCENT LIGHT FIXTURE
	DUPLEX OUTLET IN FLOOR		WALL MOUNTED STRIP LIGHT
	220 VOLT OUTLET		UNDERCABINET LIGHTING (OPTIONAL)
	DISPOSAL		WALL SCENCE
	WALL SWITCH		EXHAUST FAN
	THREE-WAY SWITCH		EXHAUST FAN & LIGHT COMBO
	FOUR-WAY SWITCH		OUTLET FOR GARAGE DOOR OPENER
	DIMMER SWITCH		SOFFIT OUTLET (OPTIONAL)
	MOTION DETECTOR SWITCH (OPTIONAL)		CHIMES
	PRE-WIRED SPEAKER		PUSHBUTTON SWITCH
	FLUSHMOUNT LED		SMOKE DETECTOR/CARBON MONOXIDE DETECTORS
	FLUSHMOUNT LED - VAPOR PROOF		TELEPHONE OUTLET PREWIRE
	MONO POINT TRACK HEAD (OPTIONAL)		

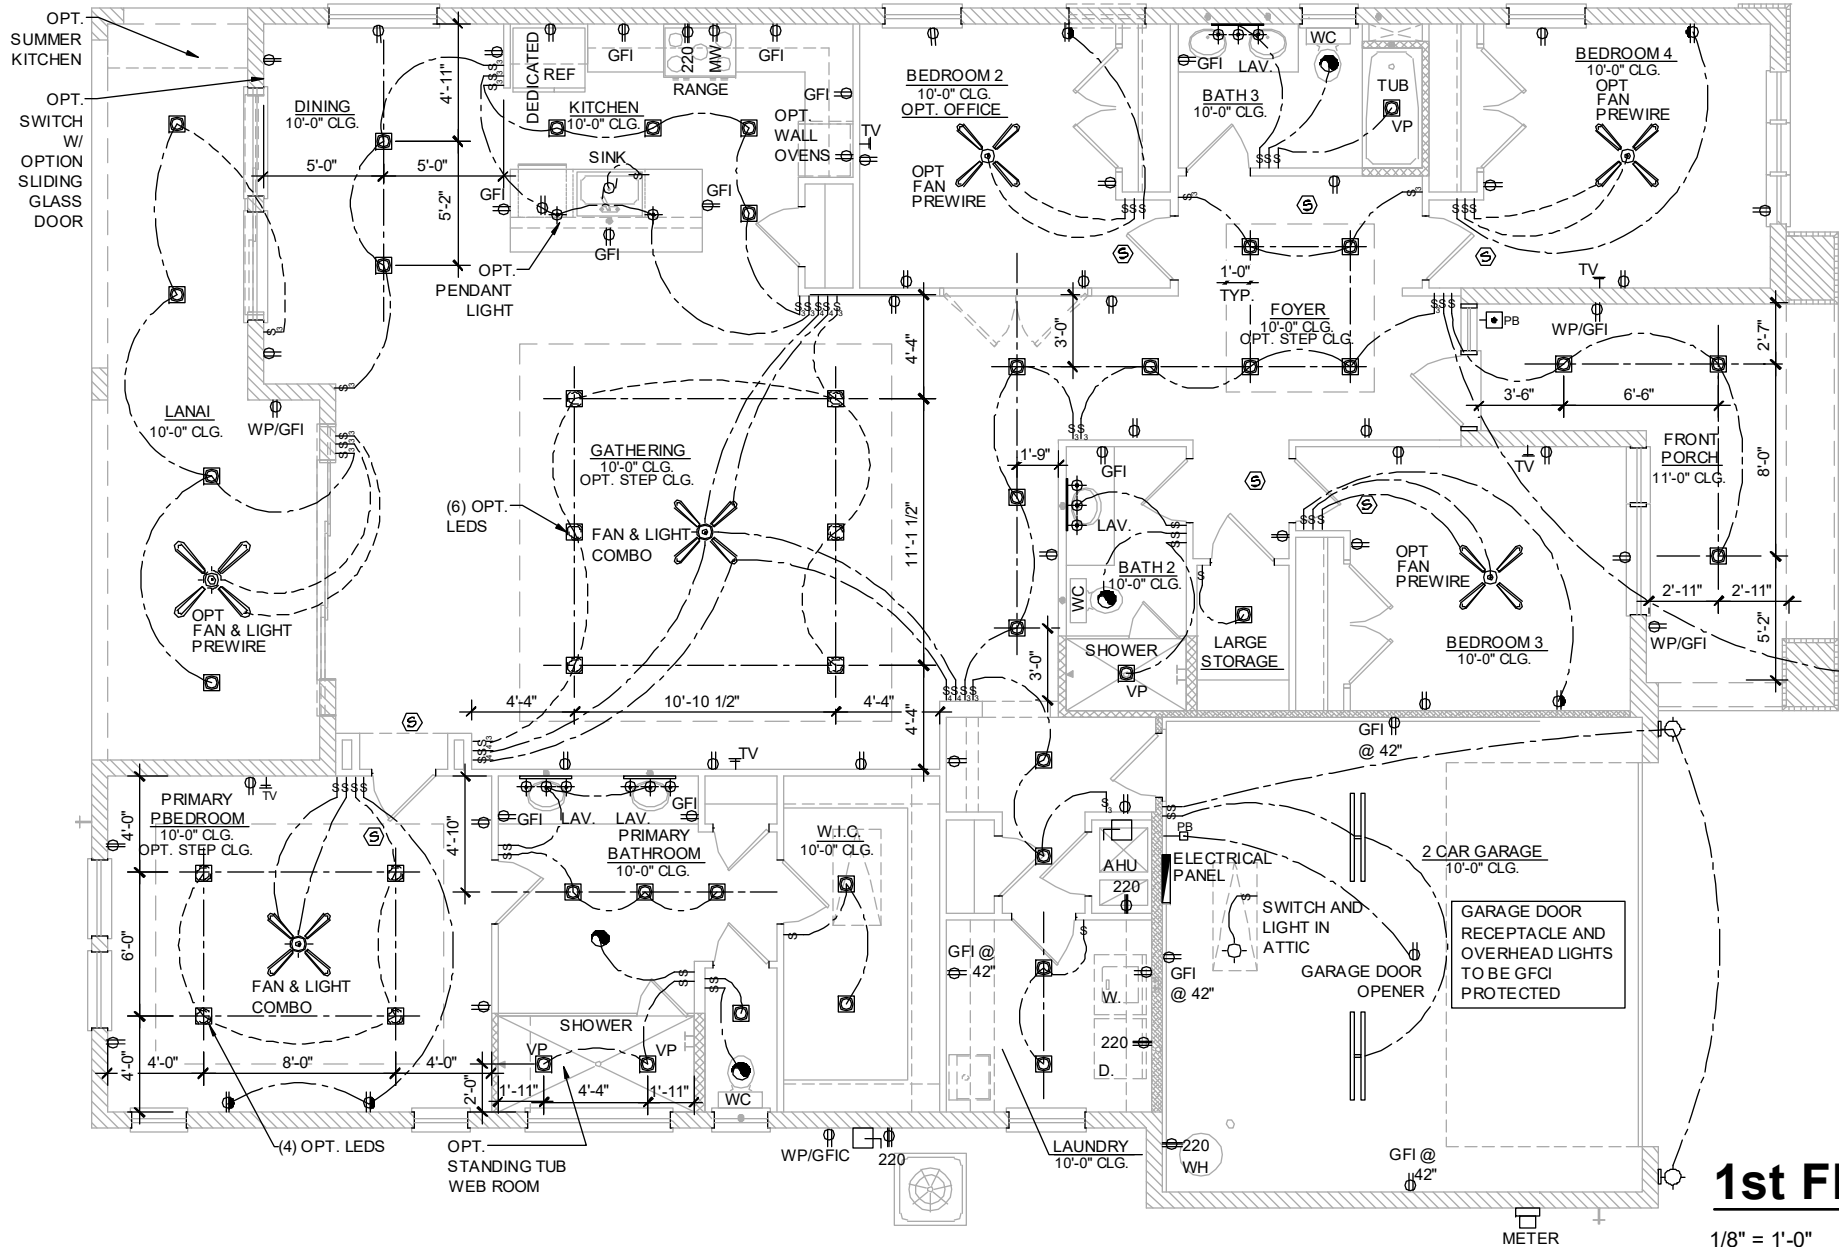


DISCLAIMER
IT IS THE CONTRACTOR/SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.

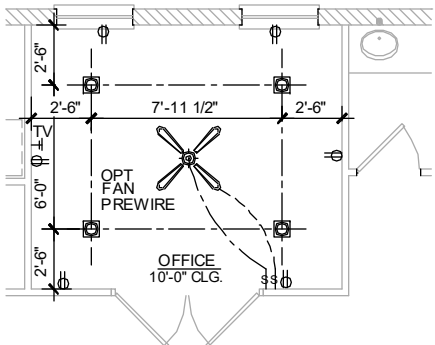

PARTIAL OPTION OFFICE ELECTRICAL PLAN

1/8" = 1'-0"

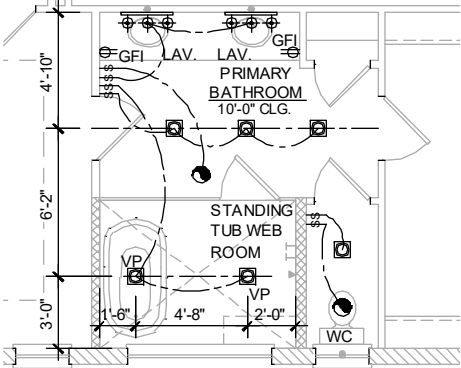

PARTIAL OPTION SUMMER KITCHEN ELECTRICAL FLOOR PLAN

1/8" = 1'-0"

PARTIAL OPTION STANDING TUB ELECTRICAL FLOOR PLAN

1/8" = 1'-0"

1st FLOOR ELECTRICAL PLAN ELEV. "D"

1/8" = 1'-0"

GENERAL NOTES

- FAN, PHONE, & CATV LOCATIONS PER CONTRACT.
- ALL SMOKE/CARBON MONOXIDE DETECTORS TO BE INSTALLED PER 2023 FBCR REFERENCED NFPA 72 AND R314. SMOKE DETECTORS SHALL BE HARDWIRED INTO AN AC ELECTRICAL POWER SOURCE AND SHALL BE EQUIPPED WITH A MONITORED BATTERY BACKUP AND SHALL BE INTERCONNECTED.
- ARCH FAULT BREAKERS: ALL BRANCH CIRCUITS SERVING BEDROOMS, FAMILY ROOMS, HALLWAYS, KITCHEN, LIVING ROOMS, DINING ROOMS, PARLORS, LIBRARIES, DENS, SUNROOMS, REC. ROOMS, CLOSETS AND LAUNDRY AREAS SHALL BE PROTECTED BY ARCH FAULT BREAKERS, PER 2023 FBCR. (REFER TO CHAPTERS 34 - 43)
- NEC 2020 210.52(G)(1) GARAGES. IN EACH ATTACHED GARAGE AND IN EACH DETACHED GARAGE WITH ELECTRIC POWER, AT LEAST ONE RECEPTACLE OUTLET SHALL BE INSTALLED IN EACH VEHICLE BAY, NOT MORE THAN 1.7M (5-1/2 FT.) ABOVE THE FLOOR.
- TAMPER-RESISTANT "TR" RECEPTACLES: ALL 125-VOLT, 15 & 20 AMPERE ELECTRICAL OUTLETS (RECEPTACLES) IN LIVING ROOM AREAS, BATHROOMS, KITCHEN, GARAGE, LAUNDRY ROOM, AND EXTERIOR LOCATIONS MUST BE "TAMPER-RESISTANT" PER 2023 FBCR. (REFER TO CHAPTERS 34 - 43)
- ALL ELECTRICAL WORK AND APPLIANCES SHALL CONFORM TO 2023 FBCR REFERENCED NFPA 70.
- EXCEPTIONS FROM GFI REQUIREMENTS SHALL BE PERMITTED PROVIDED LOCATION WHERE EXCEPTION IS DESIRED IS ALLOWED PER 2023 FBCR REFERENCED NFPA 70.
- UNLESS OTHERWISE INDICATED OR GOVERNED BY CODE, INSTALL SWITCHES AND RECEPTACLES AT THE FOLLOWING HEIGHTS ABOVE FINISH FLOOR.

ELECTRICAL DEVICES

SWITCHES AND WALL OUTLETS OVER COUNTERS	48" TO C.L.
REMAINING SWITCHES	48" TO C.L.
WALL OUTLETS	12" TO C.L.
TELEPHONE OUTLETS	12" TO C.L.
TELEVISION OUTLETS	12" TO C.L.
EXTERIOR GFIS	12" TO C.L.
GARAGE GFIS (ABOVE GARAGE FLOOR)	48" TO C.L.
THERMOSTAT	54" TO C.L.
DOOR BELL CHIMES	84" TO C.L.
DOOR BELL BUTTON	LEVEL W/ DOOR HANDLE
KITCHEN HOOD FAN "WHIP"	66" TO C.L.
KITCHEN WALL HUNG MICROWAVE RECEPTACLE	76" TO C.L.
KITCHEN DISHWASHER RECEPTACLE	UNDER SINK
KITCHEN RANGE	24" TO C.L.
KITCHEN REFRIGERATOR	48" TO C.L.
WASHER/DRYER OUTLET	36" TO C.L.
HOLLYWOOD LIGHTS	84" TO C.L.

C.L. = CENTER LINE

NFPA 70
ADD GFCI PROTECTION TO RECEPTACLES IN LAUNDRY ROOMS AND UTILITY ROOMS OF DWELLINGS WHERE INSTALLED WITHIN 6' OF THE OUTSIDE EDGE OF A SINK. THIS WOULD INCLUDE THE RECEPTACLE INSTALLED FOR A WASHING MACHINE.

RECEPTACLE OUTLETS SHALL NOT BE REQUIRED ON A WALL DIRECTLY BEHIND A RANGE OR SINK TO FULFILL THE REQUIREMENT FOR AN OUTLET EVERY 24". THE WIDTH OF THE SINK OR RANGE IS NOT TO BE INCLUDED IN THE SPACING OF THE OUTLETS UNLESS THE DISTANCE FROM THE SINK OR RANGE IS GREATER THAN 12" FOR STRAIGHT COUNTER TOPS AND 18" FOR SINKS AND RANGES INSTALLED IN CORNER COUNTERS.




ABOVE FIN. FLR.

ELECTRICAL KEY

- ⊕ DUPLEX CONVENIENCE OUTLET
- ⊕ WP WEATHERPROOF DUPLEX OUTLET
- ⊕ GFI GROUND FAULT INTERRUPTER DUPLEX OUTLET
- ⊕ HALF-SWITCHED DUPLEX OUTLET
- ⊕ DUPLEX OUTLET IN FLOOR
- ⊕ 220v 220 VOLT OUTLET
- ⊕ DISPOSAL
- ⊕ WALL SWITCH
- ⊕ THREE-WAY SWITCH
- ⊕ FOUR-WAY SWITCH
- ⊕ DIMMER SWITCH
- ⊕ MOTION DETECTOR SWITCH (OPTIONAL)
- ⊕ PRE-WIRED SPEAKER
- ⊕ FLUSHMOUNT LED
- ⊕ VP FLUSHMOUNT LED - VAPOR PROOF
- ⊕ MONO POINT TRACK HEAD (OPTIONAL)

- ⊕ PENDANT FIXTURE
- ⊕ SURFACE MOUNTED LIGHT FIXTURE
- ⊕ WALL MOUNTED LIGHT FIXTURE
- ⊕ FLUORESCENT LIGHT FIXTURE
- ⊕ WALL MOUNTED STRIP LIGHT
- ⊕ UNDERCABINET LIGHTING (OPTIONAL)
- ⊕ WALL SCNCE
- ⊕ EXHAUST FAN
- ⊕ EXHAUST FAN & LIGHT COMBO
- ⊕ OUTLET FOR GARAGE DOOR OPENER
- ⊕ SOFFIT OUTLET (OPTIONAL)
- ⊕ CHIMES
- ⊕ PUSHBUTTON SWITCH
- ⊕ SMOKE DETECTOR/CARBON MONOXIDE DETECTORS
- ⊕ TELEPHONE OUTLET PREWIRE

- ⊕ TELEVISION OUTLET PREWIRE
- ⊕ T THERMOSTAT
- ⊕ ELECTRIC METER
- ⊕ ELECTRIC PANEL
- ⊕ DISCONNECT SWITCH
- ⊕ SECURITYSYSTEMKEYPAD
- ⊕ PRE-WIRE FOR CEILING FAN
- ⊕ SECURITY/FLOOD LIGHTS
- ⊕ GAS METER
- ⊕ JB JUNCTION BOX

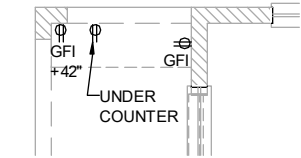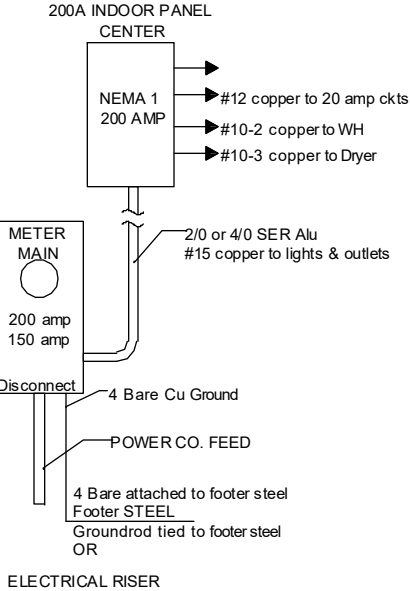


PARK SQUARE HOMES
2468 CATALINA
MASTER

title:
**ELECTRICAL
FIRST FLOOR PLAN**


project no.2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

E1

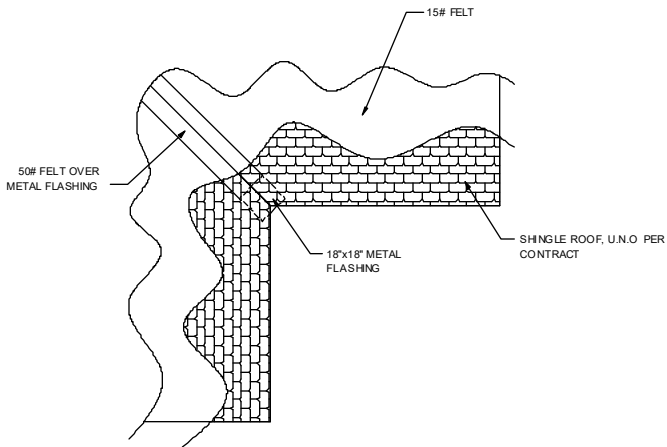

TYPICAL VALLEY FLASHING DETAIL


N.T.S.

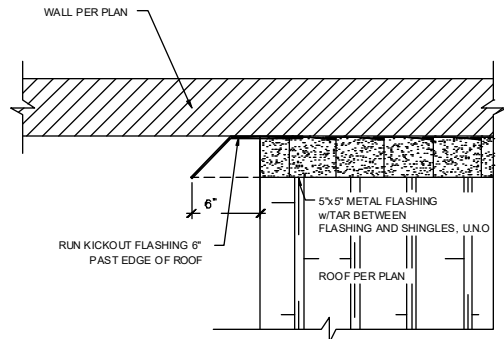

TYPICAL ROOF TO WALL FLASHING DETAIL


N.T.S.

PLAN VIEW



CAP @ LOW WALL


N.T.S.

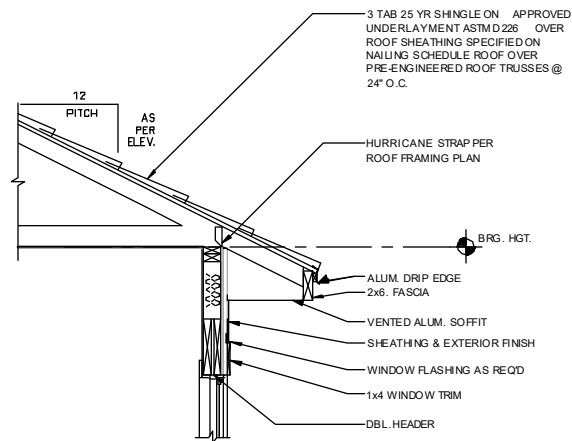

**TYPICAL WINDOW & SLIDING GLASS
DOOR Z FLASHING DETAIL**


N.T.S.

- TIE-IN WITH WEATHER RESISTIVE BARRIER
1. INTEGRATE INSTALLATION OF WEATHER RESISTIVE BARRIER WITH FLASHING TO FORM WATER SHEDDING LAPS
 2. SCORE & FOLD WEATHER RESISTIVE BARRIER ABOVE HEADER TO ALLOW FOR FLASHING INSTALLATION
 4. INSTALL HEAD FLASHING UNDER WEATHER RESISTIVE BARRIER
 5. FOLD WEATHER RESISTIVE BARRIER BACK OVER HEAD FLASHING AND SEAL WITH WEATHER RESISTIVE BARRIER TAPE

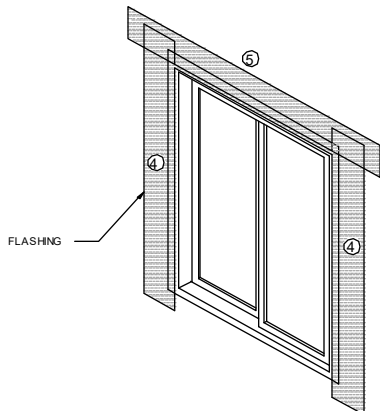

TYPICAL SLIDING GLASS DOOR FLASHING DETAIL

N.T.S.

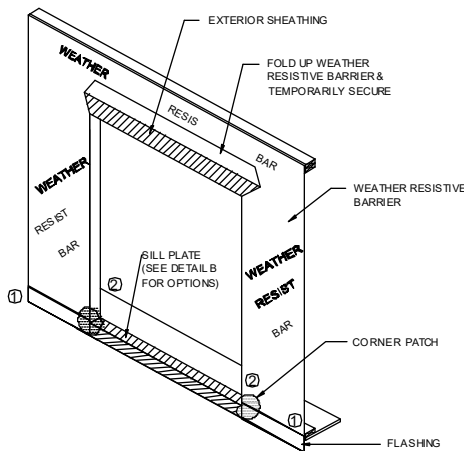

- NOTES:
1. FLASHING TO BE FLEXIBLE SELF-ADHESIVE TYPE (MIN. 6\"/>
 2. INSTALL FLASHING IN ORDER AS SHOWN BY NUMBERS
 3. MECHANICALLY FASTEN AS NECESSARY

WALL COVERING

2023 FBCR

SECTION R703.1 EXTERIOR COVERING

Exterior walls shall provide the building with a weather-resistant exterior wall envelope. The exterior wall envelope shall include flashing as described in Section R703.4.

R703.1.1 WATER RESISTANCE

The exterior wall envelope shall be designed and constructed in a manner that prevents the accumulation of water within the wall assembly by providing a water-resistant barrier behind the exterior cladding as required by Section R703.2 and a means of draining to the exterior water that penetrates the exterior cladding.

R703.2 WATER-RESISTIVE BARRIER

Not fewer than one layer of water-resistive barrier shall be applied over studs or sheathing of all exterior walls with flashing as indicated in Section R703.4, in such a manner as to provide a continuous water-resistive barrier behind the exterior wall veneer. The water-resistive barrier material shall be continuous to the top of walls and terminated at penetrations and building appendages in a manner to meet the requirements of the exterior wall envelope as described in Section R703.1. Water-resistive barrier materials shall comply with one of the following:

- 1.No. 15 felt complying with ASTM D226, Type 1.
- 2.ASTM E2568, Type 1 or 2.
- 3.ASTM E331 in accordance with Section R703.1.1.
- 4.Other approved materials in accordance with the manufacturer's installation instructions.

No.15 asphalt felt and water-resistive barriers complying with ASTM E2556 shall be applied horizontally, with the upper layer lapped over the lower layer not less than 2 inches (51 mm), and where joints occur, shall be lapped not less than 6 inches (152 mm).

R703.4 FLASHING


Approved metal flashing, vinyl flashing, self-adhered membranes and mechanically attached flexible flashing shall be applied shingle-fashion or in accordance with the manufacturer's instructions. Metal flashing shall be corrosion resistant. Fluid-applied membranes used as flashing shall be applied in accordance with the manufacturer's instructions. All flashing shall be applied in a manner to prevent the entry of water into the wall cavity or penetration of water to the building structural framing components. Self-adhered membranes used as flashing shall comply with AAMA 711. All exterior fenestration products shall be sealed at the juncture with the building wall with a sealant complying with AAMA 800 or ASTM C920 Class 25 Grade NS or greater for proper joint expansion and contraction, ASTM C1281, AAMA 812, or other approved standard as appropriate for the type of sealant. Fluid-applied membranes used as flashing in exterior walls shall comply with AAMA 714. The flashing shall extend to the surface of the exterior wall finish. Approved flashings shall be installed at the following locations:

1.Exterior window and door openings. Flashing at exterior window and door openings shall extend to the surface of the exterior wall finish or to the water-resistive barrier complying with Section 703.2 for subsequent drainage. Mechanically attached flexible flashings shall comply with AAMA 712. Flashing at exterior window and door openings shall be installed in accordance with one or more of the following:

- 1.1.The fenestration manufacturer's installation and flashing instructions, or for applications not addressed in the fenestration manufacturer's instructions, in accordance with the flashing or water-resistive barrier manufacturer's instructions. Where flashing instructions or details are not provided, pan flashing shall be installed at the sill of exterior window and door openings. Pan flashing shall be sealed or sloped in such a manner as to direct water to the surface of the exterior wall finish or to the water-resistive barrier for subsequent drainage. Openings using pan flashing shall incorporate flashing or protection at the head and sides.
- 1.2.In accordance with the flashing design or method of a registered design professional.
- 1.3.In accordance with other approved methods.
- 1.4.In accordance with FMA/AAMA 100, FMA/AAMA 200, FMA/WDMA 250, FMA/AAMA/WDMA 300 or FMA/AAMA/WDMA 400, or FMA/AAMA/WDMA 2710.
- 2.At the intersection of chimneys or other masonry construction with frame or stucco walls, with projecting lips on both sides under stucco copings.
- 3.Under and at the ends of masonry, wood or metal copings and sills.
- 4.Continuously above all projecting wood trim.
- 5.Where exterior porches, decks or stairs attach to a wall or floor assembly of wood-frame construction.
- 6.At wall and roof intersections.
- 7.At built-in gutters.

DISCLAIMER

IT IS THE CONTRACTOR'S/ SUB-CONTRACTORS RESPONSIBILITY TO REVIEW ALL INFORMATION CONTAINED HEREIN PRIOR TO COMMENCEMENT OF CONSTRUCTION. KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP IS NOT RESPONSIBLE FOR ANY MISINTERPRETATIONS, ERRORS, OMISSIONS OR CUSTOM CHANGES MISSED AND NOT REPORTED TO KEESEE ASSOCIATES & THOMAS ENGINEERING GROUP PRIOR TO CONSTRUCTION. NO EXCEPTIONS.




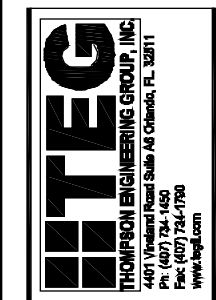


PARK SQUARE HOMES
2468 CATALINA
MASTER

Title:
FLASHING DETAILS

Project no.2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

WP1

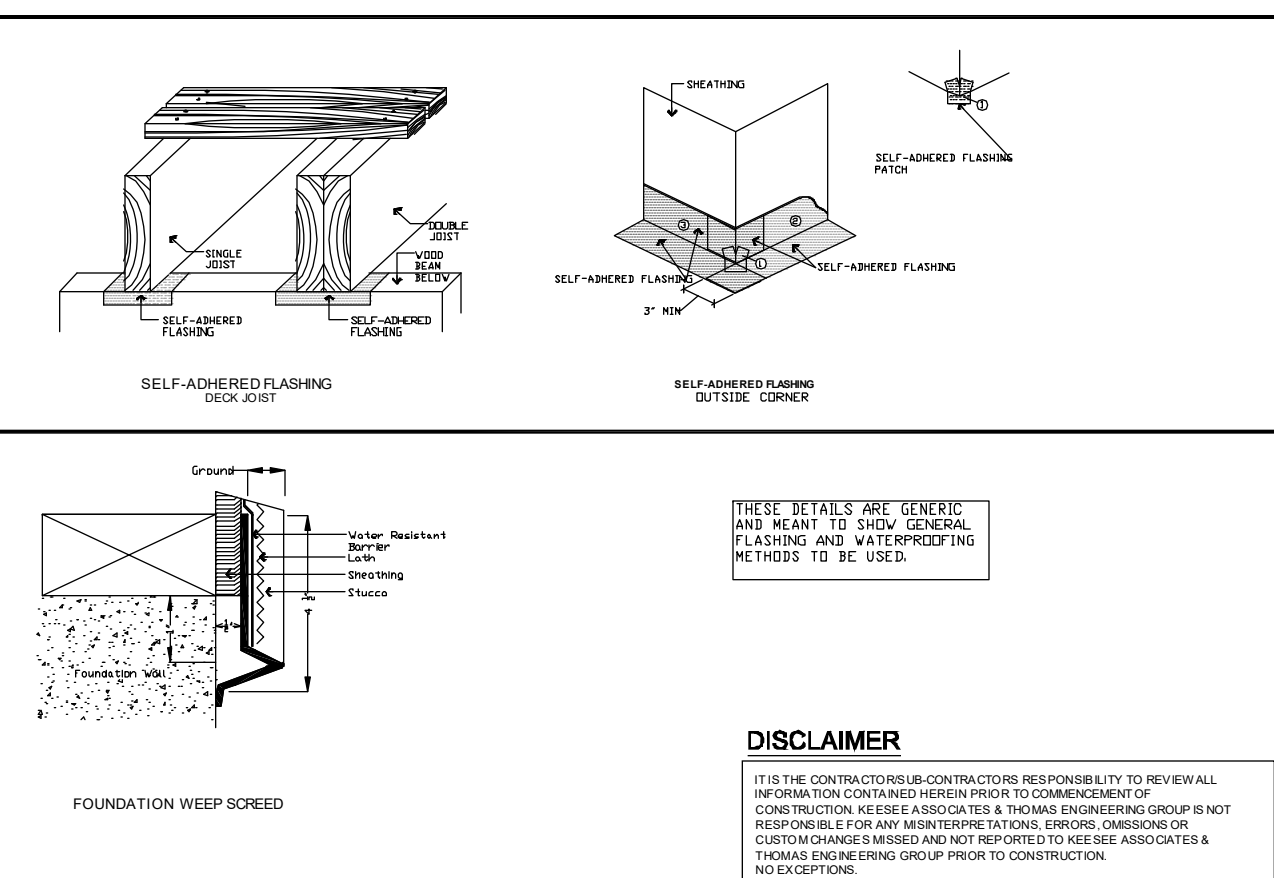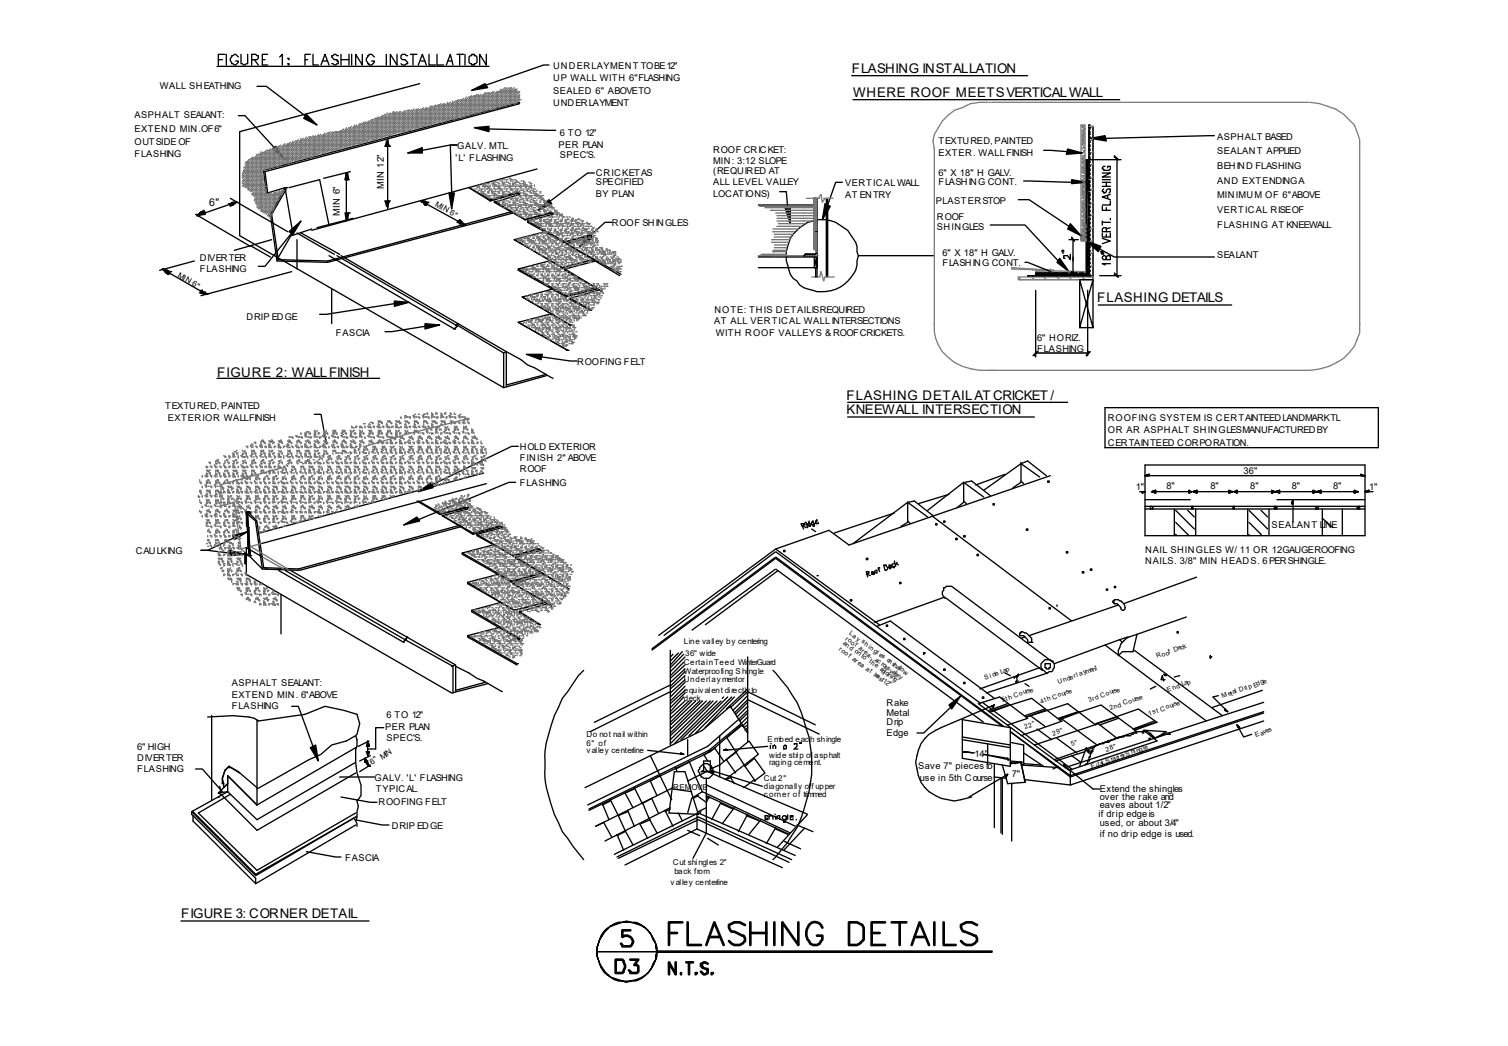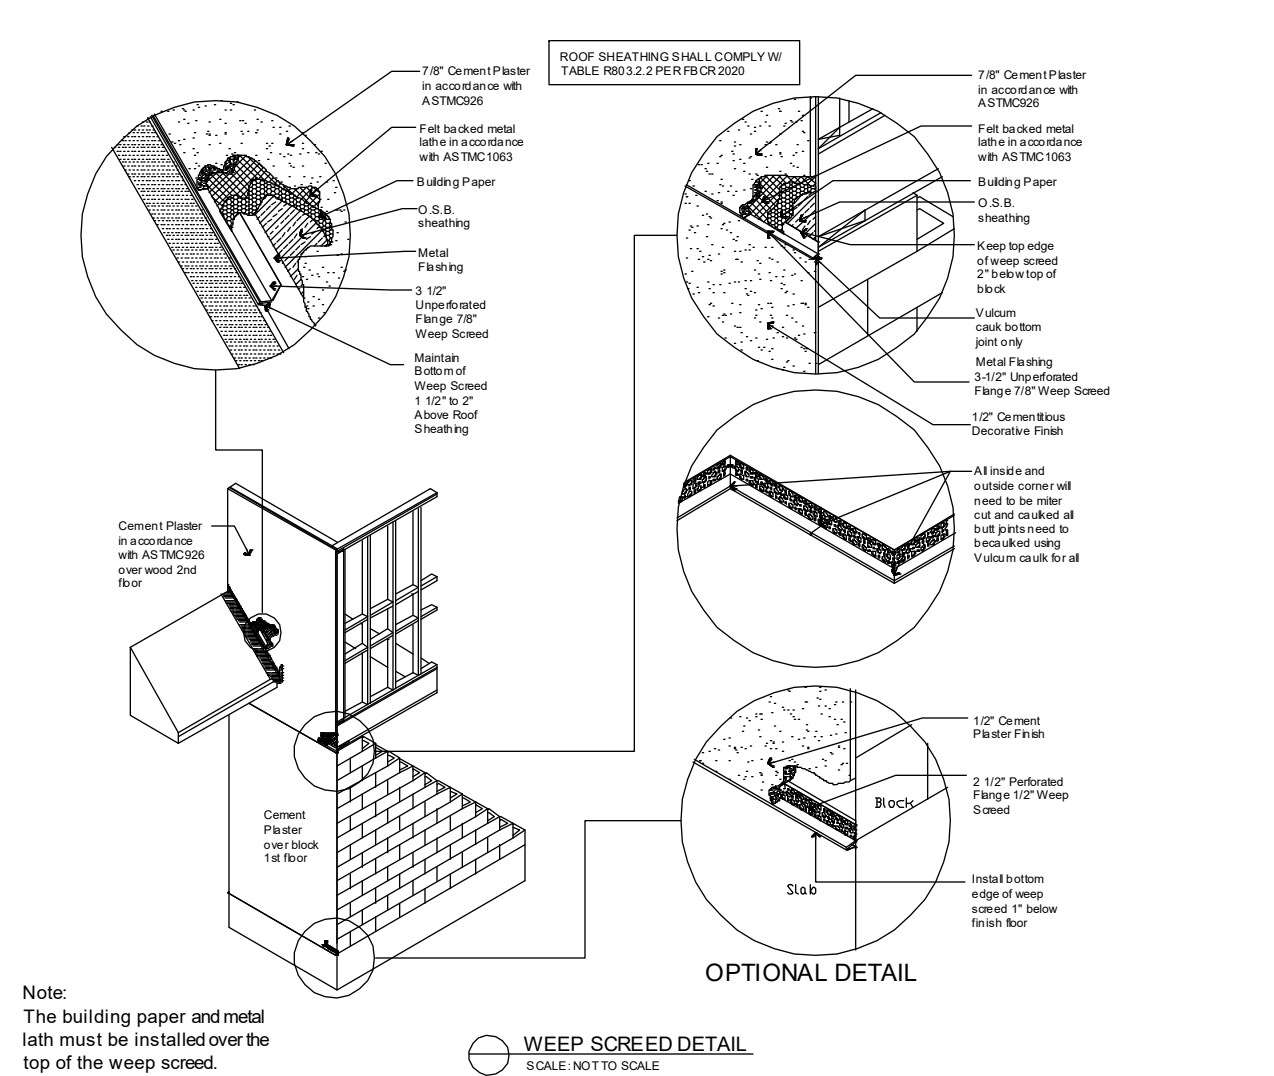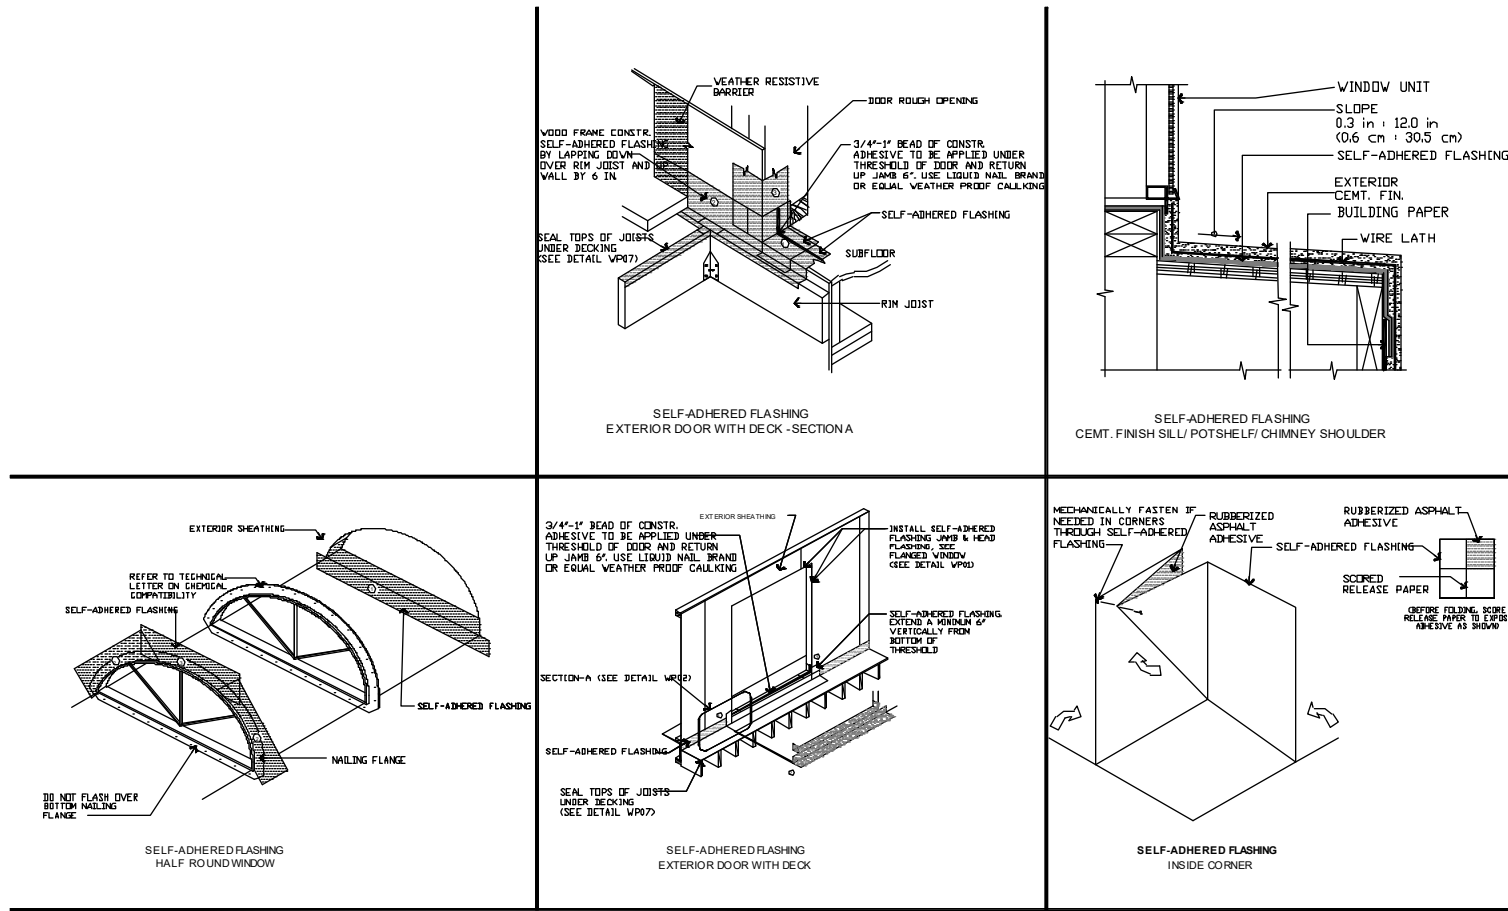

KEESEE ASSOCIATES
ARCHITECTURE | DESIGN | PLANNING
2468 Catalina Lane, Suite 200
Orlando, FL 32811
(407) 734-1750
www.keeseegroup.com

ITTEG
THOMPSON ENGINEERING GROUP, INC.
4401 Windward Road, Suite A9 Orlando, FL 32811
Ph: (407) 734-1750
Fax: (407) 734-1750
www.itteg.com

PARK SQUARE HOMES
2468 CATALINA
MASTER

title:
FLASHING DETAILS

project no. 2023221
checked:
drawn: SD
date: 8/21/23
scale: AS SHOWN

WP2