

# 1966

## THE MARGATE II (SIDING)

### FLORIDA SERIES

PAD SIZE: 40' X 65'

**SHEET INDEX:**

- 00 COVER SHEET
- 01AB FOUNDATION PLAN 'A'
- 02AB FLOOR PLAN W/ DIMENSIONS 'A'
- 03AB FLOOR PLAN W/ NOTES 'A'
- 04A EXTER. ELEVATION 'A'- FRONT & REAR
- 05A EXTER. ELEVATION 'A'- LEFT & RIGHT
- 06 CROSS SECTION / INTERIOR ELEVATIONS
- 07AB ELECTRICAL PLAN
- 08A TRUSS LAYOUT 'A'
- 09AB PRE-CAST LINTEL LAYOUT- 'A'
- 10 TYPICAL DETAILS
- 11 TYPICAL DETAILS
- D1 TYPICAL STRUCTURAL DETAILS
- D2 TYPICAL STRUCTURAL DETAILS
- D3 TYPICAL STRUCTURAL DETAILS

\* ADD .3 FOR 3-CAR GARAGE OPTION

**SHEET INDEX:**

- 00 COVER SHEET
- 01AB FOUNDATION PLAN 'B'
- 02AB FLOOR PLAN W/ DIMENSIONS 'B'
- 03AB FLOOR PLAN W/ NOTES 'B'
- 04B EXTER. ELEVATION 'B'- FRONT & REAR
- 05B EXTER. ELEVATION 'B'- LEFT & RIGHT
- 06 CROSS SECTION / INTERIOR ELEVATIONS
- 07AB ELECTRICAL PLAN
- 08B TRUSS LAYOUT 'B'
- 09AB PRE-CAST LINTEL LAYOUT- 'B'
- 10 TYPICAL DETAILS
- 11 TYPICAL DETAILS
- D1 TYPICAL STRUCTURAL DETAILS
- D2 TYPICAL STRUCTURAL DETAILS
- D3 TYPICAL STRUCTURAL DETAILS

\* ADD .3 FOR 3-CAR GARAGE OPTION

**SHEET INDEX:**

- 00 COVER SHEET
- 01C FOUNDATION PLAN 'C'
- 02C FLOOR PLAN W/ DIMENSIONS 'C'
- 03C FLOOR PLAN W/ NOTES 'C'
- 04C EXTER. ELEVATION 'C'- FRONT & REAR
- 05C EXTER. ELEVATION 'C'- LEFT & RIGHT
- 06 CROSS SECTION / INTERIOR ELEVATIONS
- 07C ELECTRICAL PLAN
- 08C TRUSS LAYOUT 'C'
- 09C PRE-CAST LINTEL LAYOUT- 'C'
- 10 TYPICAL DETAILS
- 11 TYPICAL DETAILS
- D1 TYPICAL STRUCTURAL DETAILS
- D2 TYPICAL STRUCTURAL DETAILS
- D3 TYPICAL STRUCTURAL DETAILS

\* ADD .3 FOR 3-CAR GARAGE OPTION

REVISION SCHEDULE			
NO.	DATE	DESCRIPTION	BY
1	12/22/17	UPDATE TO 2017 CODE	MW
2	05/09/18	-ADDED OPT. GAREGE SERVICE DOOR	AN
3	11/28/18	-DELETE MASTER BR. NICHE & CHANGE ALL INTERIOR ARCHES TO FLAT SOFFITS	MW
4	02/15/19	-ADDED 2019 PLAN FEET CHANGES	MW
5	05-16-19	-ADDED NEW A,B,C SIDING ELEVATIONS	JF
6	07-08-19	-REVISE ENTRY FLOORING	MW
7	01-05-21	-UPDATE TO 2020 CODE	AN
8	06-10-21	-ADD 2x6 WALL IN LAUNDRY ROOM	AN
9	08-05-21	-ADD FRONT ENTRY SECTION	AN
10	10/05/23	- DELETE INTERIOR DOORS HT	MW
11	01/04/24	- 2023 CODE UPDATE - ELEV A, B & C	MW
12	05/24/24	- ADD ON-Q PANEL	MW
13	06/25/24	- ADD EXTENDED FOYER & MOVE GARAGE WALL 2' FORWARD	MW
13	06/25/24	- ADD MODEL WALK CHANGES - NL - 240628	MW
14	04/03/26	- ADD MODEL WALK CHANGES	AN
15	05/05/26	- ADD OPT. 12' S.G.D.	MW

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH


LOT: 0000, COMMUNITY NAME

FLORIDA SERIES



© COPYRIGHT 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without the express written permission from Park Square Homes.

<p>1966</p> <p>MARGATE II</p>	<p>COVER SHEET</p>						
<p>DATE 04-05-2017</p> <p>SCALE AS NOTED</p> <p>DRAWN RDC</p> <p>JOB N/A</p> <p>SHEET</p> <p style="text-align: center;">00</p> <p>OF 00 SHEETS</p>	<p>REVISIONS</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>NO.</th> <th>DATE</th> <th>BY</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">05-16-19</td> <td></td> <td style="text-align: center;">JF</td> </tr> </tbody> </table> <p style="text-align: center;">   <small>             ITC ENGINEERING GROUP, INC.              5200 Vineland Road, Suite 200              Orlando, Florida 32811              Tel: (407) 734-1490              Fax: (407) 734-1790              www.itg.com           </small> </p> <p style="text-align: center;"> <small>             A DIVISION OF PARK SQUARE ENTERPRISES, INC.              5200 Vineland Road, Suite 200              Orlando, Florida 32811              Phone: (407) 529 - 3000           </small> </p>	NO.	DATE	BY	05-16-19		JF
NO.	DATE	BY					
05-16-19		JF					



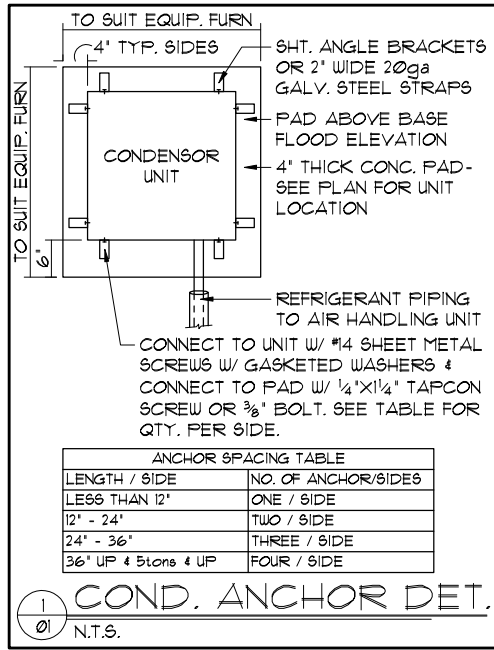

- FOUNDATION NOTES**
- CONTRACTOR VERIFY ALL DIMENSIONS ON JOB SITE.
  - DENOTES FILL CELL REINF. W/ CONC. W/ (1) #5 REBAR GRADE 60
  - DENOTES FILL CELL REINF. W/ CONC. W/ (2) #5 REBAR GRADE 60
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - WATER HEATER T & P RELIEF VALVE SHALL BE FULL SIZE TO EXTERIOR WATER HEATER AT OR ABOVE FLOOR LEVEL SHALL BE IN A PAN WITH DRAIN TO EXTERIOR. WATER HEATER SHALL HAVE APPROVED THERMAL EXPANSION DEVICE.
  - DENOTES FLOOR SLAB OF PLANT MIX CONCRETE 2500 P.S.I. 4" THICK WITH 6X6 10/10 GAUGE REINFORCING MAT. WITH MIN. 1" COVER. TERMITE TREATED SOIL WITH 2006mm (6 mil) POLYETHYLENE VAPOR BARRIER OVER COMPACTED CLEAN FILL. W/F SHALL BE PLACED IN MIDDLE TO UPPER THIRD OF SLAB AND SUPPORTED ON APPROVED SLAB BOLSTERS. FIBER MESH REINFORCEMENT MAY BE USED AS ALTERNATIVE TO WIRE MESH.
  - PAVERS MAY BE USED ILO CONCRETE SLABS IN PATIO, PORCH, DRIVE AND WALKWAY AREAS. DELETE SLAB IN AREAS PAVERS ARE USED.
  - ~~○ STANDARD FOOTING~~ NOT USED  
~~○ ALTERNATE FOOTING~~
  - MECHANICAL EQUIP. LOCATIONS WILL BE DETERMINED BY COMMUNITY AND COUNTY CODES.
  - IN LIEU OF TREATING THE SOIL, AN ALTERNATIVE TO TERMITE TREATED SOIL CAN BE TERMICIDE.
  - BORA-CARE TO BE APPLIED ON INTERIOR WALLS IAW MANUFACTURER'S INSTRUCTIONS AND SPECIFICATIONS, PURSUANT TO CH.402 FLORIDA BUILDING CODE.

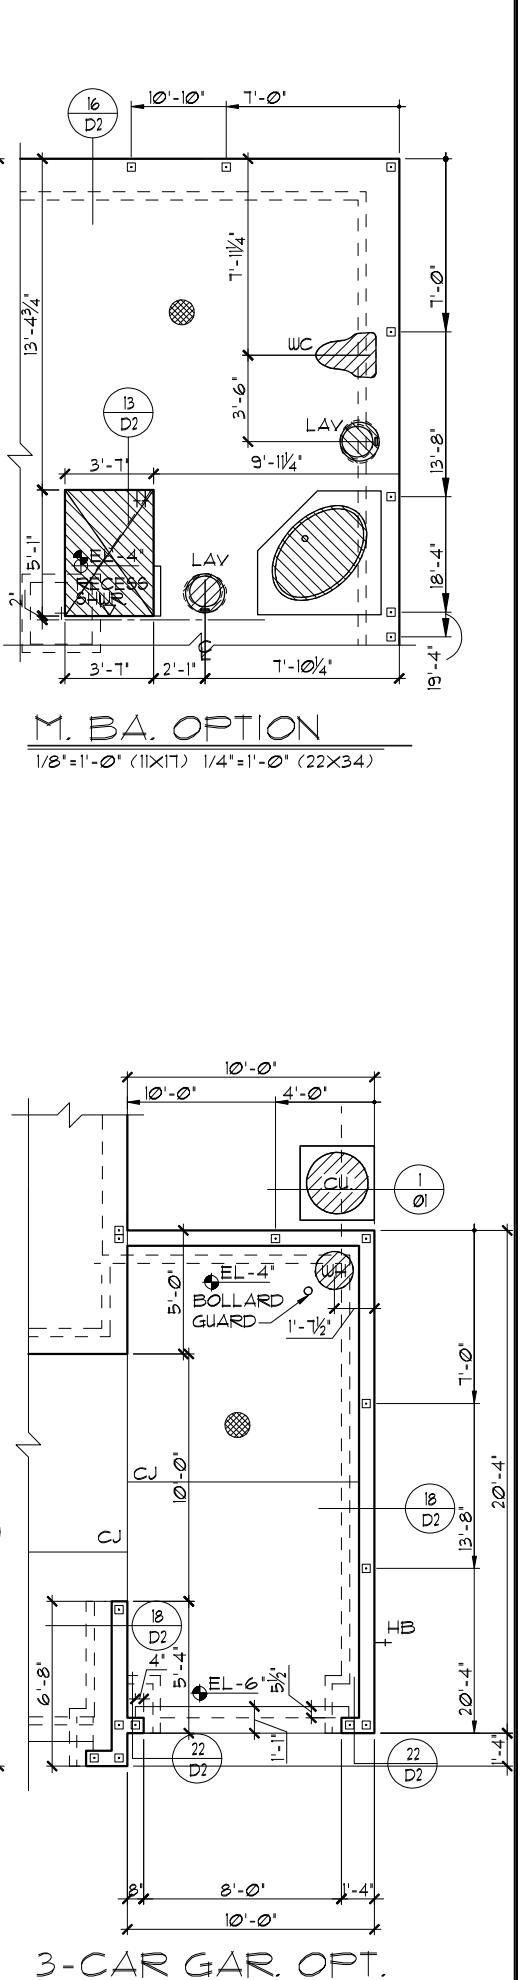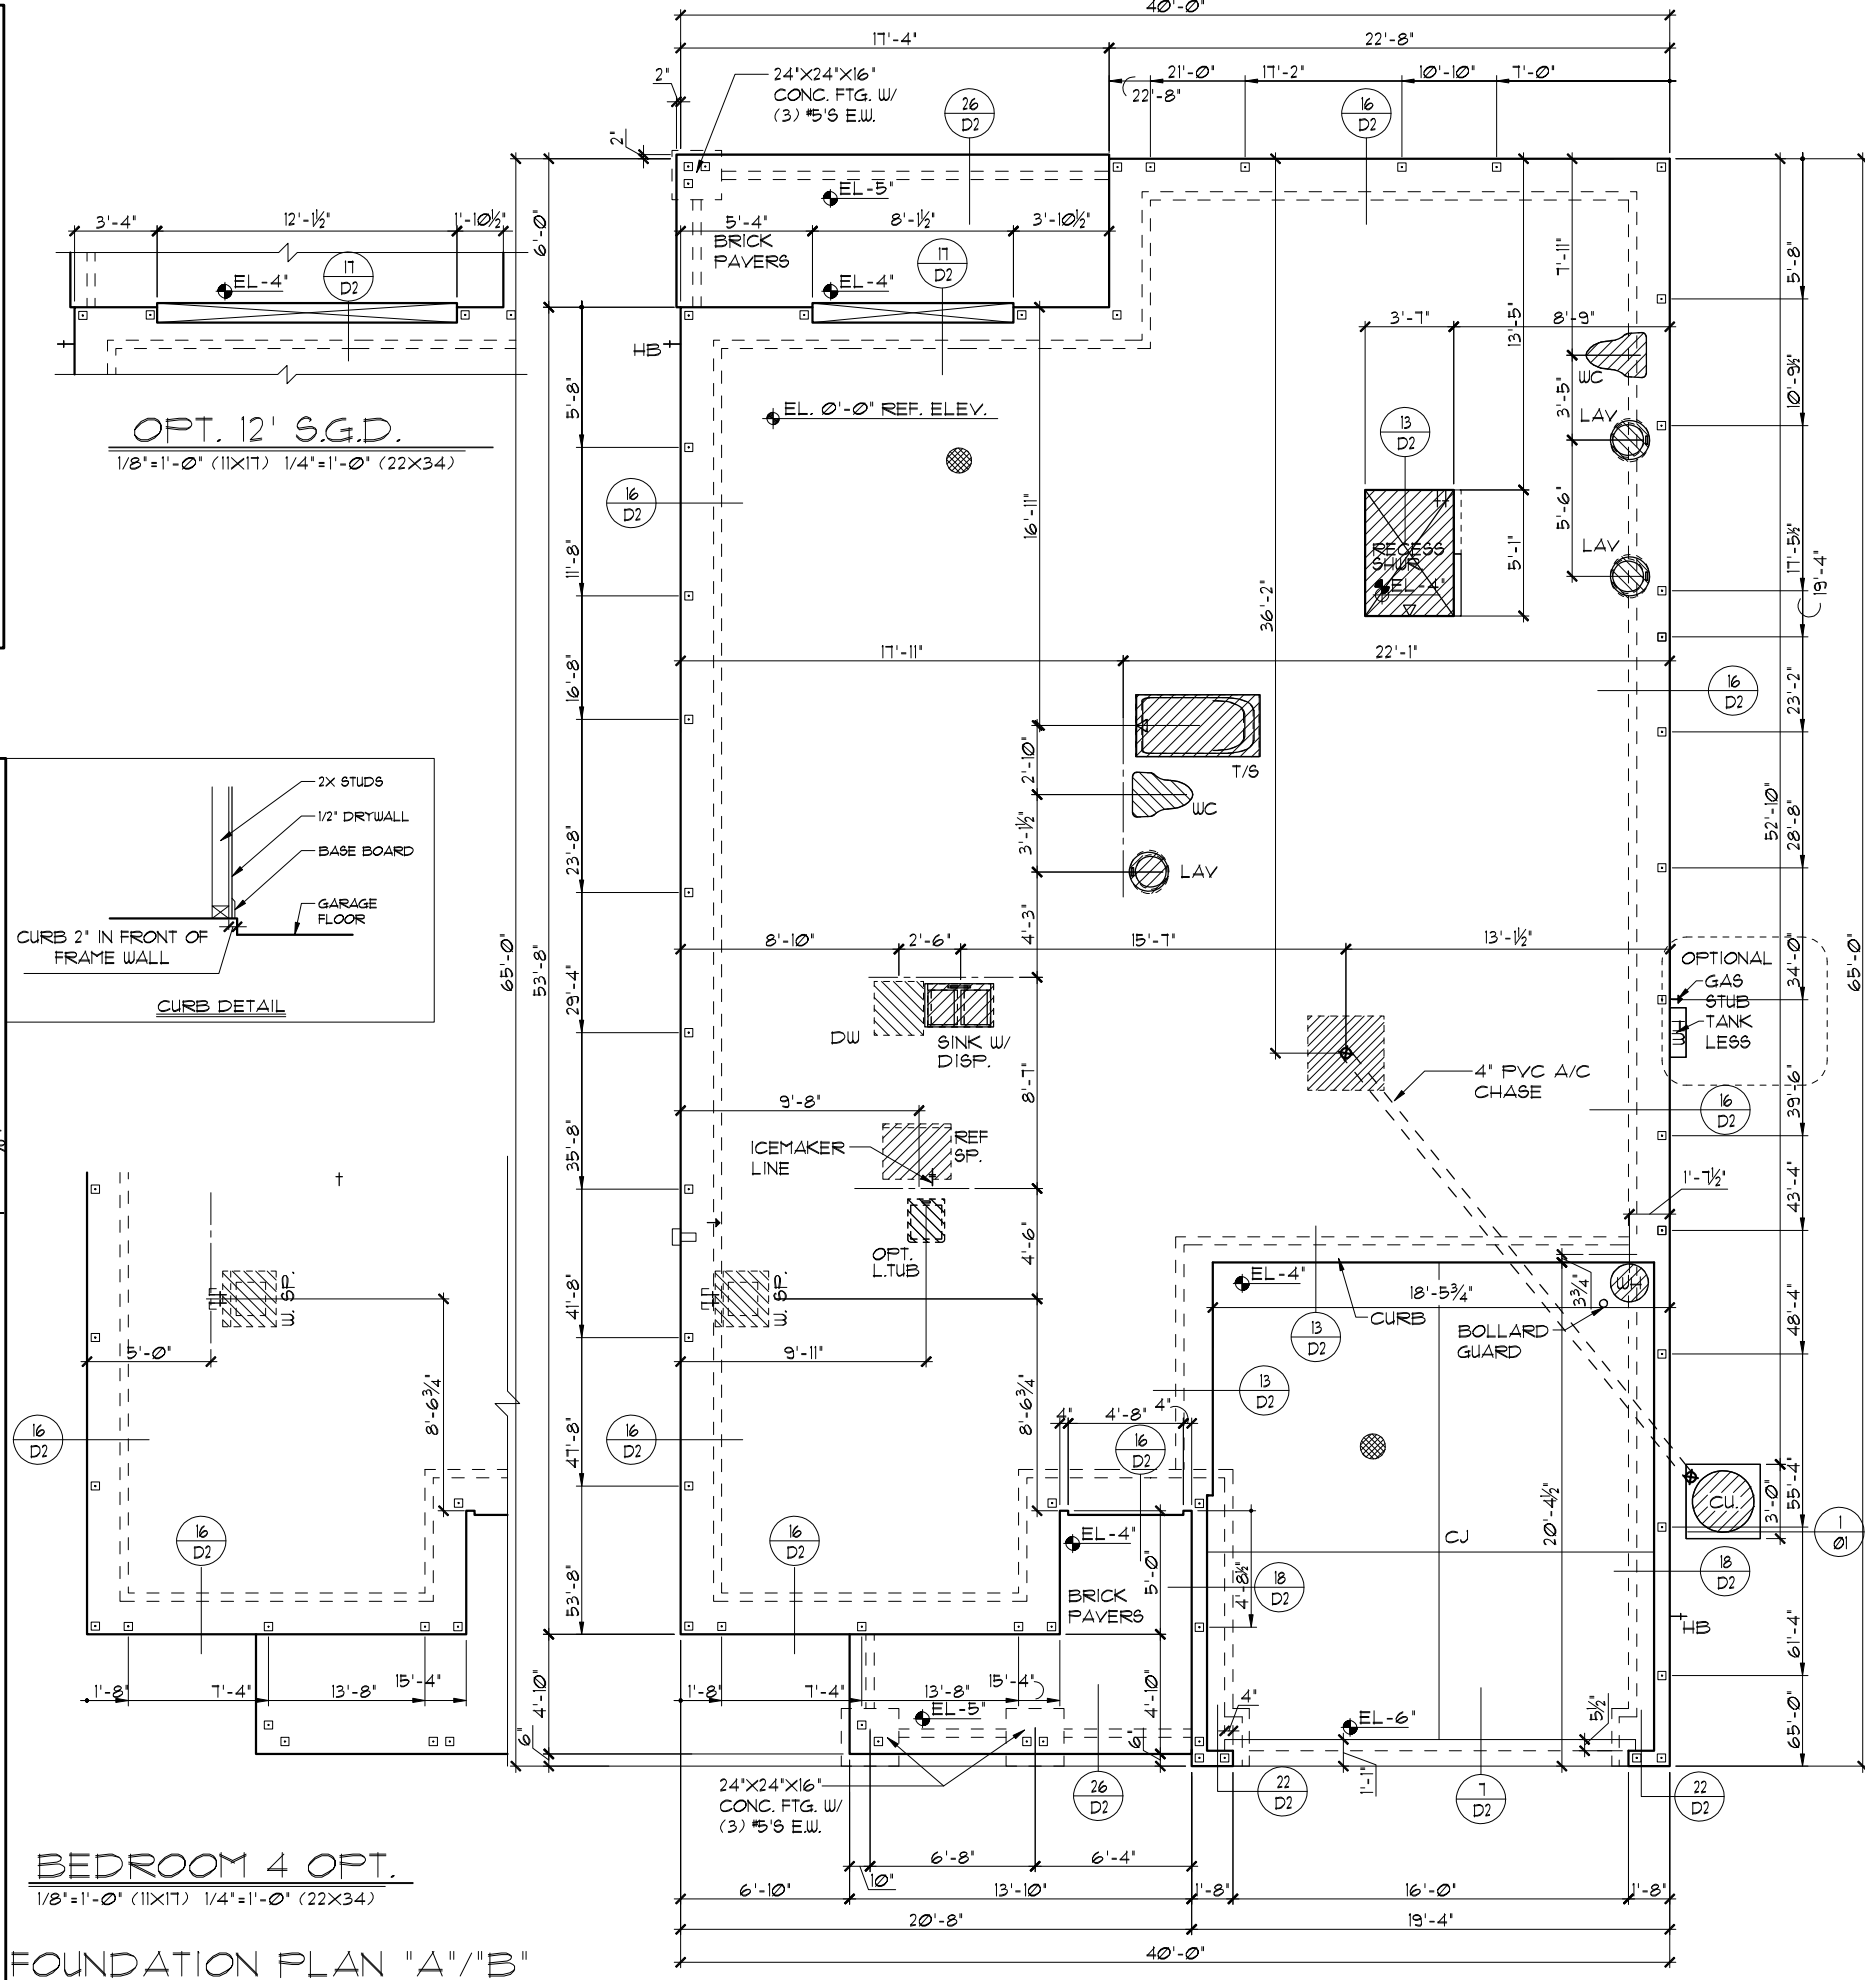







TABULATION	
TOTAL LIVING	2,000 SF.
GARAGE	385 SF.
ENTRY PORCH	64 SF.
LANAI	104 SF.
TOTAL UNDER ROOF	2,553 SF.
OPT. 3-CAR GARAGE	203 SF.
TOTAL UNDER ROOF	2,756 SF.


- GENERAL NOTES**
- CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3/2" UNLESS NOTED OTHERWISE.
  - ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1 1/2" UNLESS NOTED OTHERWISE.
  - FULL ALL DIMENSIONS FROM THE REAR OF PLAN.

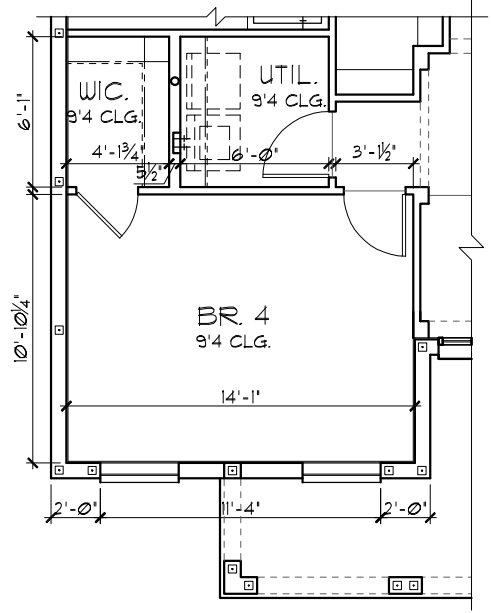


**BEDROOM 4 OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

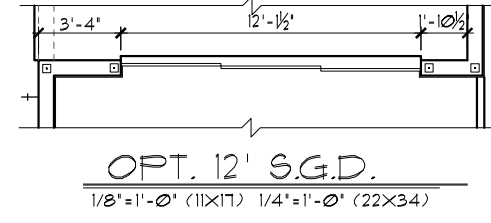


**OPT. 12' S.G.D.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

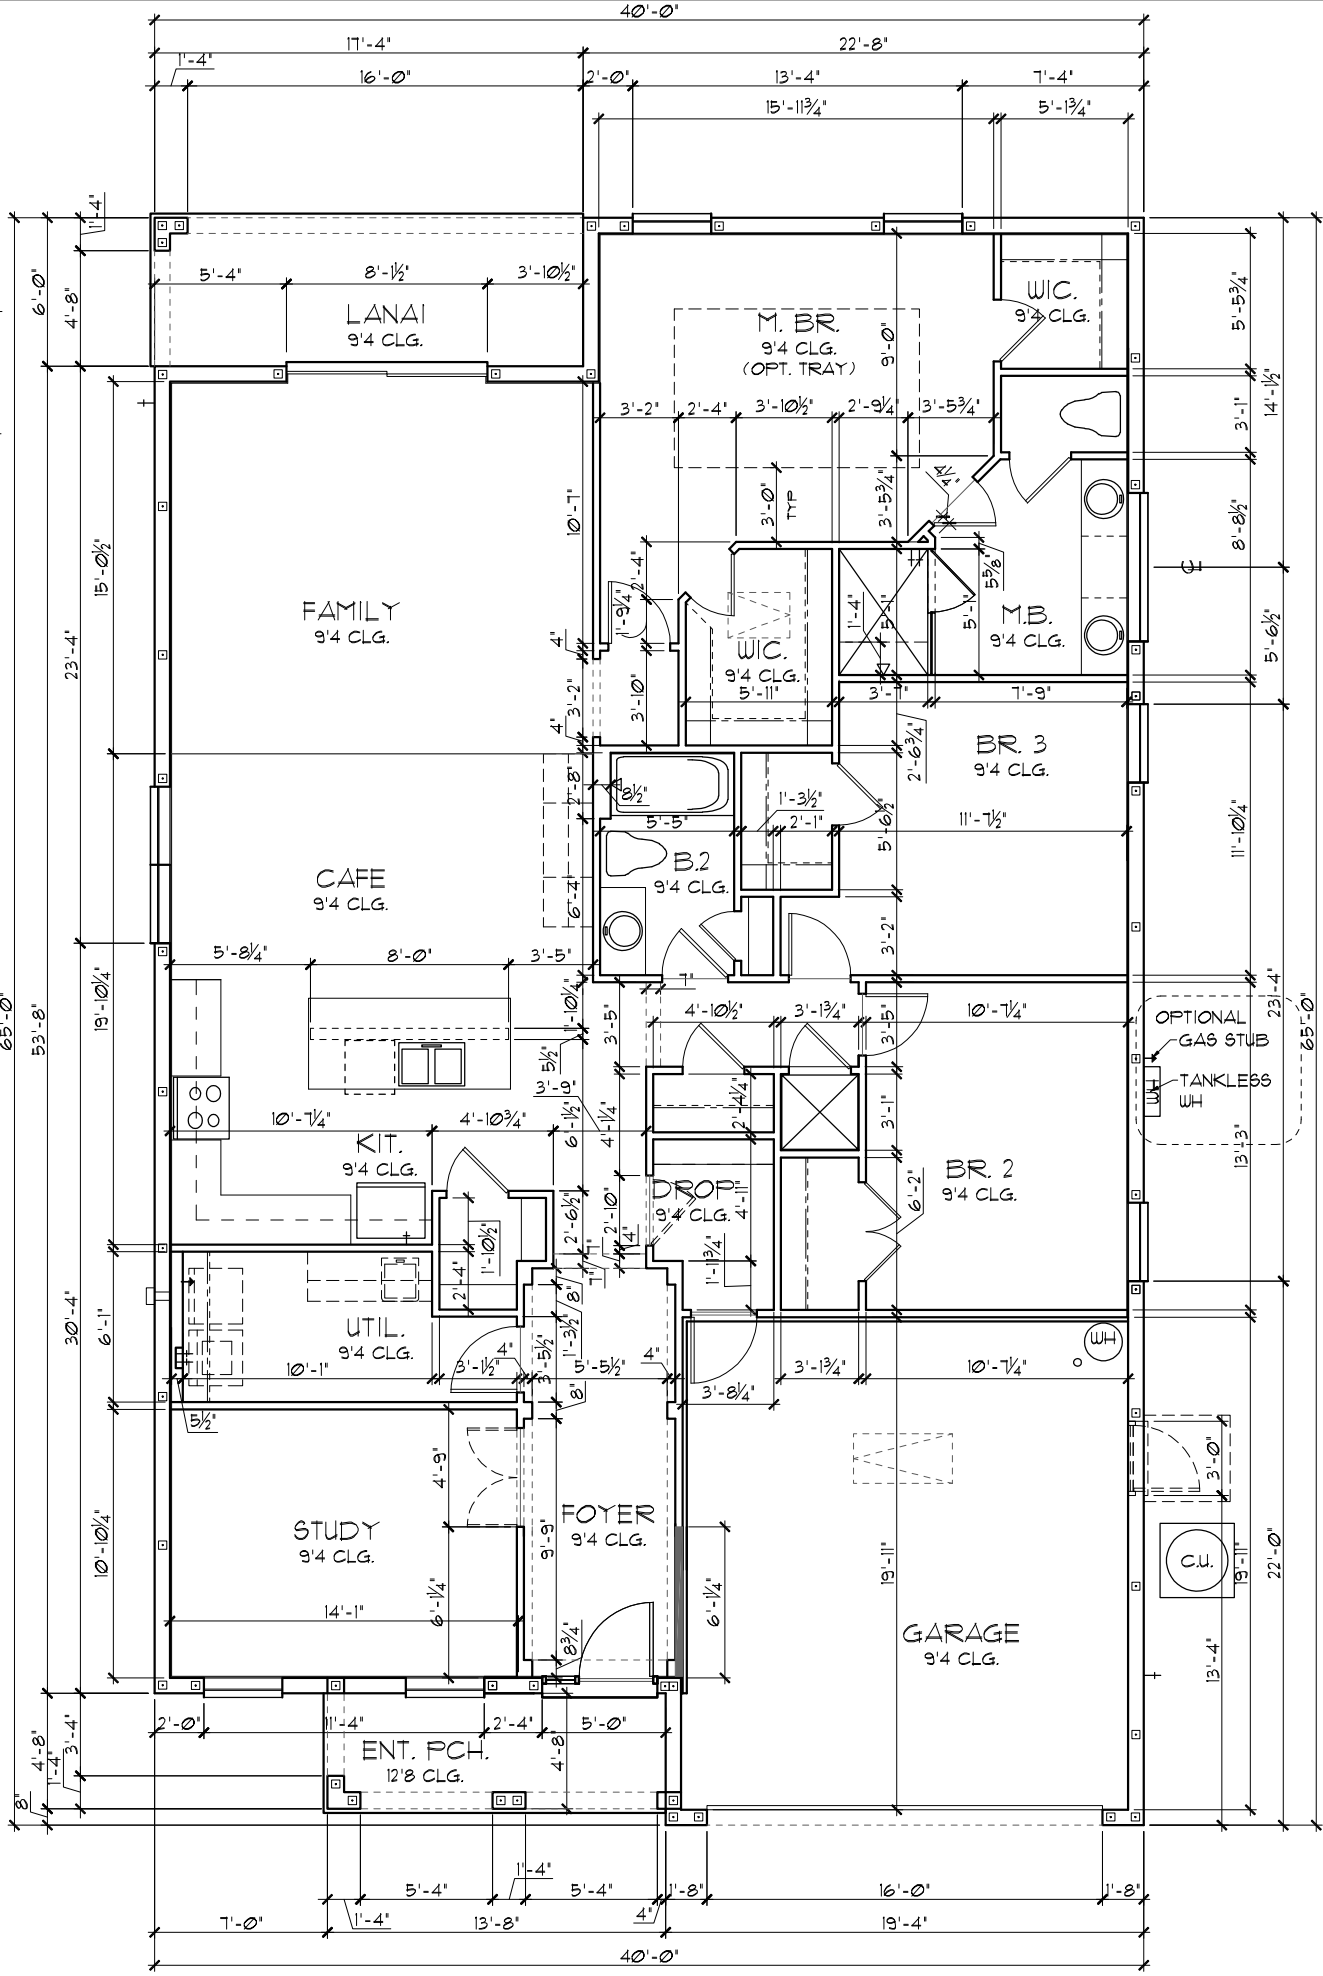

**FLOOR PLAN W/ DIMENSIONS "A"/"B"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

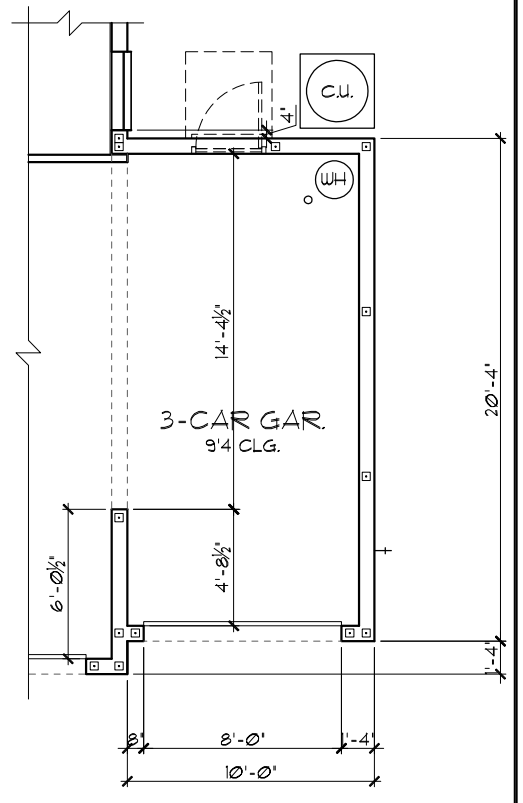

**3-CAR GAR. OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

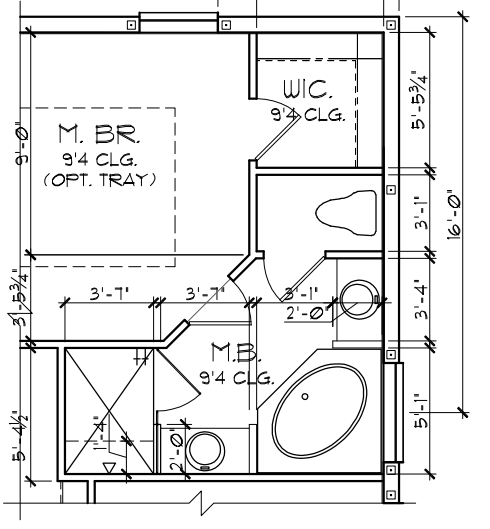

**M.B.A. OPTION**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

FLORIDA SERIES

LOT: 0000, COMMUNITY NAME

© COPYRIGHT 2021 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and design are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

DATE	04-05-2017
SCALE	AS NOTED
DRAWN	RDC
JOB	N/A
SHEET	
02AB.0	
OF 00 SHEETS	

1966  
MARGATE II

FLOOR PLAN W/ DIMENSIONS  
EXTENDED FOYER

**Park Square HOMES**






A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vneiland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 529-3000

**ITEG**  
HARRISON ENGINEERING GROUP, INC.  
10000 W. Colonial Ave., Suite 100  
Orlando, FL 32817  
Tel: (407) 734-1400  
Fax: (407) 734-1790  
www.iteg.com

REVISIONS	BY
05-16-19	JF

TABULATION	
TOTAL LIVING	1,914 SF.
GARAGE	385 SF.
ENTRY PORCH	90 SF.
LANAI	104 SF.
TOTAL UNDER ROOF	2,553 SF.
OPT. 3-CAR GARAGE	203 SF.
TOTAL UNDER ROOF	2,756 SF.

- GENERAL NOTES**
- CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3/2" UNLESS NOTED OTHERWISE.
  - ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1 1/2" UNLESS NOTED OTHERWISE.
  - FULL ALL DIMENSIONS FROM THE REAR OF PLAN.

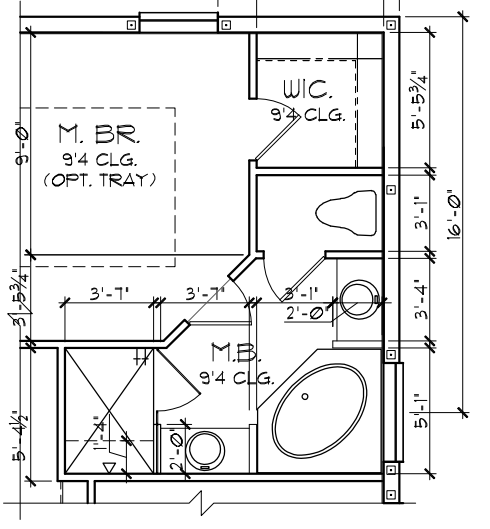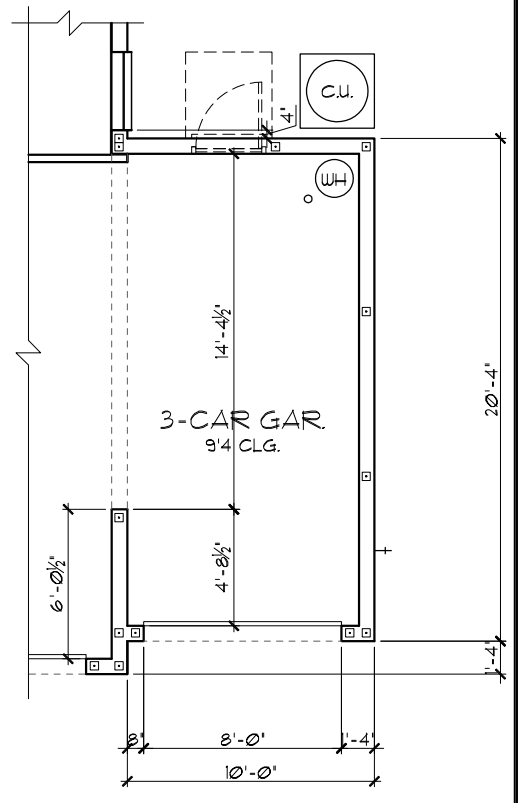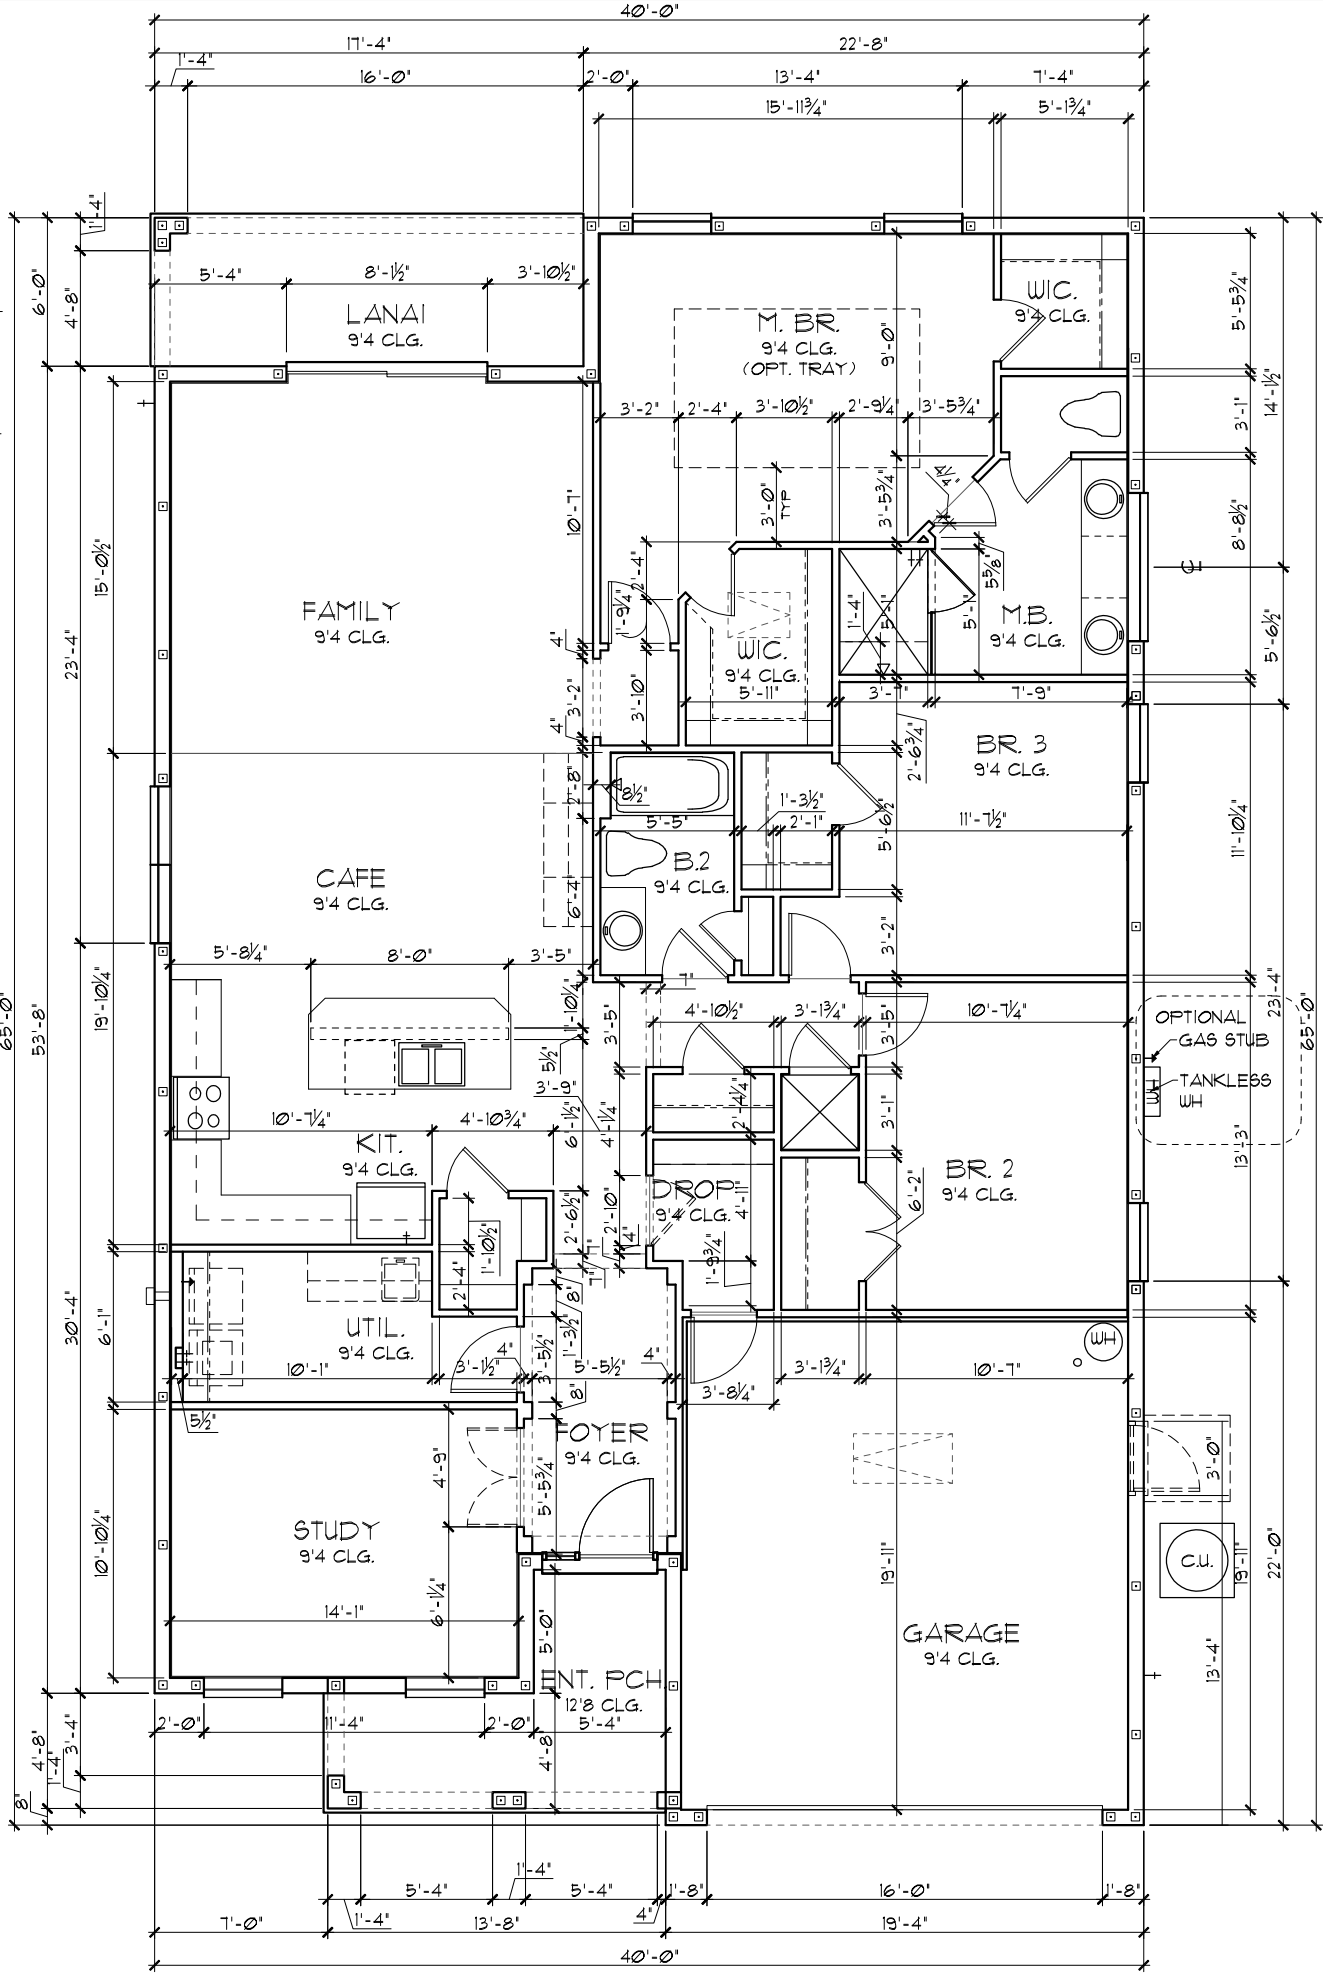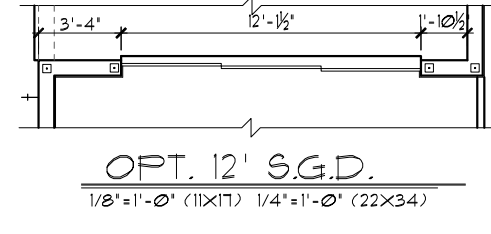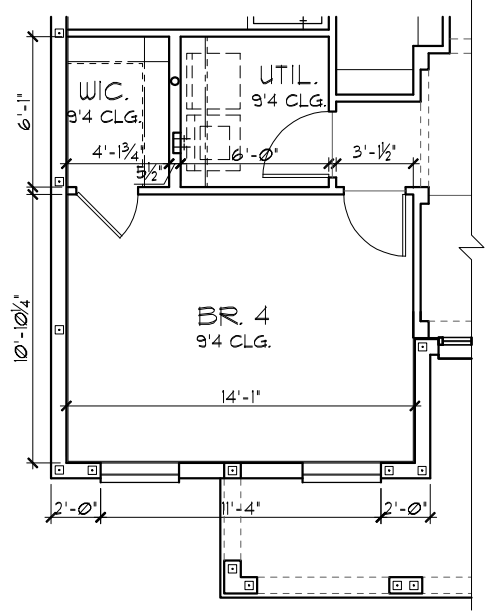

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2003 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

FLORIDA SERIES

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET  
02AB0  
OF 00 SHEETS

1966  
MARGATE II

FLOOR PLAN W/ DIMENSIONS

Park Square HOMES


A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 529-3000

ITEG  
HARRISON ENGINEERING GROUP, INC.  
10000 Lake Nona Blvd., Suite 100  
Orlando, FL 32817  
Tel: (407) 734-1400  
Fax: (407) 734-1700  
www.iteg.com

REVISIONS	BY
05-16-19	JF


TABULATION	
TOTAL LIVING	1,914 SF.
GARAGE	385 SF.
ENTRY PORCH	90 SF.
LANAI	104 SF.
TOTAL UNDER ROOF	2,553 SF.
OPT. 3-CAR GARAGE	203 SF.
TOTAL UNDER ROOF	2,756 SF.

- GENERAL NOTES**
- CONTRACTOR TO VERIFY ALL DIMENSIONS ON JOB SITE.
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - ALL INTERIOR FRAME WALL DIMENSIONS TO BE 3/2" UNLESS NOTED OTHERWISE.
  - ALL EXTERIOR BLOCK WALL DIMENSIONS TO BE 1 1/2" UNLESS NOTED OTHERWISE.
  - FULL ALL DIMENSIONS FROM THE REAR OF PLAN.

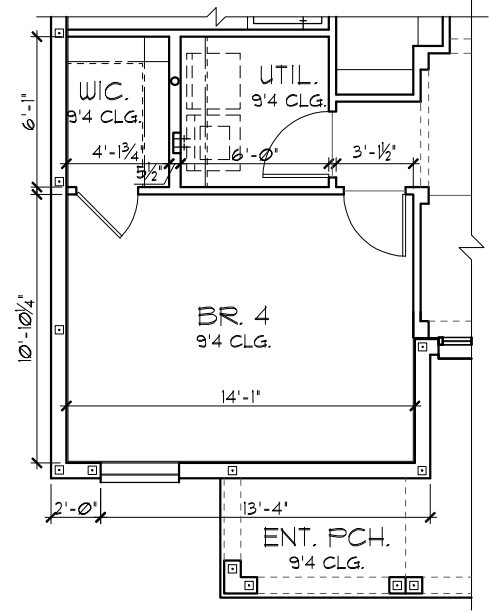


**BEDROOM 4 OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**FLOOR PLAN W/ DIMENSIONS "C"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

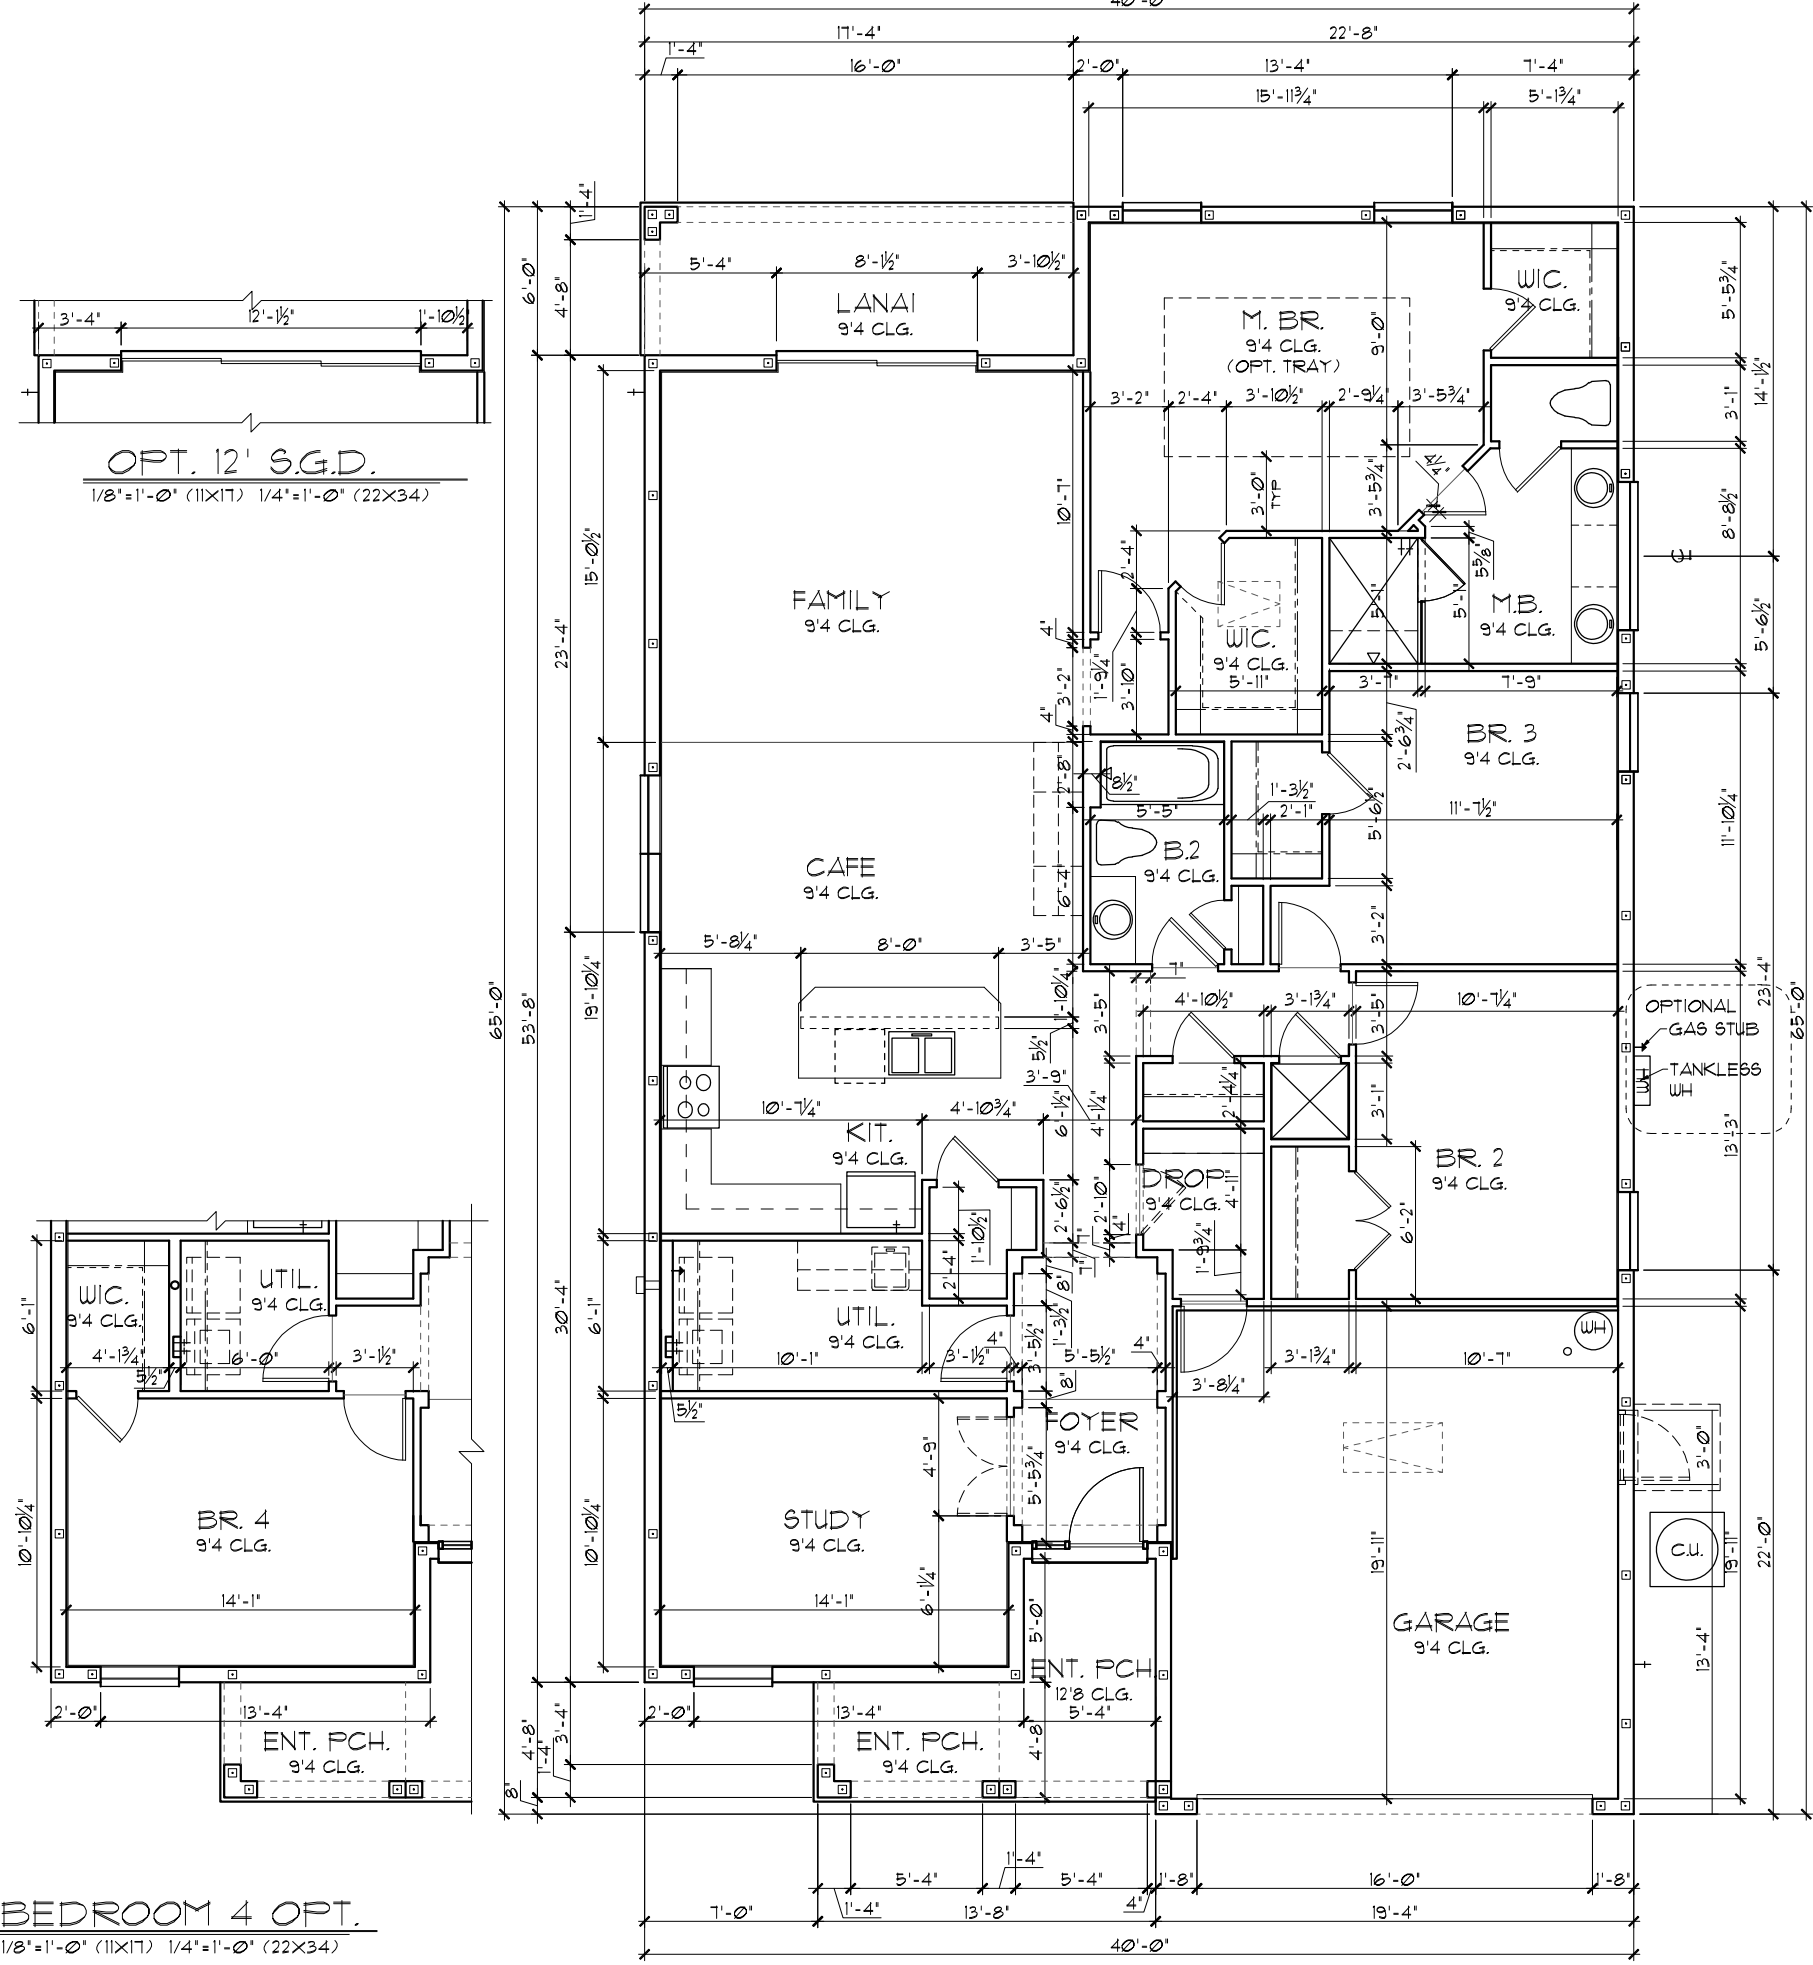


**OPT. 12' S.G.D.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

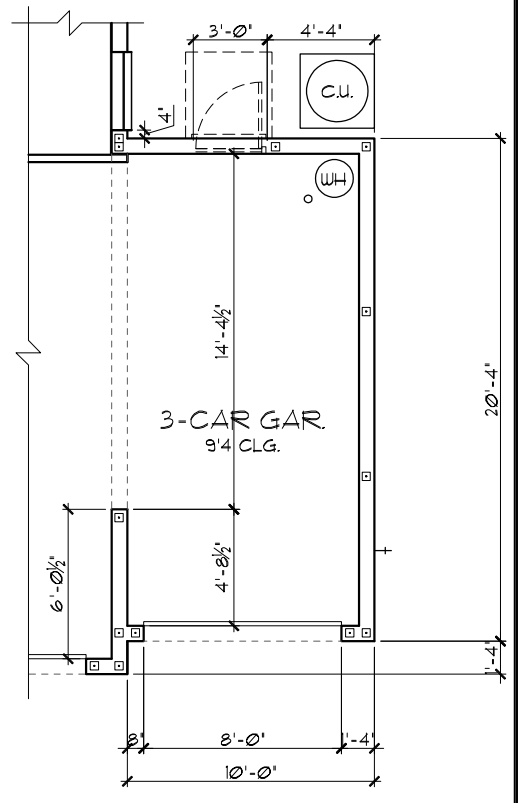

**3-CAR GAR. OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**M. B.A. OPTION**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

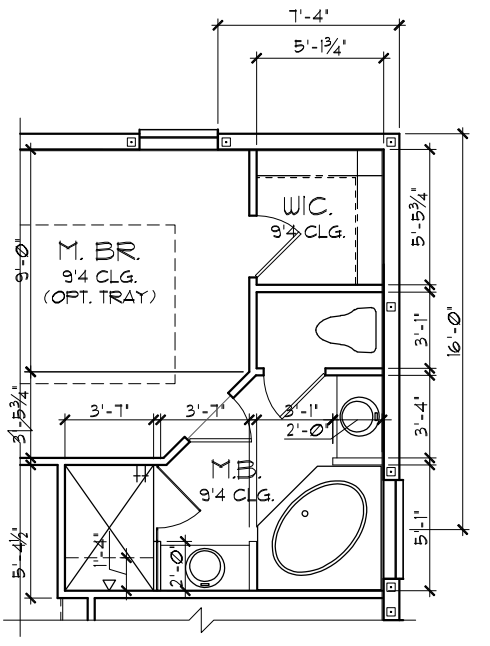

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2003 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME: **FLORIDA SERIES**

1966  
MARGATE II

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET

02C.0  
OF 00 SHEETS

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 529-3000

**Park Square HOMES**

REVISIONS BY  
05-16-19 JF

**ITEG**  
PROFESSIONAL ENGINEERING GROUP, INC.  
10000 South Orange Avenue, Suite 100  
Orlando, FL 32837  
Tel: (407) 734-1400  
Fax: (407) 734-1700  
www.iteg.com





**LOAD INFORMATION**  
PER 8TH EDITION, 2023 FLORIDA BUILDING RESIDENTIAL CODE

**DEAD LOADS**

FLOOR: STRUCTURE	1 PSF
CEILINGS	3 PSF
MECH/ELEC	5 PSF
PARTITIONS	5 PSF
<b>TOTAL</b>	<b>20 PSF</b>

**ROOF: SHEATHING** 5 PSF  
**STRUCTURE** 1 PSF  
**CEILINGS** 3 PSF  
**MECH/ELEC** 5 PSF  
**TOTAL** 20 PSF

**FLOOR LIVE LOADS**

RESIDENTIAL FLOOR:	40 PSF
UNINHABITABLE ATTIC WITHOUT STORAGE:	10 PSF
UNINHABITABLE ATTIC W/LIMITED STORAGE:	20 PSF
ROOMS OTHER THAN SLEEPING ROOM:	40 PSF
SLEEPING ROOM:	30 PSF
STAIR LIVE LOAD:	40 PSF
BALCONIES:	40 PSF
PASSANGER VEHICLE GARAGE:	50 PSF

**ROOF LIVE LOADS**

MINIMUM ROOF LIVE LOAD (PSF) TRIBUTARY LOADED AREA (SQ. FT.) FOR ANY STRUCTURAL MEMBER			
ROOF SLOPE	0-200	201-600	OVER 600
0-12 < 4:12	20	16	12
≥ 4:12 < 12:12	16	14	12
≥ 12:12	12	12	12

**WIND INFORMATION**  
PER 8TH EDITION, 2023 FLORIDA BUILDING RESIDENTIAL CODE

- BASIC WIND SPEED: 140 MPH
- RISK CATEGORY: II
- WIND EXPOSURE: B
- BUILDING TYPE: V B
- ENCLOSURE CLASSIFICATION +/- .18, INCLUDED INTERNAL PRESSURE IN NOTE #6 COEFFICIENT:
- COMPONENT / CLADDING: SEE PLAN DESIGN WIND PRESSURE:

+ XXX DESIGN WIND PRESSURE IAW FLA  
- XXX RESIDENTIAL CODE, SECTION R301


NOTE: DESIGN PRESSURES BASED ON BASIC WIND SPEED AND NOT ULTIMATE WIND SPEED.

- GENERAL NOTES**
- PROVIDE RECESS HOT & COLD WATER WITH DRAIN @ WASHER SPACE.
  - VENT DRYER THRU ROOF.
  - PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - MECHANICAL EQUIPMENT LOCATION TO BE DETERMINED BY COMMUNITY STANDARDS AND APPLICABLE COUNTY CODES.
  - |  |   |
|--|---|
|  | DENOTES CONC. BLOCK WALL HGT. @ 9'-4" AFF.  |
|  | DENOTES CONC. BLOCK WALL HGT. @ 12'-8" AFF. |
  - REFER TO TYPICAL DETAIL SHEET FOR EXTERIOR WALL FINISH SPECIFICATIONS
  - REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES
  - ANCHOR THE CONDENSER UNIT TO SLAB PER CODE: M 1307.1 - M1307.2
  - ALL INTER. FIRST FLOOR CEILINGS AT 9'-4" UNLESS NOTED OTHERWISE.
  - ALL INTER. SECOND FLOOR CEILINGS AT N/A UNLESS NOTED OTHERWISE.

NOTE: 1. DOOR FROM HOUSE TO GARAGE MUST BE SOLID WOOD DOOR NO LESS THAN 1 3/8" IN THICKNESS, SOLID OR HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1 3/8" THICK, OR 20MIN. FIRE RATED IAW R302.5.1



**EERO - R310.2.1 - FBCR2023**

SH25	NET CLEAR OPNG. HEIGHT 32' X NET CLEAR OPNG. WIDTH 21 1/2' = 6.119 SQFT	NET CLEAR OPNG. OF NOT LESS THAN 5.7 SQFT MIN. NET CLEAR OPNG. HEIGHT DIMENSION SHALL BE 24'. THE MIN. NET CLEAR OPNG. WIDTH DIMENSION SHALL BE 20'. MIN. NET CLEAR OPNG. FOR GRADE-FLOOR EMERGENCY ESCAPE AND RESCUE OPNG. SHALL BE - 5 SQFT
SH25	63" H. X 31" W. WDW SIZE	

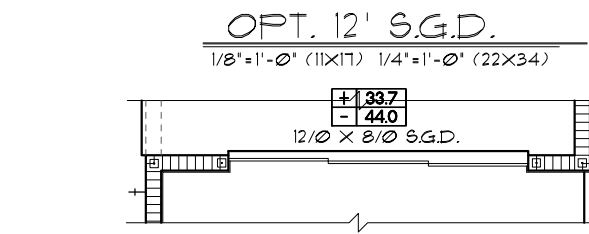


NOTE:

- ALL EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE THE BOTTOM OF THE CLEAR OPENING NOT MORE THAN 44" MIN. AFF. - R310.2 - FBCR (2023)
- IN DWELLING UNITS, WHERE THE BOTTOM OF THE CLEAR OPENING OF AN OPERABLE WINDOW OPENING IS LOCATED LESS THAN 24" ABOVE FINISH FLOOR AND GREATER THAN 12" FINISHED GRADE MUST COMPLY WITH FBCR 312.2

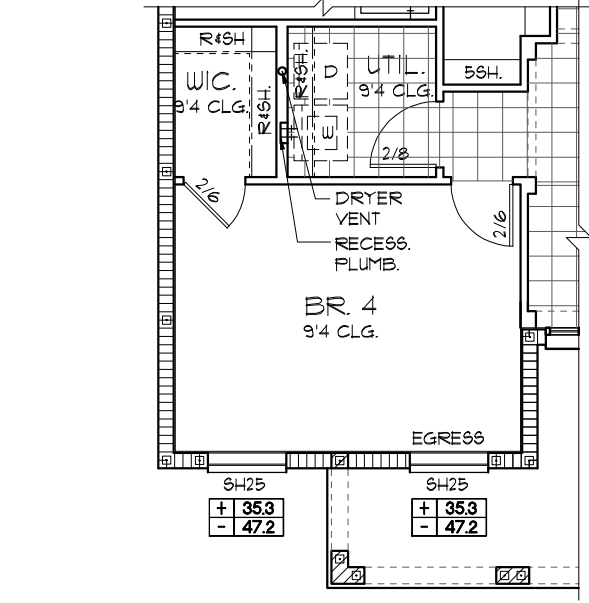
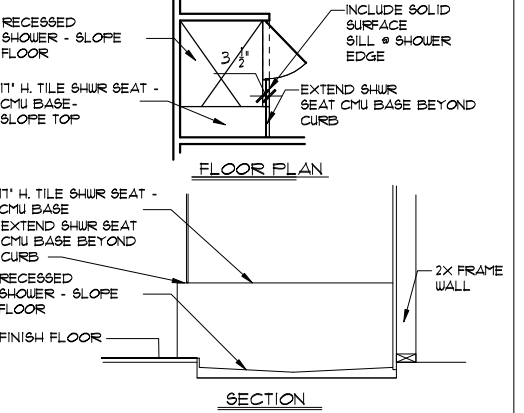


**FLOOR PLAN W/ NOTES "A"/"B"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

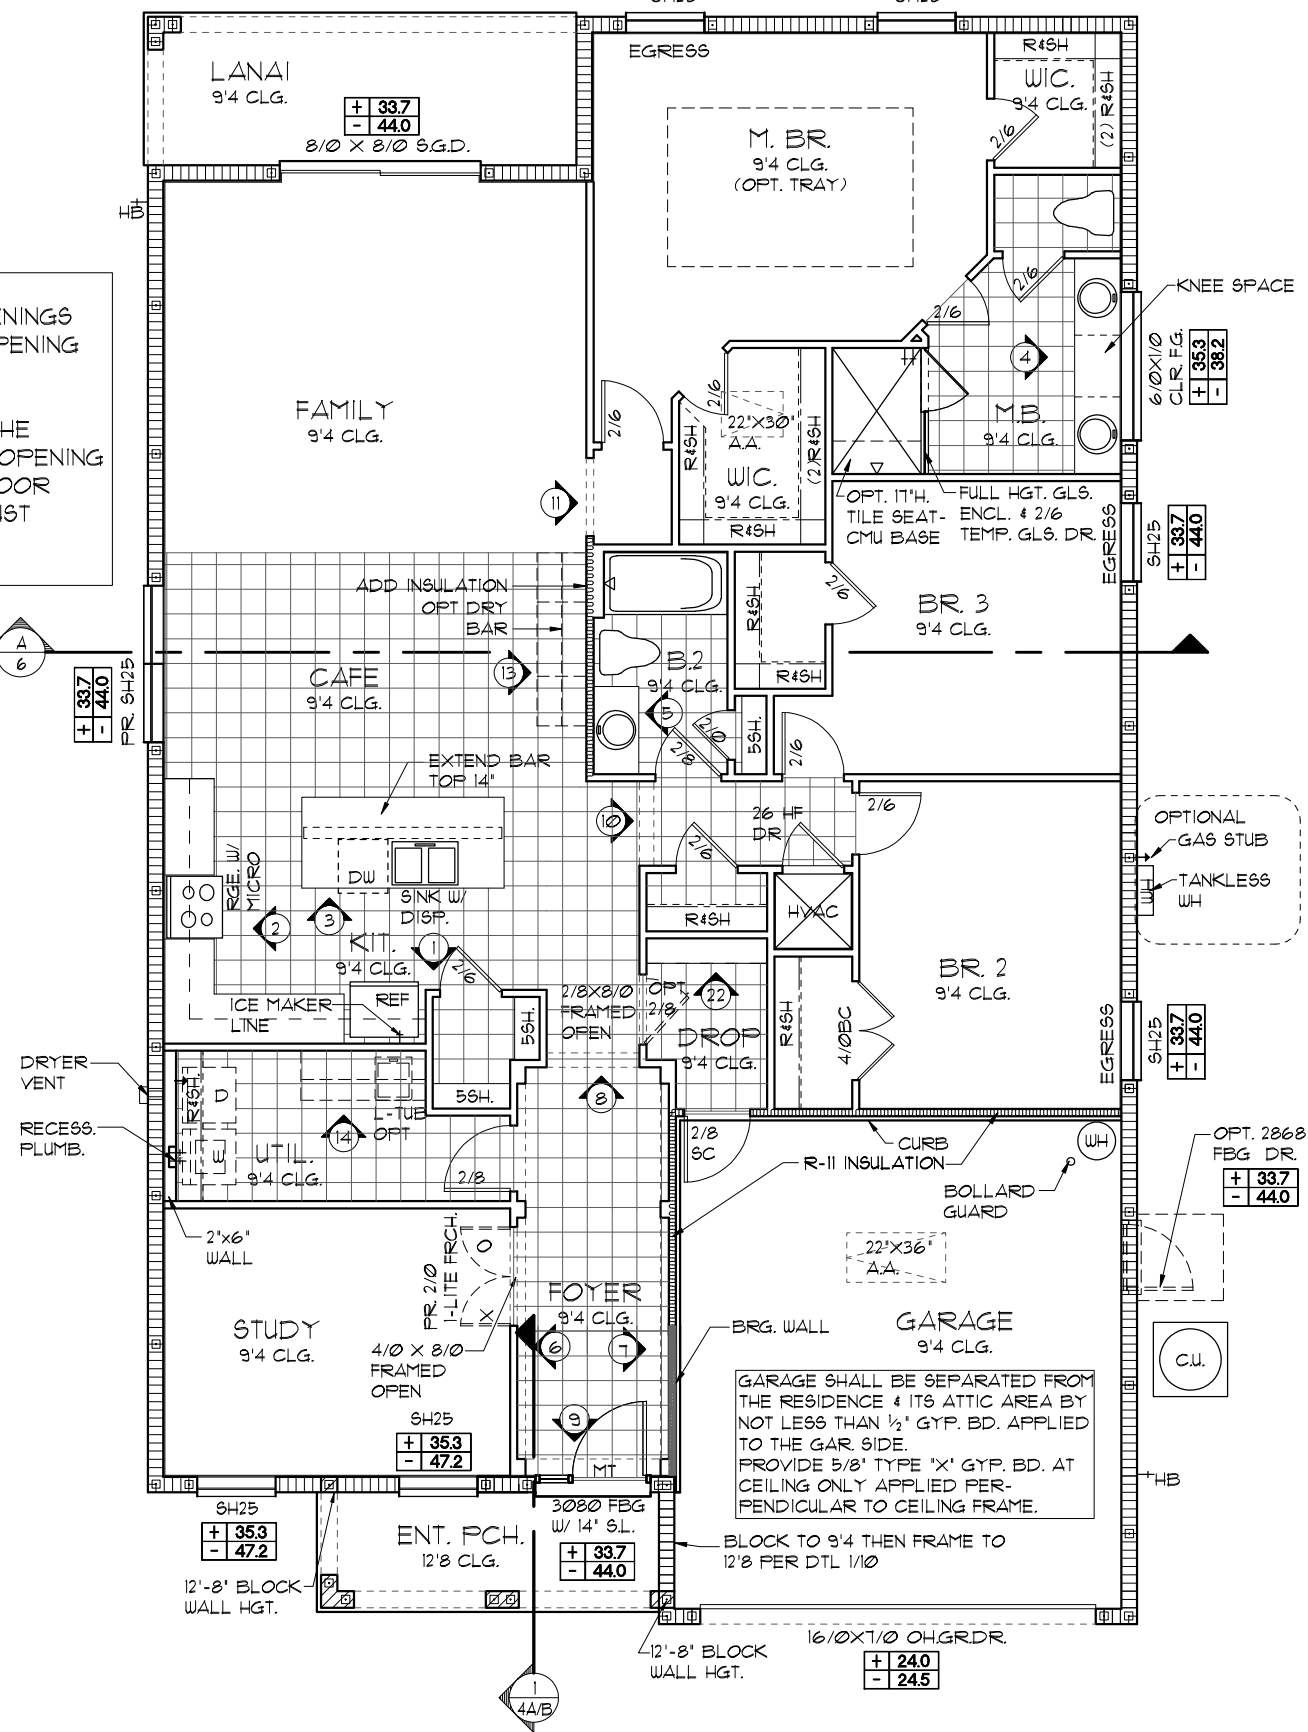

GARAGE SHALL BE SEPARATED FROM THE RESIDENCE & ITS ATTIC AREA BY NOT LESS THAN 1/2" GYP. BD. APPLIED TO THE GAR. SIDE. PROVIDE 5/8" TYPE 'X' GYP. BD. AT CEILING ONLY APPLIED PERPENDICULAR TO CEILING FRAME.

NOTE: SEE COLOR SHEET FOR INTERIOR DOOR HEIGHT REQUIREMENTS

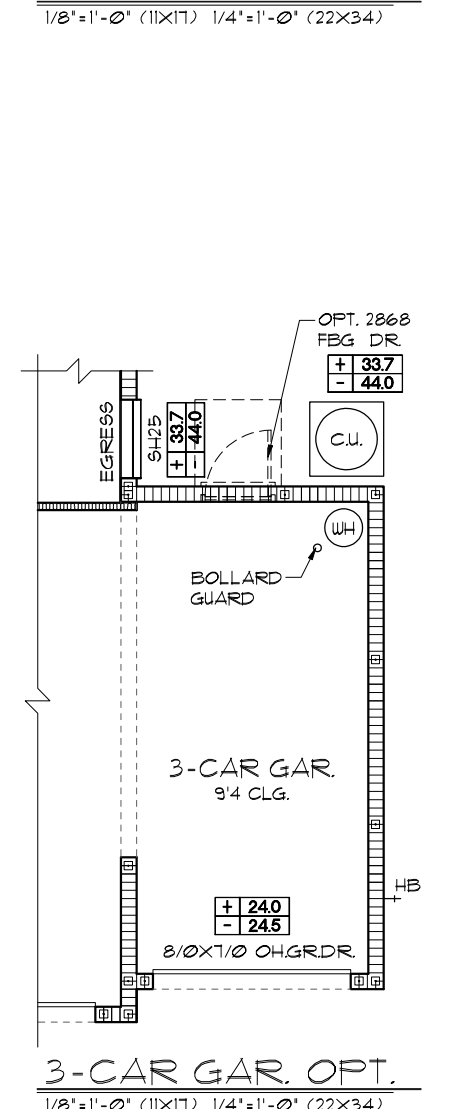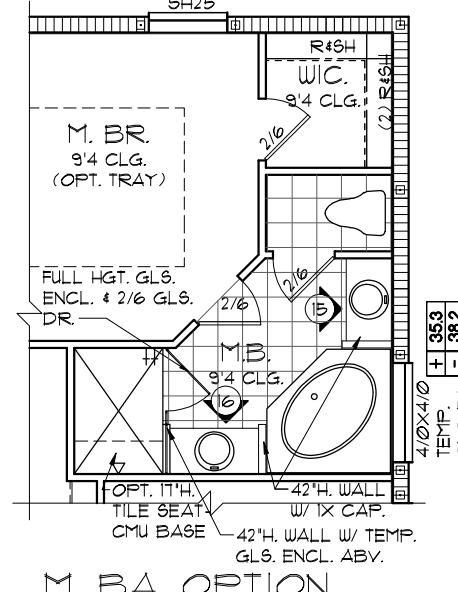

NOTE: SEE FINAL COLOR SHEET FOR FLOORING INFO

**FLORIDA SERIES**

LOT: 0000, COMMUNITY NAME: MARGATE II

1966

FLOOR PLAN W/ NOTES EXTENDED FOYER

DATE 04-05-2017

SCALE AS NOTED

DRAWN RDC

JOB N/A

SHEET 03AB OF 00 SHEETS

REVISIONS BY

05-16-19	JF
----------	----

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vlneland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 528-3000

FLORIDA SERIES  
PARK SQUARE HOMES

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

© COPYRIGHT 2017 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and designs. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

**LOAD INFORMATION**  
PER 8TH EDITION, 2023 FLORIDA BUILDING RESIDENTIAL CODE

**DEAD LOADS**

FLOOR: STRUCTURE	1 PSF
CEILINGS	3 PSF
MECH/ELEC	5 PSF
PARTITIONS	5 PSF
<b>TOTAL</b>	<b>20 PSF</b>

**ROOF: SHEATHING** 5 PSF  
**STRUCTURE** 1 PSF  
**CEILINGS** 3 PSF  
**MECH/ELEC** 5 PSF  
**TOTAL** 20 PSF

**FLOOR LIVE LOADS**

RESIDENTIAL FLOOR:	40 PSF
UNINHABITABLE ATTIC WITHOUT STORAGE:	10 PSF
UNINHABITABLE ATTIC W/LIMITED STORAGE:	20 PSF
ROOMS OTHER THAN SLEEPING ROOM:	40 PSF
SLEEPING ROOM:	30 PSF
STAIR LIVE LOAD:	40 PSF
BALCONIES:	40 PSF
PASSANGER VEHICLE GARAGE:	50 PSF

**ROOF LIVE LOADS**

MINIMUM ROOF LIVE LOAD (PSF) TRIBUTARY LOADED AREA (SQ. FT.) FOR ANY STRUCTURAL MEMBER			
ROOF SLOPE	0-200	201-600	OVER 600
0:12 < 4:12	20	16	12
≥ 4:12 < 12:12	16	14	12
≥ 12:12	12	12	12

**WIND INFORMATION**  
PER 8TH EDITION, 2023 FLORIDA BUILDING RESIDENTIAL CODE


- BASIC WIND SPEED: 140 MPH
- RISK CATEGORY: II
- WIND EXPOSURE: B
- BUILDING TYPE: V B
- ENCLOSURE CLASSIFICATION +/- 10, INCLUDED INTERNAL PRESSURE IN NOTE #6 COEFFICIENT:
- COMPONENT / CLADDING: SEE PLAN DESIGN WIND PRESSURE:

+ XXX	DESIGN WIND PRESSURE IAW FLA
- XXX	RESIDENTIAL CODE, SECTION R302

NOTE: DESIGN PRESSURES BASED ON BASIC WIND SPEED AND NOT ULTIMATE WIND SPEED.



- GENERAL NOTES**
- PROVIDE RECESS HOT & COLD WATER WITH DRAIN @ WASHER SPACE.
  - VENT DRYER THRU ROOF.
  - PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - MECHANICAL EQUIPMENT LOCATION TO BE DETERMINED BY COMMUNITY STANDARDS AND APPLICABLE COUNTY CODES.
  - |           |   |
|-----------|---|
| [Pattern] | DENOTES CONC. BLOCK WALL HGT. @ 9'-4" AFF.  |
| [Pattern] | DENOTES CONC. BLOCK WALL HGT. @ 12'-8" AFF. |
  - REFER TO TYPICAL DETAIL SHEET FOR EXTERIOR WALL FINISH SPECIFICATIONS
  - REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES
  - ANCHOR THE CONDENSER UNIT TO SLAB PER CODE: M 1307.1 - M 1307.2
  - ALL INTER. FIRST FLOOR CEILINGS AT 9'-4" UNLESS NOTED OTHERWISE.
  - ALL INTER. SECOND FLOOR CEILINGS AT N/A UNLESS NOTED OTHERWISE.

NOTE: 1. DOOR FROM HOUSE TO GARAGE MUST BE SOLID WOOD DOOR NO LESS THAN 1 3/8" IN THICKNESS, SOLID OR HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1 3/8" THICK, OR 20MIN. FIRE RATED IAW R302.5.1

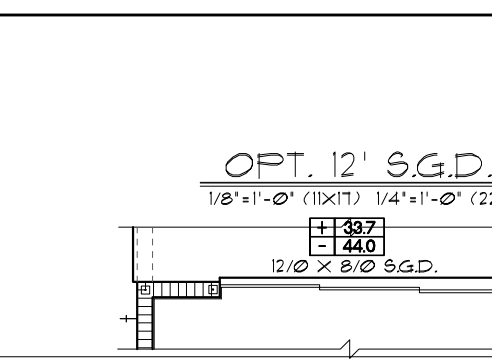











NOTE:

- ALL EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE THE BOTTOM OF THE CLEAR OPENING NOT MORE THAN 44" MIN. AFF. - R310.2 - FBCR (2023)
- IN DWELLING UNITS, WHERE THE BOTTOM OF THE CLEAR OPENING OF AN OPERABLE WINDOW OPENING IS LOCATED LESS THAN 24" ABOVE FINISH FLOOR AND GREATER THAN 12" FINISHED GRADE MUST COMPLY WITH FBCR 312.2

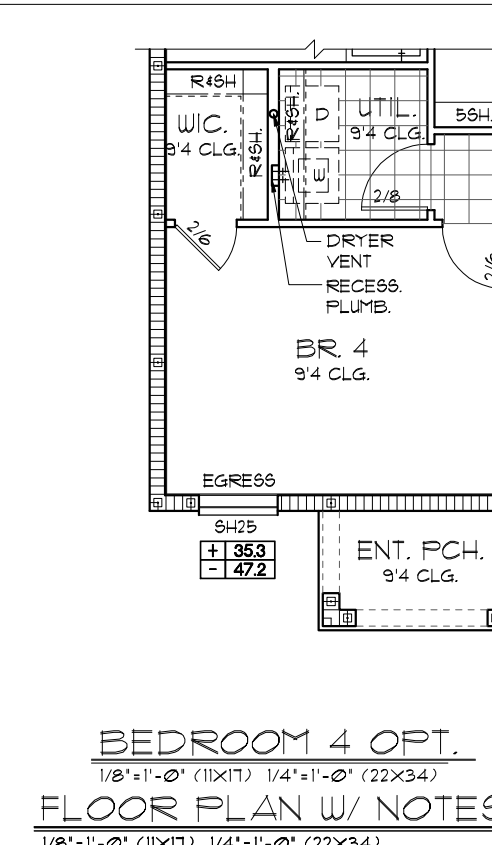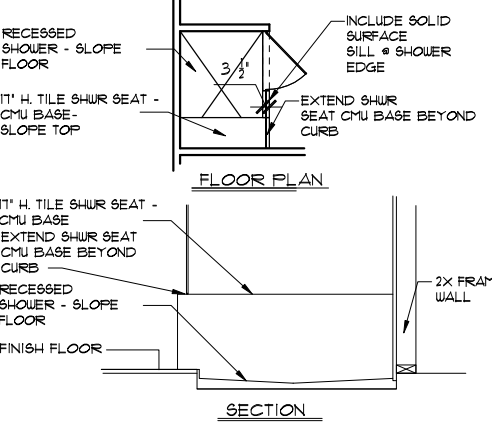

**EERO - R310.2.1 - FBCR2023**

SH25	NET CLEAR OPNG. HEIGHT 32' X NET CLEAR OPNG. WIDTH 21 1/2' = 6.119 SQFT	NET CLEAR OPENING OF NOT LESS THAN 5.7 SQFT
SH25	63" H. X 31" W. WDW SIZE	MIN. NET CLEAR OPNG. HEIGHT DIMENSION SHALL BE 24". THE MIN. NET CLEAR OPNG. WIDTH DIMENSION SHALL BE 20".

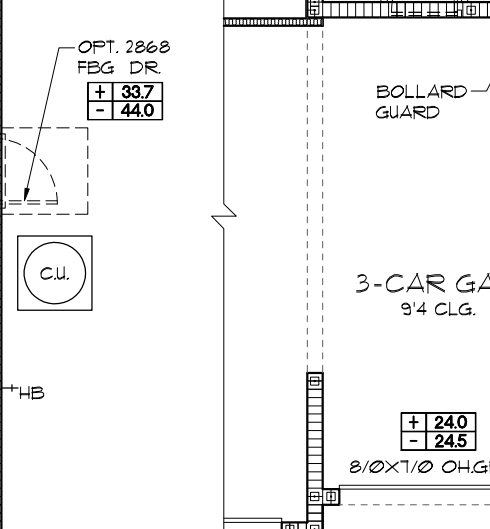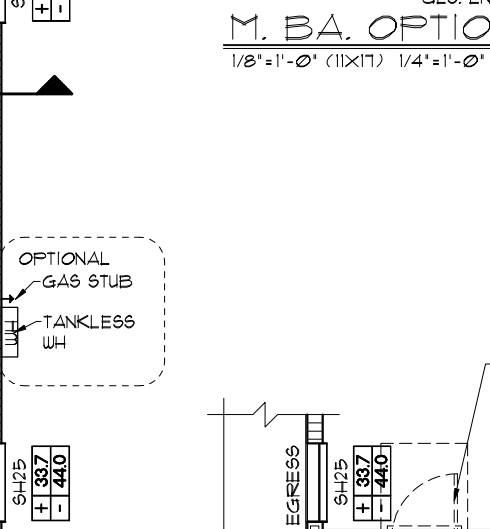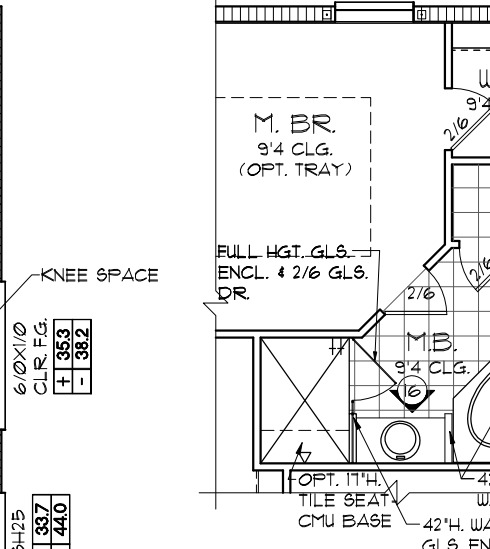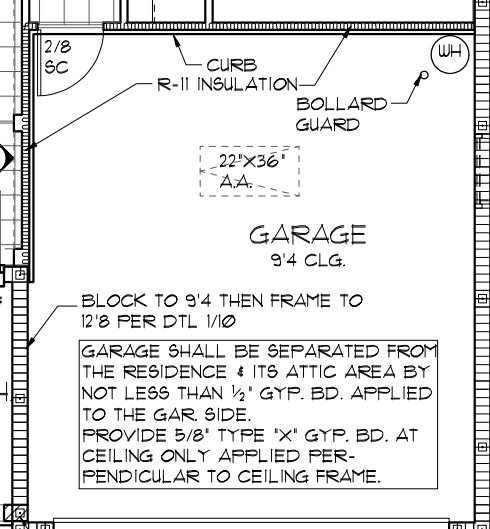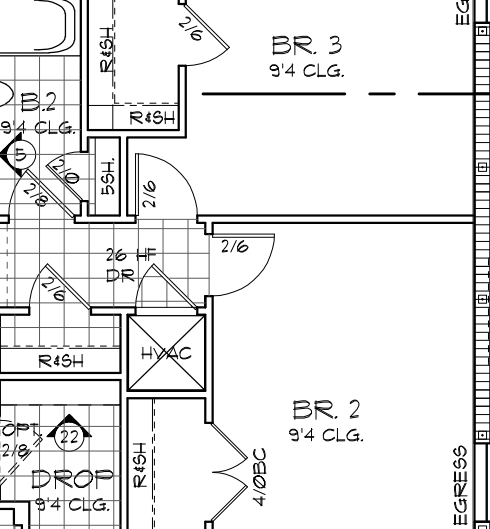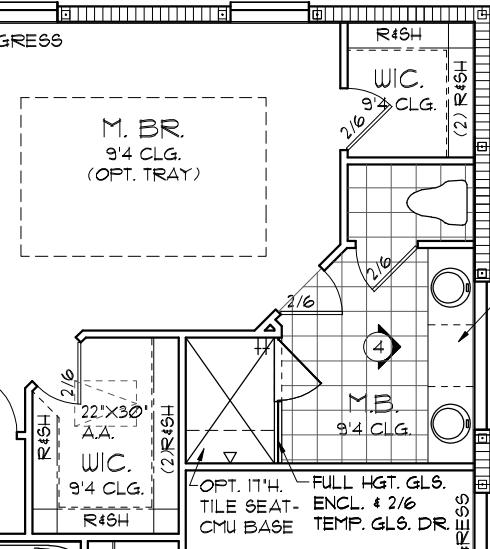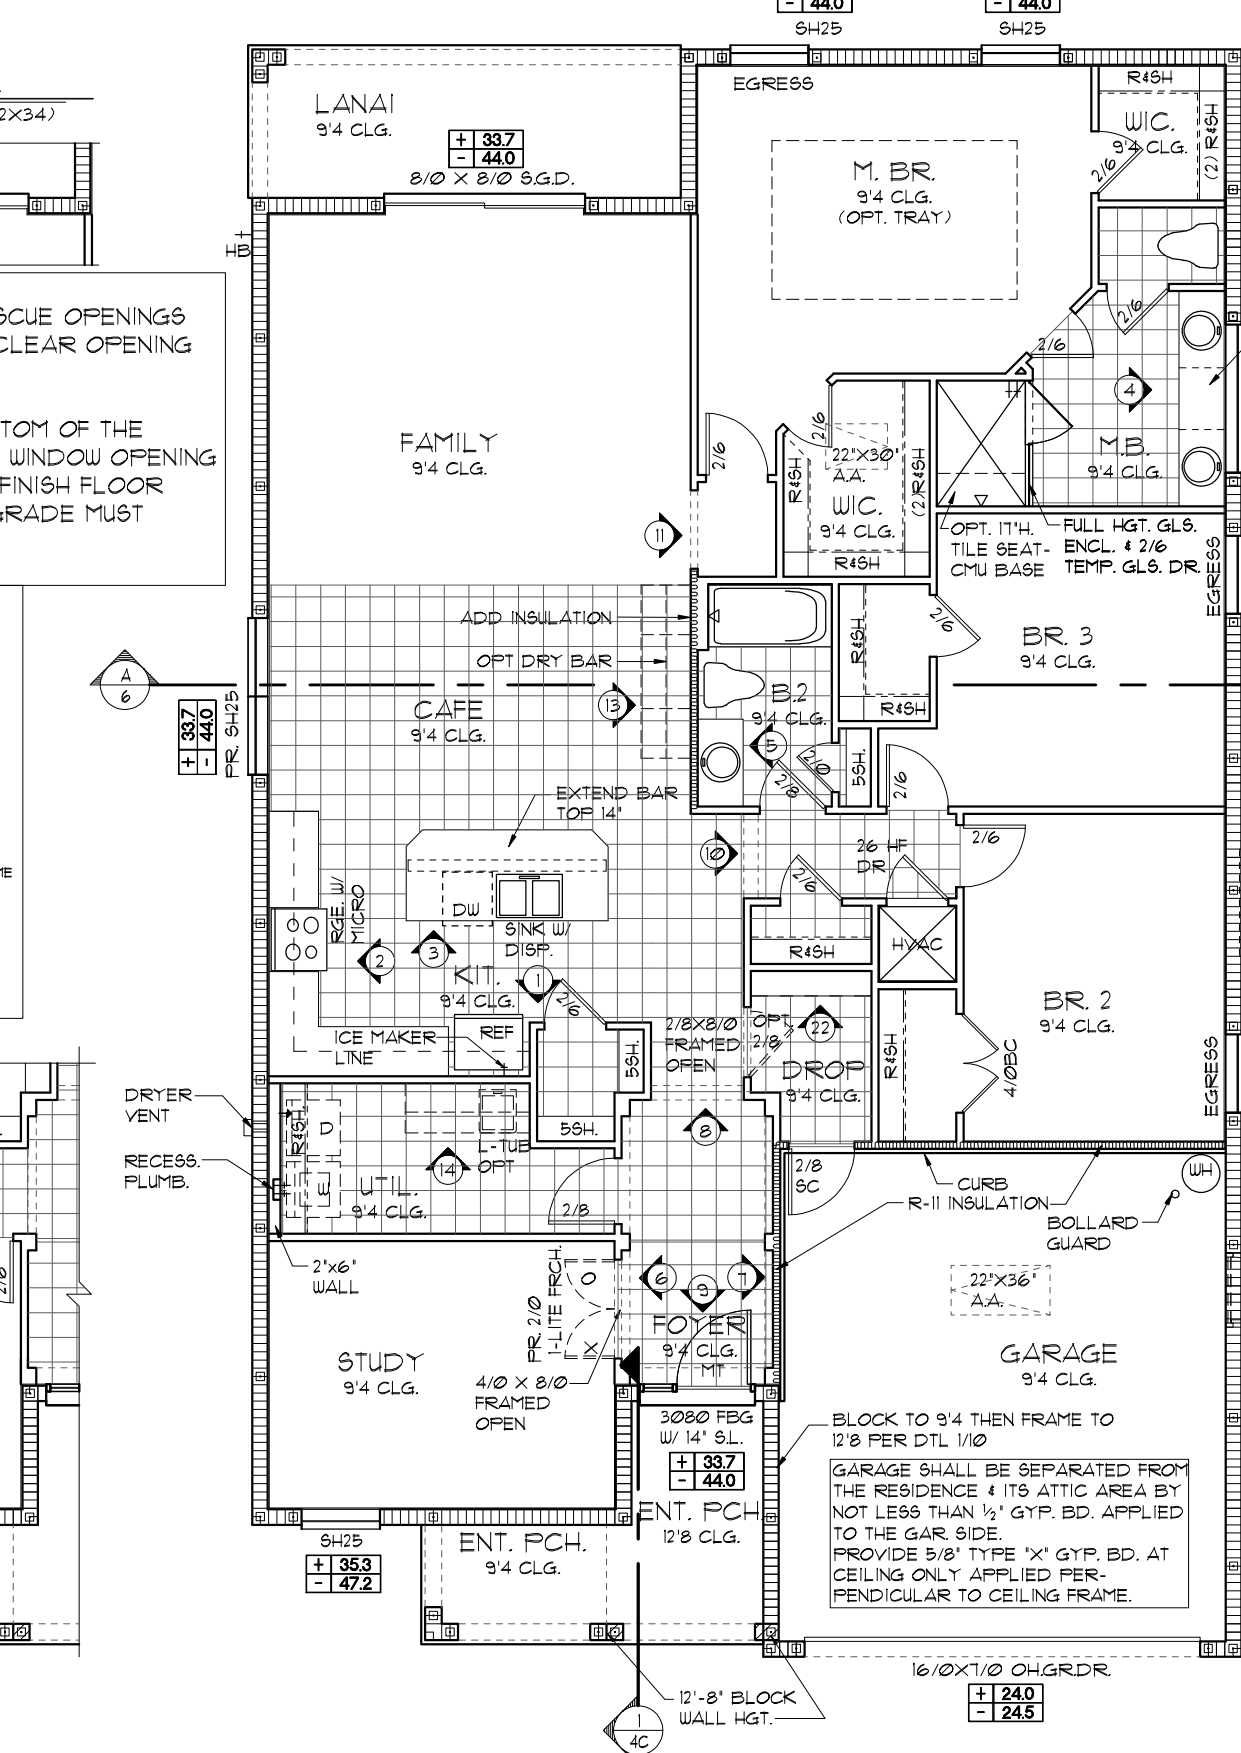

NOTE: SEE COLOR SHEET FOR INTERIOR DOOR HEIGHT REQUIREMENTS

NOTE: SEE FINAL COLOR SHEET FOR FLOORING INFO

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

**FLORIDA SERIES**

**ITEG**  
INTERTECH ENGINEERING GROUP, INC.  
10000 W. BIRCHWOOD BLVD., SUITE 200  
ORLANDO, FLORIDA 32817  
TEL: (407) 734-1400  
WWW.ITEG.COM

**Park Square HOMES**  
A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32817  
Phone: (407) 529-3000

**FLOOR PLAN W/ NOTES**

1966 MARGATE II

REVISIONS	BY
05-16-19	JF

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET 03C OF 00 SHEETS

**LOAD INFORMATION**  
PER 8TH EDITION, 2023 FLORIDA BUILDING RESIDENTIAL CODE

**DEAD LOADS**

FLOOR: STRUCTURE	1 PSF
CEILINGS	3 PSF
MECH/ELEC	5 PSF
PARTITIONS	5 PSF
TOTAL	20 PSF

**ROOF: SHEATHING** 5 PSF  
**STRUCTURE** 1 PSF  
**CEILINGS** 3 PSF  
**MECH/ELEC** 5 PSF  
**TOTAL** 20 PSF

**FLOOR LIVE LOADS**

RESIDENTIAL FLOOR:	40 PSF
UNINHABITABLE ATTIC WITHOUT STORAGE:	10 PSF
UNINHABITABLE ATTIC W/LIMITED STORAGE:	20 PSF
ROOMS OTHER THAN SLEEPING ROOM:	40 PSF
SLEEPING ROOM:	30 PSF
STAIR LIVE LOAD:	40 PSF
BALCONIES:	40 PSF
PASSANGER VEHICLE GARAGE:	50 PSF

**ROOF LIVE LOADS**

MINIMUM ROOF LIVE LOAD (PSF) TRIBUTARY LOADED AREA (SQ. FT.) FOR ANY STRUCTURAL MEMBER			
ROOF SLOPE	0-200	201-600	OVER 600
0:12 < 4:12	20	16	12
≥ 4:12 < 12:12	16	14	12
≥ 12:12	12	12	12

**WIND INFORMATION**  
PER 8TH EDITION, 2023 FLORIDA BUILDING RESIDENTIAL CODE

- BASIC WIND SPEED: 140 MPH
- RISK CATEGORY: II
- WIND EXPOSURE: B
- BUILDING TYPE: V B
- ENCLOSURE CLASSIFICATION +/- 18, INCLUDED INTERNAL PRESSURE IN NOTE #6 COEFFICIENT:
- COMPONENT / CLADDING: SEE PLAN DESIGN WIND PRESSURE:

+ XXX	DESIGN WIND PRESSURE IAW FLA
- XXX	RESIDENTIAL CODE, SECTION R302

NOTE: DESIGN PRESSURES BASED ON BASIC WIND SPEED AND NOT ULTIMATE WIND SPEED.



- GENERAL NOTES**
- PROVIDE RECESS HOT & COLD WATER WITH DRAIN @ WASHER SPACE.
  - VENT DRYER THRU ROOF.
  - PROVIDE COLD WATER LINE FOR ICE MAKER LINE @ REF. SPACE.
  - DO NOT SCALE PRINTS! CONSTRUCTION TO BE FROM CALCULATED DIMENSIONS ONLY. ANY DISCREPANCIES OR ERRORS TO BE REPORTED PROMPTLY TO SUPERVISOR FOR CLARIFICATION.
  - MECHANICAL EQUIPMENT LOCATION TO BE DETERMINED BY COMMUNITY STANDARDS AND APPLICABLE COUNTY CODES.
  - |           |   |
|-----------|---|
| [Pattern] | DENOTES CONC. BLOCK WALL HGT. @ 9'-4" AFF.  |
| [Pattern] | DENOTES CONC. BLOCK WALL HGT. @ 12'-8" AFF. |
  - REFER TO TYPICAL DETAIL SHEET FOR EXTERIOR WALL FINISH SPECIFICATIONS
  - REFER TO DETAIL SHEETS FOR FLASHING REQUIREMENTS AT ALL WOOD TO MASONRY INTERFACES
  - ANCHOR THE CONDENSER UNIT TO SLAB PER CODE: M 1307.1 - M1307.2
  - ALL INTER. FIRST FLOOR CEILINGS AT 9'-4" UNLESS NOTED OTHERWISE.
  - ALL INTER. SECOND FLOOR CEILINGS AT N/A UNLESS NOTED OTHERWISE.

NOTE: 1. DOOR FROM HOUSE TO GARAGE MUST BE SOLID WOOD DOOR NO LESS THAN 1 3/8" IN THICKNESS, SOLID OR HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1 3/8" THICK, OR 20" MIN. FIRE RATED IAW R302.5.1

OPT. 12' S.G.D.  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)  
12/0 X 8/0 S.G.D.



NOTE:

- ALL EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE THE BOTTOM OF THE CLEAR OPENING NOT MORE THAN 44" MIN. AFF. - R310.2 - FBCR (2023)
- IN DWELLING UNITS, WHERE THE BOTTOM OF THE CLEAR OPENING OF AN OPERABLE WINDOW OPENING IS LOCATED LESS THAN 24" ABOVE FINISH FLOOR AND GREATER THAN 12" FINISHED GRADE MUST COMPLY WITH FBCR 312.2

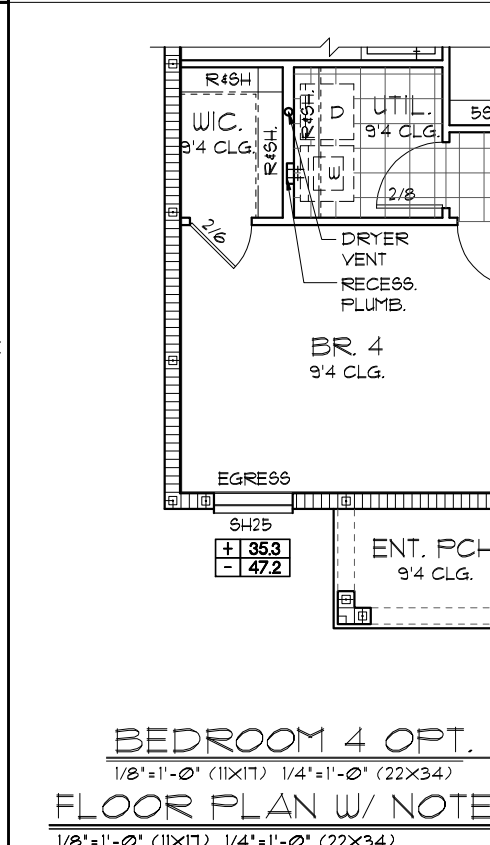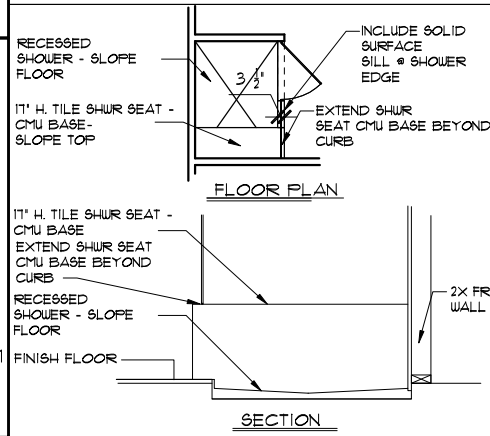

EERO - R310.2.1 - FBCR2023

SH25	NET CLEAR OPNG. HEIGHT 32' X NET CLEAR OPNG. WIDTH 21 1/2' = 6.119 SQFT	NET CLEAR OPNG. OF NOT LESS THAN 5.7 SQFT
SH25	63" H. X 31" W. WDW SIZE	MIN. NET CLEAR OPNG. HEIGHT DIMENSION SHALL BE 24". THE MIN. NET CLEAR OPNG. WIDTH DIMENSION SHALL BE 20".

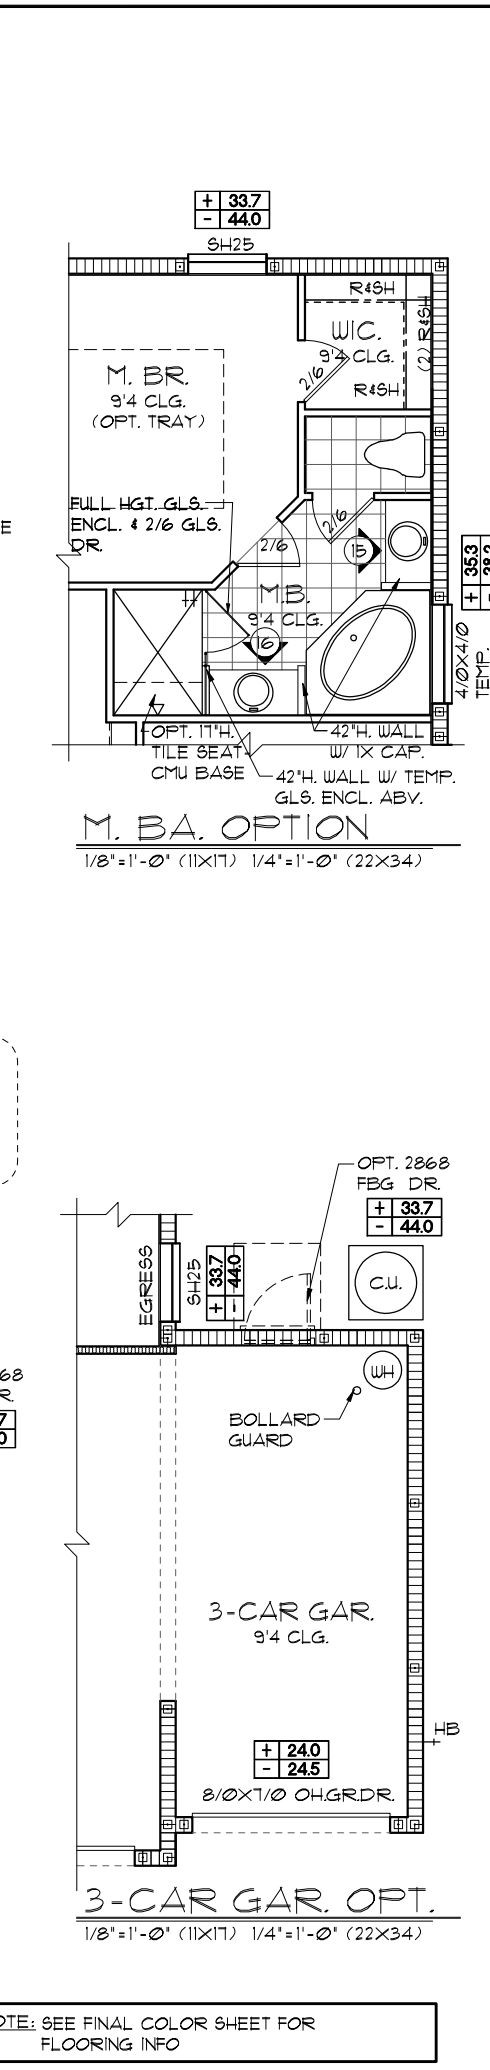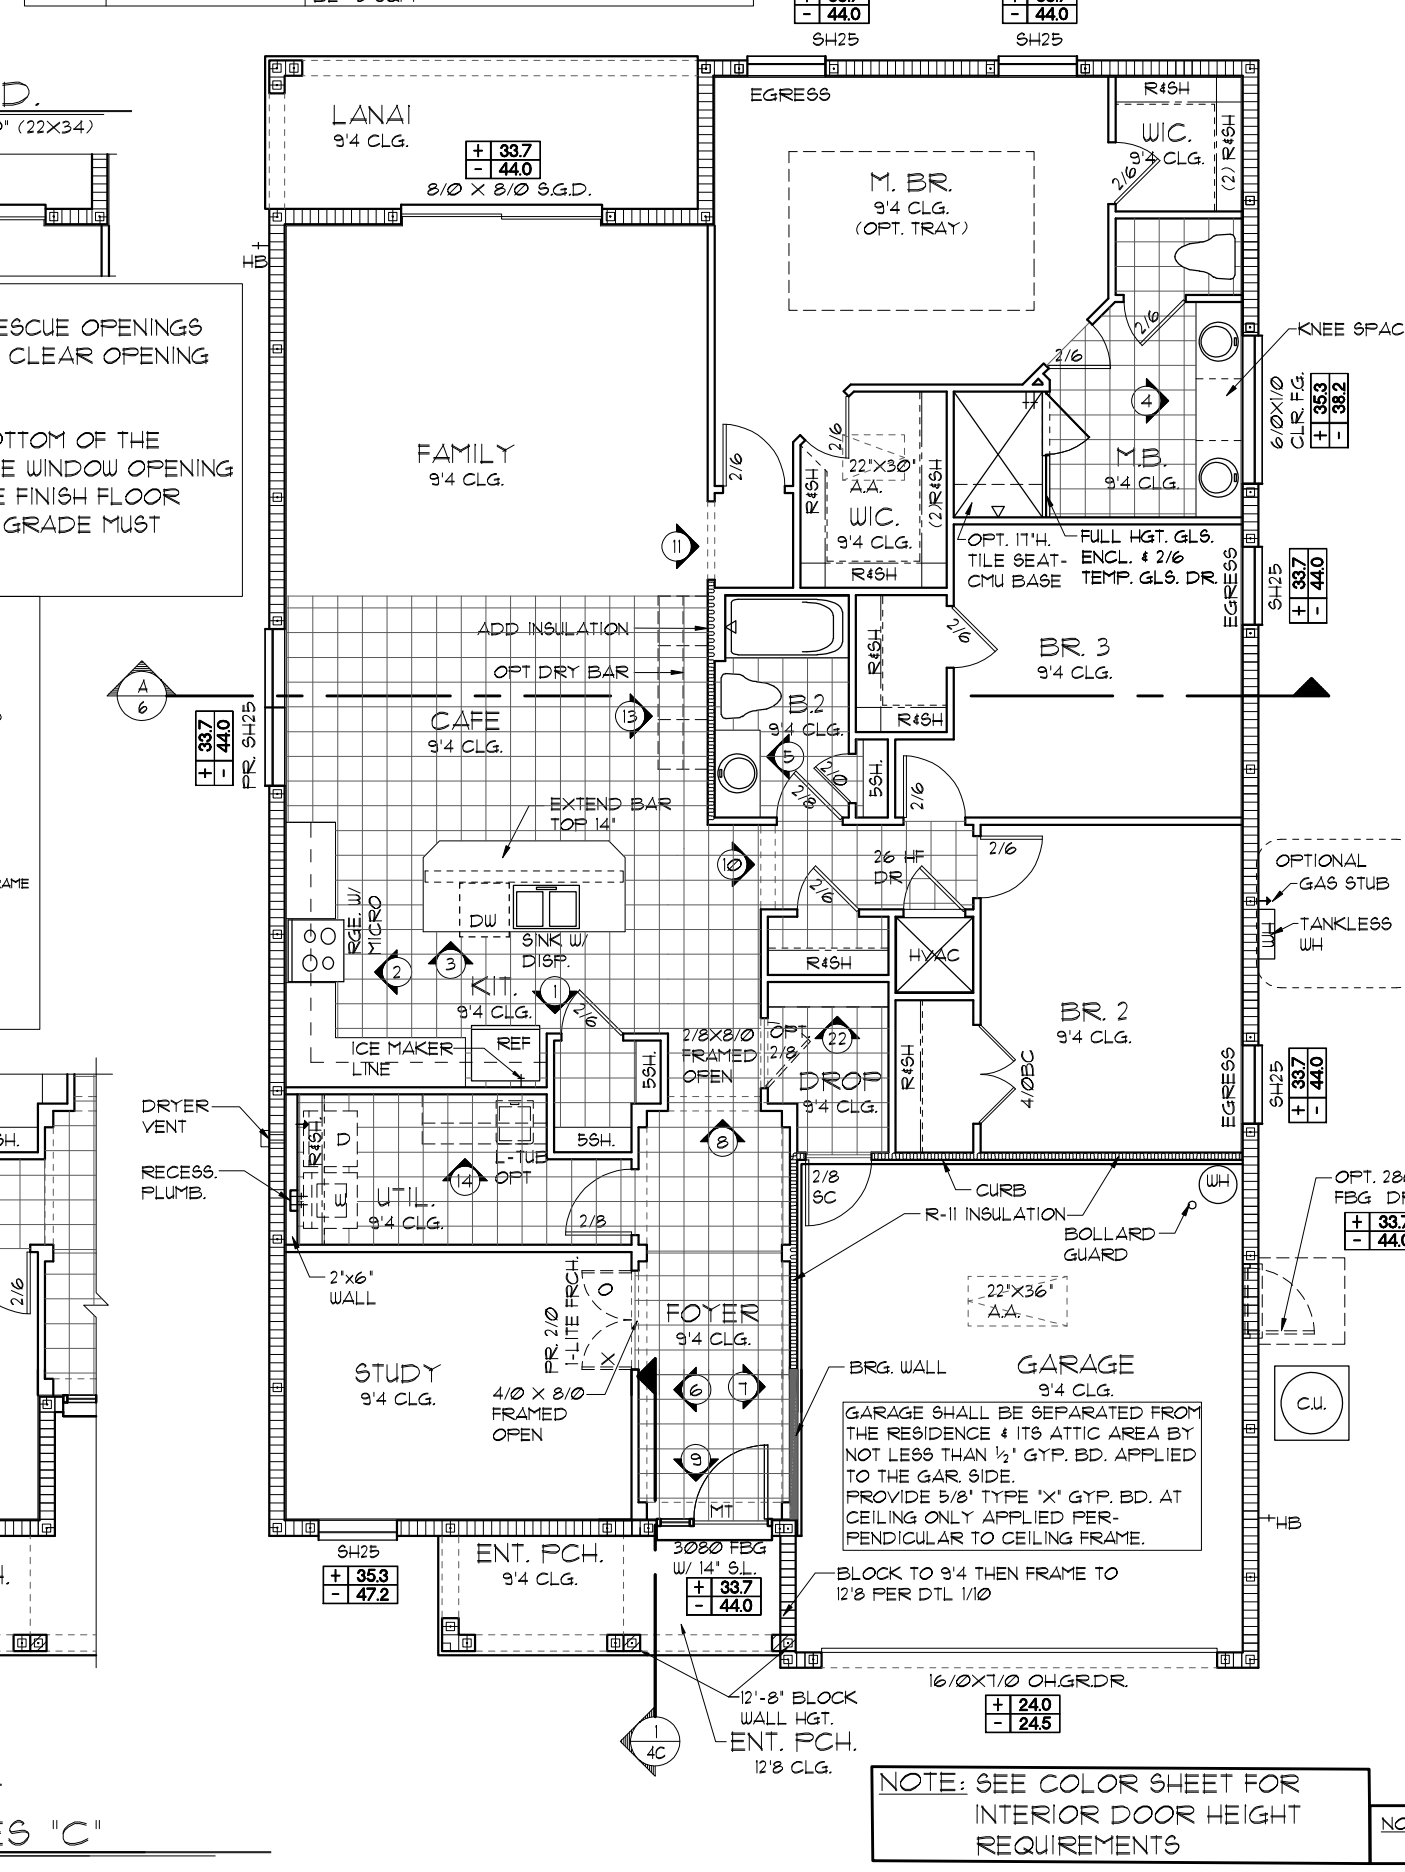

NOTE: SEE COLOR SHEET FOR INTERIOR DOOR HEIGHT REQUIREMENTS

NOTE: SEE FINAL COLOR SHEET FOR FLOORING INFO

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME: MARGATE II

**FLORIDA SERIES**

**ITEG**  
INTERTECH ENGINEERING GROUP, INC.  
14000 W. BIRCHWOOD BLVD., SUITE 200  
ORLANDO, FLORIDA 32817  
TEL: (407) 734-1700  
WWW.ITEG.COM

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32817  
Phone: (407) 529-3000





**Park Square HOMES**

FLOOR PLAN W/ NOTES  
EXTENDED FOYER

1966

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET 03C OF 00 SHEETS

REVISIONS	BY
05-16-19	JF

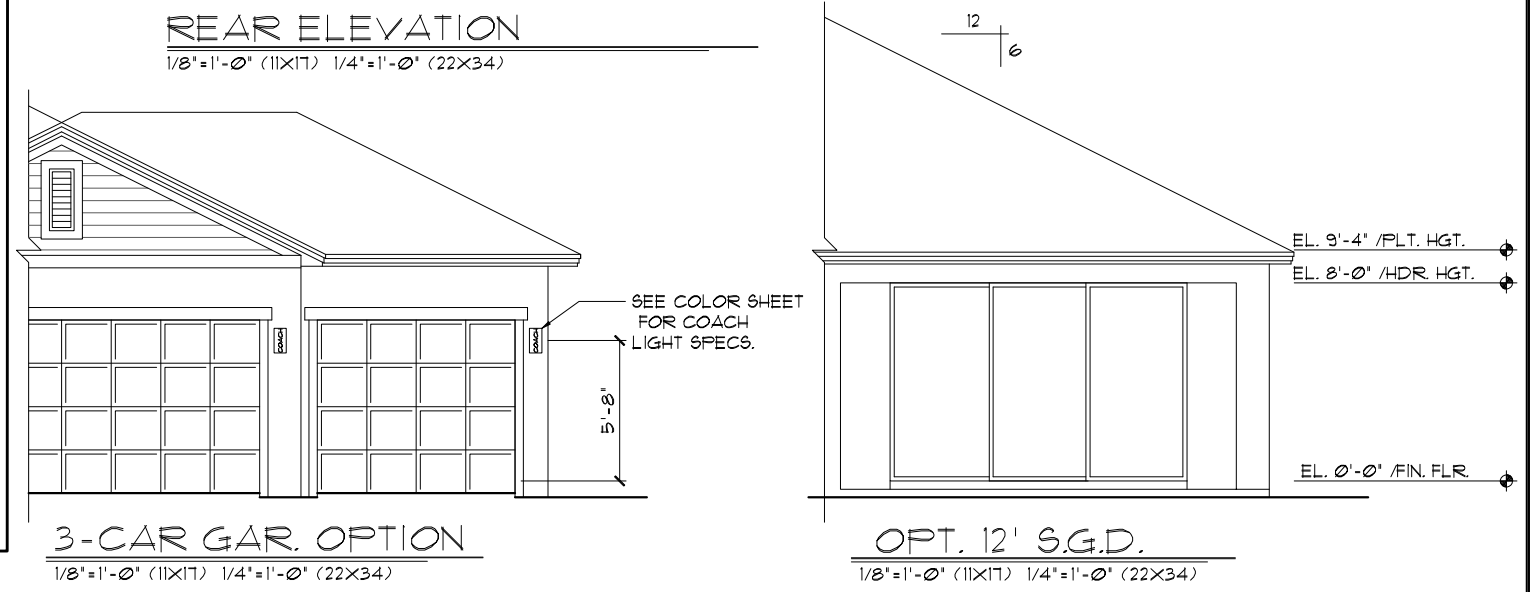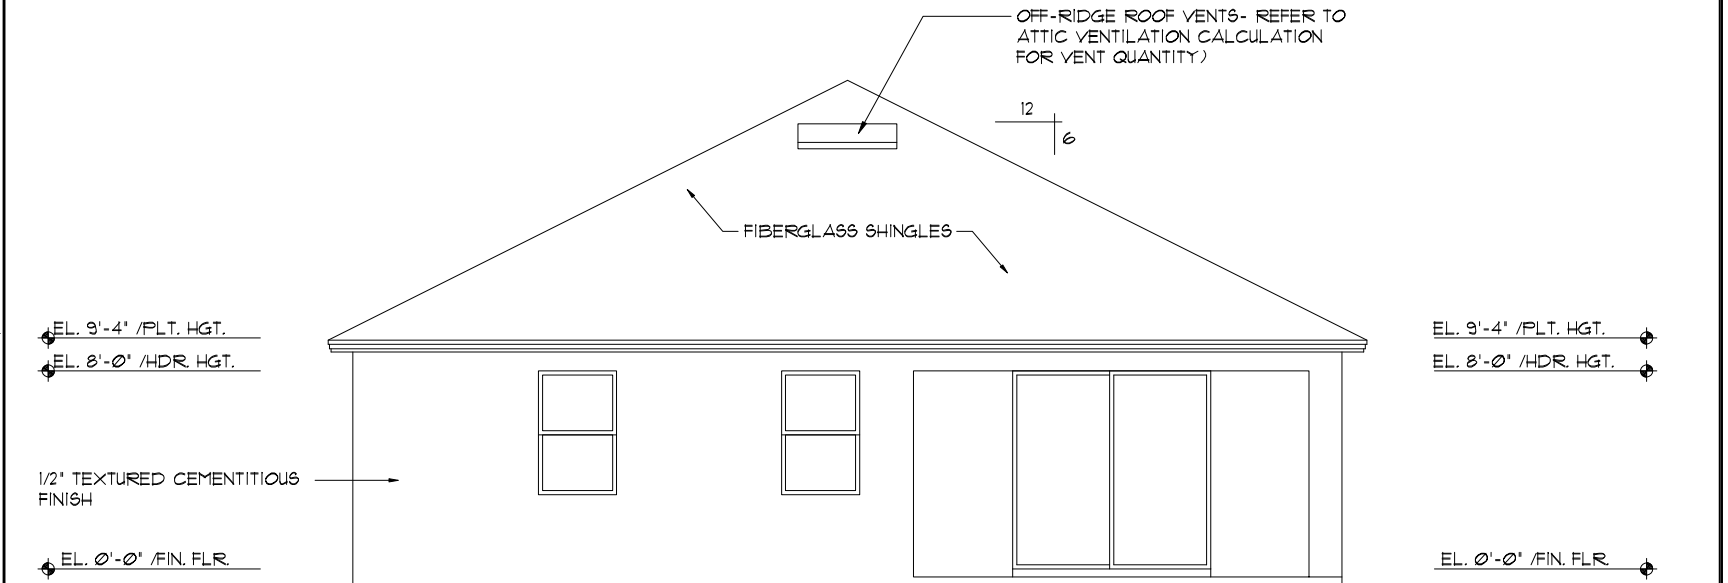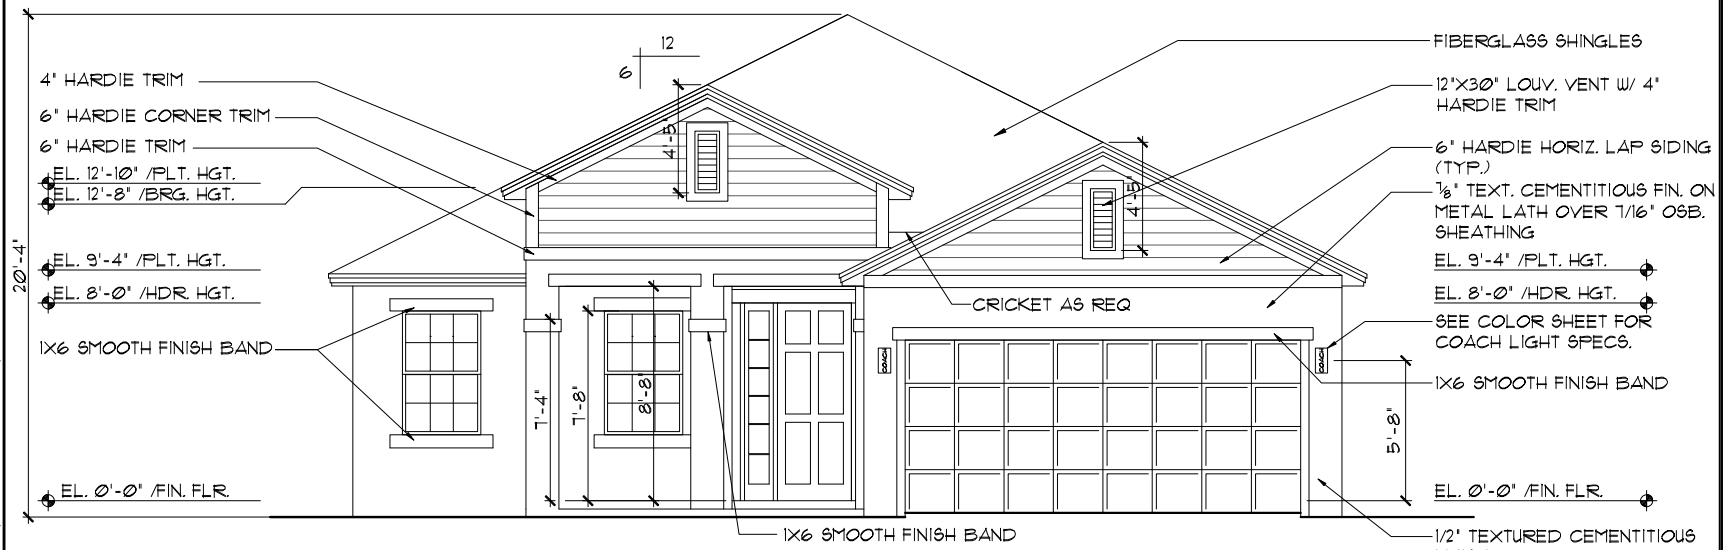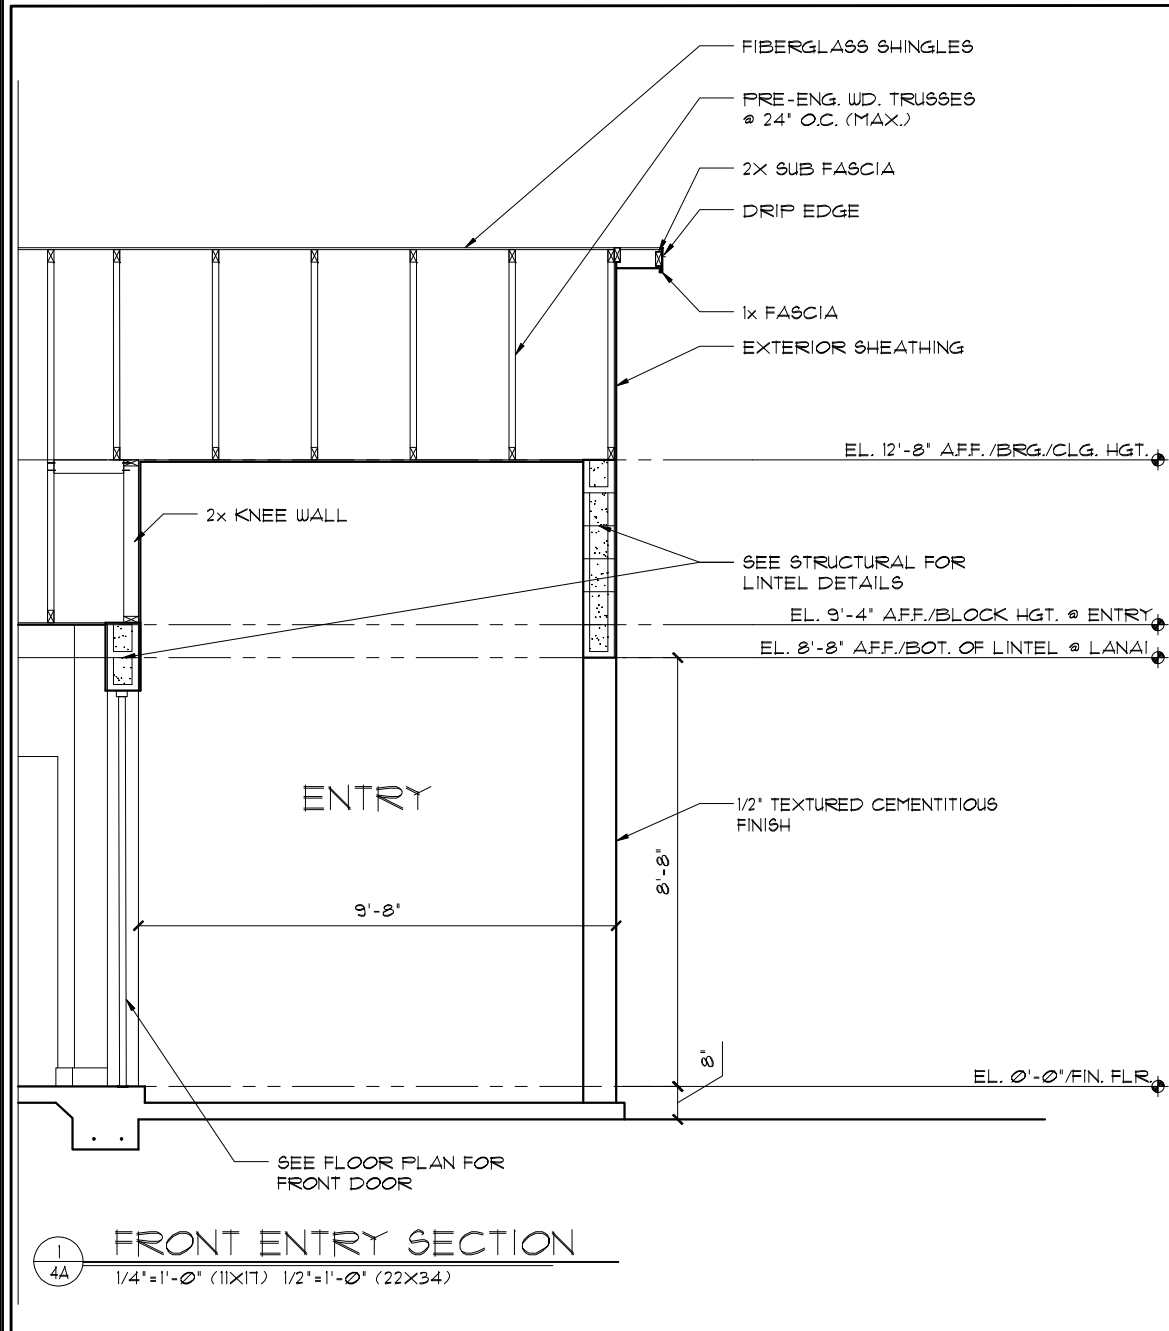

- EXTERIOR FINISH NOTES**
- LATH TO BE ATTACHED IAW R103.1.1 OF THE 8TH EDITION, FBCR, 2023 - ALL LATH AND LATH ATTACHMENTS SHALL BE OF CORROSION-RESISTANT MATERIAL. EXPANDED METAL OR WOVEN WIRE LATH SHALL BE ATTACHED WITH 1-1/2 INCH 11 GAGE NAILS HAVING A 7/16 INCH HEAD, OR 1 1/2 INCH LONG 16 GAGE STAPLES SPACED IN ACCORDANCE WITH ASTM C1063 OR C1181 OR AS OTHERWISE APPROVED.
  - PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 8TH EDITION, FBCR, 2023
  - WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 8TH EDITION, FBCR, 2023- MINIMUM NO 26 GALVANIZED SHEET GAGE CORROSION-RESISTANT WEEP SCREED OR PLASTIC WEEP SCREED WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 3-1/2 INCHES SHALL BE PROVIDED AT OR BELOW THE PLATE LINE ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C 926. THE WEEP SCREED SHALL BE PLACED A MINIMUM OF 4 INCHES ABOVE THE EARTH OR 2 INCHES ABOVE PAVED AREAS. THE WEATHER RESISTANT BARRIER SHALL LAP THE ATTACHMENT FLANGE. THE EXTERIOR LATH SHALL COVER AND TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP SCREED.
  - WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 8TH EDITION, FBCR, 2023- INSTALLED OVER WOOD BASED SHEATHING SHALL INCLUDE A WATER RESISTIVE VAPOR PERMEABLE BARRIER EQUIVALENT TO 2 LAYERS OF GRADE D PAPER
  - 'ZIP SYSTEMS' WALL SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS.
  - STUCCO APPLICATION MUST BE IAW R103.1.4 OF THE 8TH EDITION, FBCR, 2023 OR EXCEPTION : APPLICATION INSTALLED IN ACCORDANCE WITH ASTM C 926
  - UNDERLAYMENT REQUIREMENTS MUST BE IAW R305.1.1 OF THE 8TH EDITION, FBCR 2023 -  
 R305.1.1 Underlayment.  
 Underlayment for roof slopes 2:12 and greater shall conform to the applicable standards listed in this chapter. Underlayment materials required to comply with ASTM D226, D1910, D4869 and D6151, OR ASTM D8251 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated. Underlayment for roof slopes 2:12 and greater shall be applied and attached in accordance with Section R305.1.1.1, R305.1.1.2 as applicable.

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
 LOT: 0000, COMMUNITY NAME  
 1966  
 MARGATE II  
 DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET  
 04A  
 OF 00 SHEETS





**FLORIDA SERIES**  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000  
 www.psq.com

REVISIONS	BY
05-16-19	JF

**ITEG**  
 PROVISION ENGINEERING GROUP, INC.  
 10000 W. Colonial Ave., Suite 100  
 Orlando, FL 32817  
 Tel: (407) 734-1400  
 Fax: (407) 734-1700  
 www.iteg.com

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000

**Park Square HOMES**  
 EXTERIOR ELEVATION FRONT AND REAR

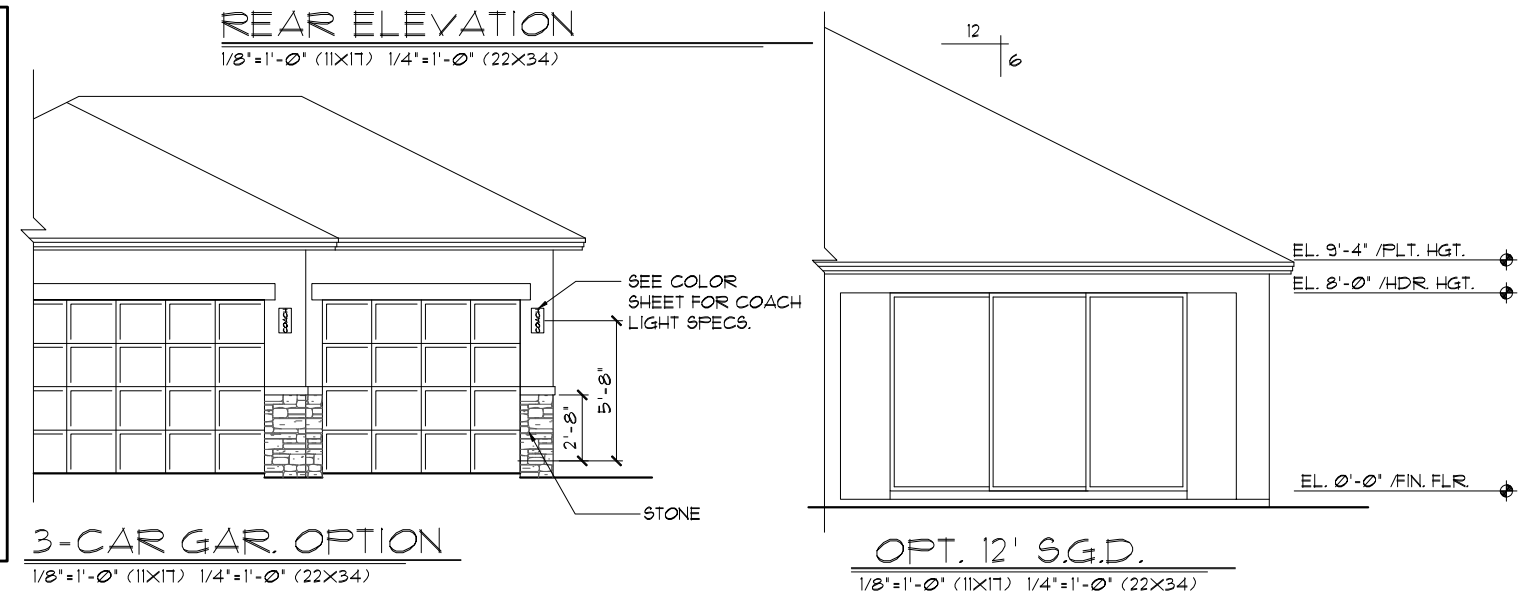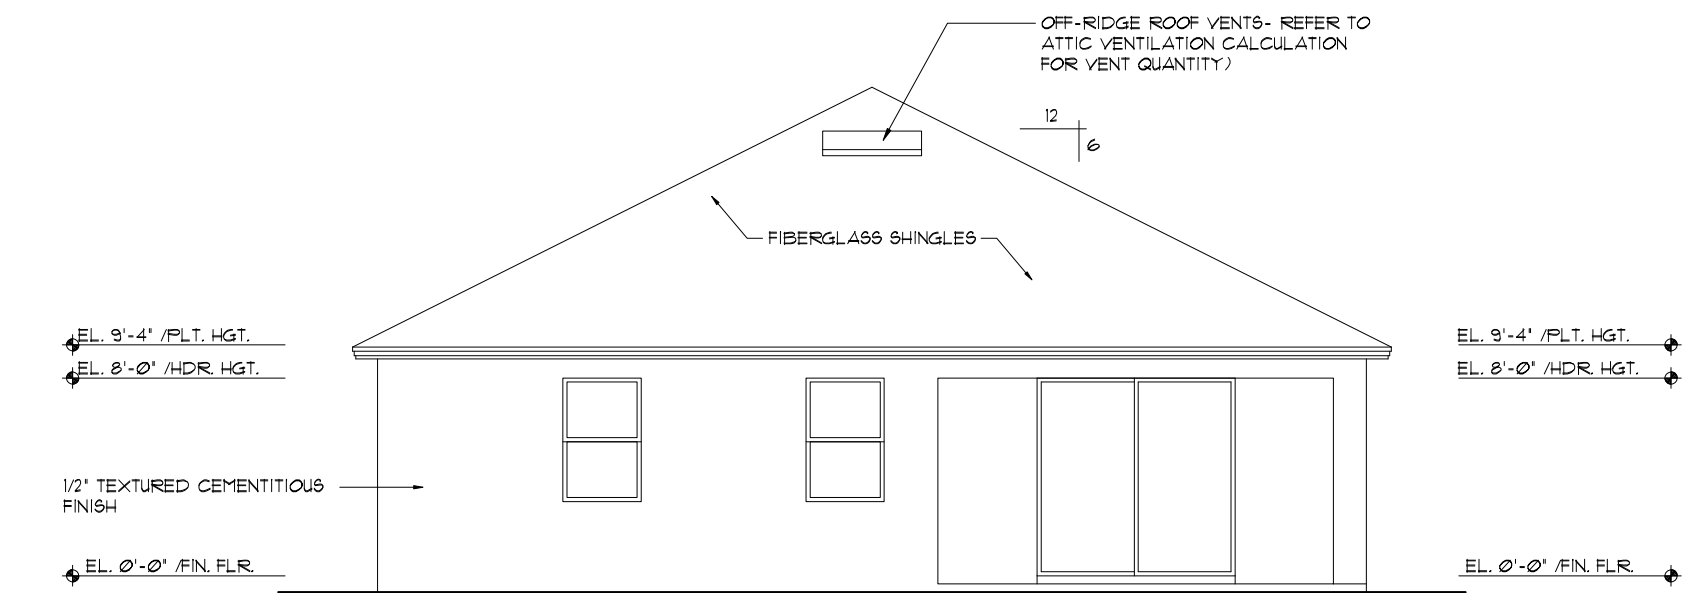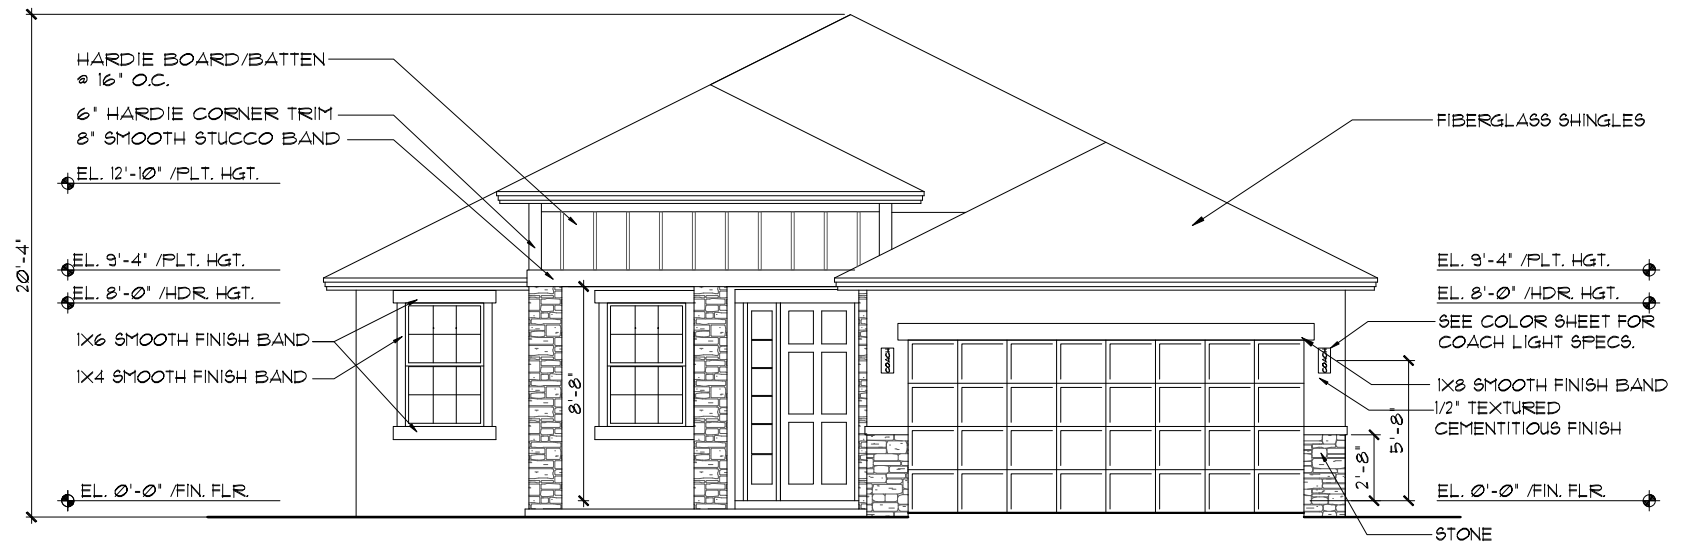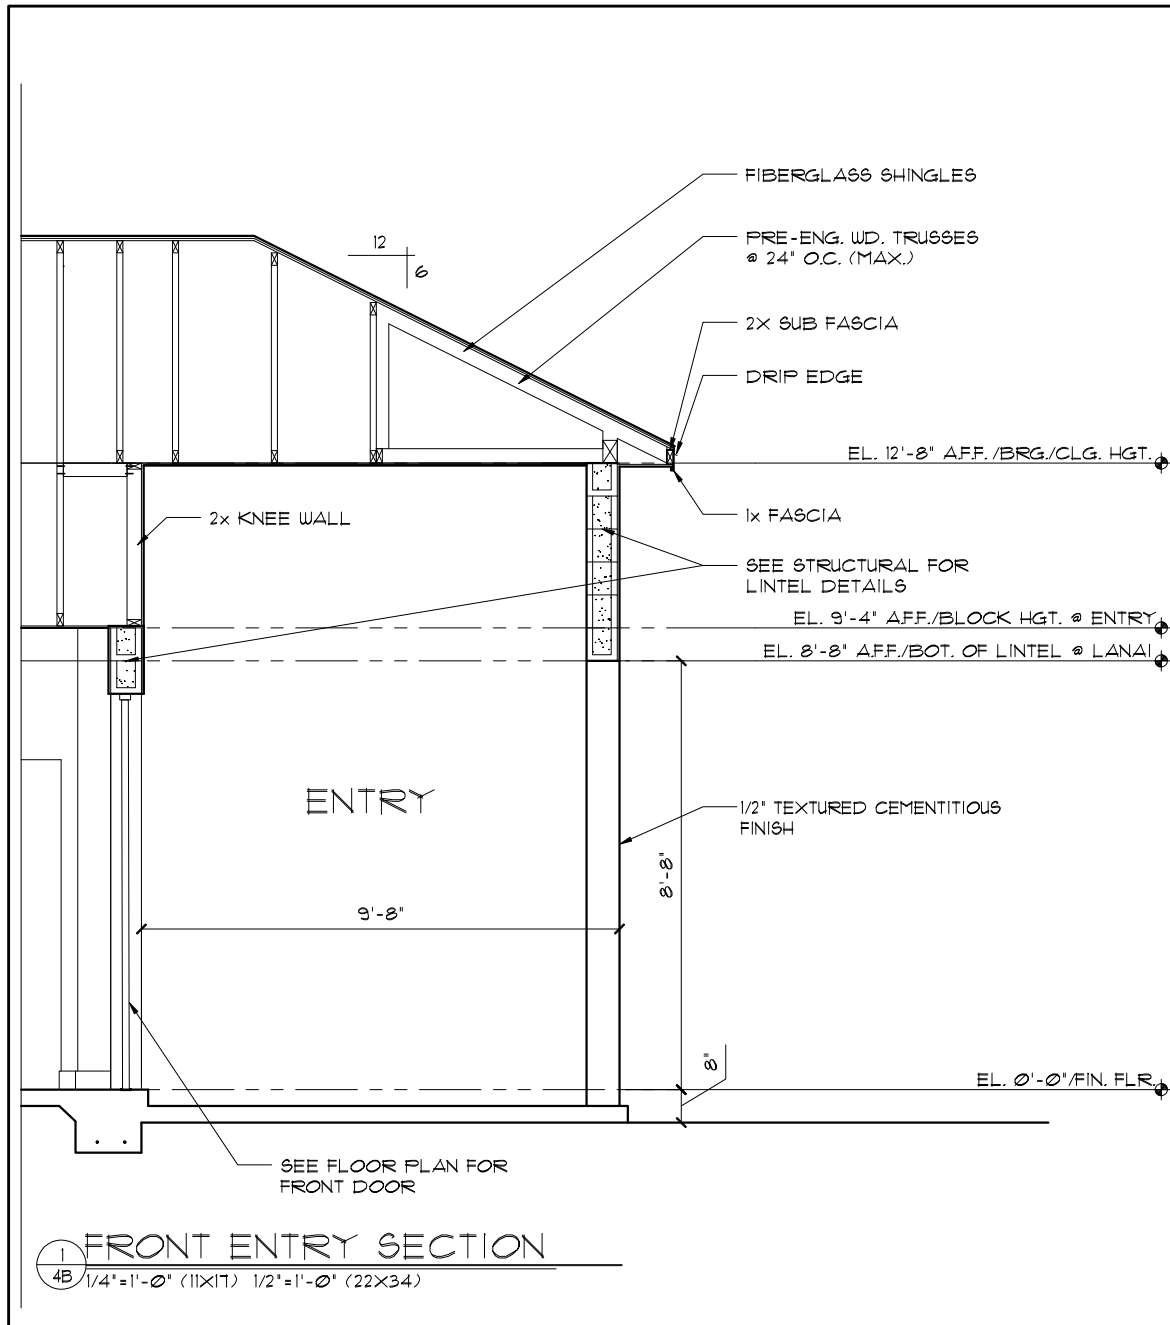

**EXTERIOR FINISH NOTES**




- LATH TO BE ATTACHED IAW R103.1.1 OF THE 8TH EDITION, FBCR, 2023 - ALL LATH AND LATH ATTACHMENTS SHALL BE OF CORROSION-RESISTANT MATERIAL. EXPANDED METAL OR WOVEN WIRE LATH SHALL BE ATTACHED WITH 1-1/2 INCH 11 GAGE NAILS HAVING A 7/16 INCH HEAD, OR 1 1/2 INCH LONG 16 GAGE STAPLES SPACED IN ACCORDANCE WITH ASTM C1063 OR C1181 OR AS OTHERWISE APPROVED.
- PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 8TH EDITION, FBCR, 2023
- WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 8TH EDITION, FBCR, 2023- MINIMUM NO 26 GALVANIZED SHEET GAGE CORROSION-RESISTANT WEEP SCREED OR PLASTIC WEEP SCREED WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 3-1/2 INCHES SHALL BE PROVIDED AT OR BELOW THE PLATE LINE ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C 926. THE WEEP SCREED SHALL BE PLACED A MINIMUM OF 4 INCHES ABOVE THE EARTH OR 2 INCHES ABOVE PAVED AREAS. THE WEATHER RESISTANT BARRIER SHALL LAP THE ATTACHMENT FLANGE. THE EXTERIOR LATH SHALL COVER AND TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP SCREED.
- WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 8TH EDITION, FBCR, 2023- INSTALLED OVER WOOD BASED SHEATHING SHALL INCLUDE A WATER RESISTIVE VAPOR PERMEABLE BARRIER EQUIVALENT TO 2 LAYERS OF GRADE D PAPER
- 'ZIP SYSTEMS' WALL SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS.
- STUCCO APPLICATION MUST BE IAW R103.1.4 OF THE 8TH EDITION, FBCR, 2023 OR EXCEPTION : APPLICATION INSTALLED IN ACCORDANCE WITH ASTM C 926
- UNDERLAYMENT REQUIREMENTS MUST BE IAW R305.1.1 OF THE 8TH EDITION, FBCR 2023 -  
 R305.1.1 Underlayment.  
 Underlayment for roof slopes 2:12 and greater shall conform to the applicable standards listed in this chapter. Underlayment materials required to comply with ASTM D226, D1910, D4869 and D6151, OR ASTM D2251 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated. Underlayment for roof slopes 2:12 and greater shall be applied and attached in accordance with Section R305.1.1.1, R305.1.1.2 as applicable.

LOT: 0000, COMMUNITY NAME: MARGATE II  
 1966  
 DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET 04B OF 00 SHEETS  
 THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH


**FLORIDA SERIES**  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000  
**ITEG**  
 ITC ENGINEERING GROUP, INC.  
 10000 Lake Nona Blvd., Suite 100  
 Orlando, FL 32826  
 Phone: (407) 734-1400  
 Fax: (407) 734-1790  
 www.iteg.com

REVISIONS	BY
05-16-19	JF

EXTERIOR ELEVATION FRONT AND REAR  
 Park Square HOMES  
 Copyright 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without the express written permission from Park Square Homes.

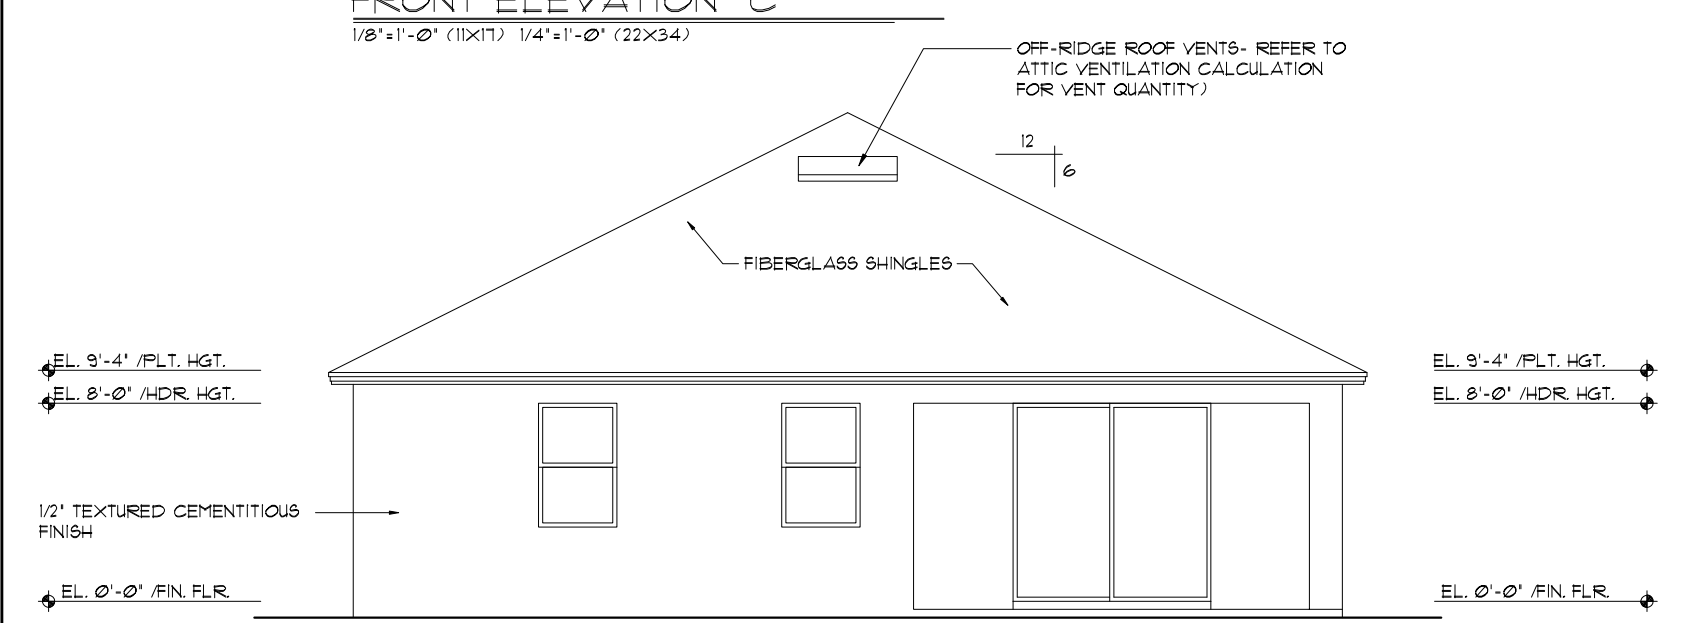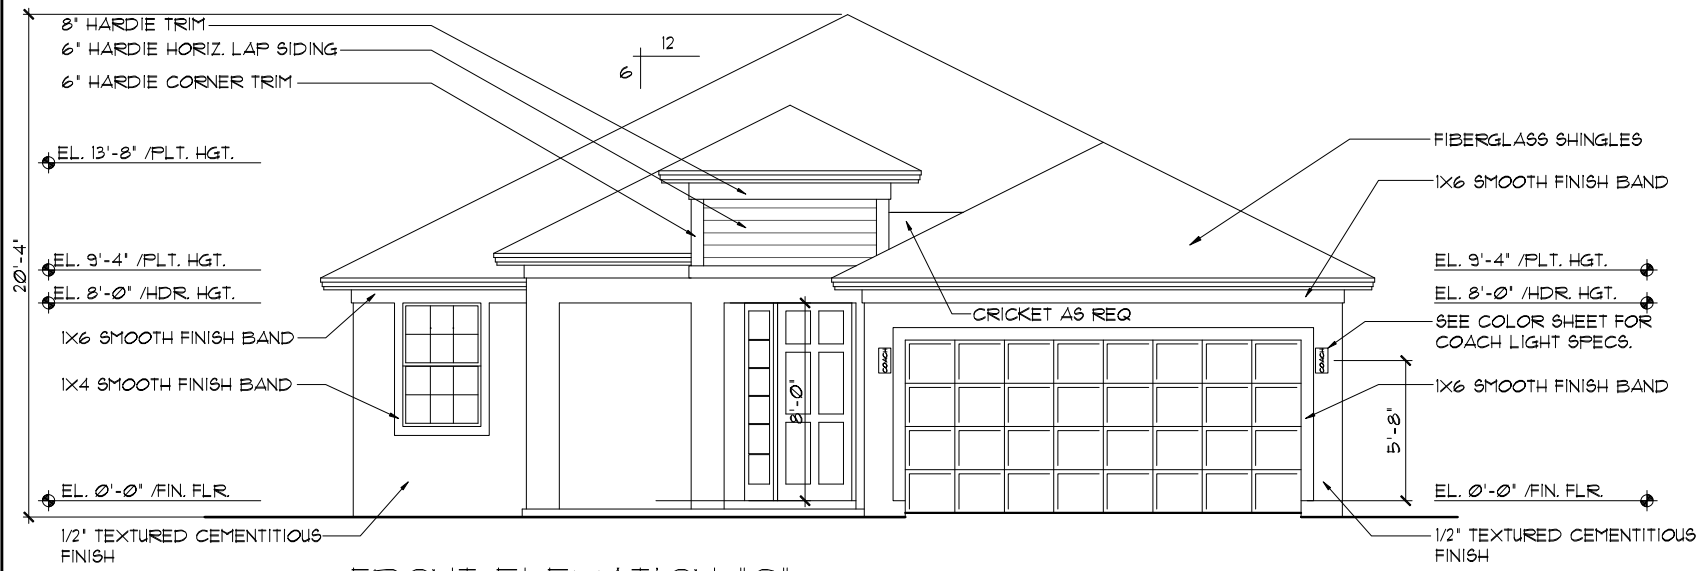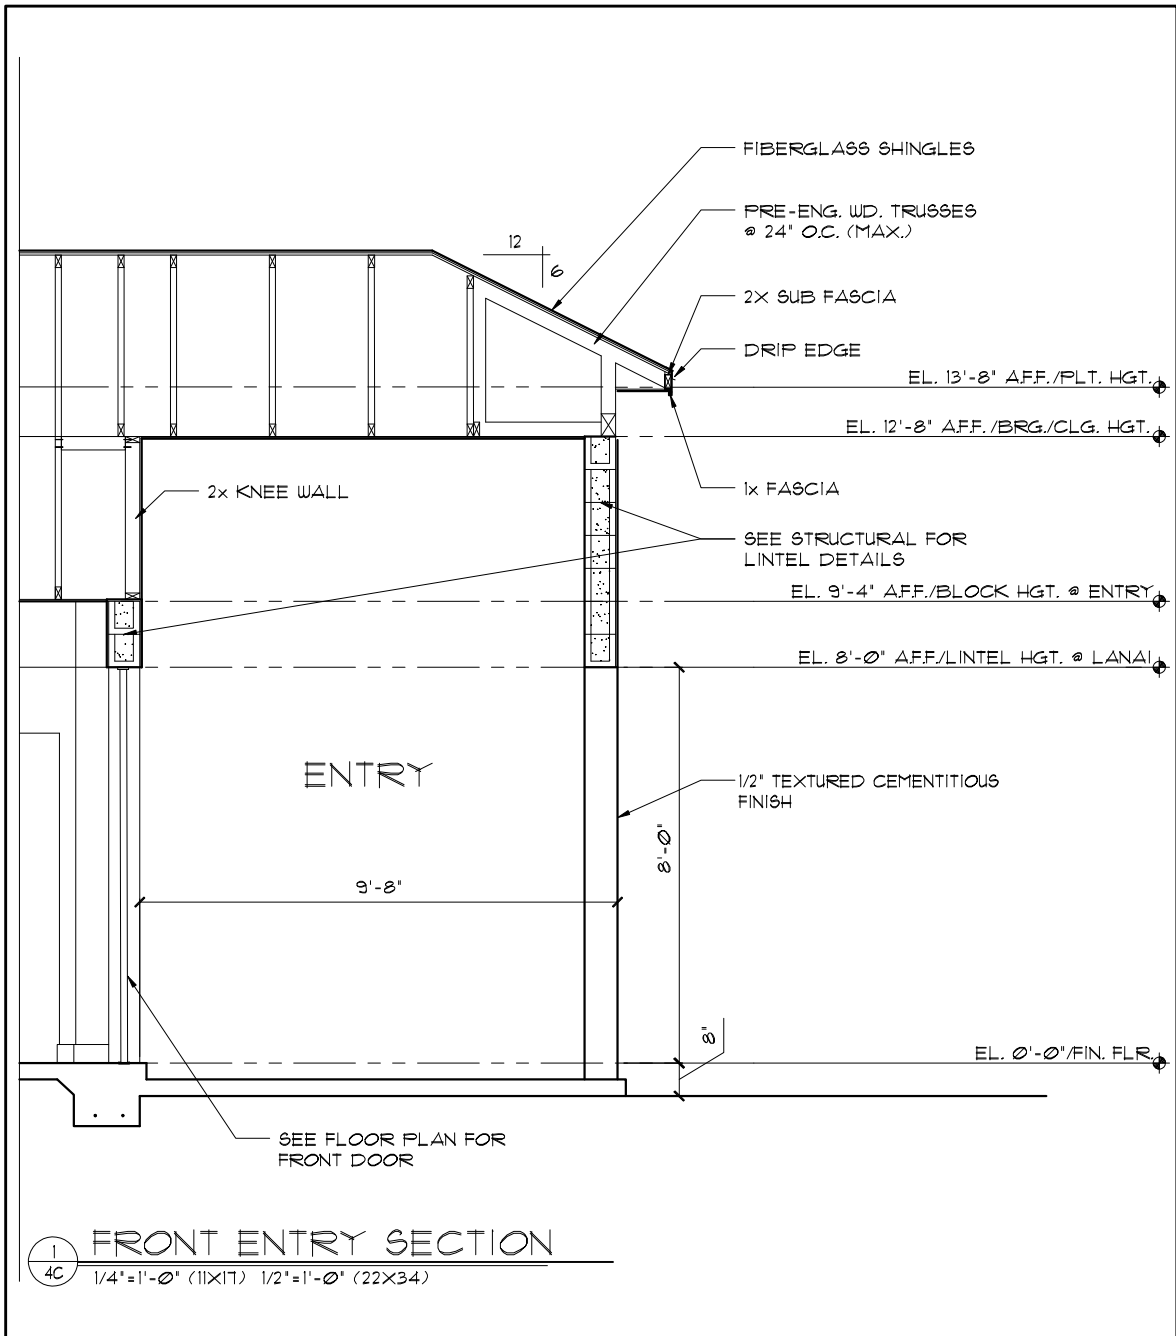

- EXTERIOR FINISH NOTES**
- LATH TO BE ATTACHED IAW R103.1.1 OF THE 8TH EDITION, FBCR 2023 - ALL LATH AND LATH ATTACHMENTS SHALL BE OF CORROSION-RESISTANT MATERIAL. EXPANDED METAL OR WOVEN WIRE LATH SHALL BE ATTACHED WITH 1-1/2 INCH 11 GAGE NAILS HAVING A 7/16 INCH HEAD, OR 1 1/2 INCH LONG 16 GAGE STAPLES SPACED IN ACCORDANCE WITH ASTM C1063 OR C1181 OR AS OTHERWISE APPROVED.
  - PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 8TH EDITION, FBCR 2023
  - WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 8TH EDITION, FBCR 2023- MINIMUM NO 26 GALVANIZED SHEET GAGE CORROSION-RESISTANT WEEP SCREED OR PLASTIC WEEP SCREED WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 3-1/2 INCHES SHALL BE PROVIDED AT OR BELOW THE PLATE LINE ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C 926. THE WEEP SCREED SHALL BE PLACED A MINIMUM OF 4 INCHES ABOVE THE EARTH OR 2 INCHES ABOVE PAVED AREAS. THE WEATHER RESISTANT BARRIER SHALL LAP THE ATTACHMENT FLANGE. THE EXTERIOR LATH SHALL COVER AND TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP SCREED.
  - WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 8TH EDITION, FBCR 2023- INSTALLED OVER WOOD BASED SHEATHING SHALL INCLUDE A WATER RESISTIVE VAPOR PERMEABLE BARRIER EQUIVALENT TO 2 LAYERS OF GRADE D PAPER
  - 'ZIP SYSTEMS' WALL SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS.
  - STUCCO APPLICATION MUST BE IAW R103.1.4 OF THE 8TH EDITION, FBCR 2023 OR EXCEPTION: APPLICATION INSTALLED IN ACCORDANCE WITH ASTM C 926
  - UNDERLAYMENT REQUIREMENTS MUST BE IAW R305.1.1 OF THE 8TH EDITION, FBCR 2023 -  
 R305.1.1 Underlayment.  
 Underlayment for roof slopes 2:12 and greater shall conform to the applicable standards listed in this chapter. Underlayment materials required to comply with ASTM D226, D1910, D4869 and D6151, OR ASTM D8251 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated. Underlayment for roof slopes 2:12 and greater shall be applied and attached in accordance with Section R305.1.1.1, R305.1.1.2 as applicable.

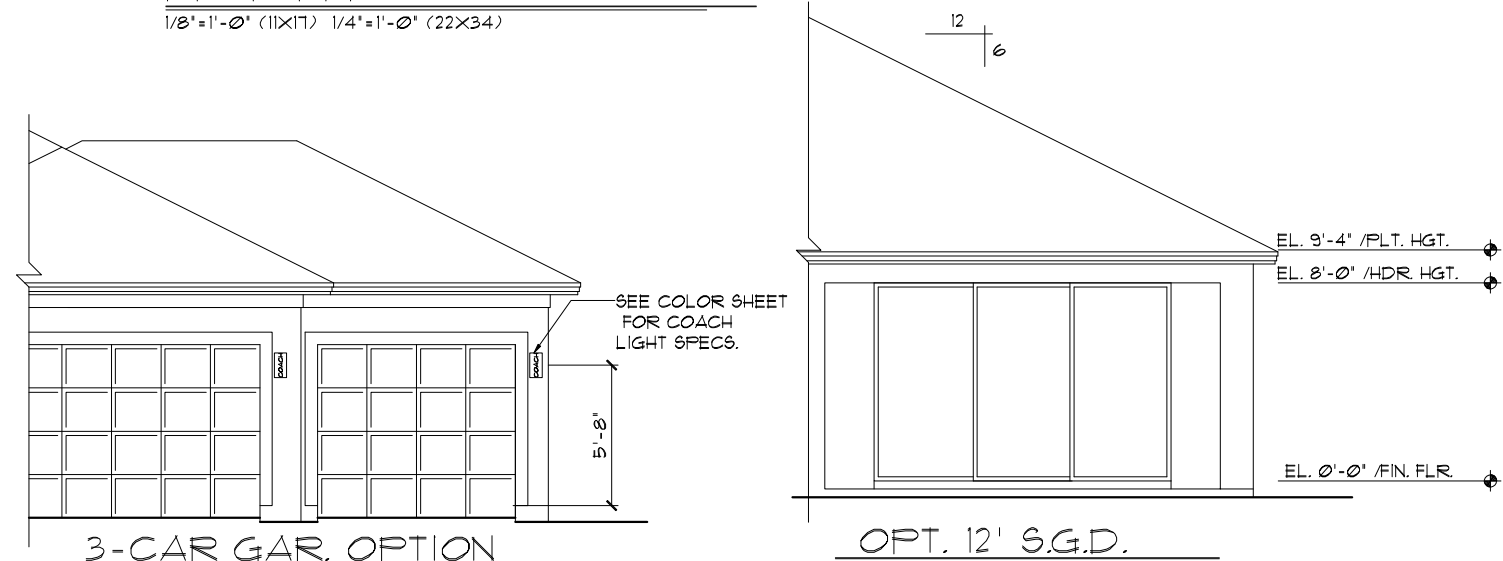

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
 LOT: 0000, COMMUNITY NAME  
 1966  
 MARGATE II  
 FLORIDA SERIES  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000  
 www.psq.com

REVISIONS	BY
05-16-19	JF

**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 1400 S. Orange Blossom Trail, Suite 200  
 Orange, Florida 32811  
 Tel: (407) 734-1400  
 Fax: (407) 734-1790  
 www.iteg.com

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000




**Park Square HOMES**

EXTERIOR ELEVATION  
 FRONT AND REAR

DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET  
**04C**  
 OF 00 SHEETS

**EXTERIOR FINISH NOTES**

- LATH TO BE ATTACHED IAW R103.1.1 OF THE 8TH EDITION, FBCR 2023
- PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 8TH EDITION, FBCR 2023
- WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 8TH EDITION, FBCR 2023
- WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 8TH EDITION, FBCR 2023
- 'ZIP SYSTEMS' WALL SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS.

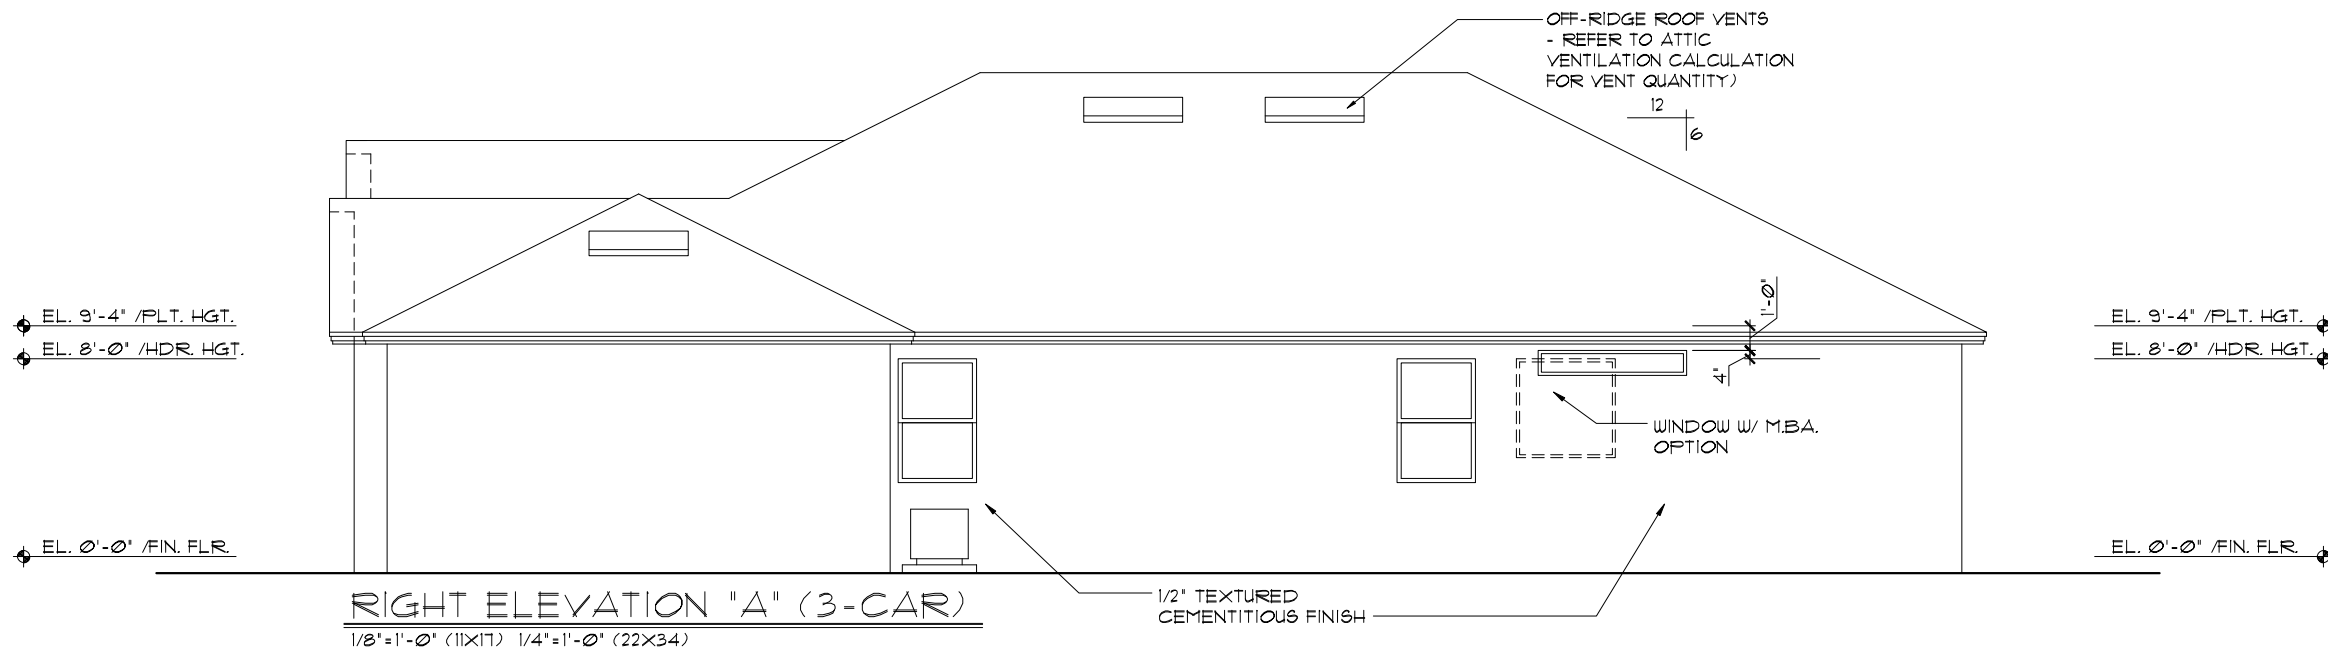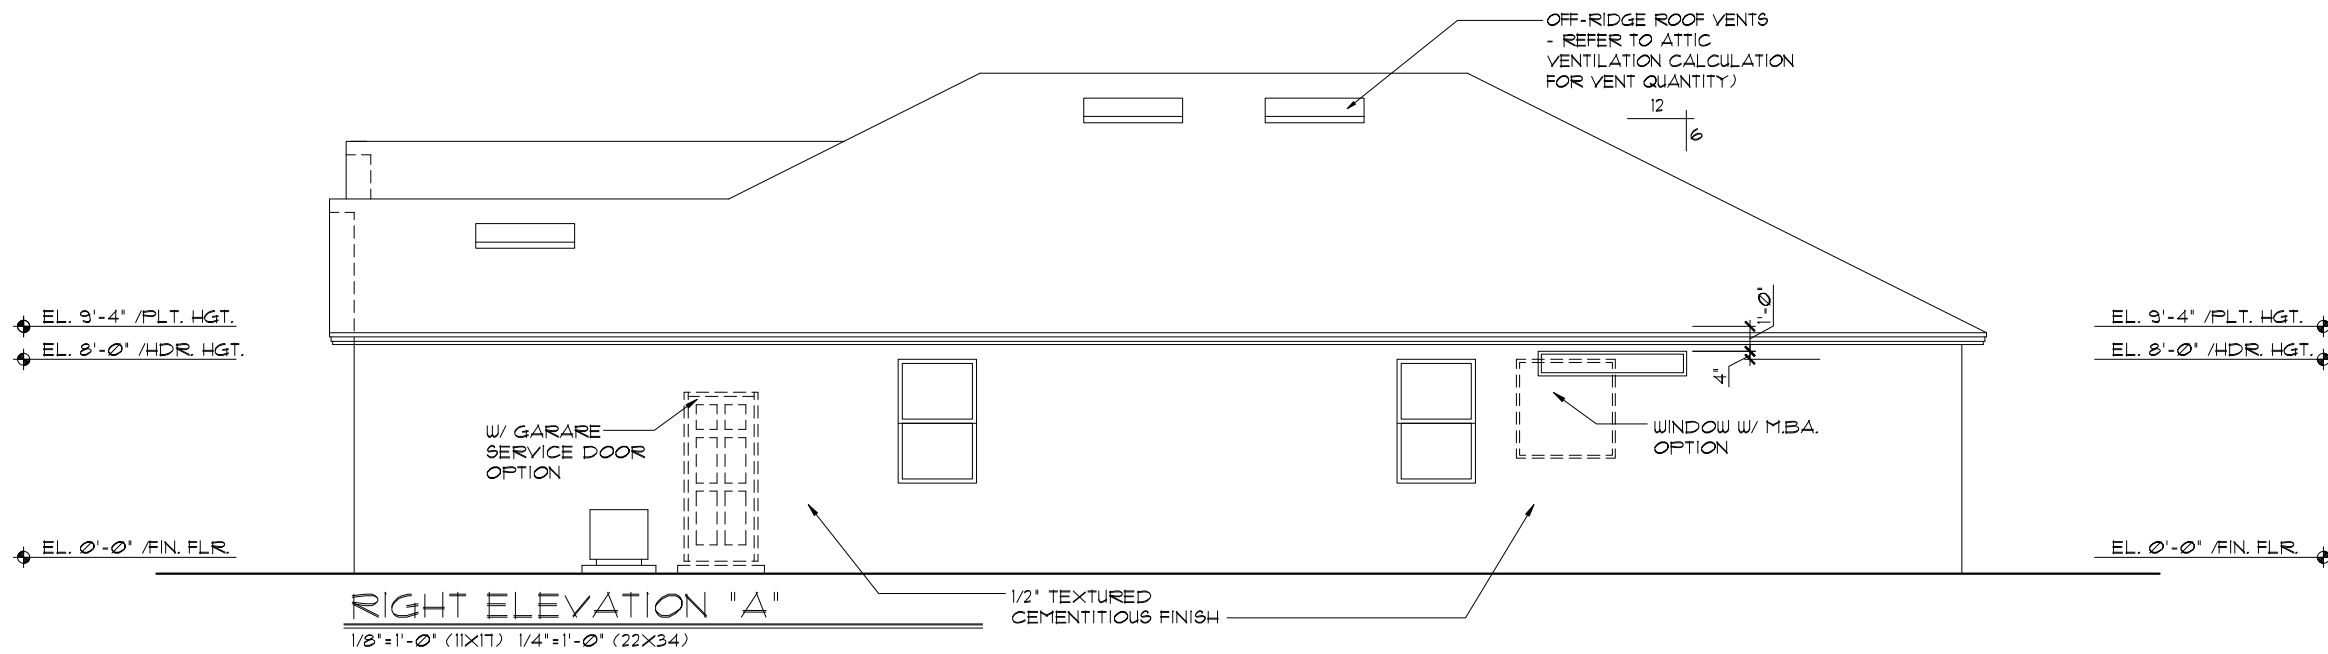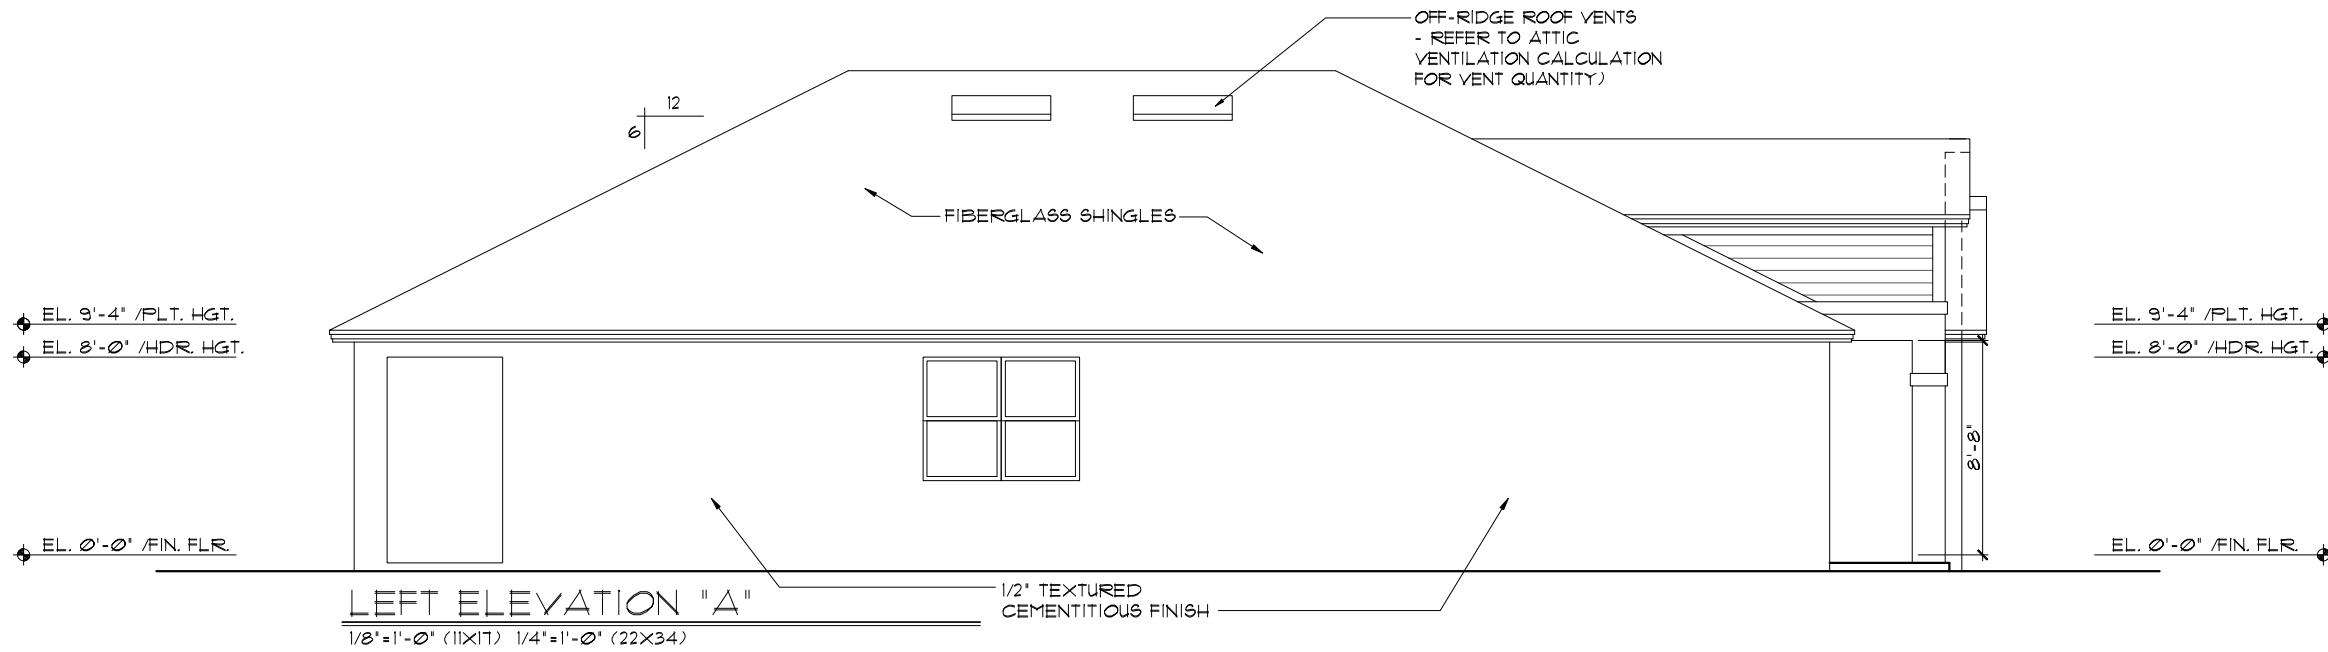

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
**LOT: 0000, COMMUNITY NAME**  
**FLORIDA SERIES**

Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and design are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS	BY
05-16-19	JF

**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Tel: (407) 734-1400  
 Fax: (407) 734-1790  
 www.iteg.com




A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
**Park Square HOMES**  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000

**EXTERIOR ELEVATION LEFT AND RIGHT**

1966  
**MARGATE II**

DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET **05A**  
 OF 00 SHEETS

- EXTERIOR FINISH NOTES**
- LATH TO BE ATTACHED IAW R103.1.1 OF THE 8TH EDITION, FBCR, 2023
  - PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R103.1.2 OF THE 8TH EDITION, FBCR, 2023
  - WEEP SCREED TO BE INSTALLED IAW R103.1.2.1 OF THE 8TH EDITION, FBCR, 2023
  - WATER RESISTANT BARRIER TO BE INSTALLED IAW R103.1.3 OF THE 8TH EDITION, FBCR, 2023
  - 'ZIP SYSTEMS' WALL SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS.

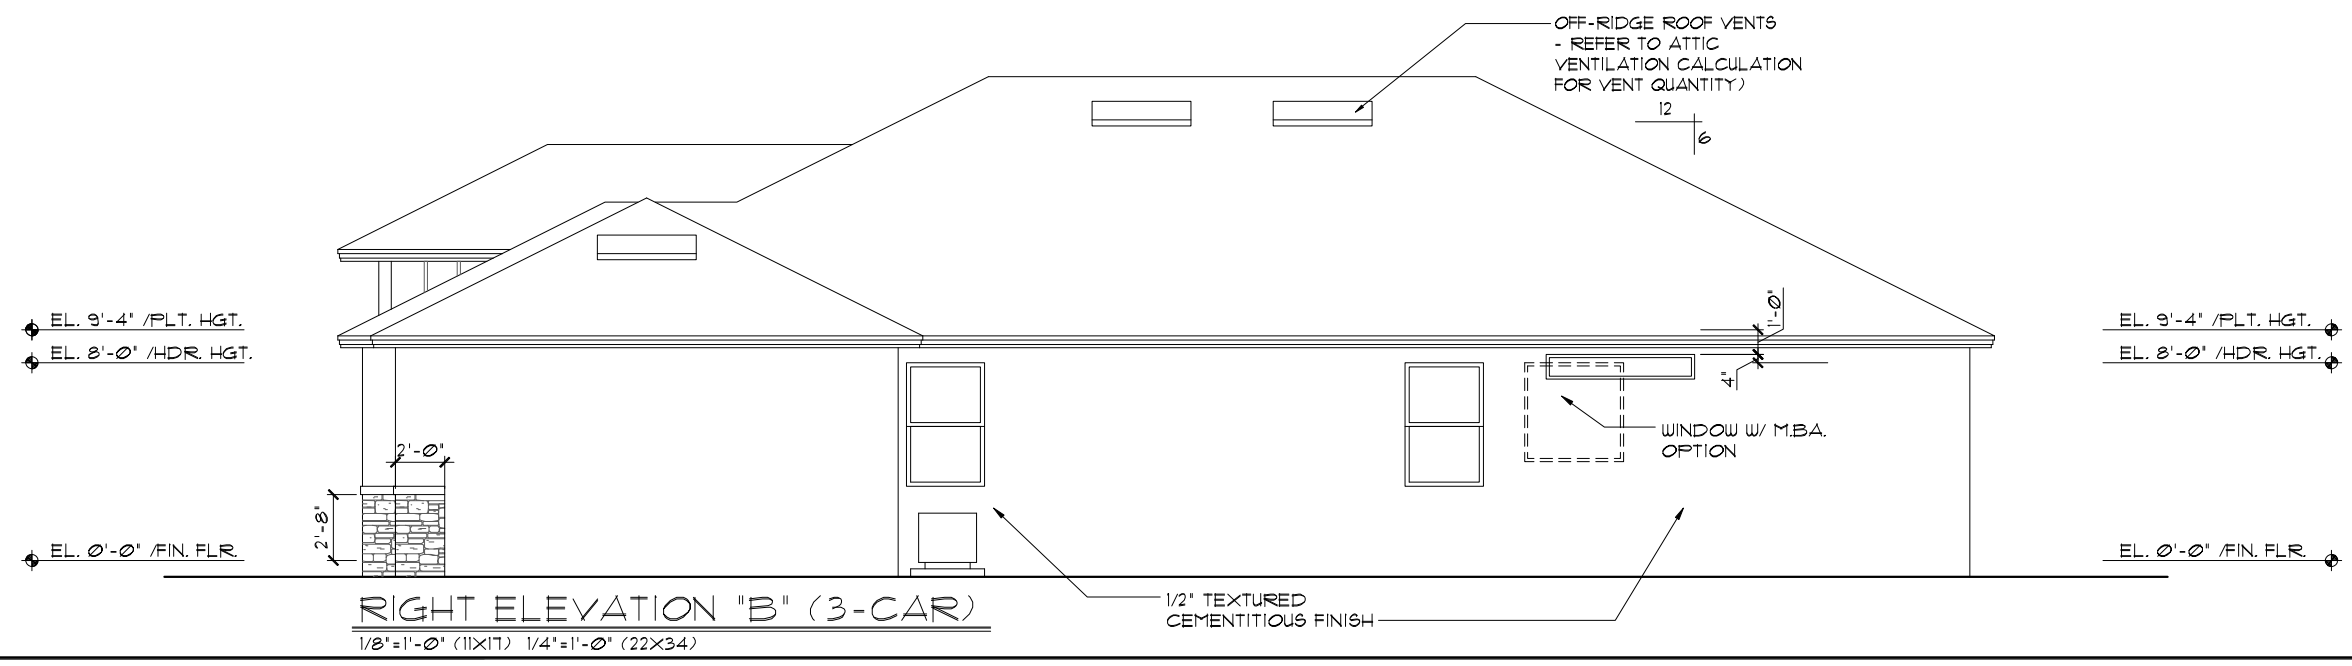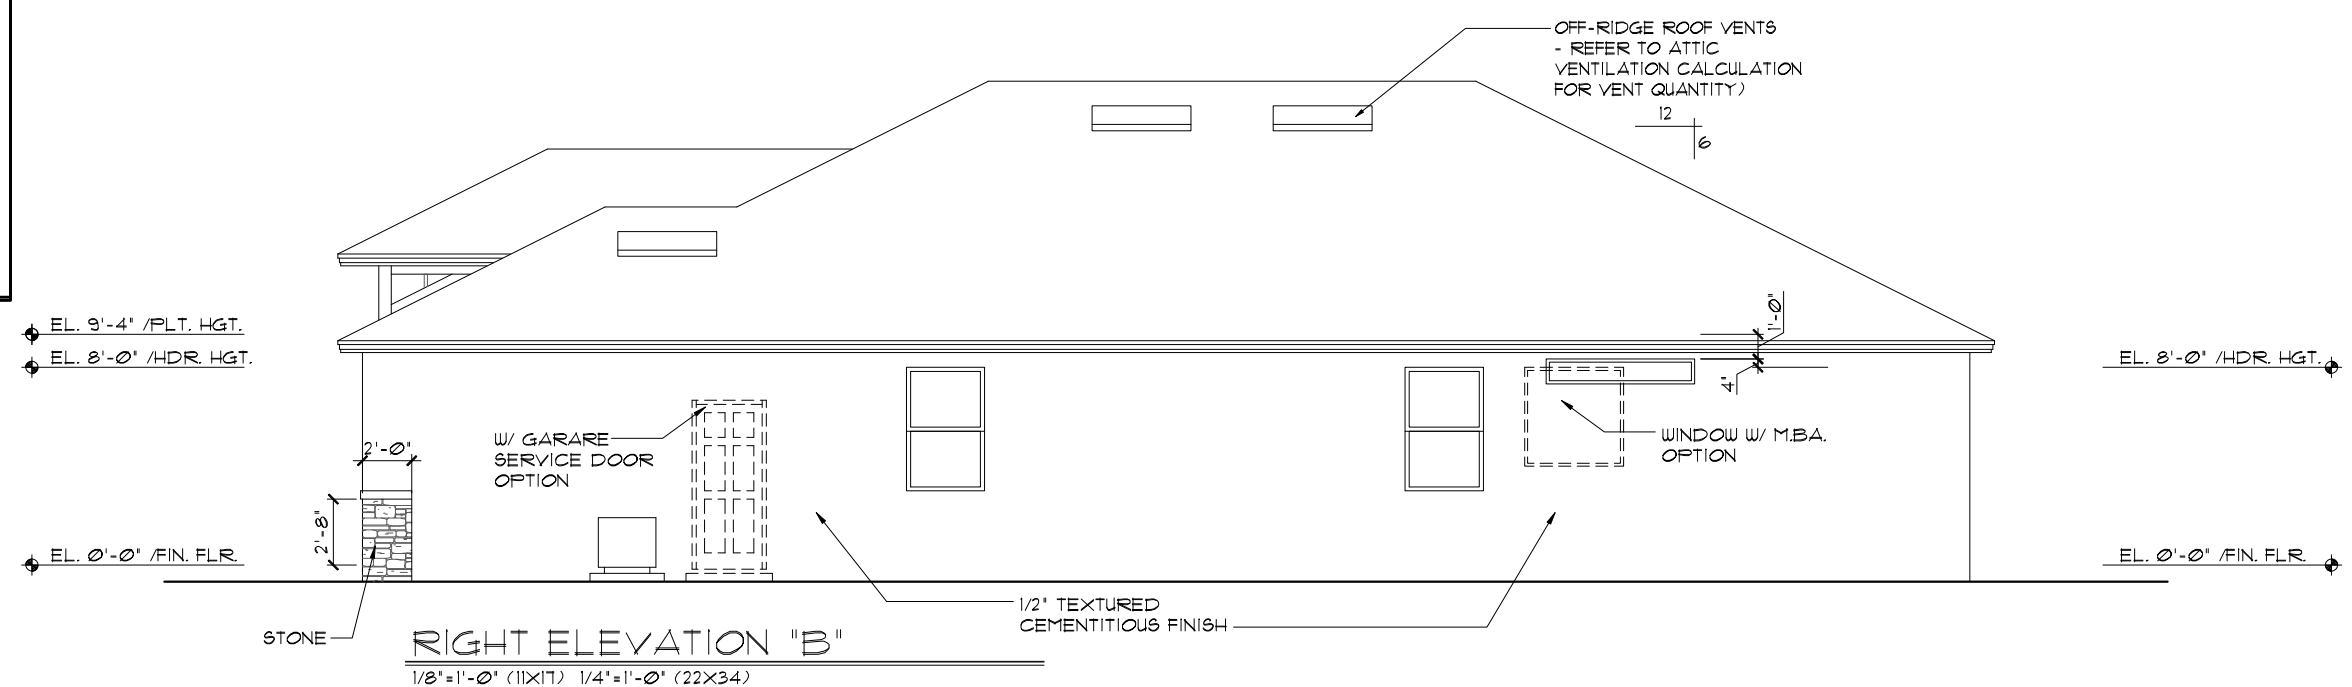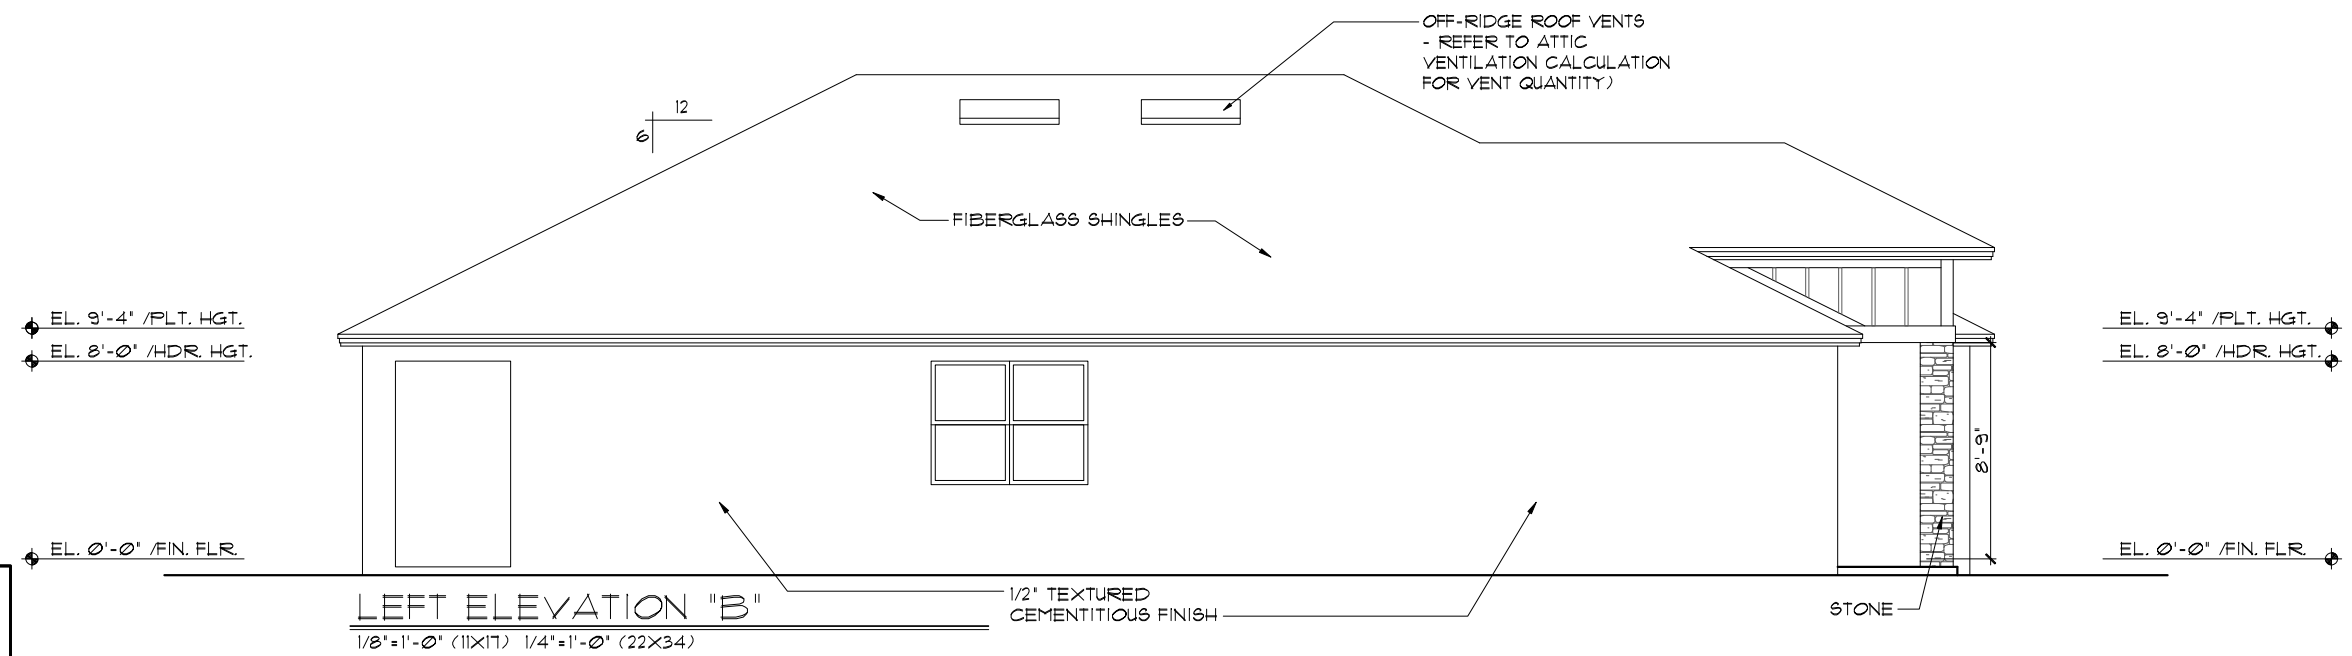

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME


FLORIDA SERIES  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000  
 www.psq.com

REVISIONS	BY
05-16-19	JF

EXTERIOR ELEVATION LEFT AND RIGHT  
 1966  
 MARGATE II  
 DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET 05B OF 00 SHEETS


**EXTERIOR FINISH NOTES**

- LATH TO BE ATTACHED IAW R703.1.1 OF THE 8TH EDITION, FBCR, 2023
- PLASTERING TO BE WITH PORTLAND CEMENT, INSTALLED IAW R703.1.2 OF THE 8TH EDITION, FBCR, 2023
- WEEP SCREED TO BE INSTALLED IAW R703.1.2.1 OF THE 8TH EDITION, FBCR, 2023
- WATER RESISTANT BARRIER TO BE INSTALLED IAW R703.1.3 OF THE 8TH EDITION, FBCR, 2023
- 'ZIP SYSTEMS' WALL SHEATHING MAY BE USED AS AN ALTERNATIVE FOR WALL SHEATHING AND VAPOR BARRIER, ON EXTERIOR WALLS.

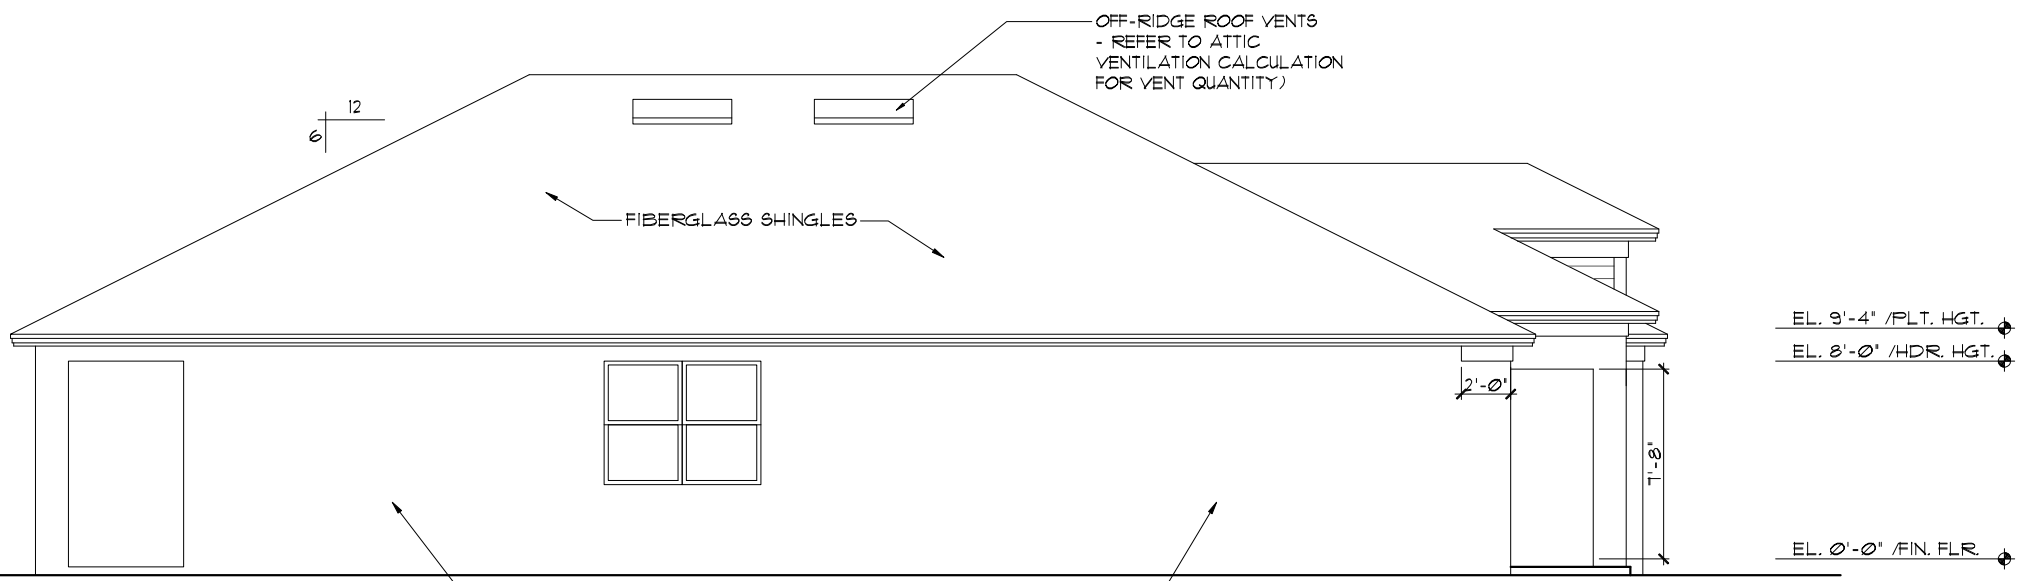


**LEFT ELEVATION "C"**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

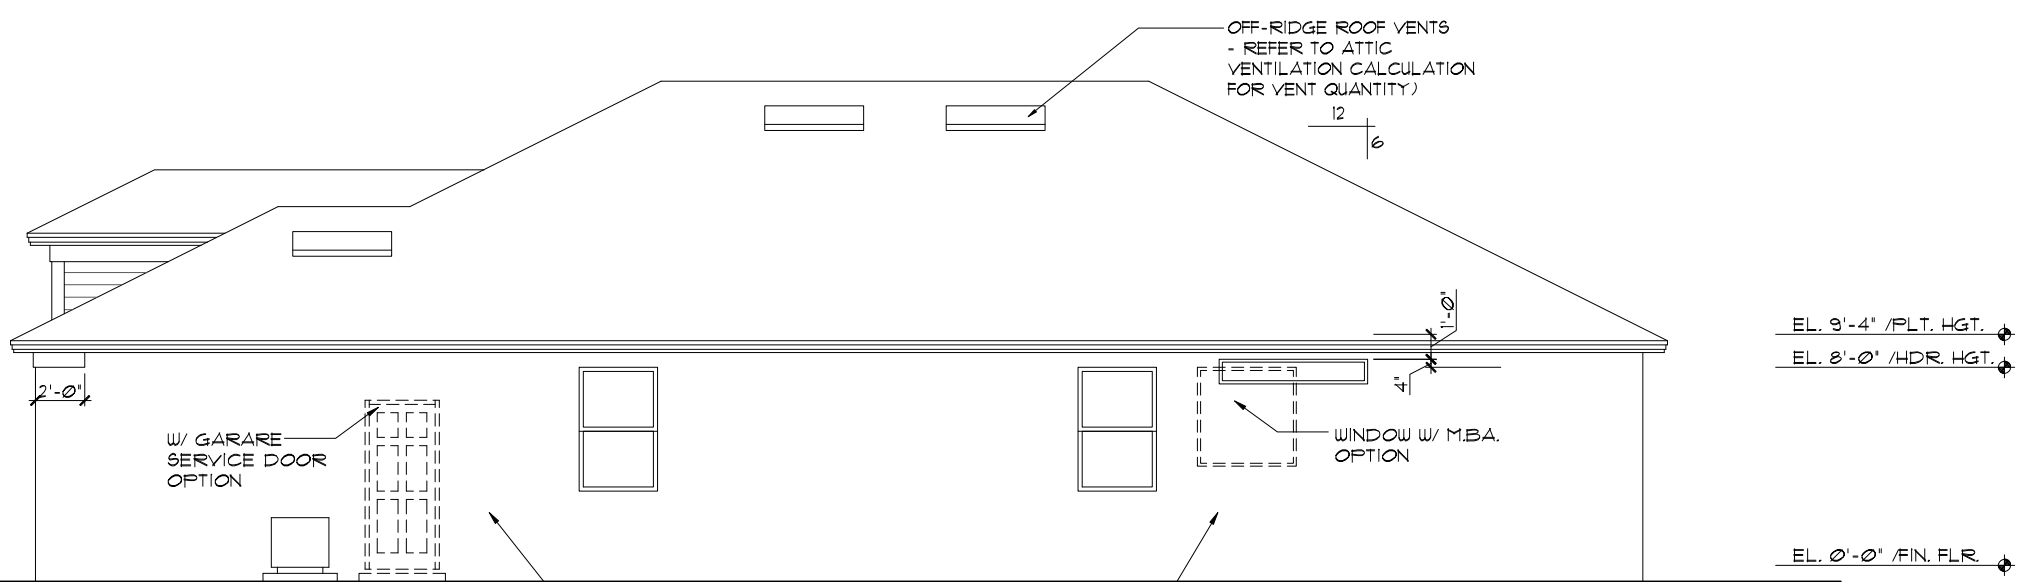

**RIGHT ELEVATION "C"**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

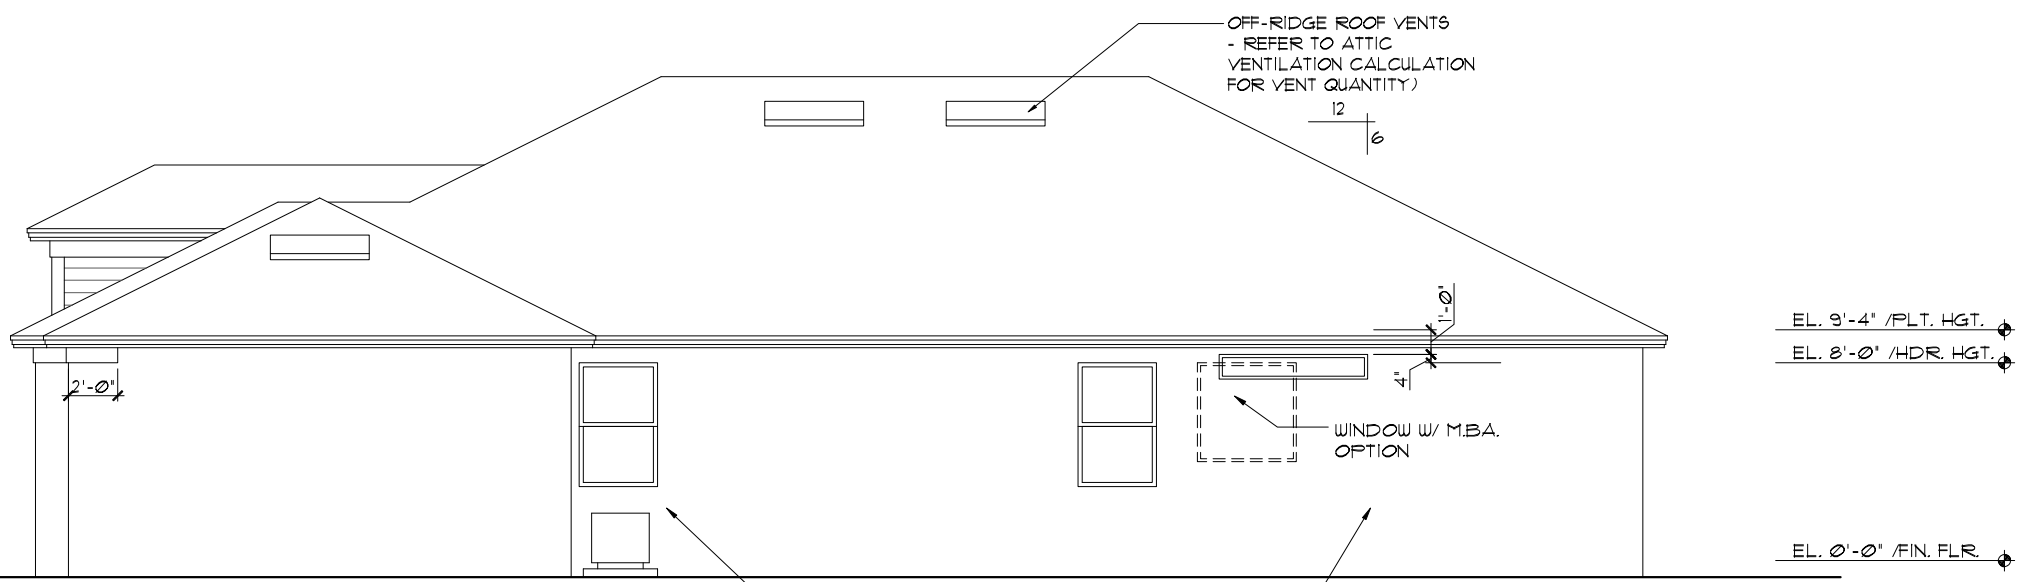

**RIGHT ELEVATION "C" (3-CAR)**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

FLORIDA SERIES

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

© COPYRIGHT 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS	BY
05-16-19	JF



**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 734-1790  
 www.iteg.com

A DIVISION OF PARK SQUARE  
**ENTERPRISES, INC.**  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000

**Park Square HOMES**  
 EXTERIOR ELEVATION  
 LEFT AND RIGHT

1966  
 MARGATE II

DATE 04-05-2017
SCALE AS NOTED
DRAWN RDC
JOB N/A
SHEET
05C
OF 00 SHEETS

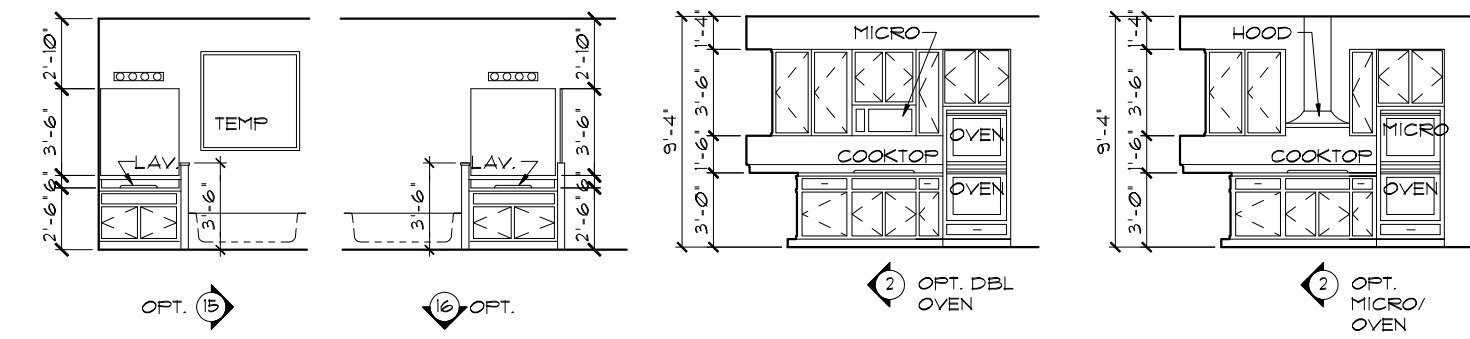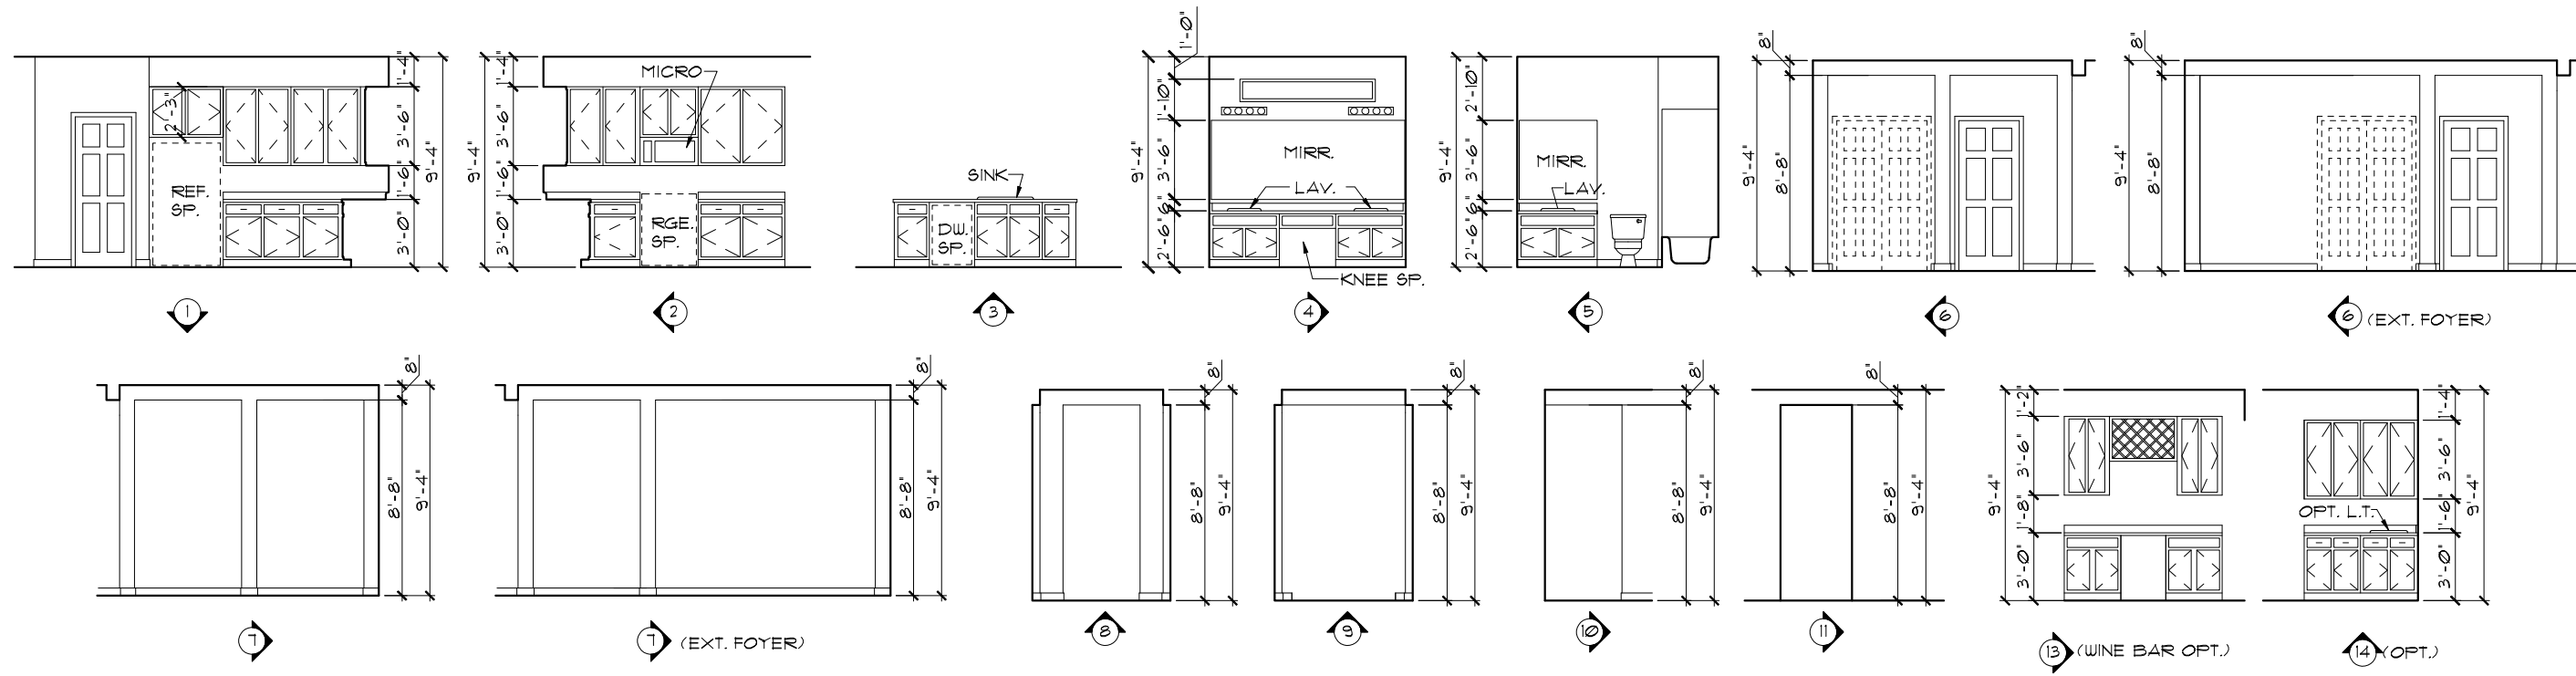


**INTERIOR ELEVATIONS**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)  
 NOTE: INTERIOR ELEVATIONS ARE CONCEPTUAL ONLY.  
 SEE CABINET SHOP DRAWINGS FOR FINAL VERIFICATION.

INSULATION INFORMATION- FBC- ENERGY R402, TABLE R402.12

WALL TYPES	INSULATION
1. CONCRETE BLOCK - INT INSULATION, EXTERIOR	R= 4.0
2. FRAME- WOOD EXTERIOR	R= 13.0
3. FRAME -WOOD, ADJACENT	R= 13.0
CEILING TYPES	
1. UNDER ATTIC (VENTED)	R= 30.0

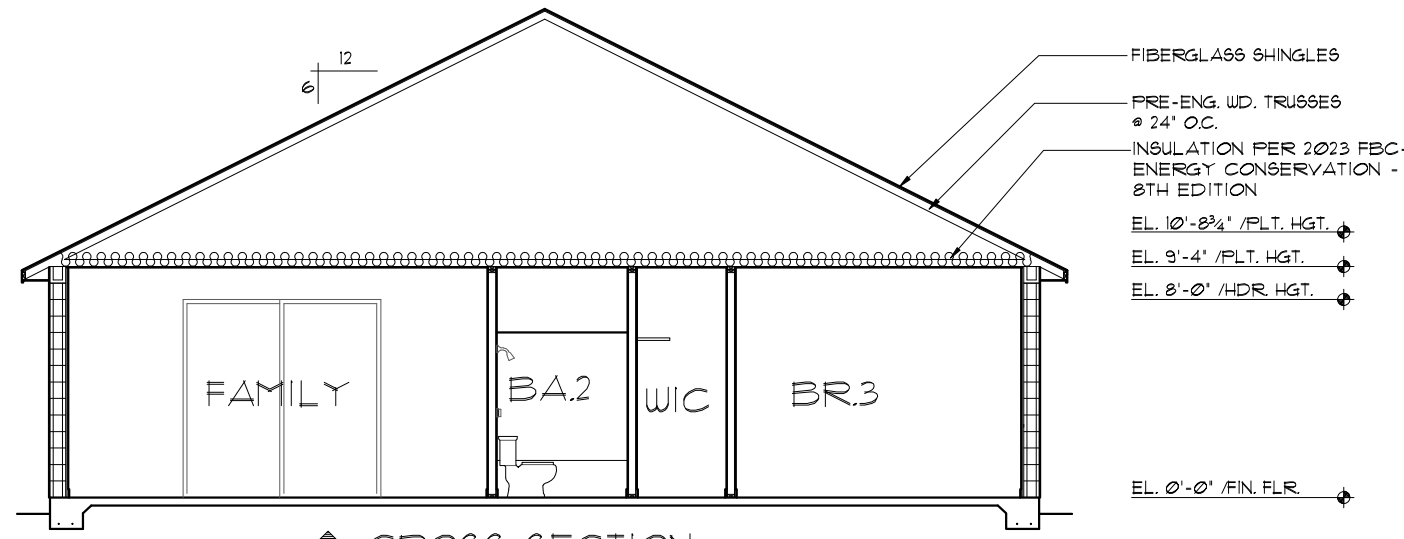

**CROSS SECTION**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
 LOT: 0000, COMMUNITY NAME  
 FLORIDA SERIES  
 1966  
 MARGATE II

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000  
 www.psq.com

INTERIOR ELEVATIONS/  
 CROSS SECTION

REVISIONS	BY
05-16-19	JF

DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET 06  
 OF 06 SHEETS

**MECHANICAL/GENERAL NOTES**

PER 8TH ED. 2023 FLA BLD. CODE-RESIDENTIAL  
 1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION 610.1 ABC.1

2.) APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION, SERVICE, REPAIR AND REPLACEMENT WITHOUT REMOVING PERMANENT CONSTRUCTION.  
 A) CHAPTER 13 OF THE FBC-R 2023 8TH SECTION M1305.1

3.) AIR CONDITIONING SYSTEM SHALL BE COMPLETELY BALANCED. ALL ROOMS ISOLATED FROM THE RETURN AIR SHALL BE PROVIDED WITH MEANS TO COMPLY WITH SECTION M1602 OF THE FBCR CODE 2023 8TH EDITION.

4.) IAW NEC 2020- 210.12-ALL 15A OR 20A, 120V BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES IN THE FOLLOWING LOCATIONS REQUIRE AFCI PROTECTION- KITCHEN, FAMILY RMS, DINING RMS, LIVING RMS, PARLORS, LIBRARIES, BEDROOMS, DENS, CLOSETS, SUNROOMS, RECREATION RMS, HALLWAYS OR SIMILAR AREAS SHALL BE PROTECTED BY A LISTED AFCI DEVICE OF THE COMBINATION TYPE.

5.) IAW NEC 2020- 406.12, ALL 15A AND 20A, 125V RECEPTACLES SHALL BE LISTED AS TAMPER RESISTANT.  
 6.) ALL OUTLETS IN BATHROOMS, KITCHEN, GARAGES AND LAUNDRY ROOM SHALL BE GFCI

7.) SMOKE ALARMS SHALL BE IN ALL SLEEPING AREAS, SHALL BE INTERCONNECTED, SHALL BE WITHIN 1' TO 3' OF PEAK & SHALL BE 3' FROM THE SUPPLY OR RETURN AIR-STREAM & EQUIPPED W/ A BATTERY BACKUP. ALARMS MAY NOT BE CONNECTED WHERE ALARMS ARE WIRELESS & ALL ALARMS SOUND UPON ACTIVATION IAW FBCR R314.3 & R314.4. MODEL\* TO BE USED ON THIS JOB TO BE:  
 BRK: SMOKE-9120B, C/O- SC9120B  
 KIDDE: SMOKE-21007581, C/O 21006377-N

8.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023, 8TH ED. P280.1


9.) ALL EQUIPMENT & APPLIANCES, INCLUDING WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS IT IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023, 8TH ED.

10.) THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3

11.) ALL ELECTRICAL WORK TO BE DONE PER NFPA70-NEC 2020

12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN ACCORDANCE WITH NEC 250.53(A)2)

12.) ALL DWELLING UNIT RECEPTACLE WILL BE IN ACCORDANCE WITH NFPA70-NEC2020 - ARTICLE 210-52

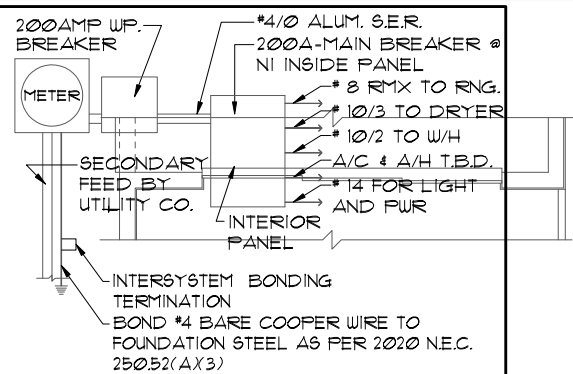

**ELECTRICAL RISER DIAGRAM**

NOTE:  
 N.T.S.  
 ELECTRICAL MATERIALS AND INSTALLATIONS SHALL COMPLY W/ APPLICABLE PROVISIONS OF THE NATIONAL ELEC. CODE 250.52(A)1) TO (6), LOCAL CODES, AND THE LOCAL POWER COMPANY.


250.52(A)3) Concrete-Encased Electrode. Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.


There are two types of concrete-encased electrodes:  
 (1) steel reinforcing bars or rods which are not less than 1/4 inch in diameter and at least 20 ft. long, encased in 2 inches of concrete; (2) 20 ft. of bare copper conductor not smaller than No. 4 AWG encased in 2 inches of concrete.

The steel reinforcing rods must be in a location that is in direct contact with the earth. The reinforcing rods can be connected with tie wires, and a single length of rod can be used as the concrete-encased electrode. The reinforcing rods cannot be coated with non-conductive material.


Section 250.50 requires a concrete-encased electrode to be connected to the grounding electrode system if it is present. Several states have modified this requirement to say a concrete-encased electrode must be used as a grounding electrode only if it is available. In those jurisdictions, if the footings or foundations have been poured before the electrical contractor arrives at the site, and a reinforcing rod is not available for use as a grounding electrode, then a grounding connection to the reinforcing rod is not required.

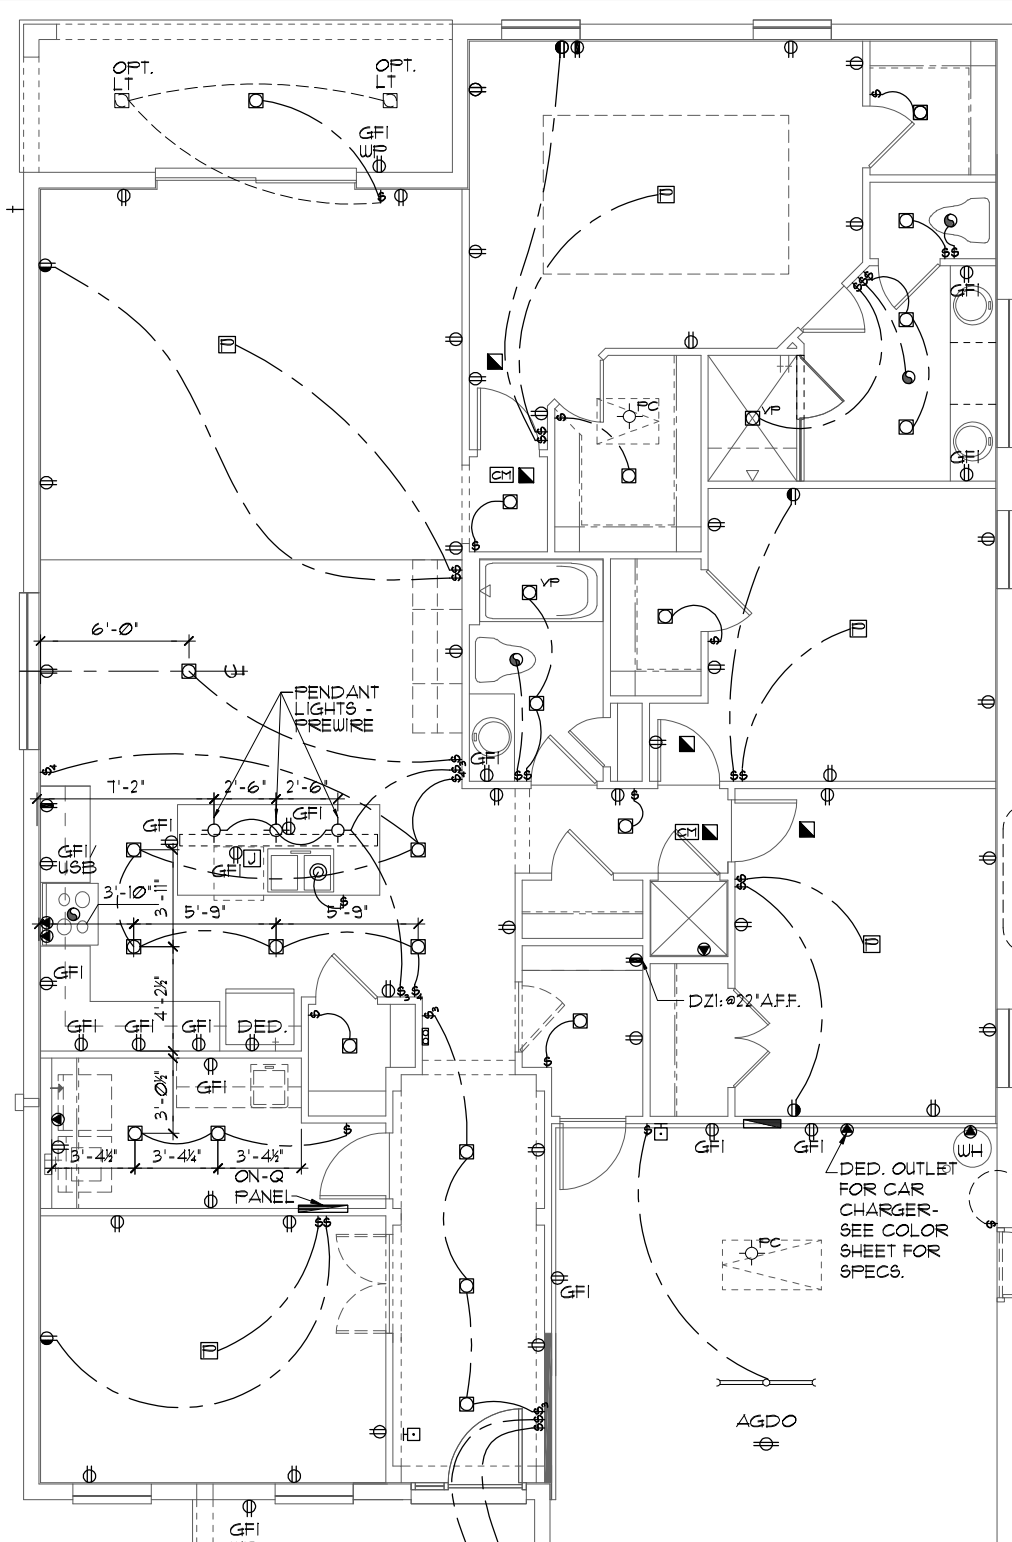

**BEDROOM 4 OPT.**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

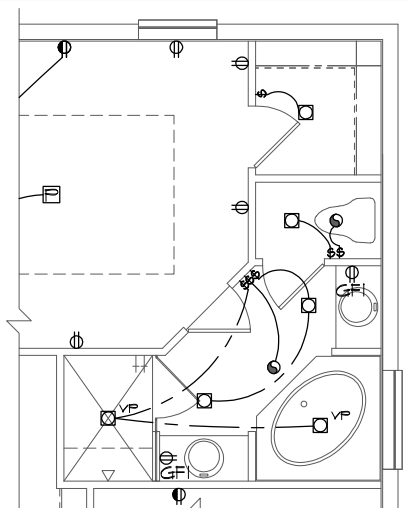


**M.B.A. OPTION**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

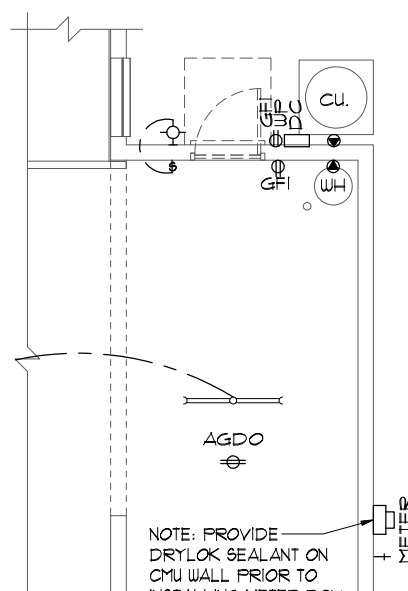

**3-CAR GAR. OPT.**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**ELECTRICAL LEGEND**

⊞	SINGLE POLE SWITCH	◀	OUTLET, TV/CABLE
⊞	THREE WAY SWITCH	◀	OUTLET, PHONE
⊞	OUTLET 110-115	◻	INTERCOM
⊞	OUT. 110-115, SPLIT WIRED	◻	CHIMES
⊞	OUT. 110-115, W/ USB	◻	SMOKE DETECTOR/SMOKE
⊞	OUT. 110-115, CLG. MOUNT.	◻	CARBON MONOXIDE
⊞	OUT. 110-115, FLR. MOUNT.	◻	PUSH BUTTON
⊞	SPL. PURPOSE 220-240	◻	EXHAUST FAN
⊞	LIGHT FIXT., CLG. MTD.	◻	EX. FAN/LIGHT COMBO
⊞	LIGHT FIXT., WALL MTD.	◻	DISPOSAL
⊞	LED LIGHT FIXT., RECESSED	◻	ELECTRICAL PANEL
⊞	LIGHT FIXT., REC. ADJUST.	◻	CEILING FAN, PREWIRE
⊞	LIGHT FIXT., FULL CHAIN	◻	CEILING FAN, INSTALL
⊞	LED LIGHT FIXT., FLUORESCENT	◻	ELECT. JUNCTION BOX
⊞	LIGHT FIXT., EXT. FLOODS	◻	THERMOSTAT
⊞	LIGHT FIXT., EMERG. EXIT	◻	DISCONNECT SWITCH
⊞	LIGHT FIXT., EXIT/BACKUP	◻	ELEC. POWER METER

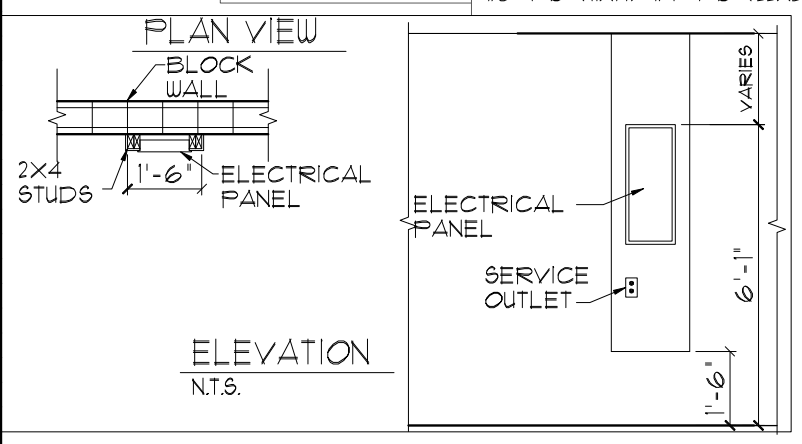

**ELECTRICAL PLAN**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

NOTE: SEE FINAL COLOR SHEET FOR TV, FANS & PHONE LOCATIONS  
 NOTE: ON-Q BOX TO BE INSTALLED PER COMMUNITY SPECS

**FLORIDA SERIES**

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

**LOT: 0000, COMMUNITY NAME**

1966  
**MARGATE II**

**ELECTRICAL PLAN**  
**EXTENDED FOYER**

DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET 07 OF 00 SHEETS

**ITEG**  
 ITC ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000

**Park Square HOMES**  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000

REVISIONS BY  
 05-16-19 JF

THIS PLAN, IDEAS, AND DESIGN ARE NOT TO BE COPIED OR REPRODUCED IN ANY MANNER OR FORM WITHOUT THE EXPRESS WRITTEN PERMISSION FROM PARK SQUARE HOMES.

**MECHANICAL/GENERAL NOTES**

PER 8TH ED. 2023 FLA BLD. CODE-RESIDENTIAL  
 1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION 610.1 ABC1

2.) APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION, SERVICE, REPAIR AND REPLACEMENT WITHOUT REMOVING PERMANENT CONSTRUCTION.  
 A) CHAPTER 13 OF THE FBC-R 2023 8TH SECTION M1305.1

3.) AIR CONDITIONING SYSTEM SHALL BE COMPLETELY BALANCED. ALL ROOMS ISOLATED FROM THE RETURN AIR SHALL BE PROVIDED WITH MEANS TO COMPLY WITH SECTION M1602 OF THE FBCR CODE 2023 8TH EDITION.

4.) IAW NEC 2020- 210.12-ALL 15A OR 20A, 120V BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES IN THE FOLLOWING LOCATIONS REQUIRE AFCI PROTECTION- KITCHEN, FAMILY RMS, DINING RMS, LIVING RMS, PARLORS, LIBRARIES, BEDROOMS, DENS, CLOSETS, SUNROOMS, RECREATION RMS, HALLWAYS OR SIMILAR AREAS SHALL BE PROTECTED BY A LISTED AFCI DEVICE OF THE COMBINATION TYPE.

5.) IAW NEC 2020- 406.12, ALL 15A AND 20A, 125V RECEPTACLES SHALL BE LISTED AS TAMPER RESISTANT.

6.) ALL OUTLETS IN BATHROOMS, KITCHEN, GARAGES AND LAUNDRY ROOM SHALL BE GFCI

7.) SMOKE ALARMS SHALL BE IN ALL SLEEPING AREAS, SHALL BE INTERCONNECTED, SHALL BE WITHIN 1' TO 3' OF PEAK & SHALL BE 3' FROM THE SUPPLY OR RETURN AIR-STREAM & EQUIPPED W/ A BATTERY BACKUP. ALARMS MAY NOT BE CONNECTED WHERE ALARMS ARE WIRELESS & ALL ALARMS SOUND UPON ACTIVATION IAW FBCR R314.3 & R314.4. MODEL\* TO BE USED ON THIS JOB TO BE:  
 BRK: SMOKE-9120B, C/O- SC9120B  
 KIDDE: SMOKE-21007581, C/O 21006377-N

8.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023, 8TH ED. P2801.1


9.) ALL EQUIPMENT & APPLIANCES, INCLUDING WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS IT IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023, 8TH ED.

10.) THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3

11.) ALL ELECTRICAL WORK TO BE DONE PER NFPA70-NEC 2020

12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN ACCORDANCE WITH NEC 250.53(A)2)

12.) ALL DWELLING UNIT RECEPTACLE WILL BE IN ACCORDANCE WITH NFPA70-NEC2020 - ARTICLE 210-52

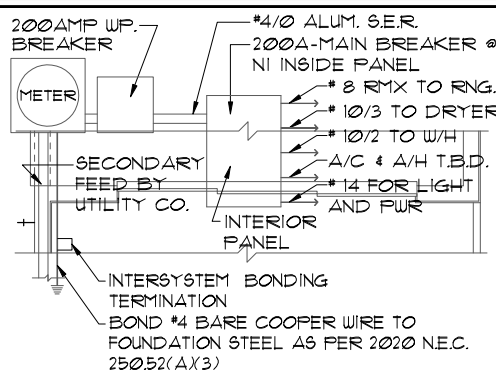



250.52(A)3) Concrete-Encased Electrode. Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.


There are two types of concrete-encased electrodes:  
 (1) steel reinforcing bars or rods which are not less than 1/2 inch in diameter and at least 20 ft. long, encased in 2 inches of concrete;  
 (2) 20 ft. of bare copper conductor not smaller than No. 4 AWG encased in 2 inches of concrete.

The steel reinforcing rods must be in a location that is in direct contact with the earth. The reinforcing rods can be connected with tie wires, and a single length of rod can be used as the concrete-encased electrode. The reinforcing rods cannot be coated with non-conductive material.

Section 250.50 requires a concrete-encased electrode to be connected to the grounding electrode system if it is present. Several states have modified this requirement to say a concrete-encased electrode must be used as a grounding electrode only if it is available. In those jurisdictions, if the footing or foundations have been poured before the electrical contractor arrives at the site, and a reinforcing rod is not available for use as a grounding electrode, then a grounding connection to the reinforcing rod is not required.

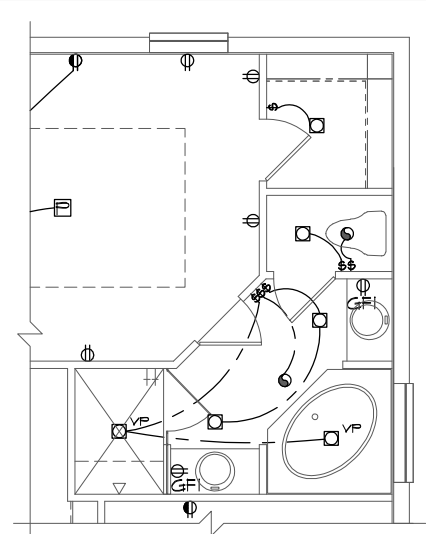
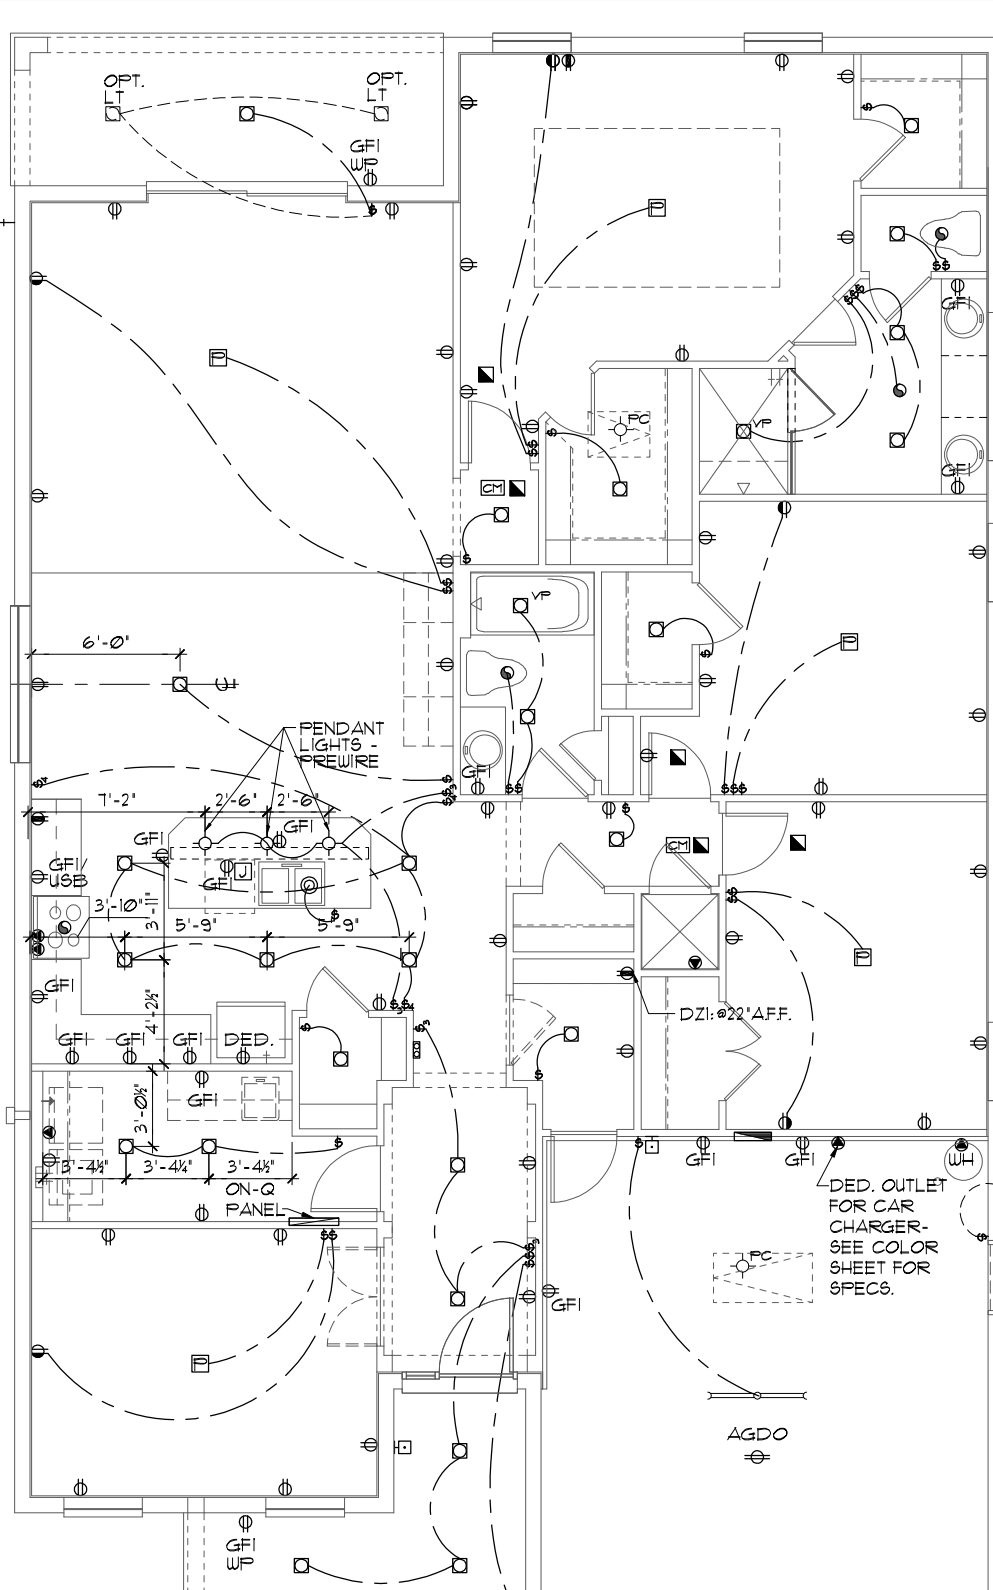


**M. BA. OPTION**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

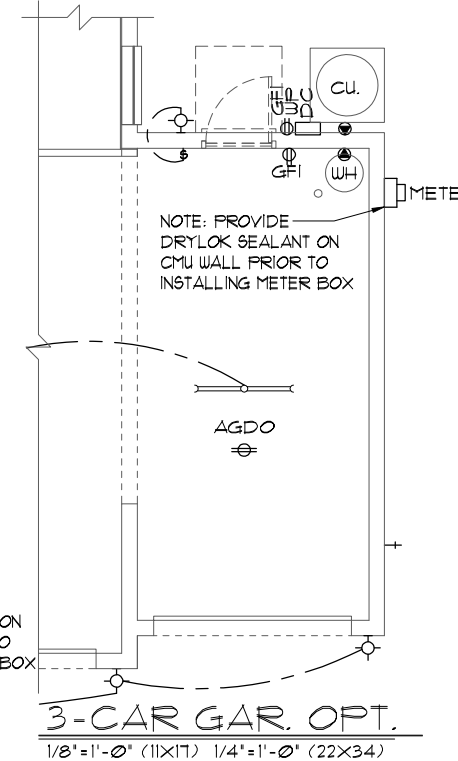

**ELECTRICAL LEGEND**

⊞	SINGLE POLE SWITCH	⊞	OUTLET, TV/CABLE
⊞	THREE WAY SWITCH	⊞	OUTLET, PHONE
⊞	OUTLET 110-115	⊞	INTERCOM
⊞	OUT. 110-115, SPLIT WIRED	⊞	CHIMES
⊞	OUT. 110-115, W/ USB	⊞	SMOKE DETECTOR/SMOKE
⊞	OUT. 110-115, CLG. MOUNT.	⊞	CARBON MONOXIDE
⊞	OUT. 110-115, FLR. MOUNT.	⊞	PUSH BUTTON
⊞	SPL. PURPOSE 220-240	⊞	EXHAUST FAN
⊞	LIGHT FIXT., CLG. MTD.	⊞	EX. FAN/LIGHT COMBO
⊞	LIGHT FIXT., WALL MTD.	⊞	DISPOSAL
⊞	LIGHT FIXT., RECESSED	⊞	ELECTRICAL PANEL
⊞	LIGHT FIXT., REC. ADJUST.	⊞	CEILING FAN, PREWIRE
⊞	LIGHT FIXT., FULL CHAIN	⊞	CEILING FAN, INSTALL
⊞	LED LIGHT FIXT., FLUORESCENT	⊞	ELECT. JUNCTION BOX
⊞	LIGHT FIXT., EXT. FLOODS	⊞	THERMOSTAT
⊞	LIGHT FIXT., EMERG. EXIT	⊞	DISCONNECT SWITCH
⊞	LIGHT FIXT., EXIT/BACKUP	⊞	ELEC. POWER METER

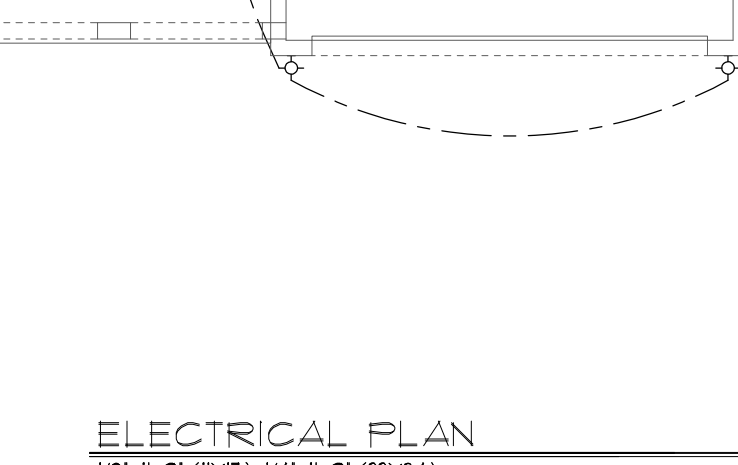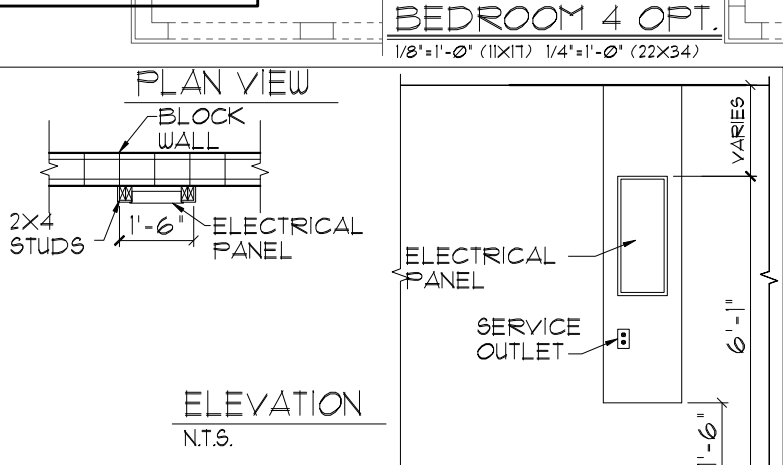

NOTE: ON-Q BOX TO BE INSTALLED PER COMMUNITY SPECS  
 NOTE: SEE FINAL COLOR SHEET FOR TV, FANS & PHONE LOCATIONS

**FLORIDA SERIES**

**LOT: 0000, COMMUNITY NAME**

**1966 MARGATE II**

**ELECTRICAL PLAN**

**DATE 04-05-2017**

**SCALE AS NOTED**

**DRAWN RDC**

**JOB N/A**

**SHEET 07**

**OF 00 SHEETS**

**NOTE: THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH**

**ITEG**  
 ITCORPORATION ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 734-1790  
 www.iteg.com

**REVISIONS**

REVISIONS	BY
05-16-19	JF

**Park Square HOMES**  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000

**MECHANICAL/GENERAL NOTES**

PER 8TH ED. 2023 FLA BLD. CODE-RESIDENTIAL  
 1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION 610.1 ABC1

2.) APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION, SERVICE, REPAIR AND REPLACEMENT WITHOUT REMOVING PERMANENT CONSTRUCTION.  
 A) CHAPTER 13 OF THE FBC-R 2023 8TH SECTION M1305.1

3.) AIR CONDITIONING SYSTEM SHALL BE COMPLETELY BALANCED. ALL ROOMS ISOLATED FROM THE RETURN AIR SHALL BE PROVIDED WITH MEANS TO COMPLY WITH SECTION M1602 OF THE FBCR CODE 2023 8TH EDITION.

4.) IAW NEC 2020- 210.12-ALL 15A OR 20A, 120V BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES IN THE FOLLOWING LOCATIONS REQUIRE AFCI PROTECTION- KITCHEN, FAMILY RMS, DINING RMS, LIVING RMS, PARLORS, LIBRARIES, BEDROOMS, DEN, CLOSETS, SUNROOMS, RECREATION RMS, HALLWAYS OR SIMILAR AREAS SHALL BE PROTECTED BY A LISTED AFCI DEVICE OF THE COMBINATION TYPE.

5.) IAW NEC 2020- 406.12, ALL 15A AND 20A, 125V RECEPTACLES SHALL BE LISTED AS TAMPER RESISTANT.  
 6.) ALL OUTLETS IN BATHROOMS, KITCHEN, GARAGES AND LAUNDRY ROOM SHALL BE GFCI

7.) SMOKE ALARMS SHALL BE IN ALL SLEEPING AREAS, SHALL BE INTERCONNECTED, SHALL BE WITHIN 1' TO 3' OF PEAK & SHALL BE 3' FROM THE SUPPLY OR RETURN AIR-STREAM & EQUIPPED W/ A BATTERY BACKUP. ALARMS MAY NOT BE CONNECTED WHERE ALARMS ARE WIRELESS & ALL ALARMS SOUND UPON ACTIVATION IAW FBCR R314.3 & R314.4. MODEL # TO BE USED ON THIS JOB TO BE:  
 BRK: SMOKE-9120B, C/O- SC9120B  
 KIDDE: SMOKE-21007581, C/O 21006377-N

8.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023, 8TH ED. P2801.1


9.) ALL EQUIPMENT & APPLIANCES, INCLUDING WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS IT IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023, 8TH ED.

10.) THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3

11.) ALL ELECTRICAL WORK TO BE DONE PER NFPA70-NEC 2020

12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN ACCORDANCE WITH NEC 250.53(A)2

12.) ALL DWELLING UNIT RECEPTACLE WILL BE IN ACCORDANCE WITH NFPA70-NEC2020 - ARTICLE 210-52

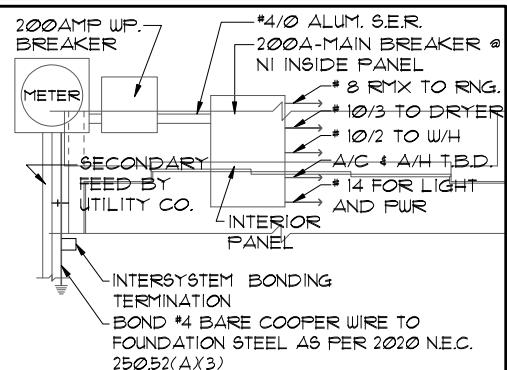

NOTE:  
 ELECTRICAL MATERIALS AND INSTALLATIONS SHALL COMPLY W/ APPLICABLE PROVISIONS OF THE NATIONAL ELEC. CODE 250.52(A)1) TO (6), LOCAL CODES, AND THE LOCAL POWER COMPANY.



250.52(A)3) Concrete-Encased Electrode. Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

There are two types of concrete-encased electrodes:  
 (1) steel reinforcing bars or rods which are not less than 1/4 inch in diameter and at least 20 ft. long, encased in 2 inches of concrete;  
 (2) 20 ft. of bare copper conductor not smaller than No. 4 AWG encased in 2 inches of concrete.


The steel reinforcing rods must be in a location that is in direct contact with the earth. The reinforcing rods can be connected with tie wires, and a single length of rod can be used as the concrete-encased electrode. The reinforcing rods cannot be coated with non-conductive material.

Section 250.50 requires that concrete-encased electrode to be connected to the grounding electrode system if it is present. Several states have modified this requirement to say a concrete-encased electrode must be used as a grounding electrode only if it is available. In those jurisdictions, if the footings or foundations have been poured before the electrical contractor arrives at the site, and a reinforcing rod is not available for use as a grounding electrode, then a grounding connection to the reinforcing rod is not required.

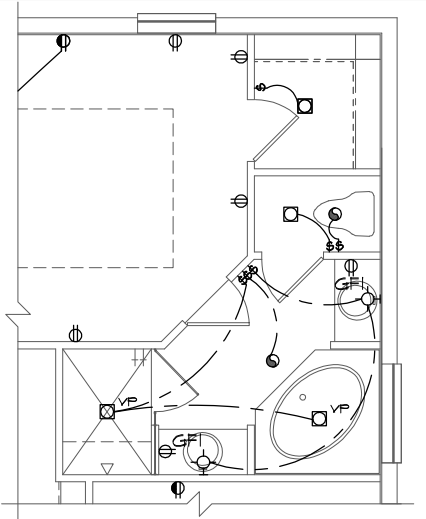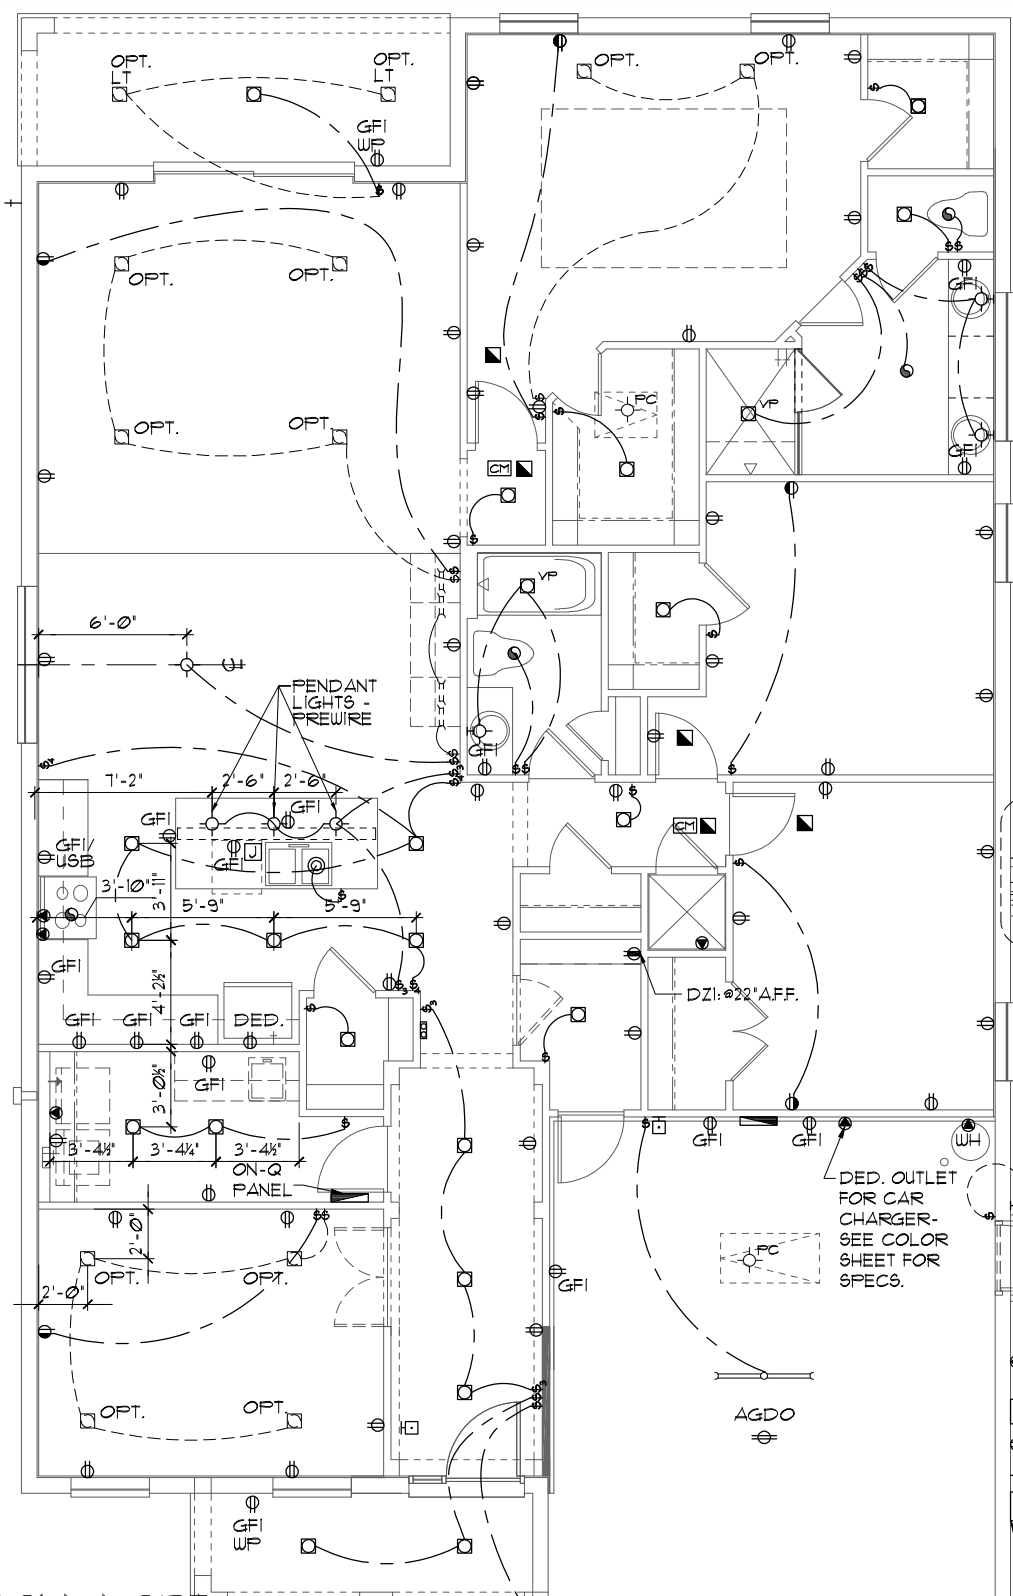


**ELECTRICAL LEGEND**

⊞	SINGLE POLE SWITCH	◀	OUTLET, TV/CABLE
⊞	THREE WAY SWITCH	◀	OUTLET, PHONE
⊞	OUTLET 110-115	◻	INTERCOM
⊞	OUT. 110-115, SPLIT WIRED	⊞	CHIMES
⊞	OUT. 110-115, W/ USB	⊞	SMOKE DETECTOR/SMOKE
⊞	OUT. 110-115, CLG. MOUNT.	⊞	CARBON MONOXIDE
⊞	OUT. 110-115, FLR. MOUNT.	⊞	PUSH BUTTON
⊞	SPCL. PURPOSE 220-240	⊞	EXHAUST FAN
⊞	LIGHT FIXT., CLG. MTD.	⊞	EX. FAN/LIGHT COMBO
⊞	LIGHT FIXT., WALL MTD.	⊞	DISPOSAL
⊞	LED LIGHT FIXT., RECESSED	⊞	ELECTRICAL PANEL
⊞	LIGHT FIXT., REC. ADJUST.	⊞	CEILING FAN, PREWIRE
⊞	LIGHT FIXT., PULL CHAIN	⊞	CEILING FAN, INSTALL
⊞	LED LIGHT FIXT., FLUORESCENT	⊞	ELECT. JUNCTION BOX
⊞	LIGHT FIXT., EXT. FLOODS	⊞	THERMOSTAT
⊞	LIGHT FIXT., EMERG. EXIT	⊞	DISCONNECT SWITCH
⊞	LIGHT FIXT., EXIT/BACKUP	⊞	ELEC. POWER METER

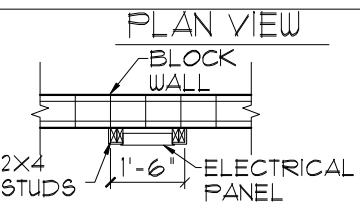

**BEDROOM 4 OPT.**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

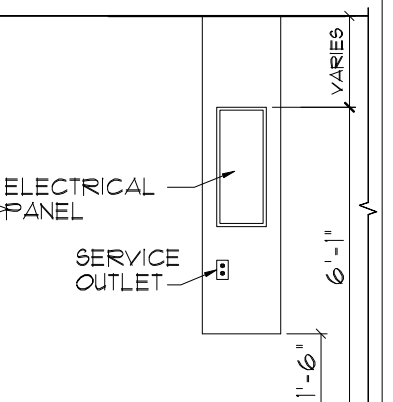

**ELECTRICAL PLAN**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

NOTE: ON-Q BOX TO BE INSTALLED PER COMMUNITY SPECS  
 NOTE: SEE FINAL COLOR SHEET FOR TV, FANS & PHONE LOCATIONS

LOT: 000, COMMUNITY NAME  
 THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
 FLORIDA SERIES  
 1966  
 MARGATE II  
 DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET 07 OF 00 SHEETS

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000  
**Park Square HOMES**  
**ITEG**  
 ITCORPORATION ENGINEERING GROUP, INC.  
 11000 W. US HWY 19, SUITE 100  
 TAMPA, FLORIDA 33613  
 TEL: (813) 974-1400  
 FAX: (813) 974-1700  
 www.iteg.com  
 REVISIONS BY  
 05-16-19 JF

**MECHANICAL/GENERAL NOTES**

PER 8TH ED. 2023 FLA BLD. CODE-RESIDENTIAL  
 1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION 610.1 ABC.1

2.) APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION, SERVICE, REPAIR AND REPLACEMENT WITHOUT REMOVING PERMANENT CONSTRUCTION.  
 A) CHAPTER 13 OF THE FBC-R 2023 8TH SECTION M1305.1

3.) AIR CONDITIONING SYSTEM SHALL BE COMPLETELY BALANCED. ALL ROOMS ISOLATED FROM THE RETURN AIR SHALL BE PROVIDED WITH MEANS TO COMPLY WITH SECTION M1602 OF THE FBCR CODE 2023 8TH EDITION.

4.) IAW NEC 2020- 210.12-ALL 15A OR 20A, 120V BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES IN THE FOLLOWING LOCATIONS REQUIRE AFCI PROTECTION- KITCHEN, FAMILY RMS, DINING RMS, LIVING RMS, PARLORS, LIBRARIES, BEDROOMS, DENS, CLOSETS, SUNROOMS, RECREATION RMS, HALLWAYS OR SIMILAR AREAS SHALL BE PROTECTED BY A LISTED AFCI DEVICE OF THE COMBINATION TYPE.

5.) IAW NEC 2020- 406.12, ALL 15A AND 20A, 125V RECEPTACLES SHALL BE LISTED AS TAMPER RESISTANT.  
 6.) ALL OUTLETS IN BATHROOMS, KITCHEN, GARAGES AND LAUNDRY ROOM SHALL BE GFCI

7.) SMOKE ALARMS SHALL BE IN ALL SLEEPING AREAS, SHALL BE INTERCONNECTED, SHALL BE WITHIN 1' TO 3' OF PEAK & SHALL BE 3' FROM THE SUPPLY OR RETURN AIR-STREAM & EQUIPPED W/ A BATTERY BACKUP. ALARMS MAY NOT BE CONNECTED WHERE ALARMS ARE WIRELESS & ALL ALARMS SOUND UPON ACTIVATION IAW FBCR R314.3 & R314.4. MODEL\* TO BE USED ON THIS JOB TO BE:  
 BRK: SMOKE-9120B, C/O- SC9120B  
 KIDDE: SMOKE-21007581, C/O 21006377-N

8.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023, 8TH ED. P2801.1


9.) ALL EQUIPMENT & APPLIANCES, INCLUDING WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS IT IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023, 8TH ED.

10.) THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3

11.) ALL ELECTRICAL WORK TO BE DONE PER NFPA70-NEC 2020

12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN ACCORDANCE WITH NEC 250.53(A)2)

12.) ALL DWELLING UNIT RECEPTACLE WILL BE IN ACCORDANCE WITH NFPA70-NEC2020 - ARTICLE 210-52

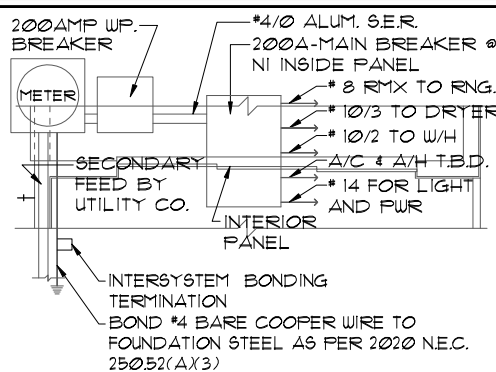

**ELECTRICAL RISER DIAGRAM**

NOTE: N.T.S.  
 ELECTRICAL MATERIALS AND INSTALLATIONS SHALL COMPLY W/ APPLICABLE PROVISIONS OF THE NATIONAL ELEC. CODE 250.52(A)1) TO (6), LOCAL CODES, AND THE LOCAL POWER COMPANY.


250.52(A)3) Concrete-Encased Electrode. Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

There are two types of concrete-encased electrodes:  
 (1) steel reinforcing bars or rods which are not less than 1/4 inch in diameter and at least 20 ft. long, encased in 2 inches of concrete;  
 (2) 20 ft. of bare copper conductor not smaller than No. 4 AWG encased in 2 inches of concrete.




The steel reinforcing rods must be in a location that is in direct contact with the earth. The reinforcing rods can be connected with tie wires, and a single length of rod can be used as the concrete-encased electrode. The reinforcing rods cannot be coated with non-conductive material.

Section 250.50 requires a concrete-encased electrode to be connected to the grounding electrode system if it is present. Several states have modified this requirement to say a concrete-encased electrode must be used as a grounding electrode only if it is available. In those jurisdictions, if the footings or foundations have been poured before the electrical contractor arrives at the site, and a reinforcing rod is not available for use as a grounding electrode, then a grounding connection to the reinforcing rod is not required.

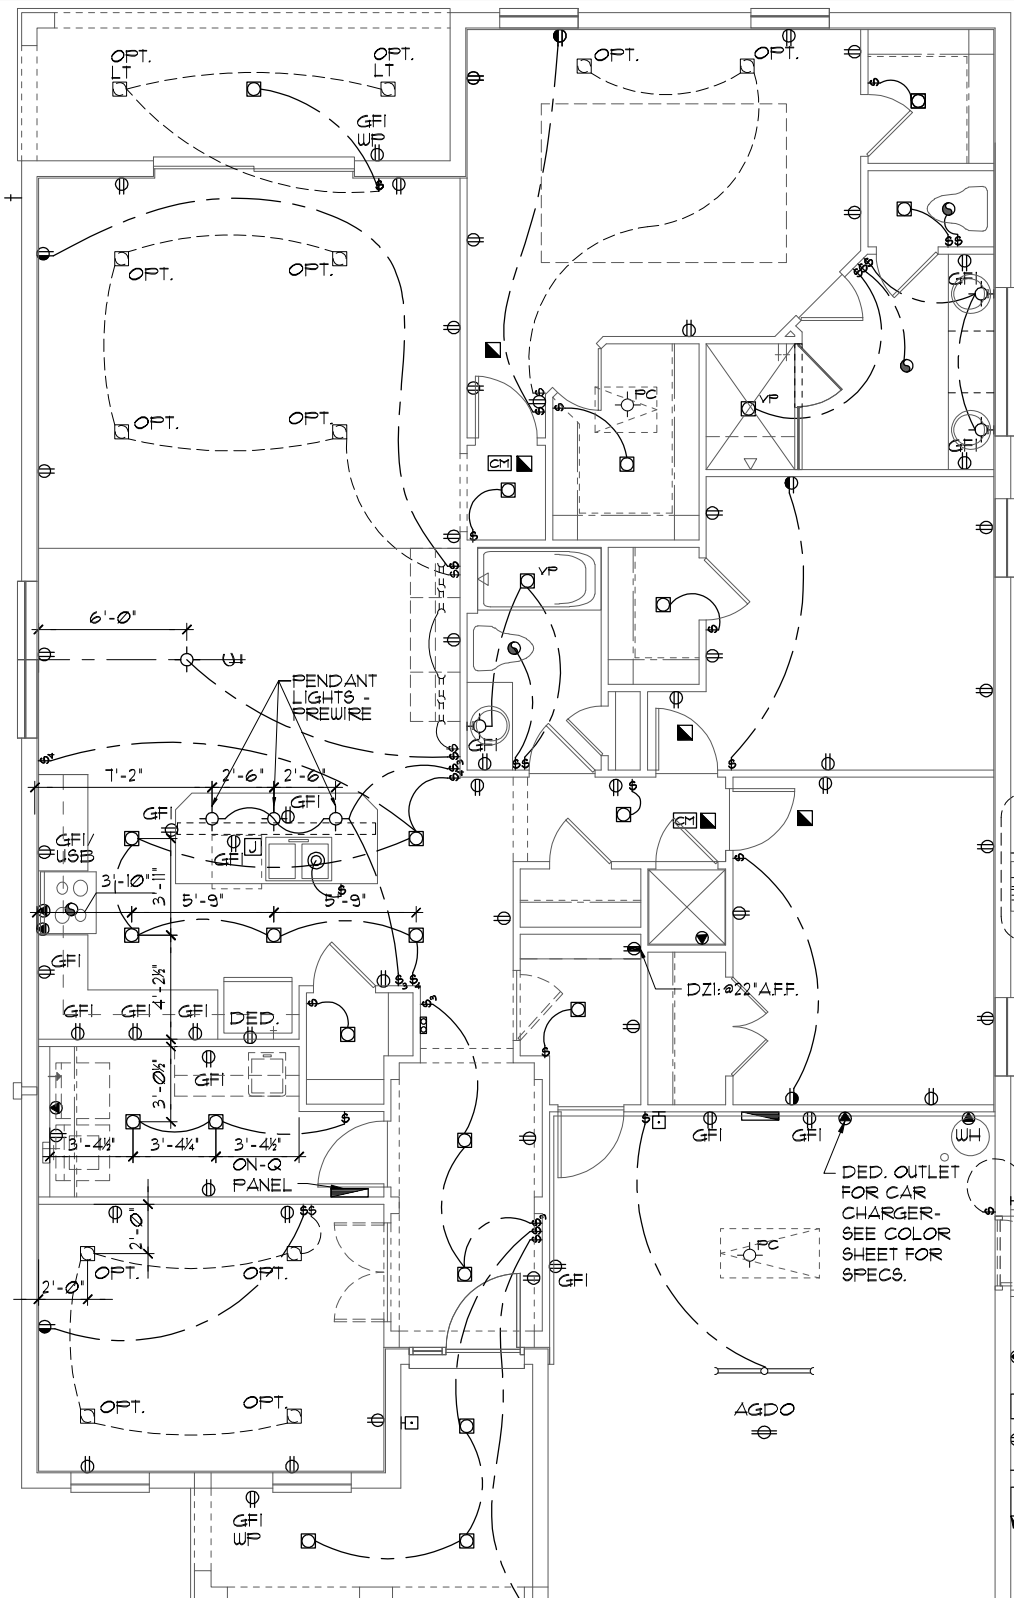


**BEDROOM 4 OPT.**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

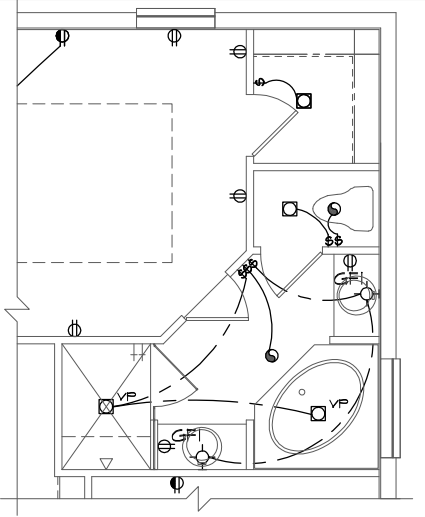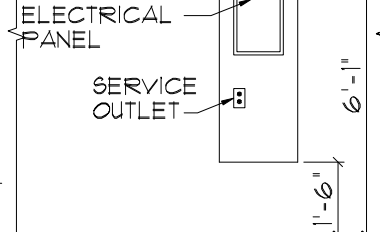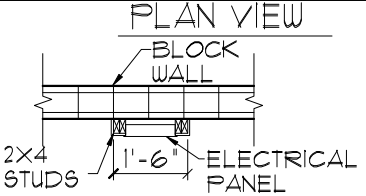

**M.B.A. OPTION**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

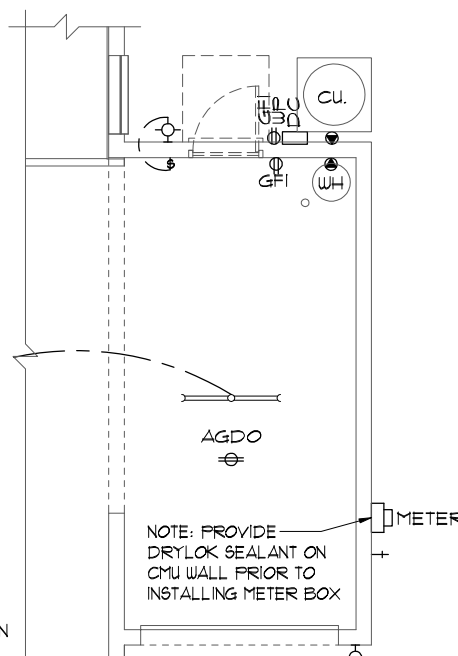

**3-CAR GAR. OPT.**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**ELECTRICAL LEGEND**

⊞	SINGLE POLE SWITCH	◀	OUTLET, TV/CABLE
⊞	THREE WAY SWITCH	◀	OUTLET, PHONE
⊞	OUTLET 110-115	◻	INTERCOM
⊞	OUT. 110-115, SPLIT WIRED	◻	CHIMES
⊞	OUT. 110-115, W/ USB	◻	SMOKE DETECTOR/SMOKE
⊞	OUT. 110-115, CL.G. MOUNT.	◻	CARBON MONOXIDE
⊞	OUT. 110-115, FLR. MOUNT.	◻	PUSH BUTTON
⊞	SPCL. PURPOSE 220-240	◻	EXHAUST FAN
⊞	LIGHT FIXT., CL.G. MTD.	◻	EX. FAN/LIGHT COMBO
⊞	LIGHT FIXT., WALL MTD.	◻	DISPOSAL
⊞	LED LIGHT FIXT., RECESSED	◻	ELECTRICAL PANEL
⊞	LIGHT FIXT., REC. ADJUST.	◻	CEILING FAN, PREWIRE
⊞	LIGHT FIXT., FULL CHAIN	◻	CEILING FAN, INSTALL
⊞	LED LIGHT FIXT., FLUORESCENT	◻	ELECT. JUNCTION BOX
⊞	LIGHT FIXT., EXT. FLOODS	◻	THERMOSTAT
⊞	LIGHT FIXT., EMERG. EXIT	◻	DISCONNECT SWITCH
⊞	LIGHT FIXT., EXIT/BACKUP	◻	ELEC. POWER METER

NOTE: SEE FINAL COLOR SHEET FOR TV, FANS & PHONE LOCATIONS

NOTE: ON-Q BOX TO BE INSTALLED PER COMMUNITY SPECS

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

1966 MARGATE II

ELECTRICAL PLAN

DATE 04-05-2017

SCALE AS NOTED

DRAWN RDC

JOB N/A

SHEET 07 OF 00 SHEETS

FLORIDA SERIES

REVISIONS BY

05-16-19 JF

IITEG

IITEG ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Tel: (407) 734-1400  
 Fax: (407) 734-1790  
 www.iiteg.com

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000

Park Square HOMES

ELECTRICAL PLAN

1966 MARGATE II

DATE 04-05-2017

SCALE AS NOTED

DRAWN RDC

JOB N/A

SHEET 07 OF 00 SHEETS

**MECHANICAL/GENERAL NOTES**

PER 8TH ED. 2023 FLA BLD. CODE-RESIDENTIAL  
 1.) COMPLETE DUCT DESIGN W/ SIZES & R-VALUE COMPLYING W/ THE FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION 610.1 ABC1

2.) APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION, SERVICE, REPAIR AND REPLACEMENT WITHOUT REMOVING PERMANENT CONSTRUCTION.  
 A) CHAPTER 13 OF THE FBC-R 2023 8TH SECTION M1305.1

3.) AIR CONDITIONING SYSTEM SHALL BE COMPLETELY BALANCED. ALL ROOMS ISOLATED FROM THE RETURN AIR SHALL BE PROVIDED WITH MEANS TO COMPLY WITH SECTION M1602 OF THE FBCR CODE 2023 8TH EDITION.

4.) IAW NEC 2020- 210.12-ALL 15A OR 20A, 120V BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES IN THE FOLLOWING LOCATIONS REQUIRE AFCI PROTECTION- KITCHEN, FAMILY RMS, DINING RMS, LIVING RMS, PARLORS, LIBRARIES, BEDROOMS, DEN, CLOSETS, SUNROOMS, RECREATION RMS, HALLWAYS OR SIMILAR AREAS SHALL BE PROTECTED BY A LISTED AFCI DEVICE OF THE COMBINATION TYPE.

5.) IAW NEC 2020- 406.12, ALL 15A AND 20A, 125V RECEPTACLES SHALL BE LISTED AS TAMPER RESISTANT.  
 6.) ALL OUTLETS IN BATHROOMS, KITCHEN, GARAGES AND LAUNDRY ROOM SHALL BE GFCI

7.) SMOKE ALARMS SHALL BE IN ALL SLEEPING AREAS, SHALL BE INTERCONNECTED, SHALL BE WITHIN 1' TO 3' OF PEAK & SHALL BE 3' FROM THE SUPPLY OR RETURN AIR-STREAM & EQUIPPED W/ A BATTERY BACKUP. ALARMS MAY NOT BE CONNECTED WHERE ALARMS ARE WIRELESS & ALL ALARMS SOUND UPON ACTIVATION IAW FBCR R314.3 & R314.4. MODEL\* TO BE USED ON THIS JOB TO BE:  
 BRK: SMOKE-9120B, C/O- SC9120B  
 KIDDE: SMOKE-21007581, C/O 21006377-N

8.) ALL WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS WATER HEATER IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023, 8TH ED. P280.1


9.) ALL EQUIPMENT & APPLIANCES, INCLUDING WATER HEATERS HAVING AN IGNITION SOURCE TO BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS MINIMUM 18" ABOVE GARAGE FLOOR UNLESS IT IS LISTED AS FLAMMABLE VAPOR IGNITION RESISTANT. IAW FBCR 2023, 8TH ED.

10.) THE MAXIMUM ALLOWABLE EXHAUST DUCT LENGTH SHALL BE DETERMINED BY ONE OF THE METHODS SPECIFIED IN SECTIONS M1502.4.5.1 THROUGH M1502.4.5.3

11.) ALL ELECTRICAL WORK TO BE DONE PER NFPA70-NEC 2020

12.) ADDITIONAL ELECTRODE MAY BE REQUIRED IN ACCORDANCE WITH NEC 250.53(A)2)

12.) ALL DWELLING UNIT RECEPTACLE WILL BE IN ACCORDANCE WITH NFPA70-NEC2020 - ARTICLE 210-52

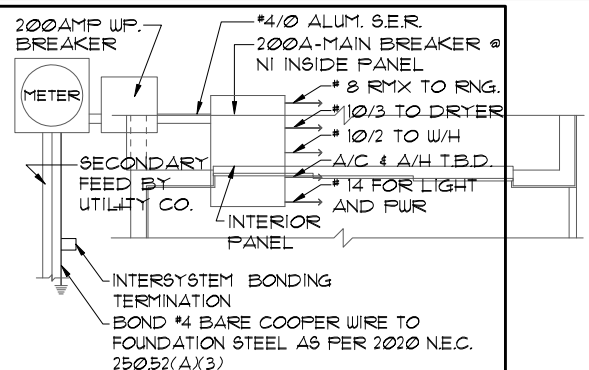

**ELECTRICAL RISER DIAGRAM**

NOTE: ELECTRICAL MATERIALS AND INSTALLATIONS SHALL COMPLY W/ APPLICABLE PROVISIONS OF THE NATIONAL ELEC. CODE 250.52(A)1) TO (6), LOCAL CODES, AND THE LOCAL POWER COMPANY.


250.52(A)3) Concrete-Encased Electrode. Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

Concrete-encased electrodes can be horizontal or vertical and must be at least 20 ft. long.

There are two types of concrete-encased electrodes: (1) steel reinforcing bars or rods which are not less than 1/2 inch in diameter and at least 20 ft. long, encased in 2 inches of concrete; (2) 20 ft. of bare copper conductor not smaller than No. 4 AWG encased in 2 inches of concrete.


The steel reinforcing rods must be in a location that is in direct contact with the earth. The reinforcing rods can be connected with tie wires, and a single length of rod can be used as the concrete-encased electrode. The reinforcing rods cannot be coated with non-conductive material.

Section 250.50 requires a concrete-encased electrode to be connected to the grounding electrode system if it is present. Several states have modified this requirement to say a concrete-encased electrode must be used as a grounding electrode only if it is available. In those jurisdictions, if the footings or foundations have been poured before the electrical contractor arrives at the site, and a reinforcing rod is not available for use as a grounding electrode, then a grounding connection to the reinforcing rod is not required.

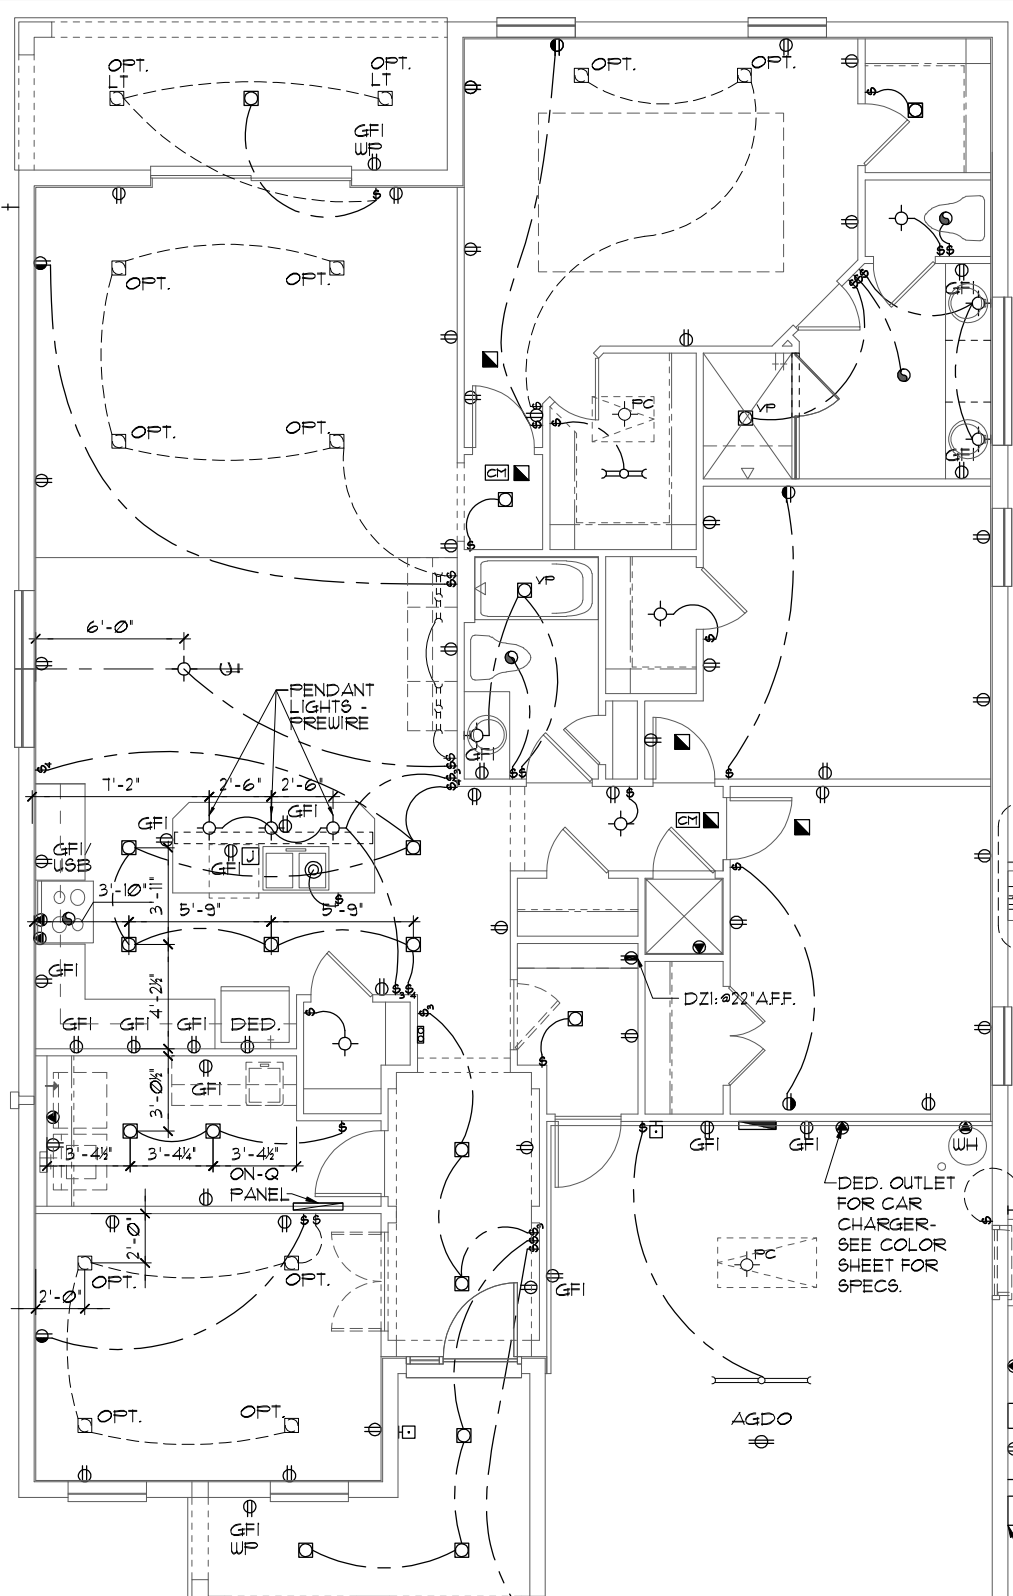


**ELECTRICAL PLAN**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

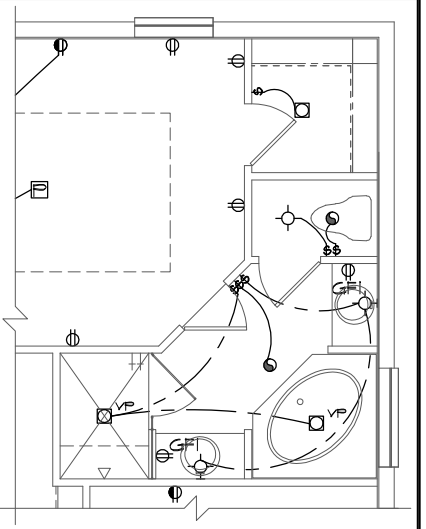

**M. BA. OPTION**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

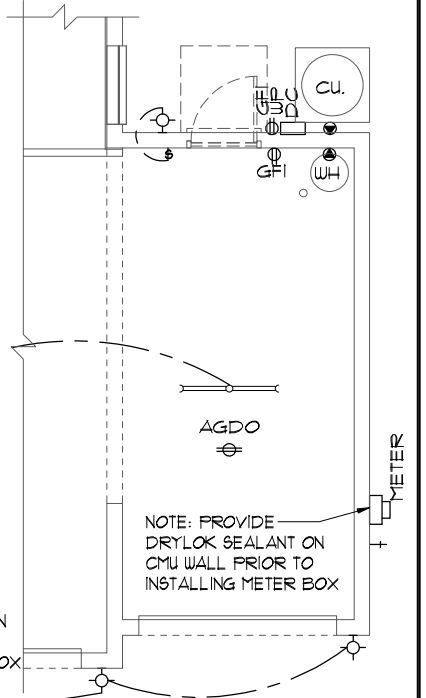


**3-CAR GAR. OPT.**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**ELECTRICAL LEGEND**


⊞	SINGLE POLE SWITCH	⊞	OUTLET, TV/CABLE
⊞	THREE WAY SWITCH	⊞	OUTLET, PHONE
⊞	OUTLET 110-115	⊞	INTERCOM
⊞	OUT. 110-115, SPLIT WIRED	⊞	CHIMES
⊞	OUT. 110-115, W/ USB	⊞	SMOKE DETECTOR/SMOKE
⊞	OUT. 110-115, CLG. MOUNT.	⊞	CARBON MONOXIDE
⊞	OUT. 110-115, FLR. MOUNT.	⊞	PUSH BUTTON
⊞	SPCL. PURPOSE 220-240	⊞	EXHAUST FAN
⊞	LIGHT FIXT., CLG. MTD.	⊞	EX. FAN/LIGHT COMBO
⊞	LIGHT FIXT., WALL MTD.	⊞	DISPOSAL
⊞	LED LIGHT FIXT., RECESSED	⊞	ELECTRICAL PANEL
⊞	LIGHT FIXT., REC. ADJUST.	⊞	CEILING FAN, PREWIRE
⊞	LIGHT FIXT., FULL CHAIN	⊞	CEILING FAN, INSTALL
⊞	LED LIGHT FIXT., FLUORESCENT	⊞	ELECT. JUNCTION BOX
⊞	LIGHT FIXT., EXT. FLOODS	⊞	THERMOSTAT
⊞	LIGHT FIXT., EMERG. EXIT	⊞	DISCONNECT SWITCH
⊞	LIGHT FIXT., EXIT/BACKUP	⊞	ELEC. POWER METER

**PLAN VIEW**

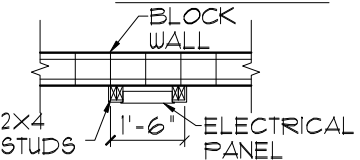

**ELEVATION**

N.T.S.

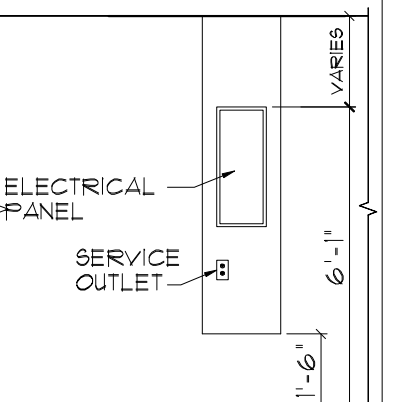


NOTE: ON-Q BOX TO BE INSTALLED PER COMMUNITY SPECS  
 NOTE: SEE FINAL COLOR SHEET FOR TV, FANS & PHONE LOCATIONS

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
 LOT: 0000, COMMUNITY NAME  
 1966  
 MARGATE II  
 DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET 07 OF 00 SHEETS

**FLORIDA SERIES**  
**ITEG**  
 ITC ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000  
 WWW.ITEG.COM

REVISIONS	BY
05-16-19	JF

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
**Park Square HOMES**

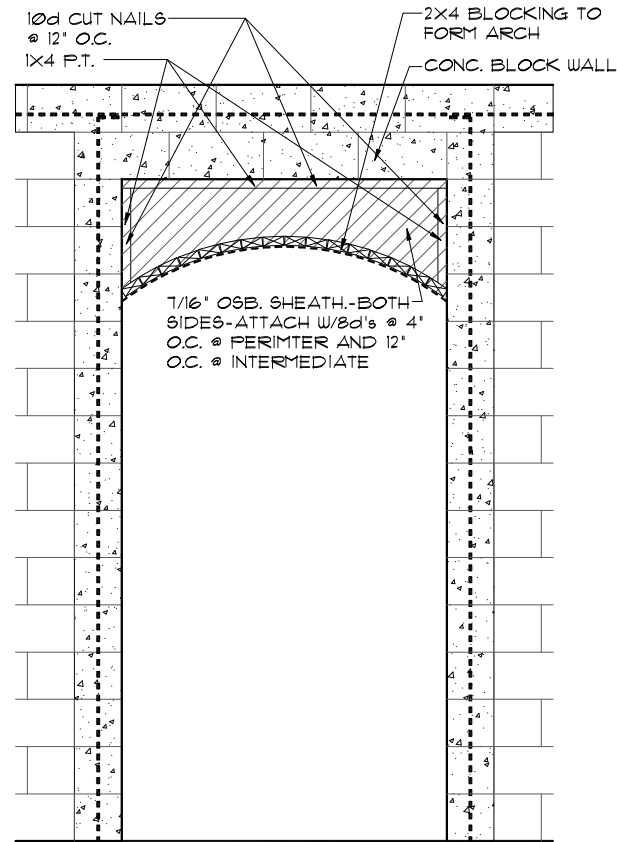

4  
8A  
DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL:----- 4.68S.F.  
PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78S.F./VENT.  
(VENT TYPE: LOMANCO MODEL TT0-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- 4.32S.F.  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
( 50 LF. @ 0.087S.F. VENTING PER LF.)

UPPER PORTION PERCENTAGE: 50%  
LOWER PORTION PERCENTAGE: 50%

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/150 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{150} = 17.28\text{S.F.}$  NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL:----- 4.68S.F.  
PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78S.F./VENT.  
(VENT TYPE: O'HAGIN MODEL 'S')

LOWER PORTION VENTILATION TOTAL:----- 4.32S.F.  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:  
( 50LF. @ 0.087S.F. VENTING PER LF.)

UPPER PORTION PERCENTAGE: 50%  
LOWER PORTION PERCENTAGE: 50%

**NOTES**


- TYPICAL ROOF GABLE OVERHANG TO BE 12' UNLESS OTHERWISE NOTED.
- TYPICAL ROOF EAVES OVERHANG TO BE 12' UNLESS OTHERWISE NOTED.
- PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
- ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
- TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC61 I.
- REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
- SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.11 - Underlayment materials required to comply with ASTM D226, D4869 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.11. Underlayment shall be applied and attached in accordance with Table R305.11.
- OFF RIDGE VENTS MAXIMUM OPENING SIZES:  
• 0-HAGIN - 1' X 19" HOLE
- TILE ROOF TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.33. Underlayment materials required to comply with ASTM D226, D1910, D4869 and D6151 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.11. Underlayment shall be applied and attached in accordance with Table R305.11.
- TILE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.33. Underlayment materials required to comply with ASTM D226, D1910, D4869 and D6151 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.11. Underlayment shall be applied and attached in accordance with Table R305.11.
- TILE ROOF TO BE INSTALLED IAW FBCR 2023, 8TH EDITION ASTM C1492-R305.3.5

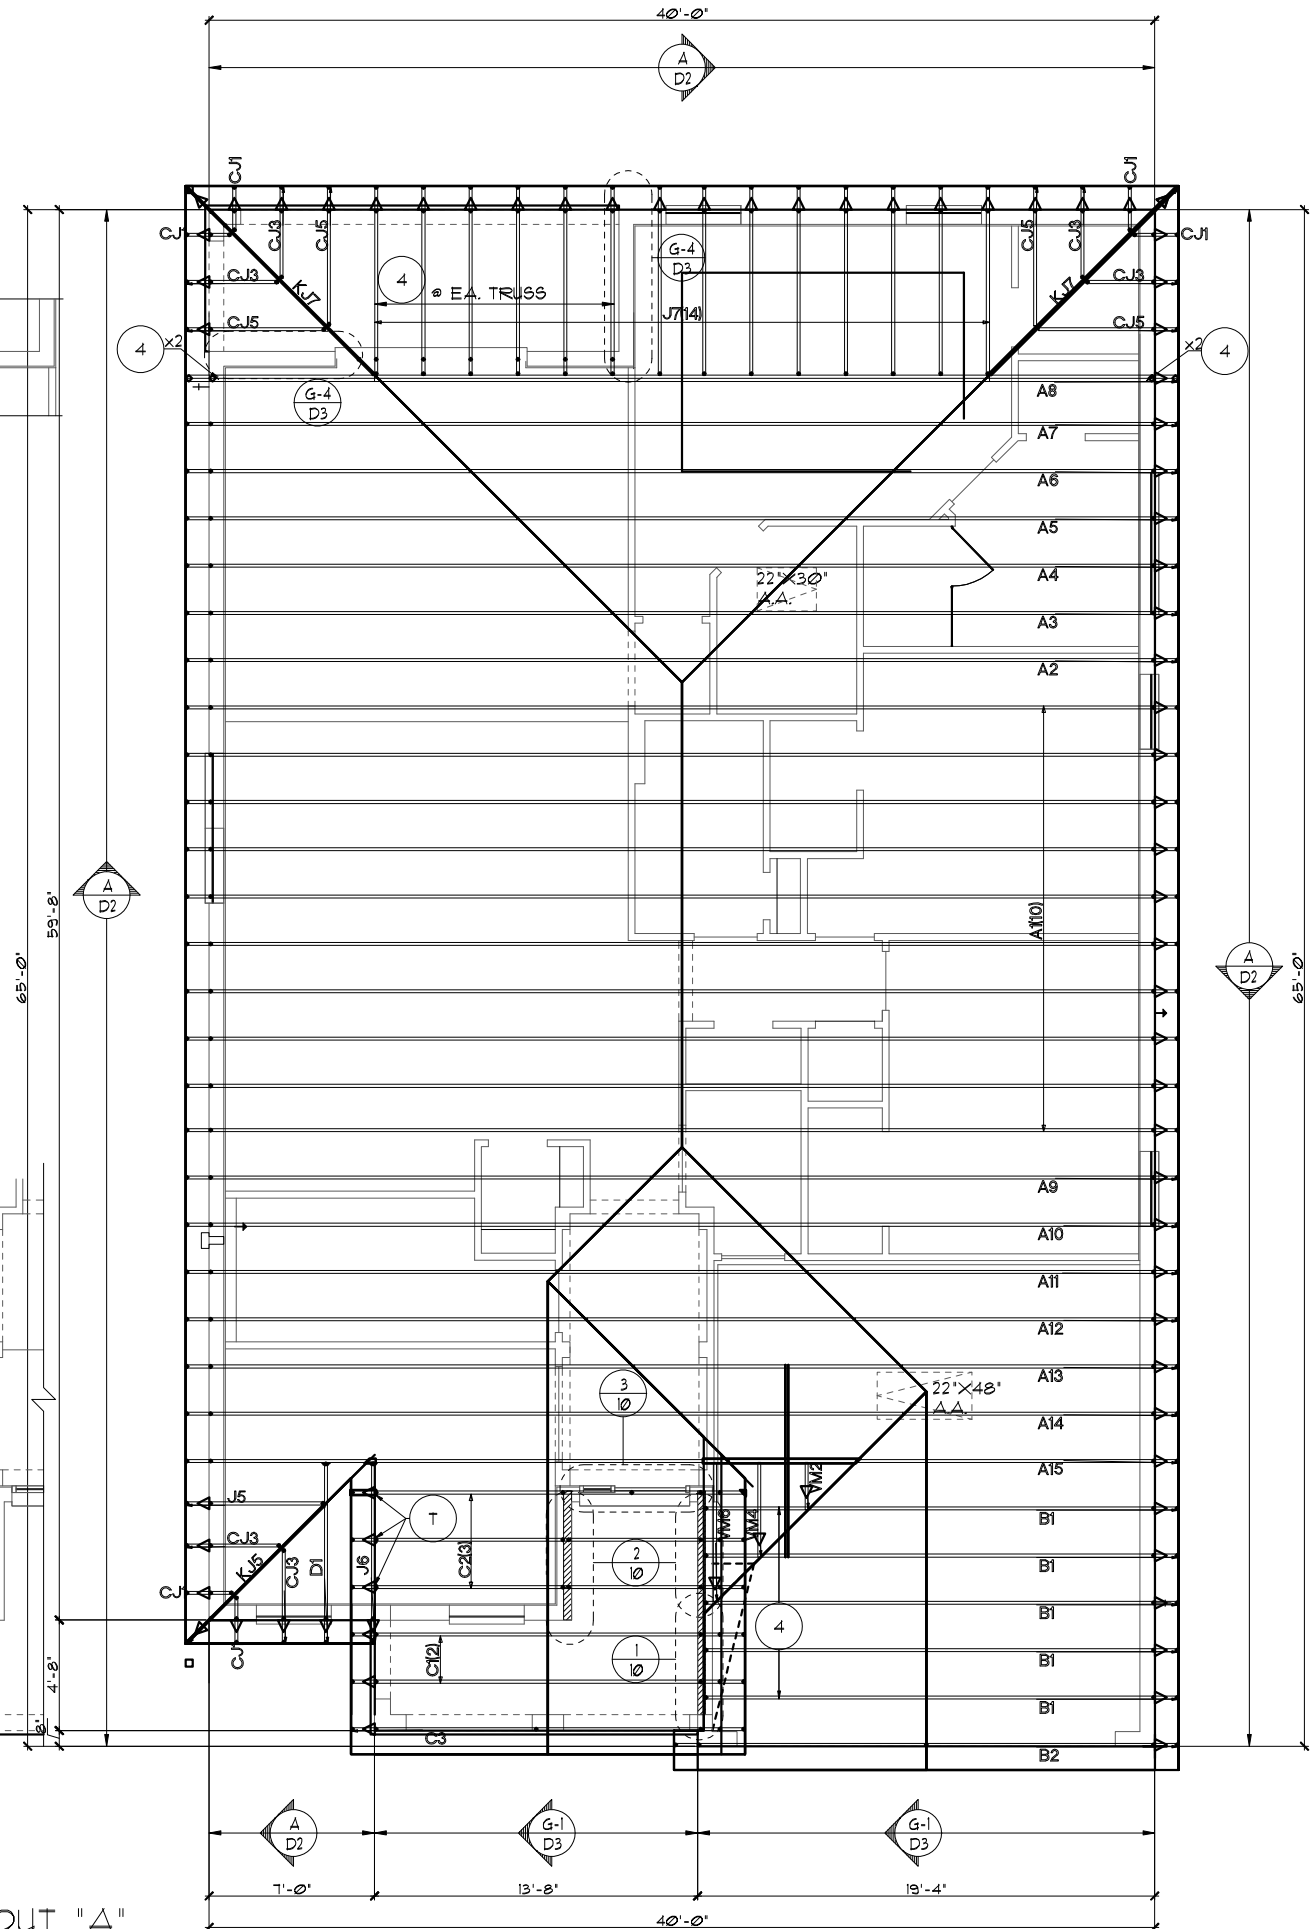

TRUSS LAYOUT "A"  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 2023 EDITION OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH  
 LOT: 0000 COMMUNITY NAME  
 FLORIDA SERIES  
 TRUSS LAYOUT  
 1966  
 MARGATE II

REVISIONS  
 05-16-19  
 BY: JF  
 IITEG  
 THOMPSON ENGINEERING GROUP, INC.  
 4401 University Road, Suite 200  
 Orlando, Florida 32811  
 Phone: (407) 529-3000  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vireland Road, Suite 200  
 Orlando, Florida 32811  
 Phone: (407) 529-3000  
 PARK SQUARE HOMES  
 DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET  
 08A  
 OF 00 SHEETS

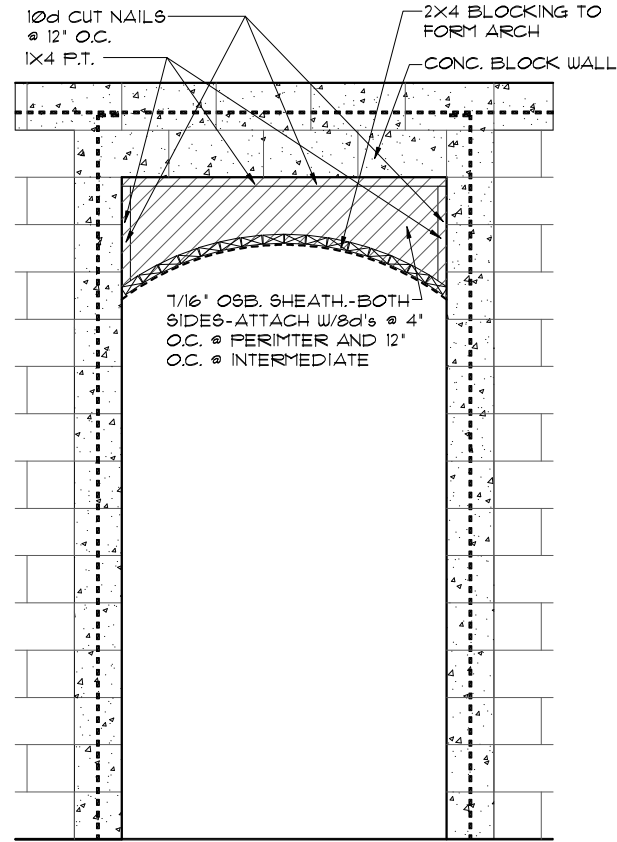

4 DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL: 4.68S.F.  
PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78S.F./VENT.  
(VENT TYPE: LOMANCO MODEL T10-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL: 4.32S.F.  
PROVIDED W/ VENTILATED SOFFITS @ EAVE: 50 LF. @ 0.087S.F. VENTING PER LF.

UPPER PORTION PERCENTAGE: 50%  
LOWER PORTION PERCENTAGE: 50%

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/150 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{150} = 17.28\text{S.F.}$  NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL: 4.68S.F.  
PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78S.F./VENT.  
(VENT TYPE: O'HAGIN MODEL 'S')

LOWER PORTION VENTILATION TOTAL: 4.32S.F.  
PROVIDED W/ VENTILATED SOFFITS @ EAVE: 50 LF. @ 0.087S.F. VENTING PER LF.

UPPER PORTION PERCENTAGE: 50%  
LOWER PORTION PERCENTAGE: 50%

**NOTES**

- TYPICAL ROOF GABLE OVERHANG TO BE 12' UNLESS OTHERWISE NOTED.
- TYPICAL ROOF EAVES OVERHANG TO BE 12' UNLESS OTHERWISE NOTED.
- PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
- ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
- TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING # ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC61.1.
- REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
- SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
- OFF RIDGE VENTS MAXIMUM OPENING SIZES:
  - TILE ROOF TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.3.3. Underlayment materials required to comply with ASTM D226, D1910, D4869 and D6151 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
- TILE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.3.3. Underlayment materials required to comply with ASTM D226, D1910, D4869 and D6151 shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
- OFF RIDGE VENTS MAXIMUM OPENING SIZES:
  - O'HAGIN - 1' X 19" HOLE
- TILE ROOF TO BE INSTALLED IAW FBCR 2023, 8TH EDITION ASTM C1492-R305.3.5

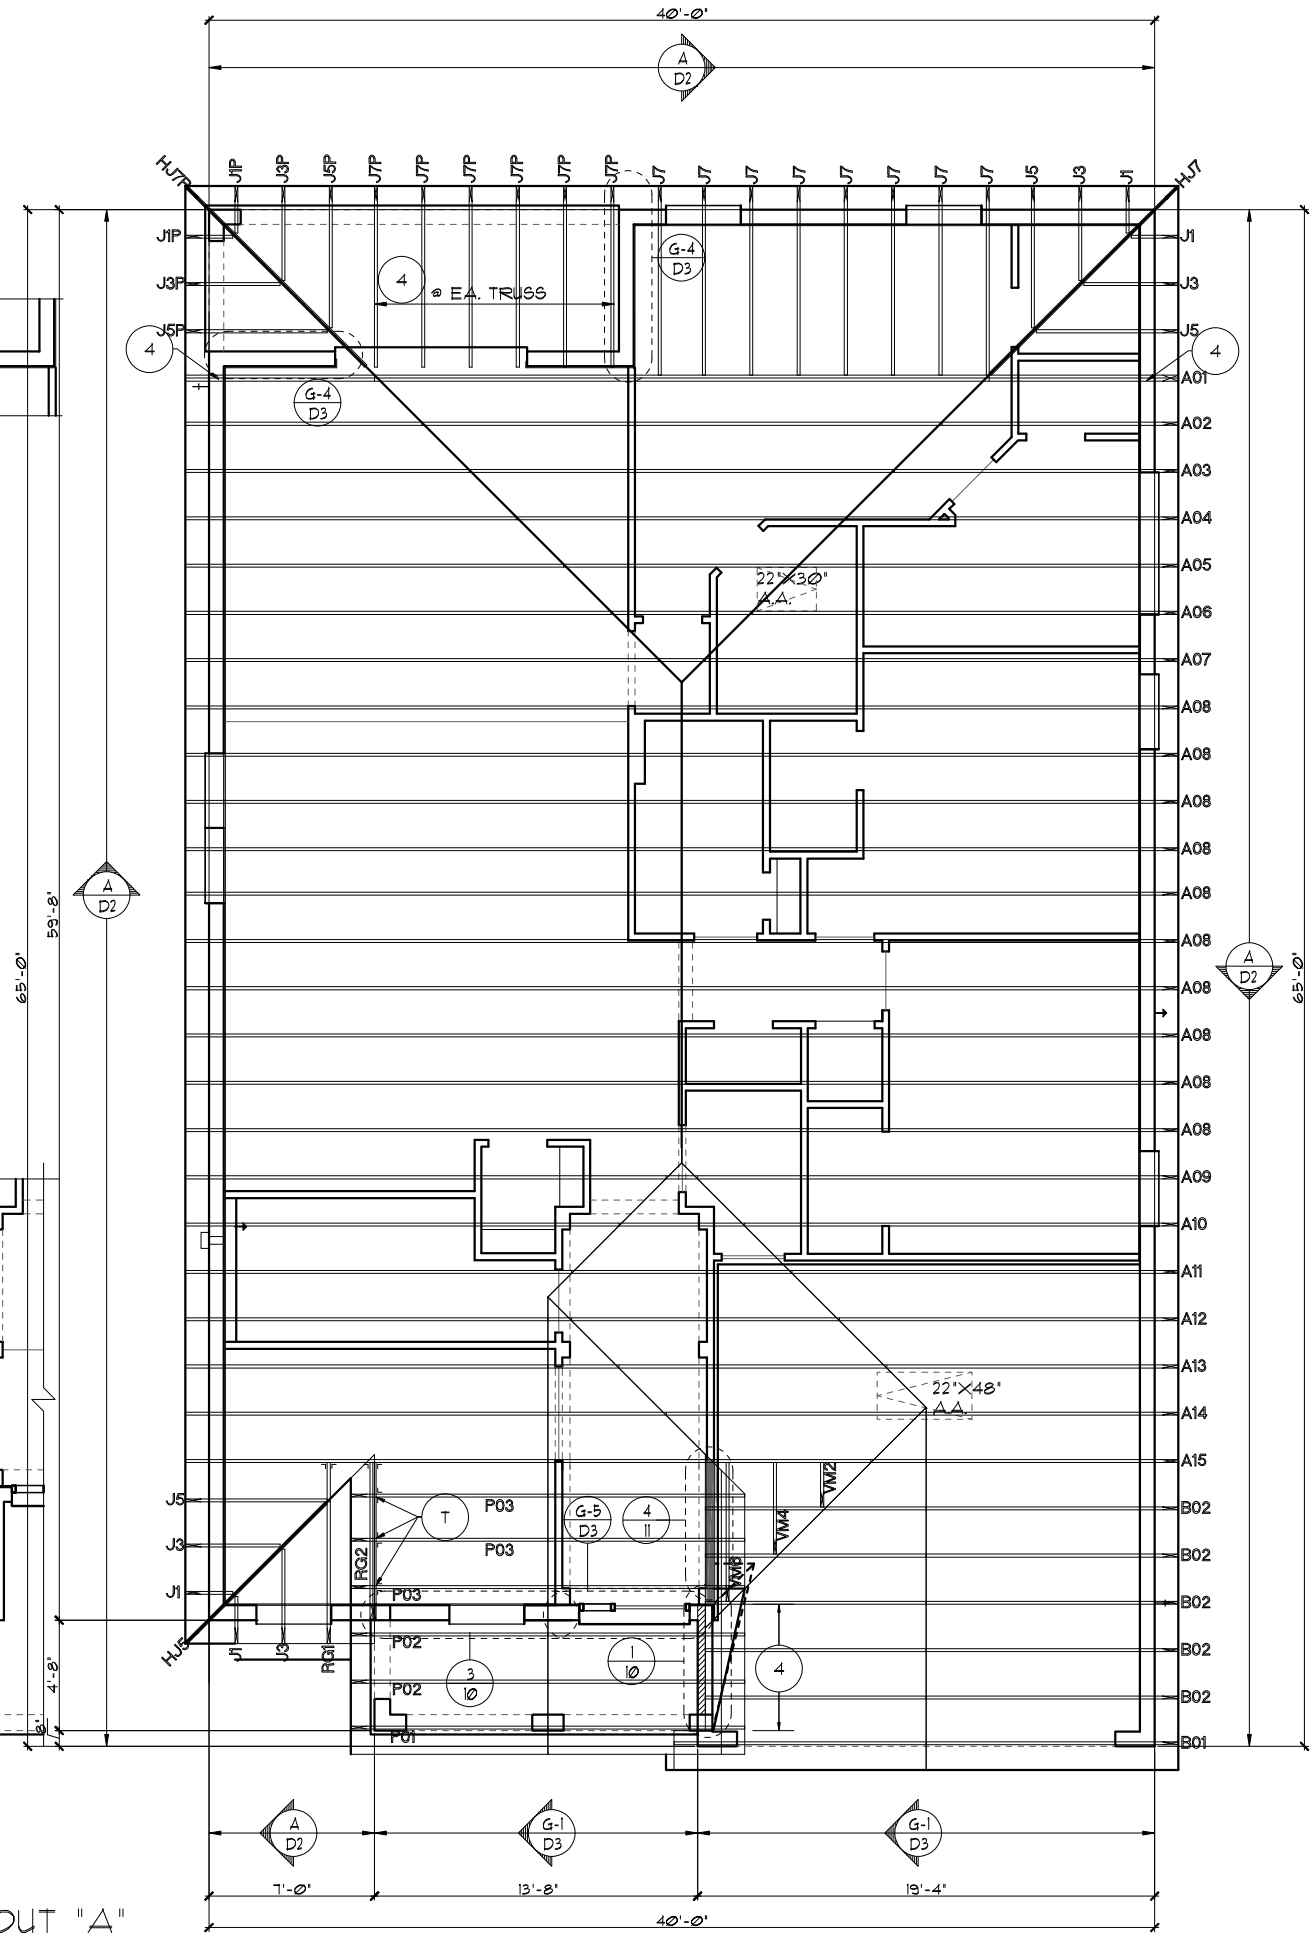

TRUSS LAYOUT "A"  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

FLORIDA SERIES

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 2023 EDITION OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000 COMMUNITY NAME: 1966 MARGATE II

TRUSS LAYOUT

DATE 04-05-2017  
SCALE AS NOTED  
DRAW: RDC  
JOB: N/A  
SHEET: 08A OF 00 SHEETS


REVISIONS

05-16-19	BY: JF
----------	--------

© COPYRIGHT 2017 Park Square Homes hereby reserves its common law copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied or changed in any manner, or form whatsoever, nor are they to be assigned to any third party without the express written permission from Park Square Homes.

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Village Road, Suite 200  
Orlando, Florida 32811  
Phone: (407) 529-3000

ITEG THOMPSON ENGINEERING GROUP, INC.  
4401 University Blvd., Suite 400  
Orlando, FL 32811  
Phone: (407) 754-1000  
www.iteg.com

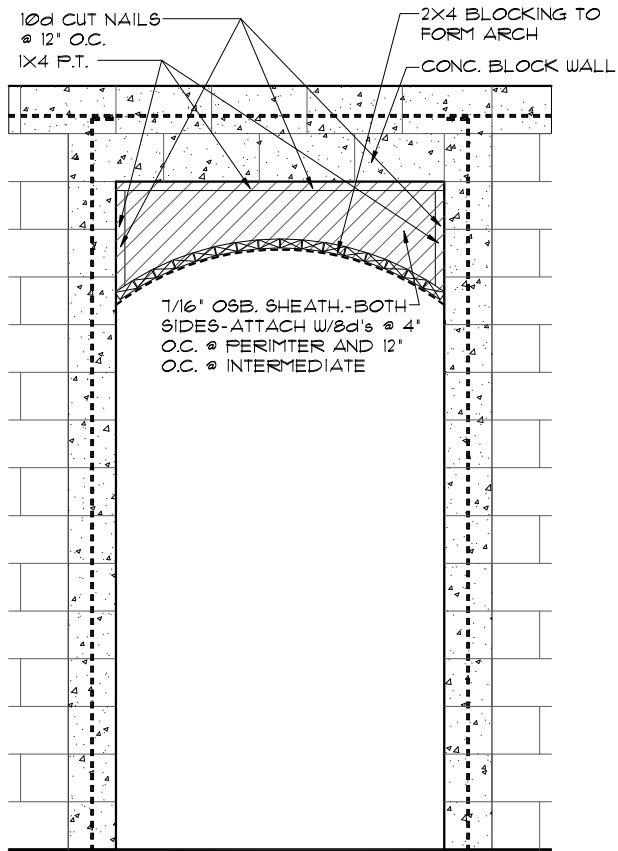

4  
 8A  
 DETAIL  
 1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:


TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL: ----- 4.68S.F.  
 PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78S.F. /VENT.  
 (VENT TYPE: LOMANCO MODEL T10-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL: ----- 4.32S.F.  
 PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
 ( 50 LF. @ 0.0878S.F. VENTING PER LF.)

UPPER PORTION PERCENTAGE: 50%  
 LOWER PORTION PERCENTAGE: 50%

- NOTES**
1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
  4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCS1.1.
  6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4069 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
  8. OFF RIDGE VENTS MAXIMUM OPENING SIZES:
    - LOMANCO : (2) 9 1/4" DIA. CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FEL OR ANY OTHER METHOD LISTED PER FBC R305.1.1.

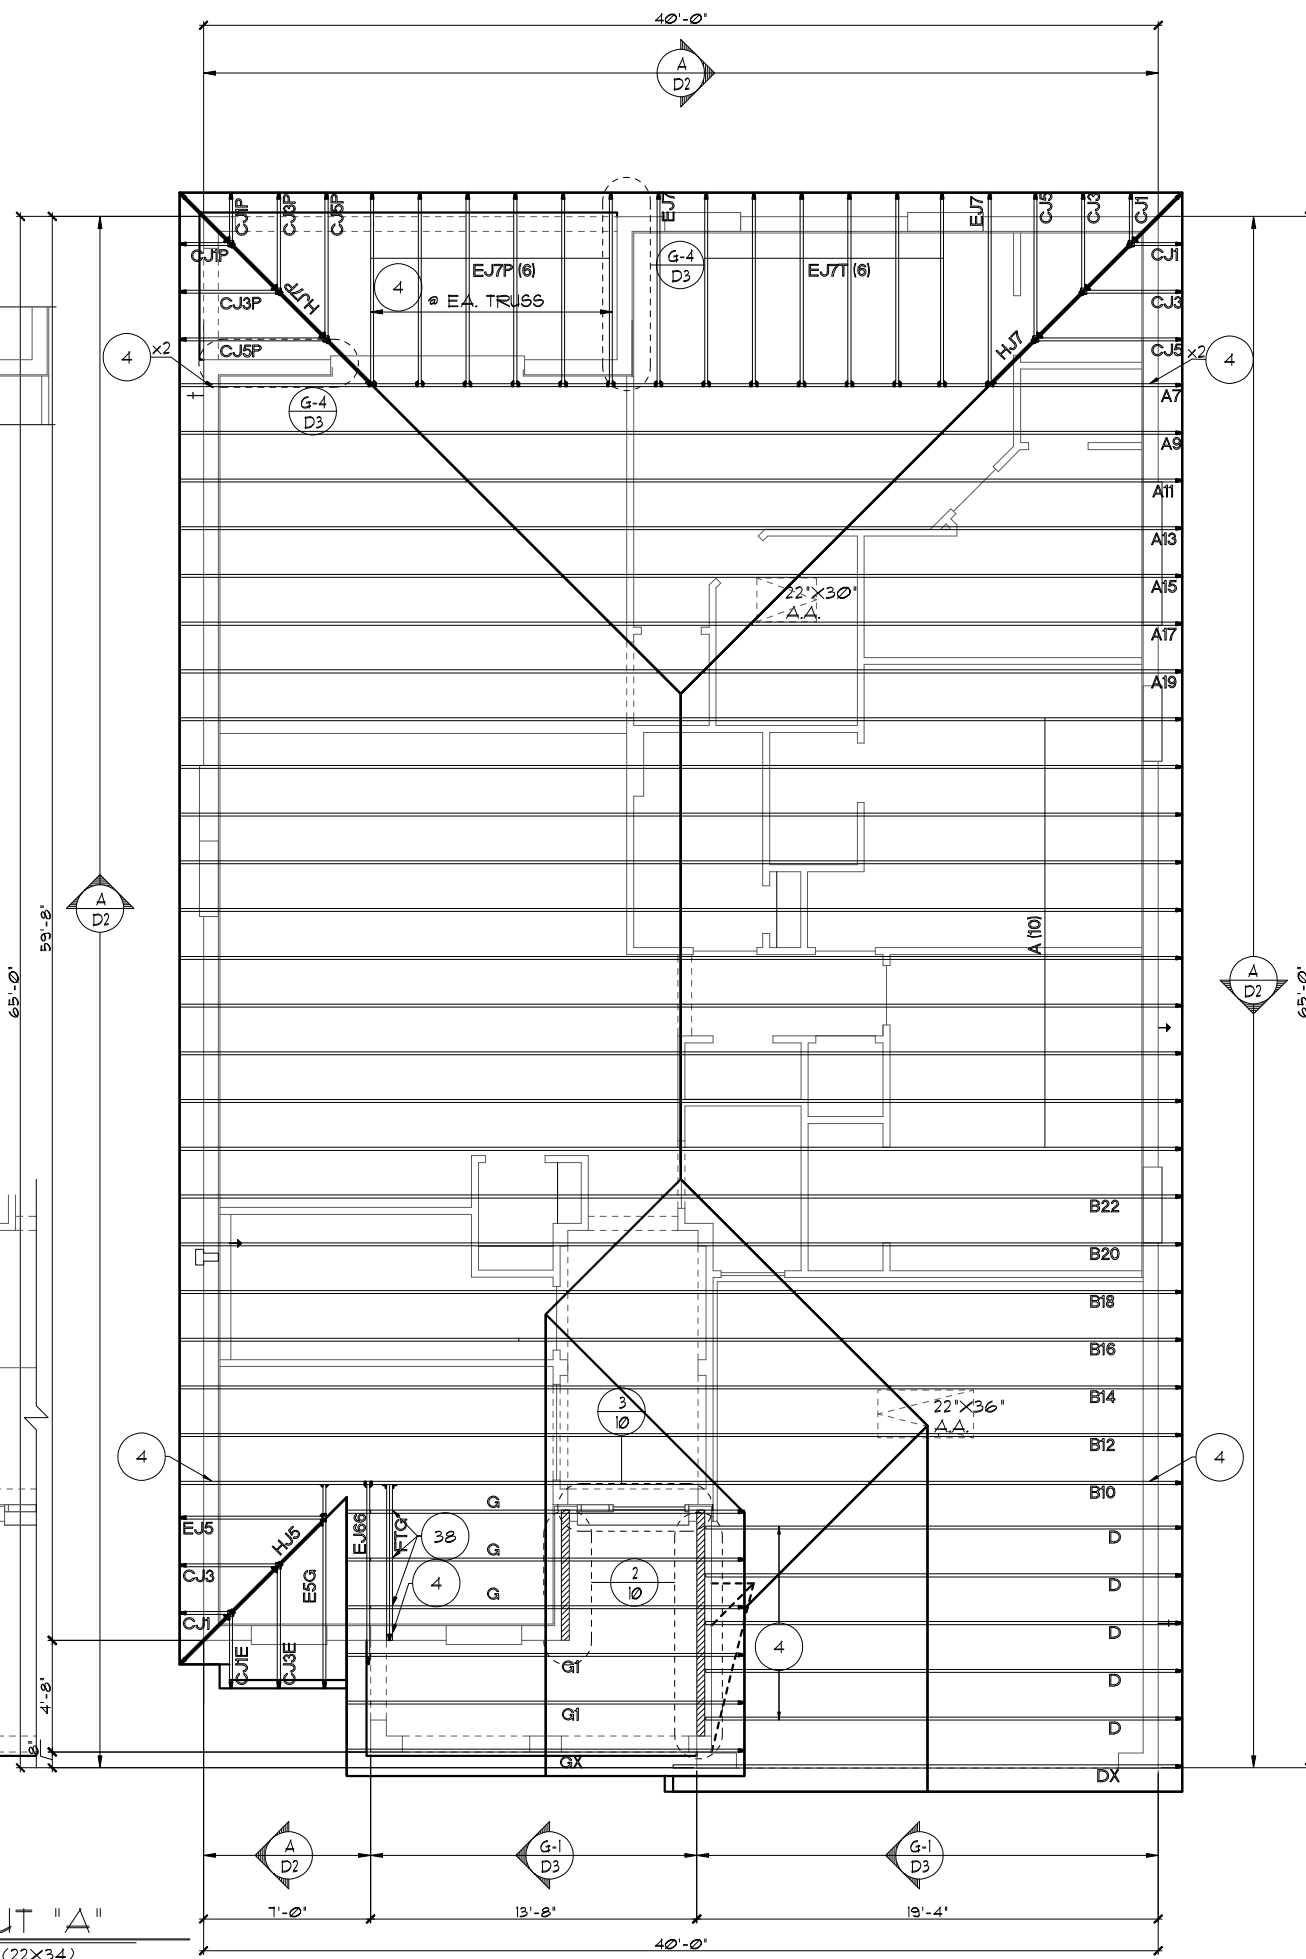

TRUSS LAYOUT "A"  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

FLORIDA SERIES  
 LOT: 0000 COMMUNITY NAME  
 THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

© COPYRIGHT 2023 Park Square Homes. It hereby reserves its common law copyright and other copyrights in these plans, ideas, and designs. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS

NO.	DATE	BY
05-16-19		SH

**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida 32811  
 Phone: (407) 241-1799  
 www.iteg.com


A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida 32811  
 Phone: (407) 529 - 3000

**Park Square HOMES**

TRUSS LAYOUT

1966  
 MARGATE II

DATE 04-05-2011  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET  
 08A  
 OF 00 SHEETS

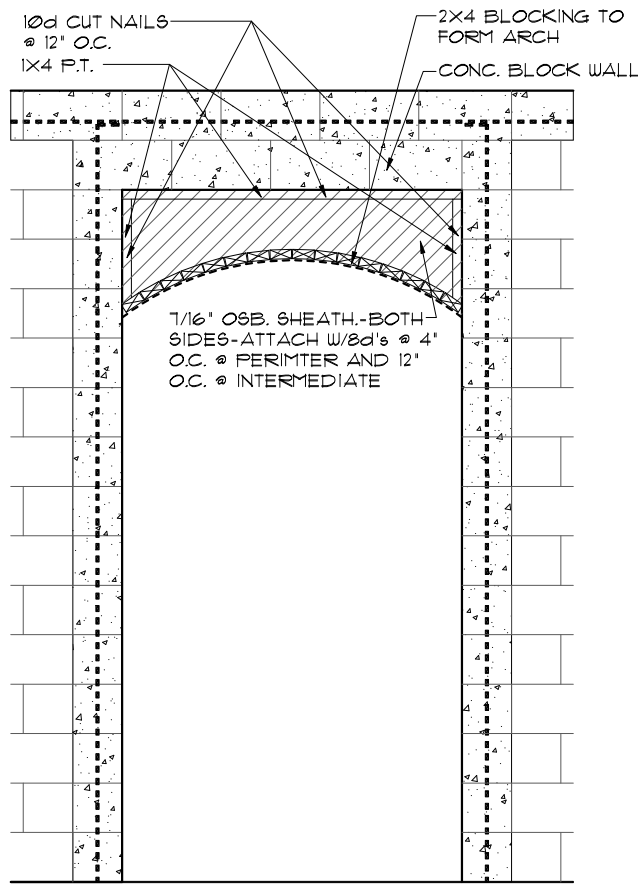

4  
8A  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL:----- 4.68S.F.  
PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78S.F. /VENT. (VENT TYPE: LOMANCO MODEL T10-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- 4.32S.F.  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:-- ( 50 LF. @ 0.087S.F. VENTING PER LF.)

UPPER PORTION PERCENTAGE: 50%  
LOWER PORTION PERCENTAGE: 50%

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/150 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL:----- 4.68S.F.  
PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .87S.F. /VENT. (VENT TYPE: O'HAGIN MODEL 'S')

LOWER PORTION VENTILATION TOTAL:----- 4.32S.F.  
PROVIDED W/ VENTILATED SOFFITS @ EAVE: ( 50LF. @ 0.087S.F. VENTING PER LF.)

UPPER PORTION PERCENTAGE: 50%  
LOWER PORTION PERCENTAGE: 50%

**NOTES**

1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCSI 1.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R905.11 - Underlayment materials required to comply with ASTM D226, D4869 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R905.11. Underlayment shall be applied and attached in accordance with Table R905.11.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES:
  - O-HAGIN - 7' X 19' HOLE
9. TILE ROOF TO BE INSTALLED IAW FBCR 2023, 8TH EDITION ASTM C1492-R905.3.5

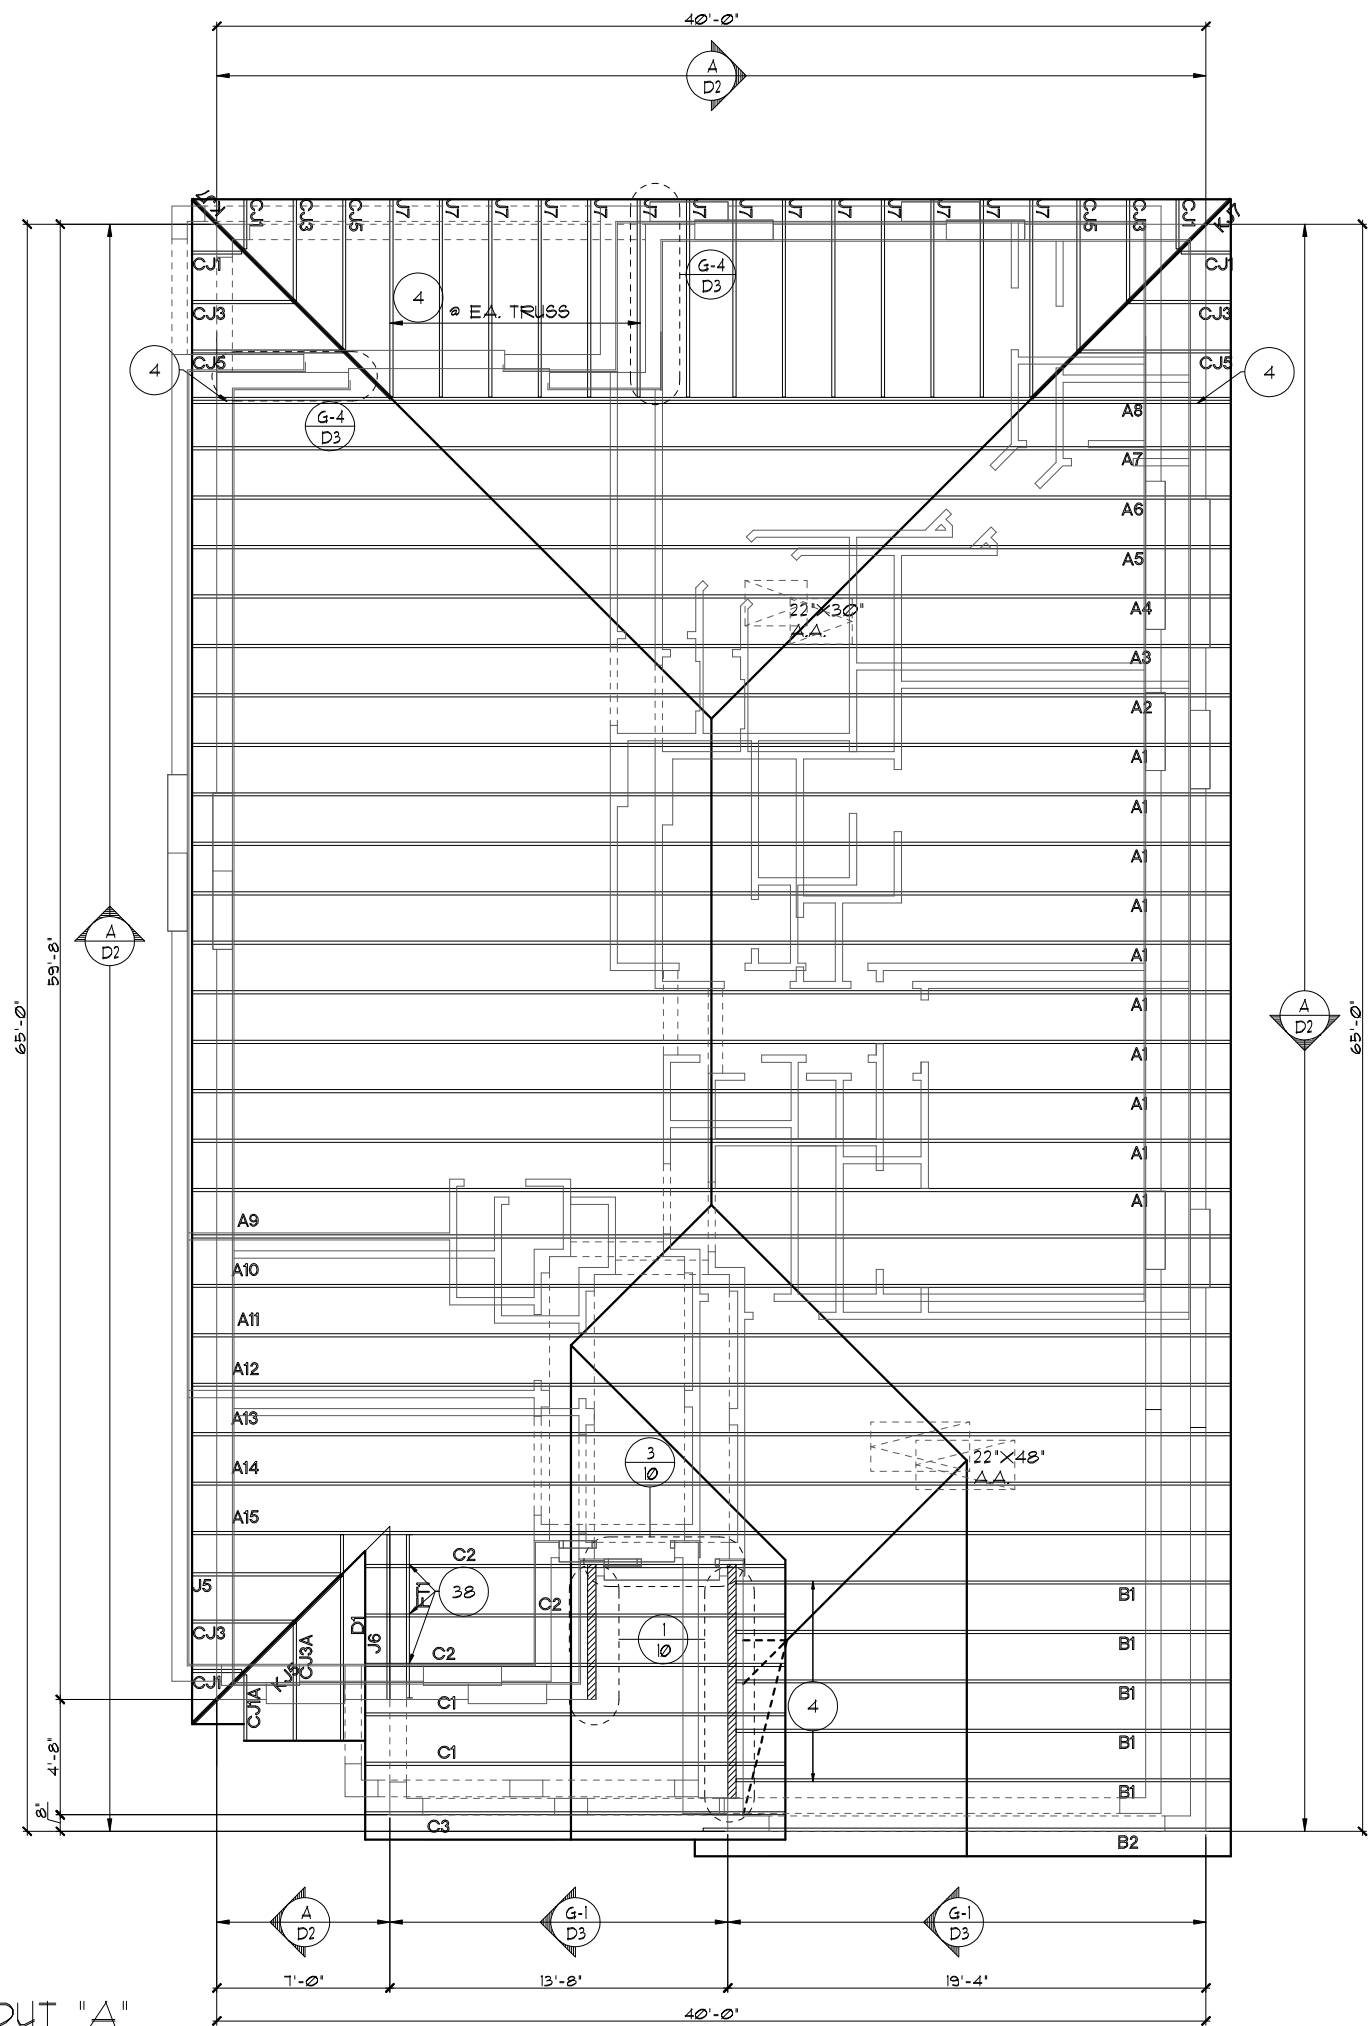


TRUSS LAYOUT "A"  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME: MARGATE II

<p style="writing-mode: vertical-rl; transform: rotate(180deg);">FLORIDA SERIES</p> <p style="writing-mode: vertical-rl; transform: rotate(180deg);">A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida, 32811 Phone: (407) 529 - 3000</p>					
<p style="writing-mode: vertical-rl; transform: rotate(180deg);">TRUSS LAYOUT</p>	<p style="writing-mode: vertical-rl; transform: rotate(180deg);">1966</p> <p style="writing-mode: vertical-rl; transform: rotate(180deg);">MARGATE II</p>				
<p style="writing-mode: vertical-rl; transform: rotate(180deg);">DATE 04-05-2017</p> <p style="writing-mode: vertical-rl; transform: rotate(180deg);">SCALE AS NOTED</p> <p style="writing-mode: vertical-rl; transform: rotate(180deg);">DRAWN RDC</p> <p style="writing-mode: vertical-rl; transform: rotate(180deg);">JOB N/A</p> <p style="writing-mode: vertical-rl; transform: rotate(180deg);">SHEET</p>	<p style="writing-mode: vertical-rl; transform: rotate(180deg);">REVISIONS</p> <table border="1"> <tr> <th>REVISIONS</th> <th>BY</th> </tr> <tr> <td>05-16-19</td> <td>JF</td> </tr> </table>	REVISIONS	BY	05-16-19	JF
REVISIONS	BY				
05-16-19	JF				
<p style="writing-mode: vertical-rl; transform: rotate(180deg);">© COPYRIGHT 2017 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and design are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without the express written permission from Park Square Homes.</p>					



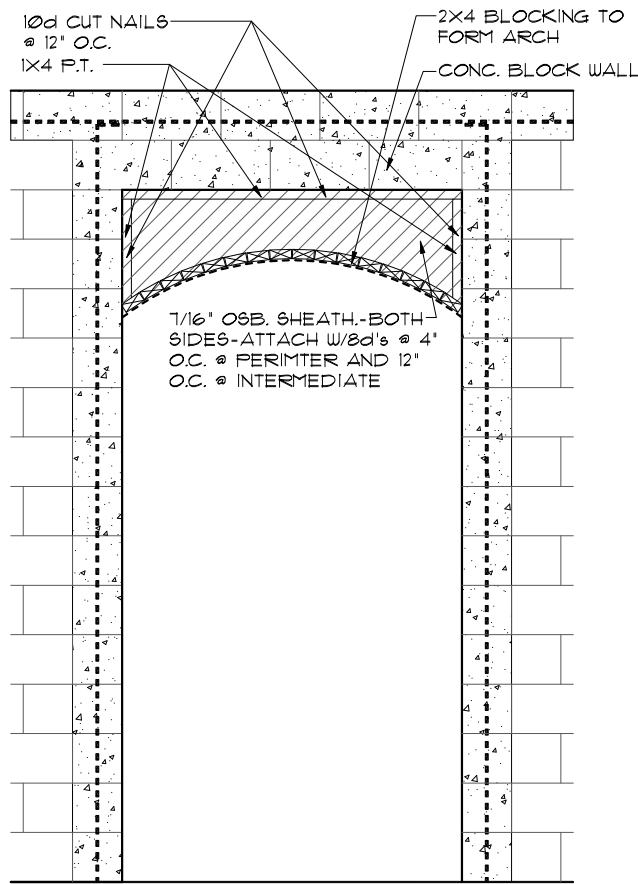

**4**  
8A  
DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:


TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL: ----- **4.68S.F.**  
 PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78S.F.** /VENT.  
 (VENT TYPE: LOMANCO MODEL TT0-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL: ----- **4.32S.F.**  
 PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
 ( **50** L.F. @ **0.087S.F.** VENTING PER L.F.)

UPPER PORTION PERCENTAGE: **50%**  
 LOWER PORTION PERCENTAGE: **50%**

- NOTES**
1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
  4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCS1.1.
  6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
  8. OFF RIDGE VENTS MAXIMUM OPENING SIZES:
    - LOMANCO : (2) 9 1/4" DIA. CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1.1

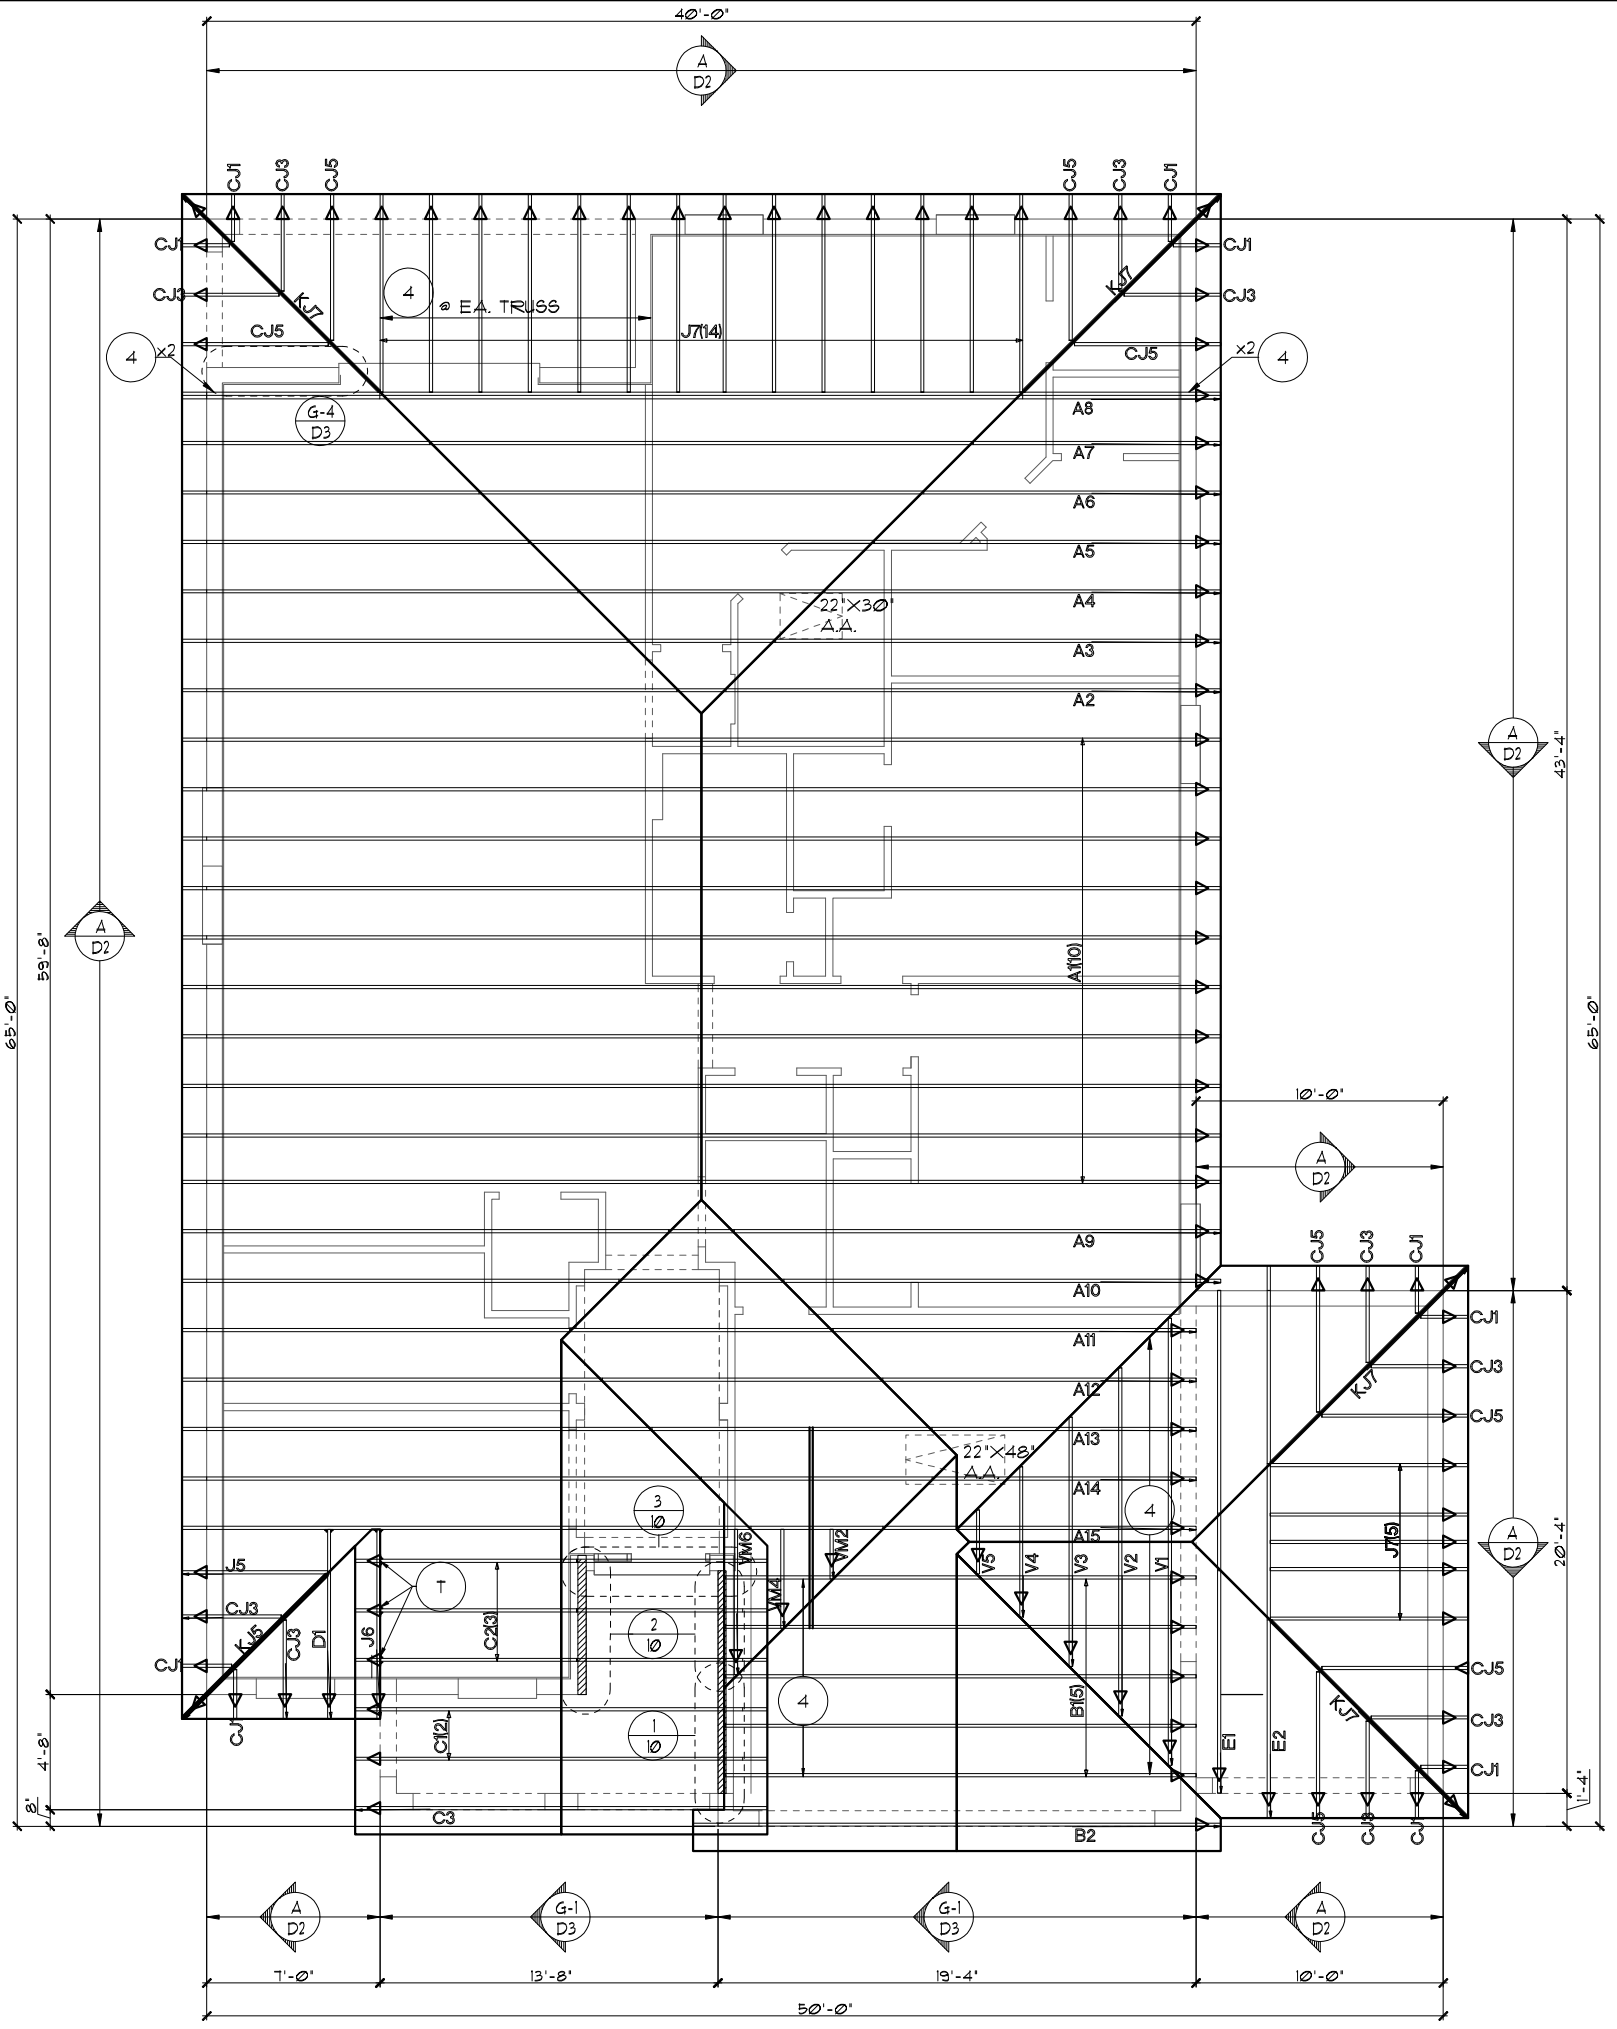

**TRUSS LAYOUT "A"**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

3-CAR GARAGE OPTION  
 THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
 LOT: 0000, COMMUNITY NAME  
 1966  
 MARGATE II  
 DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET  
**08A.3**  
 OF 00 SHEETS

**FLORIDA SERIES**


**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 5200 Vineyard Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 734-1790  
 www.iteg.com

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineyard Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 528 - 3000

**Park Square HOMES**

TRUSS LAYOUT  
 1966  
 MARGATE II

REVISIONS	BY
05-16-19	JF

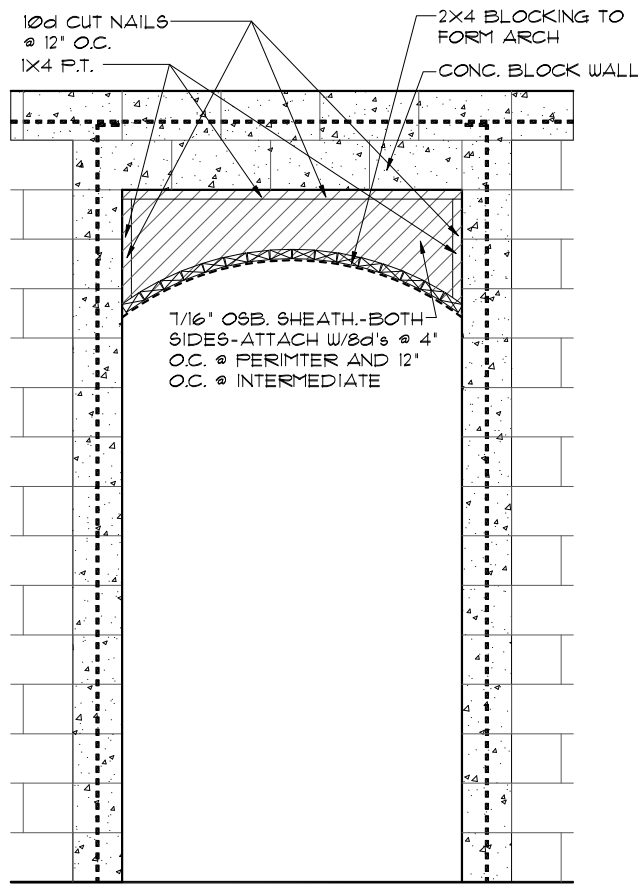

**4**  
8A  
**DETAIL**  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC 2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:


TOTAL VENTED SPACE:  $\frac{2,593\text{SF}}{300} = 8.64\text{SF}$ , NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL: ----- **4.68SF**, PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78SF** /VENT. (VENT TYPE: LOMANCO MODEL TT0-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL: ----- **4.32SF**, PROVIDED W/ VENTILATED SOFFITS @ EAVE:-- ( **50** L.F. @ **0.087SF** VENTING PER L.F.)

UPPER PORTION PERCENTAGE: **50%**  
LOWER PORTION PERCENTAGE: **50%**

- NOTES**
1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
  4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/UTCA BC91.1.
  6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
  8. OFF RIDGE VENTS MAXIMUM OPENING SIZES:
    - LOMANCO : (2) 9 1/4" DIA. CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1.1

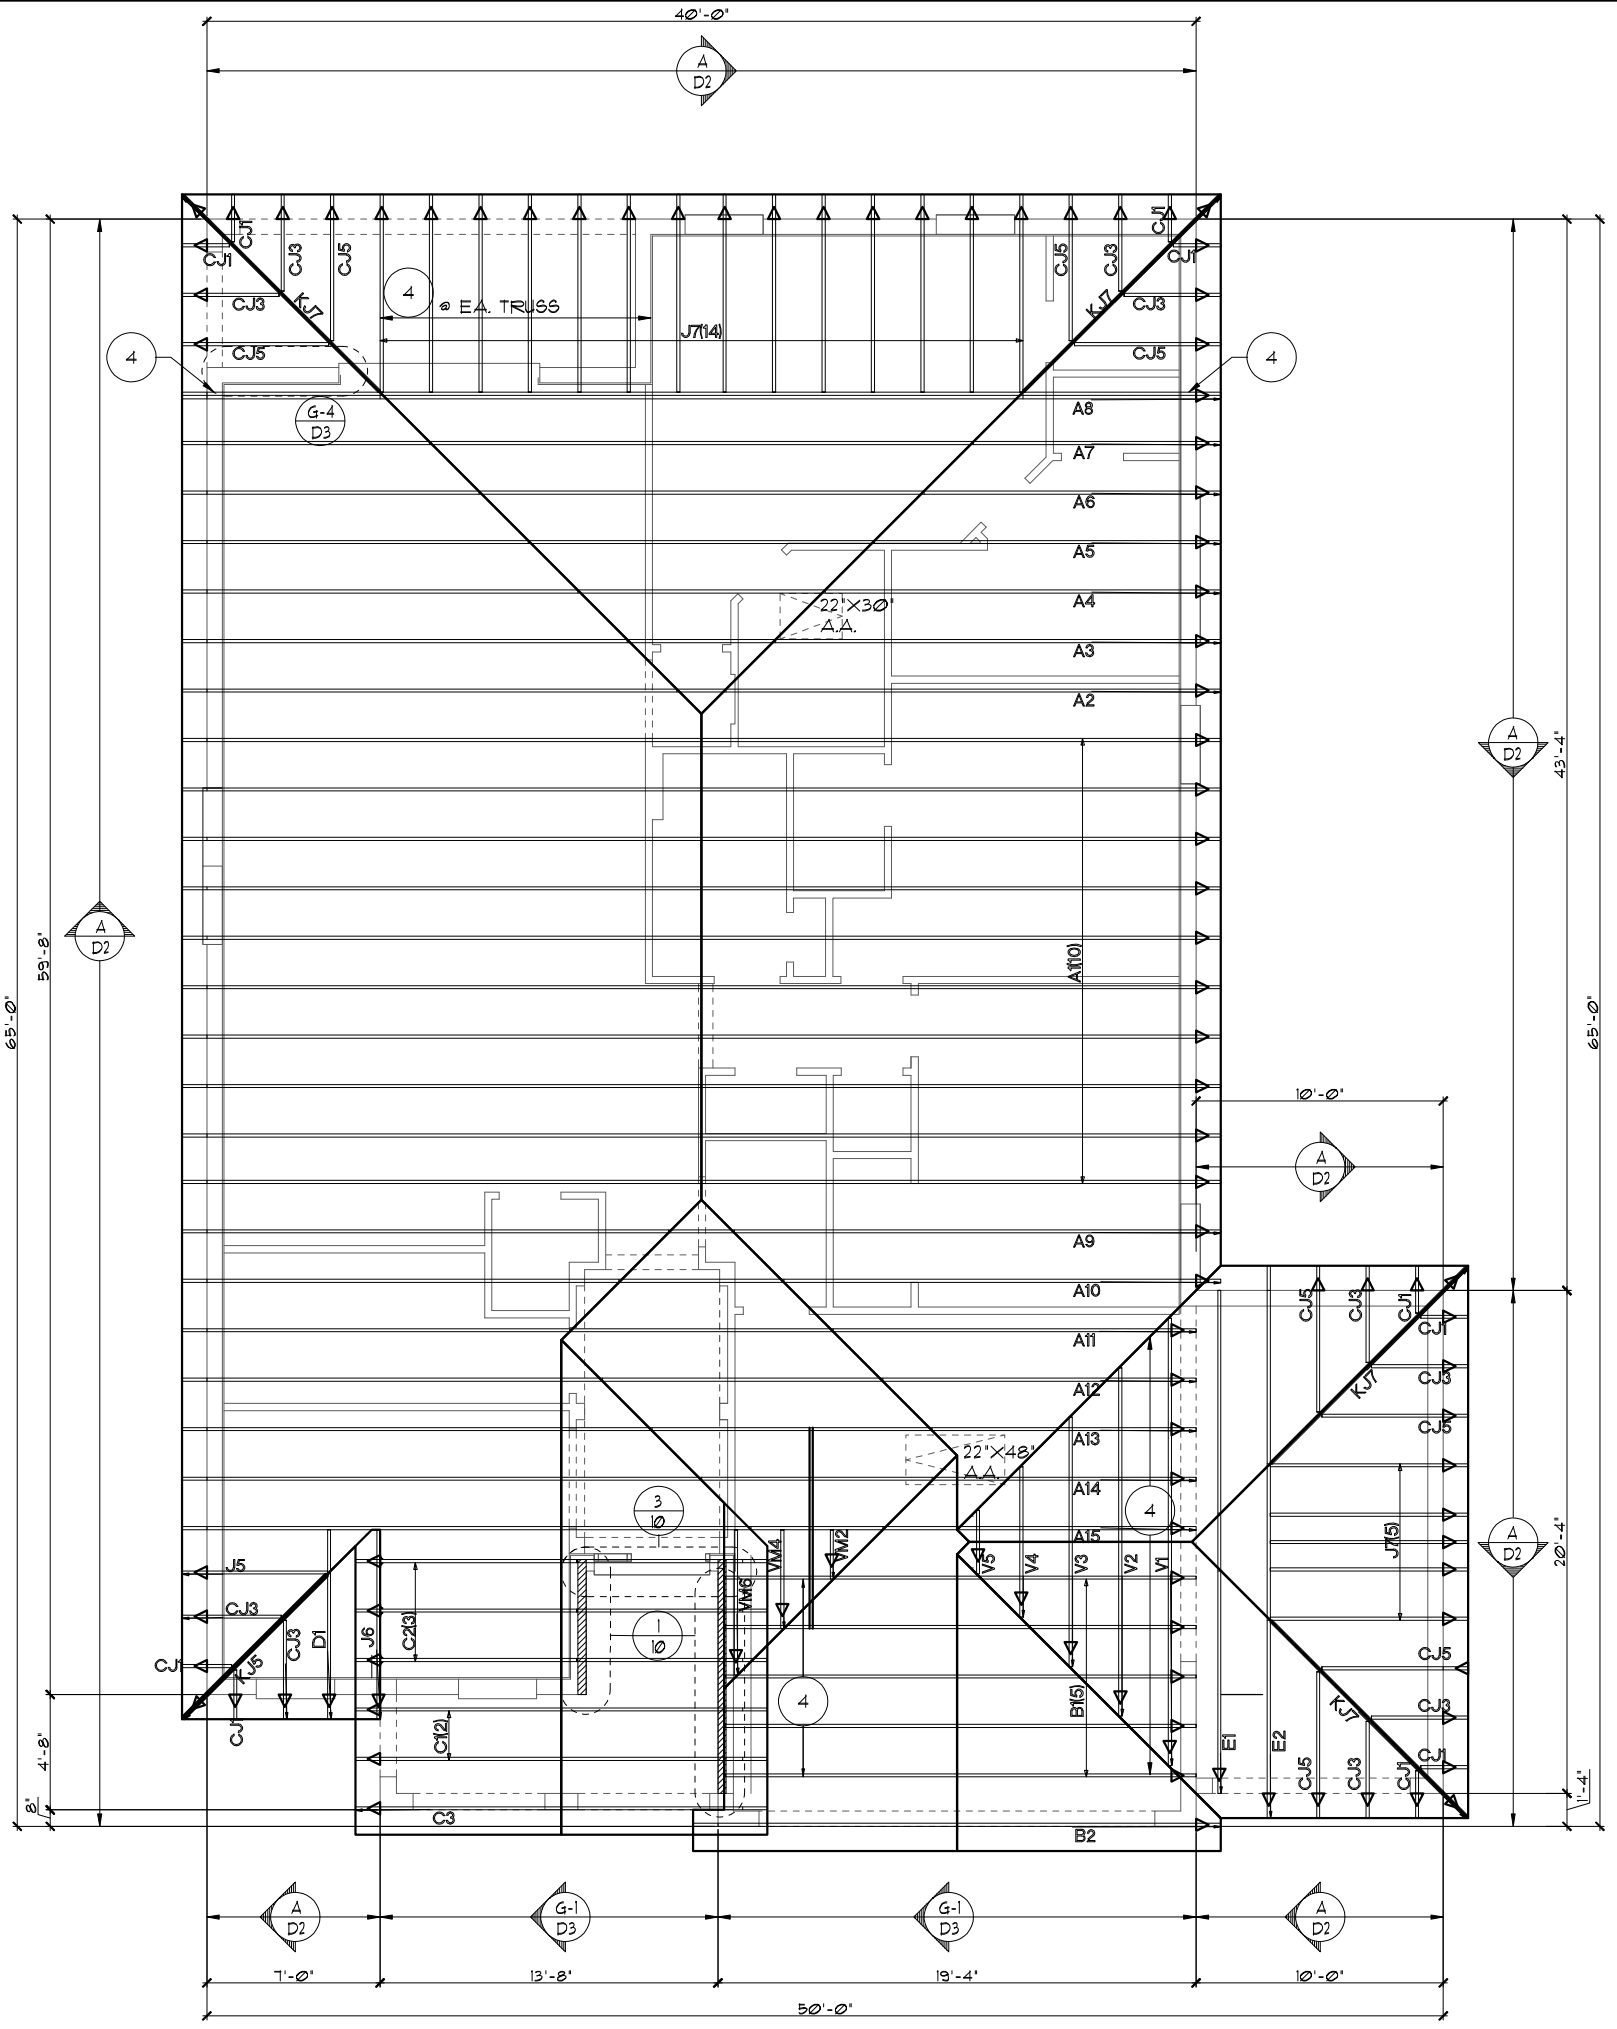

**TRUSS LAYOUT "A"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

3-CAR GARAGE OPTION

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

1966

MARGATE II

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET  
08A.3  
OF 00 SHEETS

FLORIDA SERIES

A DIVISION OF PARK SQUARE ENTERPRISES, INC.

5200 Vineland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 528 - 3000

**Park Square HOMES**


REVISIONS	BY
05-16-19	JF

**ITEG**  
HOBBSON ENGINEERING GROUP, INC.  
1401 W. Colonial Ave. Suite 100  
Orlando, FL 32811  
Tel: (407) 734-1400  
Fax: (407) 734-1790  
www.iteg.com

These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without the express written permission from Park Square Homes.





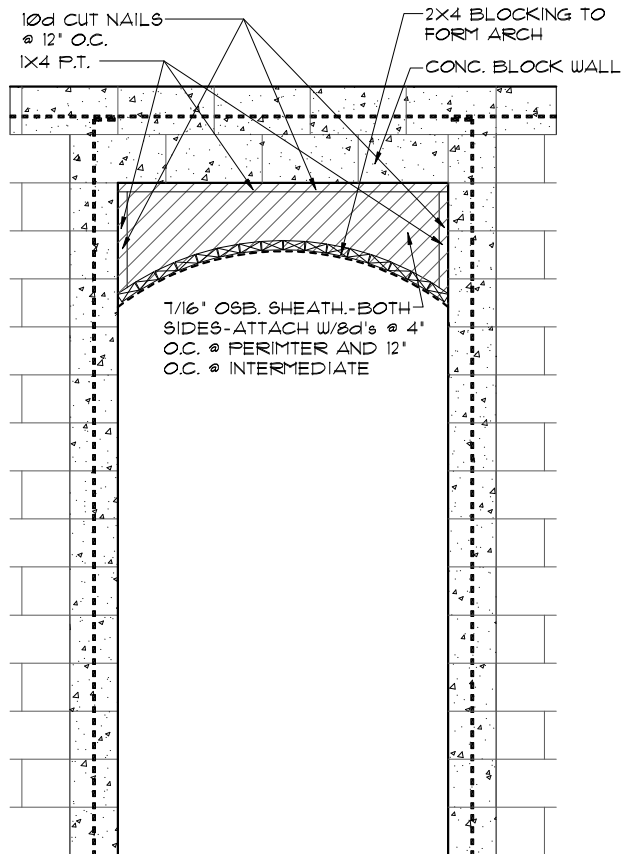

**4**  
8B  
DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R806: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593SF.}{300} = 8.64SF.$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL: ----- **468SF.**  
PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **78SF.** /VENT.  
(VENT TYPE: LOMANCO MODEL T10-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL: ----- **432SF.**  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
( **50 LF.** @ **0.087SF.** VENTING PER LF.)


UPPER PORTION PERCENTAGE: 50%  
LOWER PORTION PERCENTAGE: 50%

**NOTES**

1. TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/ATCA BCS1.1.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R905.1.1 - Underlayment materials required to comply with ASTM D226, D4869 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R905.1.1. Underlayment shall be applied and attached in accordance with Table R905.1.1.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
  - LOMANCO : (2) 9 1/2" DIA. CIRCLES
  - MILLENNIUM METAL : 2 1/2" X 46" HOLE
9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R905.1.1

**TRUSS LAYOUT "B"**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

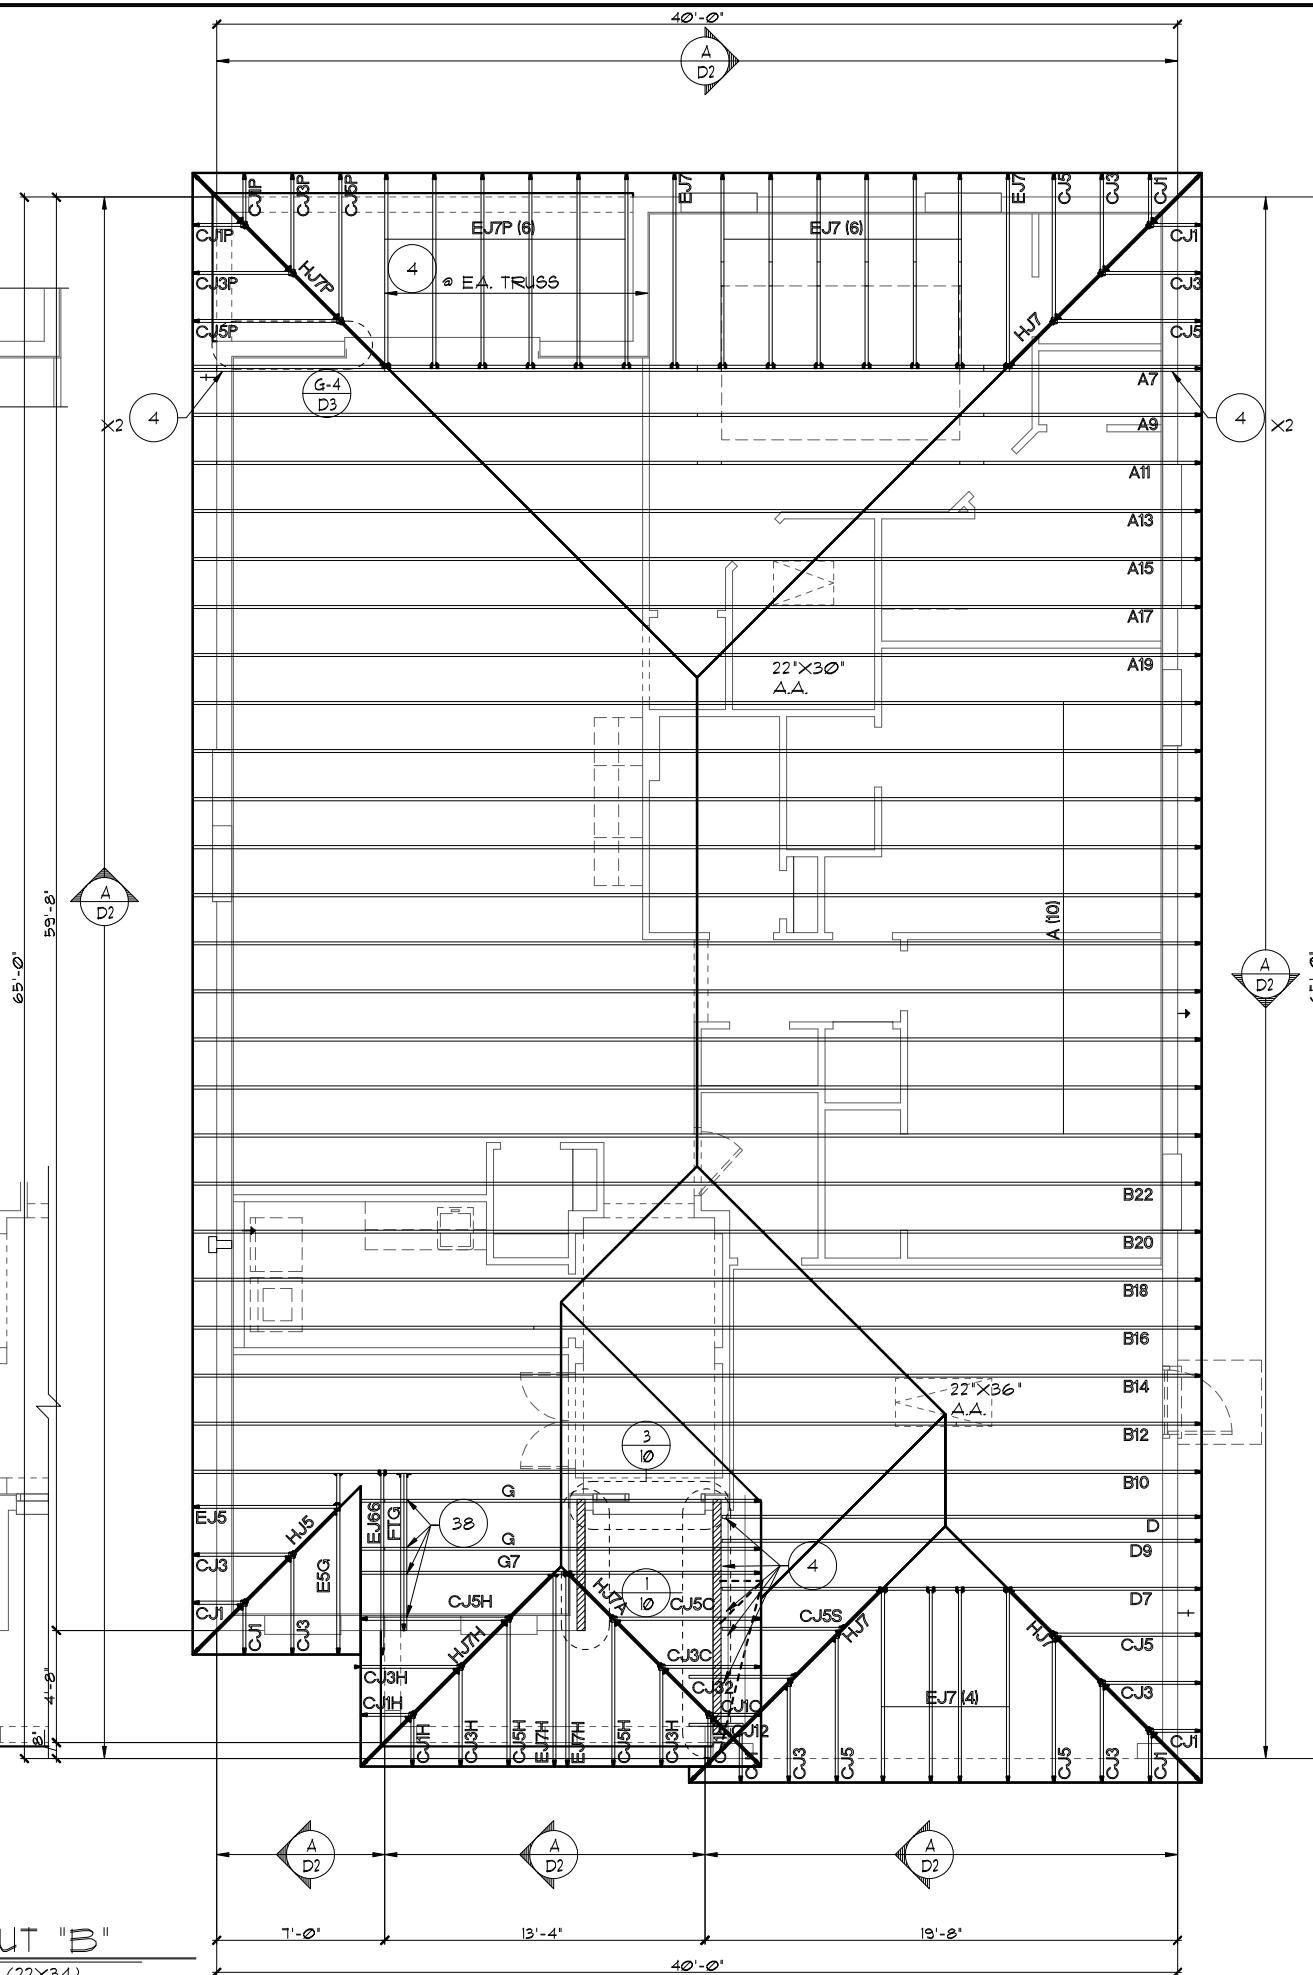

FLORIDA SERIES

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

REVISIONS	BY
05-16-19	JF

**ITTEG**  
THOMPSON ENGINEERING GROUP, INC.  
4401 Vineyard Road, Suite 200  
Orlando, Florida 32811  
Phone: (407) 529-3000

**Park Square HOMES**

**TRUSS LAYOUT**


1966  
MARGATE II

DATE 04-05-2011  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET

08B  
OF 08 SHEETS





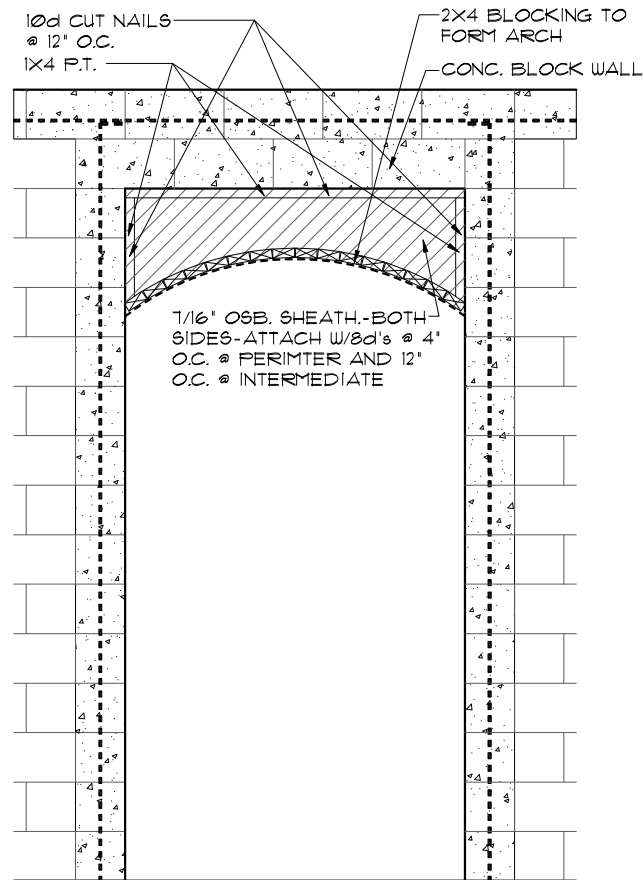

**4**  
**8B** **DETAIL**  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R206: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL:----- **4.68S.F.**  
PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78S.F.** /VENT.  
(VENT TYPE: LOMANCO MODEL 770-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- **4.32S.F.**  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:---  
( **50** L.F. @ **0.087S.F.** VENTING PER L.F.)

UPPER PORTION PERCENTAGE: **50%**  
LOWER PORTION PERCENTAGE: **50%**

**NOTES**

- TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
- ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
- TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA ECSI 1.
- REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
- SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R905.1.1 - Underlayment materials required to comply with ASTM D226, D4869 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R905.1.1. Underlayment shall be applied and attached in accordance with Table R905.1.1.
- OFF RIDGE VENTS MAXIMUM OPENING SIZES :
  - LOMANCO : (2) 9 1/4" DIA. CIRCLES
  - MILLENNIUM METAL : 2 1/2" X 46" HOLE
- ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R905.1.1

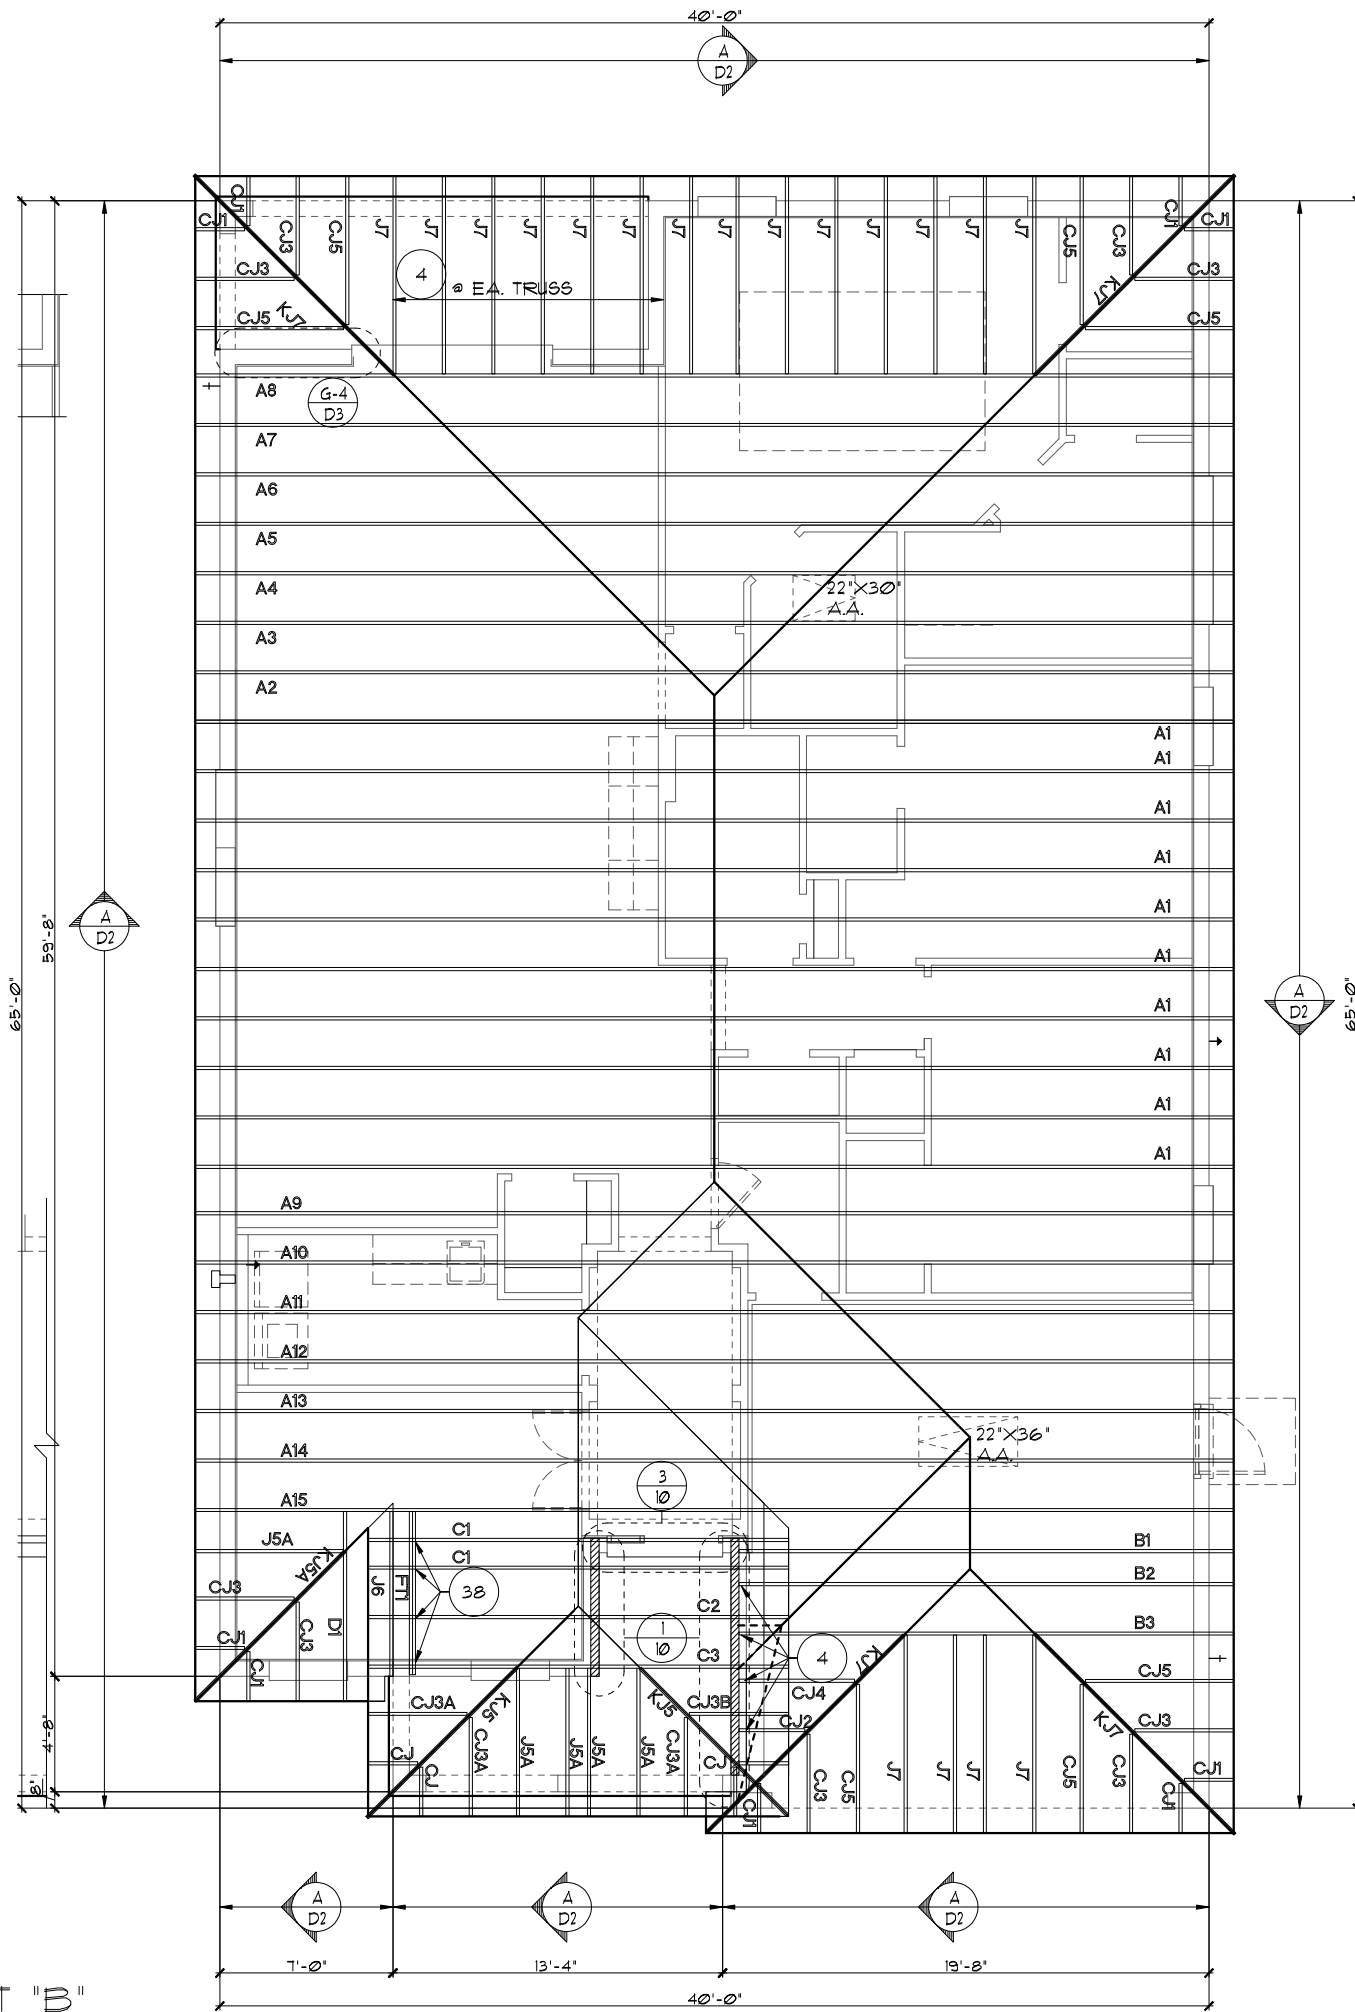

**TRUSS LAYOUT "B"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

FLORIDA SERIES

LOT: 0000, COMMUNITY NAME

1966

MARGATE II

DATE 04-05-2017

SCALE AS NOTED

DRAWN RDC

JOB N/A

SHEET

008B

OF 00 SHEETS

REVISIONS	BY
05-16-19	JF

**ITEG**  
THOMPSON ENGINEERING GROUP, INC.  
10000 W. BOCA RATON BLVD., SUITE 100  
BOCA RATON, FL 33433  
TEL: (561) 734-1400  
WWW.ITEG.COM

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vlneland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 529 - 3000

**Park Square HOMES**


TRUSS LAYOUT

DATE 04-05-2017

SCALE AS NOTED

DRAWN RDC

JOB N/A

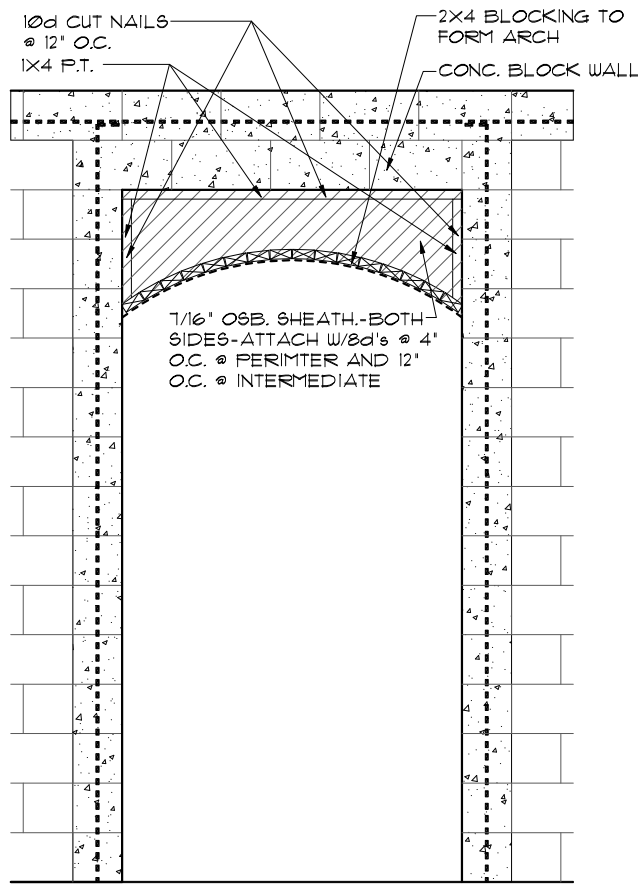

**4**  
**8B** DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R806: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:


TOTAL VENTED SPACE:  $\frac{2,593\text{SF}}{300} = 8.64\text{SF}$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL: ----- **4.68SF.**  
PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78SF.** /VENT.  
(VENT TYPE: LOMANCO MODEL TT0-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL: ----- **4.32SF.**  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
( **50** LF. @ **0.087SF.** VENTING PER LF.)

UPPER PORTION PERCENTAGE: **50%**  
LOWER PORTION PERCENTAGE: **50%**

- NOTES**
1. TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
  2. TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
  3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
  4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTC A BCS1 I.
  6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 at Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
  8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
    - LOMANCO : (2) 9 1/4" DIA. CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1.1

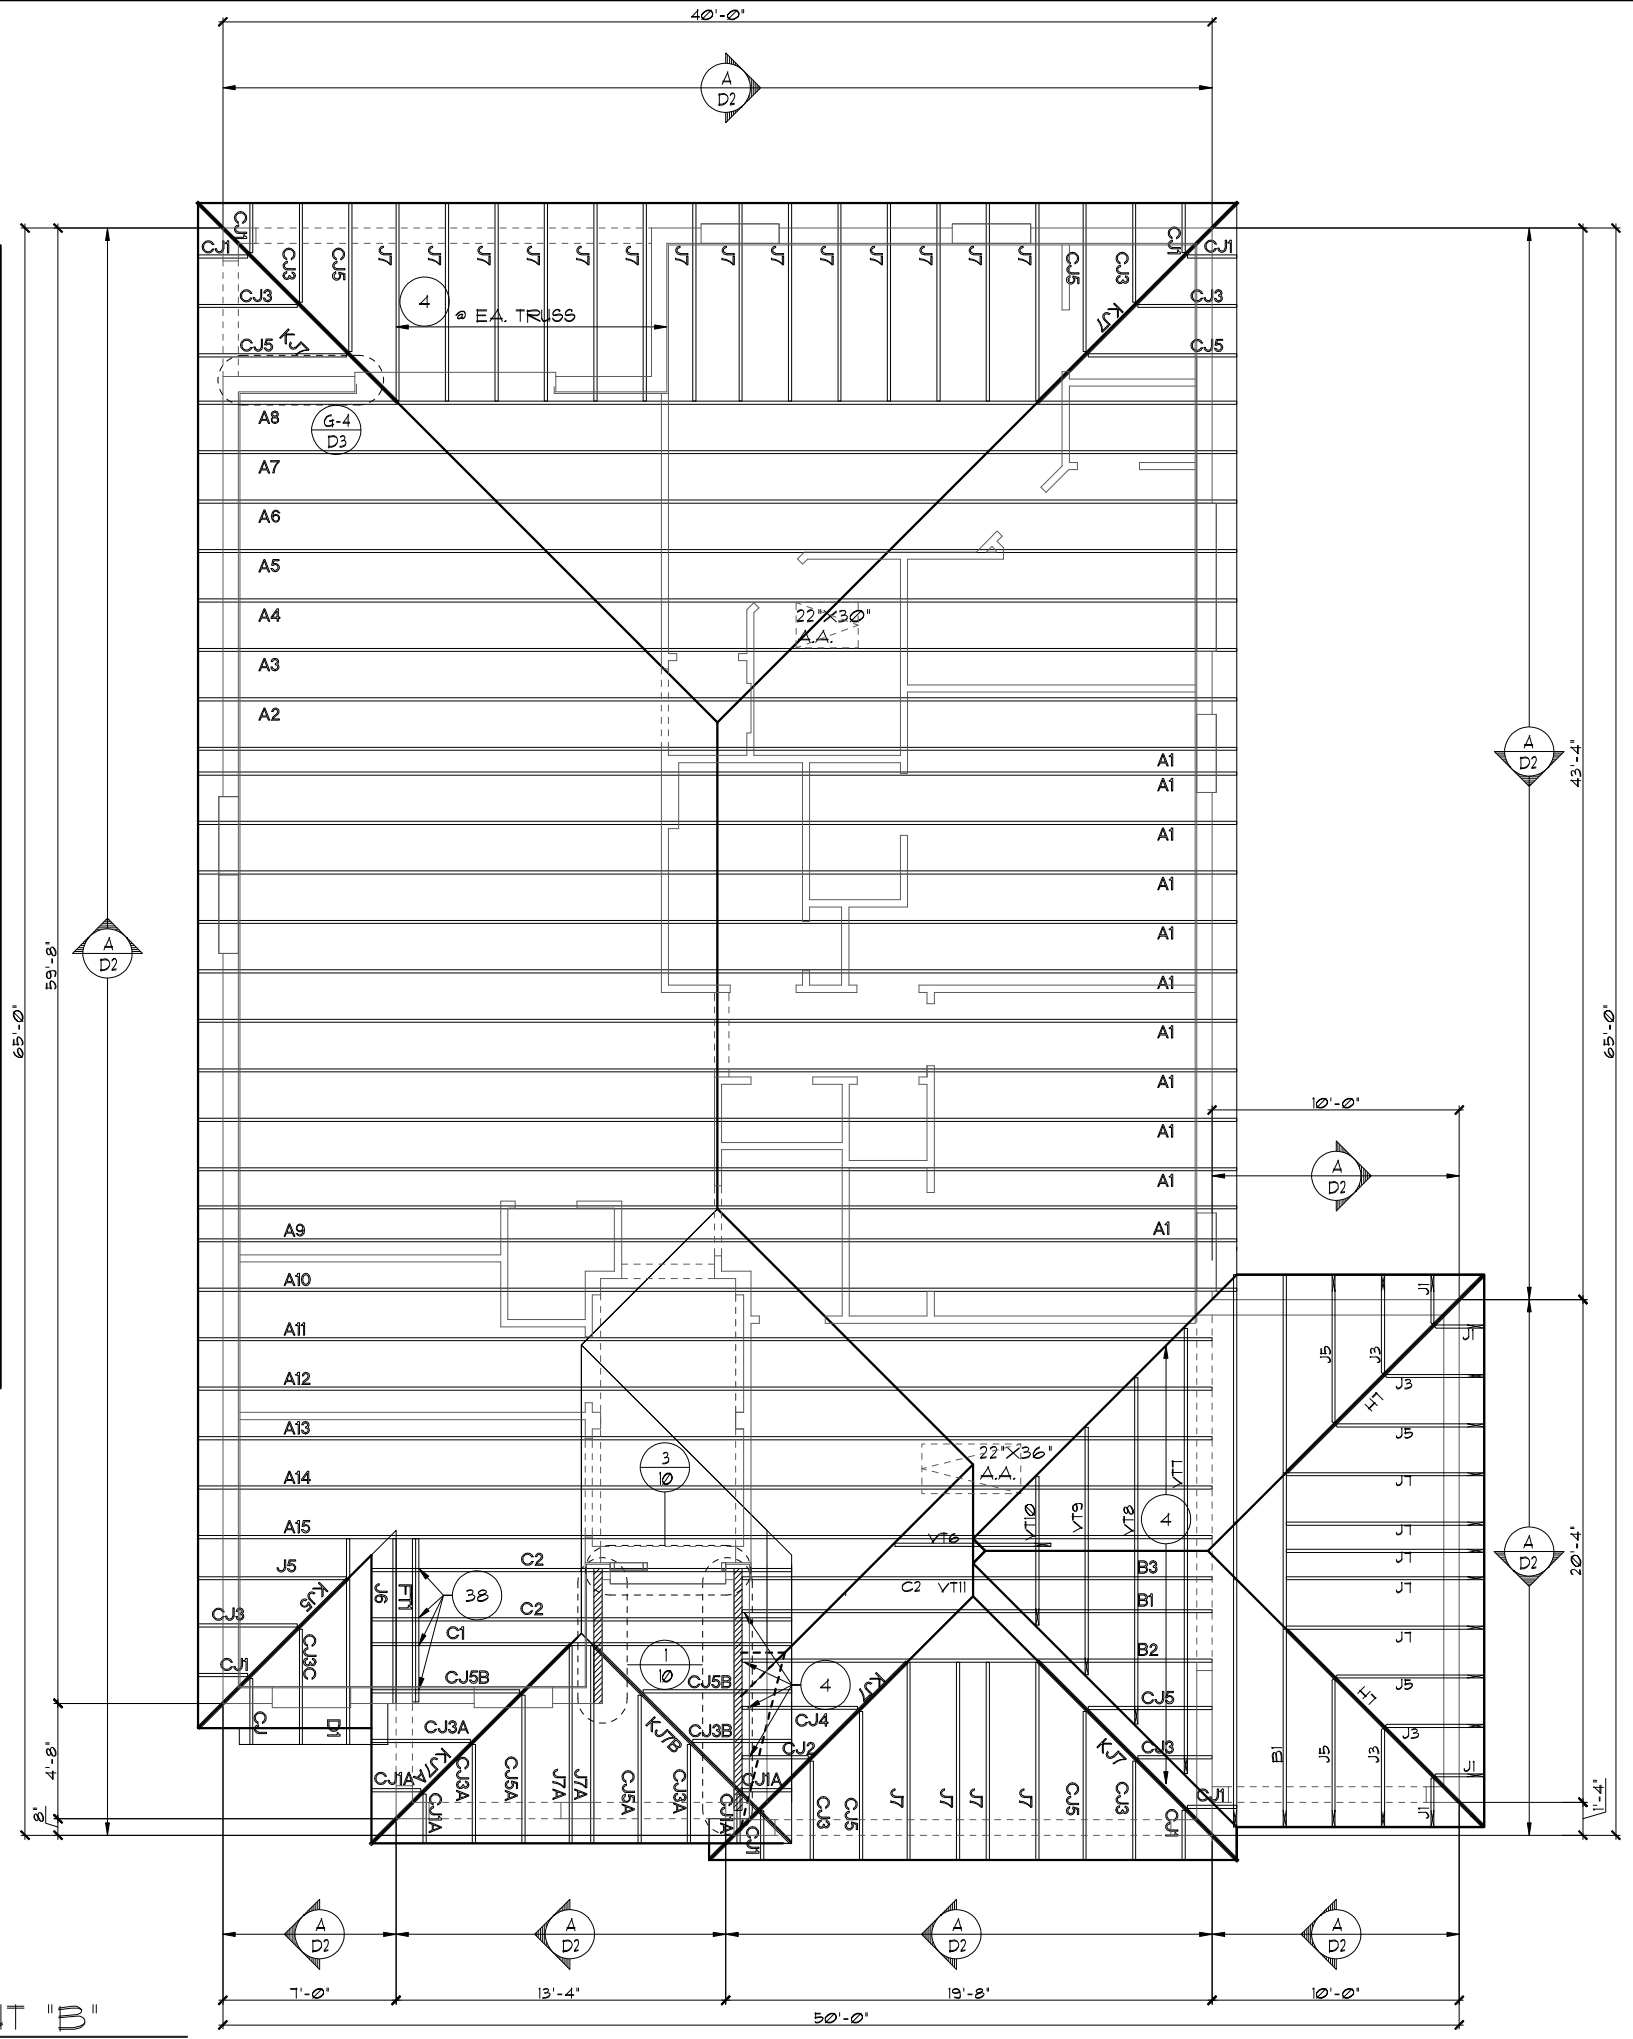


**TRUSS LAYOUT "B"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME: MARGATE II

FLORIDA SERIES	
REVISIONS	BY
05-16-19	JF
<b>ITEG</b> THOMPSON ENGINEERING GROUP, INC. 14001 W. BIRCHWOOD BLVD. SUITE 100 ORLANDO, FL 32837 TEL: (407) 794-1400 FAX: (407) 794-1790 WWW.ITEG.COM	
A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida, 32811 Phone: (407) 529 - 3000	
<b>Park Square HOMES</b>	
TRUSS LAYOUT	
DATE 04-05-2017	SCALE AS NOTED
DRAWN RDC	JOB N/A
SHEET	08B.3
OF 00 SHEETS	

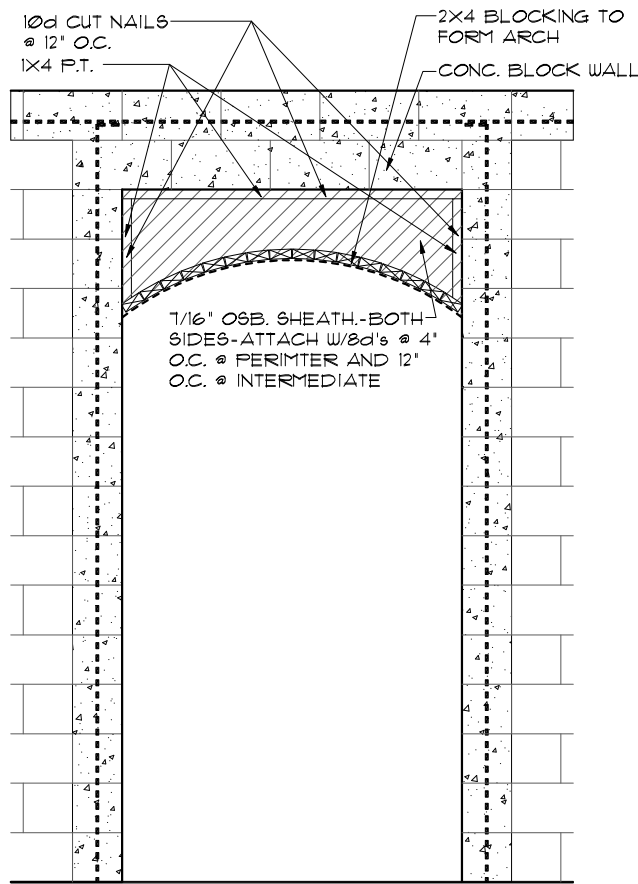

**4**  
**8B** **DETAIL**  
1/2'-1'-0" (11X17) 1'-1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R806: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{SF}}{300} = 8.64\text{SF}$ . NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL:----- **4.68SF.**  
PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78SF** /VENT.  
(VENT TYPE: LOMANCO MODEL T10-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- **4.32SF.**  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
( **50 LF.** @ **0.0878SF** VENTING PER LF.)

UPPER PORTION PERCENTAGE: **50%**  
LOWER PORTION PERCENTAGE: **50%**

**NOTES**

1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC91 I.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R905.1.1 - Underlayment materials required to comply with ASTM D226, D4869 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R905.1.1. Underlayment shall be applied and attached in accordance with Table R905.1.1.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
  - LOMANCO : (2) 9 1/4" DIA. CIRCLES
  - MILLENNIUM METAL : 2 1/2" X 46" HOLE
9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R905.1.1.

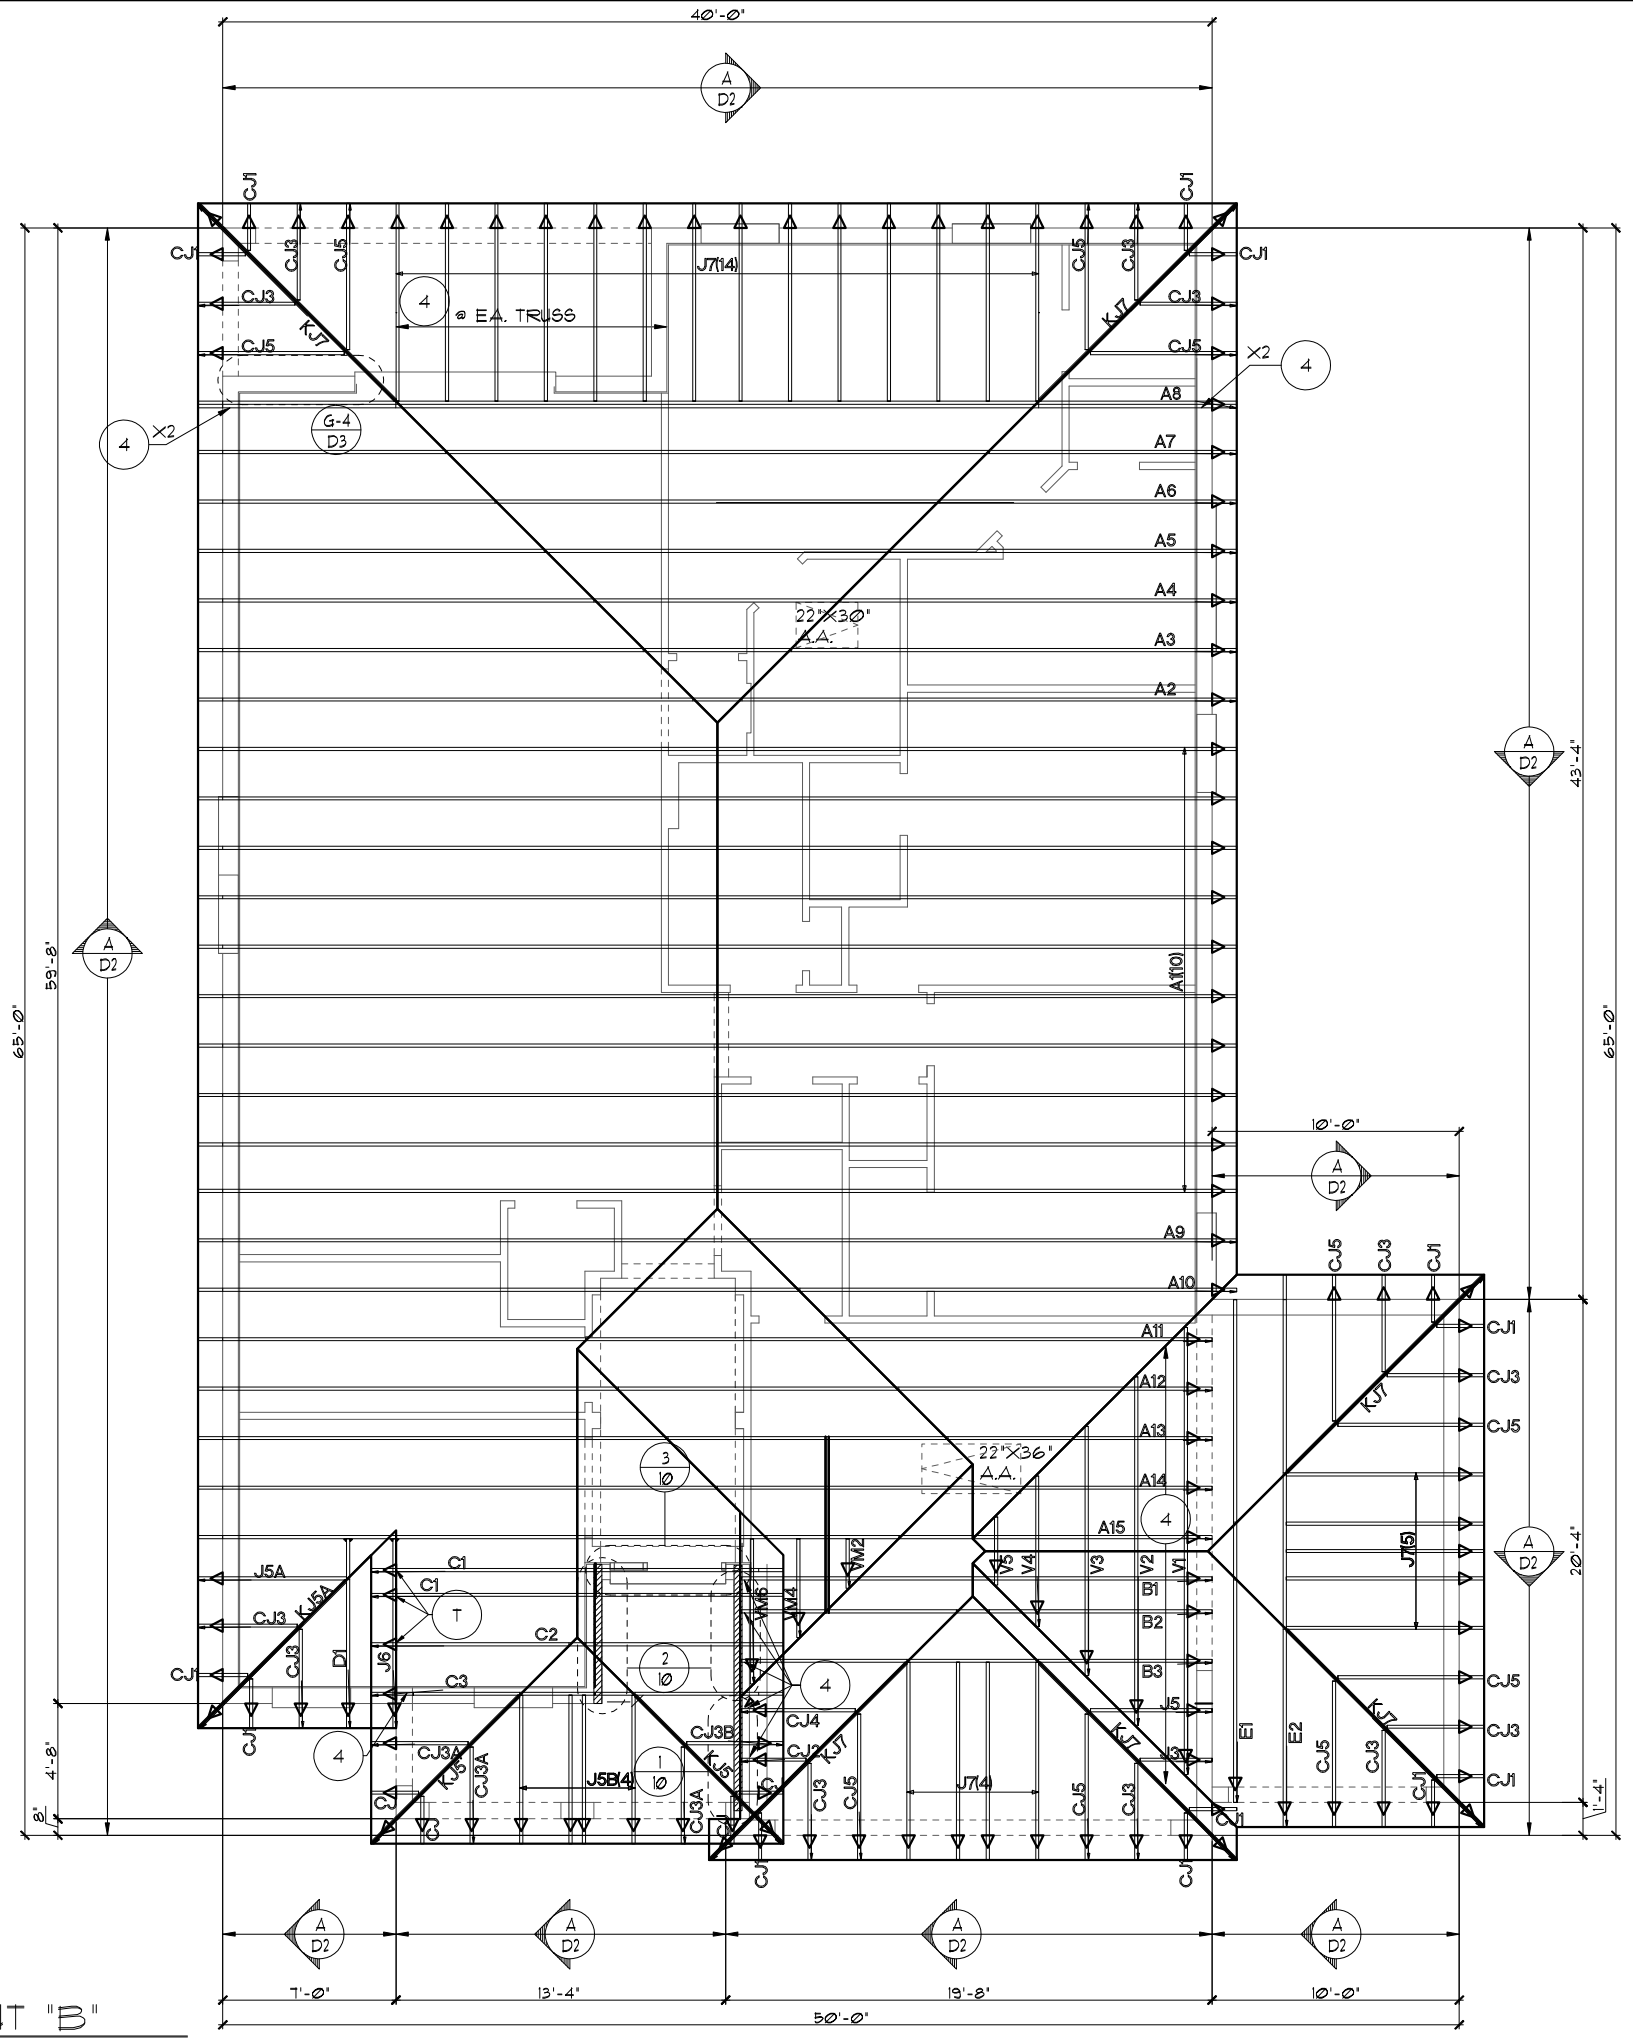


**TRUSS LAYOUT "B"**  
1/8'-1'-0" (11X17) 1/4'-1'-0" (22X34)

LOT: 0000, COMMUNITY NAME  
 THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

**FLORIDA SERIES**  
**ITEG**  
 ITC ENGINEERING GROUP, INC.  
 5200 Vineyard Road, Suite 200  
 Orlando, Florida 32811  
 Phone: (407) 529-3000  
**Park Square HOMES**  
 TRUSS LAYOUT  
 1966  
 MARGATE II  
 DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET  
**08B.3**  
 OF 08 SHEETS

REVISIONS	BY
05-16-19	JF

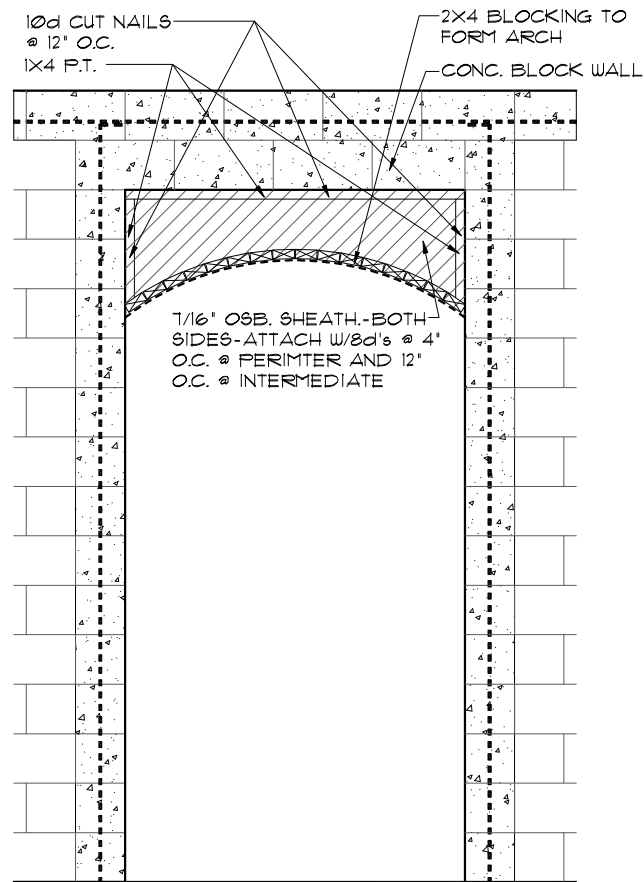

4  
8B  
DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{SF}}{300} = \underline{8,643\text{SF}}$  NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL:----- 468SF.  
PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78SF. /VENT. (VENT TYPE: LOMANCO MODEL T10-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- 432SF.  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:-- ( 50 LF. @ 0.0878SF. VENTING PER LF.)

UPPER PORTION PERCENTAGE: 50%  
LOWER PORTION PERCENTAGE: 50%

**NOTES**

1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC61 I.
6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.11 - Underlayment materials required to comply with ASTM D226, D4869 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.11. Underlayment shall be applied and attached in accordance with Table R305.11.
8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
  - LOMANCO : (2) 9 1/4" DIA. CIRCLES
  - MILLENNIUM METAL : 2 1/2" X 46" HOLE
9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.11.

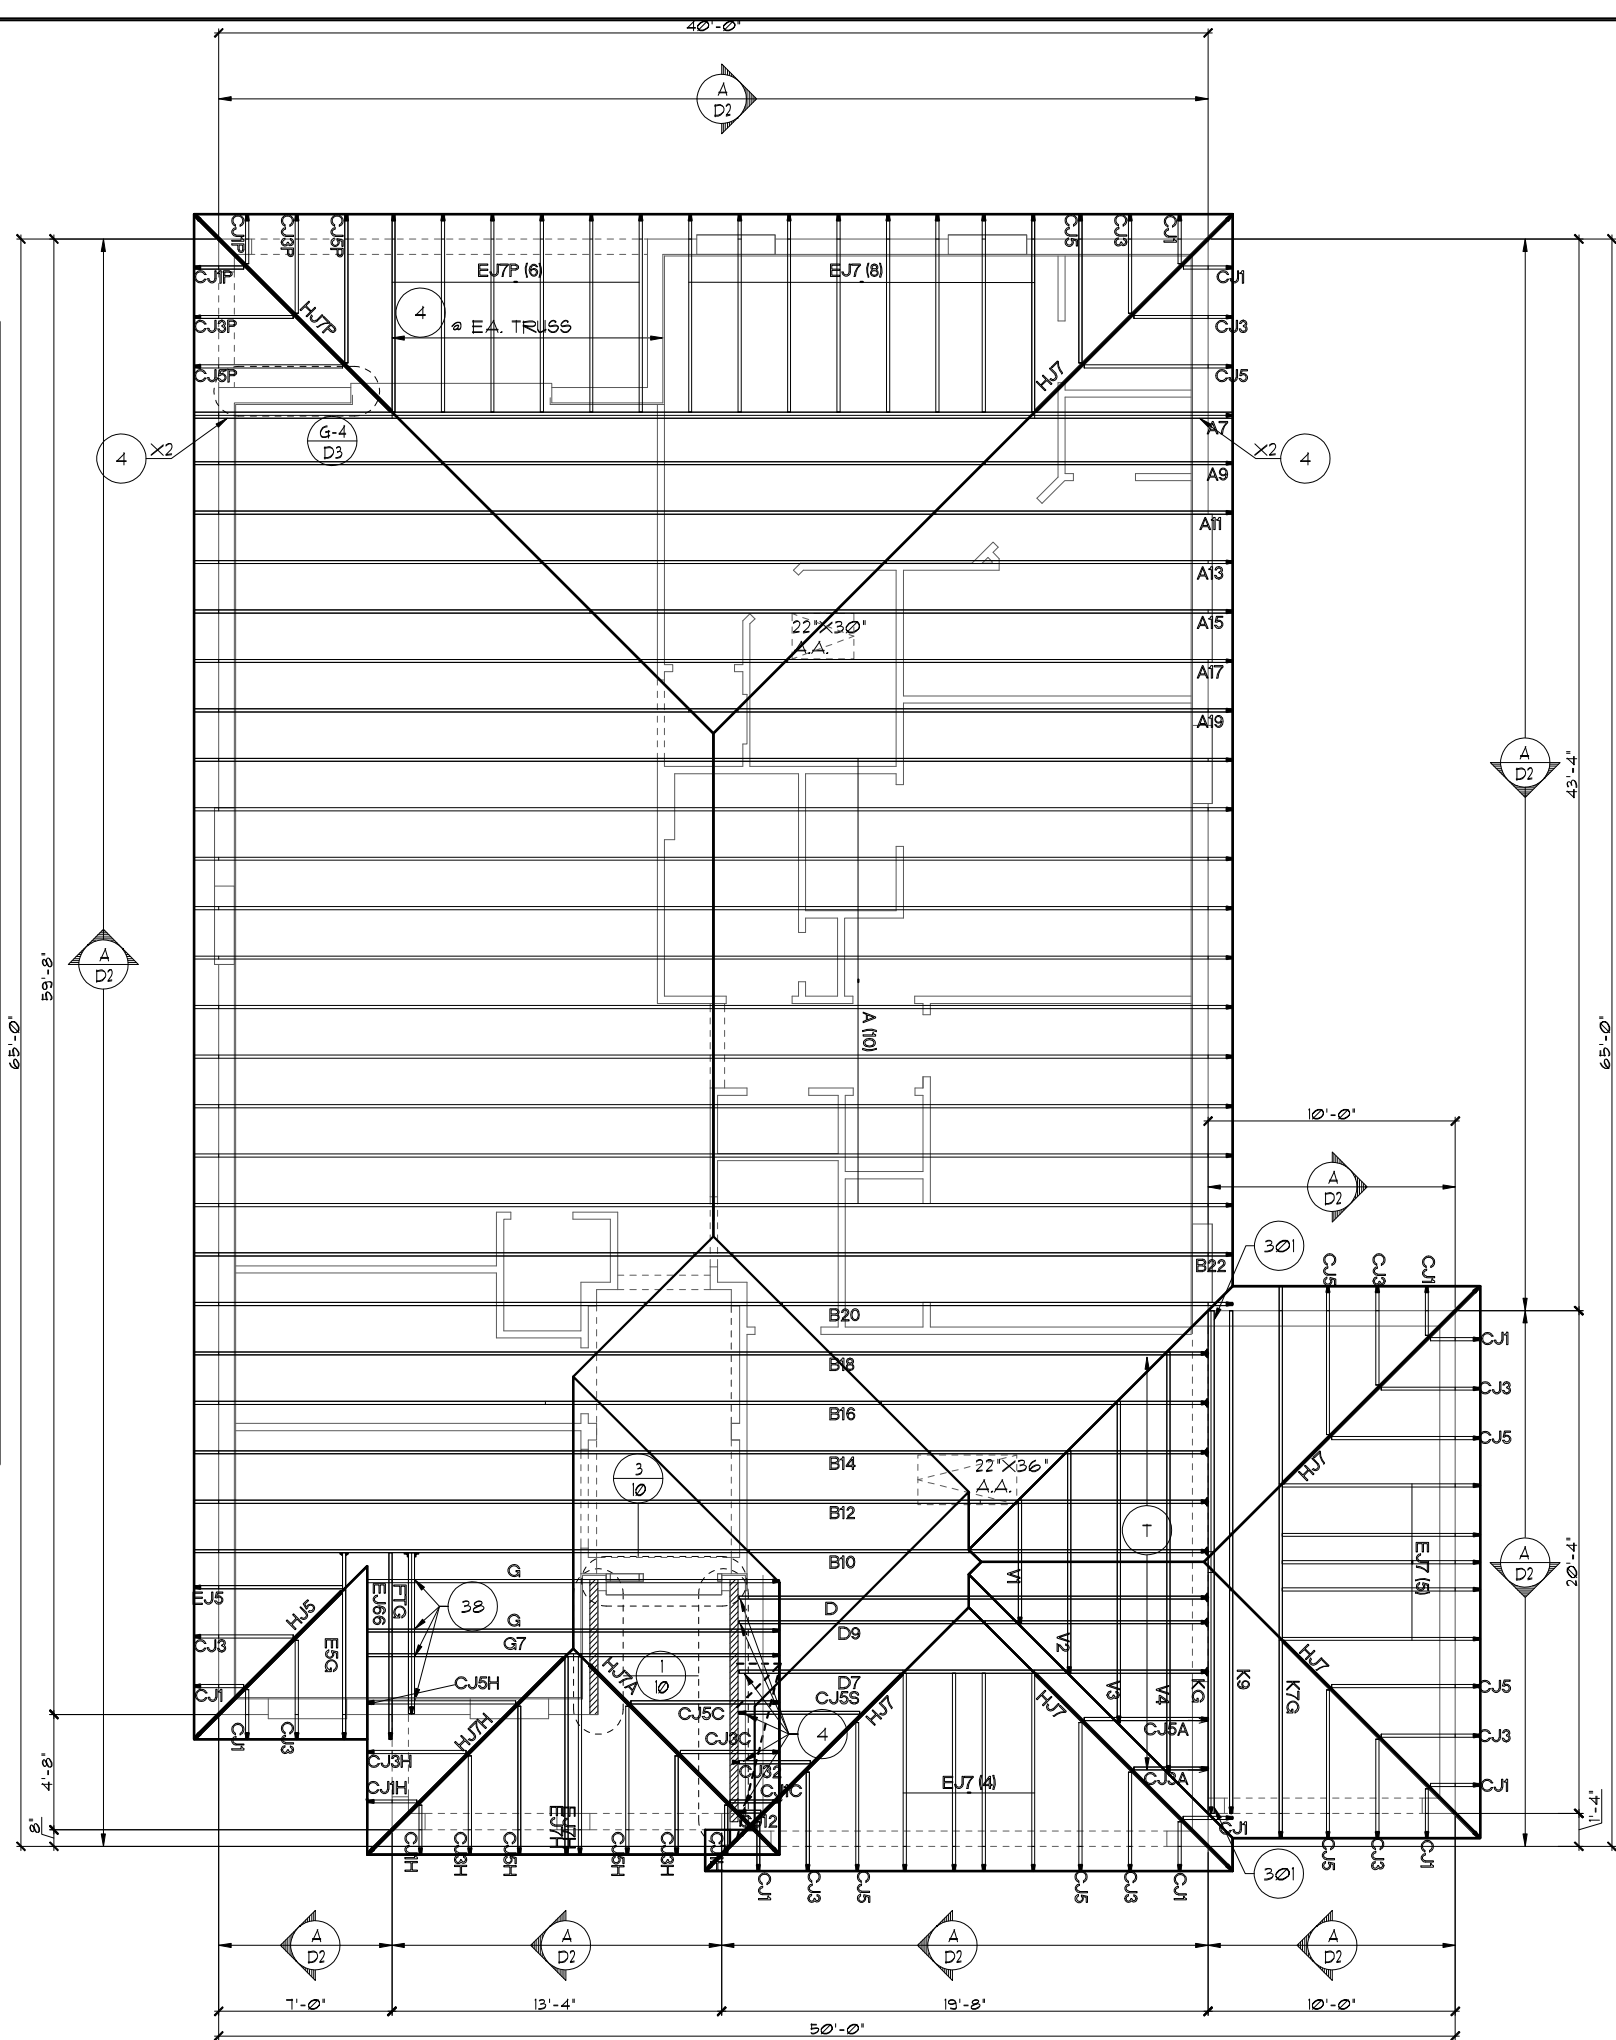


TRUSS LAYOUT "B"  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME: MARGATE II

FLORIDA SERIES	
REVISIONS	BY
05-16-19	JF
 ITCAMERSON ENGINEERING GROUP, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32811 Phone: (407) 794-1790 www.iteg.com	
 A DIVISION OF PARK SQUARE ENTERPRISES, INC. 5200 Vineland Road, Suite 200 Orlando, Florida 32811 Phone: (407) 528 - 3000	
TRUSS LAYOUT	
1966	
MARGATE II	
DATE 04-05-2017	
SCALE AS NOTED	
DRAWN	RDC
JOB	N/A
SHEET	
08B.3	
OF 00 SHEETS	

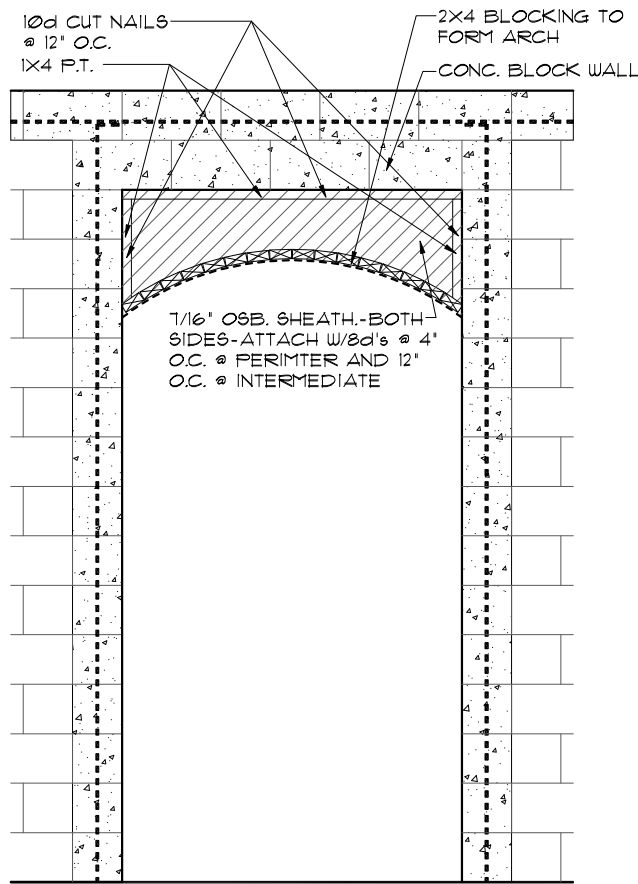

**4** **8B** **DETAIL**  
 1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:


TOTAL VENTED SPACE:  $\frac{2,593\text{SF}}{300} = 8.64\text{SF}$ . NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL:----- **4.68SF**.  
 PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78SF** /VENT.  
 (VENT TYPE: LOMANCO MODEL T10-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- **4.32SF**.  
 PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
 ( **.50 LF.** @ **0.0878SF** VENTING PER LF.)

UPPER PORTION PERCENTAGE: **50%**  
 LOWER PORTION PERCENTAGE: **50%**

- NOTES**
1. TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
  2. TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
  3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
  4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC81 I.
  6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
  8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
    - LOMANCO : (2) 9 1/4" DIA. CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1.

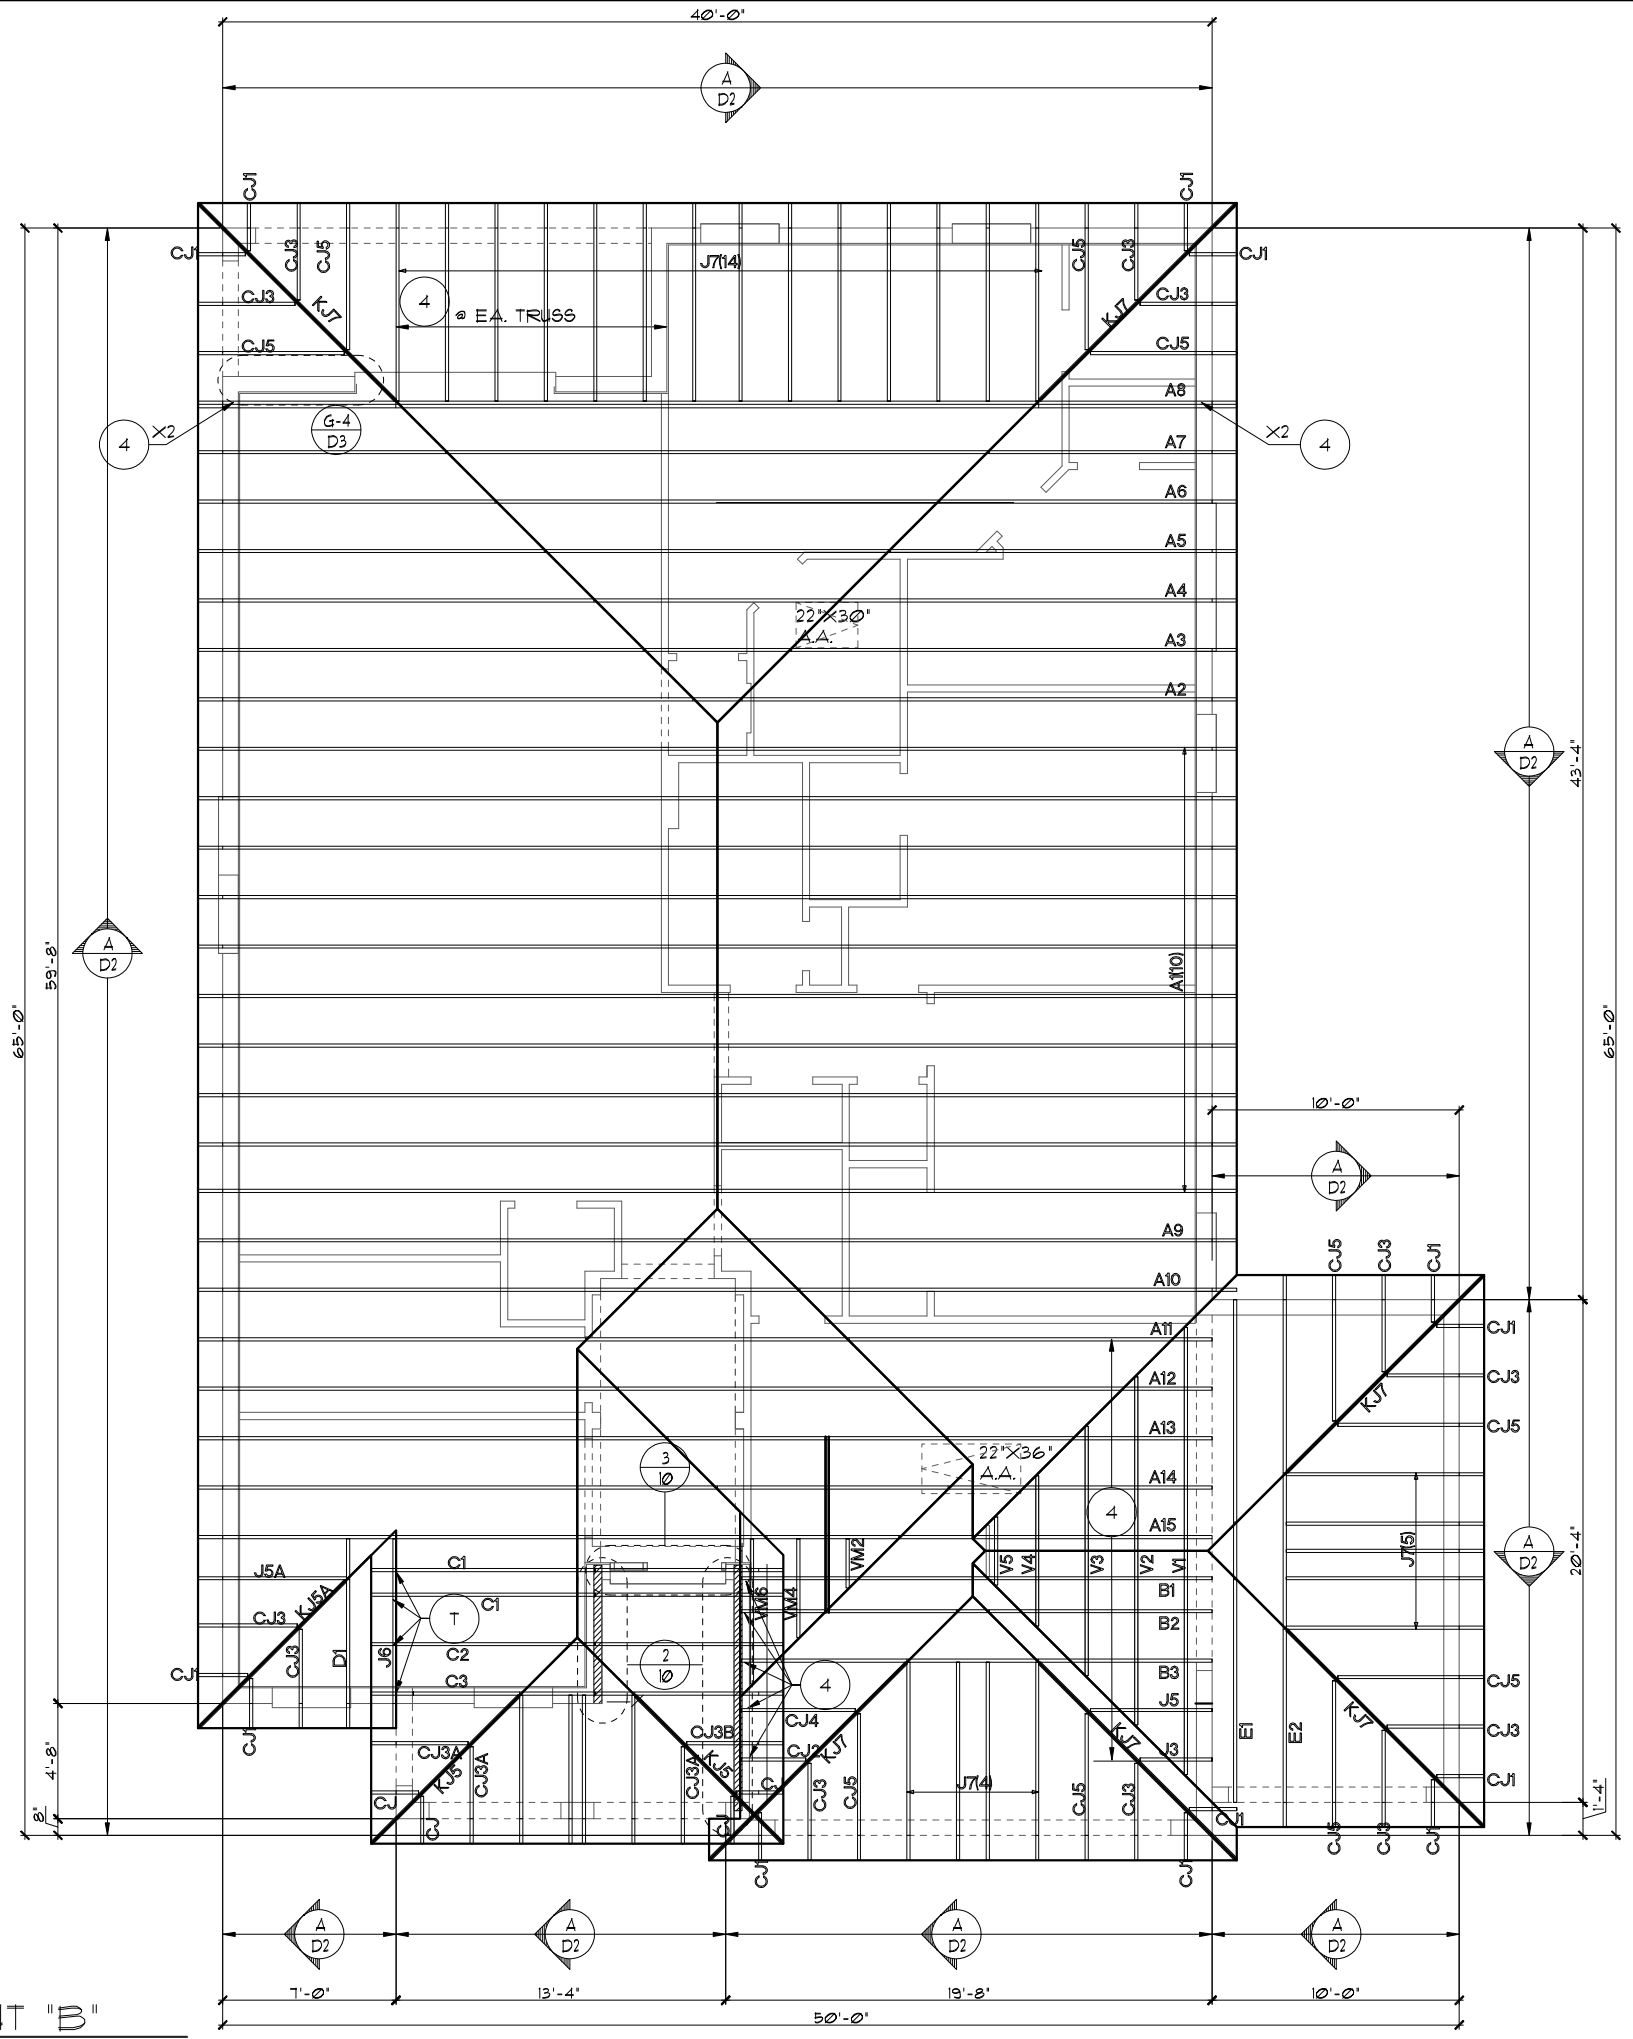

**TRUSS LAYOUT "B"**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
**LOT: 0000, COMMUNITY NAME**  
**FLORIDA SERIES**

REVISIONS	BY
05-16-19	JF


**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 5200 Vineyard Road, Suite 200  
 Orlando, Florida 32811  
 Phone: (407) 794-1790  
 www.iteg.com

**Park Square HOMES**  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineyard Road, Suite 200  
 Orlando, Florida 32811  
 Phone: (407) 529 - 3000

**TRUSS LAYOUT**

1966  
**MARGATE II**

DATE	04-05-2017
SCALE	AS NOTED
DRAWN	RDC
JOB	N/A
SHEET	08B.3
OF	08 SHEETS

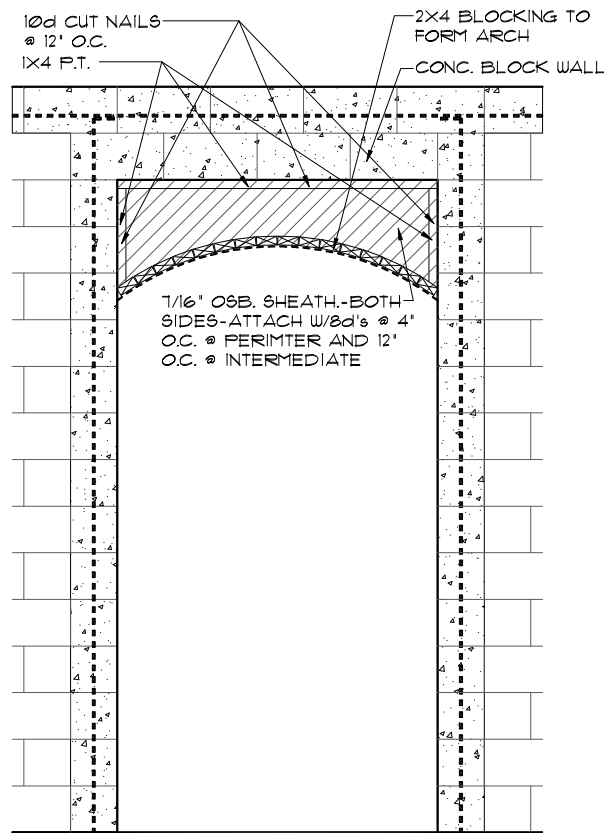

4  
8C  
DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R906: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:


TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL: ----- 4.68S.F.  
PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78S.F. /VENT.  
(VENT TYPE: LOMANCO MODEL TT0-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL: ----- 4.32S.F.  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
( 50 L.F. @ 0.087S.F. VENTING PER L.F.)

UPPER PORTION PERCENTAGE: 50%  
LOWER PORTION PERCENTAGE: 50%

- NOTES**
- TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  - TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  - PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
  - ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  - TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/UTCA BCS1.1.
  - REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  - SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R905.11 - Underlayment materials required to comply with ASTM D226, D4869 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R905.11. Underlayment shall be applied and attached in accordance with Table R905.11.
  - OFF RIDGE VENTS MAXIMUM OPENING SIZES:
    - LOMANCO : (2) 5 1/2" DIA CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  - ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R905.11.1

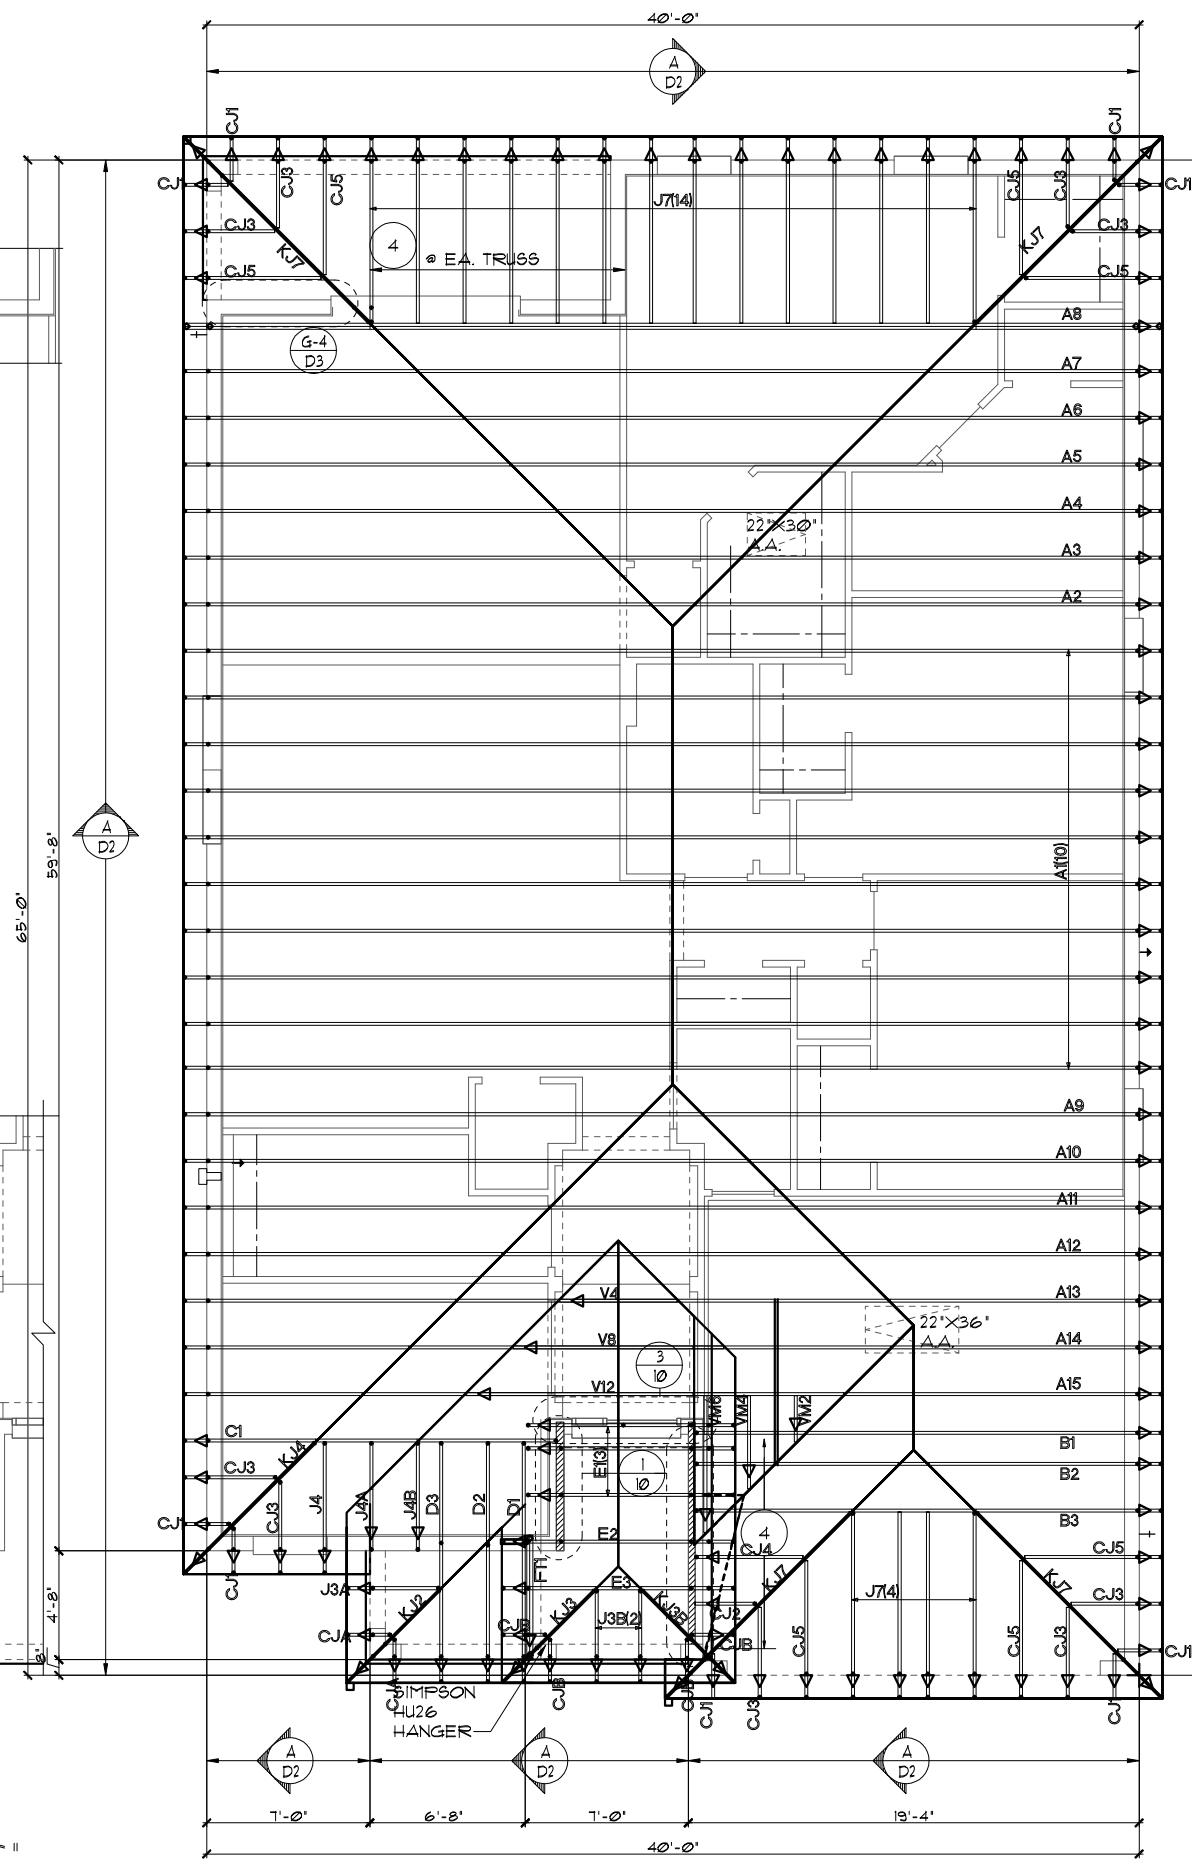

TRUSS LAYOUT "C"  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME: MARGATE II

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET 08C OF 00 SHEETS

1966

TRUSS LAYOUT


FLORIDA SERIES

REVISIONS BY  
05-10-19 JF

**ITEG**  
THOMPSON ENGINEERING GROUP, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 754-1700  
www.iteg.com

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 629-3000

Park Square HOMES

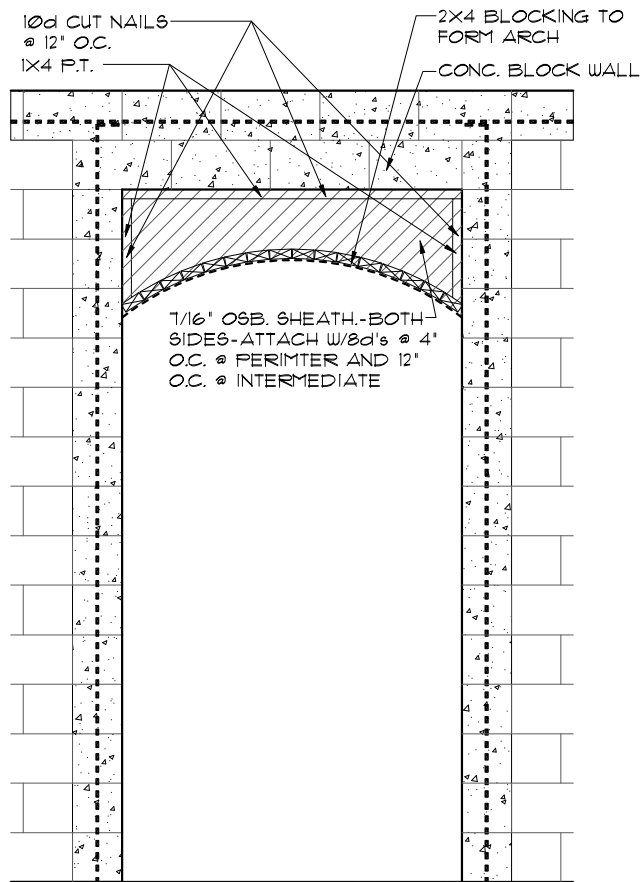

4  
8C  
DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = \frac{8.64\text{S.F.}}{\text{REQUIRED}}$


UPPER PORTION VENTILATION TOTAL:----- 4.68S.F.  
PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78S.F. /VENT.  
(VENT TYPE: LOMANCO MODEL 770-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- 4.32S.F.  
PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
( 50 LF. @ 0.087S.F. VENTING PER LF.)

UPPER PORTION PERCENTAGE: 50%  
LOWER PORTION PERCENTAGE: 50%

**NOTES**

- TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
- ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
- TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA ECSI 1.
- REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
- SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
- OFF RIDGE VENTS MAXIMUM OPENING SIZES:
  - LOMANCO : (2) 9 1/4" DIA. CIRCLES
  - MILLENNIUM METAL : 2 1/2" X 46" HOLE
- ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1

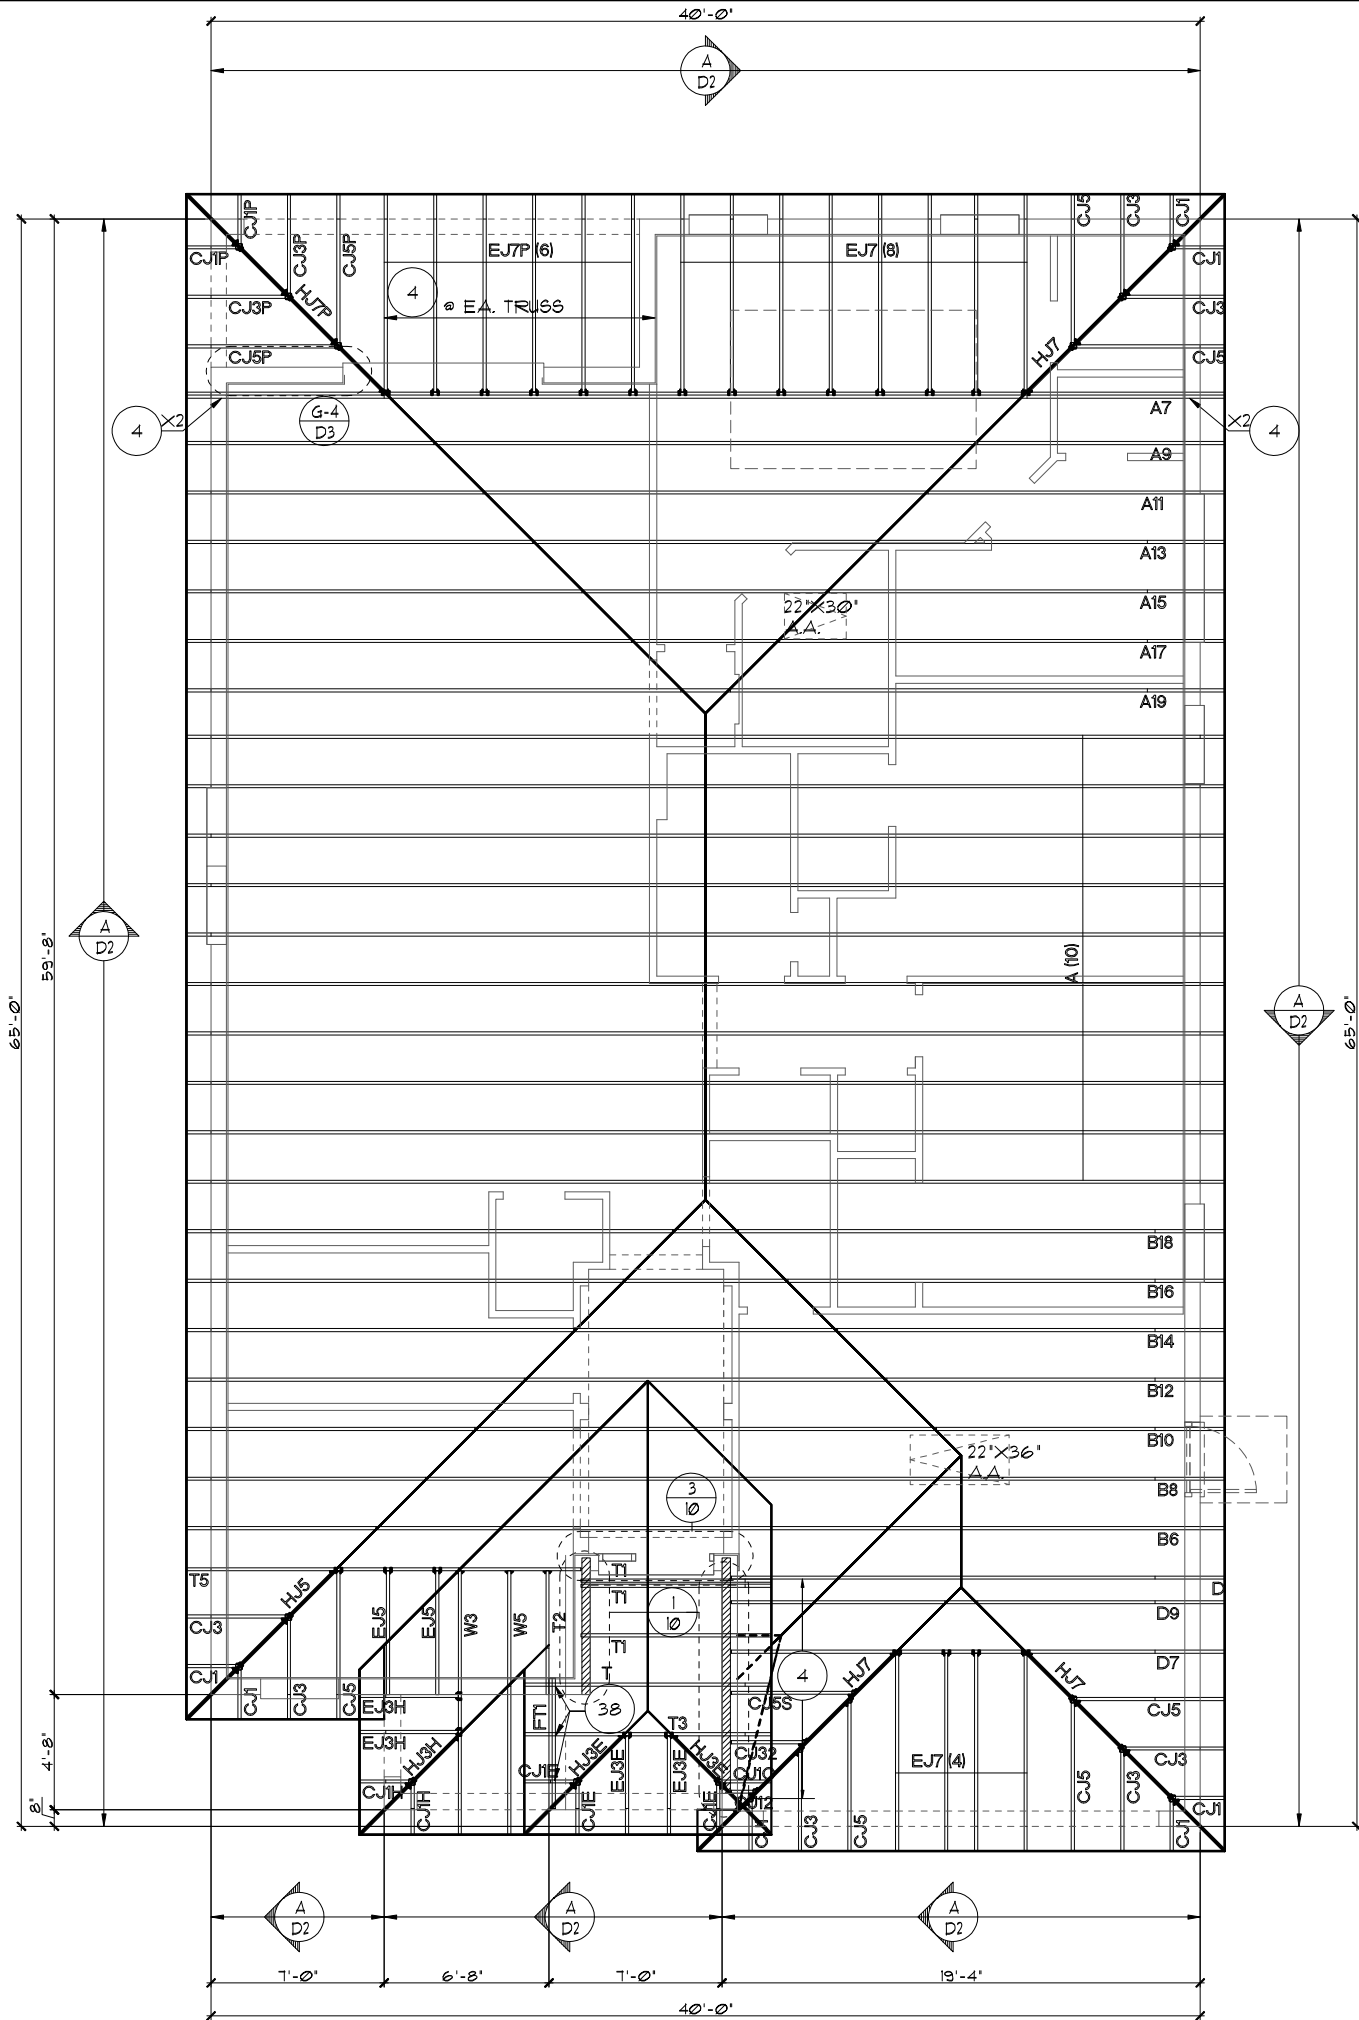

TRUSS LAYOUT "C"  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

FLORIDA SERIES

Park Square HOMES

TRUSS LAYOUT


1966  
MARGATE II

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET  
OF 00 SHEETS

REVISIONS	BY
05-16-19	JF

**ITEG**  
HOBSON ENGINEERING GROUP, INC.  
1401 W. US HWY 1  
ORLANDO, FL 32817  
TEL: (407) 734-1400  
WWW.ITEG.COM

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida, 32811  
Phone: (407) 529 - 3000

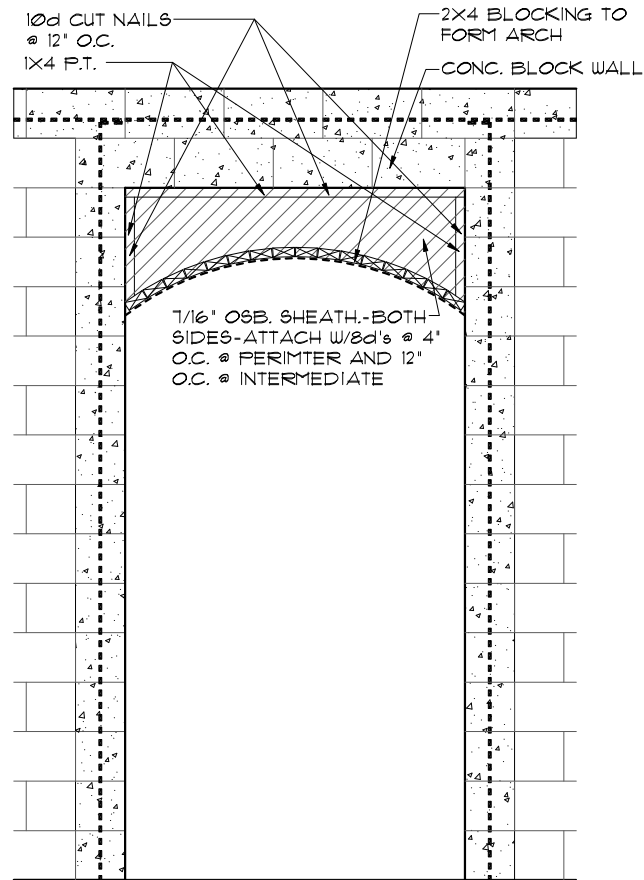

**4** **DETAIL**  
 8C 1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{SF.}}{300} = \underline{8.64\text{SF.}}$  NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL:----- **4.68SF.**  
 PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78SF.** /VENT.  
 (VENT TYPE: LOMANCO MODEL TT0-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- **4.32SF.**  
 PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
 ( **50** LF. @ **0.087SF.** VENTING PER LF.)

UPPER PORTION PERCENTAGE: **50%**  
 LOWER PORTION PERCENTAGE: **50%**

**NOTES**

- TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
- ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
- TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA ECSI 1.
- REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
- SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
- OFF RIDGE VENTS MAXIMUM OPENING SIZES:
  - LOMANCO : (2) 9 1/4" DIA. CIRCLES
  - MILLENNIUM METAL : 2 1/2" X 46" HOLE
- ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1

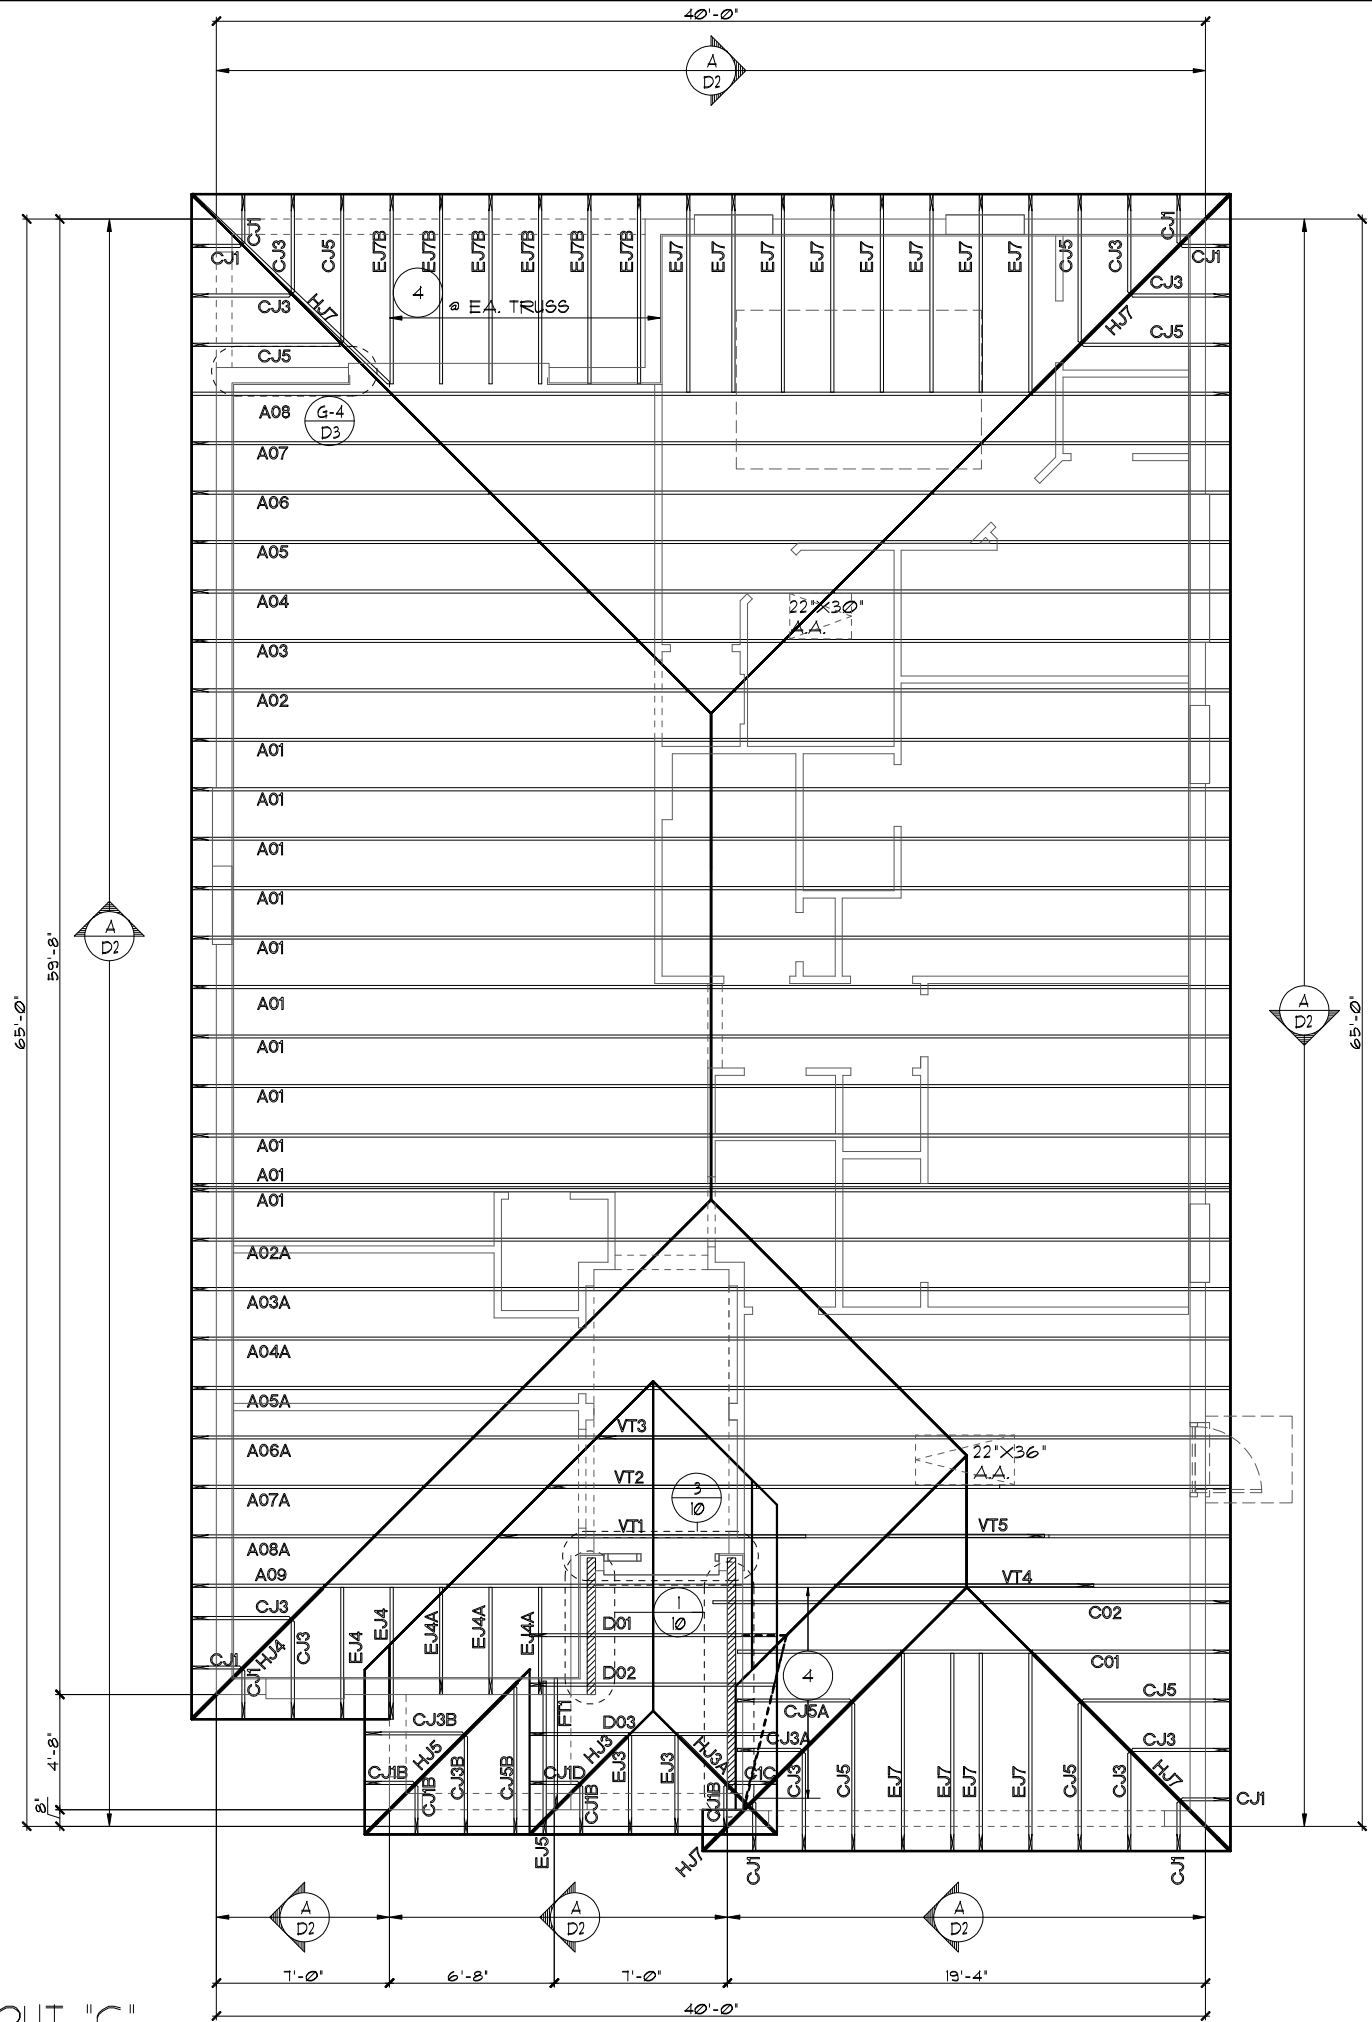

**TRUSS LAYOUT "C"**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

FLORIDA SERIES

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

© COPYRIGHT 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without the express written permission from Park Square Homes.

REVISIONS	BY
05-16-19	JF

**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 5200 Vineyard Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000

**Park Square HOMES**

A DIVISION OF PARK SQUARE ENTERPRISES, INC.


**TRUSS LAYOUT**

1966

**MARGATE II**

DATE	04-05-2017
SCALE	AS NOTED
DRAWN	RDC
JOB	N/A
SHEET	

08C  
 OF 08 SHEETS

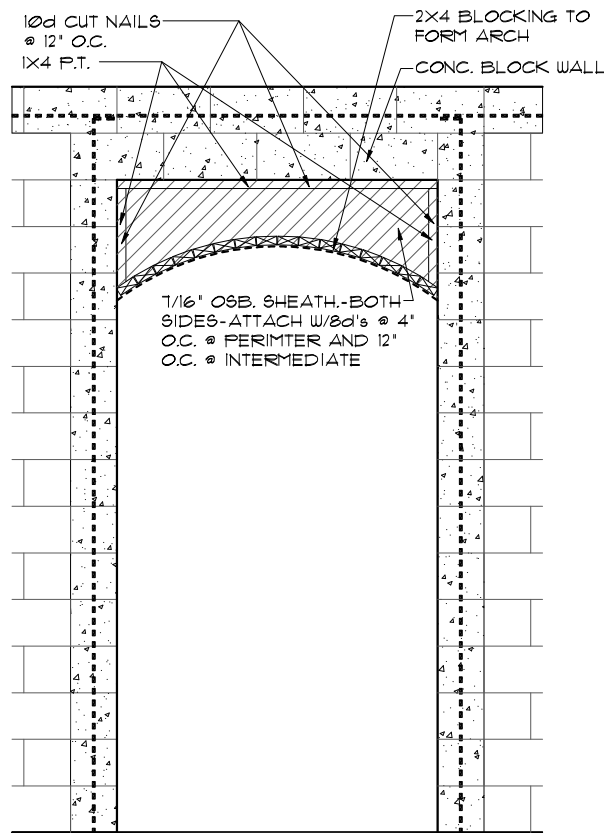

**4** **8C** **DETAIL**  
 1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R206: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:

TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL: ----- **4.68S.F.**  
 PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.78S.F.** /VENT.  
 (VENT TYPE: LOMANCO MODEL TT0-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL: ----- **4.32S.F.**  
 PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
 ( **50 L.F.** @ **0.087S.F.** VENTING PER L.F.)


UPPER PORTION PERCENTAGE: **50%**  
 LOWER PORTION PERCENTAGE: **50%**

**NOTES**

- TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
- PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
- ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
- TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BCSI 1.
- REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
- SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.11 - Underlayment materials required to comply with ASTM D226, D4869 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.11. Underlayment shall be applied and attached in accordance with Table R305.11.
- OFF RIDGE VENTS MAXIMUM OPENING SIZES:
  - LOMANCO : (2) 5 1/2" DIA. CIRCLES
  - MILLENNIUM METAL : 2 1/2" X 4 1/2" HOLE
- ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.11.1

**TRUSS LAYOUT "C"**

1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

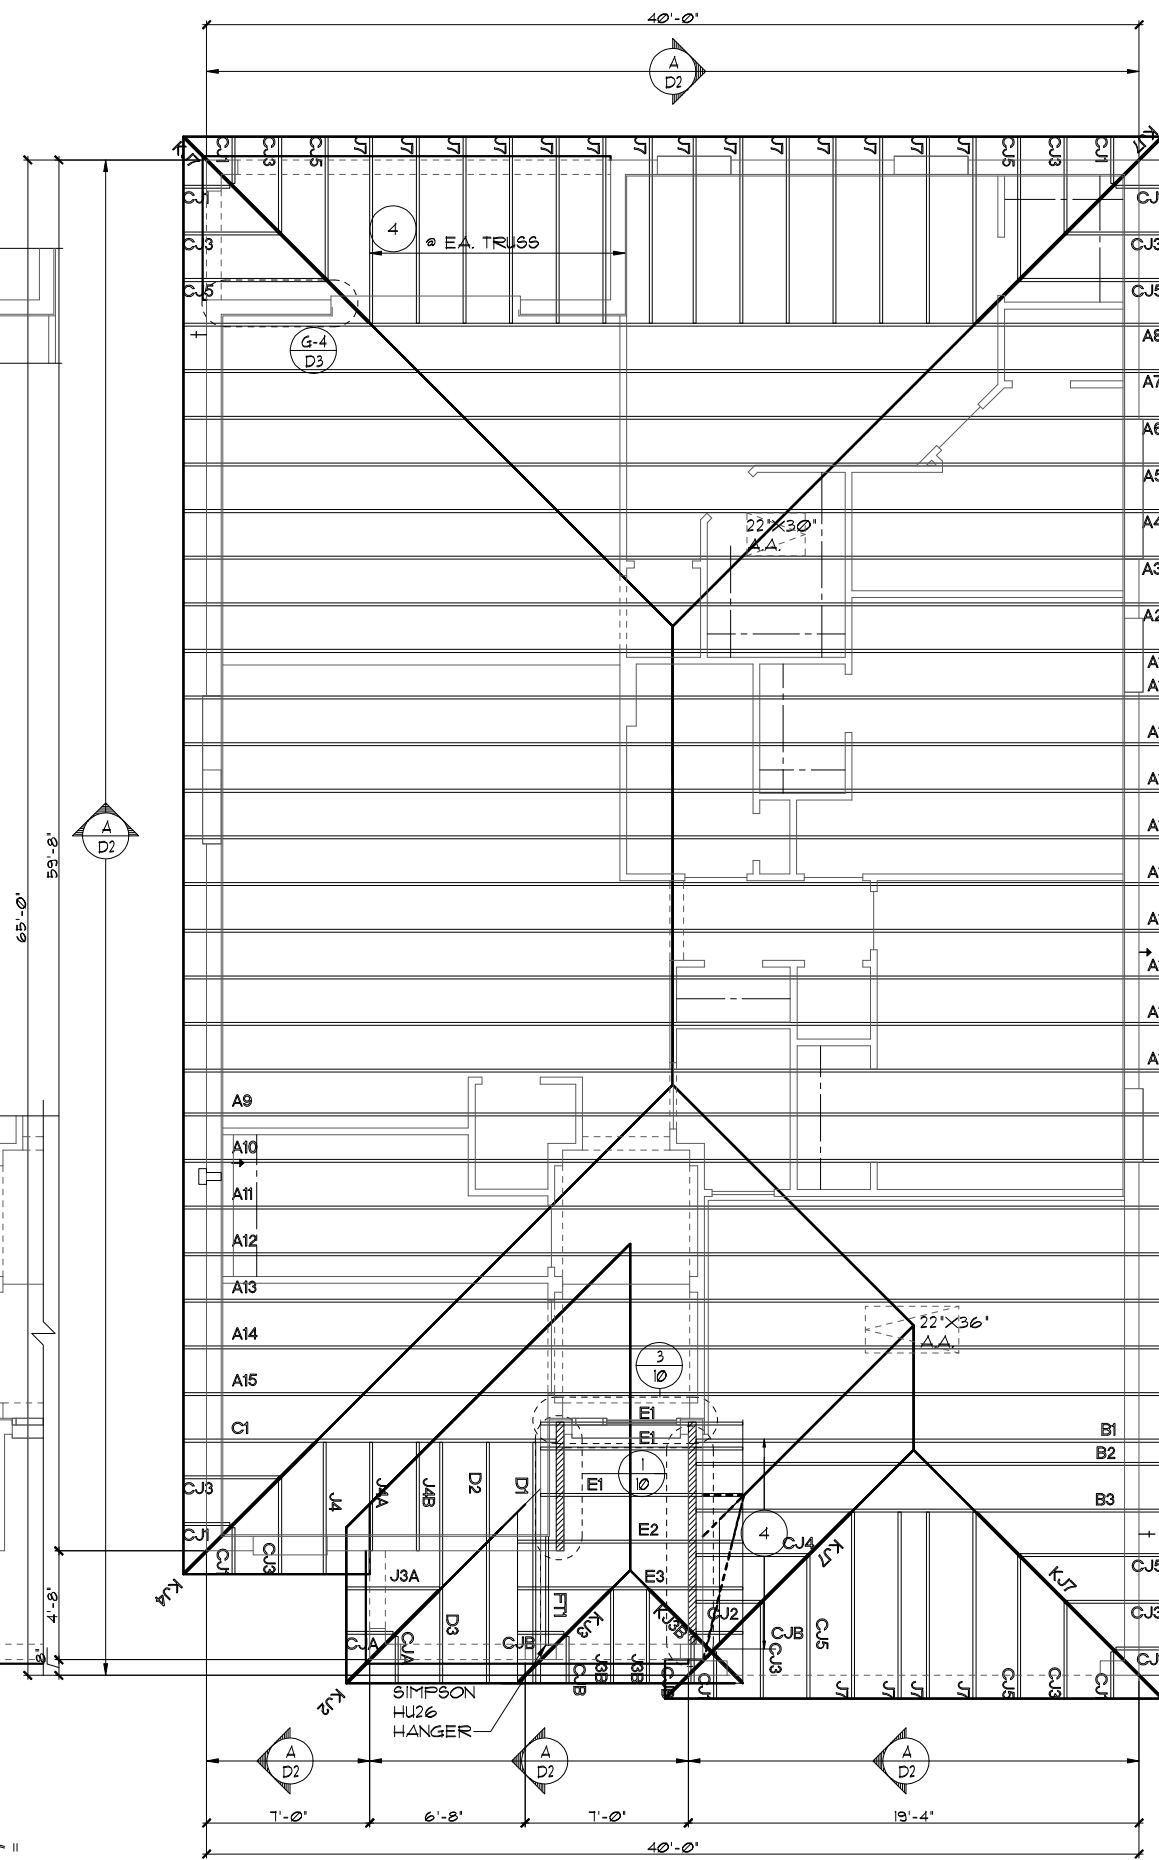

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL AND IS CERTIFIED AS SUCH

LOT: 000. COMMUNITY NAME:

FLORIDA SERIES

REVISIONS	BY
05-16-19	JF

**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 754-1700  
 www.iteg.com


**Park Square HOMES**  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 629-3000

TRUSS LAYOUT

1966

MARGATE II

DATE	04-05-2017
SCALE	AS NOTED
DRAWN	RDC
JOB	N/A
SHEET	
OF	08C SHEETS

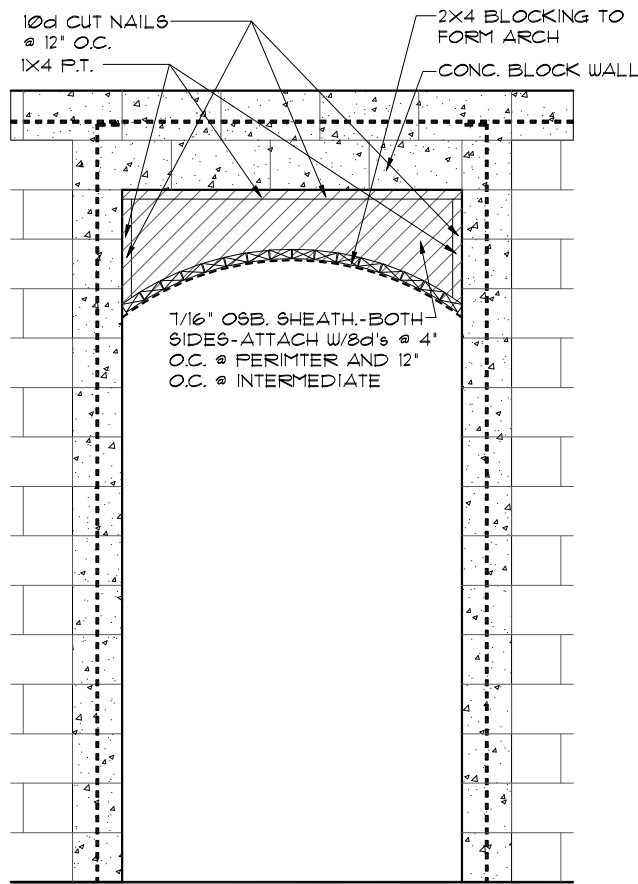

**4** **DETAIL**  
 8C 1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

- NOTES**
1. TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  2. TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
  4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCA BC61 I.
  6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 of Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
  8. OFF RIDGE VENTS MAXIMUM OPENING SIZES:
    - LOMANCO : (2) 9 1/4" DIA. CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1.1

**ATTIC VENTILATION CALCULATIONS**

PER FBC2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:


TOTAL VENTED SPACE:  $\frac{2,593SF.}{300} = 8.64SF.$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL: ----- 4.68SF.  
 PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78SF./VENT.  
 (VENT TYPE: LOMANCO MODEL TT0-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL: ----- 4.32SF.  
 PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
 ( 50 LF. @ 0.087SF. VENTING PER LF.)

UPPER PORTION PERCENTAGE: 50%  
 LOWER PORTION PERCENTAGE: 50%

**TRUSS LAYOUT "C"**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

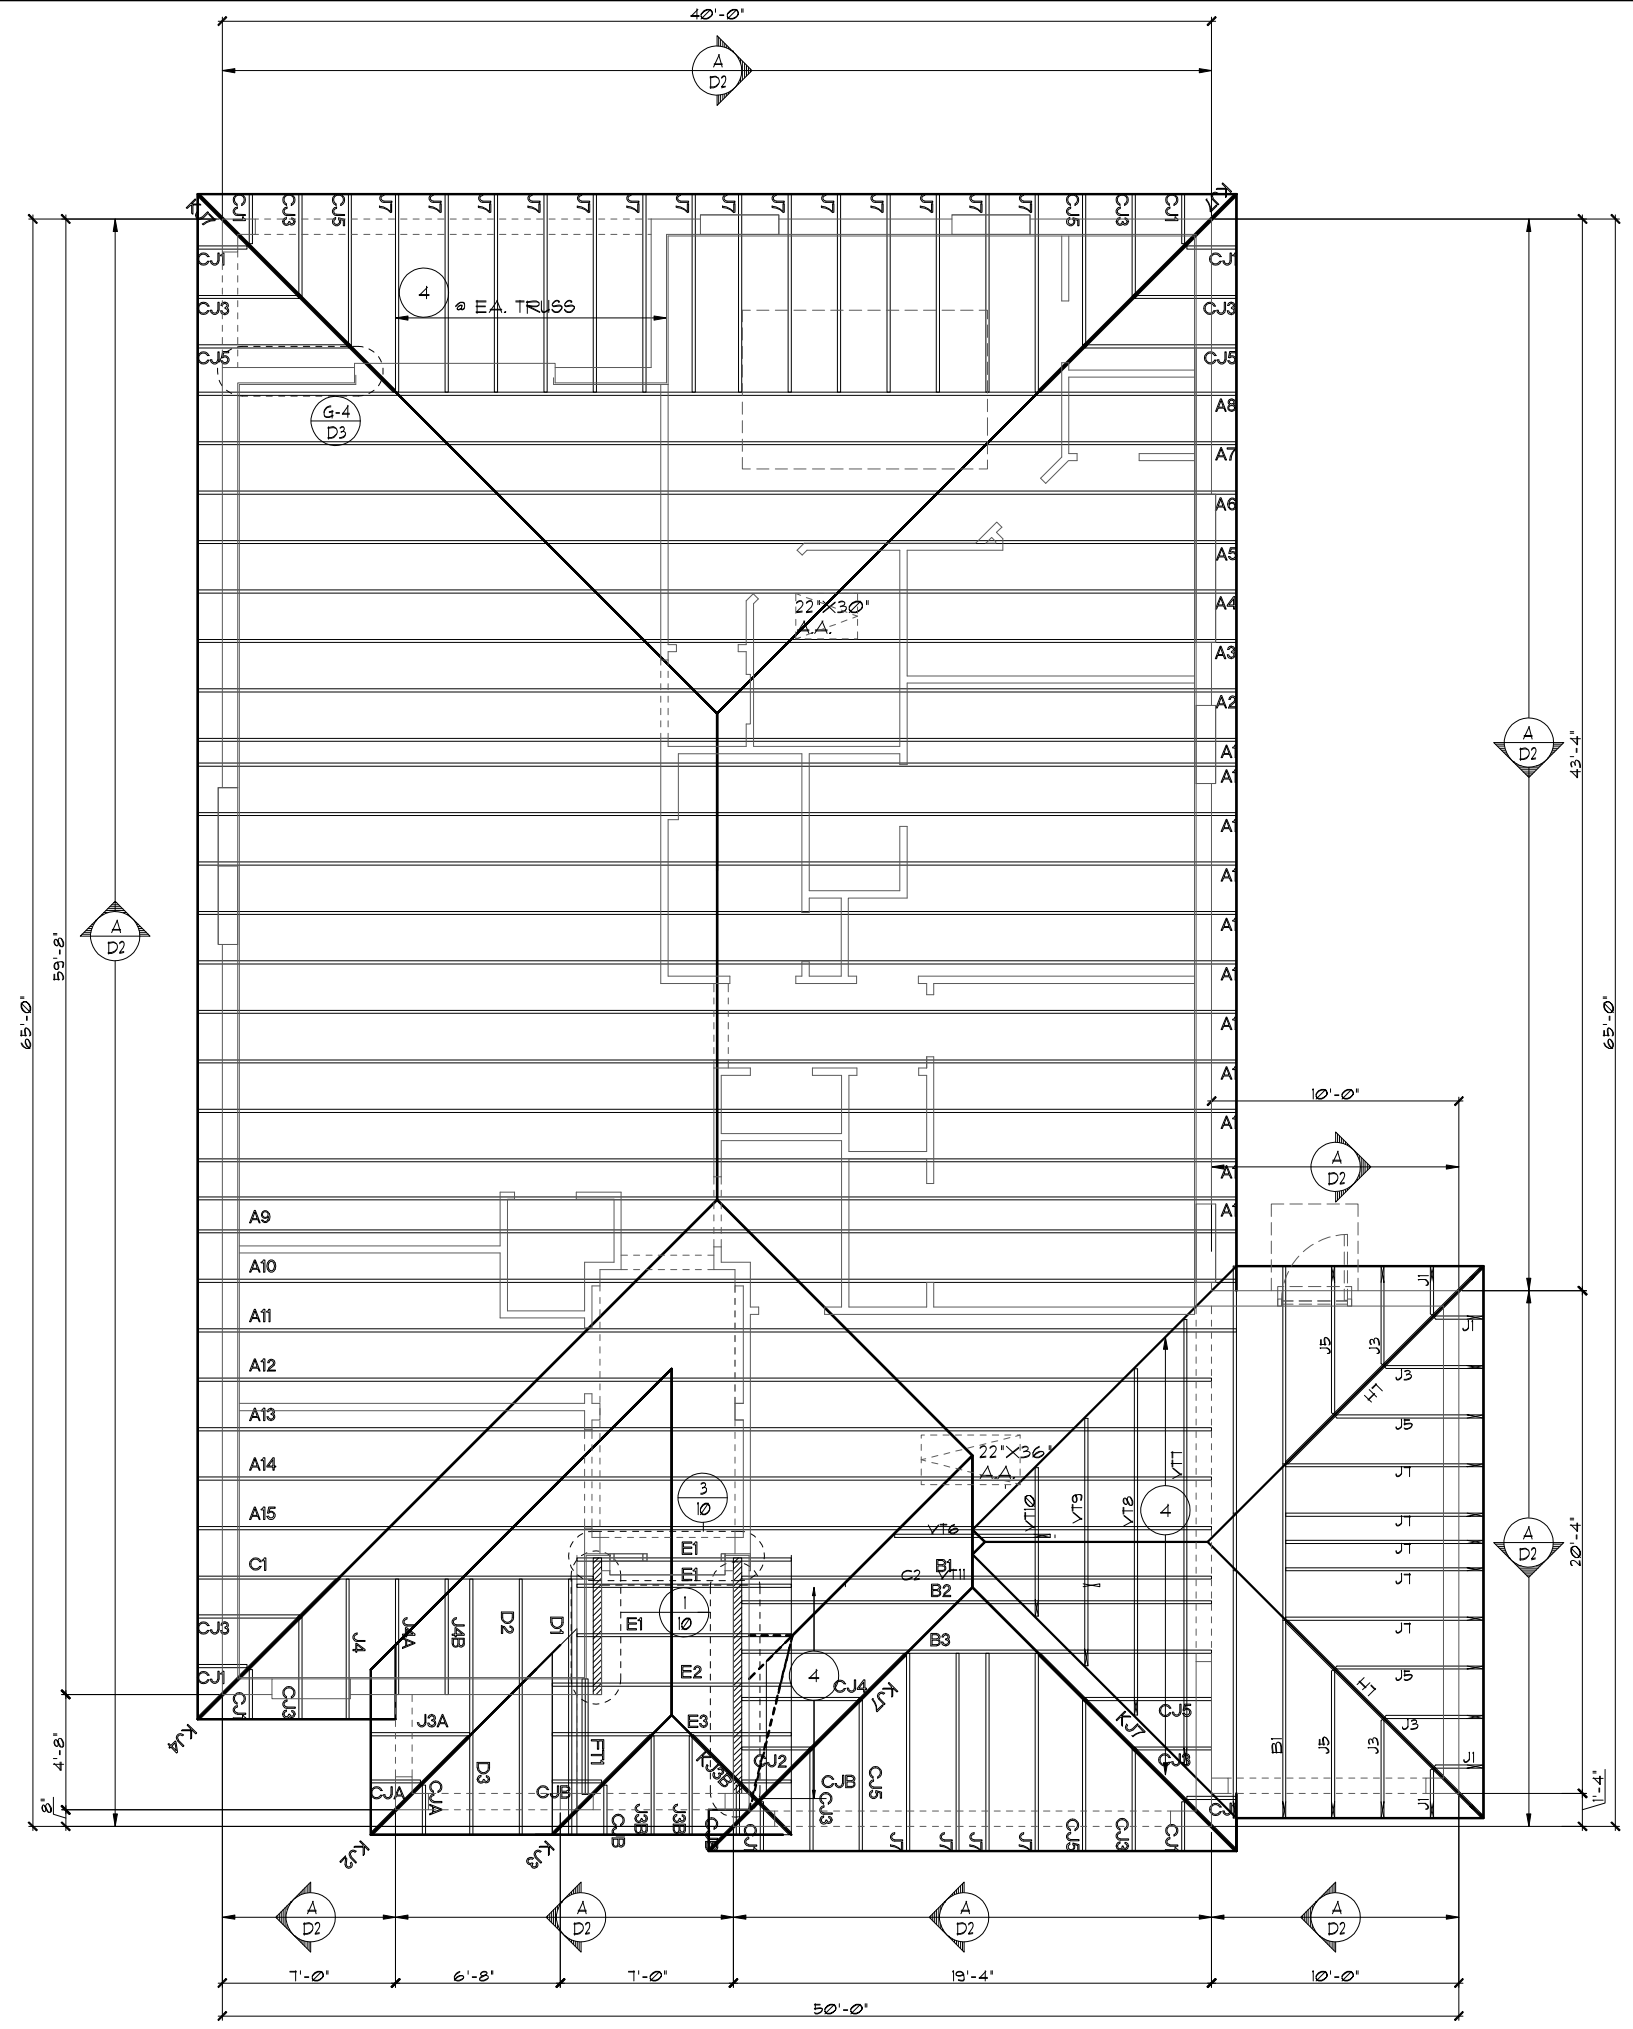

3-CAR GARAGE OPTION

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

1966

MARGATE II

FLORIDA SERIES

Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without the express written permission from Park Square Homes.

REVISIONS	BY
05-16-19	JF

**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 528-3000

**Park Square Homes**

A DIVISION OF PARK SQUARE ENTERPRISES, INC.

**TRUSS LAYOUT**

DATE 04-05-2017

SCALE AS NOTED


DRAWN RDC

JOB N/A

SHEET

08C.3

OF 00 SHEETS

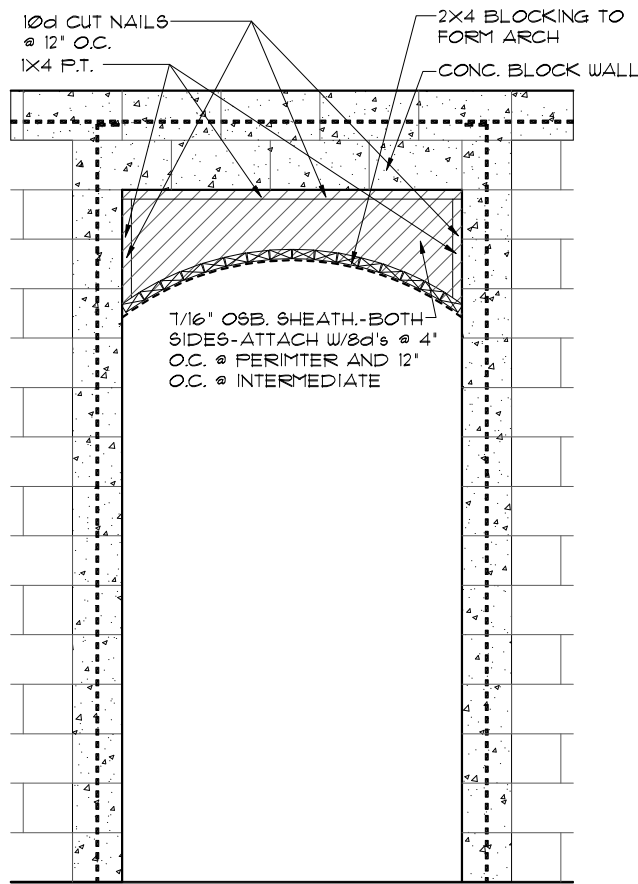

**4** **8C** **DETAIL**  
 1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC 2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:


TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = \frac{8,643\text{S.F.}}{\text{REQUIRED}}$  NET FREE VENT. REQUIRED

UPPER PORTION VENTILATION TOTAL:----- **4,688S.F.**  
 PROVIDED W/OFF RIDGE VENTS: **6** VENTS @ **.785S.F./VENT.**  
 (VENT TYPE: LOMANCO MODEL T10-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- **4,325S.F.**  
 PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
 ( **50** L.F. @ **0.0875S.F. VENTING PER L.F.**)

UPPER PORTION PERCENTAGE: **50%**  
 LOWER PORTION PERCENTAGE: **50%**

- NOTES**
1. TYPICAL ROOF GABLE OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
  2. TYPICAL ROOF EAVES OVERHANG TO BE **12"** UNLESS OTHERWISE NOTED.
  3. PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/ OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
  4. ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  5. TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTC A BC91 I.
  6. REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  7. SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
  8. OFF RIDGE VENTS MAXIMUM OPENING SIZES :
    - LOMANCO : (2) 9 1/4" DIA. CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  9. ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1.

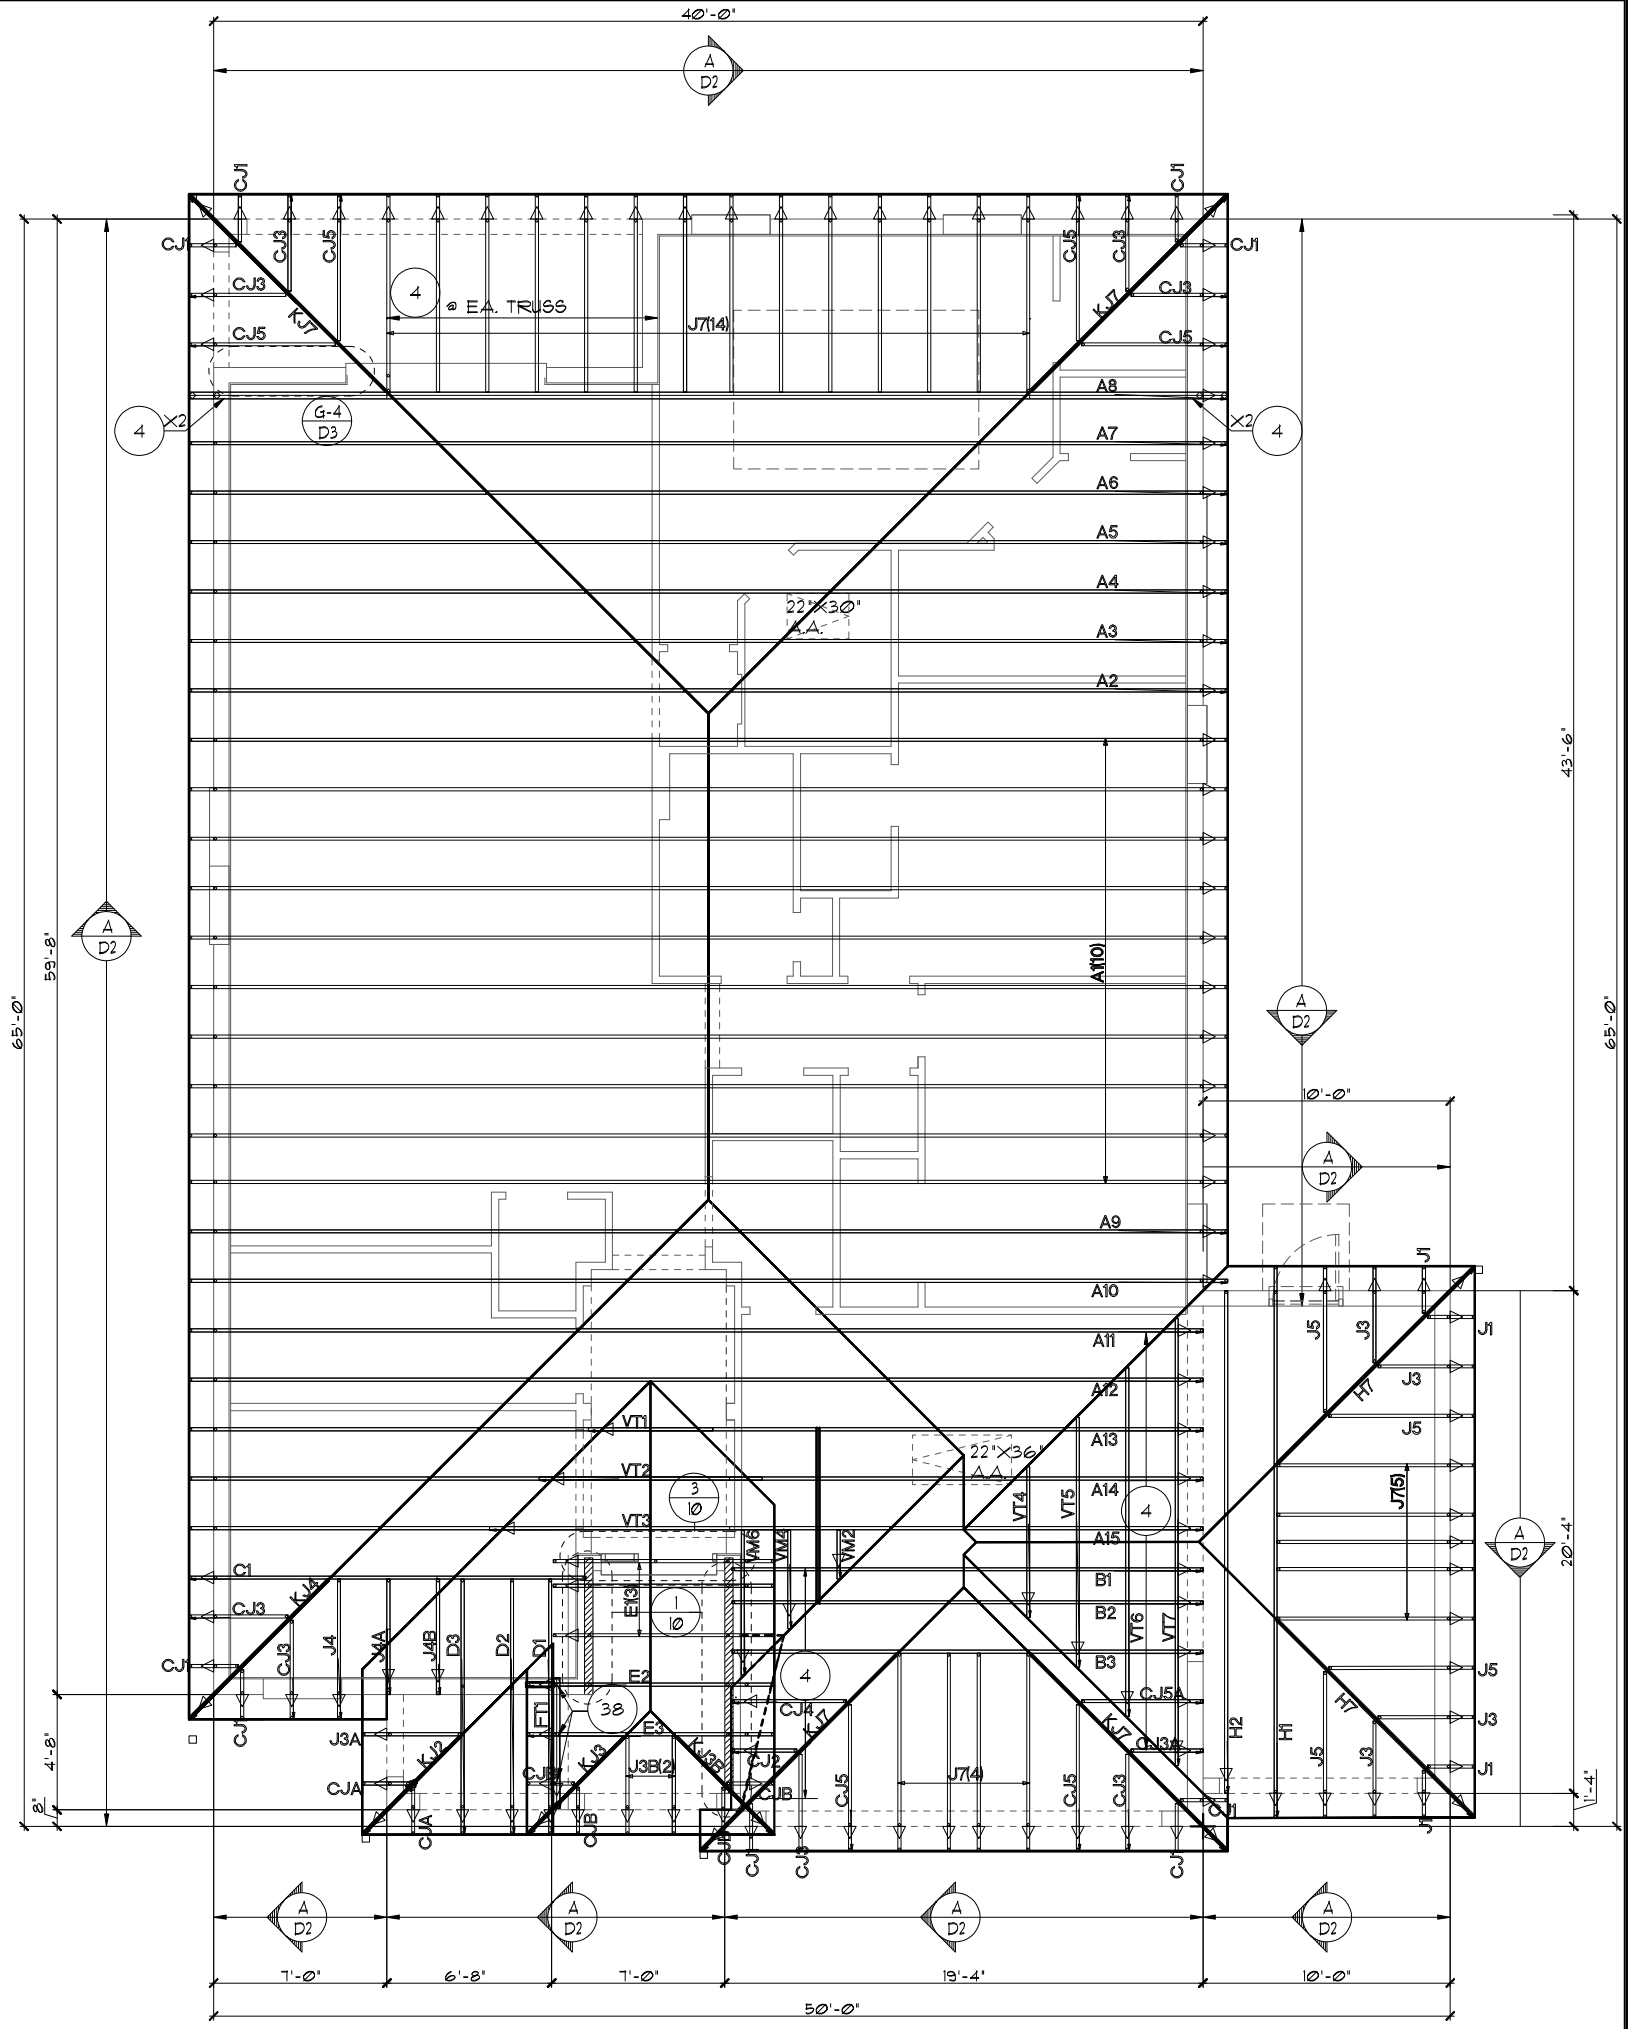

**TRUSS LAYOUT "C"**  
 1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)


THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
**LOT: 0000, COMMUNITY NAME**  
**FLORIDA SERIES**  
**1966**  
**MARGATE II**

REVISIONS	BY
05-16-19	JF

**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida 32811  
 Phone: (407) 794-1790  
 www.iteg.com

**Park Square HOMES**  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida 32811  
 Phone: (407) 528 - 3000

DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET  
 OF 00 SHEETS

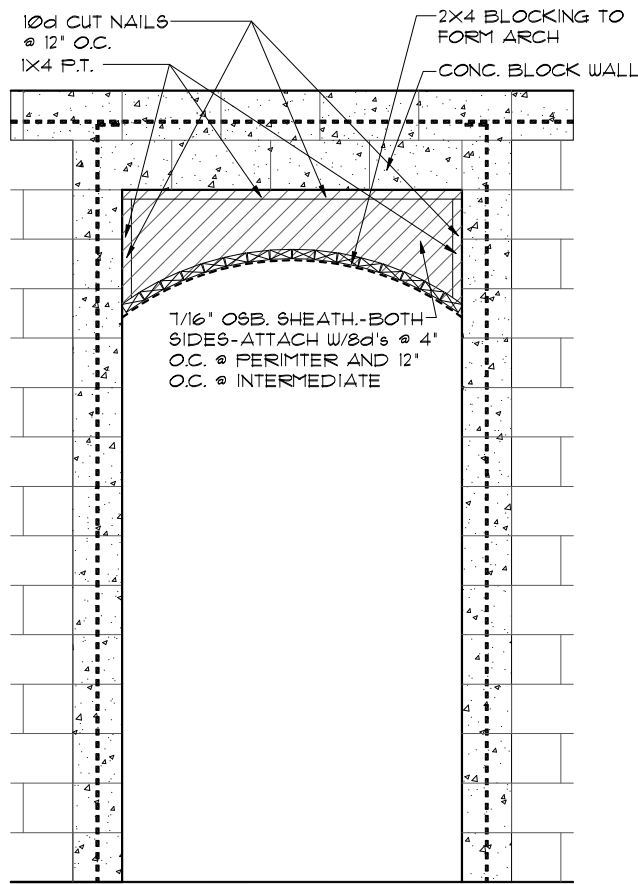

4  
8C  
DETAIL  
1/2"=1'-0" (11X17) 1"=1'-0" (22X34)

**ATTIC VENTILATION CALCULATIONS**

PER FBC 2023 8TH EDITION R306: MIN. 40% - MAX. 50% OF REQUIRED VENTILATION TO BE IN UPPER PORTION OF ATTIC SPACE AND THE BALANCE TO BE IN LOWER PORTION (EAVES).

THE MINIMUM NET VENTILATION AREA SHALL BE 1/300 OF VENTED SPACE:


TOTAL VENTED SPACE:  $\frac{2,593\text{S.F.}}{300} = 8.64\text{S.F.}$  NET FREE VENT. REQUIRED


UPPER PORTION VENTILATION TOTAL:----- 4.68S.F.  
 PROVIDED W/OFF RIDGE VENTS: 6 VENTS @ .78S.F. /VENT.  
 (VENT TYPE: LOMANCO MODEL T10-D OR MILLENNIUM METAL)

LOWER PORTION VENTILATION TOTAL:----- 4.32S.F.  
 PROVIDED W/ VENTILATED SOFFITS @ EAVE:--  
 (.50 L.F. @ 0.087S.F. VENTING PER L.F.)

UPPER PORTION PERCENTAGE: 50%  
 LOWER PORTION PERCENTAGE: 50%



- NOTES**
- TYPICAL ROOF GABLE OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  - TYPICAL ROOF EAVES OVERHANG TO BE 12" UNLESS OTHERWISE NOTED.
  - PROVIDE AND INSTALL FLASHING AND ROOFING AS PER NATIONAL ROOFING AND SHEET METAL ASSOC. STANDARDS AND/OR ACCEPTABLE INDUSTRY PRACTICE AND IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA RESIDENTIAL CODE.
  - ALL ROOF TRUSSES, GIRDERS, BEAMS, HEADERS, ETC. TO BE SIZED BY TRUSS MANUFACTURER OR FL. REG. ENG.
  - TRUSSES SHALL BE BRACED TO PREVENT ROTATION & PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR BUILDING & ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TPI/WTCB BC91.1.
  - REFER TO TRUSS MANUFACTURER'S DRAWINGS FOR TRUSS PLACEMENT & TRUSS TO TRUSS CONNECTIONS.
  - SHINGLE ROOF: UNDERLAYMENT TO BE INSTALLED IAW FBCR 2023, 8TH EDITION R305.1.1 - Underlayment materials required to comply with ASTM D226, D4869 or Type IV shall bear a label indicating compliance to the standard designation and, if applicable, type classification indicated in Table R305.1.1. Underlayment shall be applied and attached in accordance with Table R305.1.1.
  - OFF RIDGE VENTS MAXIMUM OPENING SIZES:
    - LOMANCO : (2) 3 1/4" DIA. CIRCLES
    - MILLENNIUM METAL : 2 1/2" X 46" HOLE
  - ROOF UNDERLAYMENT TO BE USED IS 2 LAYERS OF 30 LBS. SYNTHETIC FELT OR ANY OTHER METHOD LISTED PER FBC R305.1.1.

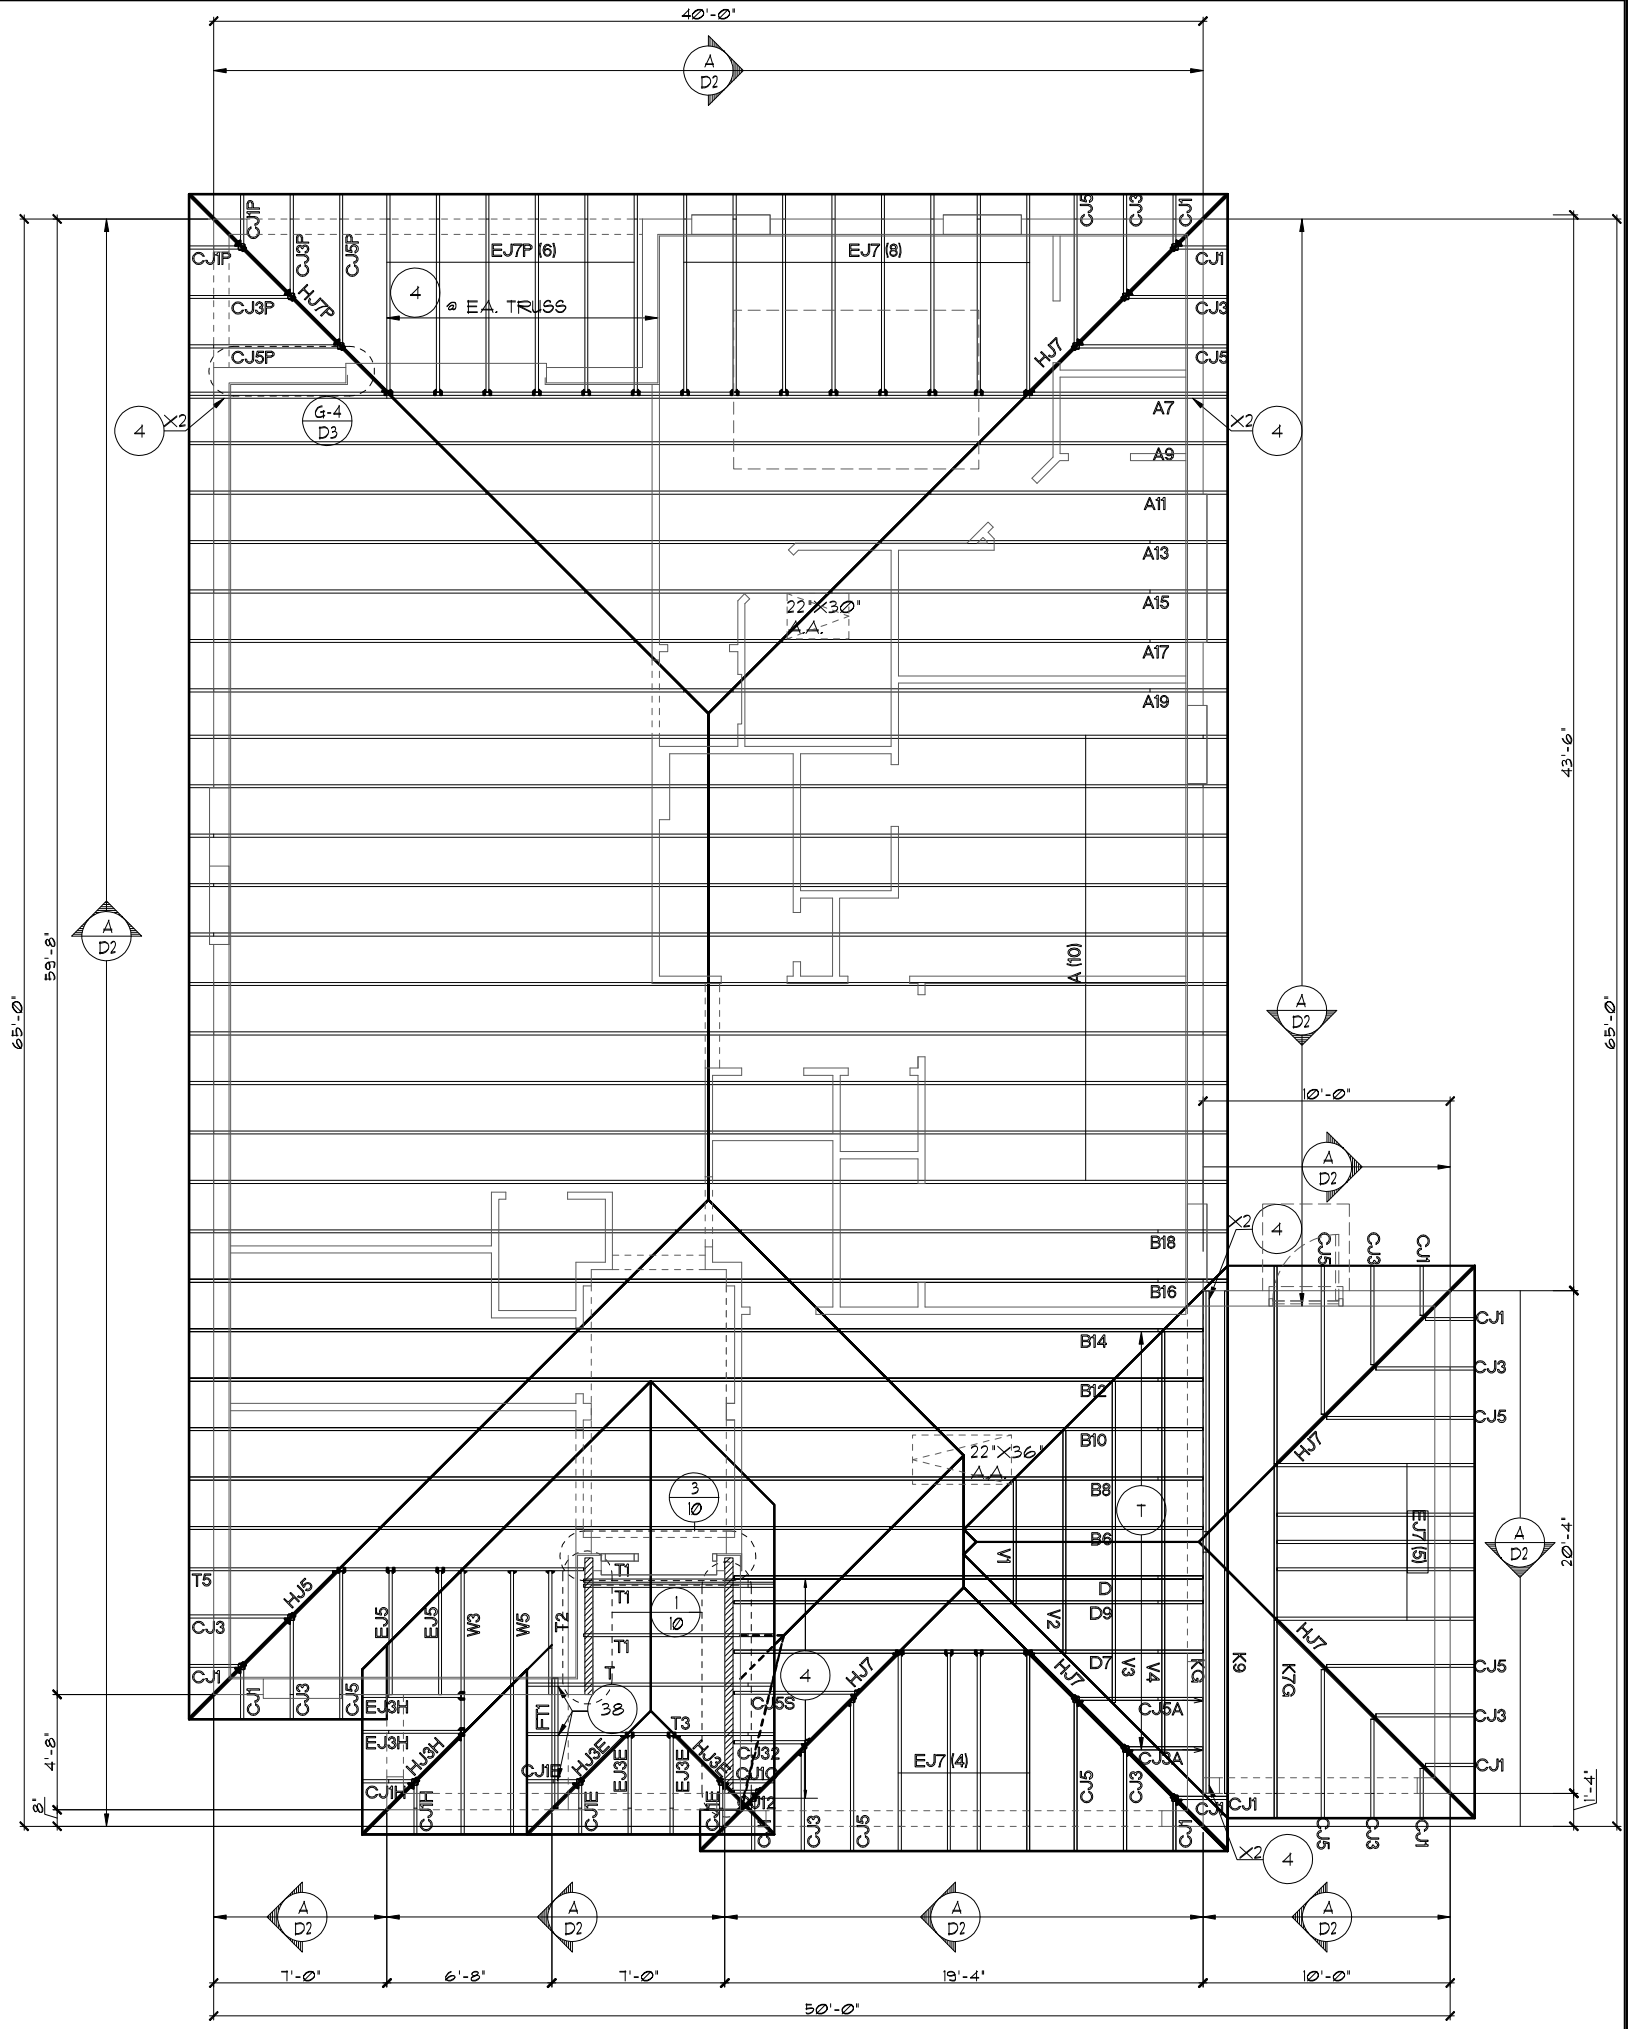

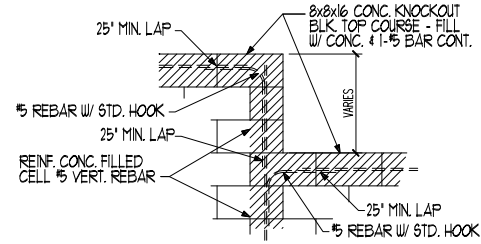


**BLOCK WALL HT. TRANSITION DETAIL**


CAST CRETE LINTEL SCHEDULE			
LINTEL NO.	LENGTH	TYPE	COMMENTS
L 1	17'-4"	8F32-1B/IT	GARAGE DOOR
L 2	4'-6"	8F16-0B/IT	S425
L 3	4'-6"	8F16-0B/IT	S425
L 4	7'-6"	8F12-0B/IT	6/0X1/0 F.G.
L 5	4'-6"	8F16-0B/IT	S425
L 6	4'-6"	8F16-0B/IT	S425
L 7	17'-4"	8F16-1B/IT	REAR LANAI
L 8	5'-10"	8F16-0B/IT	REAR LANAI
L 9	9'-4"	8F16-0B/IT	8/0X8/0 S.G.D.
L 10	7'-6"	8F16-0B/IT	FR S425
L 11	4'-6"	8F16-0B/IT	S425
L 12	4'-6"	8F16-0B/IT	S425
L 13	5'-10"	8RF12-0B/IT	FRONT DOOR
L 14	5'-4"	8F48-0B/IT	FRONT ENTRY
L 15	6'-6"	8F48-0B/IT	FRONT ENTRY
L 16	6'-6"	8F48-0B/IT	FRONT ENTRY
L 17			
L 18			
L 19			
L 20	5'-4"	8F16-0B/IT	4040 OPT MASTER BATH
L 21	9'-4"	8F32-1B/IT	GARAGE DOOR
L 22	16'-0"	8F16-1B/IT	GARAGE
L 23	13'-4"	8F16-0B/IT	12/0X8/0 S.G.D.
L 24			
L 25			
L 26	4'-6"	8RF16-0B/IT	OPT. GAR. SERVICE DOOR
L 27	4'-6"	8RF16-0B/IT	OPT. GAR. SERVICE DOOR
L 28			
L 29			
L 30			
L 31			
L 32			
L 33			
L 34			
L 35			
L 36			
L 37			
L 38			
L 39			

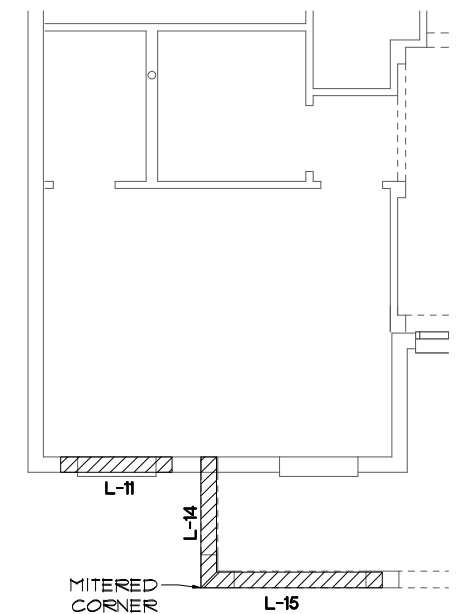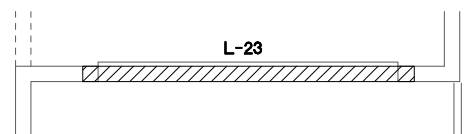


**BEDROOM 4 OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

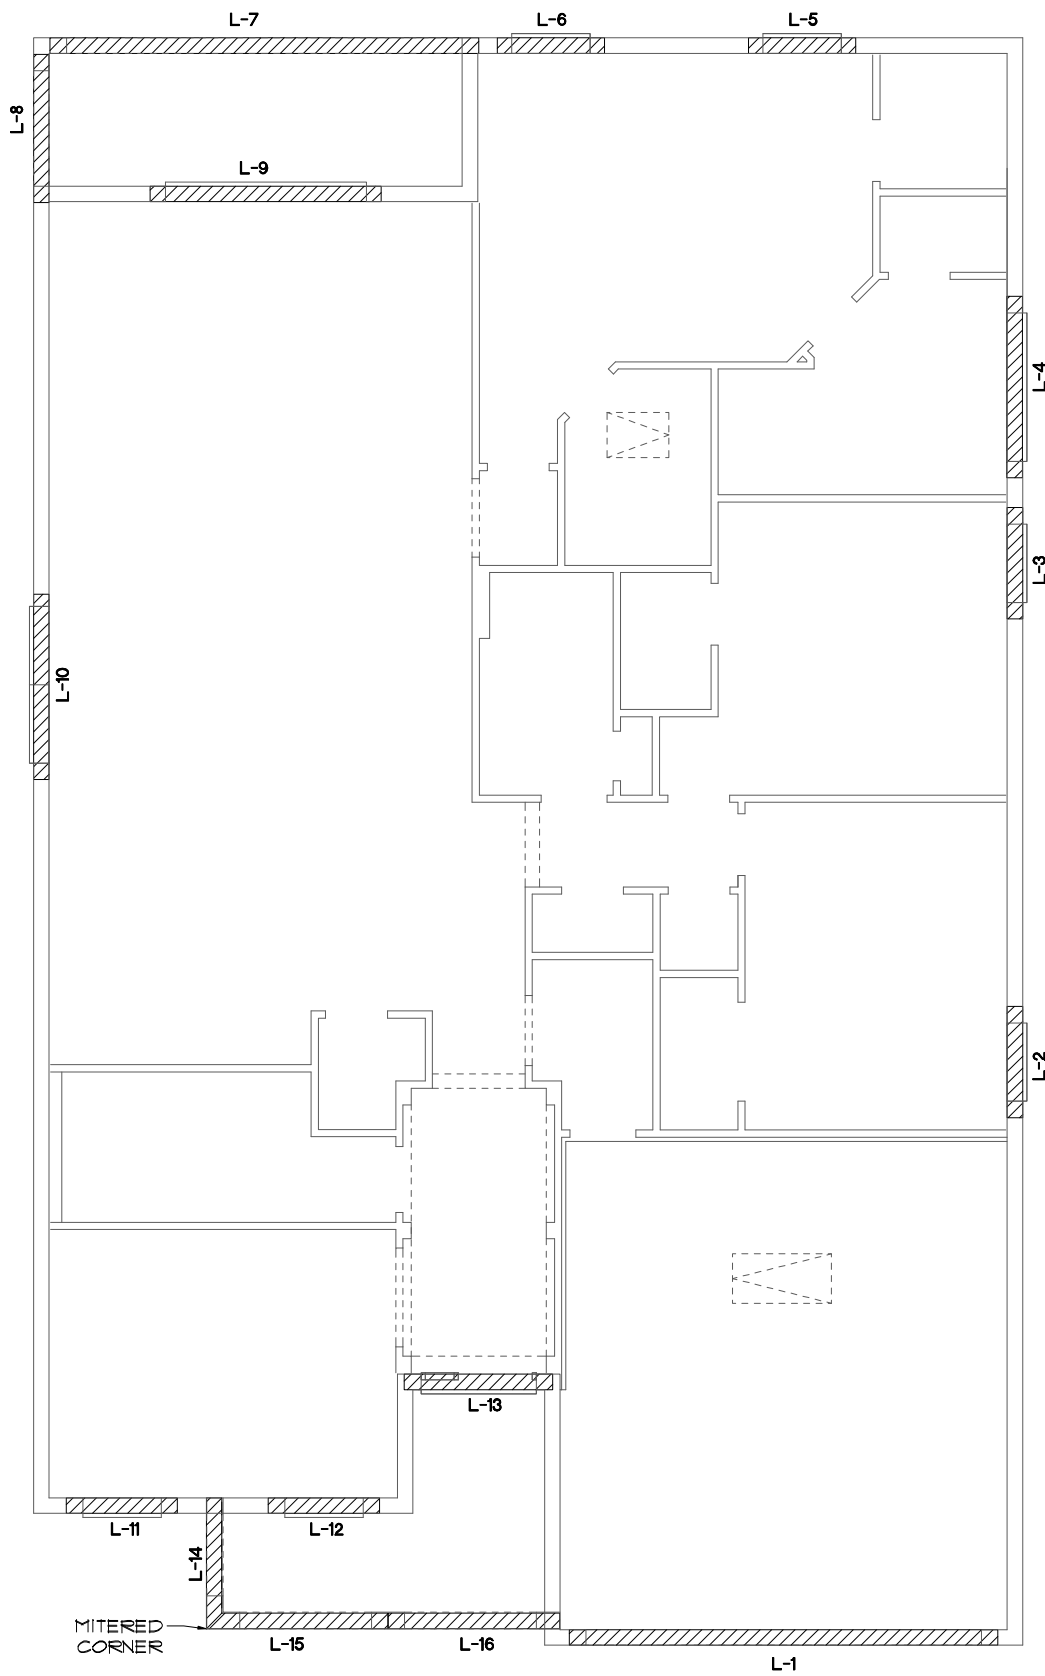

**PRE CAST LINTEL LAYOUT A & "B"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

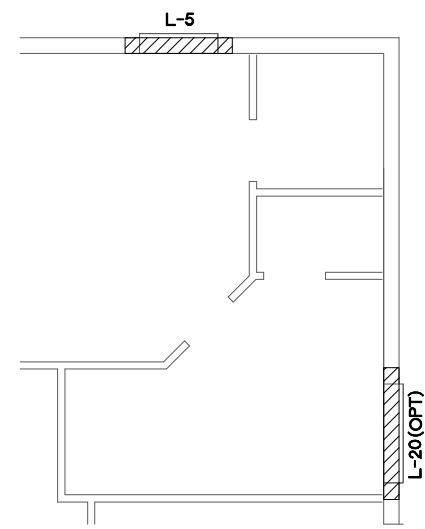

**M. B.A. OPTION**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

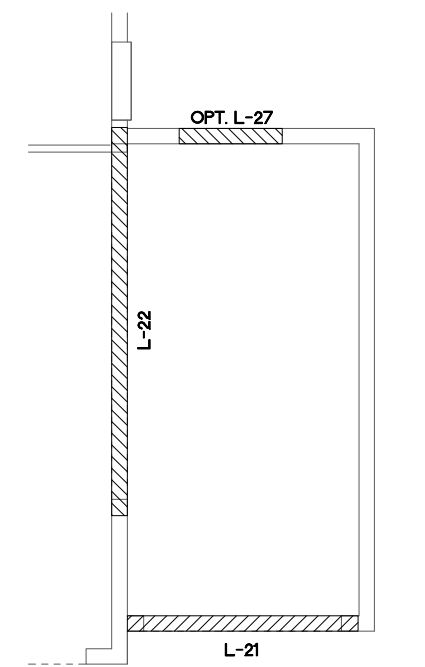

**3-CAR GAR. OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

**FLORIDA SERIES**

LOT: 0000, COMMUNITY NAME

© COPYRIGHT 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and designs are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS	BY
05-16-19	JF

**ITEG**  
THOMPSON ENGINEERING GROUP, INC.  
10000 W. Colonial Blvd., Suite 200  
Orlando, Florida 32811  
Tel: (407) 734-1400  
Fax: (407) 734-1700  
www.iteg.com


A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida 32811  
Phone: (407) 529-3000

**Park Square HOMES**



**PRE CAST LINTEL LAYOUT**

1966  
MARGATE II

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET  
**09AB**  
OF 00 SHEETS

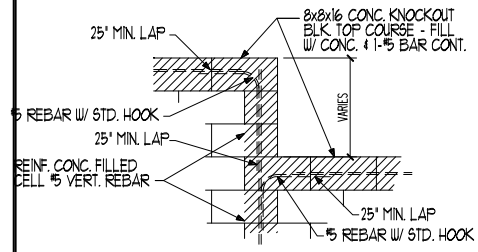



**BLOCK WALL HT. TRANSITION DETAIL**

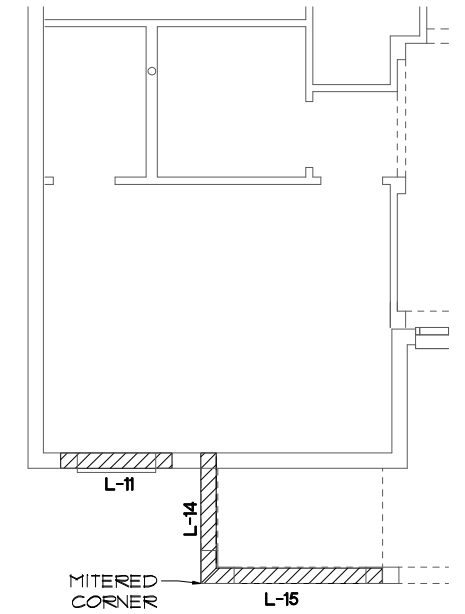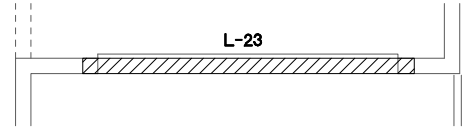


**BEDROOM 4 OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**PRE CAST LINTEL LAYOUT "C"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

CAST CRETE LINTEL SCHEDULE			
LINTEL NO.	LENGTH	TYPE	COMMENTS
L 1	17'-4"	8F32-1B/IT	GARAGE DOOR
L 2	4'-6"	8F16-0B/IT	SH25
L 3	4'-6"	8F16-0B/IT	SH25
L 4	7'-6"	8F12-0B/IT	6/0X1/0 F.G.
L 5	4'-6"	8F16-0B/IT	SH25
L 6	4'-6"	8F16-0B/IT	SH25
L 7	17'-4"	8F16-1B/IT	REAR LANAI
L 8	5'-10"	8F16-0B/IT	REAR LANAI
L 9	9'-4"	8F16-0B/IT	8/0X8/0 S.G.D.
L 10	7'-6"	8F16-0B/IT	FR SH25
L 11	4'-6"	8F16-0B/IT	SH25
L 12			
L 13	5'-10"	8RF12-0B/IT	FRONT DOOR
L 14	5'-4"	8F16-0B/IT	FRONT ENTRY
L 15	6'-6"	8F16-0B/IT	FRONT ENTRY
L 16	6'-6"	8F56-0B/IT	FRONT ENTRY
L 17			
L 18			
L 19			
L 20	5'-4"	8F16-0B/IT	4040 OPT MASTER BATH
L 21	9'-4"	8F32-1B/IT	GARAGE DOOR
L 22	16'-0"	8F16-1B/IT	GARAGE
L 23	13'-4"	8F16-0B/IT	12/0X8/0 S.G.D.
L 24			
L 25			
L 26	4'-6"	8RF16-0B/IT	OPT. GAR. SERVICE DOOR
L 27	4'-6"	8RF16-0B/IT	OPT. GAR. SERVICE DOOR
L 28			
L 29			
L 30			
L 31			
L 32			
L 33			
L 34			
L 35			
L 36			
L 37			
L 38			
L 39			

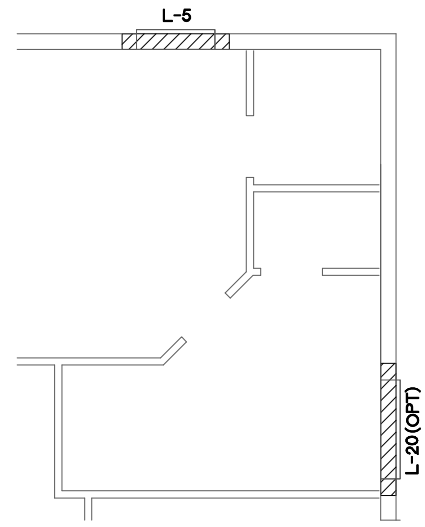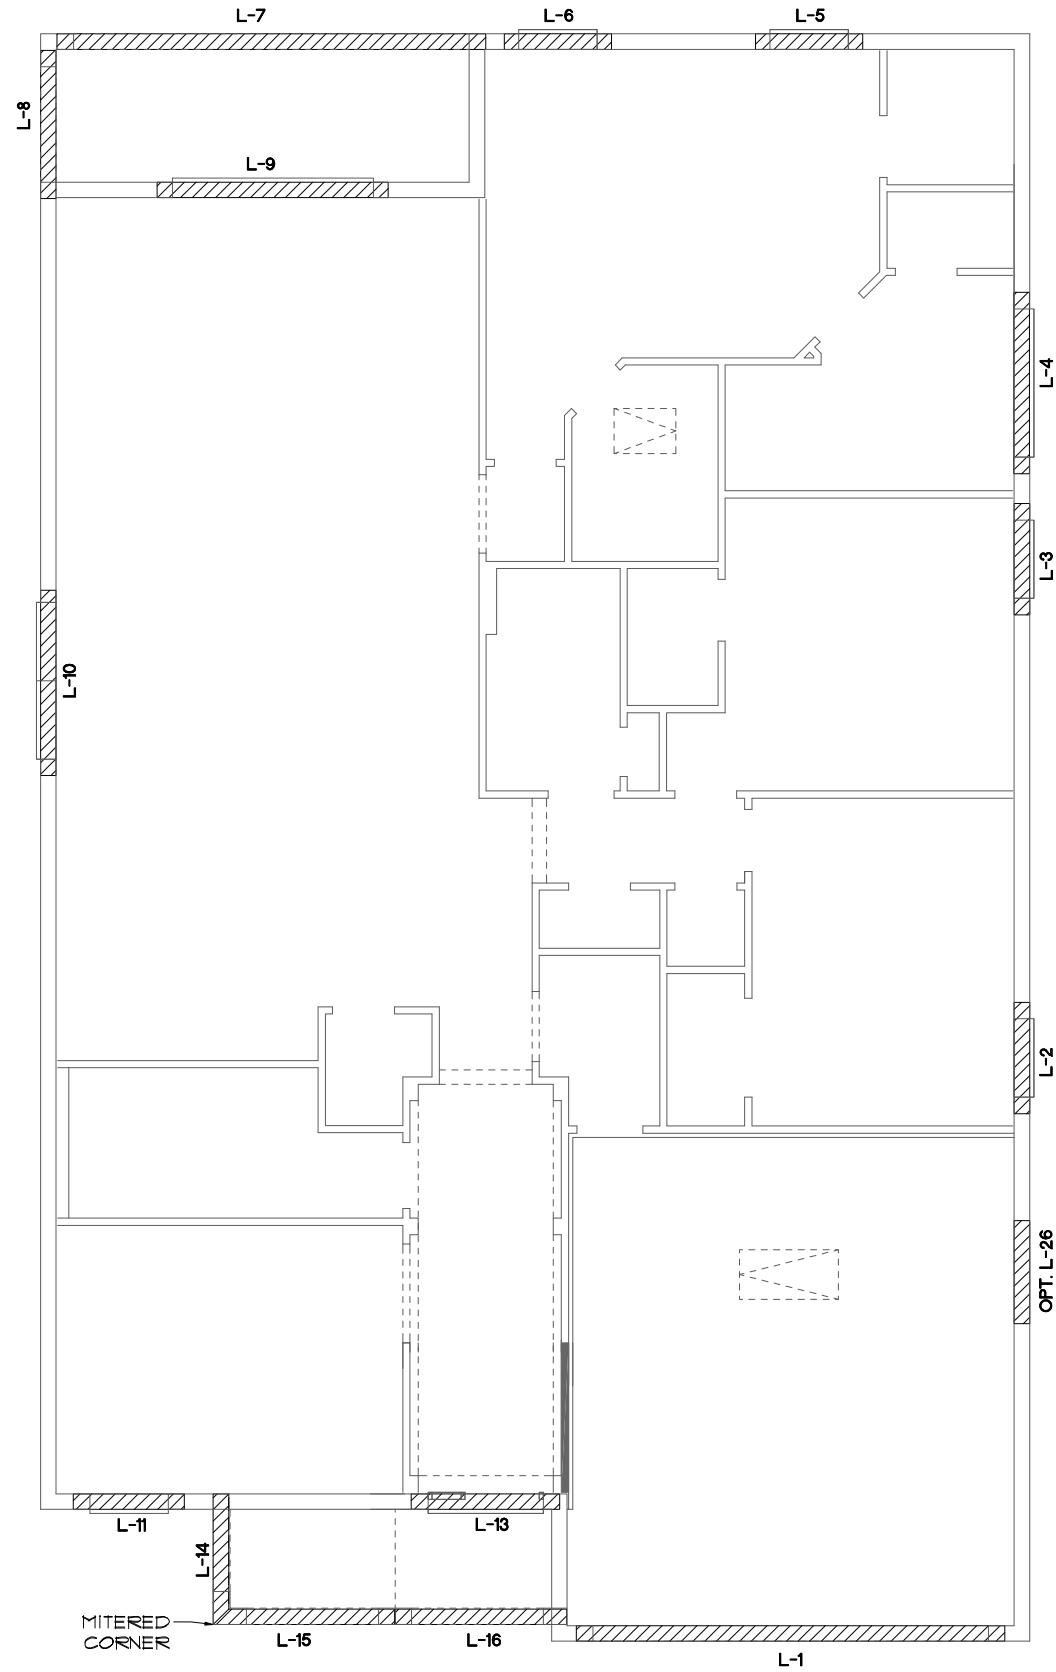

**M. B.A. OPTION**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

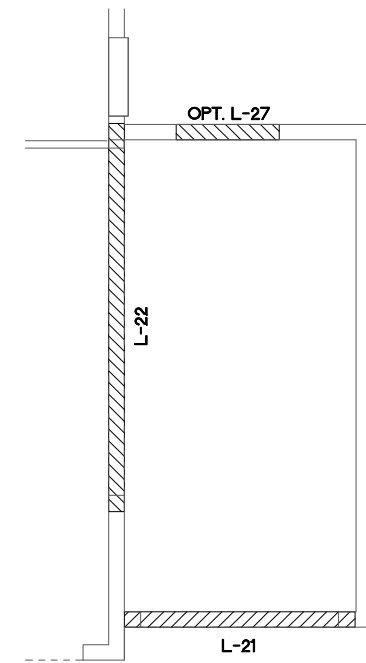

**3-CAR GAR. OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

LOT: 0000, COMMUNITY NAME

FLORIDA SERIES

© COPYRIGHT 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and design are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS	BY
05-16-19	JF


**ITEG**  
 THOMPSON ENGINEERING GROUP, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Tel: (407) 734-1400  
 Fax: (407) 734-1700  
 www.iteg.com

A DIVISION OF PARK SQUARE  
 ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529 - 3000

**Park Square HOMES**  
 PRE CAST LINTEL LAYOUT  
 EXTENDED FOYER



1966  
 MARGATE II

DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET  
 OF 00 SHEETS

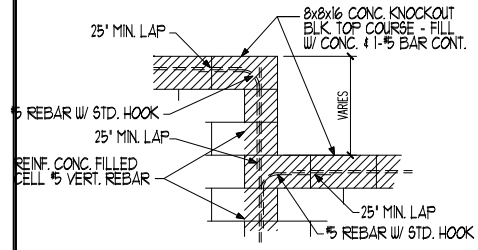



**BLOCK WALL HT. TRANSITION DETAIL**

CAST CRETE LINTEL SCHEDULE			
LINTEL NO.	LENGTH	TYPE	COMMENTS
L 1	11'-4"	8F32-1B/IT	GARAGE DOOR
L 2	4'-6"	8F16-0B/IT	SH25
L 3	4'-6"	8F16-0B/IT	SH25
L 4	7'-6"	8F12-0B/IT	6/0X1/0 F.G.
L 5	4'-6"	8F16-0B/IT	SH25
L 6	4'-6"	8F16-0B/IT	SH25
L 7	11'-4"	8F16-1B/IT	REAR LANAI
L 8	5'-10"	8F16-0B/IT	REAR LANAI
L 9	9'-4"	8F16-0B/IT	8/0X8/0 S.G.D.
L 10	7'-6"	8F16-0B/IT	FR SH25
L 11	4'-6"	8F16-0B/IT	SH25
L 12			
L 13	5'-10"	8RF12-0B/IT	FRONT DOOR
L 14	5'-4"	8F16-0B/IT	FRONT ENTRY
L 15	6'-6"	8F16-0B/IT	FRONT ENTRY
L 16	6'-6"	8F56-0B/IT	FRONT ENTRY
L 17			
L 18			
L 19			
L 20	5'-4"	8F16-0B/IT	4040 OPT MASTER BATH
L 21	9'-4"	8F32-1B/IT	GARAGE DOOR
L 22	16'-0"	8F16-1B/IT	GARAGE
L 23	13'-4"	8F16-0B/IT	12/0X8/0 S.G.D.
L 24			
L 25			
L 26	4'-6"	8RF16-0B/IT	OPT. GAR. SERVICE DOOR
L 27	4'-6"	8RF16-0B/IT	OPT. GAR. SERVICE DOOR
L 28			
L 29			
L 30			
L 31			
L 32			
L 33			
L 34			
L 35			
L 36			
L 37			
L 38			
L 39			

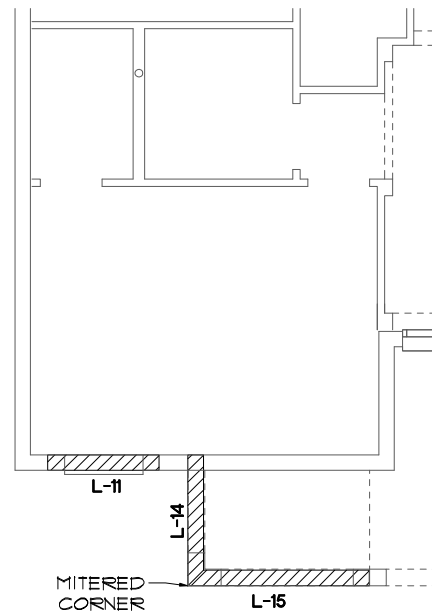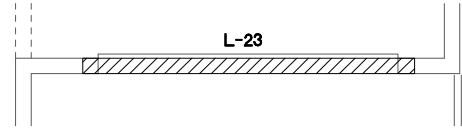


**BEDROOM 4 OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

**PRE CAST LINTEL LAYOUT "C"**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

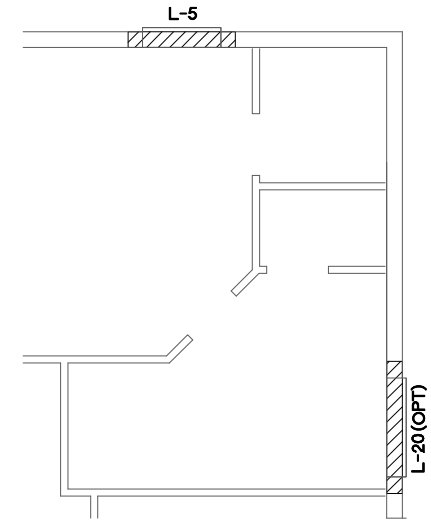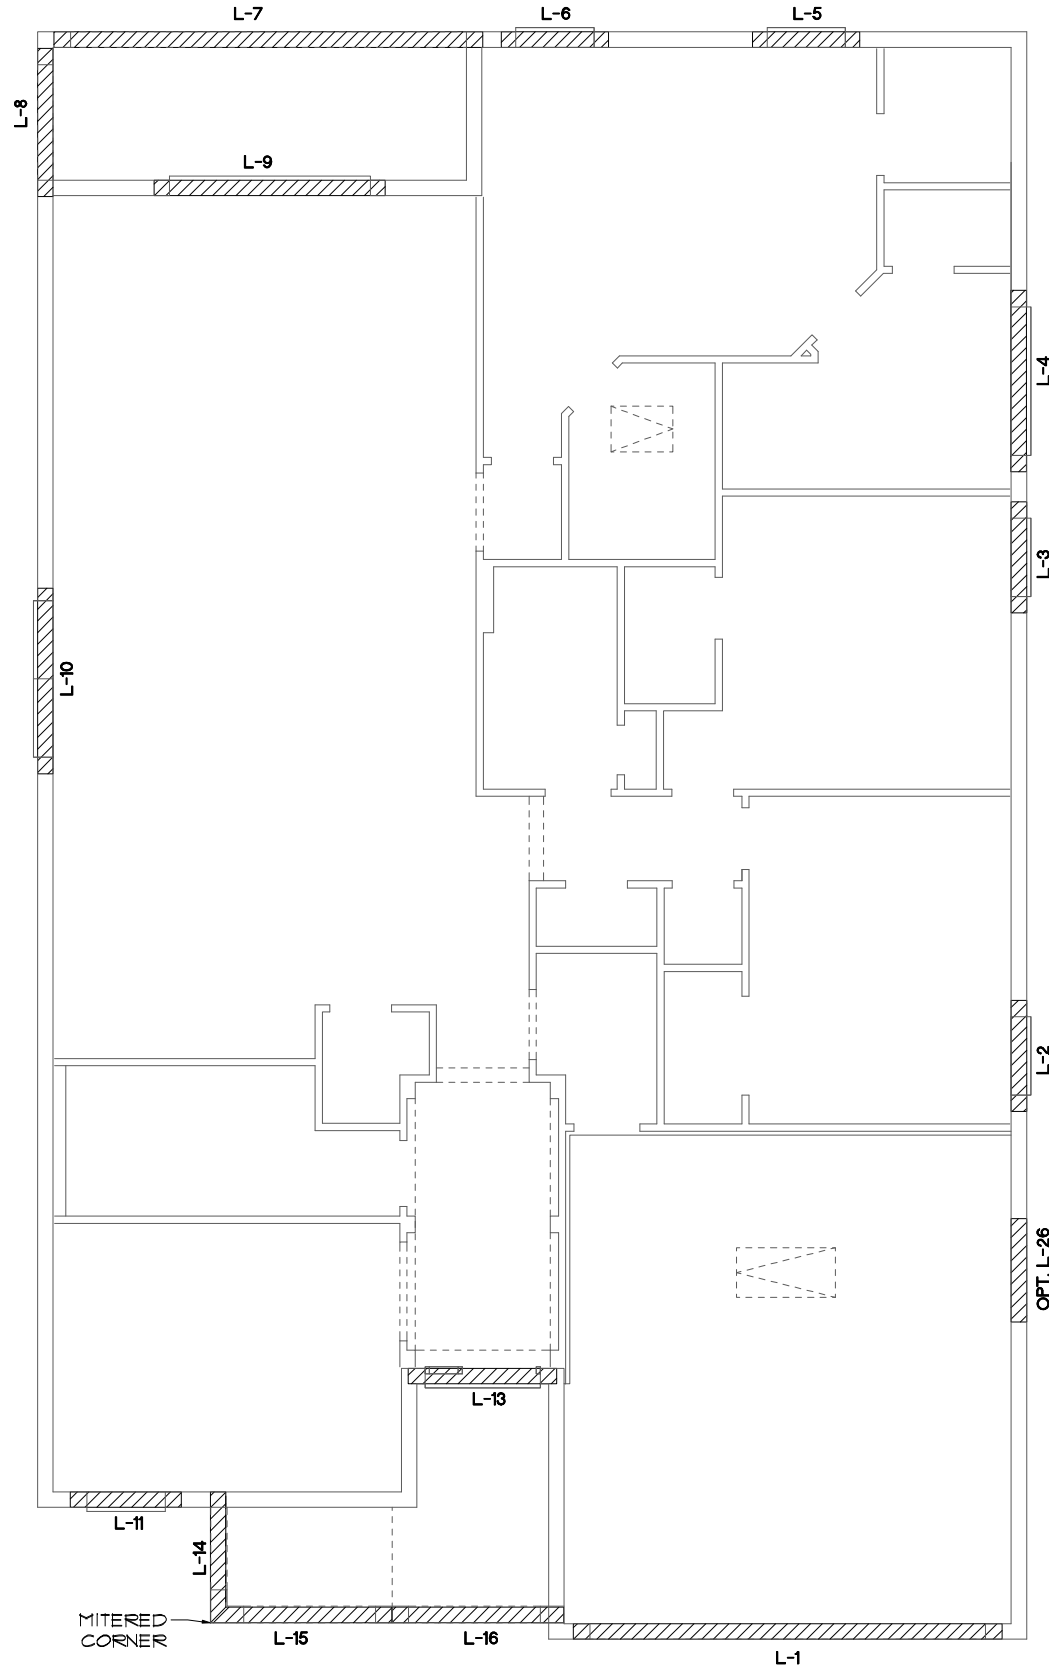

**M. B.A. OPTION**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

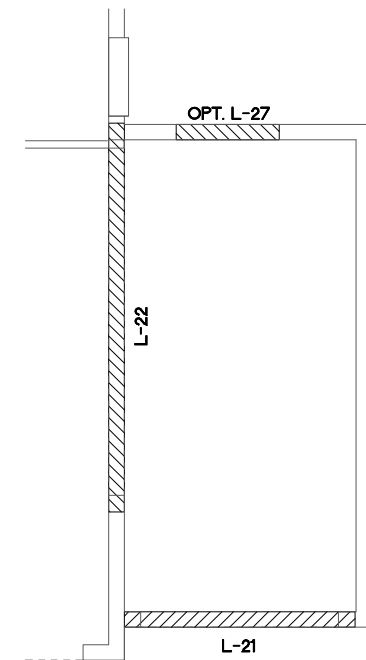

**3-CAR GAR. OPT.**  
1/8"=1'-0" (11X17) 1/4"=1'-0" (22X34)

THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8th EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH

FLORIDA SERIES

LOT: 0000, COMMUNITY NAME

© COPYRIGHT 2012 Park Square Homes hereby reserves its common law copyrights and other copyrights in these plans, ideas, and design. These plans, ideas, and design are not to be copied or changed in any manner or form whatsoever, nor are they to be assigned to any third party without first obtaining the express written permission from Park Square Homes.

REVISIONS	BY
05-16-19	JF

**ITEG**  
THOMPSON ENGINEERING GROUP, INC.  
10000 W. Colonial Ave., Suite 200  
Orlando, Florida 32811  
Tel: (407) 734-1400  
Fax: (407) 734-1790  
www.iteg.com

A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
5200 Vineland Road, Suite 200  
Orlando, Florida 32811  
Phone: (407) 529 - 3000

**Park Square HOMES**

PRE CAST LINTEL LAYOUT

1966  
MARGATE II

DATE 04-05-2017  
SCALE AS NOTED  
DRAWN RDC  
JOB N/A  
SHEET  
09C  
OF 00 SHEETS

# SAFE LOAD TABLES FOR GRAVITY, UPLIFT & LATERAL LOADS

## 8' PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	GRAVITY											
		8F8-0B	8F10-0B	8F12-0B	8F14-0B	8F16-0B	8F18-0B	8F20-0B	8F22-0B	8F24-0B	8F26-0B	8F28-0B	8F30-0B
2'-10" (34") PRECAST	2302	316e	447b	603b	752e	900d	1047d	1193e					
		316e	447b	603b	752e	900d	1047d	1193e					
3'-6" (42") PRECAST	2302	316e	447b	603b	752e	900d	1047d	1193e					
		2325	2496	3461	4438	5410	6384	7358					
4'-0" (48") PRECAST	2029	2646	447b	603b	752e	900d	1047d	1193e					
		1787	1913	2651	3403	4149	4896	5644					
4'-6" (54") PRECAST	1651	2170	4021	603b	752e	900d	1047d	1193e					
		1223	1301	1809	2311	2816	3336	3846					
5'-4" (64") PRECAST	1184	1665	2889	5091	6796	8400	10004	11608					
		1000	1059	1474	1889	2304	2721	3137					
5'-10" (70") PRECAST	972	1459	2464	4144	5408	6672	7936	9200					
		1255	2101	3263	4246	5229	6212	7195					
6'-6" (78") PRECAST	931	1255	2101	3263	4246	5229	6212	7195					
		1025	1675	2385	3194	4003	4812	5621					
7'-6" (90") PRECAST	767	1025	1675	2385	3194	4003	4812	5621					
		632	1049	1469	1889	2309	2729	3149					
9'-4" (112") PRECAST	973	768	1212	1818	2544	3270	4000	4730					
		482	802	1125	1448	1771	2094	2417					
10'-6" (126") PRECAST	456	658	1025	1514	2081	2714	3347	3980					
		598	935	1365	1854	2441	2928	3515					
11'-4" (136") PRECAST	448	545	864	1254	1644	2034	2424	2814					
		427	716	1029	1331	1635	1939	2243					
12'-0" (144") PRECAST	414	485	748	1076	1438	1855	2343	2830					
		381	648	919	1190	1462	1734	2006					
14'-0" (168") PRECAST	338	455	700	1003	1335	1714	2153	2666					
		NR	NR	NR	NR	NR	NR	NR					
14'-8" (176") PRESTRESSED	NR	NR	NR	NR	NR	NR	NR	NR					
		NR	NR	NR	NR	NR	NR	NR					
15'-4" (184") PRESTRESSED	NR	NR	NR	NR	NR	NR	NR	NR					
		NR	NR	NR	NR	NR	NR	NR					
17'-4" (208") PRESTRESSED	NR	NR	NR	NR	NR	NR	NR	NR					
		NR	NR	NR	NR	NR	NR	NR					
19'-4" (232") PRESTRESSED	NR	NR	NR	NR	NR	NR	NR	NR					
		NR	NR	NR	NR	NR	NR	NR					
21'-4" (256") PRESTRESSED	NR	NR	NR	NR	NR	NR	NR	NR					
		NR	NR	NR	NR	NR	NR	NR					
22'-0" (264") PRESTRESSED	NR	NR	NR	NR	NR	NR	NR	NR					
		NR	NR	NR	NR	NR	NR	NR					
24'-0" (288") PRESTRESSED	NR	NR	NR	NR	NR	NR	NR	NR					
		NR	NR	NR	NR	NR	NR	NR					



## 8' PRECAST W/ 2" RECESS DOOR U-LINTELS

LENGTH	TYPE	GRAVITY											
		8RF8-0B	8RF10-0B	8RF12-0B	8RF14-0B	8RF16-0B	8RF18-0B	8RF20-0B	8RF22-0B	8RF24-0B	8RF26-0B	8RF28-0B	8RF30-0B
4'-4" (52") PRECAST	1489	1991	3029	4282	5654	7155	8686	10247					
		1449	2182	2714	3246	3778	4310	4842					
4'-6" (54") PRECAST	1351	1702	2422	3285	4272	5284	6316	7348					
		832	1607	2350	3093	3836	4579	5322					
5'-8" (68") PRECAST	785	1153	1662	2274	2907	3540	4173	4806					
		779	1020	1419	1824	2229	2634	3039					
5'-10" (70") PRECAST	735	1103	1605	2217	2850	3483	4116	4749					
		907	1671	2333	2976	3619	4262	4905					
6'-8" (80") PRECAST	822	1071	1573	2185	2818	3451	4084	4717					
		761	1377	1922	2467	3012	3557	4102					
7'-6" (90") PRECAST	665	764	1371	1926	2481	3036	3591	4146					
		420	834	1253	1672	2091	2510	2929					
9'-8" (116") PRECAST	371	535	928	1491	2119	2747	3375	3993					

## 8' PRECAST & PRESTRESSED U-LINTELS

LENGTH	TYPE	UPLIFT												LATERAL	
		8P8-0T	8P10-0T	8P12-0T	8P14-0T	8P16-0T	8P18-0T	8P20-0T	8P22-0T	8P24-0T	8P26-0T	8P28-0T	8P30-0T	8U8	8F8
2'-10" (34") PRECAST	2721	2878	4101	5322	6543	7764	8985	10206						2021	2021
		2721	2784	3381	3978	4575	5172	5769	6366						
3'-6" (42") PRECAST	2165	2289	3260	4231	5202	6173	7144	8115						1291	1291
		2165	2275	2385	2495	2605	2715	2825	2935						
4'-0" (48") PRECAST	1878	1939	2832	3680	4528	5376	6224	7072						938	938
		1878	1925	2150	2375	2600	2825	3050	3275						
4'-6" (54") PRECAST	1660	1762	2501	3251	4001	4751	5501	6251						721	721
		1660	1709	2435	3111	3787	4463	5139	5815						
5'-4" (64") PRECAST	1393	1484	2110	2741	3372	4003	4634	5265						509	509
		1393	1431	2050	2670	3290	3910	4530	5150						
5'-10" (70") PRECAST	1272	1351	1930	2509	3088	3667	4246	4825						418	418
		1272	1319	1875	2431	2987	3543	4099	4655						
6'-6" (78") PRECAST	1141	1200	1733	2250	2767	3284	3801	4318						707	881
		1141	1182	1664	2146	2628	3110	3592	4074						
7'-6" (90") PRECAST	999	1079	1476	1873	2270	2667	3064	3461						591	651
		999	1029	1466	1907	2348	2789	3230	3671						
9'-4" (112") PRECAST	801	871	1258	1645	2032	2419	2806	3193						454	630
		801	795	1192	1590	1987	2384	2781	3178						
10'-6" (126") PRECAST	716	748	1093	1438	1783	2128	2473	2818						396	493
		716	611	1039	1389	1739	2089	2439	2789						
11'-4" (136") PRECAST	666	698	993	1288	1583	1878	2173	2468						363	556
		666	635	929	1259	1589	1919	2249	2579						
12'-0" (144") PRECAST	607	607	800	993	1186	1379	1572	1765						340	494
		607	486	818	1209	1594	1979	2364	2749						
13'-4" (160") PRECAST	500	500	640	780	920	1060	1200	1340						302	398
		573	409	682	1004	1326	1648	1970	2292						
14'-0" (168") PRECAST	458	458	516	623	730	837	944	1051						286	360
		548	378	629	922	1215	1508	1801	2094						
14'-8" (176") PRESTRESSED	243	NR	NR	NR	NR	NR	NR	NR						NR	351
		NR	NR	NR	NR	NR	NR	NR	NR						
15'-4" (184") PRESTRESSED	228	NR	NR	NR	NR	NR	NR	NR						NR	321
		NR	NR	NR	NR	NR	NR	NR	NR						
17'-4" (208") PRESTRESSED	188	NR	NR	NR	NR	NR	NR	NR						NR	255
		NR	NR	NR	NR	NR	NR	NR	NR						
19'-4" (232") PRESTRESSED	165	NR	NR	NR	NR	NR	NR	NR						NR	204
		NR	NR	NR	NR	NR	NR	NR	NR						
21'-4" (256") PRESTRESSED	145	NR	NR	NR	NR	NR	NR	NR						NR	172
		NR	NR	NR	NR	NR	NR	NR	NR						
22'-0" (264") PRESTRESSED	131	NR	NR	NR	NR	NR	NR	NR						NR	161
		NR	NR	NR	NR	NR	NR	NR	NR						
24'-0" (288") PRESTRESSED	121	NR	NR	NR	NR	NR	NR	NR						NR	135
		NR	NR	NR	NR	NR	NR	NR	NR						

\*REDUCE VALUE BY 25% FOR GRADE 40 FIELD REBAR

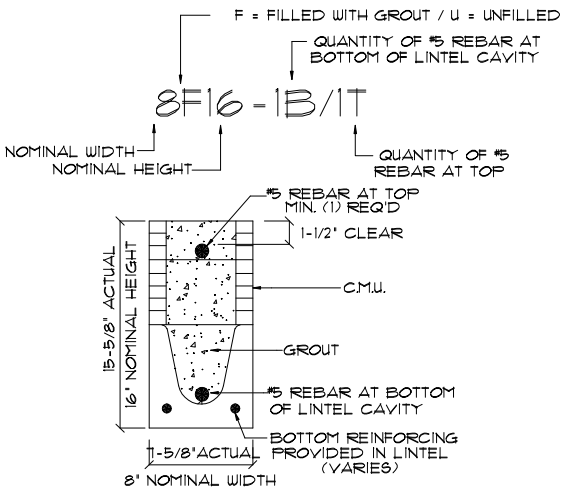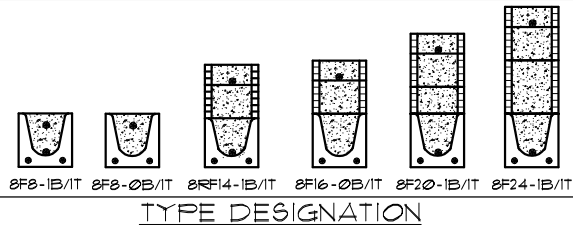

### MATERIALS


1. f'c precast lintels = 3500 psi.
2. f'c prestressed lintels = 6000 psi.
3. f'c grout = 3000 psi w/ maximum 3/8" aggregate.
4. Concrete masonry units (CMU) per ASTM C90 w/ minimum net area compressive strength = 1900 psi.
5. Rebar provided in precast lintel per ASTM A615 GR60. Field rebar per ASTM A615 GR40 or GR60.
6. Prestressing strand per ASTM A416 grade 270 low relaxation.
7. T/32 wire per ASTM A510.
8. Mortar per ASTM C270 type M or S.

### GENERAL NOTES


1. Provide full mortar head and bed joints.
2. Shore filled lintels as required.
3. Installation of lintel must comply with the architectural and/or structural drawings.
4. Lintels are manufactured with 5-1/2' long notches at the ends to accommodate vertical cell reinforcing and grouting.
5. All lintels meet or exceed L/360 vertical deflection, except lintels 17'-4" and longer with a nominal height of 8' meet or exceed L/180.
6. Bottom field added rebar to be located at the bottom of the lintel cavity.
7. T/32" diameter wire stirrups are welded to the bottom steel for mechanical anchorage.
8. Cast-in-place concrete may be provided in composite lintel in lieu of concrete masonry units.
9. Safe load ratings based on rational design analysis per ACI 318 and ACI 530.

### SAFE LOAD TABLE NOTES


1. All values based on minimum 4' bearing. Exception: Safe loads for unfilled lintels must be reduced by 20% if bearing length is less than 6'-1/2". Safe loads for all recessed lintels based on 8' nominal bearing.
2. N.R. = Not Rated.
3. Safe loads are total superimposed allowable load on the section specified.
4. Safe loads based on grade 40 or grade 60 field rebar.
5. Additional lateral load capacity can be obtained by the designer by

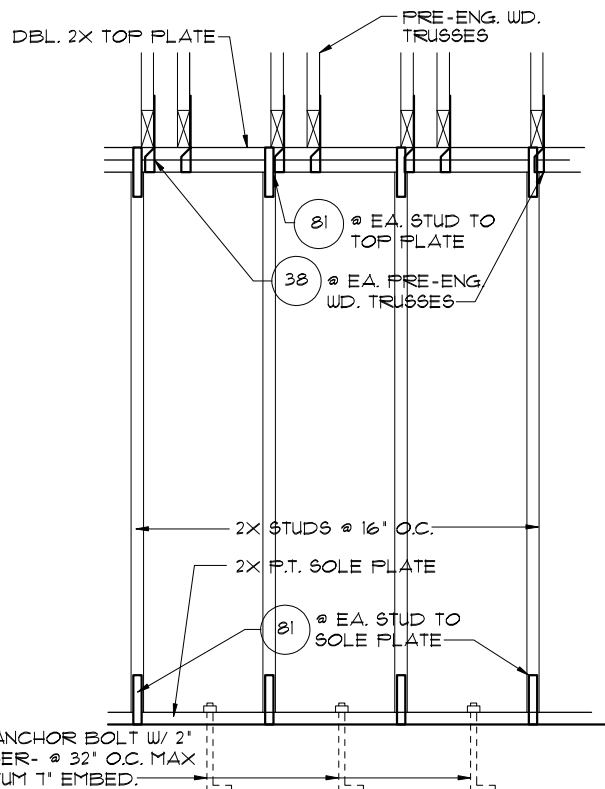


**4 DETAIL (BRG. W/ UPLIFT)**  
 1/2" Ø ANCHOR BOLT W/ 2" WASHER - @ 32" O.C. MAX. MINIMUM 1" EMBED.  
 81 @ EA. STUD TO TOP PLATE  
 38 @ EA. PRE-ENG. WD. TRUSSES  
 2X STUDS @ 16" O.C.  
 2X P.T. SOLE PLATE  
 81 @ EA. STUD TO SOLE PLATE

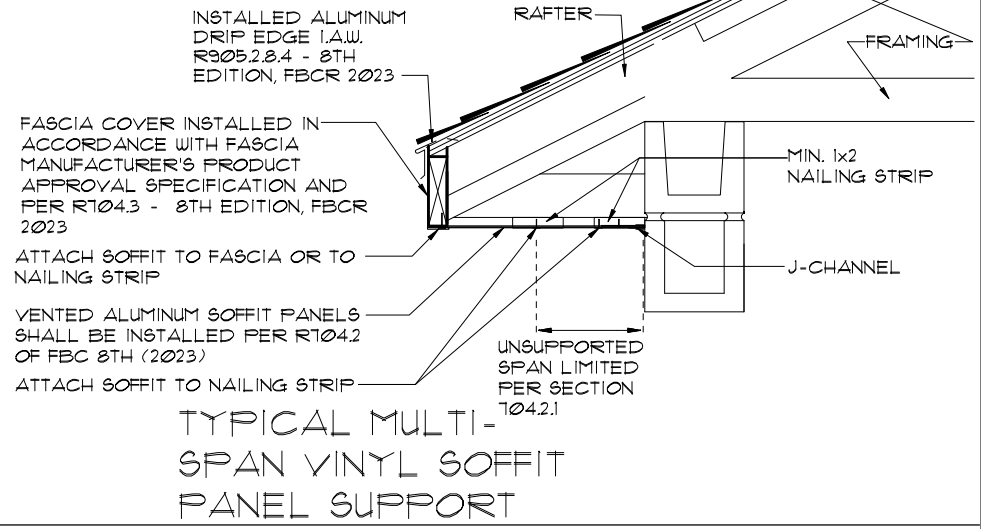


**TYPICAL MULTI-SPAN VINYL SOFFIT PANEL SUPPORT**

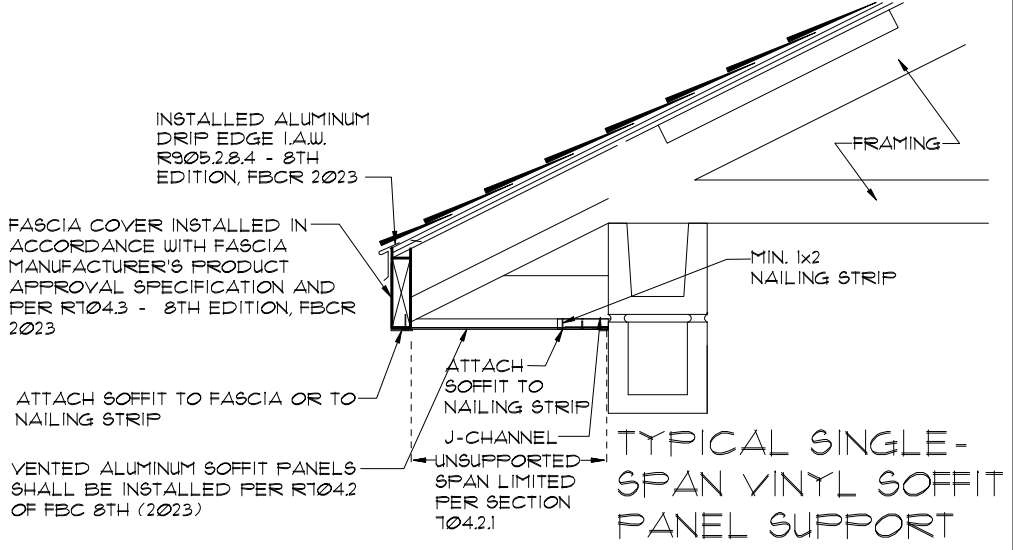


**TYPICAL SINGLE-SPAN VINYL SOFFIT PANEL SUPPORT**

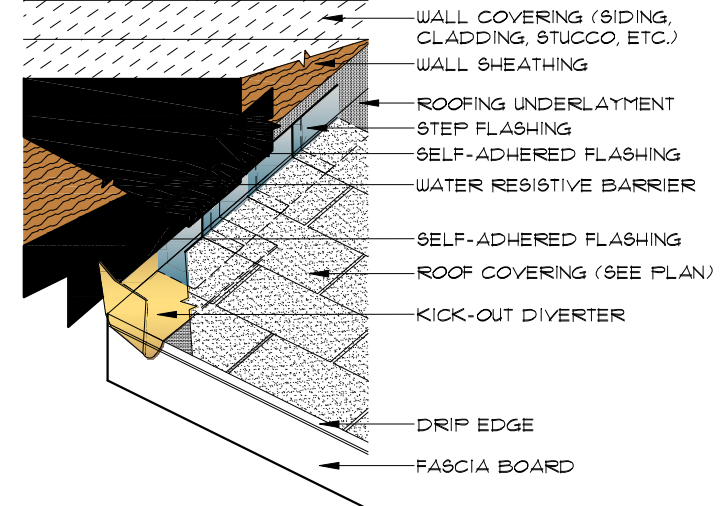

**2 KICK-OUT FLASHING**  
 N.T.S.

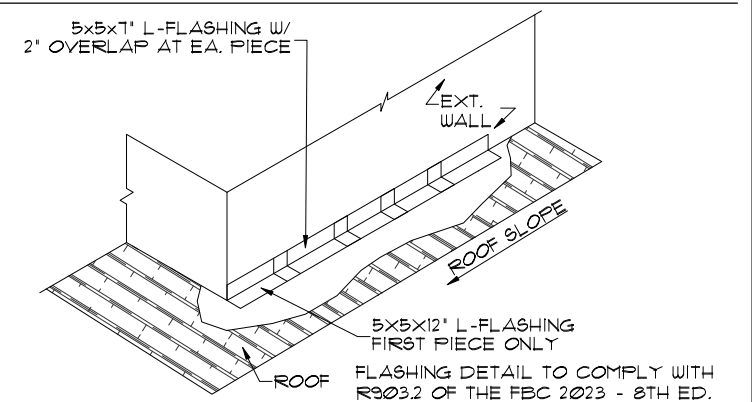

**1 STEP WALL FLASHING**  
 N.T.S.

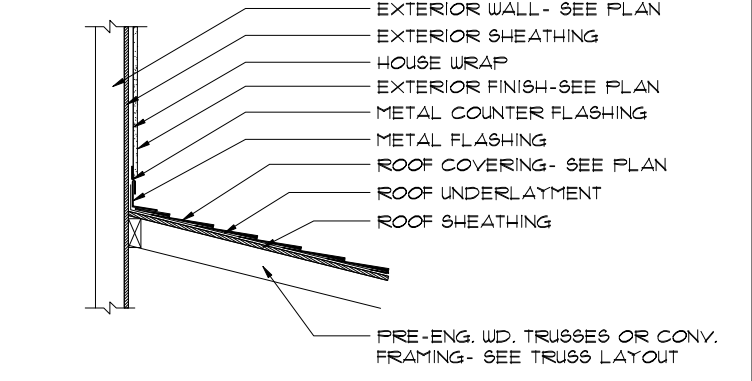

**3 HEAD WALL FLASHING**  
 N.T.S.

**CONNECTOR SCHEDULE**

CONNECT. TYPE	SIMPSON		USP		MAX. UPLIFT	LAT. LDS. FI / F2
	DESCRIPTION	FASTENERS PER CONNECTOR	DESCRIPTION	FASTENERS PER CONNECTOR		
4	HETA20	14-10d x 1 1/2"	ETA20	14-10d	1,810	65 / 960
5	DETAL20	18-10d x 1 1/2"	N/A	N/A	2,480	2000 / 1370
20	H3	RFT: 4-8d / PLT: 4-8d	RT3	RFT: 4-8d / PLT: 4-8d	455	125 / 160
21	HI	RFT: 6-8dx1 1/2" / PLT: 4-8d	RT15	RFT: 5-8dx1 1/2" / PLT: 5-8d	475	485 / 165
22	HI0A	RFT: (9)10d x 1 1/2" PLT: (9)10d x 1 1/2"	RT16	RFT: 8-8d x 1 1/2" PLT: 8-8d	990	585 / 525
23	LUS26	HDR: 4-10d / JST: 4-10d RFT / TRS: (4)8d	JUS26	HDR: 4-10d / JST: 4-10d	935	N/A
24	HTZ	PLT / STD: (2)8dx 1 1/2" (8)8d	RT20	RFT / TRS: 9-10d PLT / STD: 13-10d	985	400 / N/A
26	H25A	RFT: 5-8d / PLT: 5-8d	RT1	RFT: 5-8d / PLT: 5-8d	415	150 / 150
34	A34	H: 4-8dx1 1/2" / P: 4-8dx1 1/2"	MP34	H: 4-8dx1 1/2" / P: 4-8dx1 1/2"	365	280 / 303
35	A35F	H: 4-8dx1 1/2" / P: 4-8dx1 1/2"	MFAIF	H: 6-8dx1 1/2" / P: 6-8dx1 1/2"	440	440 / N/A
37	MTS12	14-10d	MTW12	14-10d	1,000	N/A
38	MTS16	14-10d	MTW16	14-10d	1,000	N/A
43	LSTA12	10-10d	LSTA12	10-10d	905	N/A
45	ST18	14-16d	ST18	14-16d	1,200	N/A
47	LSTA24	18-10d	LSTA24	18-10d	1,295	N/A
71	MSTA36	26-10d	MSTA36	26-10d	2,135	N/A
72	MSTC66	64-16d SINKERS	N/A	N/A	5,495	N/A
79	SF1	STD: 6-10d / PLT: 4-10d	SPT22	STD: 4-10d / PLT: 4-10d	535	560 / 260
80	SF2	STD: 6-10d / PLT: 6-10d	SPT224	STD: 6-10d / PLT: 6-10d	605	560 / 260
81	SPH4,6,8	12-10d x 1 1/2"	TP4,6,8	12-10d x 1 1/2"	885	N/A
90	ABU66	12-16d	PAU66	12-16d	2,240	N/A
93	CB66	(2) 3/8" BOLTS	PA8X8	4-10d	2,300	985
92	ABU44	12-16d	PAU44	12-16d	2,200	N/A
93	AC6 (MAX)	28-16d	PBS66	24-16d	1,815	1,070
94	AC4 (MAX)	28-16d	PBS44	24-16d	1,815	1,070
95	HTS20	20-10d	HTW20	20-10d	1,450	N/A
96	HD8A	SILL: 1/8" BOLT STUD: (3) 3/8" x 5 1/2" BOLTS	HHD8A	SILL: 1/8" BOLT STUD: (3) 3/8" x 5 1/2" BOLTS	7,910	N/A
99	A35	H: 4-8dx1 1/2" / P: 4-8dx1 1/2"	MFAI	H: 6-8dx1 1/2" / P: 6-8dx1 1/2"	440	440 / N/A
98-101	HTT4	3/8" BOLT / 18-16dx2 1/2"	N/A	N/A	3,640	N/A
97-100-102	HTT5	3/8" BOLT / 26-10d	N/A	N/A	4,275	N/A
103	VGTR/L	32-SDS 1/4" x 3" / (2) 3/8" BLT	N/A	N/A	3,990	N/A
104	HDU8-SDS2.5	7/8" BLT / 20-SDS 1/4" x 2 1/2"	N/A	N/A	5,020	N/A
110	HCF2	12-10d x 1 1/2"	HHCF2	20-10d x 1 1/2"	520	260 / N/A
167	HHUS46	H: 14-16d / J: 6-16d	THD46	H: 8-16d / J: 12-10d	1,550	N/A
168	U46	H: 8-10d / J: 4-10d	SUH46	H: 8-16d / J: 4-16d	710	N/A
181	HUS26	20-16d	THD26	H: 20-16d / J: 10-10d	1,550	N/A
184	HHUS28-2	G: 28-16d / T: 8-16d	EHUH28-2	12-16d	2,000	N/A
214	HUC212-3TF	HD: 16-3/16" x 1 1/2" TAPCON BM: 6-16d	HDO212-3	HD: 18-3/16" x 1 1/2" TAPCON BM: 6-10d	1,135	N/A
215	HGUS210-2	HDR: 46-16d / JST: 10-16d	EHUH210-2	HDR: 40-16d / JST: 16-10d	2,720	N/A
216	HUS412	BLOCK: 10-1/4" x 1 1/2" TC JOIST: 10-16d	HUS412	BLOCK: 10-1/4" x 1 1/2" TC JOIST: 10-16d	3,240	N/A
217	HUS212-2	BLOCK: 10-1/4" x 1 1/2" TC JOIST: 10-16d	HUS212-2	BLOCK: 10-1/4" x 1 1/2" TC JOIST: 10-16d	2,630	N/A
219	MBHA412	H: 1-ATR 3/4 x 8 TOP FACE JOIST: 18-10d	NFM35X12U	H: 1-1/2" J-BOLT J: 5-1/2" BOLTS	3,145	N/A
220	N/A	N/A	NFM 3X12	BLK: 1/2" Ø J / JST: 14-10d	1,620	N/A
226	MBHA4.15/12	HDR: (2) 3/4" Ø x 8" JOIST: 18-10d	NFM45U	HDR: MIN. 1/2" Ø 'J' BOLT JOIST: (5) 1/2" Ø BOLTS	2,160	N/A
231	MBHA3.56/16	HDR: (2) 3/4" Ø x 8" JOIST: 18-10d	NFM35X16U	HDR: MIN. 1/2" Ø x J-BOLTS JOIST: (5) 1/2" Ø BOLTS	3,450	N/A
232	MBHA5.50/16	HDR: (2) 3/4" Ø x 8" JOIST: 18-10d	NFM55X16U	HDR: MIN. 1/2" Ø x J-BOLTS JOIST: (5) 1/2" Ø BOLTS	3,450	N/A
240	HI5	R: 4-10dx1 1/2" / P: 4-10dx1 1/2"	N/A	N/A	1,300	480 / N/A
241	LGT2	30-16d-sinker	LUGT2	32-10d	2,000	1015 / 440
301	MGT	(1) 3/4" BLTS / GIR: 22-10d	N/A	N/A	3,965	N/A
302	HGT-2 or 3	LTL: 3/4" BLTS / GIR: 8-10d	USC63	LTL: 3/4" BLTS / GIR: 8-16d	6,485	N/A
303	HGT-4	LTL: 3/4" BLTS / GIR: 16-10d	N/A	N/A	9,250	N/A
401	SUR/L414	FACE: 18-16d / JST: 8-16d	N/A	N/A	1,700	N/A
T	CONNECTORS TO BE SPECIFIED AND PROVIDED BY TRUSS MANUFACTURERS					

LOT: 0000, COMMUNITY NAME  
 THIS STRUCTURE IS DESIGNED TO WITHSTAND 140 MPH WINDS PER THE 8TH EDITION, 2023 OF THE FLORIDA BUILDING CODE RESIDENTIAL, AND IS CERTIFIED AS SUCH  
 FLORIDA SERIES  
 A DIVISION OF PARK SQUARE ENTERPRISES, INC.  
 5200 Vineland Road, Suite 200  
 Orlando, Florida, 32811  
 Phone: (407) 529-3000  
 www.park-square.com

REVISIONS BY  
 05-16-19 JF  
**ITEG**  
 ITRUSS ENGINEERING GROUP, INC.  
 10000 W. US HWY 90, SUITE 100  
 FORT MYERS, FL 33907  
 (813) 939-1100  
 www.iteg.com

DETAILS/ CONNECTOR SCHEDULE  
 1966  
 MARGATE II  
 DATE 04-05-2017  
 SCALE AS NOTED  
 DRAWN RDC  
 JOB N/A  
 SHEET 11 OF 20 SHEETS